




CODE REVIEW SUMMARY (2024 IBC CHAPTERS 3-6)

NEW CONSTRUCTION	PROPOSED OCCUPANCIES	CONSTRUCTION TYPE	ALLOWABLE BUILDING HEIGHT		ALLOWABLE STORIES ABOVE GRADE PLANE		ALLOWABLE AREA (PER FLOOR)		SEPARATION OF OCCUPANCIES	SEPERATION REQUIRED	SPRINKLER REQUIRED
			ALLOWED	PROPOSED/ EXISTING	ALLOWED	PROPOSED	ALLOWED*	PROPOSED/ EXISTING			
YES	BUSINESS B AND STORAGE S1 AND RESIDENTIAL R2	III-B	55'	APPROX. 37'	2	2	16,000 SQFT.	3,000 SQFT.	S1/B TO R2	1 HR	NFPA13R

NOTE: MOST RESTRICTIVE OF COMBINED LIMITATIONS SHOWN

AUTO SERVICE ELEVATED

AFFITTAMI LLC

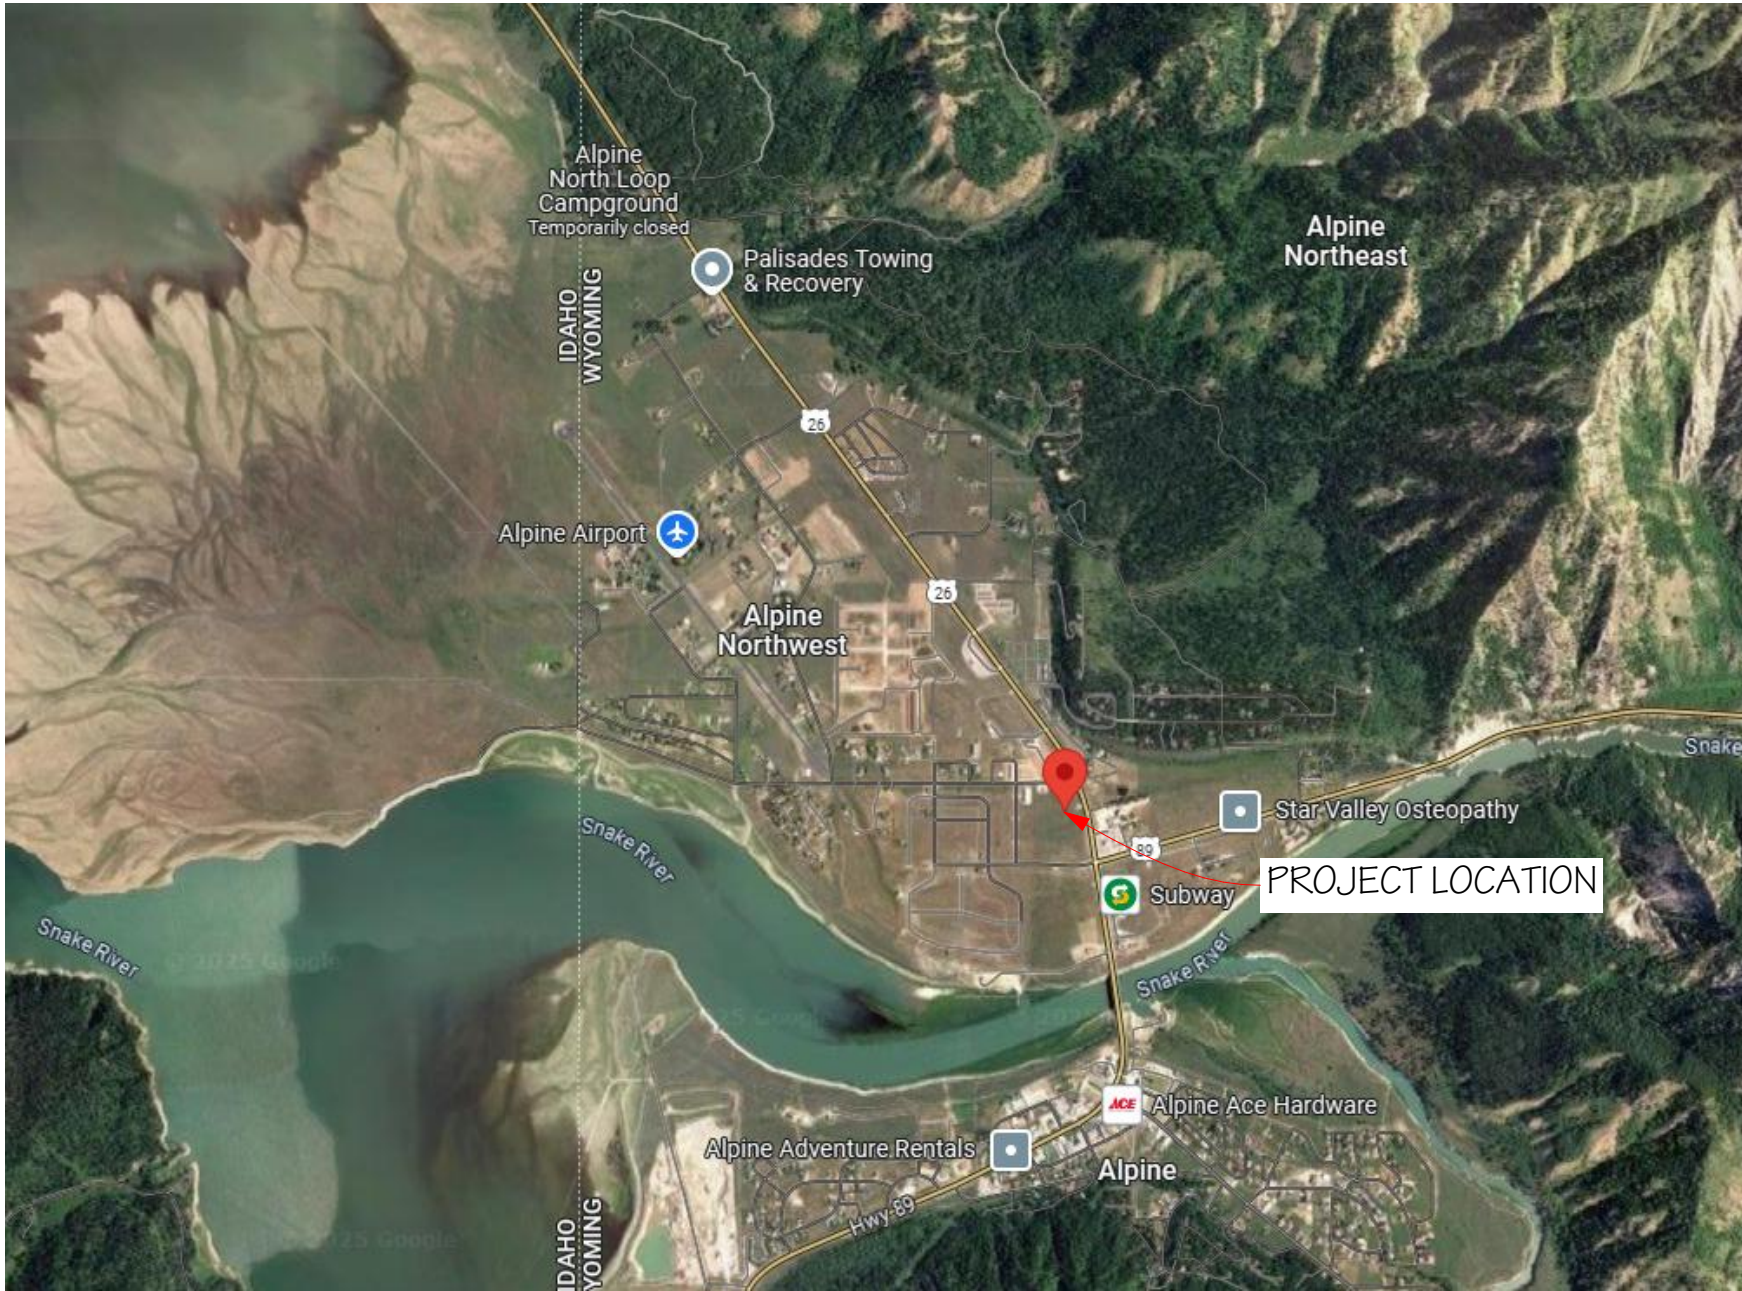

VICINITY MAP
NOT TO SCALE

43.174119, -111.020047

FINISHED SQUARE FOOTAGE	
ID	AREA
MAIN LEVEL SHOP/ OFFICE	2,994
TENANT AREA 1	1,092
TENANT AREA 2	813
TENANT AREA 3	1,096
	5,995 ft ²

UNFINISHED SQUARE FOOTAGE	
ID	AREA
EXTERIOR BALCONY	268
STORAGE LOFT OVER STORAGE	144
STORAGE LOFT OVER OFFICE	433
	845 ft ²

LOCATION:	ALPINE, WYOMING
ROOF SNOW:	96 PSF
GROUND SNOW:	137 PSF
WIND SPEED:	115 MPH
EXPOSURE:	C
FROST DEPTH:	36
SEISMIC:	D
Ss	1.09
S1	0.3
SDS	0.88
SD1	0.51
REGULATION:	IBC 2024

INDEX OF SHEETS

G-101	COVER SHEET
G-102	COMMERCIAL CODE SUMMARY
G-103	LIFE SAFETY - ADA MANEUVERING CLEARANCES
G-104	LIFE SAFETY - MAIN LEVEL OCCUPANCY
G-105	LIFE SAFETY -UPPER LEVEL OCCUPANCY
G-106	LIFE SAFETY - MAIN LEVEL EGRESS
G-107	LIFE SAFETY - UPPER LEVEL EGRESS
G-108	LIFE SAFETY - FIRE KEY
G-109	LIFE SAFETY - FIRE DETAIL
C-101	SITE PLAN
C-102	RECORDED SURVEY
C-103	SITE CONTOURS
C-104	SITE STORMWATER
A-101	MAIN LEVEL
A-102	SECOND LEVEL
A-201	ELEVATIONS
A-202	ELEVATIONS
A-301	SECTIONS
A-302	SECTIONS
S-101	FOUNDATION
S-201	STORAGE LOFT FRAMING
S-301	WALL FRAMING
M0.0	MECHANICAL COVER SHEET

INDEX OF SHEETS

M0.1	MECHANICAL SCHEDULES
M0.2	MECHANICAL SPECIFICATIONS
M1.1	MECHANICAL PLAN - LEVEL 1
M1.2	MECHANICAL PLAN - LEVEL 2
M5.0	MECHANICAL DETAILS
P0.0	PLUMBING COVER SHEET
P0.1	PLUMBING SCHEDULES
P0.2	PLUMBING SPECIFICATIONS
P1.1	WASTE AND VENT PLAN - LEVEL 1
P1.2	WASTE AND VENT PLAN - LEVEL 2
P2.1	WATER AND GAS PLAN - LEVEL 1
P2.2	WATER AND GAS PLAN - LEVEL 2
P5.0	PLUMBING DETAILS AND DIAGRAMS
E00	ELECTRICAL SYMBOLS AND ABBREV.
E01	RISER, SCHED., LOAD CALCS, DETAILS
E02	LIGHTING AND PANEL SCHEDULES
E03	ENERGY COMPLIANCE FORMS
E11	LIGHTING PLAN LEVEL 1
E12	LIGHTING PLAN LEVEL 2
E21	POWER PLAN LEVEL 1
E22	POWER PLAN LEVEL 2
E31	MECHANICAL POWER PLAN LEVEL 1
E32	MECHANICAL POWER PLAN LEVEL 2

ENGINEER: RICHARD D SEAMONS	###
EIT:	###
DRAWN BY: BW	###
CHKD BY: ###	###
PLOT DATE: 5/16/2025	

AFFITTAMI LLC - KATHERINE KRESAN - AUTO SERVICE ELEVATED	PARCEL NO: 37182030004500
ELK MEADOWS ADDITION LOT: 3	

South Fork Design Group, LLC
127 E. Main St, Suite 111
Rexburg, ID 83440
www.southforkdesign.com
208-852-6236
Copyright 2025 | South Fork Design | All Rights Reserved.

SOUTH FORK
DESIGN

Professional Engineer
RICHARD D. SEAMONS
13700
WYOMING

THESE PLANS ARE STAMPED
ENGINEERED FOR THE
LOCATION SPECIFIED. IF
LOCATION CHANGES
REENGINEERING IS REQUIRED.

COVER SHEET	
REVISION DATE	DESCRIPTION

CODE STUDY: AUTO SERVICE ELEVATED ALPINE

PROJECT: AUTO SERVICE ELEVATED ALPINE

LOCATION: ALPINE, WYOMING

CODE STUDY BY: BLAKE WALKER SOUTH FORK DESIGN

Basic Building Description

- Construction Type:** IIIB
- Sprinkler System:** NFPA 13R installed (IBC 903.3.1.2)
- Area/Height Approach:** Uses separated by fire barriers; allowable area based on sum of ratios (IBC 508.4.2); height checked for each area (IBC 508.4.3).

Address Identification (IBC 502.1)

- Approved address identification required, visible from the street.
- Characters:** Arabic numbers or letters, minimum 4 inches high, 0.5 inch wide.
- Contrast:** Installed on a contrasting background.
- Visibility:** If not visible from the public way due to private road access, a monument, pole, or other approved sign is required.
- Additional locations may be required by the fire official.

Site Description & Frontage Calculation (IBC 506.3.2, 202)

Side	Boundary	Distance to Boundary (ft)	Length of Perimeter (ft)	Accessible (Street/Fire Lane)?
North	Lot Line	41.0	60.0	Yes
East	Lot Line	47.0	50.0	No
South	Lot Line	25.0	60.0	No
West	Lot Line	53.0	50.0	No
Total Perimeter:			220.0	

- Perimeter Fronting Public Way/Accessible Space:** 60.0 ft
- Basis for Frontage Increase:** Smallest open space >= 20 ft is 41.0 ft (North side).
- Percent of Perimeter with >= 20 ft Open Space:** (60.0 / 220.0) = 27.3%
- Allowable Area Increase due to Frontage:** 25.00% (IBC 506.3.3)

Building Height & Area Summary

Height (IBC 504.3, Table 504.3)

Parameter	Value	Status
Actual Height	37.17 ft	
Allowed Height	55.00 ft	OK (Actual height is within allowed)

Overall Area (IBC 502.1, 506)

Parameter	Value	Notes
Total Building Area	6,000.0 sq.ft	
Building Allowed Area	40,000.0 sq.ft	Includes 25% frontage increase (IBC 506.3)
Building Area Ratio	0.14	(5514 / 40000) - OK

- Allowable area calculations based on Tables 504.3, 504.4, 506.2 and Section 506.
- Allowable stories based on Table 504.4 and Section 504.
- Uses separated by fire barriers (IBC 508.4); max floor area per use based on Table 504.4.

Building Interior Analysis

2nd Floor Areas

Area	Occ. Group	Actual Area (sq.ft)	Allowable Area (sq.ft)	Area Ratio	Occupant Load	Min. Egress Req.	Exits Provided	Exit Status	Min. Width (in)	Width Provided (in)	Width on Path (in)	Comm. Path (ft)	Max. Travel (ft)	Actual Travel (ft)	Travel Status	Corridor?
Apartm ent 1	R2	1,023.00	20,000.00	0.05	5.1 (1)	1	1		1.02 (3)	1.02 (3)	36.0 (4)	115.00 (5)	200.00 (4)	115.00 (5)	OK	No
Apartm ent 2	R2	769.00	20,000.00	0.04	3.8 (1)	1	1		1.02 (3)	0.77 (5)	36.0 (4)	114.00 (5)	200.00 (4)	114.00 (5)	OK	No
Apartm ent 3	R2	1,023.00	20,000.00	0.05	5.1 (1)	1	1		1.02 (3)	1.02 (3)	36.0 (4)	123.00 (5)	200.00 (4)	123.00 (5)	OK	No
2nd Floor Total	-	2,815.00	20,000.00	0.14	14.1	3	3	OK	2.84 (6)	108.00 (6)	108.00 (6)	123.00 (5)	200.00 (5)	123.00 (5)	OK	No

Notes for 2nd Floor Table: (1) Based on 200.0 sq.ft/occupant (IBC T 1004.5) (2) Based on IBC 1006.2.1 & Table 1006.2.1 (3) Based on IBC 1005.3.2 (Other egress components) (4) Common path of egress travel ok per IBC 1006.2.1 (5) Max exit access travel distance per IBC Table 1017.2 (6) Min Door Width = 2.8 in (1005.3.2), Min Stair Width = 4.2 in (1005.3.1)

- Egress Doors:** Pivoted/side-hinged swinging type required (IBC 1010.1.2). May swing either direction within dwelling units (IBC 1010.1.2.1, Ex 4). Manually operated horizontal sliding doors allowed for occupant load <= 10 (Ex 9).
- Exit Signs:** Required for exits/exit access doors (IBC 1013.1).

1st Floor Areas

Area	Occ. Group	Actual Area (sq.ft)	Allowable Area (sq.ft)	Area Ratio	Occupant Load	Min. Egress Req.	Exits Provided	Exit Status	Min. Width (in)	Width Provided (in)	Width on Path (in)	Comm. Path (ft)	Max. Travel (ft)	Actual Travel (ft)	Travel Status	Corridor?
Office B		324.00	23,750.00	0.01	2.2 (7)	1 (8)	1	OK	0.43 (3)	36.00 (3)	10.00 (4)	200.00 (5)	32.00 (4)	32.00 (5)	OK	No
Shop SI		2,278.00	21,875.00	0.10	39.6 (9)	2 (2)	2	OK	7.92 (3)	72.00 (3)	114.00 (4)	200.00 (5)	114.00 (4)	0 (5)	OK	No
Storage SI		97.00	21,875.00	0.00	1.0 (10)	1 (8)	2	OK	0.20 (3)	72.00 (3)	16.50 (4)	200.00 (5)	38.00 (4)	38.00 (5)	OK	No
1st Floor - Total	-	2,699.00	22,084.00	0.12	42.8	2 (12)	3	OK	8.6 (3)	108.00 (3)	16.50 (4)	200.00 (5)	75.50 (4)	75.50 (5)	OK	No

Notes for 1st Floor Table: (3) Based on IBC 1005.3.2 (Other egress components) (4) Common path of egress travel ok per IBC 1006.2.1 (5) Max exit access travel distance per IBC Table 1017.2 (7) Based on 150.0 sq.ft/occupant (IBC T 1004.5) (8) Based on IBC 1006.2 (9) Based on 57.5 sq.ft/occupant (IBC T 1004.5) (10) Based on 300.0 sq.ft/occupant (IBC T 1004.5) (11) Floor allowed area calculation per IBC 506. (12) Based on IBC 1006.3.3

- Egress Doors:** Pivoted/side-hinged swinging type required (IBC 1010.1.2). May swing either direction (IBC 1010.1.2.1). Manually operated horizontal sliding doors allowed for occupant load <= 10 (Ex 9).
- Exit Signs:** Not required for Office or Storage (IBC 1013.1). Required for Shop (IBC 1013.1). Not required for overall floor egress path (IBC 1013.1).

Egress Details & Requirements

(Note: Code references are from 2021 IBC unless noted otherwise)

Exit Width (1005)

- Calculation basis depends on component (Stairs: 1005.3.1; Other: 1005.3.2).
- Loss of one means of egress cannot reduce capacity by > 50% (1005.5).
- Minimum door width per 1010.1.1.

Egress Continuity & Separation

- Path of egress shall not be interrupted (1003.6).
- Where 2 exits required, minimum separation is 1/2 diagonal of area (measured straight line), with exceptions (1007.1.1).

Illumination (1008.2)

- Means of egress illuminated when space occupied (Exemption: Dwelling/sleeping units).
- Minimum 1 foot-candle at walking surface.
- Illumination required along exit discharge path to public way.
- Emergency power requirements per 1008.3.

Doors (1010)

- Type:** Pivoted or side-hinged swinging required (1010.1.2).
 - Exceptions: Dwelling units (Ex 4), Occupant Load <= 10 (Manual sliding - Ex 9), Revolving (Ex 5), Compliant Horizontal Sliding (Ex 6), Power-operated (Ex 7).
- Swing Direction:** Generally towards egress travel for Occupant Load >= 50, or in Group H. May swing either way in dwelling units (1010.1.2.1).
- Landings:** Required on each side of door, same elevation (within 1/2" threshold difference) (1010.1.4, 1010.1.6). Width >= door/stair width. Length min 44" in direction of travel if load >= 50 (1010.1.5). Space between doors in series: 48" + swing width (1010.1.7).
- Additional Doors:** Must comply with Section 1010 if provided for egress (1010.1).

Locks & Latches (1010.2)

- General:** Readily openable from egress side without key/special knowledge/effort (1010.2). Single motion to unlatch (1010.2.1).
- Prohibited:** Manual flush/surface bolts (1010.2.5), except inactive leaf of pair in storage/equipment room (Ex 2) or doors not required for egress in dwelling units (Ex 1).
- Permitted in Dwelling/Sleeping Units (Load <= 10):** Night latch, deadbolt, security chain if openable from inside without key/tool (1010.2.4 #5, 1010.2.5 Ex 1).
- Closets:** Must be openable from inside if they latch (1010.2.6).
- Permitted Locking (where operation prevented):** Includes automatic flush bolts on pairs (inactive leaf has no knob/hardware) (1010.2.4 #4), fire doors after temp disables unlatching (1010.2.4 #6), roof access doors (1010.2.4 #7), certain court doors (1010.2.4 #8), dwelling/sleeping unit balconies/decks (1010.2.4 #9), small private office balconies/decks (1010.2.4 #10).

Stairways (1011)

Feature	Within Dwelling Units	Other Stairways	Code Ref (Other)
Min. Width	N/A	44 inches (36" if Occ Load < 50; 48" clear if accessible egress route)	1011.2, 1009.3.2
Max Riser Height	N/A	7 inches	1011.5.2
Min Riser Height	N/A	4 inches	1011.5.2
Min Tread Depth	N/A	11 inches	1011.5.2
Riser Type	May be open	Solid Required	1011.5.5.3
Max Variation	N/A	3/8 inch (per flight)	1011.5.4
Handrails	N/A	Both sides required	1011.11
Handrail Height	N/A	34-38 inches	1014.2
Handrail Grip	N/A	Type I: 1.25"-2" dia circ, or equiv. grasp	1014.3.1
Handrail Continuity	N/A	Continuous, no obstructions; Return/extend	1014.4, 1014.6
Headroom	N/A	80 inches min	1011.3
Under Stair Space	N/A	N/A	1011.7.3
Landings	N/A	Top & Bottom req'd; Dim=Width (48" max if straight run)	1011.6
Max Rise/Flight	N/A	12 feet	1011.8

Guards (1015, 1607.9)

- Required:** Open sides of walking surfaces > 30" above floor/grade (1015.2).
- Min Height:** 42 inches (Exceptions: 36" within dwelling units (Ex 1); 34-38" if top rail is stair handrail within dwelling unit (Ex 2)).
- Strength:** Resist 50 plf top load, 200 lb concentrated load. Intermediate rails resist 50 psf over 1 sq.ft. (1607.9, ASCE 7.4.5.1).
- Openings:** Block passage of 4" sphere (Exceptions: 4 3/8" sphere allowed between 36-42" height (Ex 1); 6" triangle at riser/tread/guard (Ex 2); 4 3/8" sphere on stair sides within dwelling units (Ex 6); 21" sphere in certain non-public areas (Ex 4)).

Emergency Escape and Rescue Openings (1031)

- Required:** Group R-2 occupancies in stories with only one exit (where permitted by T1006.3.4(1)&(2)) (1031.2 #1).
- Location:** Open directly to public way or yard/court opening to public way (1031.2).
- Size:** Min 5.7 sq.ft clear area (5.0 sq.ft at grade floor); Min 24" clear height; Min 20" clear width (1031.3).
- Height:** Bottom of opening max 44" above floor (1031.3.3).
- Operation:** Operational from inside without keys/tools, including bars/grilles (1031.2.1).

Accessibility (IBC Chapter 11, ICC A117.1-2009)

General

- Entrances:** At least 60% of public entrances accessible (1105.1). At least one accessible entrance to each tenant/dwelling/sleeping unit (1105.1.7).
- Parking:** Accessible spaces per Table 1106.1 required if parking provided (1106.1). Additional rules for outpatient/rehab facilities (1106.3, 1106.4).
- Route:** At least one accessible route connecting accessible levels (1104.4). Must coincide with general circulation path (1104.5).
- Drinking Fountains:** Where provided, >=2 required: one for wheelchair users (<=36" spout height), one for standing persons (38-43" spout height), unless single unit meets both (1109.5.1). If >2 provided, >=50% accessible (1109.5.2). Spout location reqs (A117.1 602.5), min 4" flow height (A117.1 602.6).

Toilet Facilities (A117.1)

- Turning Space:** 67" diameter or T-shaped space required (603.2.1, 304.3). Doors cannot swing into fixture clear floor space (exception for single use) (603.2.2).
- Water Closet:** 16-18" centerline from adjacent side wall/partition (604.2). Seat height 17-19" (604.4).
 - Clearance (No Compartment): 60" min perpendicular to side wall, 56" min perpendicular to rear wall (604.3.1).
 - Compartment: 60" wide min; 56" deep min (wall hung) or 59" deep min (floor mount) (604.9.2.1).
- Grab Bars:** 1.25-2" diameter, 1.5" space from wall (609.2, 609.3). Mounted 33-36" high (609.4). Side bar: 42" min length, start <=12" from rear wall, extend to 54" from rear wall (604.5.1). Rear bar: 24" min length (36" preferred), centered on WC (604.5.2).
- Urinals:** Stall type or wall hung, rim <= 17" high (605.2).
- Lavatories:** Rim <= 34" high (606.3). Pipes insulated/protected (606.6).
- Sinks:** <= 11" deep (606.5).
- Mirrors:** Bottom edge <= 40" above floor if over lav/sink/counter (603.3).

Additional Toilet Requirements (IBC 2902)

- Public facilities required for public utilization areas. Route cannot pass through kitchens/storage (2902.3, 2902.3.1).
- Cannot open directly into food prep areas (2902.3.2).
- Max travel distance 500 ft (2902.3.3). Directional signage required (2902.4.1).
- Multi-occupant room egress doors not lockable from inside (exception: family/assisted use) (2902.3.6).
- Separate facilities per sex generally required (exceptions for low occupant loads in specific occupancies, dwelling units, single-user rooms) (2902.2).
- Fixture location/partitions per IBC 2903.

Fire Resistance & Separation

Exterior Walls (IBC 705, Tables 601, 705.5, 705.8)

Side	Occ. Grp	Fire Sep. Wall Rating (hr)	Bearing Wall Rating (hr)	Non-Bearing Wall Rating (hr) (Inside Face)	Parapet Req'd? (705.11)	Max Unprotected Openings (%)	Max Protected Openings (%)	Projections Limit (to FSD line)	Combustible Projections Limit (within 5 ft of FSD line)
North S1, B	R2, S1, B	41.0	2	0	Bearing: Yes; Non-Br: No (Ex 1)	No Limit	No Limit	Cannot extend closer than 40" (T705.2)	Must be noncombustible, 1-hr rated, T&HT, or FRT Wood (T05.2.3)
East S1, B	R2, S1, B	47.0	2	0	Bearing: Yes; Non-Br: No (Ex 1)	No Limit	No Limit	Cannot extend closer than 40" (T705.2)	Must be noncombustible, 1-hr rated, T&HT, or FRT Wood (T05.2.3)
South S1, B	R2, S1, B	25.0	2	0	Yes (or roof protection) (Ex 4)	70%	No Limit	Cannot extend closer than 40" (T705.2)	Must be noncombustible, 1-hr rated, T&HT, or FRT Wood (T05.2.3)
West S1, B	R2, S1, B	53.0	2	0	Bearing: Yes; Non-Br: No (Ex 1)	No Limit	No Limit	Cannot extend closer than 40" (T705.2)	Must be noncombustible, 1-hr rated, T&HT, or FRT Wood (T05.2.3)

Building Element Fire Resistance (Construction Type IIIB - Table 601)

Building Element	Min. Fire-Resistance Rating (Hours)	Material Notes
Exterior Walls	See Exterior Walls table above	-
Primary Structural Frame	0	Any material
Interior Bearing Walls	0	Any material
Interior Nonbearing Walls	0	Any material
Floor/Ceiling Assembly	0	Any material
Roof/Ceiling Assembly	0	Any material
Shaft Enclosure	1	Any material
Stairs	0	Any material

Occupancy Separation (IBC 508.4, Table 508.4)

Separation Between	Required Fire Barrier Rating (hr)	Required Opening Protection (hr) (Table 716.1(2))
R2 and S1	1	NA
R2 and B	1	NA

- Accessory Occupancies:** No separation required if <= 10% of story area and within tabular limits (508.2.3, 508.2.4).

Incidental Use Separation (IBC Table 509.1)

Area	Separation Requirement
Furnace Room (>400k BTU/hr input)	1 hour OR Sprinkler System
Boiler Room (>15 psi & 10 hp)	1 hour
Refrigerant Machinery Room	1 hour OR Sprinkler System
Hydrogen Cut-off Room (not Group H)	2 hour
Incinerator Room	2 hour AND Sprinkler System
Paint Shop (not Group H)	2 hour OR 1 hour + Sprinkler System
Laundry Room > 100 sq.ft	1 hour OR Sprinkler System (Note: Text lists 1 hour separately too - verify)
Waste/Linen Collection Room > 100 sq.ft	1 hour OR Sprinkler System

Dwelling Unit Separation (IBC 420, 708)

- Walls:** 1-hour fire partitions required (420.2, 708.3). Extend foundation/floor below to underside of floor/roof deck above (708.4). Supporting construction protection generally required (708.5).
- Floors:** Horizontal assemblies required (420.3). Minimum 1-hour rating (Implied by Table 601/711 - confirm specific req.).

Smoke Barriers (IBC 709, 710)

- Required rating: 1 hour (709.3).
- Must be continuous membrane (wall-to-wall, floor-to-deck/slab above) (710.4).
- Opening requirements per 710.5.

Marking and Identification (IBC 703.5)

- Fire walls/barriers/partitions, smoke barriers/partitions require permanent identification in accessible concealed spaces (within 15ft of ends, max 30ft intervals).

Penetrations of Fire-Resistive Assemblies (IBC 714)

- General:** Must use tested systems or approved firestop systems (714.4.1, 714.5.1).
- Walls (Through):** Exceptions for certain steel/ferrous/copper pipes/conduits (714.4.1.2 Ex).
- Walls (Membrane):** Same requirements. Exceptions for certain steel boxes (size/spacing limits), listed boxes, sprinkler escutcheons (714.4.2 Ex).
- Floors/Roofs (Through):** Firestop rating >= 1 hr and >= floor rating (714.5.1.2). Exceptions for certain pipes/conduits through single concrete floor, tested outlet boxes (714.5.1.2 Ex).
- Floors/Roofs (Membrane):** Same requirements. Exceptions for certain pipes/boxes through concrete/masonry, tested outlet boxes, sprinkler escutcheons (714.5.2 Ex).

Ducts and Air Transfer Openings (IBC 717)

- Dampers required where ducts penetrate fire walls, fire barriers, shaft enclosures, fire partitions, smoke barriers (717.5). Must be accessible (717.4).

Draftstopping (IBC 708.4.2)

- Required above/along fire partitions if they don't extend to deck/floor above.
- Attic Exceptions:** Not needed if < 4 dwelling units (Ex 3); Divide space into <= 3000 sq.ft areas or above every 2 units (smaller prevails) (Ex 4). If corridor walls separate units, only needed above one corridor wall (Ex 2).
- Floor/Ceiling Exceptions:** Similar exceptions apply if partition doesn't extend to floor above (Ex 2, Ex 3).

Fire Protection Systems

Automatic Sprinkler Systems (IBC 903)

- Required Conditions:**
 - Fire areas containing Group R occupancy (903.2.8). *This applies to the apartments.*
- Provided System:** NFPA 13R (per Basic Building Description section).

Fire Pumps (IBC 913)

- If provided, must be in room separated by 2-hour fire barrier (913.2.1).

Portable Fire Extinguishers (IBC 906)

- Required (906.1). Location per Table 906.1. Size/distribution per 906.3.
- Dwelling Units:** Require min 1-A:10-B:C rated extinguisher each (906.1 Ex).

Fire Alarm & Detection Systems (IBC 907)

- Manual Fire Alarm:** Required (activates occupant notification) (907.2.9.1). Exception may apply if units separated by 1-hr partitions and have direct exit to exterior.
- Smoke Alarms (R-2 Occupancy - 907.2.11):**
 - Locations:** Outside each sleeping area, inside each sleeping room, on all stories (including basement) (907.2.11.2).
 - Placement Restrictions:** Avoid placement too close to cooking appliances (distance varies by type - ionization/photoelectric) or bathrooms (min 3 ft horizontally) unless necessary for required locations (907.2.11.3, 907.2.11.4).
 - Interconnection:** Required if >1 alarm needed (907.2.11.5).
 - Power:** Primary power from building wiring with battery backup (907.2.11.6).

Other Building Requirements

Roofing (IBC Chapter 15)


- Class:** Class C or better required (Table 1505.1). Exception allows No. 1 cedar/redwood shakes/shingles.
- Drainage:** Secondary (overflow) drains or scuppers required if water can be trapped by walls/parapets extending above roof (1502.2). Sized to prevent exceeding design load (1611.1). Scuppers min 4" opening (1502.3). Design per IPC Ch 11.

Light and Ventilation (IBC 1204, 1202)


- Light:** Natural (min 8% floor area glazed) OR artificial (avg 10 fc at 30" AFF) required for occupied spaces (1204.1-1204.3). Adjoining room rules apply (1204.2.1).
- Ventilation:** Natural (min 4% floor area openable area) OR mechanical (per IMC) required (1202.1, 1202.5). Adjoining room rules apply (1202.5.1.1). Below grade opening clearances (1202.5.1.2).
- Bathing Rooms:** Mechanical ventilation required (1202.5.2.1).

Glazing (IBC 2406)


- Safety Glazing Required in Hazardous Locations:**
 - Doors (swinging, sliding, bifold) (2406.4.1).
 - Adjacent to doors (within 24" arc, bottom edge < 60" AFF) (2406.4.2).
 - Large panels (>9 sq.ft, bottom < 18" AFF, top > 36" AFF, near walking surface) (2406.4.3).
 - Guards and railings (2406.4.4).
 - Near wet areas (hot tubs, pools, showers, etc., bottom < 60" AFF) (2406.4.5).
 - Near stairs/ramps/landings (bottom < 60" AFF) (2406.4.6).
 - Near bottom landing of stairs (specific conditions) (2406.4.7).
 - Numerous exceptions apply - refer to code text.
- </

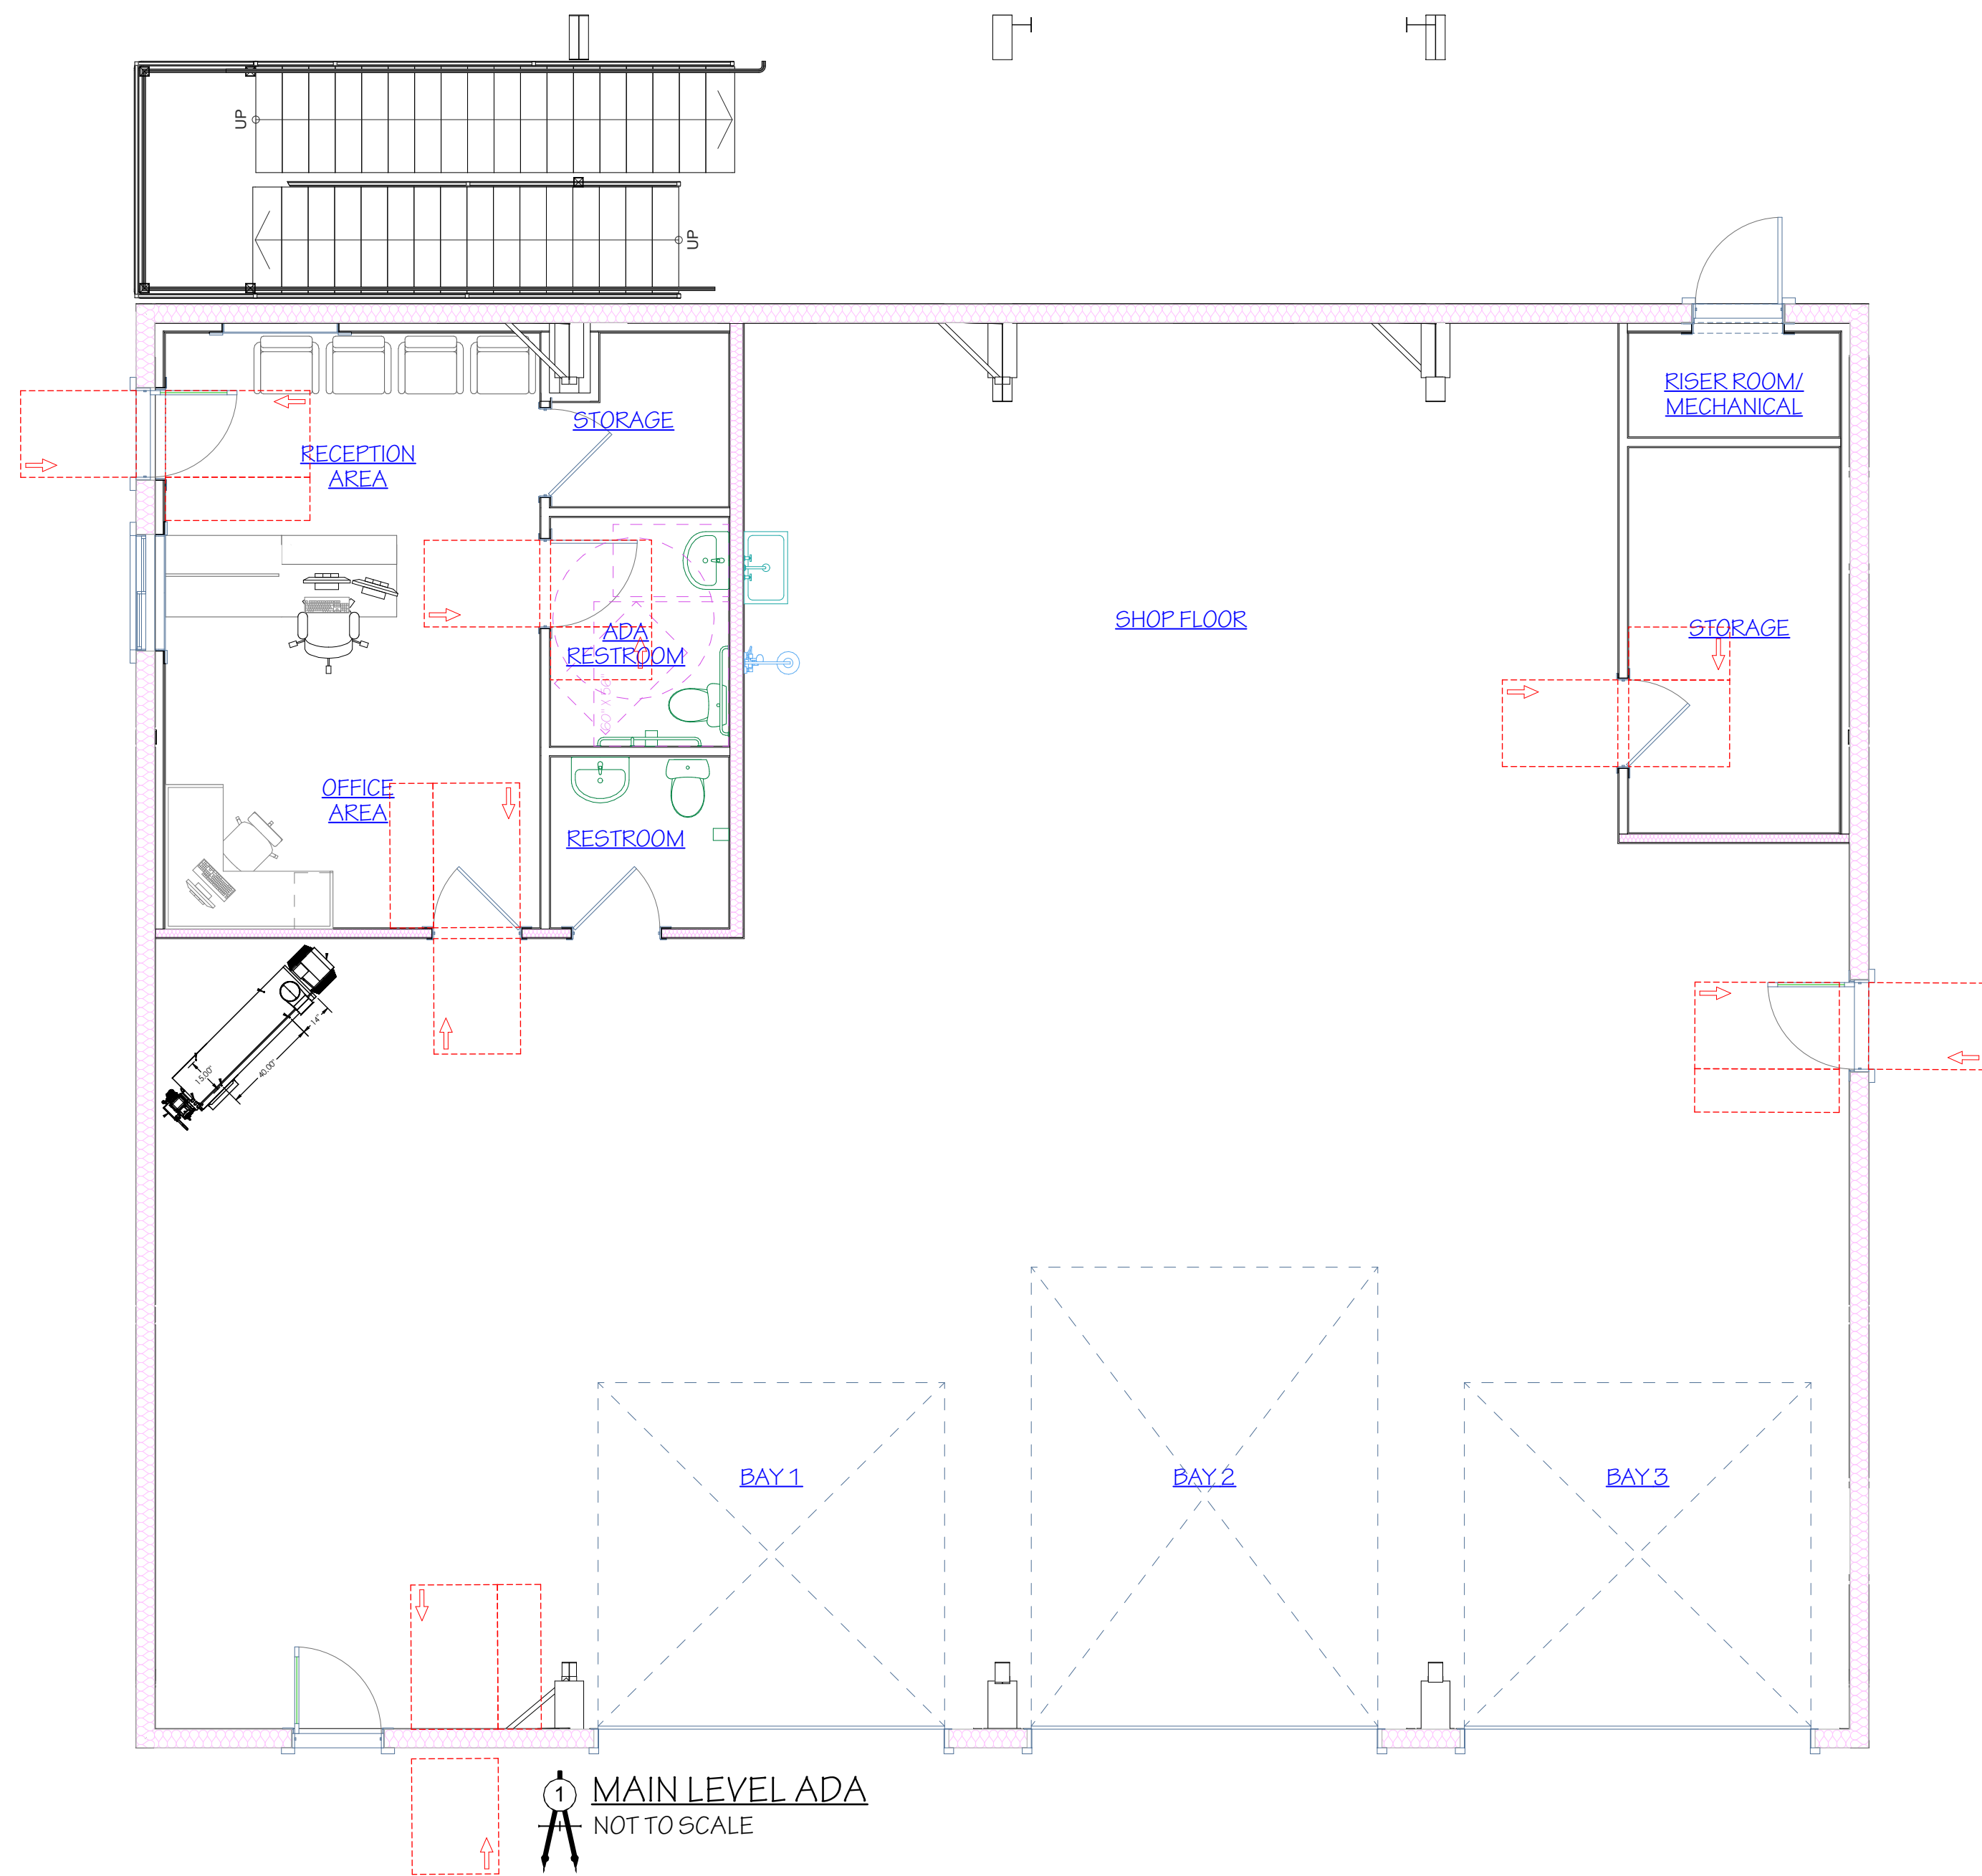


MANEUVERING CLEARANCES AT DOORS

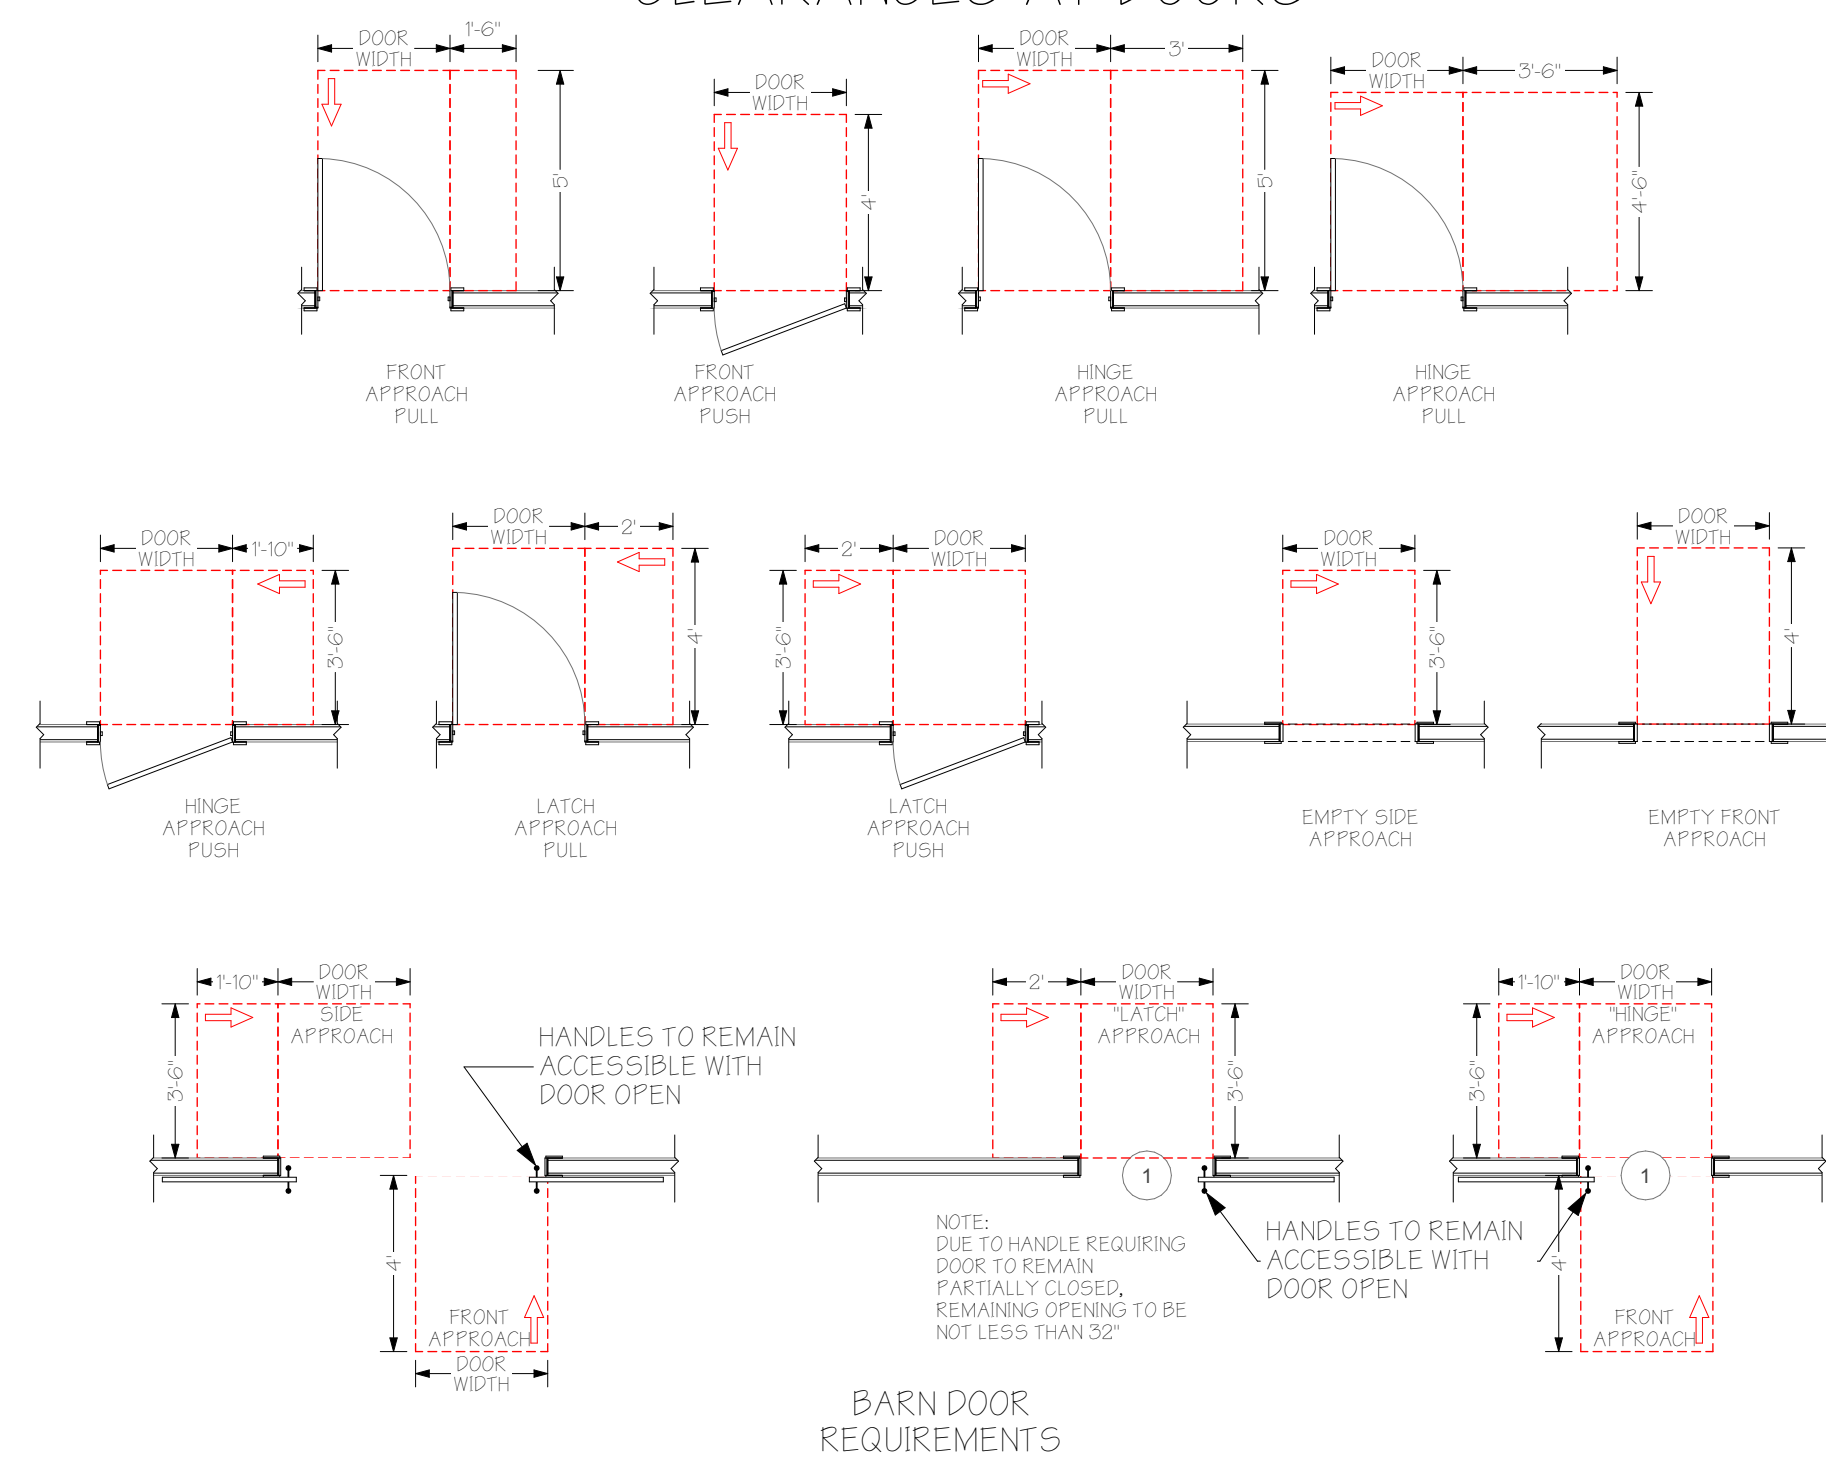

TURNING SPACE

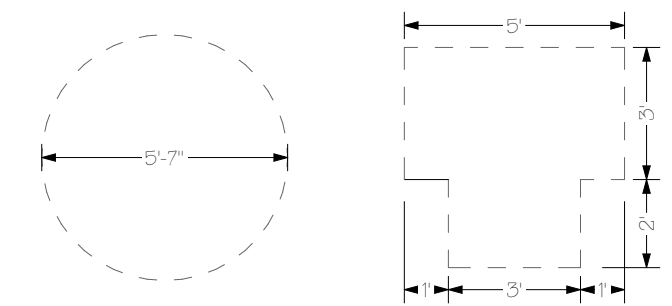

CLEAR FLOOR SPACE

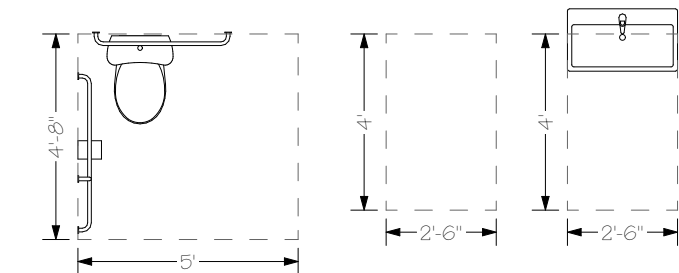

MANEUVERING AND CLEARANCE REQUIREMENTS

ENGINEER: RICHARD D SEAMONS
EIT: ###
DRAWN BY: BW
CHKD BY: ###
PLOT DATE: 5/16/2025

AFFITTAMI LLC - KATHERINE
KRESAN - AUTO SERVICE
ELEVATED
PARCEL NO: 37182030004500
ELK MEADOWS ADDITION LOT: 3

South Fork Design Group, LLC
127 E. Main St. Suite 111
Rexburg, ID 83440
www.southforkdesign.com
208-852-6236

SOUTH FORK DESIGN


Professional Engineer
RICHARD D. SEAMONS
13700
WYOMING

THESE PLANS ARE STAMPED
ENGINEERED FOR THE
LOCATION SPECIFIED. IF
LOCATION CHANGES
REENGINEERING IS REQUIRED.

REVISION DATE	DESCRIPTION

G-103

PLN# 25-01-009

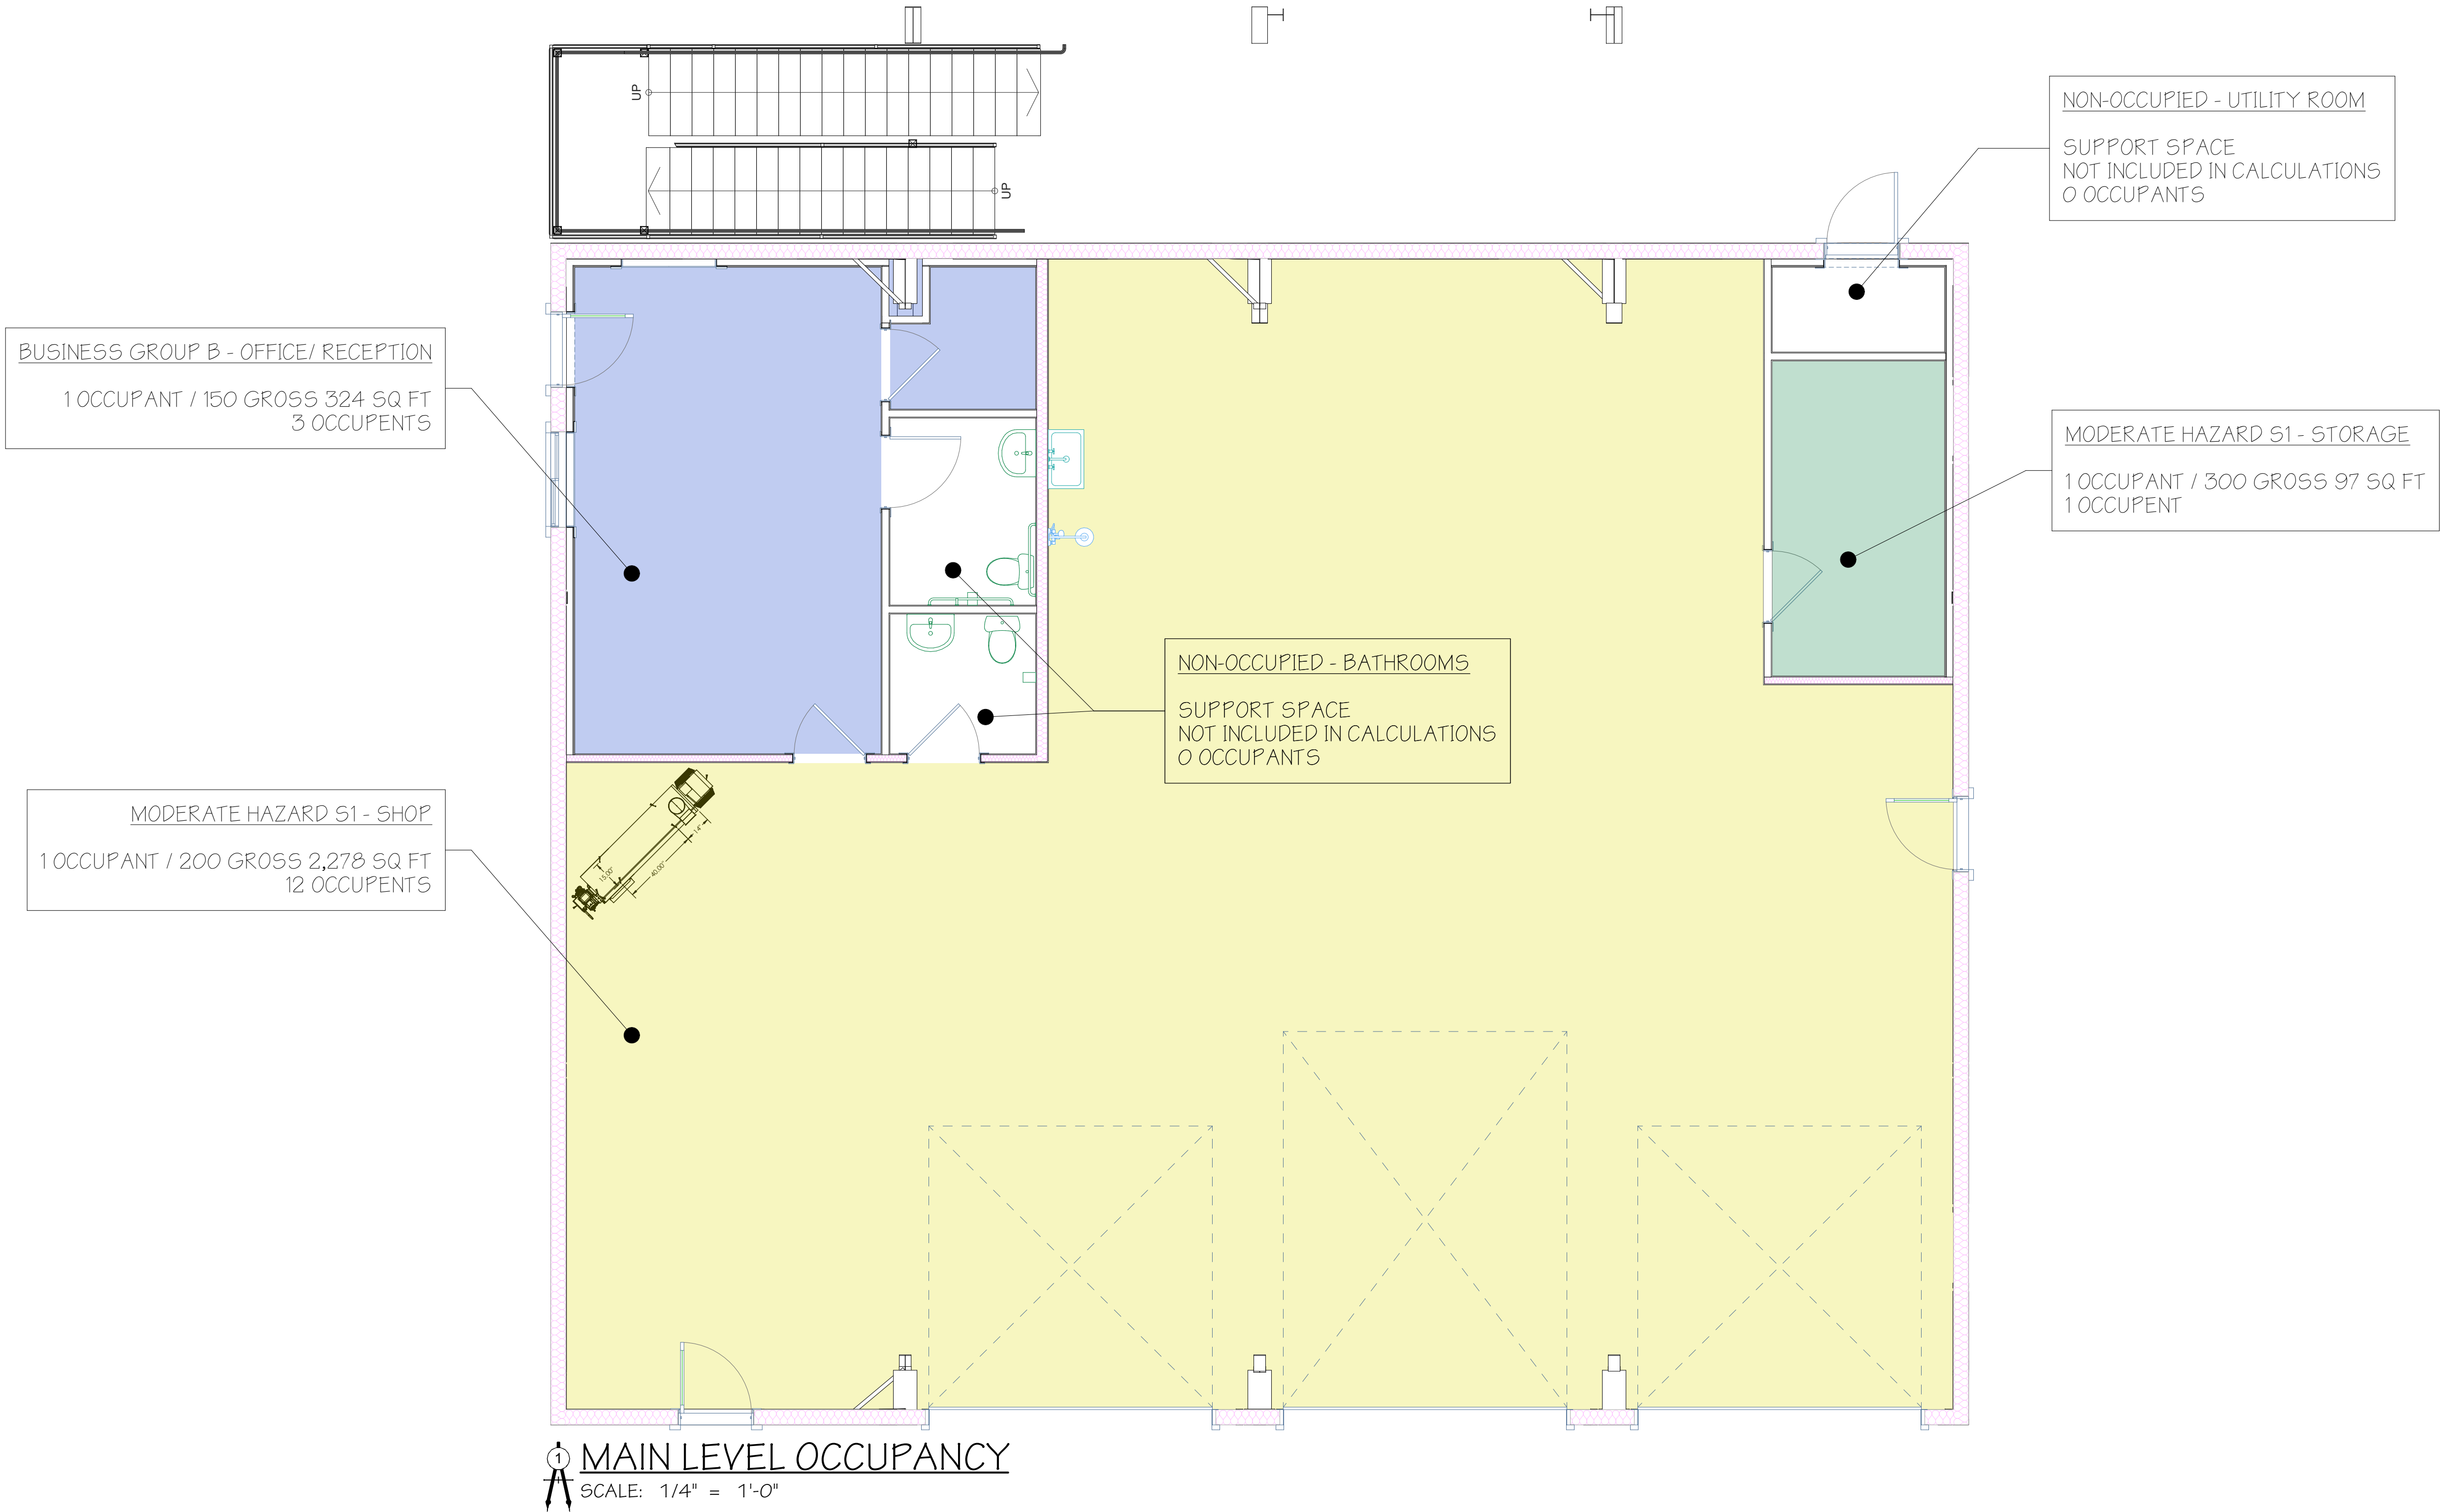

OCCUPANCY SUMMARY (2024 IBC 1004.5)					
ROOM/ AREA LABEL	FUNCTION OF SPACE	NET OR GROSS	OCCUPANT LOAD FACTOR	AREA SQ FT	OCCUPANT LOAD
BUSINESS GROUP B - OFFICE/ RECEPTION	"BUSINESS AREAS"	GROSS	150	324	3
MODERATE HAZARD S1 - SHOP	"AUTOMOTIVE SHOP"	GROSS	200	2278	12
MODERATE HAZARD S1 - STORAGE	"STORAGE"	GROSS	300	97	1
RESIDENTIAL R2 - APARTMENT 1	"APARTMENT"	GROSS	200	1023	6
RESIDENTIAL R2 - APARTMENT 2	"APARTMENT"	GROSS	200	769	4
RESIDENTIAL R2 - APARTMENT 3	"APARTMENT"	GROSS	200	1023	6
BUILDING TOTAL:					32

ENGINEER: RICHARD D SEAMONS
EIT: ###
DRAWN BY: BW
CHKD BY: ###
PLOT DATE: 5/16/2025

AFFITTAMI LLC - KATHERINE
KRESAN - AUTO SERVICE
ELEVATED
PARCEL NO: 37182030004500
ELK MEADOWS ADDITION LOT: 3

South Fork Design Group, LLC
127 E. Main St Suite 111
Rexburg, ID 83440
www.southforkdesign.com
208-852-6236
Copyright 2025 | South Fork Design | All Rights Reserved.

SEAMONS

13700

Professional Engineer

WYOMING

THESE PLANS ARE STAMPED
ENGINEERED FOR THE
LOCATION SPECIFIED. IF
LOCATION CHANGES
REENGINEERING IS REQUIRED.

LIFE SAFETY - MAIN LEVEL OCCUPANCY

REVISION DATE

DESCRIPTION


G-104

PLN# 25-01-009

RESIDENTIAL R2 - APARTMENT 1
1 OCCUPANT / 200 GROSS 1,023 SQ FT
6 OCCUPENTS

RESIDENTIAL R2 - APARTMENT 2
1 OCCUPANT / 200 GROSS 769 SQ FT
4 OCCUPENTS

RESIDENTIAL R2 - APARTMENT 3
1 OCCUPANT / 200 GROSS 1,023 SQ FT
6 OCCUPENTS

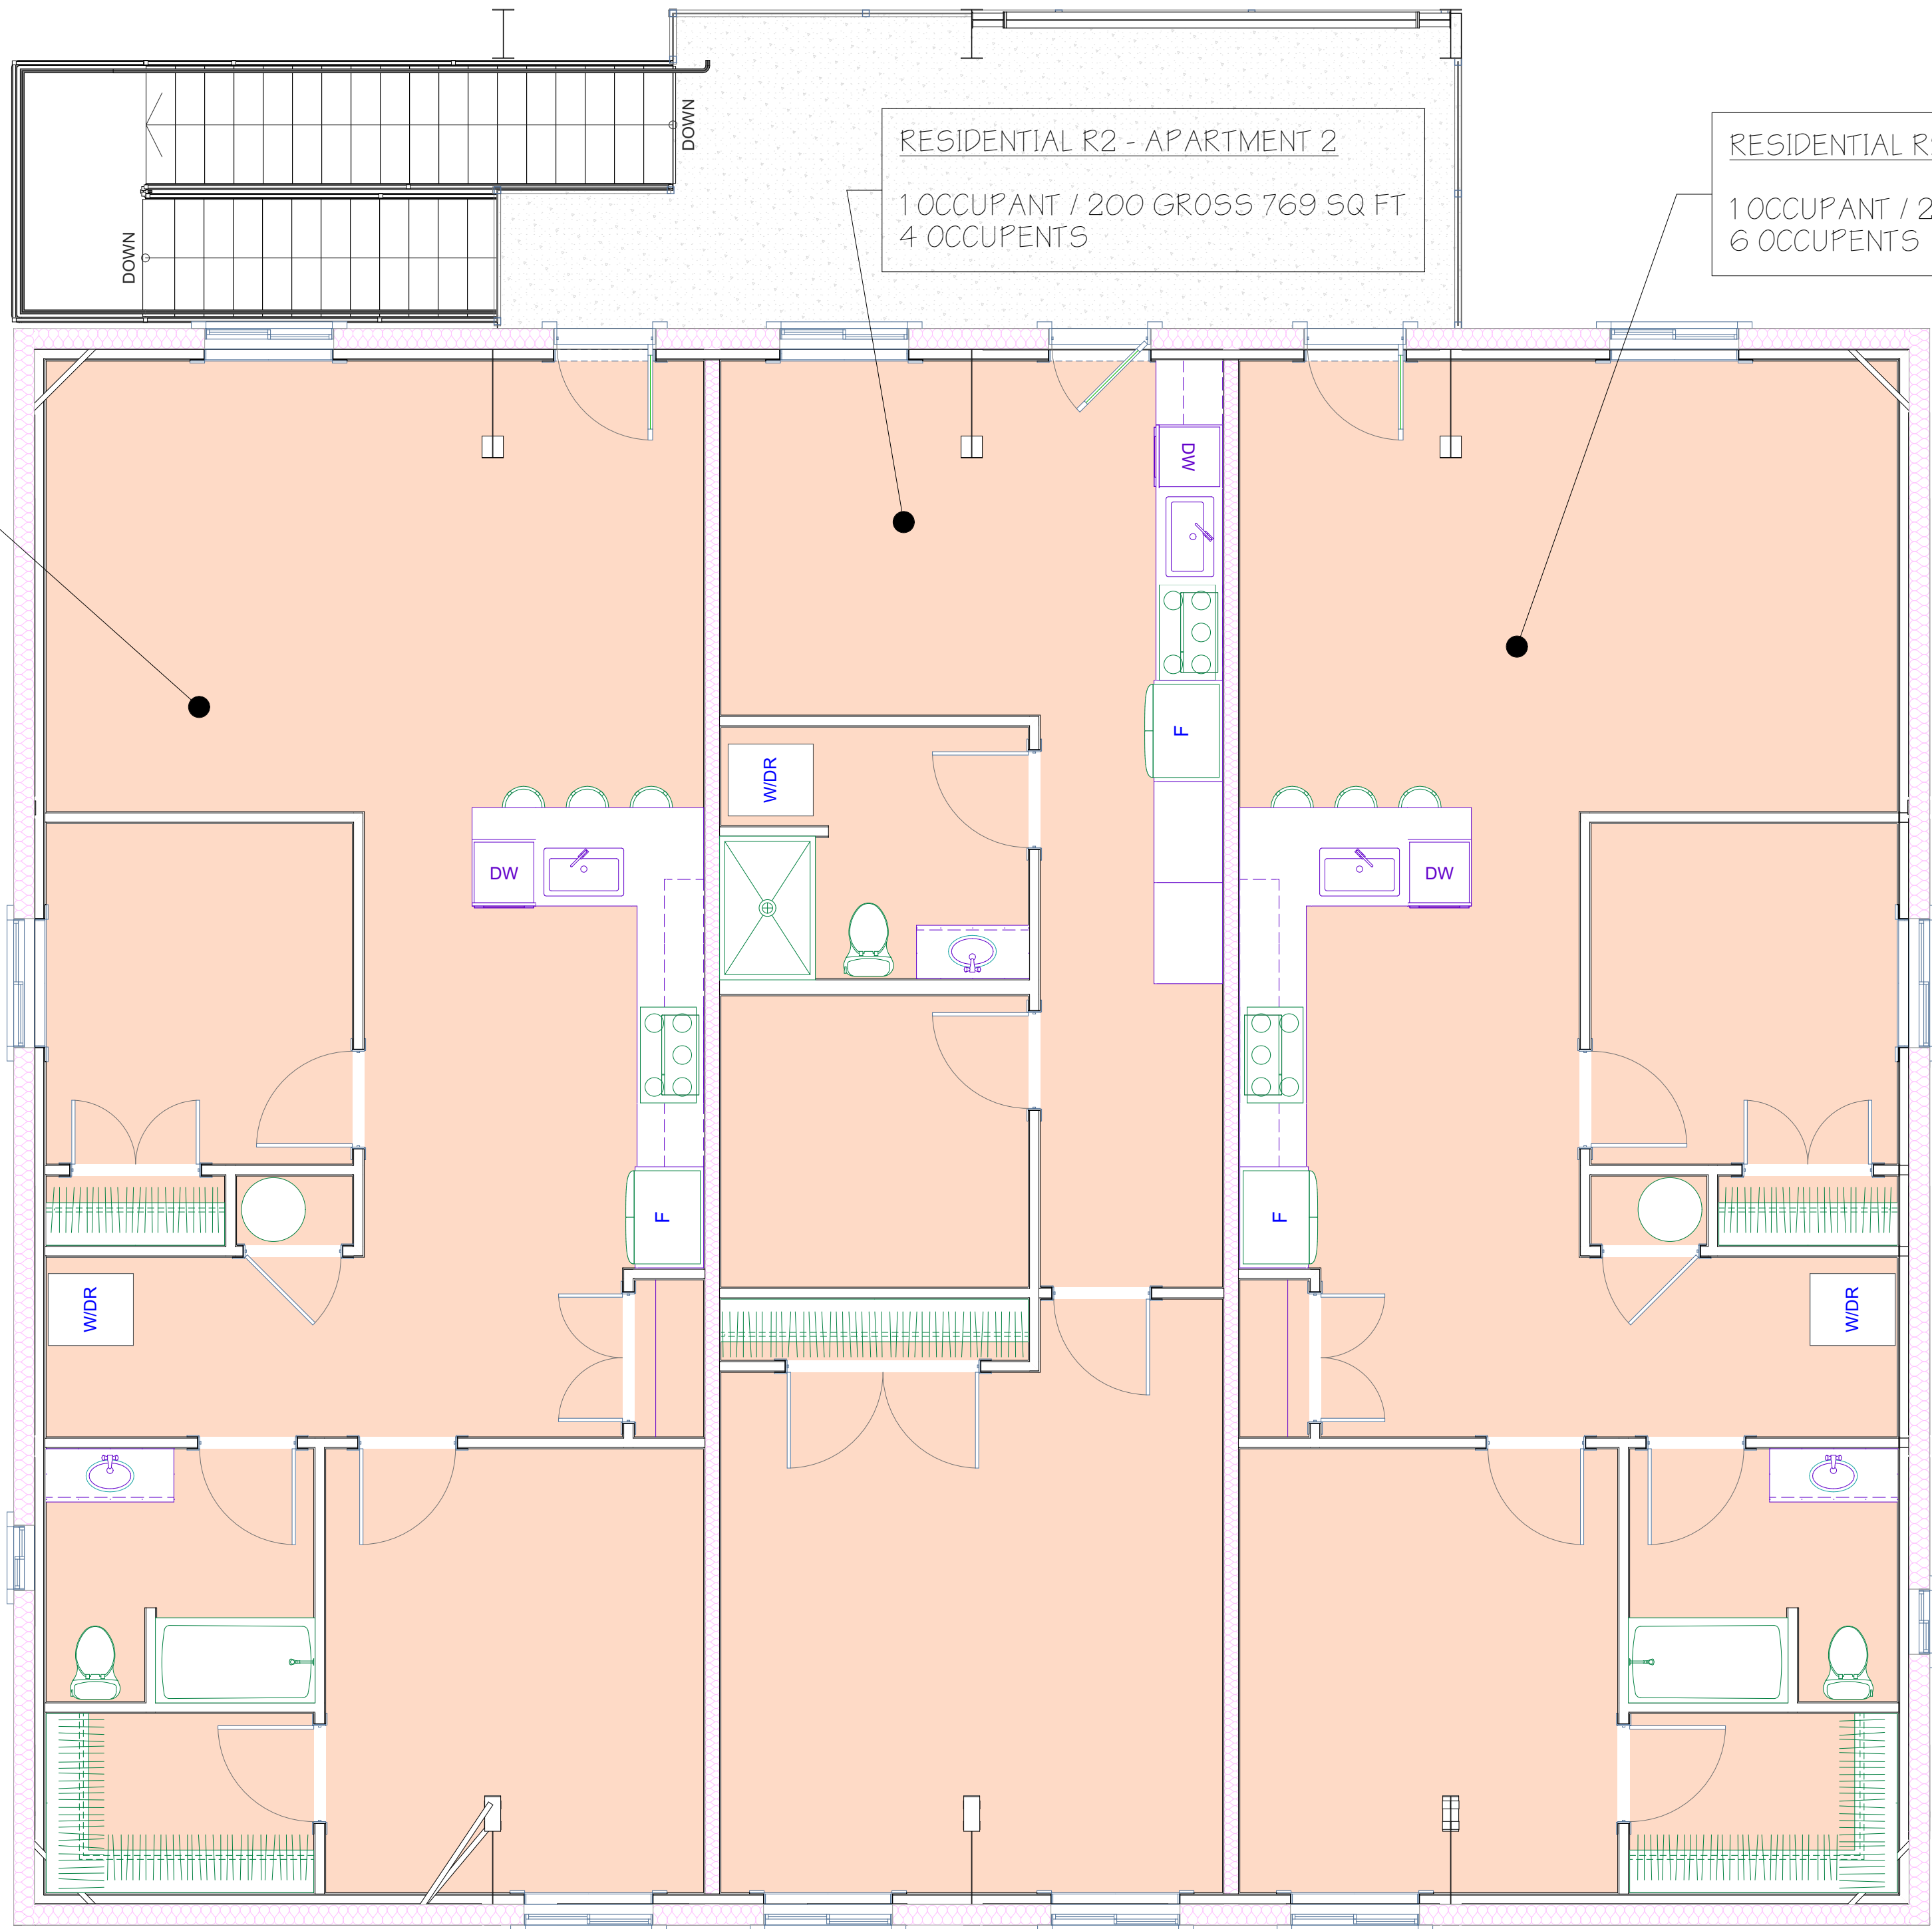

1 SECOND LEVEL OCCUPANCY
SCALE: 1/4" = 1'-0"

OCCUPANCY SUMMARY (2024 IBC 1004.5)					
ROOM/ AREA LABEL	FUNCTION OF SPACE	NET OR GROSS	OCCUPANT LOAD FACTOR	AREA SQ FT	OCCUPANT LOAD
BUSINESS GROUP B - OFFICE/ RECEPTION	"BUSINESS AREAS"	GROSS	150	324	3
MODERATE HAZARD S1 - SHOP	"AUTOMOTIVE SHOP"	GROSS	200	2278	12
MODERATE HAZARD S1 - STORAGE	"STORAGE"	GROSS	300	97	1
RESIDENTIAL R2 - APARTMENT 1	"APARTMENT"	GROSS	200	1023	6
RESIDENTIAL R2 - APARTMENT 2	"APARTMENT"	GROSS	200	769	4
RESIDENTIAL R2 - APARTMENT 3	"APARTMENT"	GROSS	200	1023	6
BUILDING TOTAL:					32

ENGINEER: RICHARD D SEAMONS
EIT: ###
DRAWN BY: BW
CHKD BY: ###
PLOT DATE: 5/16/2025

AFFITTAMI LLC - KATHERINE
KRESAN - AUTO SERVICE
ELEVATED
PARCEL NO: 37182030004500
ELK MEADOWS ADDITION LOT: 3


South Fork Design Group, LLC
127 E. Main St Suite 111
Rexburg, ID 83440
www.southforkdesign.com
208-852-6236
Copyright 2025 | South Fork Design | All Rights Reserved.

SOUTH FORK
DESIGN

Professional Engineer
RICHARD D. SEAMONS
13700
STATE OF WYOMING

THESE PLANS ARE STAMPED
ENGINEERED FOR THE
LOCATION SPECIFIED. IF
LOCATION CHANGES
REENGINEERING IS REQUIRED.


LIFE SAFETY - UPPER LEVEL OCCUPANCY	
REVISION DATE	DESCRIPTION

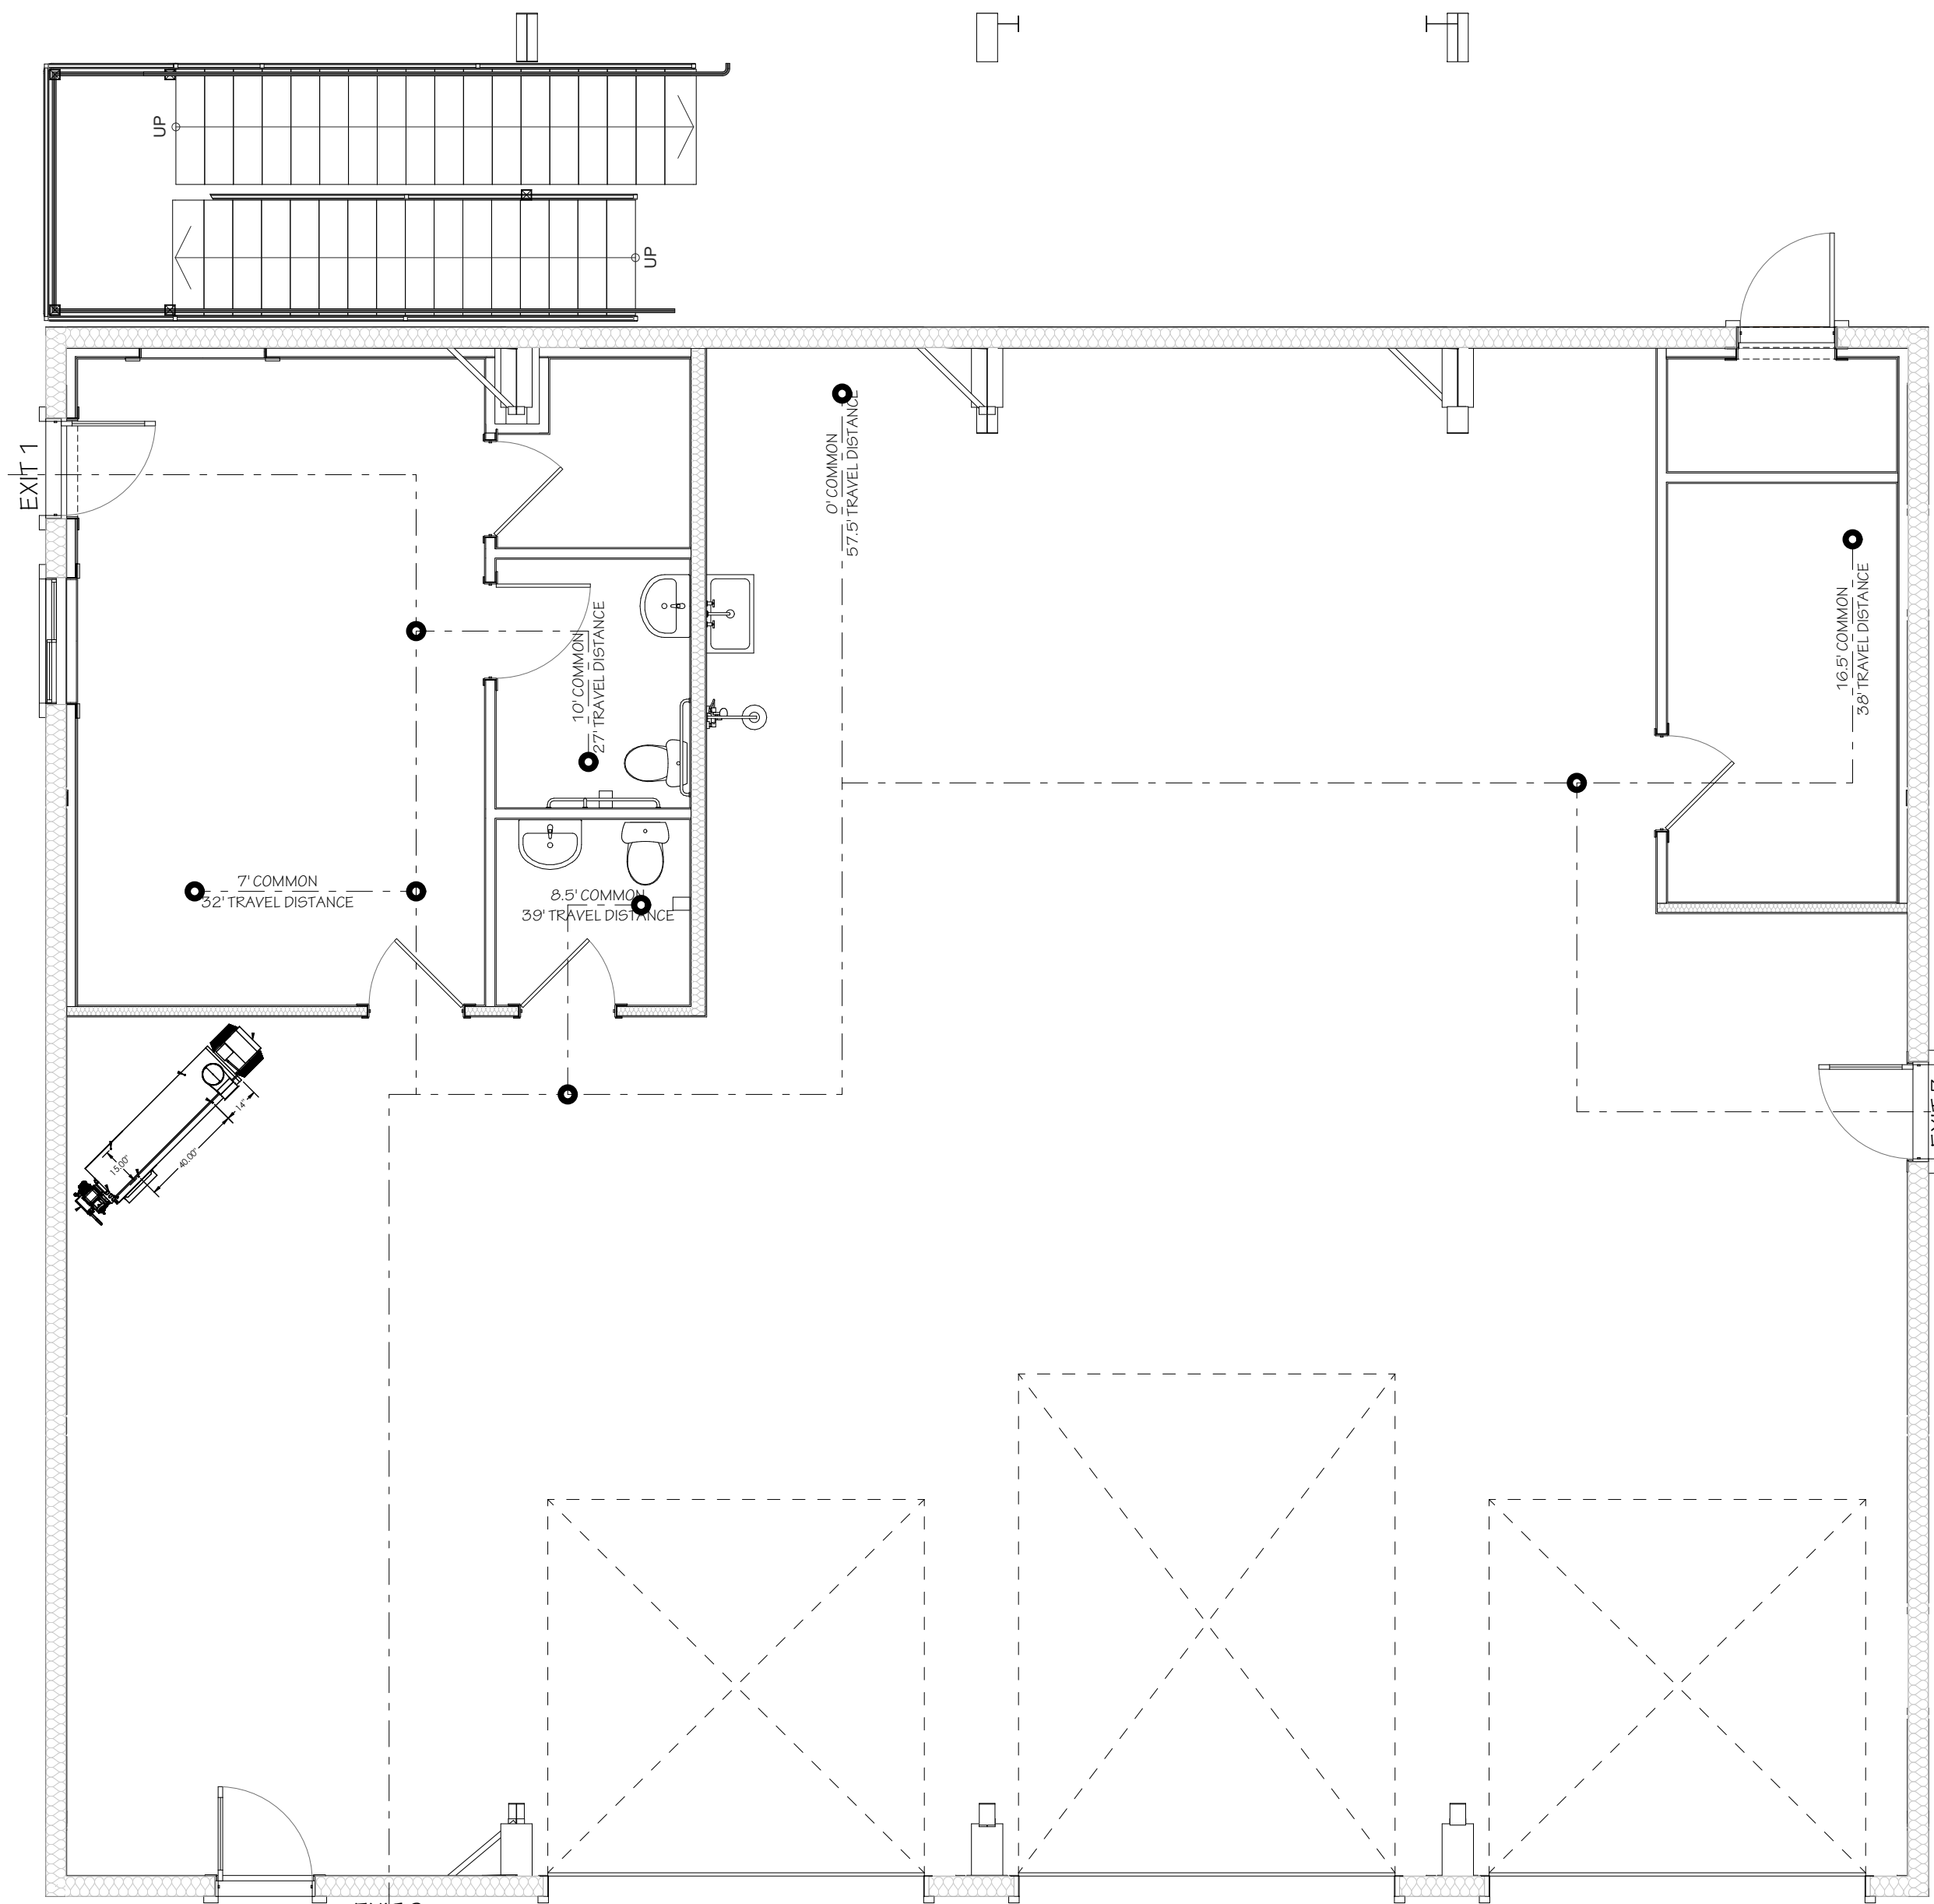

 **MAIN LEVEL EGRESS**
NOT TO SCALE

EGRESS DISTANCE REQUIREMENTS	# OCCUPANTS SERVED	MAX ALLOWED	MAX PLANNED
MAXIMUM COMMON PATH OF EGRESS EXIT 1 (1006.2.1)	3	100' SPRINKLERED	7'
MAXIMUM COMMON PATH OF EGRESS EXIT 2 (1006.2.1)	12	100' SPRINKLERED	0'
MAXIMUM COMMON PATH OF EGRESS EXIT 3 (1006.2.1)	1	100' SPRINKLERED	16.5
MAXIMUM COMMON PATH OF EGRESS EXIT 4 (1006.2.1)	6	125' SPRINKLERED	115'
MAXIMUM COMMON PATH OF EGRESS EXIT 5 (1006.2.1)	4	125' SPRINKLERED	114'
MAXIMUM COMMON PATH OF EGRESS EXIT 6 (1006.2.1)	6	125' SPRINKLERED	123
MAXIMUM EXIT ACCESS TRAVEL DISTANCE EXIT 1 (1017.2)	3	250' SPRINKLERED	32'
MAXIMUM EXIT ACCESS TRAVEL DISTANCE EXIT 2 (1017.2)	12	250' SPRINKLERED	57.5'
MAXIMUM EXIT ACCESS TRAVEL DISTANCE EXIT 3 (1017.2)	1	250' SPRINKLERED	38'
MAXIMUM EXIT ACCESS TRAVEL DISTANCE EXIT 4 (1017.2)	6	250' SPRINKLERED	115'
MAXIMUM EXIT ACCESS TRAVEL DISTANCE EXIT 5 (1017.2)	4	250' SPRINKLERED	114'
MAXIMUM EXIT ACCESS TRAVEL DISTANCE EXIT 6 (1017.2)	6	250' SPRINKLERED	123


EGRESS CAPACITY REQUIREMENTS	# OCCUPANTS SERVED	MIN REQUIRED (INCHES)	PLANNED MIN.
EXIT 1 (1005.3.2)	3	0.6	36"
EXIT 2 (1005.3.2)	12	2.4	36"
EXIT 3 (1005.3.2)	1	0.2	36"
EXIT 4 (1005.3.2)	6	1.2	36"
EXIT 5 (1005.3.2)	4	0.8	36"
EXIT 6 (1005.3.2)	6	1.2	36"

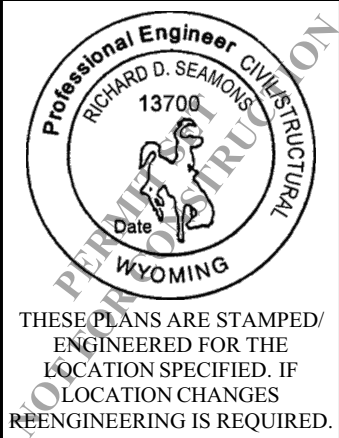

THESE PLANS ARE STAMPED
ENGINEERED FOR THE
LOCATION SPECIFIED. IF
LOCATION CHANGES
REENGINEERING IS REQUIRED.

LIFE SAFETY - MAIN LEVEL EGRESS

REVISION DATE	DESCRIPTION




South Fork Design Group, LLC
127 E. Main St. Suite 111
Rexburg, ID 83440
www.southforkdesign.com
208-852-6236

Copyright 2025 | South Fork Design | All Rights Reserved.

AFFITTAMI LLC - KATHERINE KRESAN - AUTO SERVICE ELEVATED
PARCEL NO: 37182030004500
ELK MEADOWS ADDITION LOT: 3

ENGINEER: RICHARD D SEAMONS
EIT: ###
DRAWN BY: BW
CHKD BY: ###
PLOT DATE: 5/16/2025

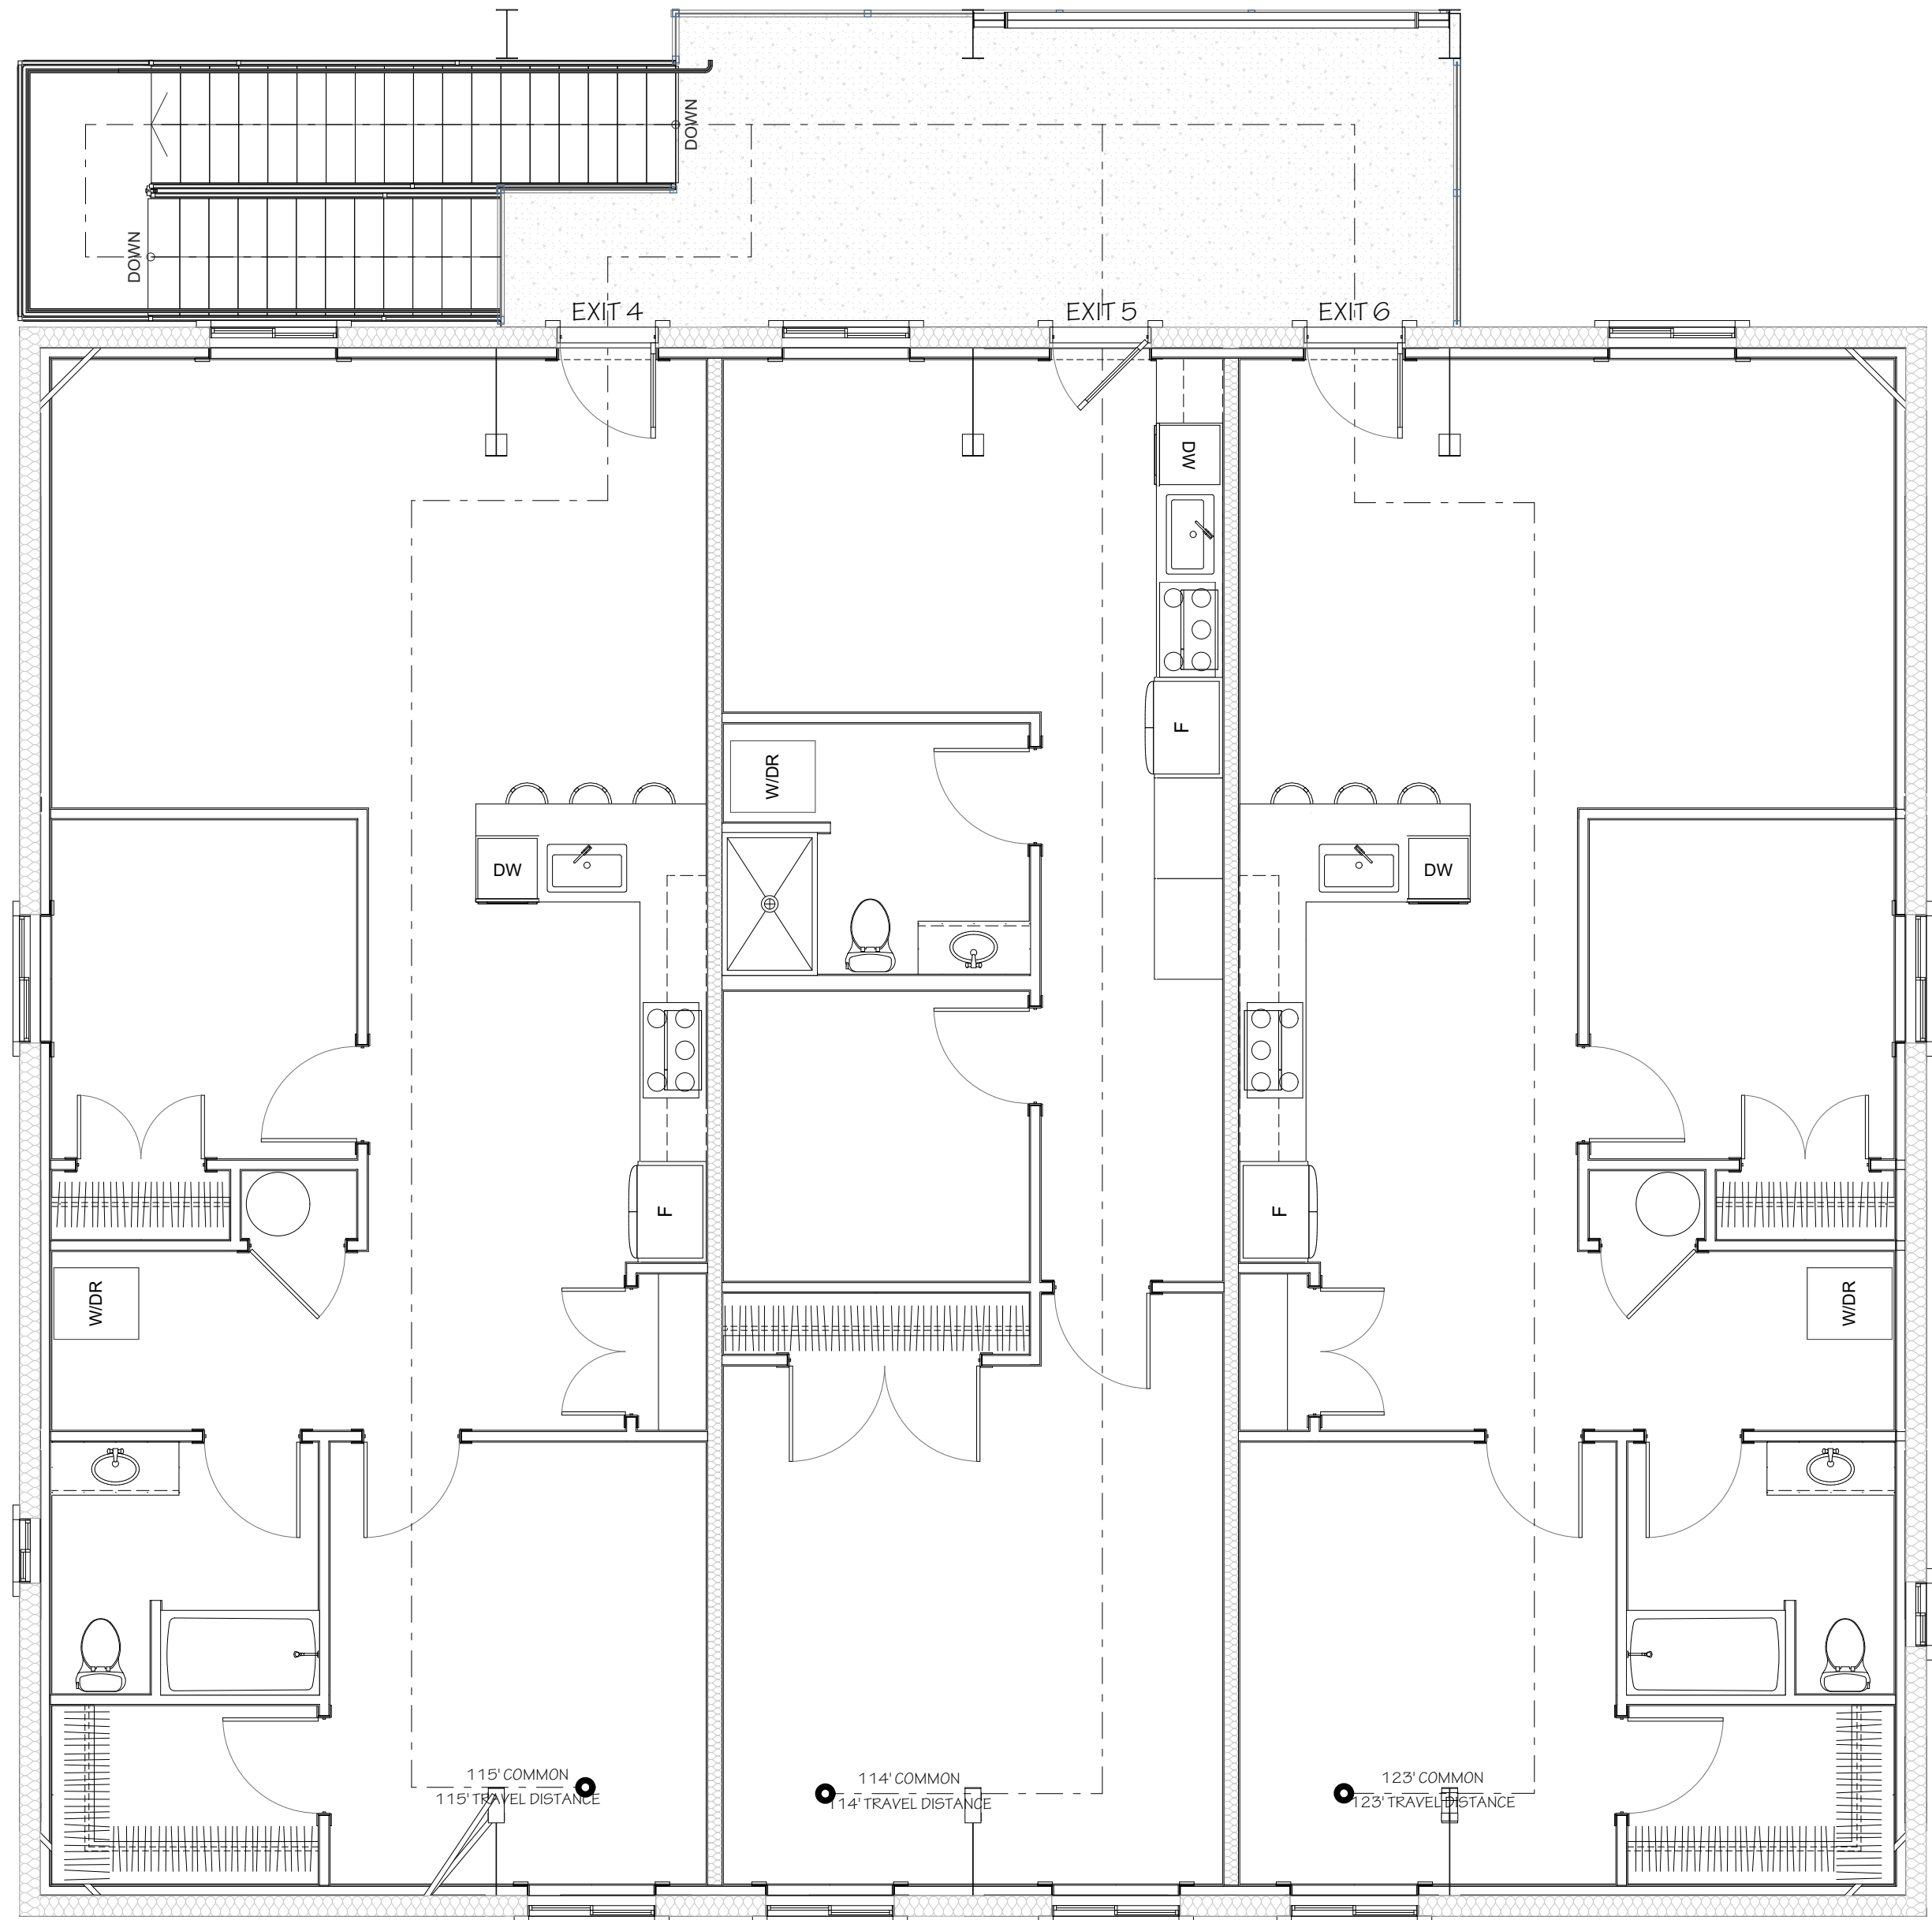

SECOND LEVEL EGRESS
NOT TO SCALE

EGRESS DISTANCE REQUIREMENTS	# OCCUPANTS SERVED	MAX ALLOWED	MAX PLANNED
MAXIMUM COMMON PATH OF EGRESS EXIT 1 (1006.2.1)	3	100' SPRINKLERED	7'
MAXIMUM COMMON PATH OF EGRESS EXIT 2 (1006.2.1)	12	100' SPRINKLERED	0'
MAXIMUM COMMON PATH OF EGRESS EXIT 3 (1006.2.1)	1	100' SPRINKLERED	16.5
MAXIMUM COMMON PATH OF EGRESS EXIT 4 (1006.2.1)	6	125' SPRINKLERED	115'
MAXIMUM COMMON PATH OF EGRESS EXIT 5 (1006.2.1)	4	125' SPRINKLERED	114'
MAXIMUM COMMON PATH OF EGRESS EXIT 6 (1006.2.1)	6	125' SPRINKLERED	123
MAXIMUM EXIT ACCESS TRAVEL DISTANCE EXIT 1 (1017.2)	3	250' SPRINKLERED	32'
MAXIMUM EXIT ACCESS TRAVEL DISTANCE EXIT 2 (1017.2)	12	250' SPRINKLERED	57.5'
MAXIMUM EXIT ACCESS TRAVEL DISTANCE EXIT 3 (1017.2)	1	250' SPRINKLERED	38'
MAXIMUM EXIT ACCESS TRAVEL DISTANCE EXIT 4 (1017.2)	6	250' SPRINKLERED	115'
MAXIMUM EXIT ACCESS TRAVEL DISTANCE EXIT 5 (1017.2)	4	250' SPRINKLERED	114'
MAXIMUM EXIT ACCESS TRAVEL DISTANCE EXIT 6 (1017.2)	6	250' SPRINKLERED	123

EGRESS CAPACITY REQUIREMENTS	# OCCUPANTS SERVED	MIN REQUIRED (INCHES)	PLANNED MIN.
EXIT 1 (1005.3.2)	3	0.6	36"
EXIT 2 (1005.3.2)	12	2.4	36"
EXIT 3 (1005.3.2)	1	0.2	36"
EXIT 4 (1005.3.2)	6	1.2	36"
EXIT 5 (1005.3.2)	4	0.8	36"
EXIT 6 (1005.3.2)	6	1.2	36"

ENGINEER: RICHARD D SEAMONS
EIT: ###
DRAWN BY: BW
CHKD BY: ###
PLOT DATE: 5/16/2025

AFFITTAMI LLC - KATHERINE
KRESAN - AUTO SERVICE
ELEVATED
PARCEL NO: 37182030004500
ELK MEADOWS ADDITION LOT: 3


South Fork Design Group, LLC
127 E. Main St. Suite 111
Rexburg, ID 83440
www.southforkdesign.com
208-852-6236
Copyright 2025 | South Fork Design | All Rights Reserved.

SOUTH FORK
DESIGN


Professional Engineer
RICHARD D. SEAMONS
13700
WYOMING

THESE PLANS ARE STAMPED
ENGINEERED FOR THE
LOCATION SPECIFIED. IF
LOCATION CHANGES
REENGINEERING IS REQUIRED.


LIFE SAFETY - UPPER LEVEL EGRESS	
REVISION DATE	DESCRIPTION

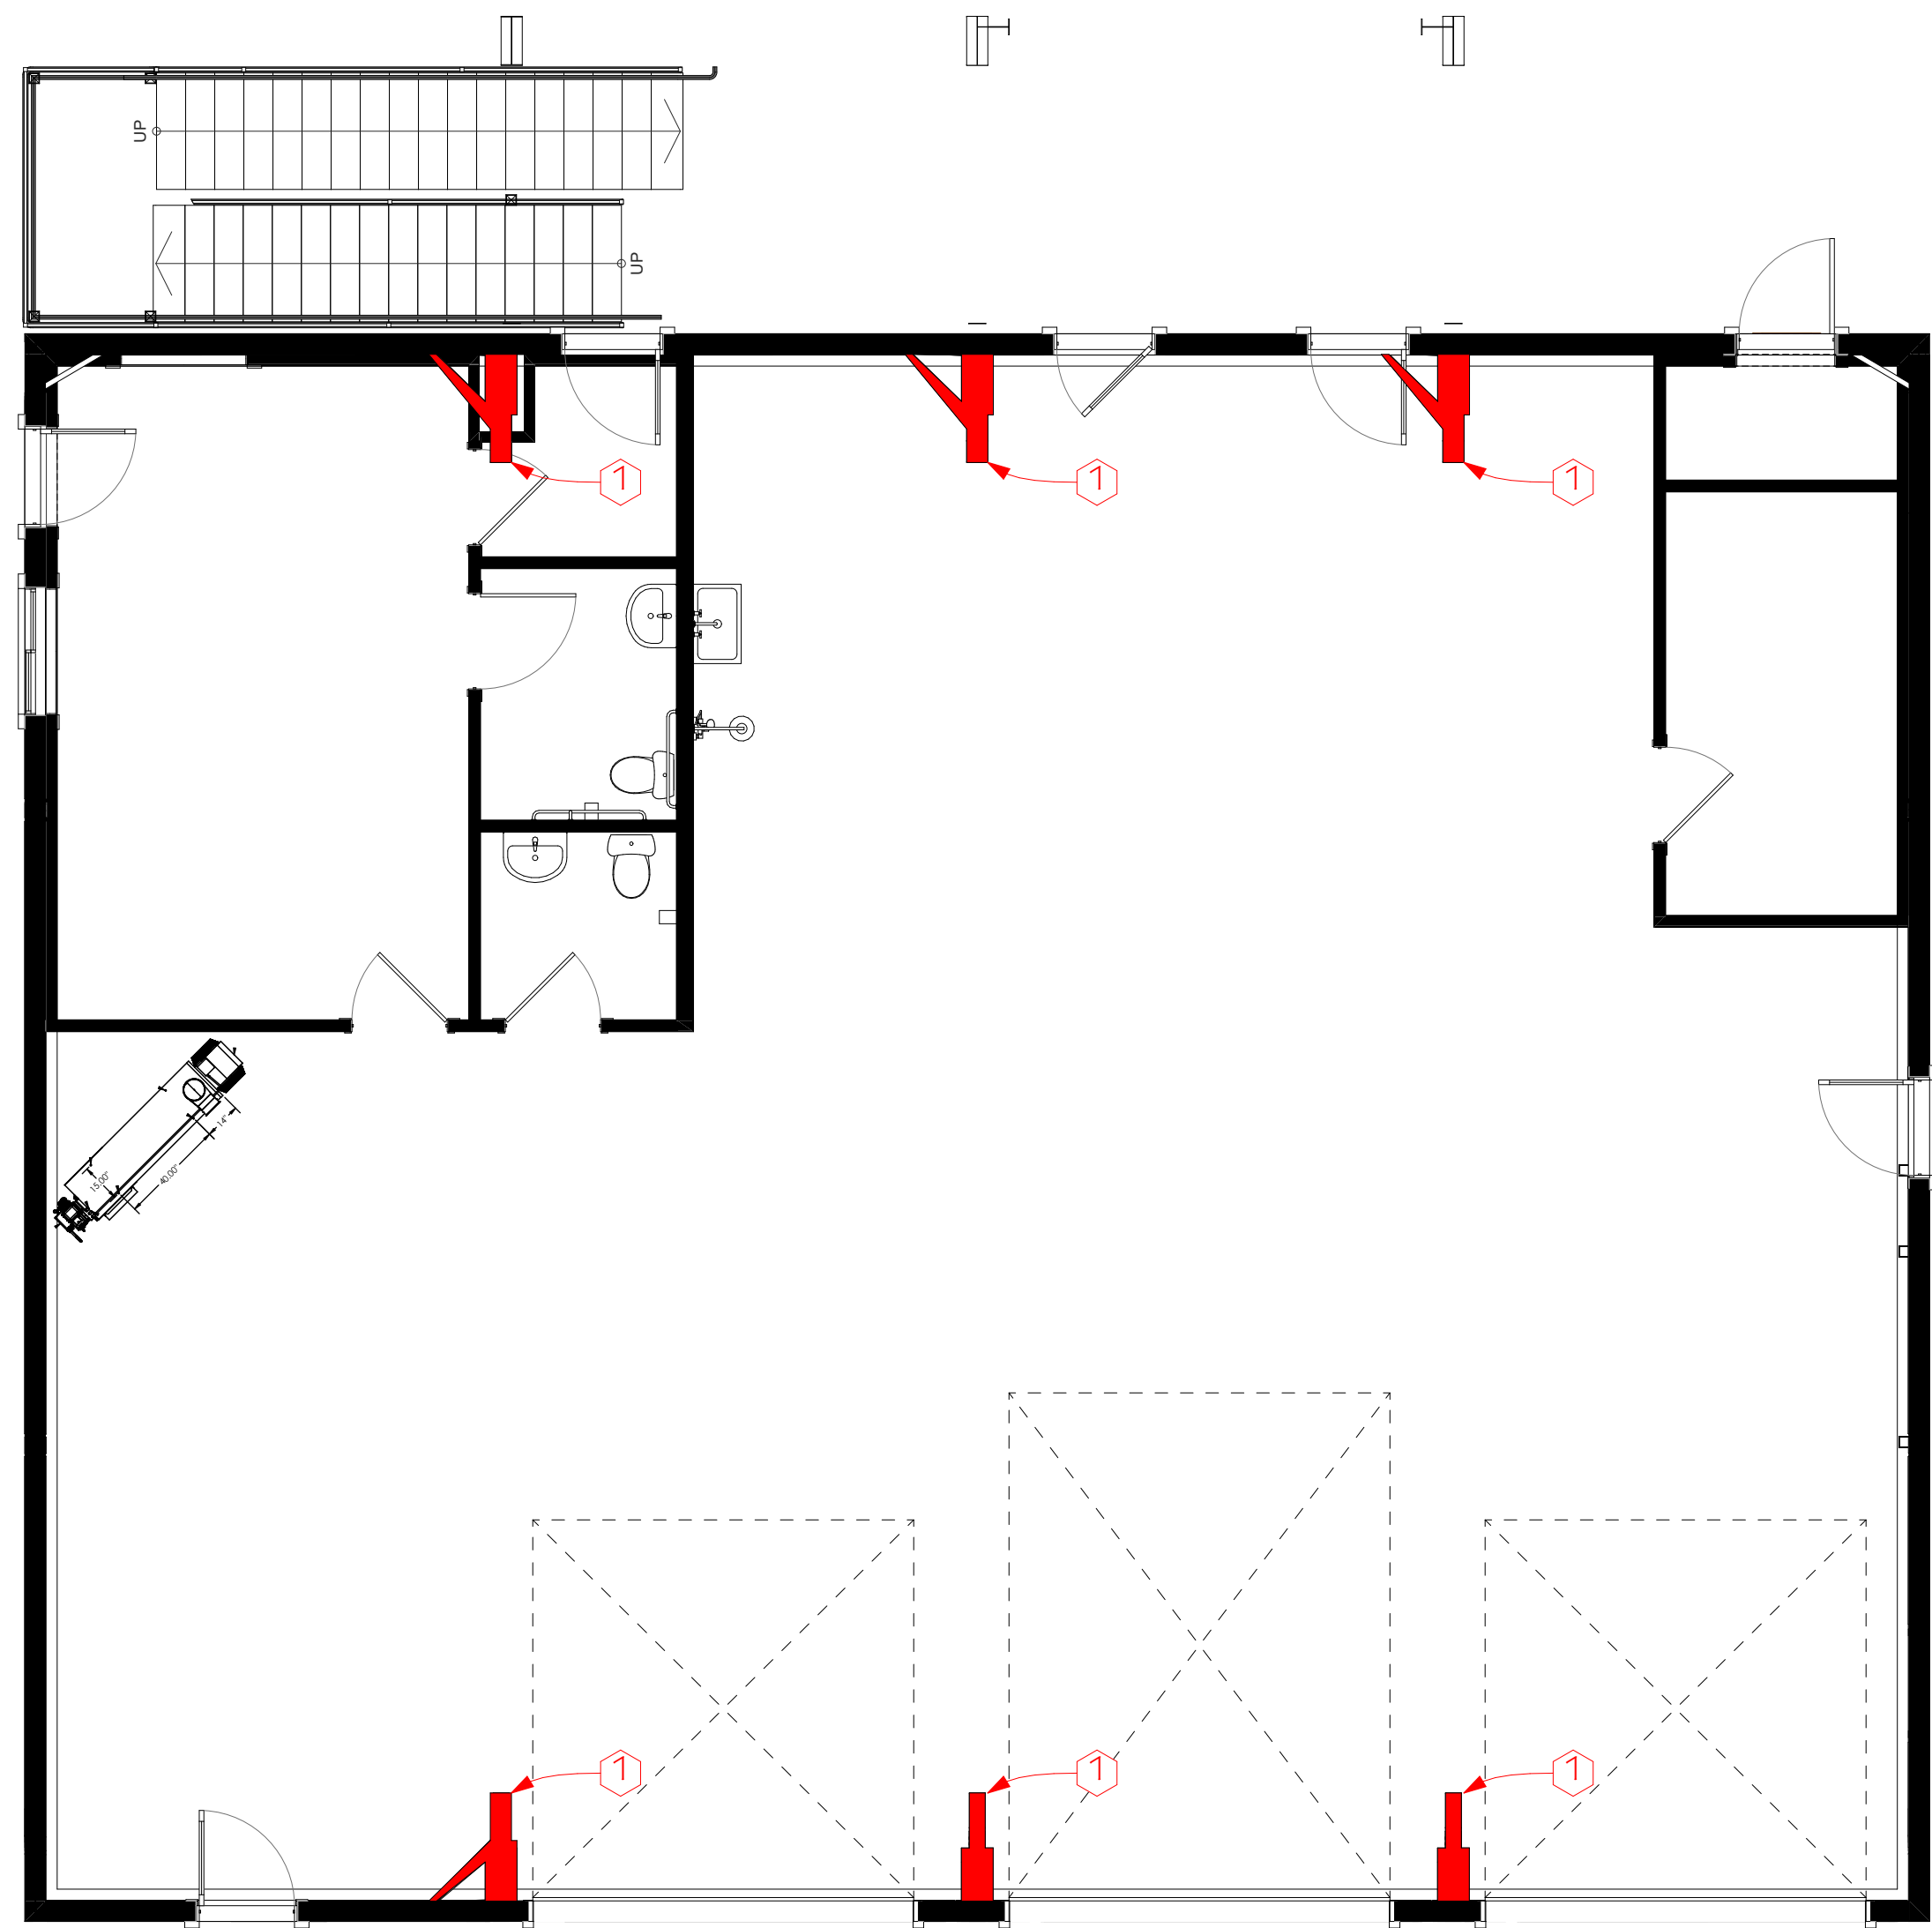

1 MAIN LEVEL FIRE
SCALE: 3/16" = 1'-0"

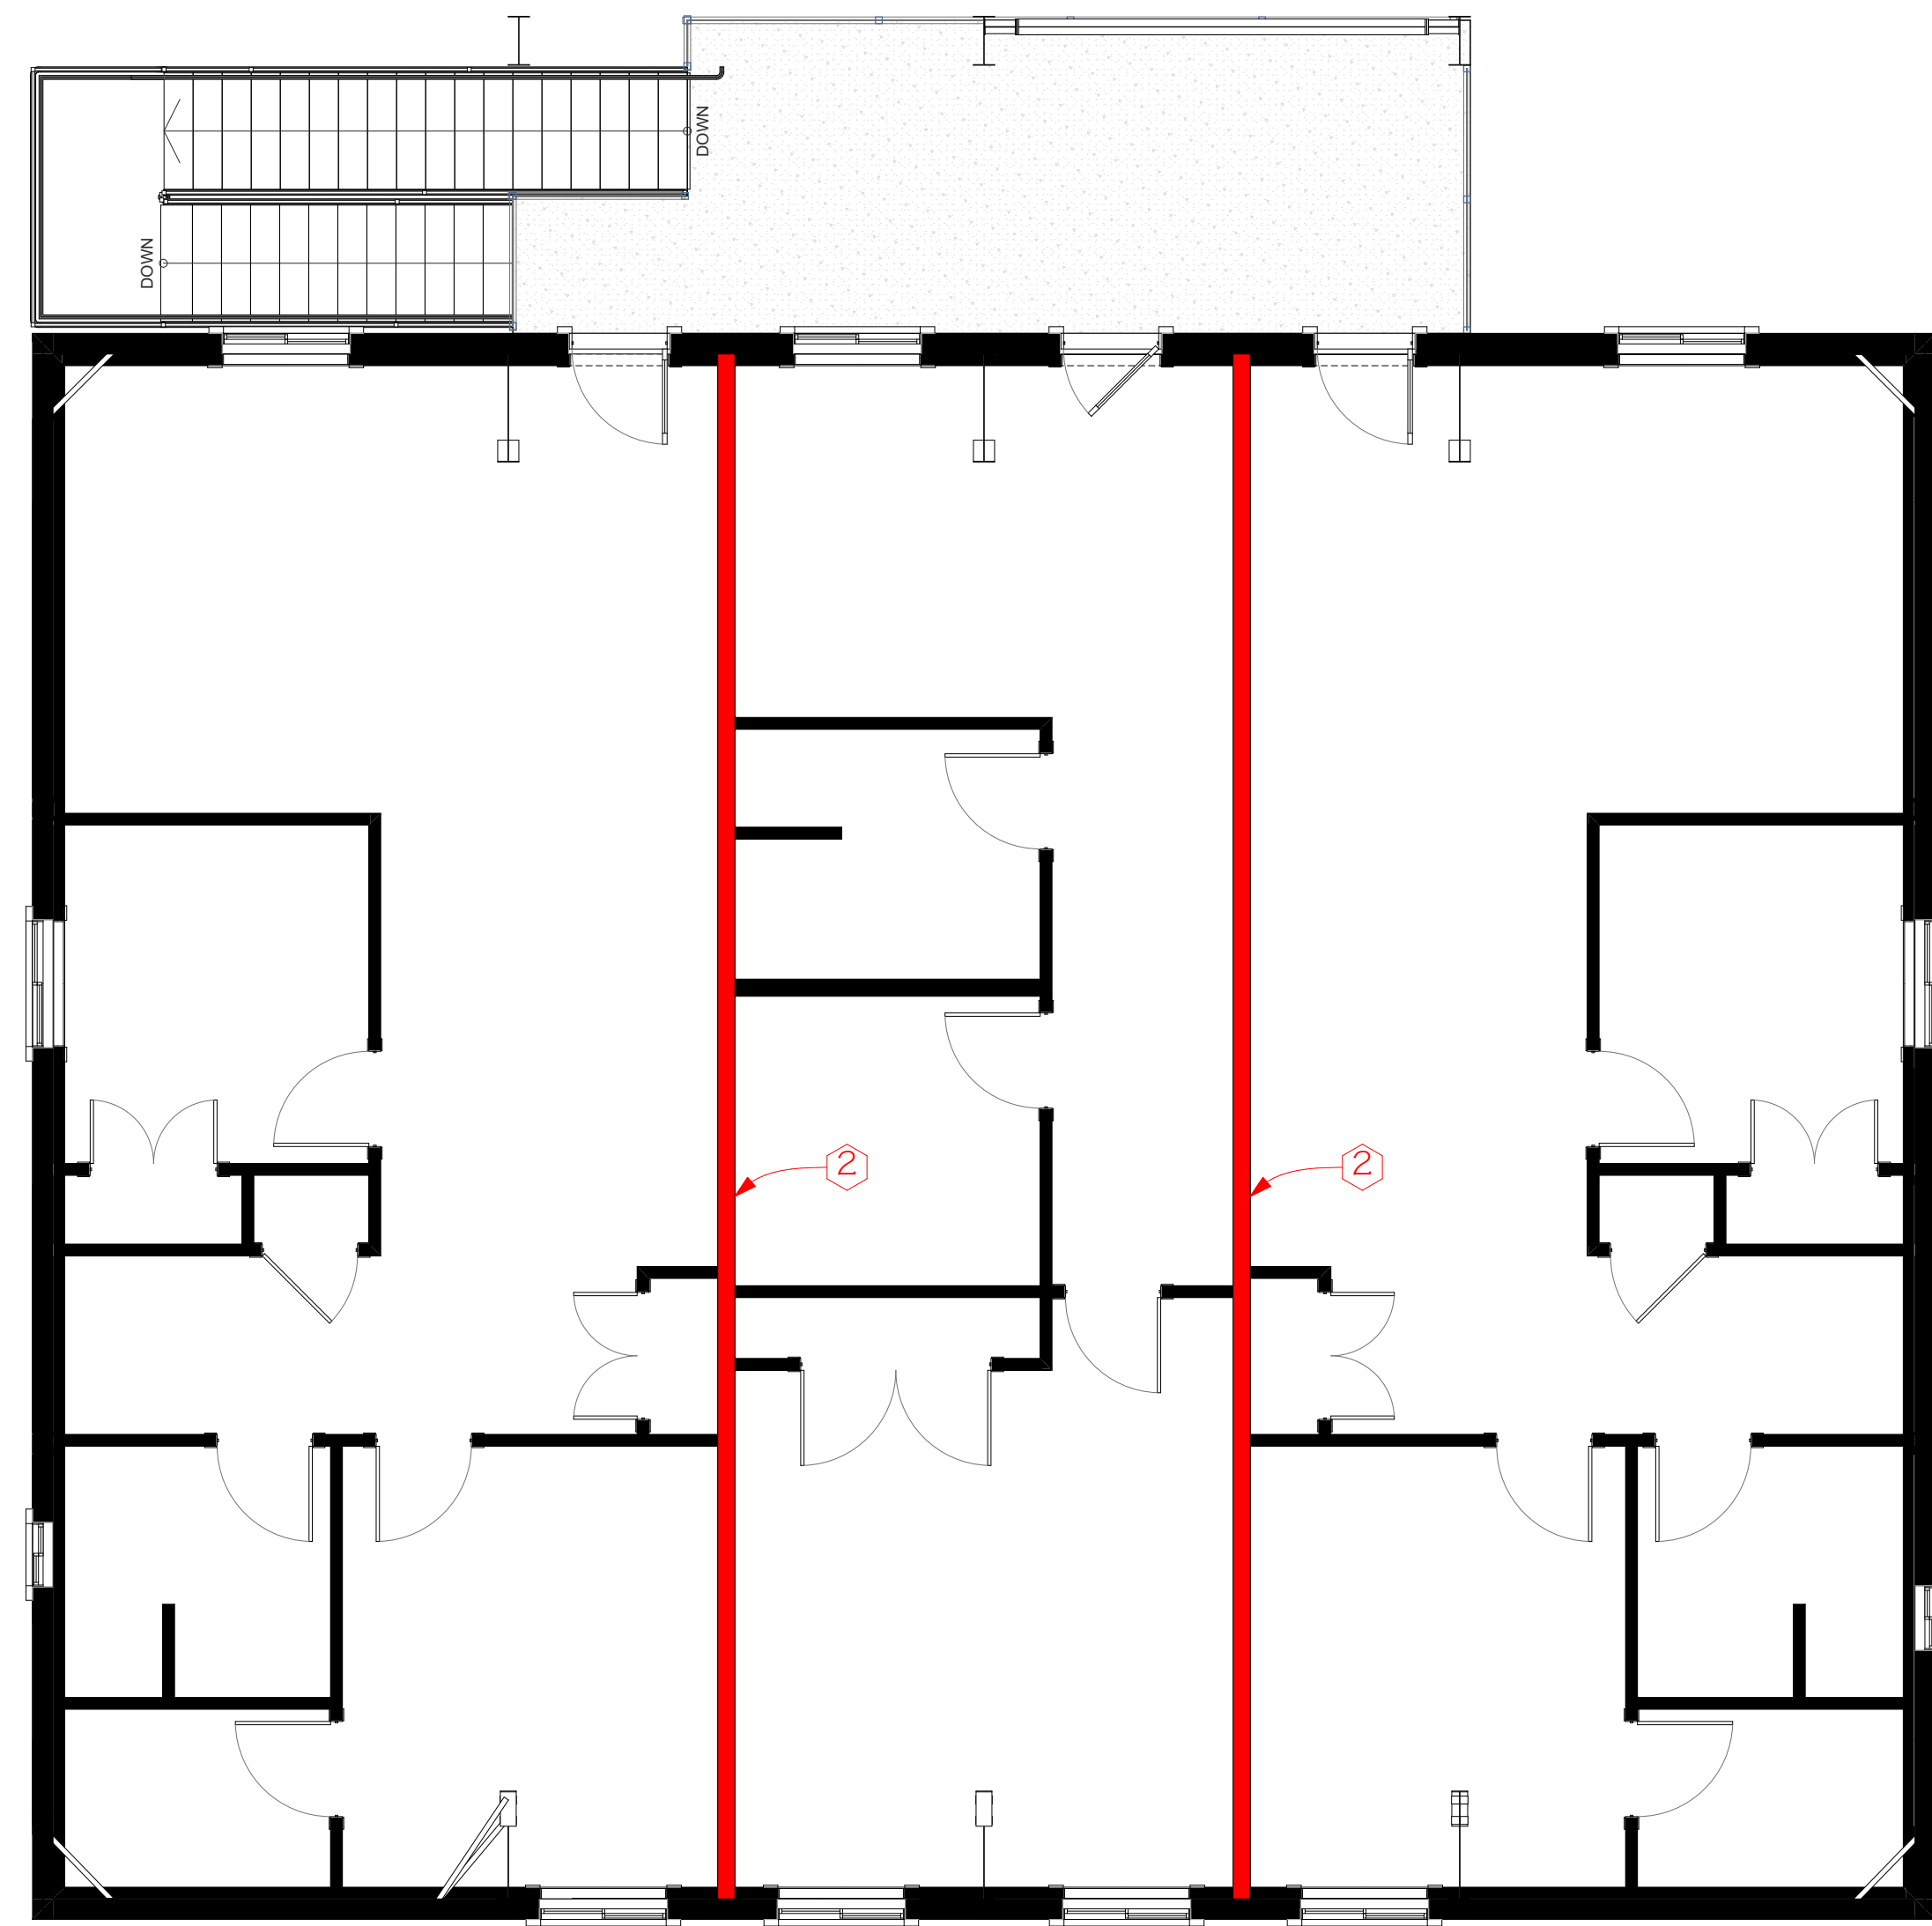

2 UPPER LEVEL FIRE
SCALE: 3/16" = 1'-0"

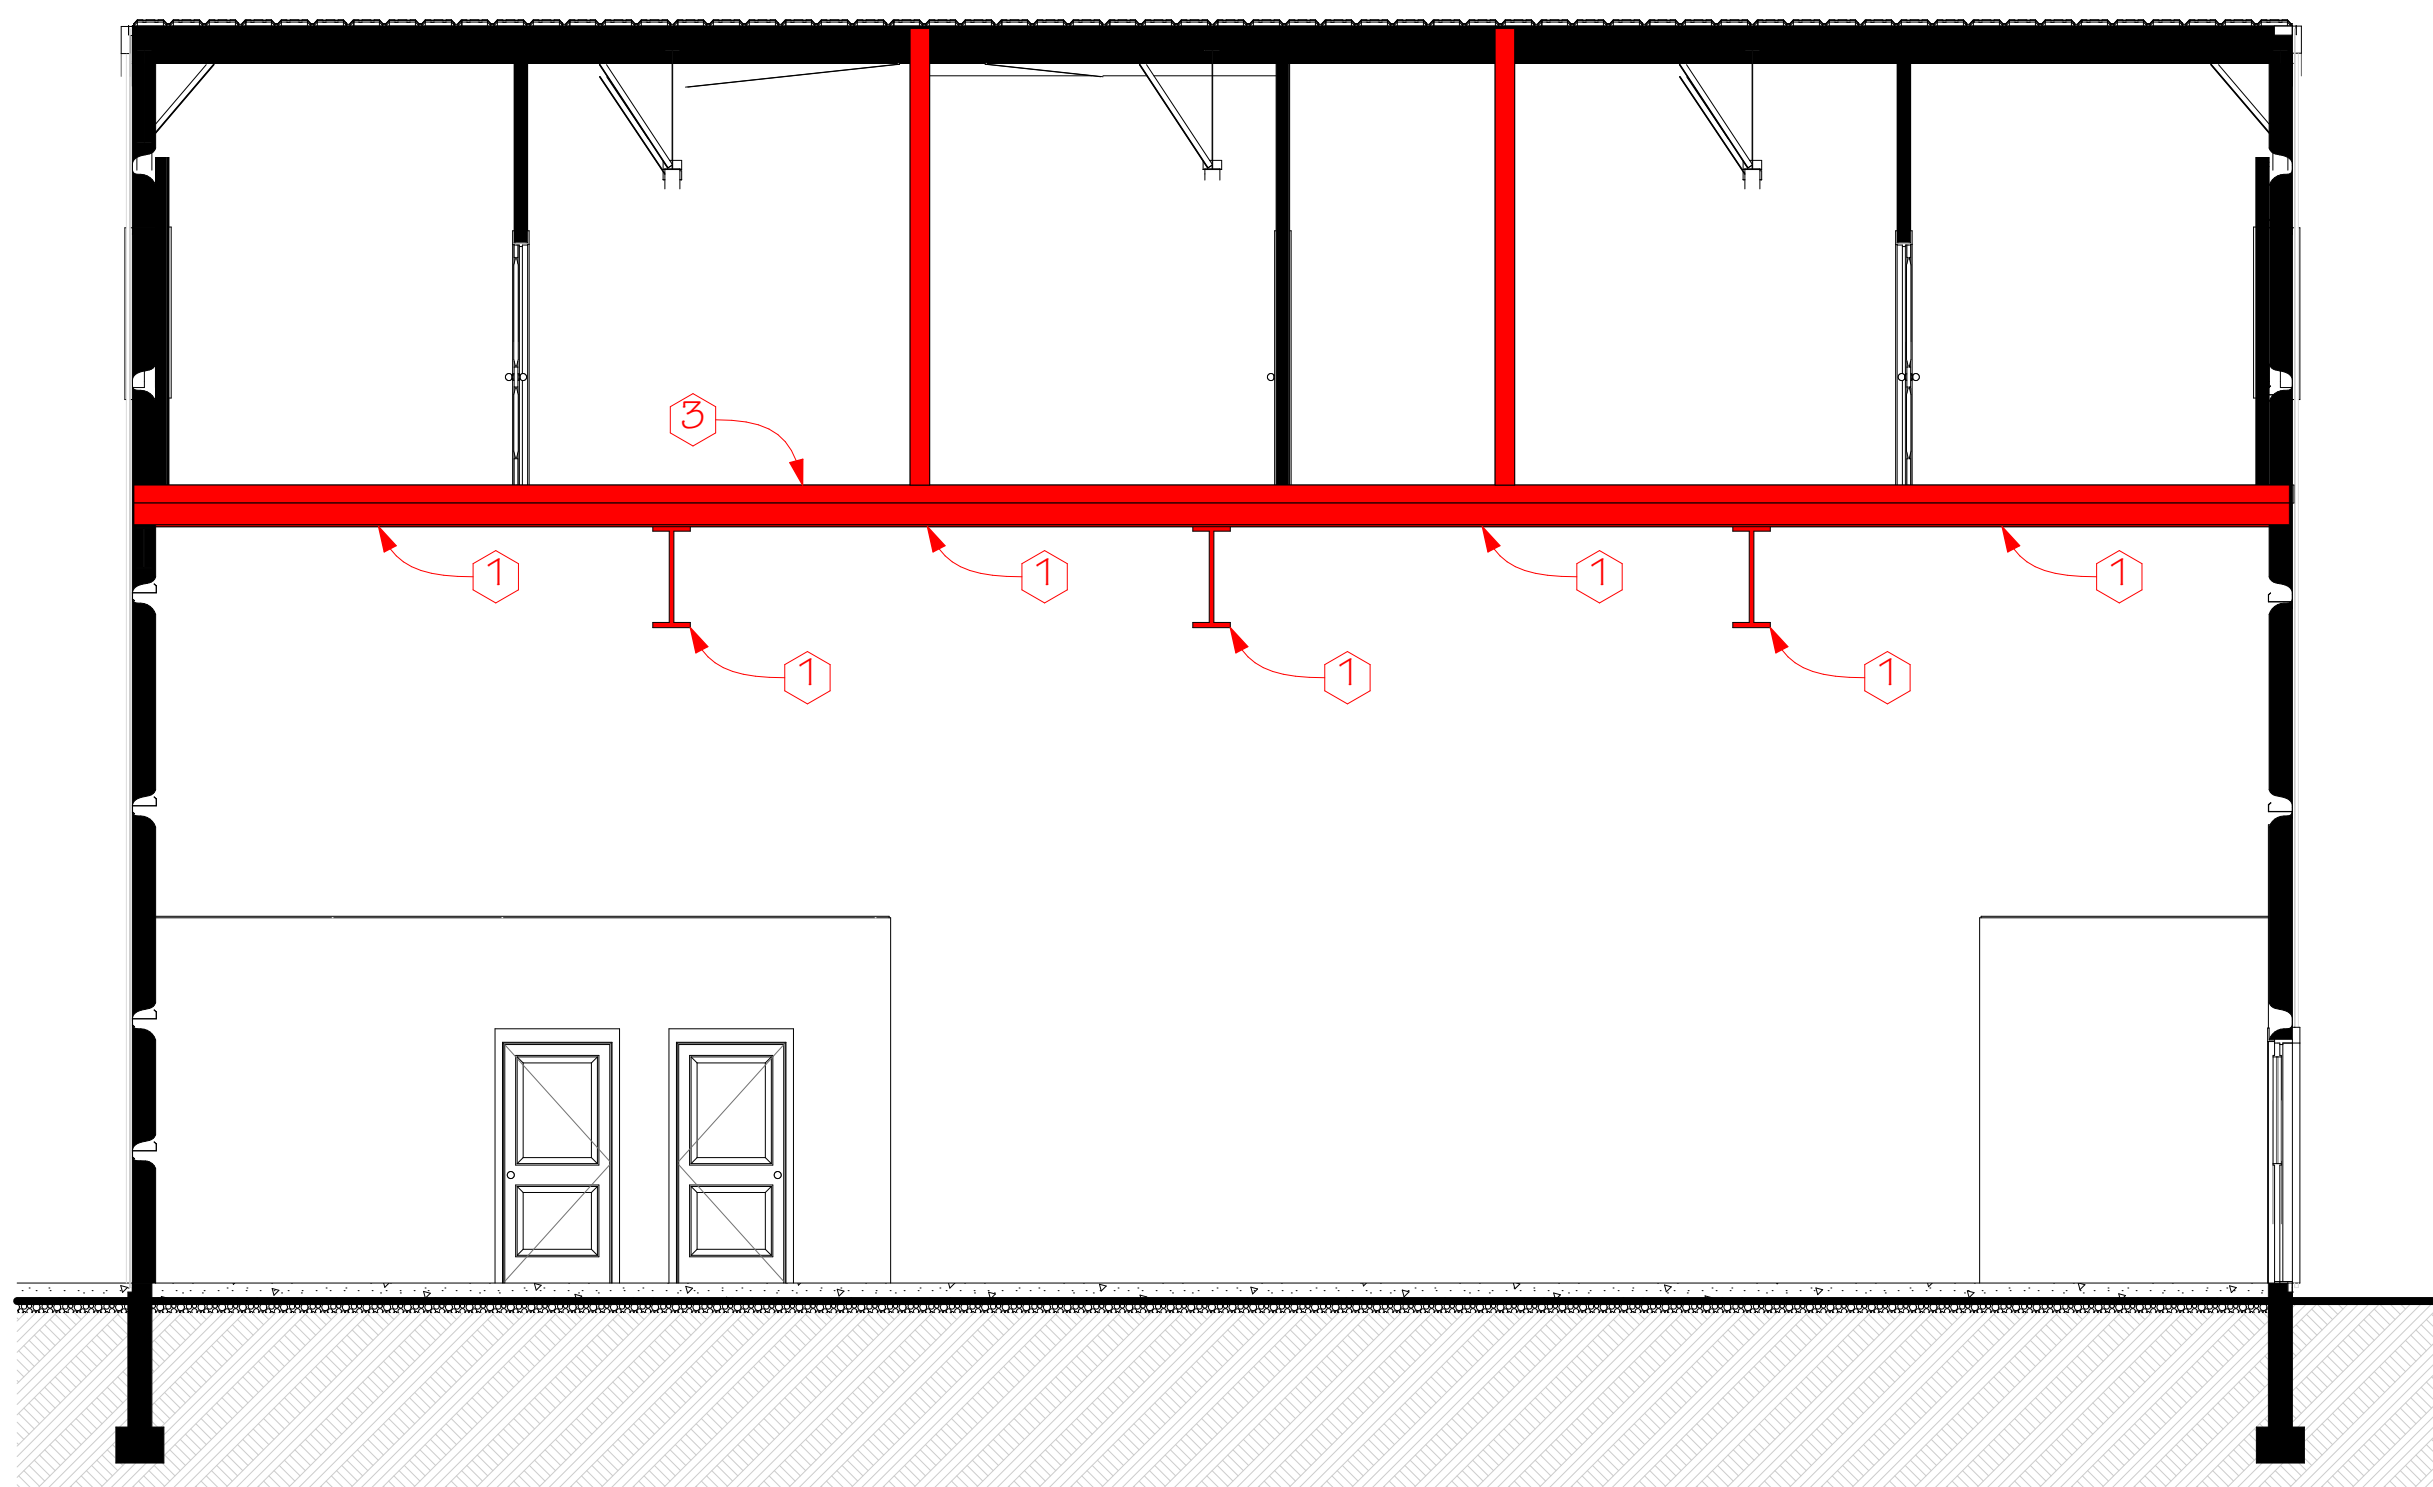

3 SECTION B FIRE
SCALE: 3/16" = 1'-0"

FIRE KEYNOTES:

- 1 1 HR FLOOR ASSEMBLY SUPPORTING CONSTRUCTION MUST BE PROTECTED PER 711.2.3 - 1 HR APPROVED INTUMESCENT COATING
- 2 1 HR PARTITION WALL AS UNIT SEPARATION - UL U309 (FOR SOUND) SEE FOLLOWING PAGE FOR DETAILS
- 3 1 HR HORIZONTAL ASSEMBLY PRESCRIPTIVE PER 721.1(3) - 1 3.5" THICKNESS W/ NO LESS THAN 3/4" COVERAGE OVER REINFORCEMENT

ENGINEER: RICHARD D SEAMONS
EIT: ###
DRAWN BY: BW
CHKD BY: ###
PLOT DATE: 5/16/2025

AFFITTAMI LLC - KATHERINE KRESAN - AUTO SERVICE ELEVATED
PARCEL NO: 37182030004500
ELK MEADOWS ADDITION LOT: 3

South Fork Design Group, LLC
127 E. Main St Suite 111
Rexburg, ID 83440
www.southforkdesign.com
208-852-6236



Professional Engineer
RICHARD D. SEAMONS
13700
WYOMING
THESE PLANS ARE STAMPED
ENGINEERED FOR THE
LOCATION SPECIFIED. IF
LOCATION CHANGES
REENGINEERING IS REQUIRED.

LIFE SAFETY - FIRE KEY	
REVISION DATE	DESCRIPTION

FIRE PARTITION WALL NOTES: (SEPARATION BETWEEN UPPER FLOOR UNITS) 708

Fire partitions must be continuous from the top of the fire-resistance-rated floor assembly below to one of the following:

- The underside of the fire-resistance-rated floor or roof sheathing, deck, or slab above.
- The underside of a ceiling assembly with a fire-resistance rating equal to or greater than the partition.
- The underside of a non-rated ceiling, provided the partition is constructed to intersect with the underside of the fire-resistance-rated floor or roof assembly above.

Supporting Construction: Per Section 708.4.2, the supporting structural elements (e.g., columns, beams) for fire partitions must have a fire-resistance rating not less than that required for the fire partition itself.

Penetrations: Penetrations through fire partitions (e.g., for pipes, ducts, or electrical conduit) must be protected with approved firestop systems or devices to maintain the fire-resistance rating, as specified in Section 714 - Penetrations.

Joints: Fire-resistant joint systems in fire partitions must be protected to maintain the required fire-resistance rating, per Section 715 - Fire-Resistant Joint Systems.

FLOOR HORIZONTAL ASSEMBLY NOTES: (SEPARATION BETWEEN UPPER FLOOR UNITS) - 711



Continuity (Section 711.2.2): Horizontal assemblies must be continuous without unprotected openings, penetrations, or joints that would compromise their fire-resistance rating, except as permitted by the code. They must extend:

- From exterior wall to exterior wall, or to a fire wall, fire barrier, or other vertical fire-resistance-rated assembly that maintains the separation.
- Vertically through the assembly to maintain the fire-resistance rating, ensuring no gaps or unprotected interruptions.


Supporting Construction (Section 711.2.3): Structural elements (e.g., columns, beams, or walls) supporting a fire-resistance-rated horizontal assembly must have a fire-resistance rating not less than that required for the horizontal assembly itself.

Penetrations (Section 711.2.4 and Section 714): Penetrations through horizontal assemblies (e.g., for pipes, ducts, or electrical systems) must be protected with approved firestop systems, through-penetration firestop systems, or devices to maintain the fire-resistance rating, as specified in Section 714 - Penetrations.

Joints (Section 711.2.5 and Section 715): Joints in or between horizontal assemblies (e.g., expansion or construction joints) must be protected with fire-resistant joint systems to maintain the required fire-resistance rating, per Section 715 - Fire-Resistant Joint Systems.

GA FILE NO. WP 3246	PROPRIETARY*	1 HOUR FIRE	50 to 54 STC SOUND
GYPSUM WALLBOARD, GYPSUM PANEL PRODUCT, WOOD STUDS			
Fire Design: One layer 5/8" proprietary gypsum board applied parallel to ONE SIDE of 2 x 4 wood studs 24" o.c. with 6d coated nails, 1-7/8" long, 0.0915" shank, 1/4" heads, 7" o.c. OPPOSITE SIDE: One layer 5/8" proprietary gypsum panel product applied parallel to studs with 6d coated nails, 1-7/8" long, 0.0915" shank, 1/4" heads, 7" o.c. Joints staggered 24" on OPPOSITE SIDES. (LOAD-BEARING)			
Sound Design: Sound tested with screws 12" o.c. and 3-1/2" glass fiber insulation friction fit in stud space.		Thickness: 4-3/4" (Fire and Sound) Approx. Weight: 7 psf (Fire and Sound) Fire Test: UL R3660, 10CA25812, 8-17-10, Sound Test: UL Design U309 OL 11-0616, 6-20-11	
PROPRIETARY GYPSUM PANEL PRODUCT			
CertainTeed Gypsum Inc. 5/8" CertainTeed® Type X Gypsum Board 5/8" SilentFX® QuickCut™			
EXCERPT FROM GA-600-2018 FIRE RESISTANCE AND SOUND CONTROL DESIGN MANUAL			

2 UL309 FIRE PARTITION
NOT TO SCALE

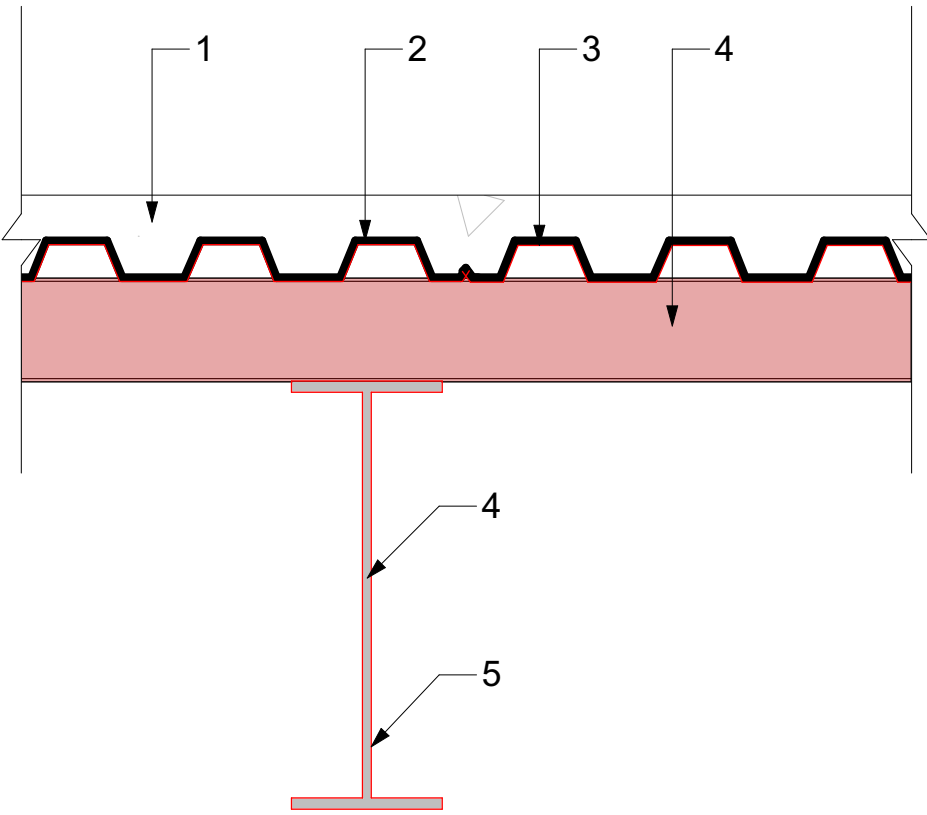

HORIZONTAL FLOOR ASSEMBLY: 711.2


- 1 - SLAB PRESCRIPTIVE PER 721.1(3) - 1 3.5" THICKNESS W/ NO LESS THAN 3/4" COVERAGE OVER REINFORCEMENT
- 2 - B-DECKING
- 3 - COAT UNDERSIDE OF B-DECKING WITH APPROVED 1-HR INTUMESCENT COATING OR OTHER APPROVED
- 4 - STRUCTURAL FRAME
- 5 - COAT STRUCTURAL FRAME WITH APPROVED 1-HR INTUMESCENT COATING OR OTHER APPROVED
- 4 - PRIMARY STRUCTURAL FRAME
- 7 - COAT STRUCTURAL FRAME WITH APPROVED 1-HR INTUMESCENT COATING OR OTHER APPROVED

1 HORIZONTAL FLOOR ASSEMBLY
NOT TO SCALE

ENGINEER: RICHARD D SEAMONS	###		
EIT:	###		
DRAWN BY: BW	###		
CHKD BY: ###	###		
PLOT DATE: 5/16/2025			

AFFITTAMI LLC - KATHERINE KRESAN - AUTO SERVICE ELEVATED	PARCEL NO: 37182030004500	LOT: 3
ELK MEADOWS ADDITION		


South Fork Design Group, LLC
127 E. Main St, Suite 111
Rexburg, ID 83440
www.southforkdesign.com
208-852-6236

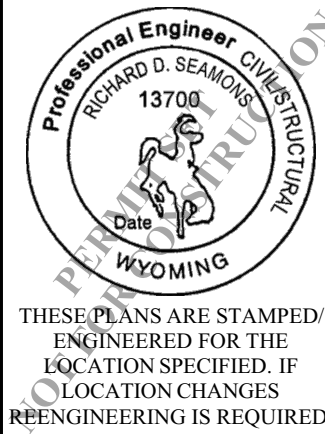

THESE PLANS ARE STAMPED
ENGINEERED FOR THE
LOCATION SPECIFIED. IF
LOCATION CHANGES
REENGINEERING IS REQUIRED.

LIFE SAFETY - FIRE DETAIL	
REVISION DATE	DESCRIPTION

NOTE: THIS SURVEY WAS PERFORMED AND CREATED BY MARLOWE A. SCHERBEL.
IT IS PUT ON THIS PAGE FOR REFERENCE ONLY.
THIS PAGE IS NOT TO SCALE.

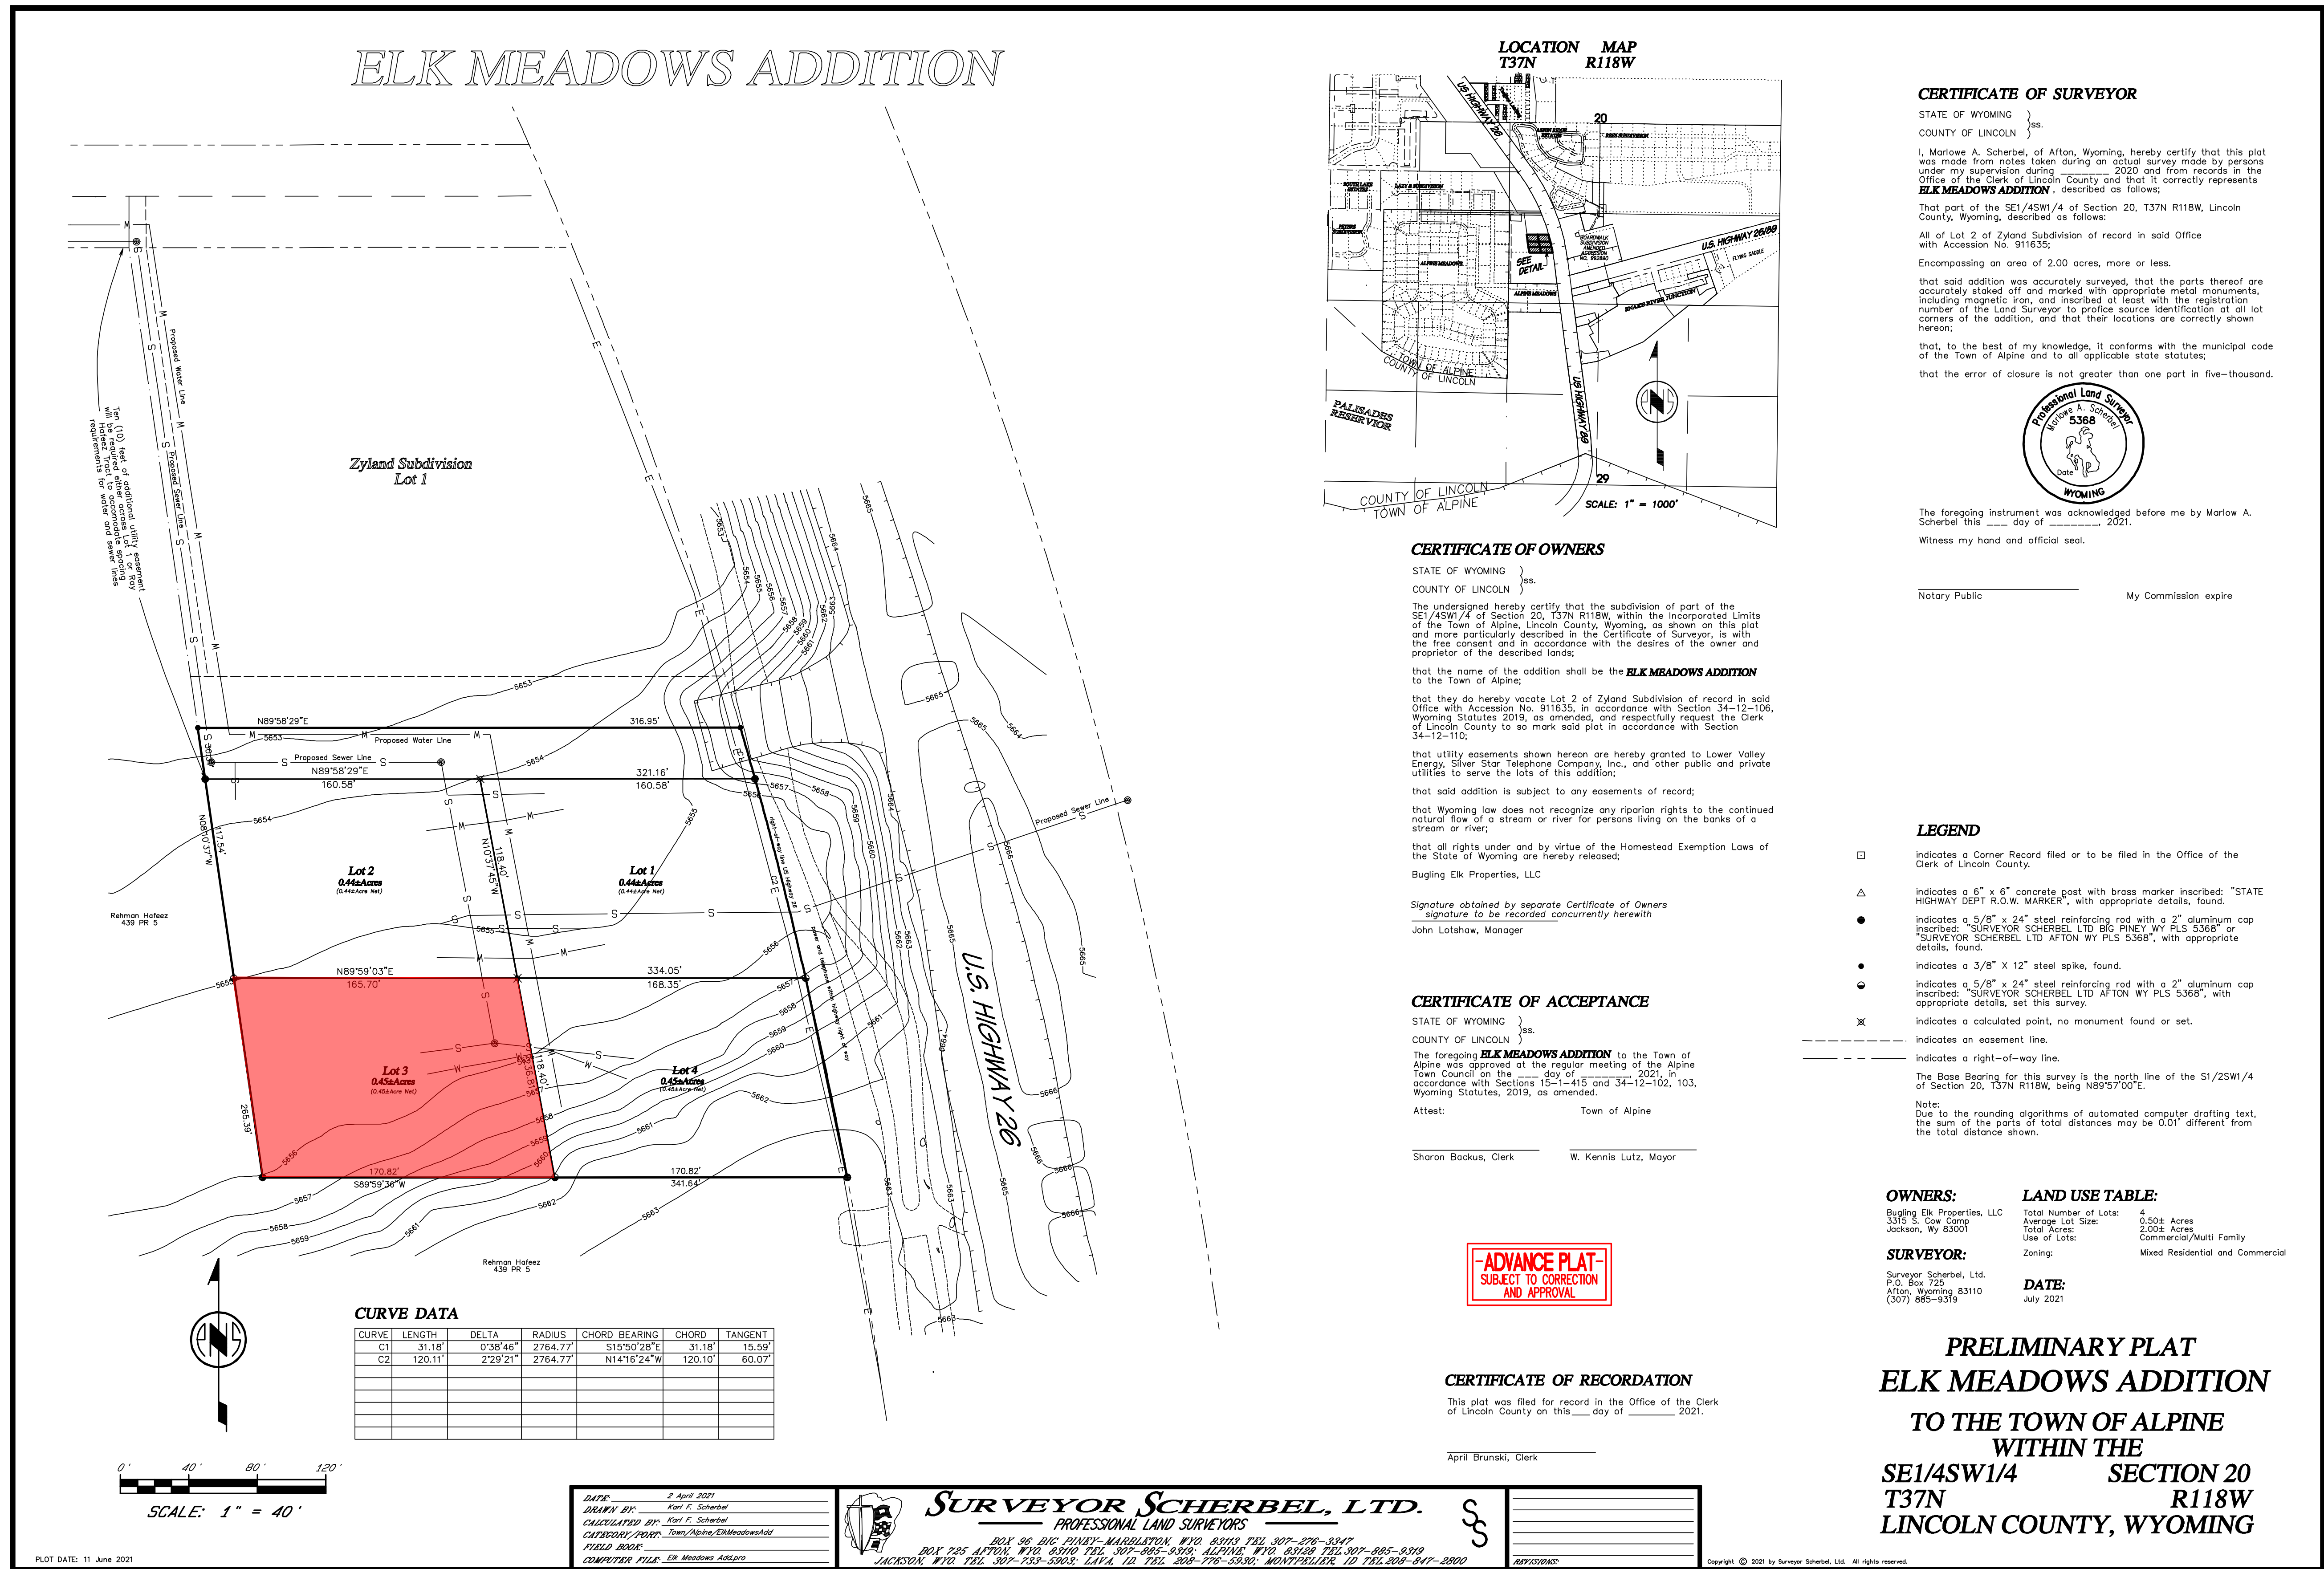

ENGINEER: RICHARD D SEAMONS
EIT: ###
DRAWN BY: BW
CHKD BY: ###
PLOT DATE: 5/16/2025


AFFITAMI LLC - KATHERINE
KRESAN - AUTO SERVICE
ELEVATED
PARCEL NO: 37182030004500
ELK MEADOWS ADDITION LOT: 3


South Fork Design Group, LLC
127 E. Main St, Suite 111
Rexburg, ID 83440
www.southforkdesign.com
208-852-6236

SOUTH FORK
DESIGN

RECORDED SURVEY
REVISION DATE
DESCRIPTION


C-102
PLN# 25-01-009

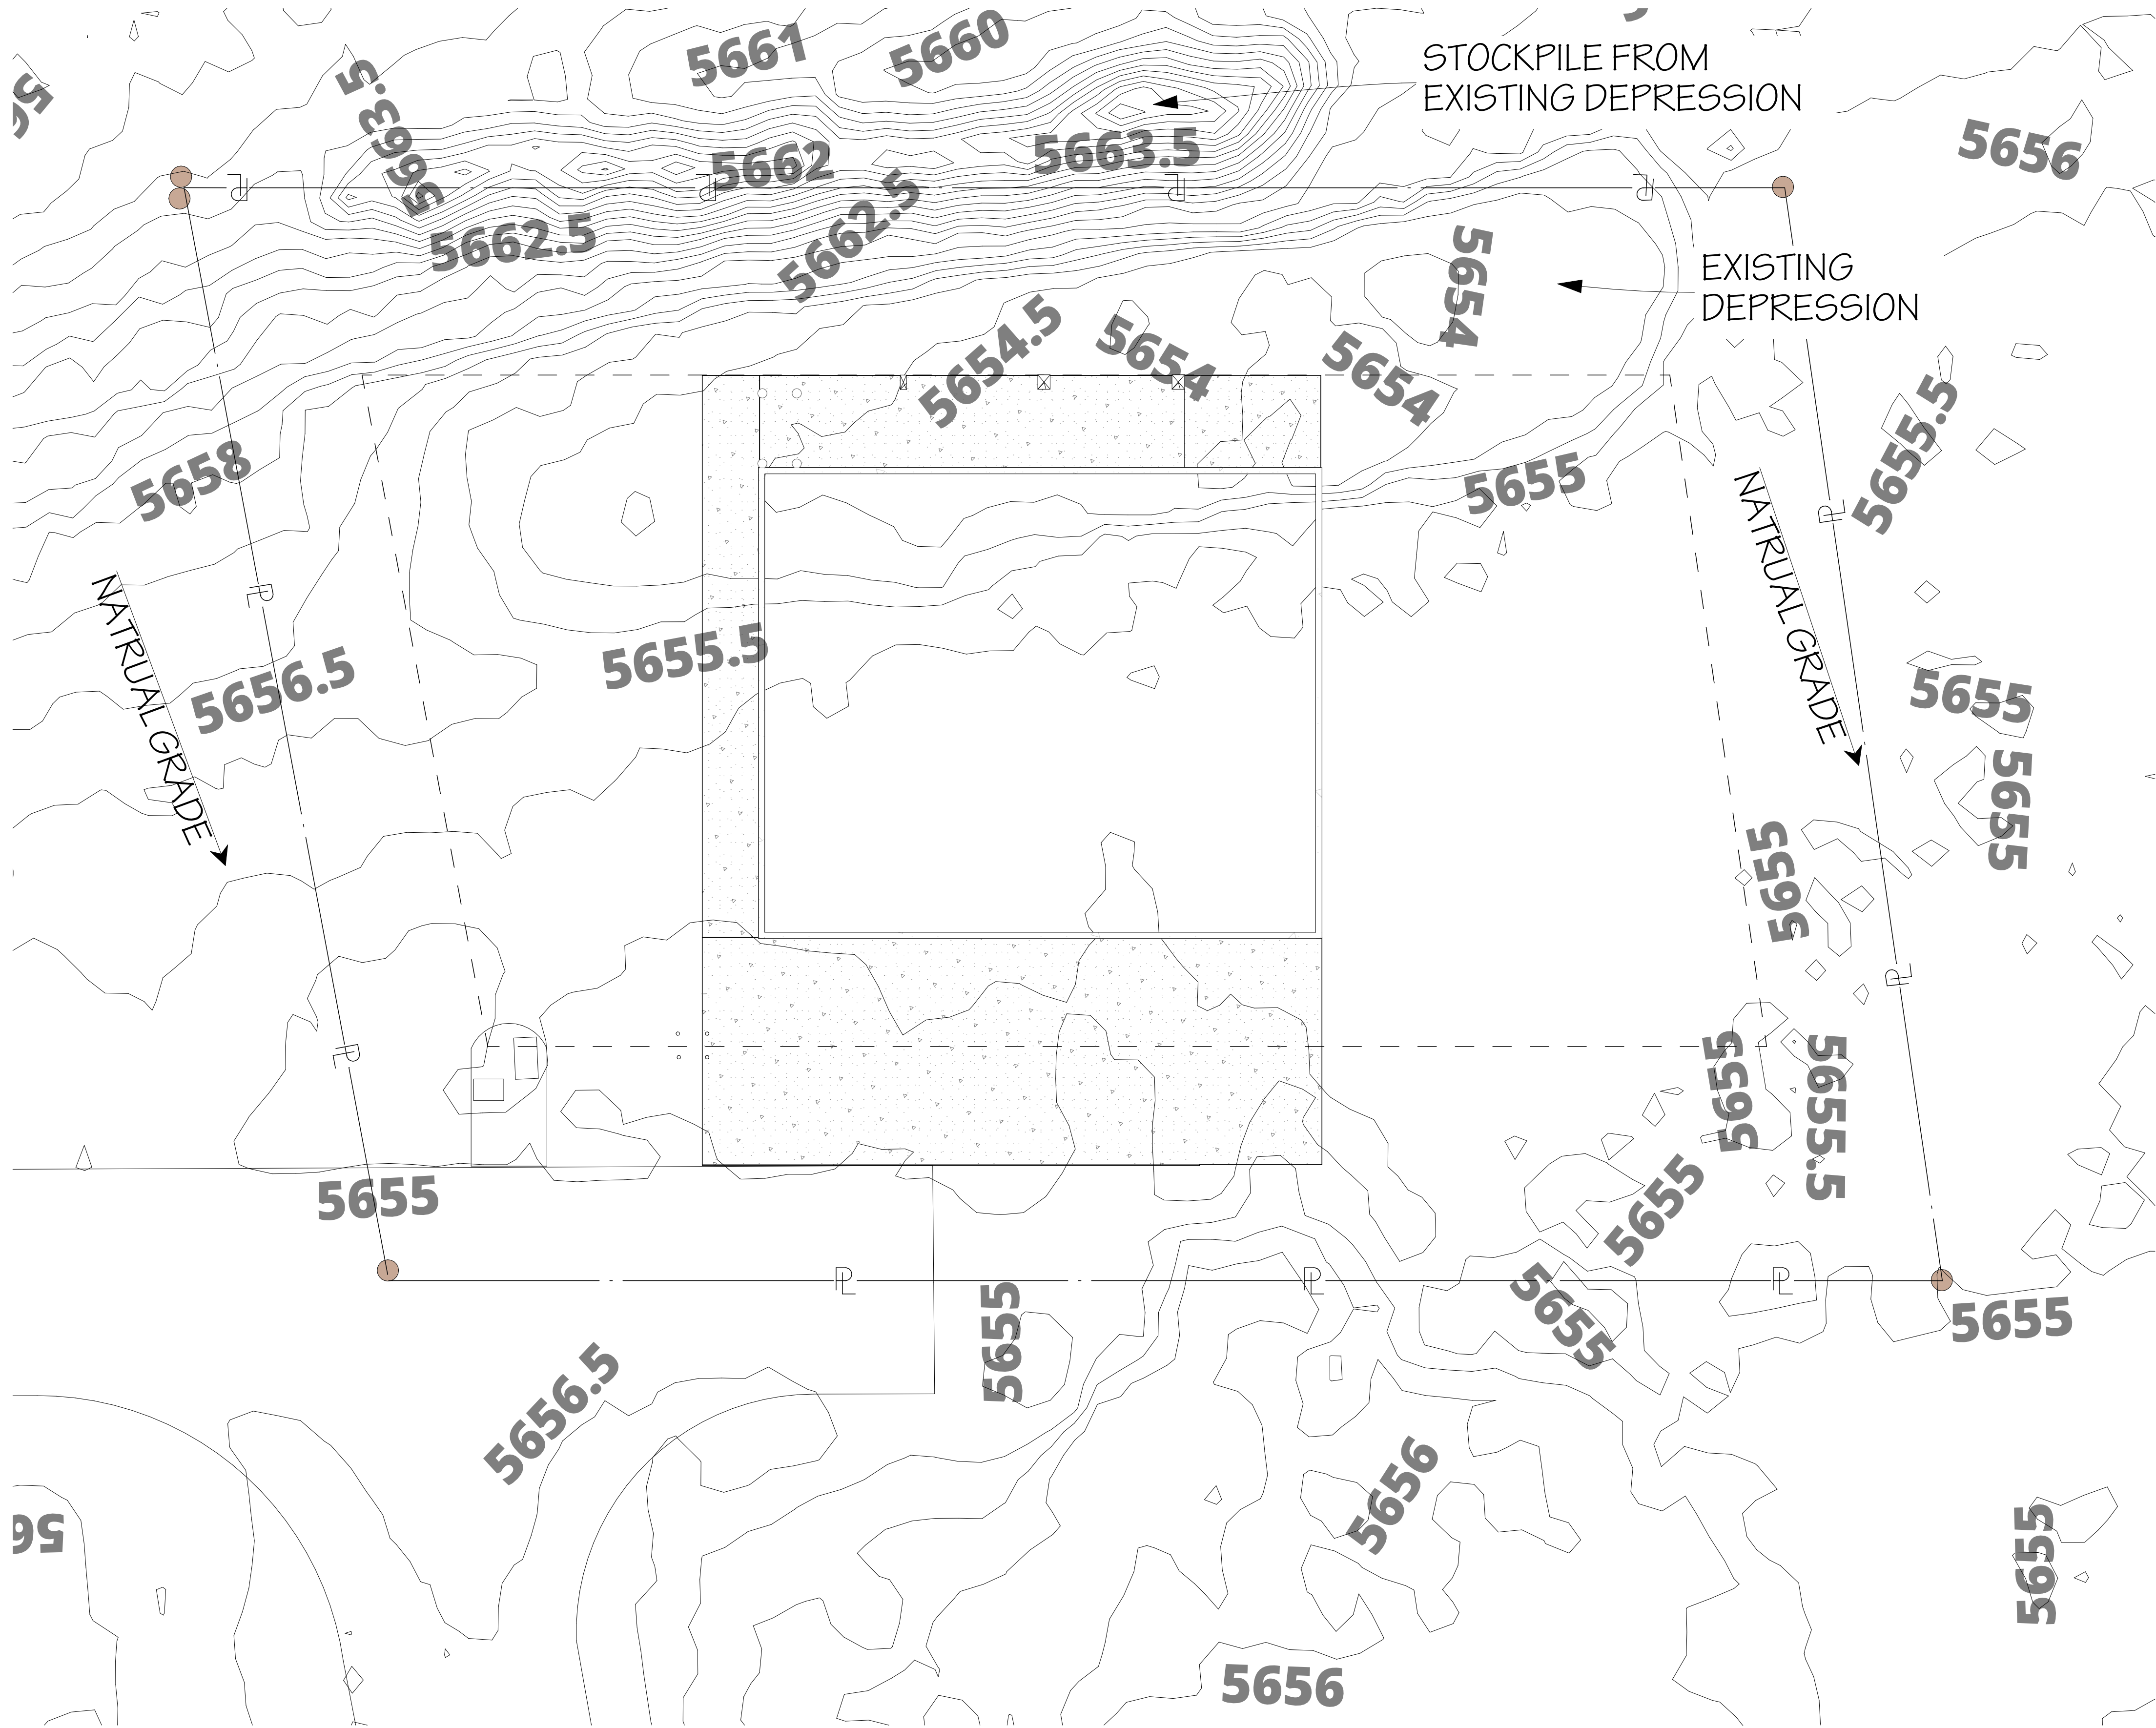

 **SITE CONTOURS**
SCALE: 1" = 10'

SHEET TITLE: SITE CONTOURS	
REVISION DATE	DESCRIPTION

C-103
PLN# 25-01-009




SOUTH FORK
DESIGN

South Fork Design Group, LLC
127 E. Main St. Suite 111
Rexburg, ID 83440
www.southforkdesign.com
208-852-6236

Copyright 2025 | South Fork Design | All Rights Reserved.

AFFITTAMI LLC - KATHERINE KRESAN - AUTO SERVICE ELEVATED
PARCEL NO: 37182030004500
ELK MEADOWS ADDITION LOT: 3

ENGINEER: RICHARD D SEAMONS
EIT: ###
DRAWN BY: BW
CHKD BY: ###
PLOT DATE: 5/16/2025

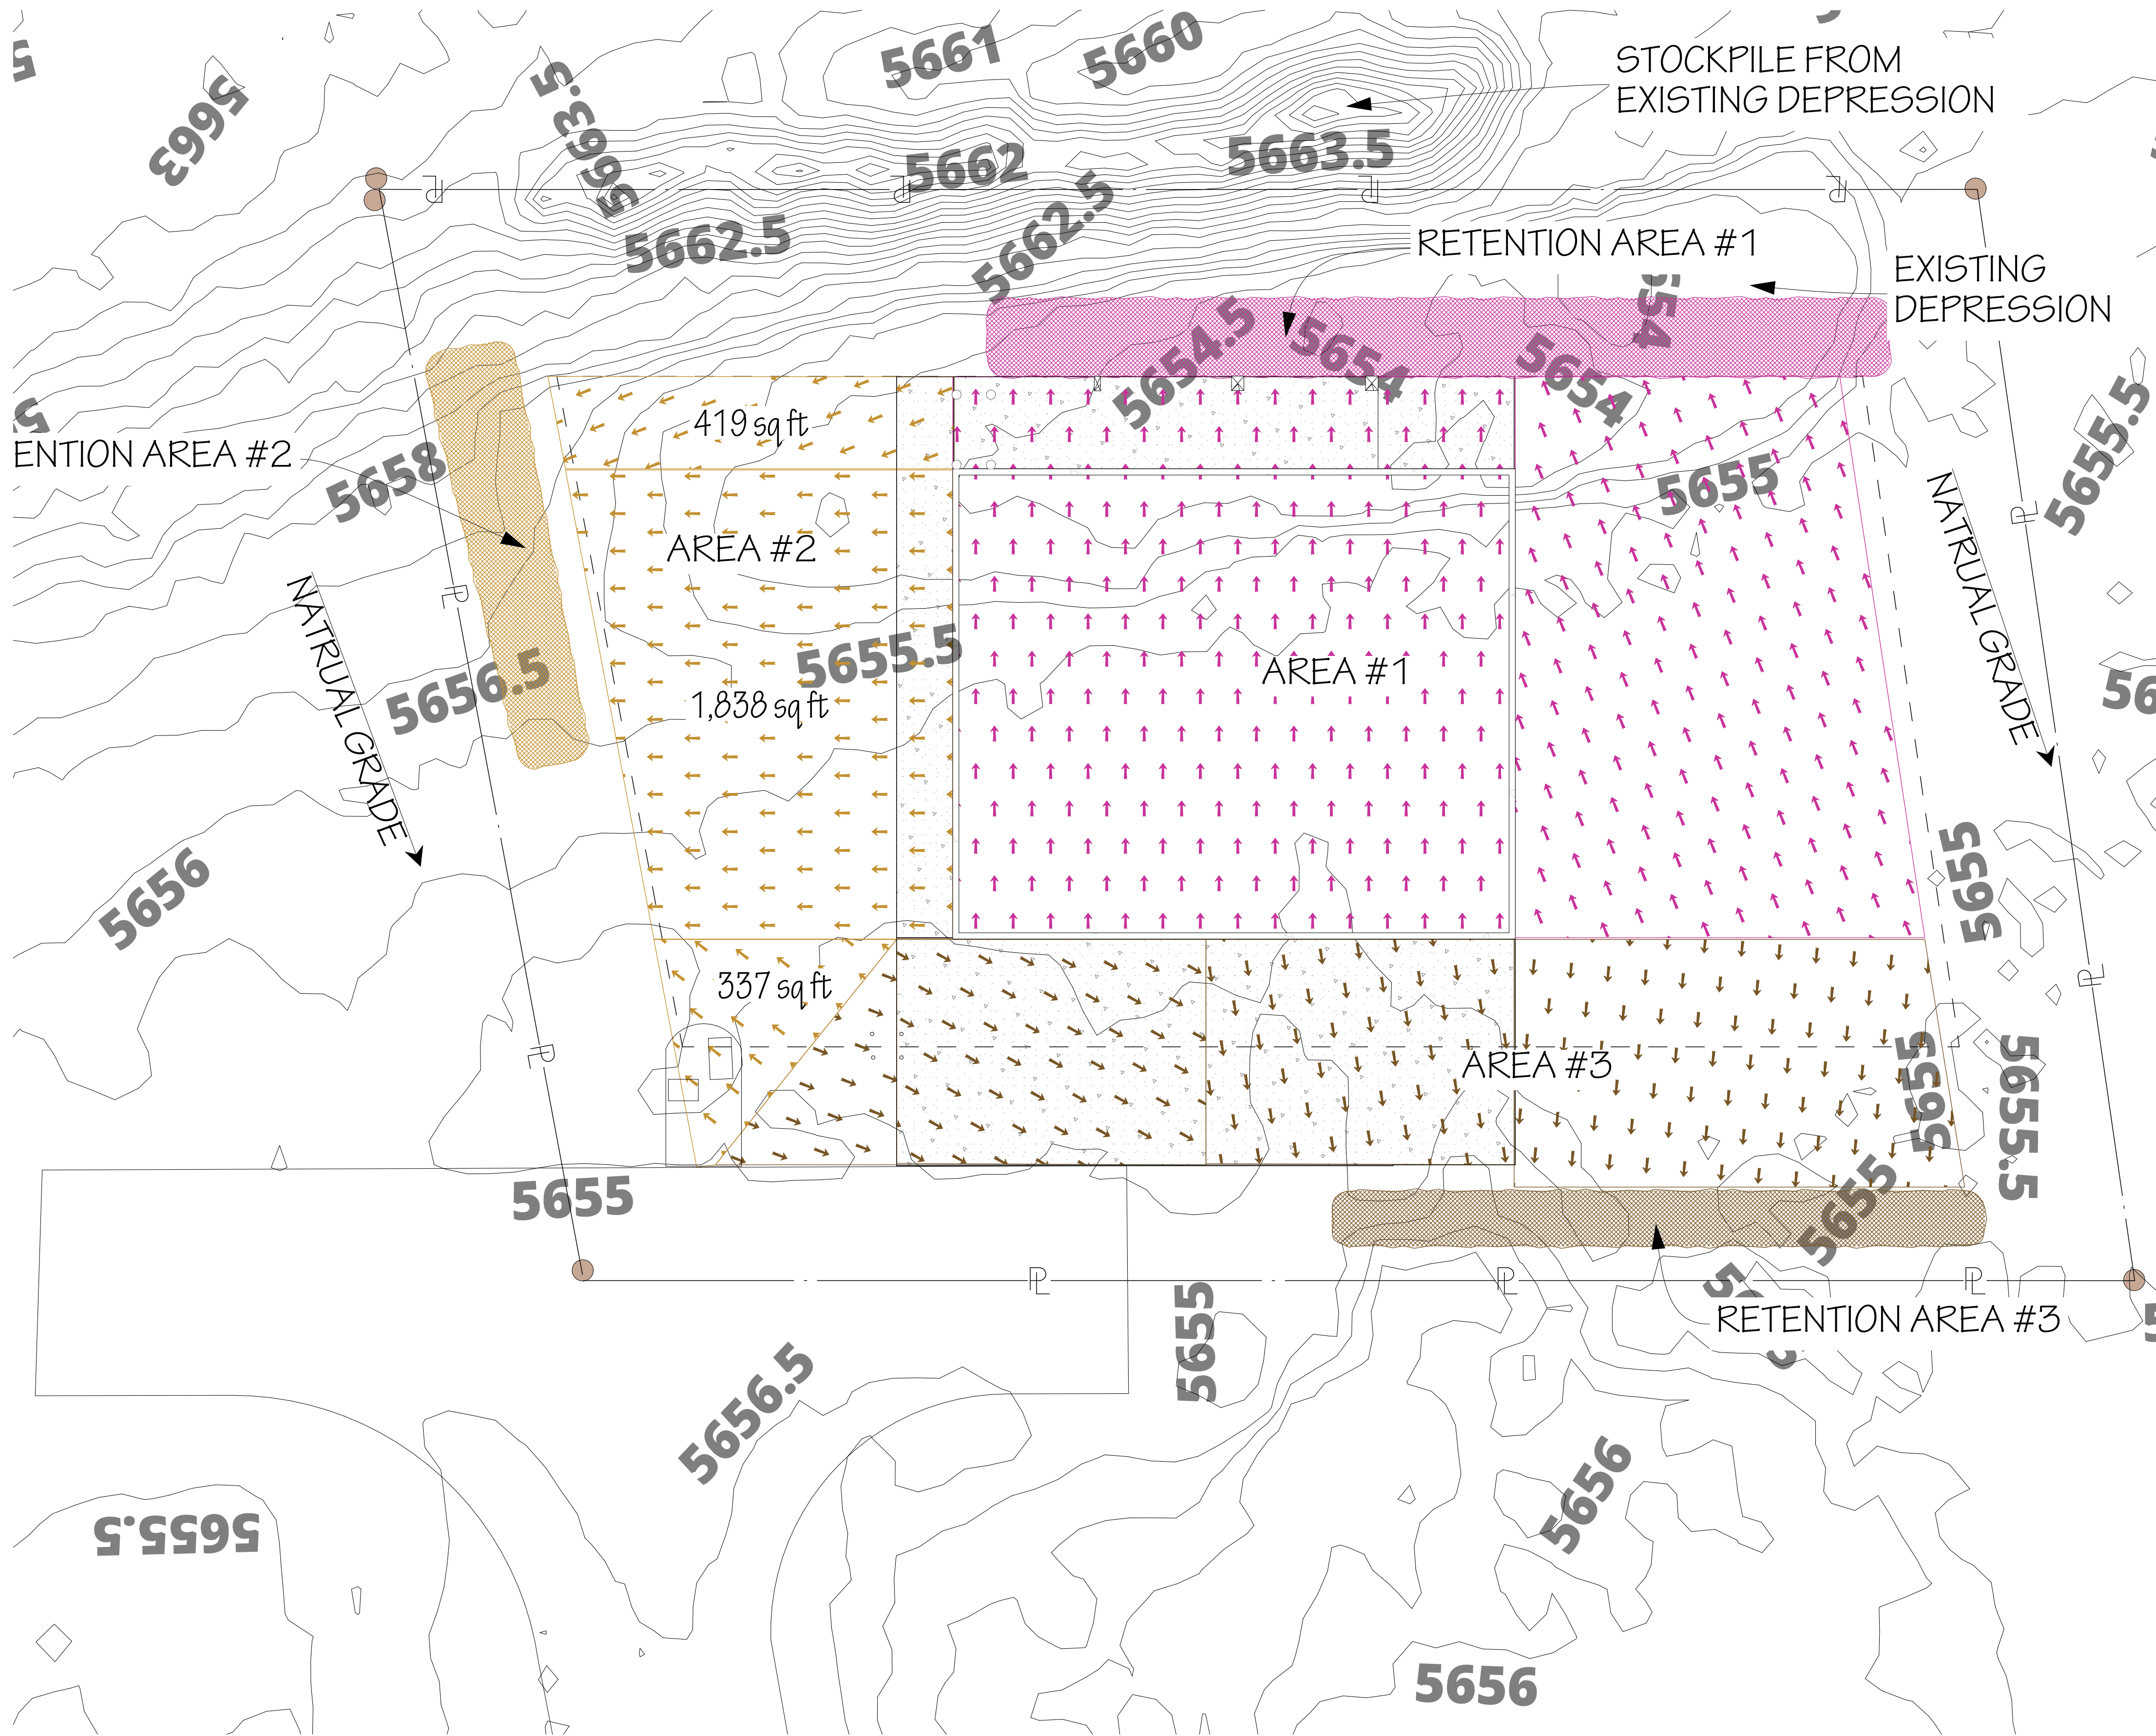

SITE WATER RETENTION
SCALE: 1" = 10'

STORMWATER NARRATIVE:

THIS PLAN IS TO FULFILL THE REQUIREMENTS OF THE TETON COUNTY LAND AND DEVELOPMENT CODE, 2022 SECTIONS 5-2-3. A DRAINAGE PLAN IS NEEDED DUE TO REQUIREMENTS LISTED IN THE TETON COUNTY LDC, 2022 5-2-3 B.

THIS PLAN IS DESIGNED TO MANAGE ONE HUNDRED PERCENT (100%) OF THE 95TH PERCENTILE RAINFALL EVENT ON SITE AND SHALL NOT BE ALLOWED TO DISCHARGE OFFSITE TO SURFACE WATERS.

1. THE 95TH PERCENTILE RAINFALL EVENT, ALSO KNOWN AS THE WATER QUALITY CAPTURE VOLUME (WQCV), FOR TETON COUNTY IS 0.65-INCHES FALLING OVER A 24-HOUR PERIOD BASED ON THE PERIOD OF RECORD FROM 1927 TO 1982 FOR THE DRIGGS RAIN GAUGE (USC00102676). THUS, 95% OR DAILY STORM EVENTS ARE ESTIMATED TO HAVE A DEPTH OF 0.65-INCHES OR LESS.
2. TOTAL RUNOFF VOLUME FROM A SITE SHOULD BE DETERMINED USING THE DIRECT DETERMINATION METHOD, WHICH TAKES INTO ACCOUNT RAINFALL, DEPRESSION STORAGE, AND INFILTRATION. THE HYDROLOGIC SOIL GROUP FROM THE SITE SHOULD BE USED TO DETERMINE ESTIMATED INFILTRATION ON THE SITE.
3. EXAMPLES OF STORMWATER FACILITIES THAT CAN BE USED TO MANAGE AND INFILTRATE THE WQCV INCLUDE BUT ARE NOT LIMITED TO, BIO-RETENTION AREAS, STORMWATER PLANTER BOXES, VEGETATED SWALES, INFILTRATION TRENCHES, INFILTRATION WELLS, PERMEABLE PAVEMENTS, CISTERNS ADN RAINWATER HARVESTING SYSTEMS, AND GREEN ROOFS.

NOTE:
THE RUNOFF FLOW RATE, VELOCITY, AND VOLUME POST-DEVELOPMENT SHALL BE EQUAL TO OR LESS THAN THE PRE-DEVELOPMENT RUNOFF FLOW RATE AND VOLUME FOR THE 10-YEAR AND 100-YEAR EVENT. IF THIS CONDITION CANNOT BE MET SPECIAL APPROVAL MUST BE OBTAINED BY THE COUNTY PUBLIC WORKS DIRECTOR, ADN THE APPLICATION MUST SHOW THAT ALL DOWNSTREAM FACILITIES ARE ADEQUATE TO CONVEY THE POST-DEVELOPMENT FLOWS.

RETENTION AREA FOR STORMWATER COLLECTION			
RETENTION AREA	AREA (FT²)	DEPTH (IN)	VOLUME(FT³)
AREA #1	806	5"	335.75
AREA #2	397	4"	132.33
AREA #3	415	5"	172.81

$$(collection\ area(ft^2) \times 0.65_{in}) \times \left(\frac{1_{ft}}{12_{in}}\right) = collected\ water\ volume(ft^3)$$

STORMWATER RUNOFF AREA	
RUNOFF AREA	SQ FT
AREA #1	5,972
AREA #2	2,594
AREA #3	3,036

ENGINEER: RICHARD D SEAMONS
EIT: ###
DRAWN BY: BW
CHKD BY: ###
PLOT DATE: 5/16/2025


AFFITAMI LLC - KATHERINE
KRESAN - AUTO SERVICE
ELEVATED
PARCEL NO: 37182030004500
ELK MEADOWS ADDITION LOT: 3

South Fork Design Group, LLC
127 E. Main St, Suite 111
Rexburg, ID 83440
www.southforkdesign.com
208-852-6236
Copyright 2025 | South Fork Design | All Rights Reserved.

SOUTH FORK
DESIGN


SHEET TITLE: SITE STORMWATER	
REVISION DATE	DESCRIPTION

1 MAIN LEVEL PLAN
SCALE: 1/4" = 1'-0"

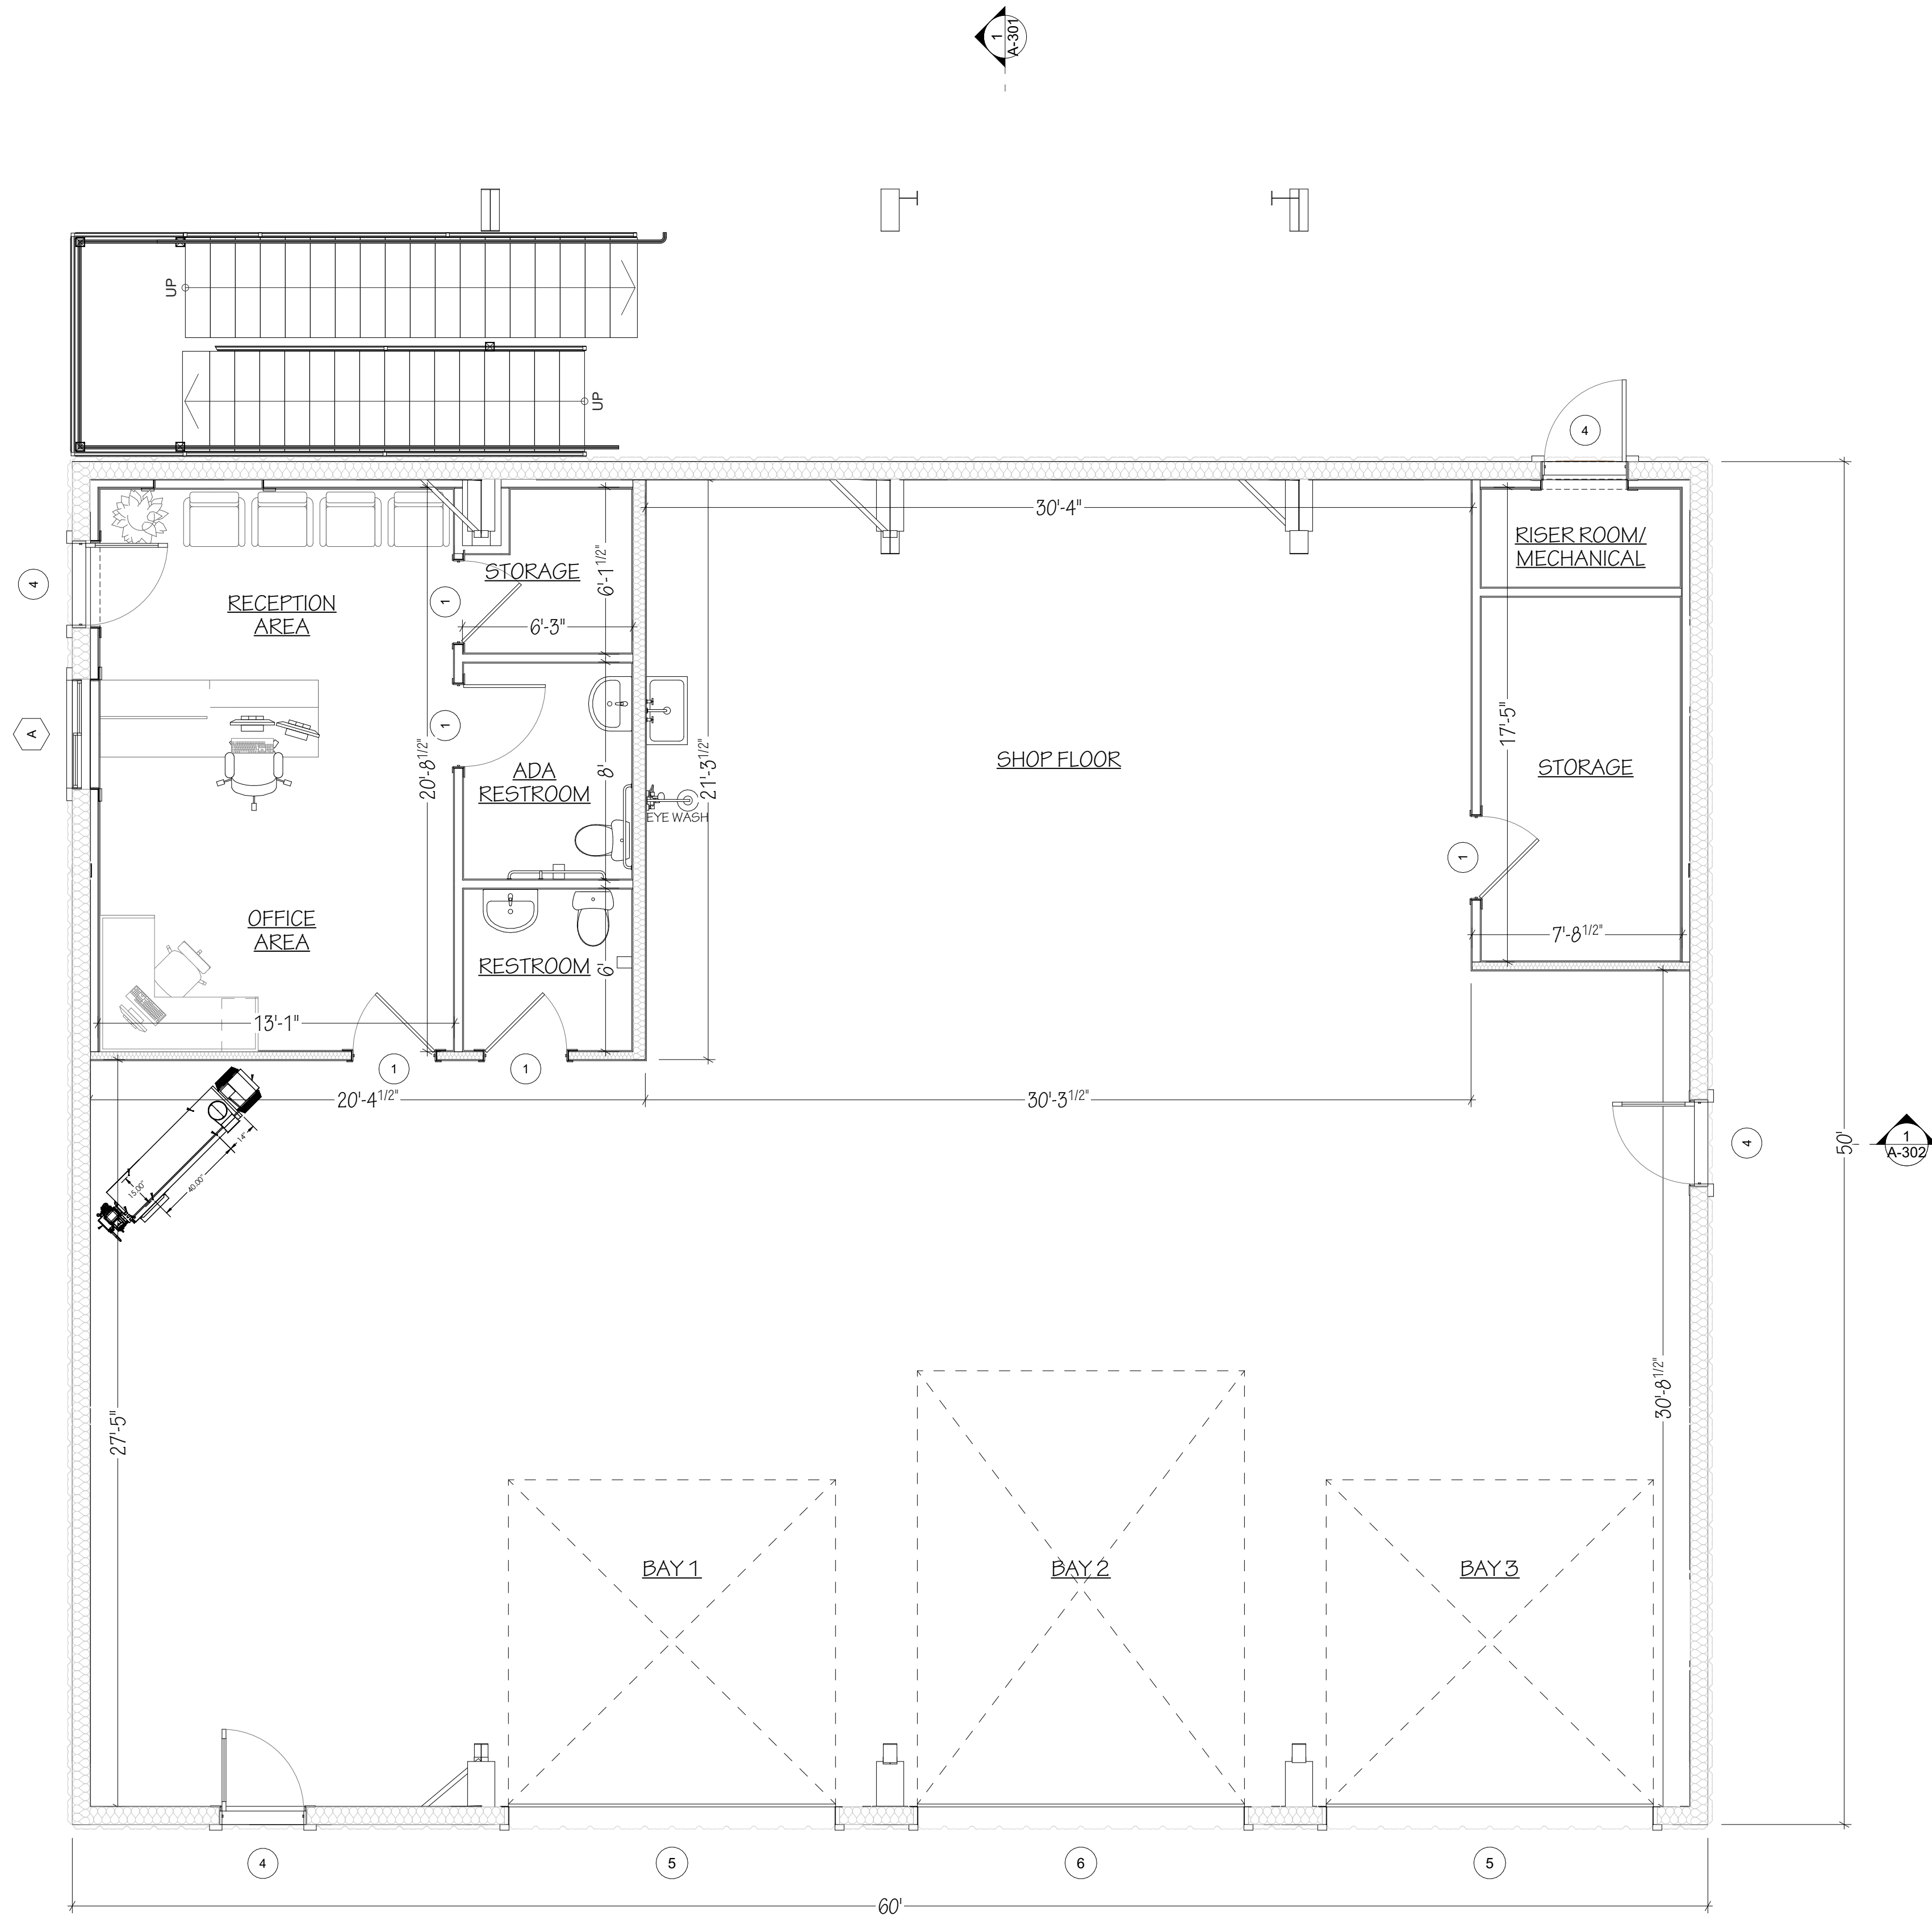

WINDOW SCHEDULE							
ID	TYPE	QTY	SIZE		HEAD HEIGHT	TEMPERED	NOTES
			W	HT			
A	TBD	1	4'	3'	6'-8"	---	
B	TBD	2	2'	2'	28'-10 1/2"	---	
C	TBD	9	4'	4'	28'-10 1/2"	---	

DOOR SCHEDULE						
ID	QTY	LOCATION	FIRE RATING	DOOR		NOTES
				W	HT	
1	18	Interior	---	3'	6'-8"	
2	4	Interior	---	4'	6'-8"	
3	1	Interior	---	6'	6'-8"	
4	7	Exterior	---	3'	6'-8"	
5	2	Exterior	---	12'	12'	
6	1	Exterior	---	12'	16'	

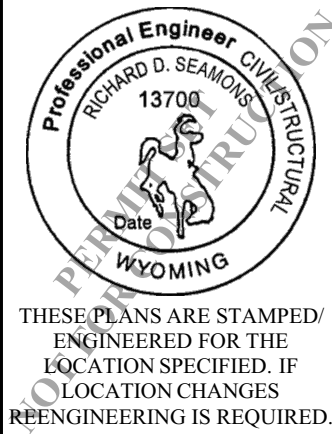

MAIN LEVEL	
REVISION DATE	DESCRIPTION

A-101


PLN# 25-01-009

South Fork Design Group, LLC
127 E. Main St. Suite 111
Rexburg, ID 83440
www.southforkdesign.com
208-852-6256

AFFITTAMI LLC - KATHERINE
KRESAN - AUTO SERVICE
ELEVATED
PARCEL NO: 37182030004500
ELK MEADOWS ADDITION LOT: 3


ENGINEER: RICHARD D SEAMONS
EIT: ###
DRAWN BY: BW
CHKD BY: ###
PLOT DATE: 5/16/2025

1 SECOND LEVEL PLAN
SCALE: 1/4" = 1'-0"

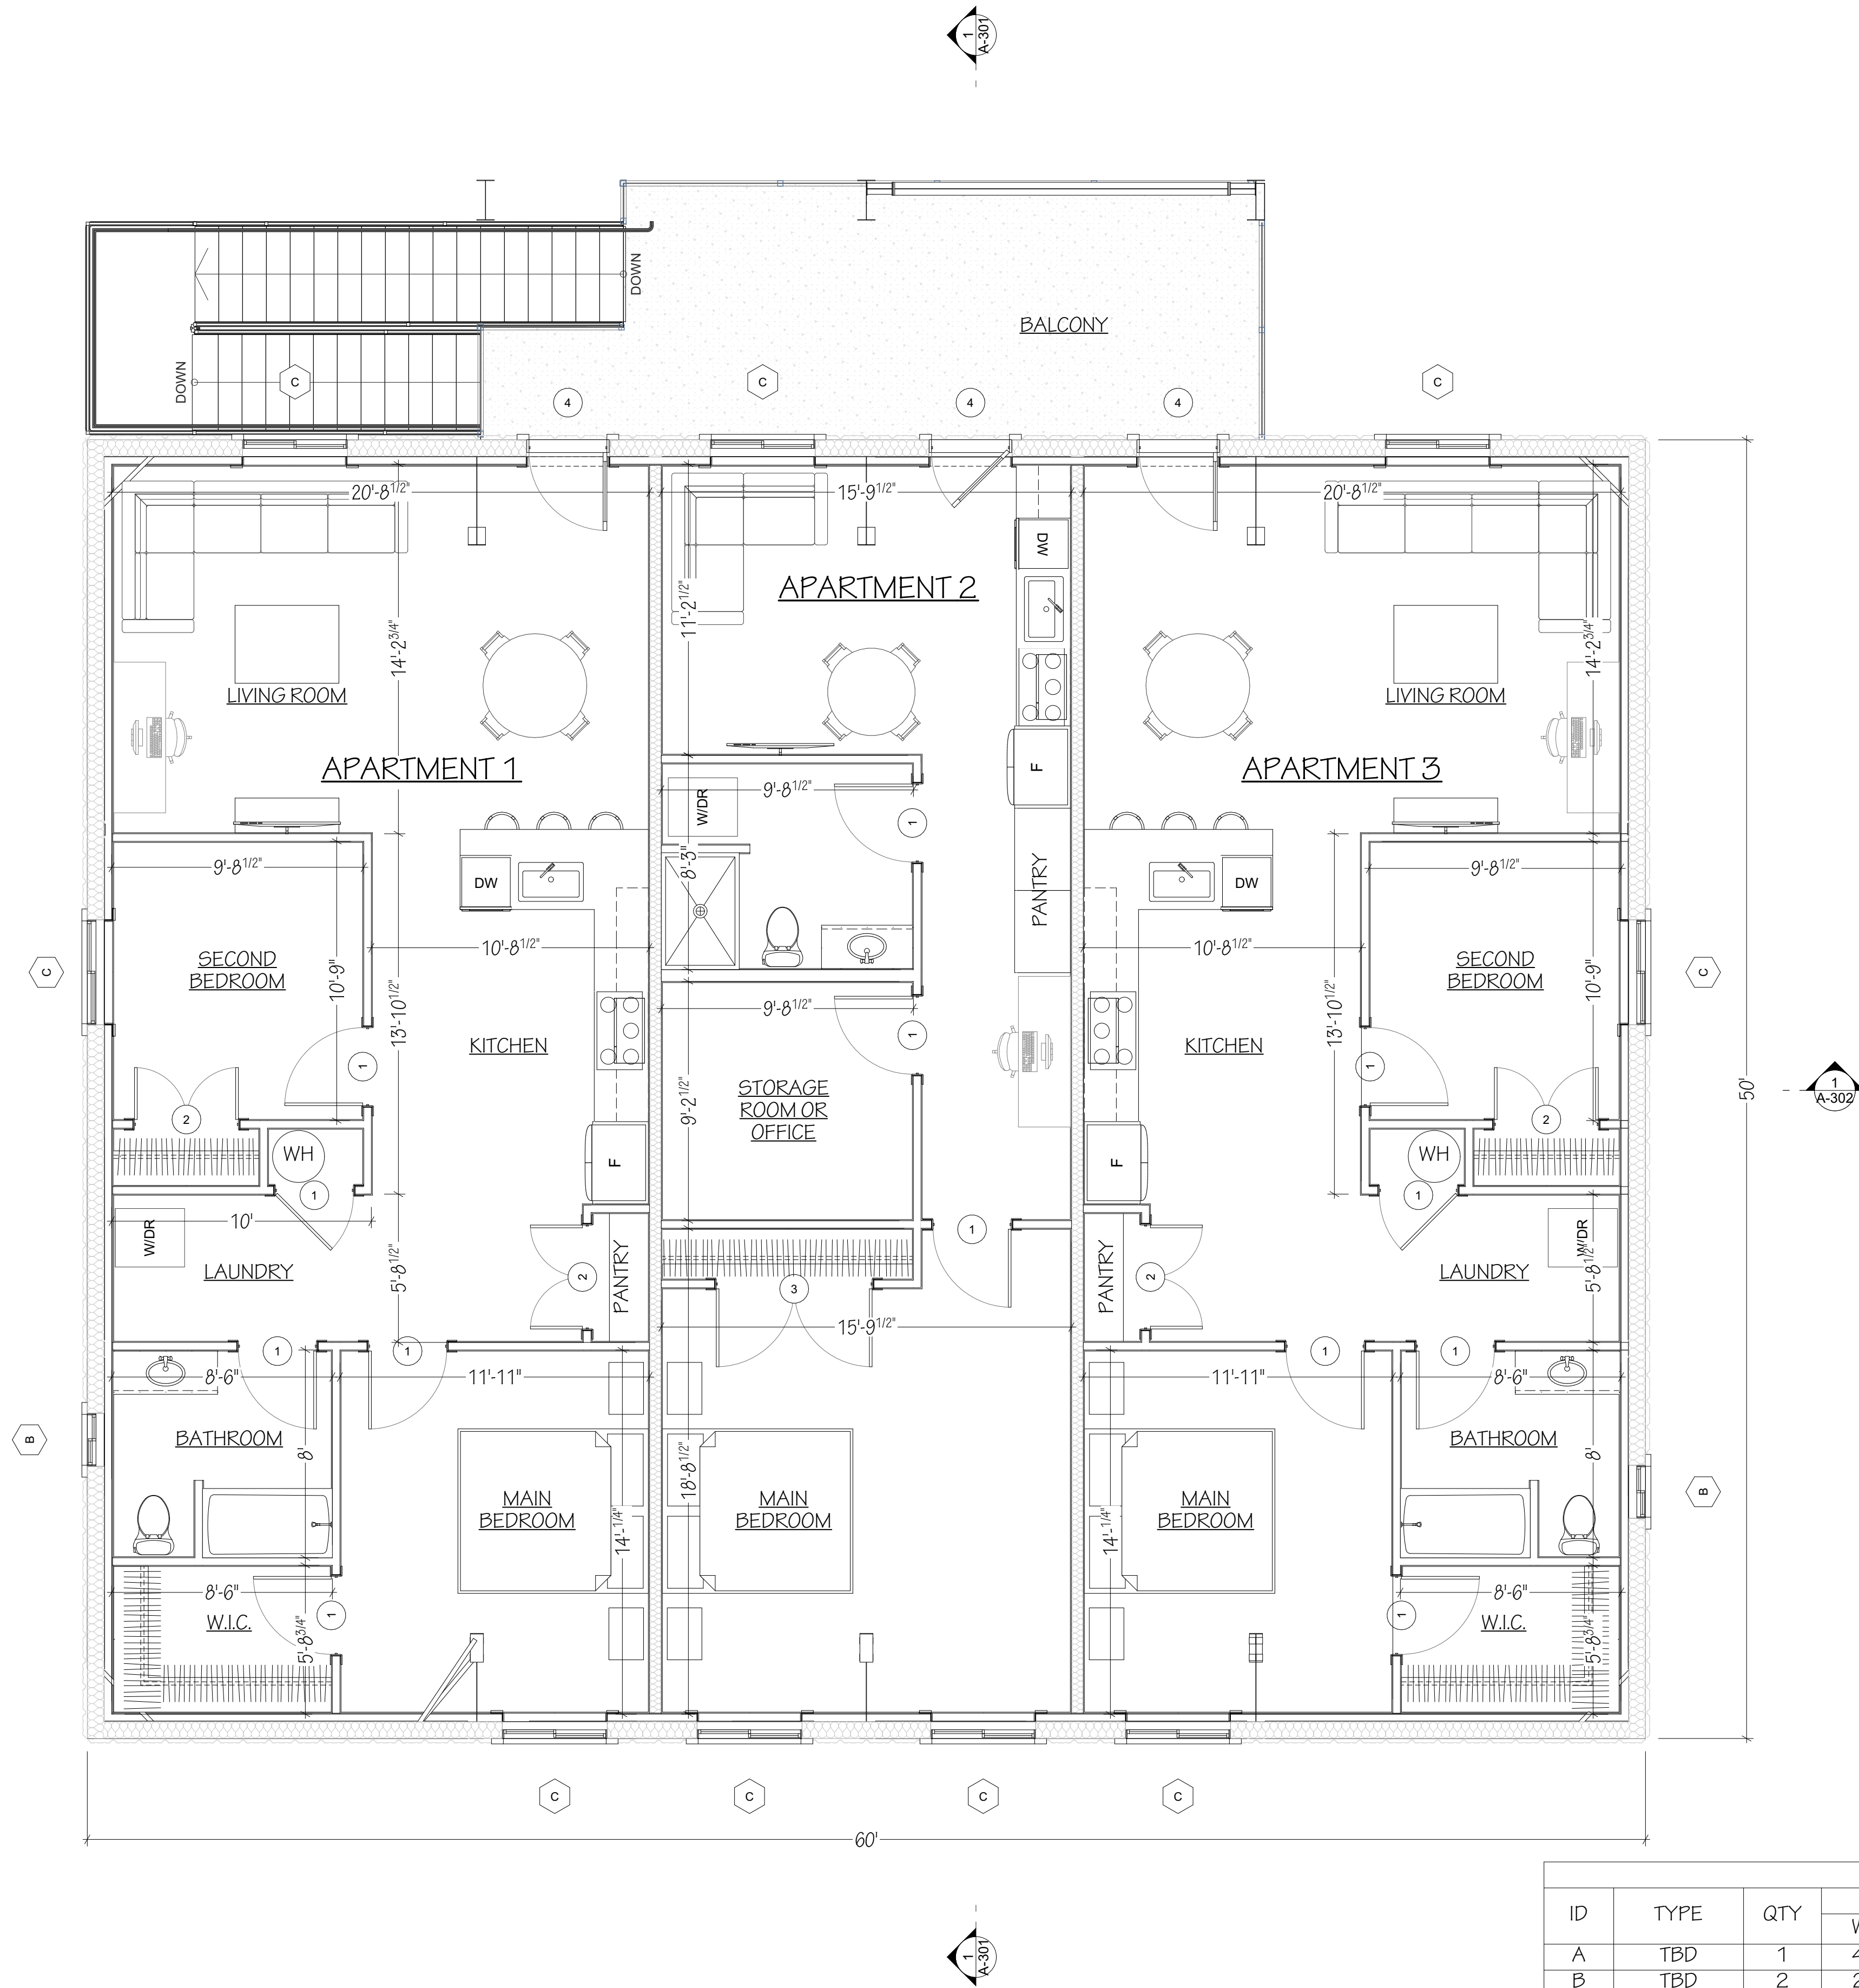

WINDOW SCHEDULE							
ID	TYPE	QTY	SIZE		HEAD HEIGHT	TEMPERED	NOTES
			W	HT			
A	TBD	1	4'	3'	6'-8"	---	
B	TBD	2	2'	2'	28'-10 ^{1/2"}	---	
C	TBD	9	4'	4'	28'-10 ^{1/2"}	---	

DOOR SCHEDULE						
ID	QTY	LOCATION	FIRE RATING	DOOR		NOTES
				W	HT	
1	18	Interior	---	3'	6'-8"	
2	4	Interior	---	4'	6'-8"	
3	1	Interior	---	6'	6'-8"	
4	7	Exterior	---	3'	6'-8"	
5	2	Exterior	---	12'	12'	
6	1	Exterior	---	12'	16'	

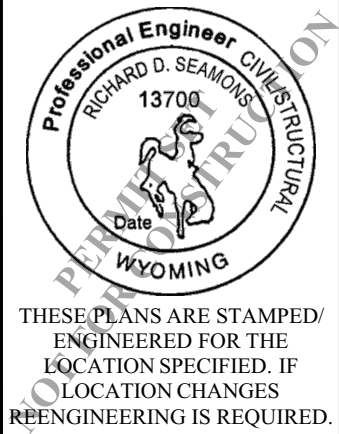

THESE PLANS ARE STAMPED
ENGINEERED FOR THE
LOCATION SPECIFIED. IF
LOCATION CHANGES
REENGINEERING IS REQUIRED.

SECOND LEVEL

REVISION DATE

DESCRIPTION


A-102

PLN# 25-01-009

South Fork Design Group, LLC
127 E. Main St. Suite 111
Rexburg, ID 83440
www.southforkdesign.com
208-852-6236

AFFITTAMI LLC - KATHERINE
KRESAN - AUTO SERVICE
ELEVATED
PARCEL NO: 37182030004500
ELK MEADOWS ADDITION LOT: 3

ENGINEER: RICHARD D SEAMONS
EIT: ###
DRAWN BY: BW
CHKD BY: ###
PLOT DATE: 5/16/2025

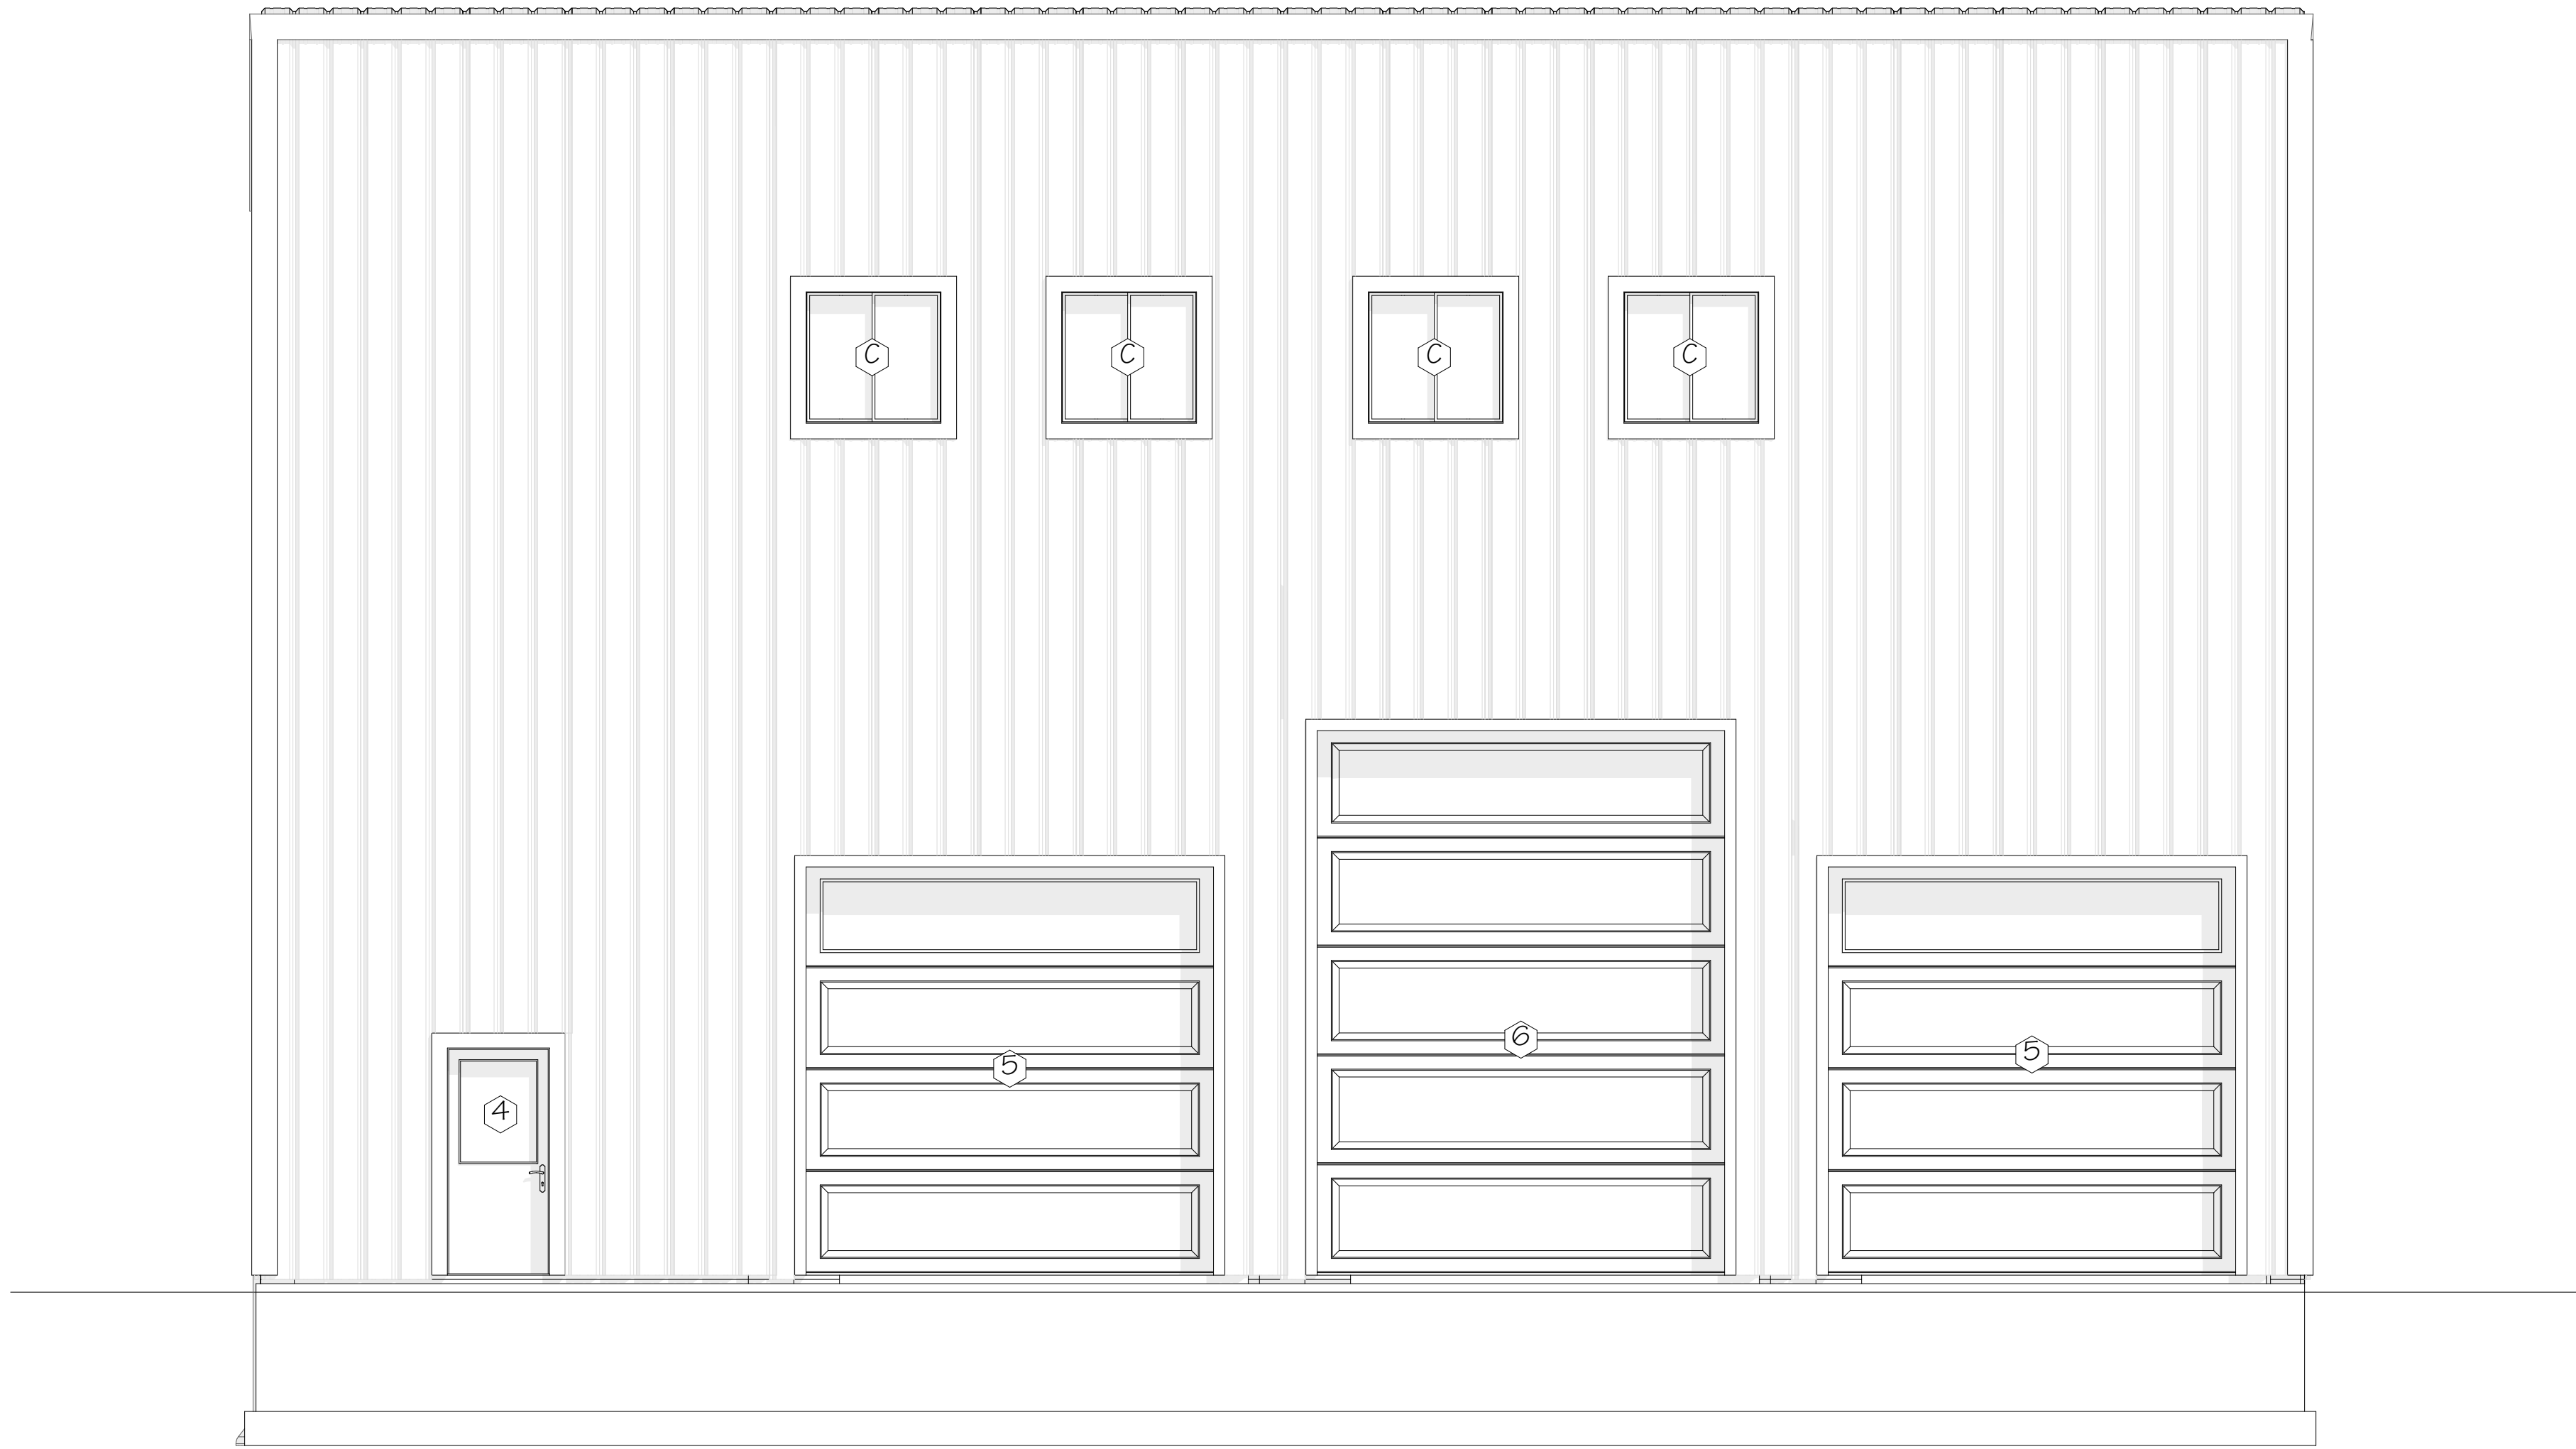

1 FRONT ELEVATION
SCALE: 1/4" = 1'-0"




2 REAR ELEVATION
SCALE: 1/4" = 1'-0"

ENGINEER: RICHARD D SEAMONS
EIT: ###
DRAWN BY: BW
CHKD BY: ###
PLOT DATE: 5/16/2025

AFFITTAMI LLC - KATHERINE
KRESAN - AUTO SERVICE
ELEVATED
PARCEL NO: 37182030004500
ELK MEADOWS ADDITION LOT: 3

South Fork Design Group, LLC
127 E. Main St. Suite 111
Rexburg, ID 83440
www.southforkdesign.com
208-852-6236


SOUTH FORK
DESIGN

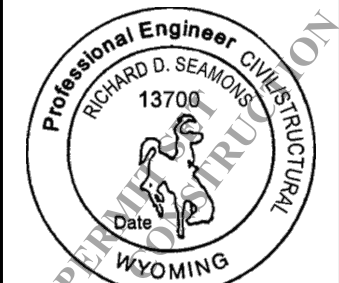


THESE PLANS ARE STAMPED
ENGINEERED FOR THE
LOCATION SPECIFIED. IF
LOCATION CHANGES
REENGINEERING IS REQUIRED.

ELEVATIONS	
REVISION DATE	DESCRIPTION

A-201
PLN# 25-01-009

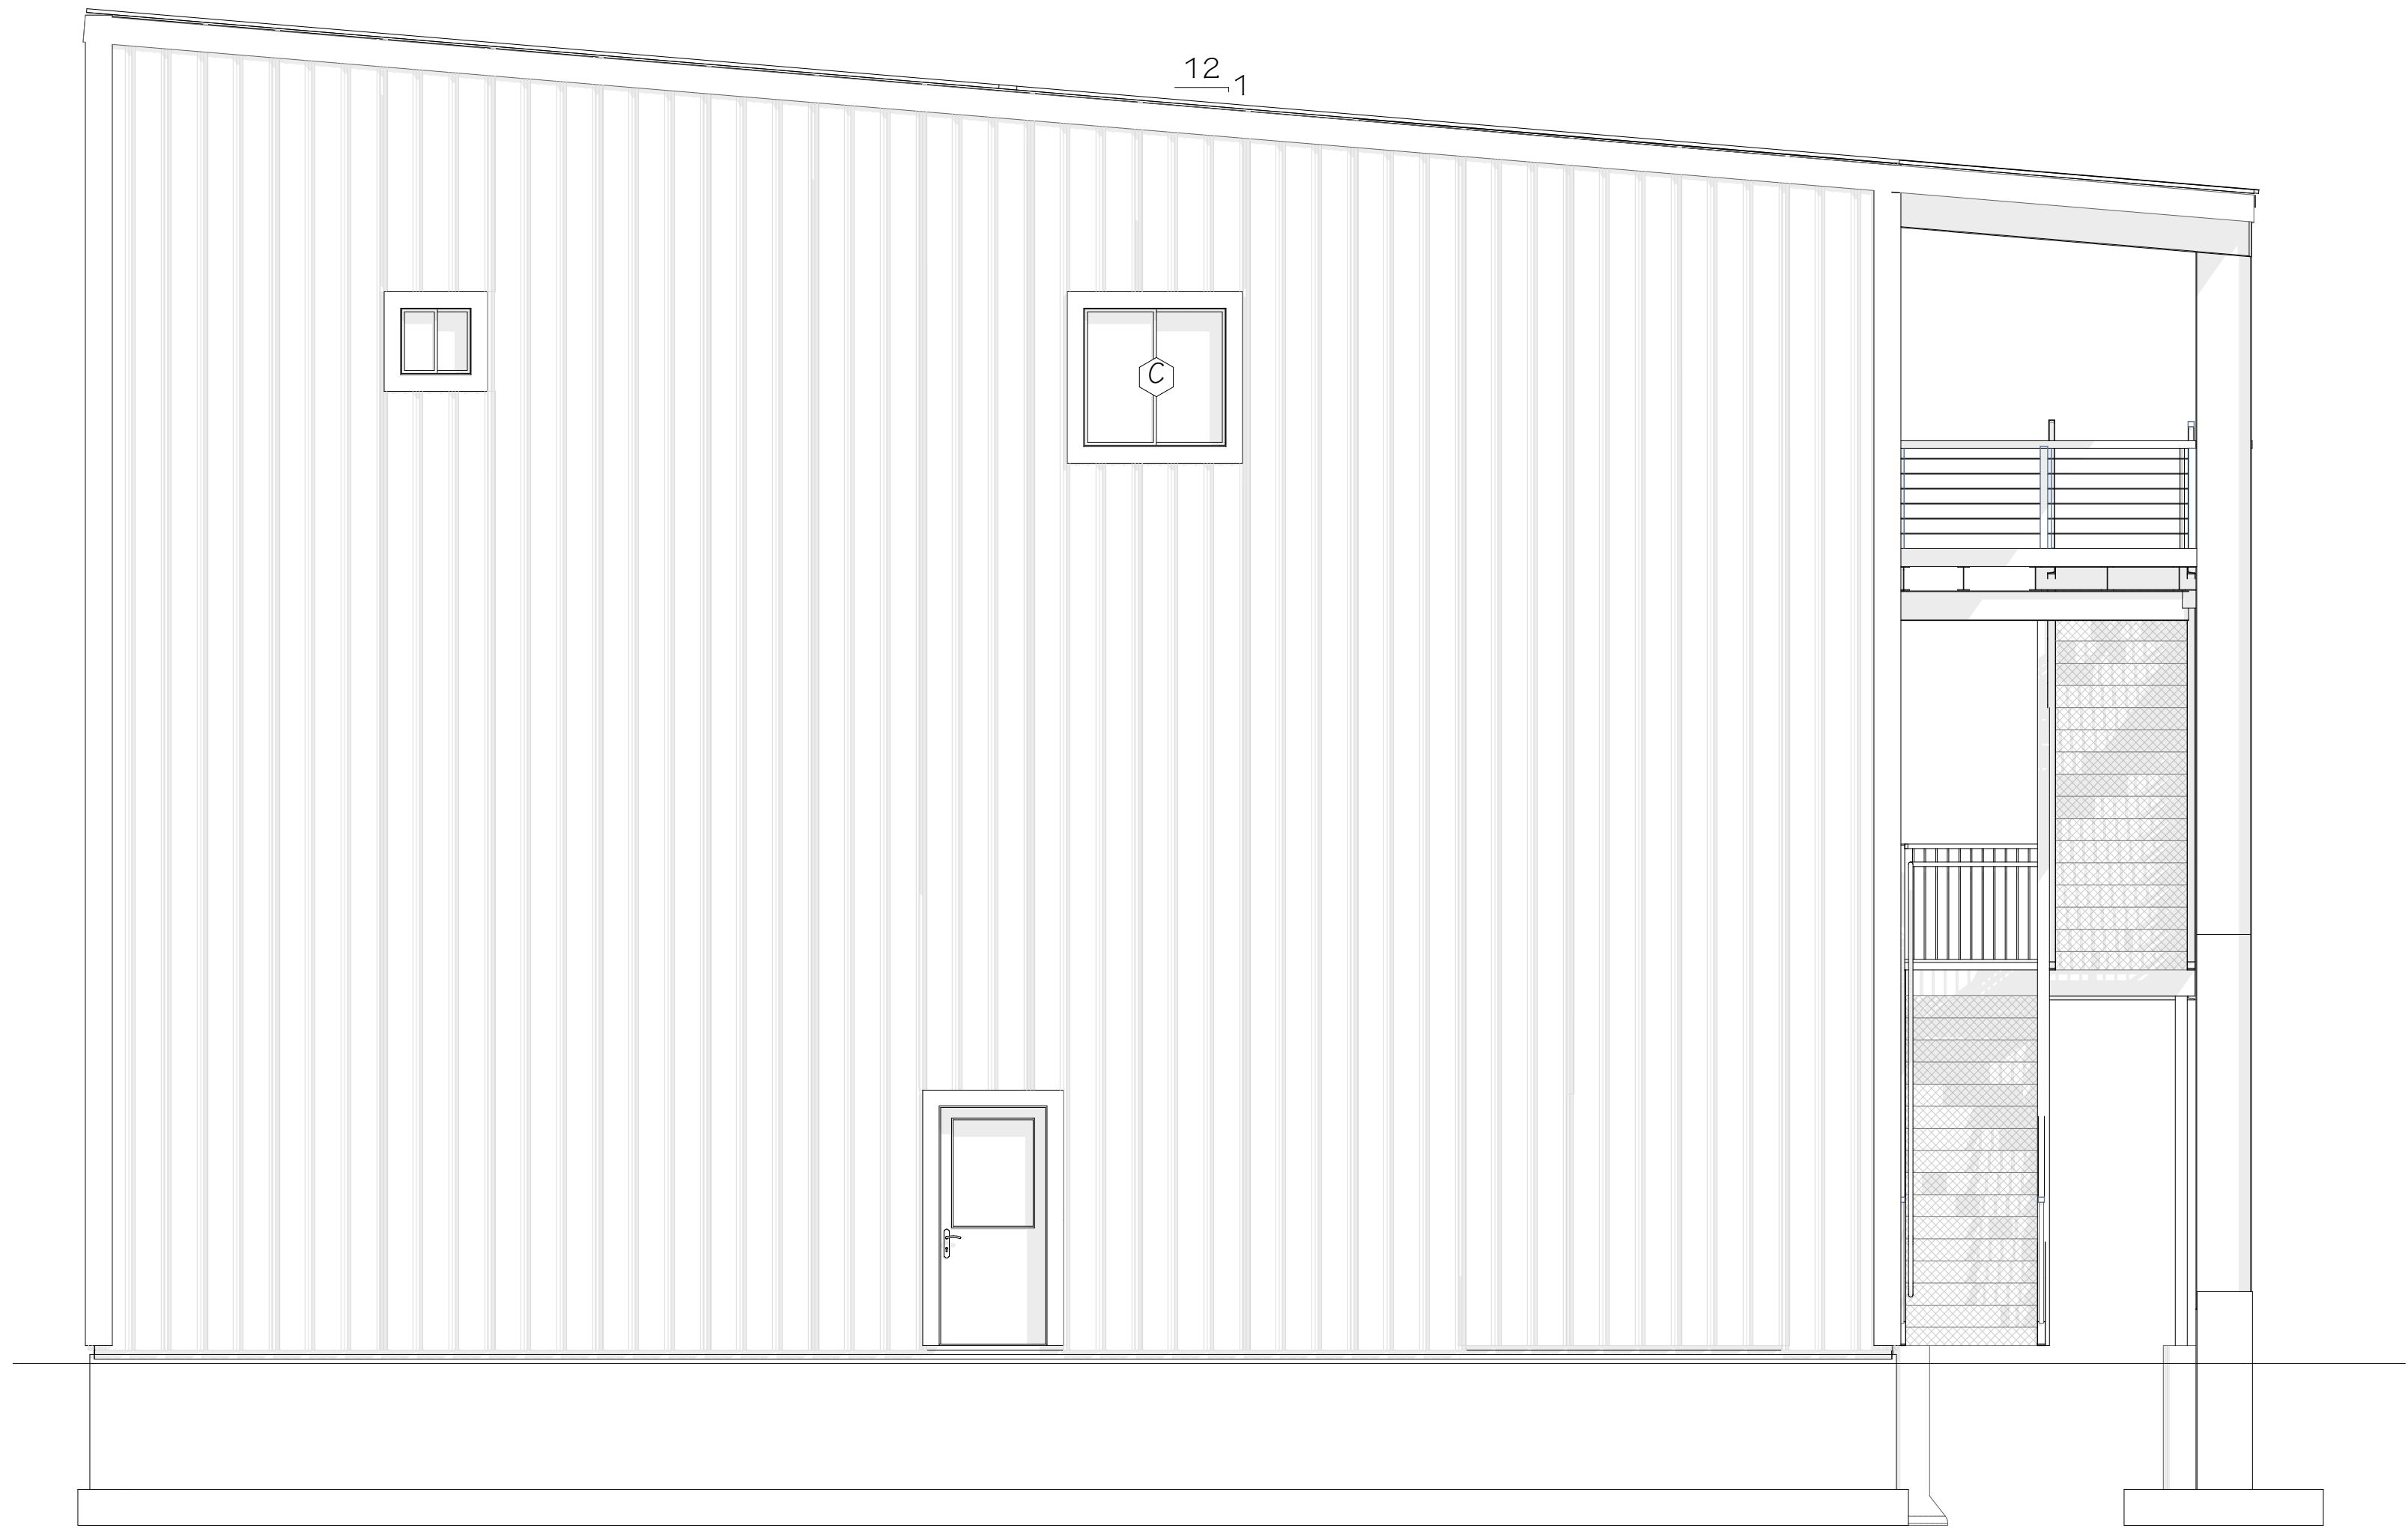

1 RIGHT ELEVATION
SCALE: 1/4" = 1'-0"

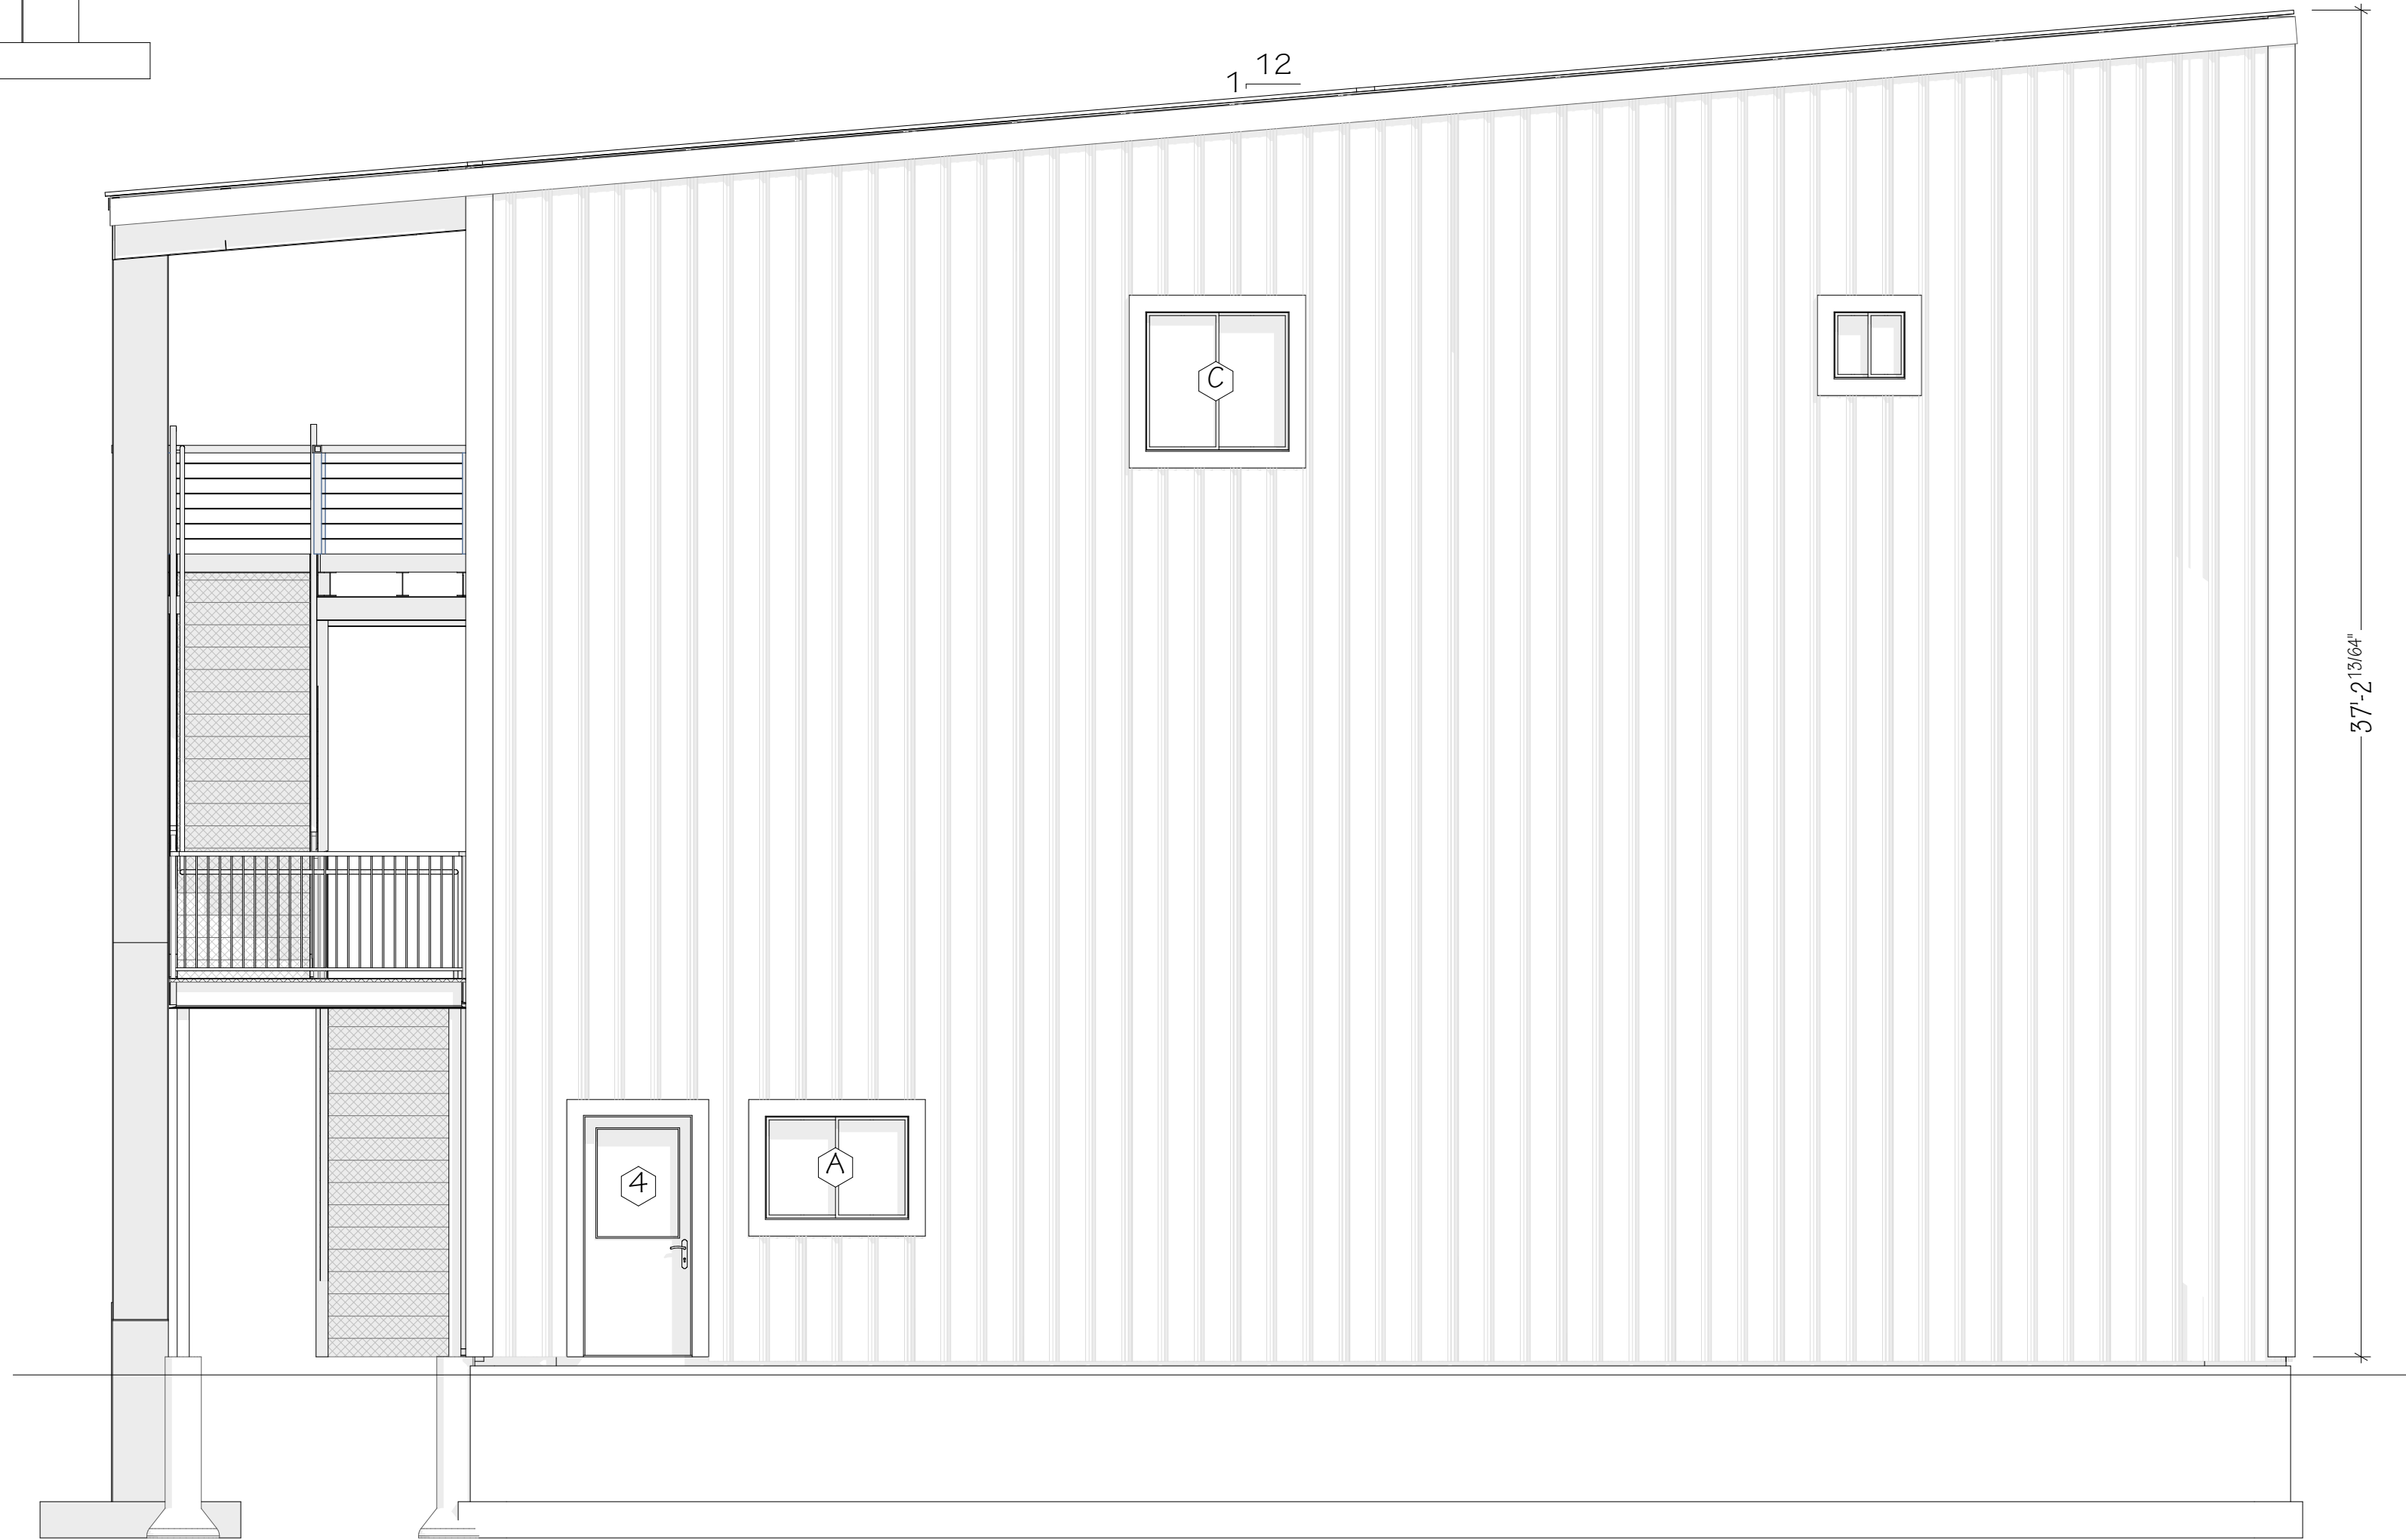

2 LEFT ELEVATION
SCALE: 1/4" = 1'-0"

THESE PLANS ARE STAMPED,
ENGINEERED FOR THE
LOCATION SPECIFIED. IF
LOCATION CHANGES
REENGINEERING IS REQUIRED.



ELEVATIONS	
REVISION DATE	DESCRIPTION

A-202


PLN# 25-01-009

South Fork Design Group, LLC
127 E. Main St. Suite 111
Rexburg, ID 83440
www.southforkdesign.com
208-852-6236




AFFITTAMI LLC - KATHERINE
KRESAN - AUTO SERVICE
ELEVATED
PARCEL NO: 37182030004500
ELK MEADOWS ADDITION LOT: 3

ENGINEER: RICHARD D SEAMONS	###
EIT:	###
DRAWN BY: BW	###
CHKD BY:	###
PLOT DATE:	5/16/2025

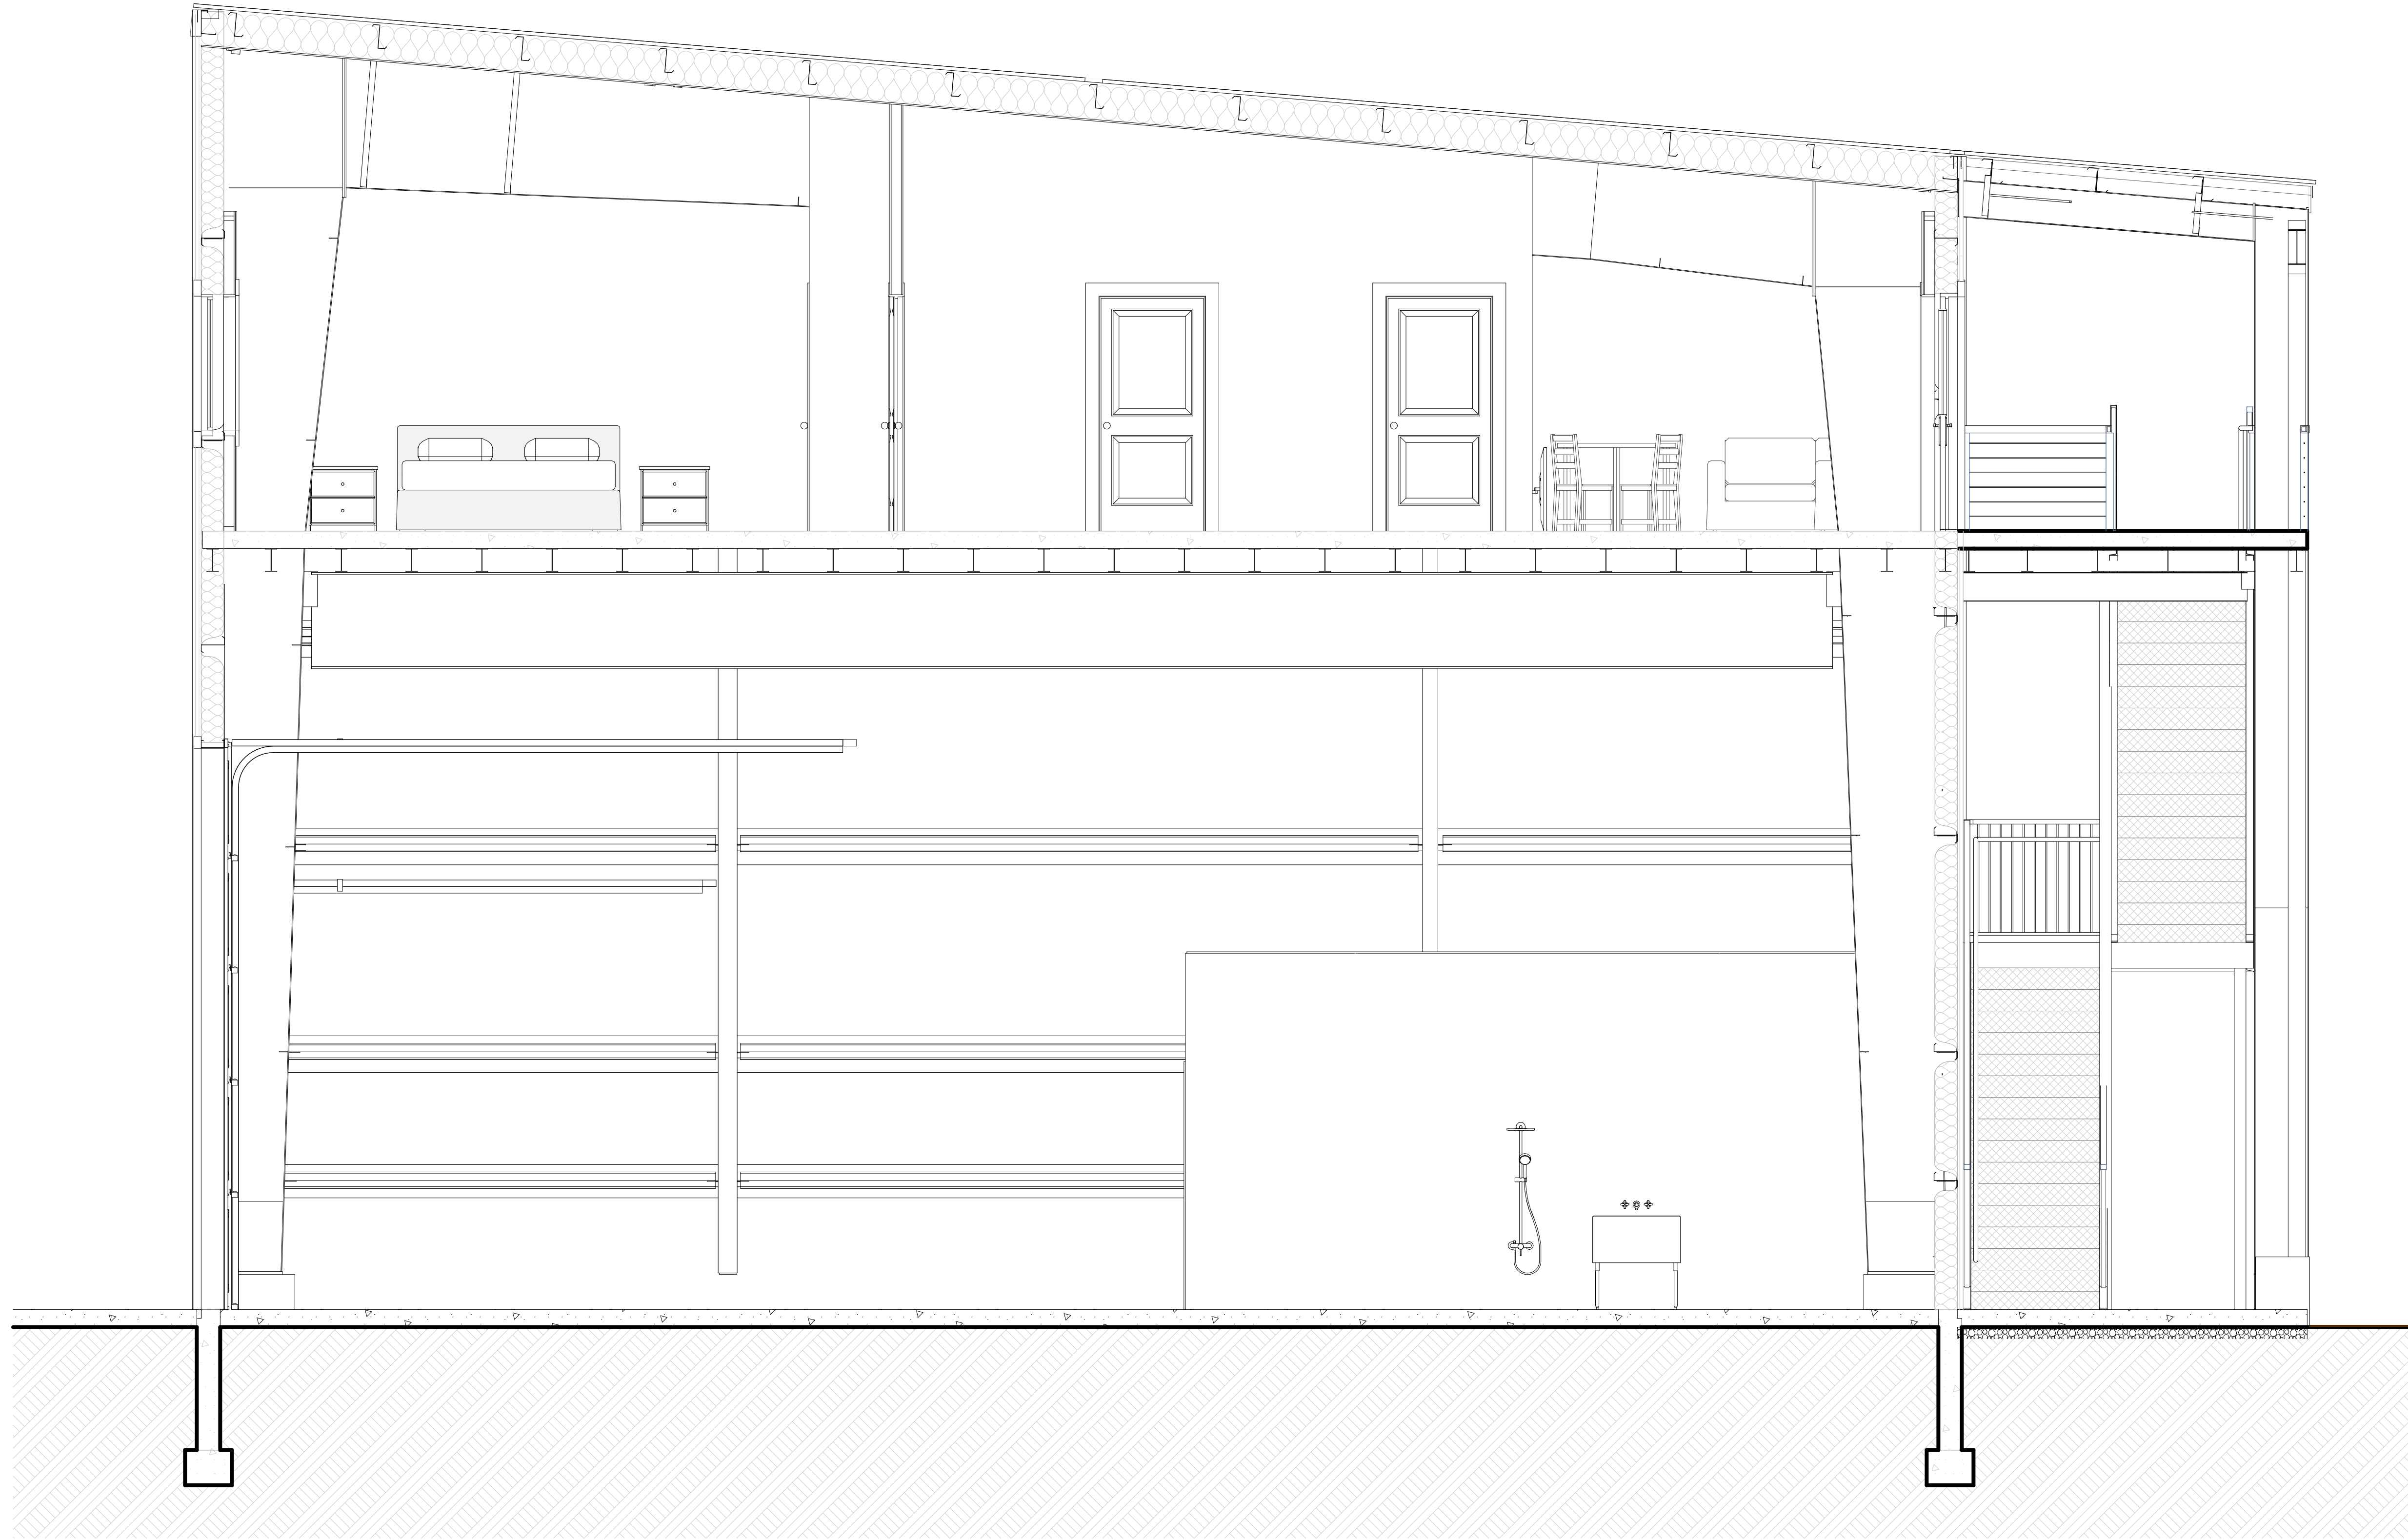

 **SECTION A**
SCALE: 3/8" = 1'-0"

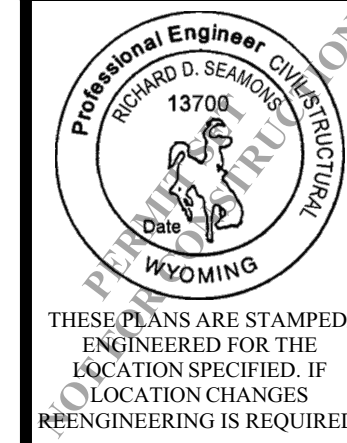

SECTIONS	
REVISION DATE	DESCRIPTION

A-301
PLN# 25-01-009


SOUTH FORK DESIGN
South Fork Design Group, LLC
127 E. Main St. Suite 111
Rexburg, ID 83440
www.southforkdesign.com
208-852-6236
Copyright 2025 | South Fork Design | All Rights Reserved.

AFFITTAMI LLC - KATHERINE KRESAN - AUTO SERVICE ELEVATED
PARCEL NO: 37182030004500
ELK MEADOWS ADDITION LOT: 3

ENGINEER: RICHARD D SEAMONS
EIT: ###
DRAWN BY: BW
CHKD BY: ###
PLOT DATE: 5/16/2025



 **SECTION B**
SCALE: 3/8" = 1'-0"

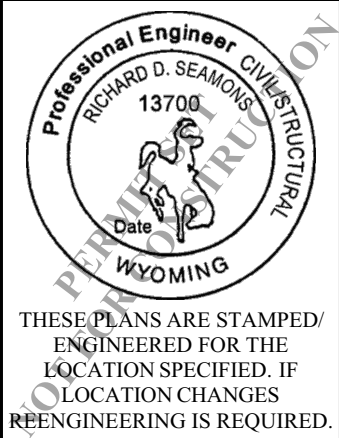

SECTIONS	
REVISION DATE	DESCRIPTION





South Fork Design Group, LLC
127 E. Main St. Suite 111
Rexburg, ID 83440
www.southforkdesign.com
208-852-6236

Copyright 2025 | South Fork Design | All Rights Reserved.

AFFITTAMI LLC - KATHERINE KRESAN - AUTO SERVICE ELEVATED
PARCEL NO: 37182030004500
ELK MEADOWS ADDITION LOT: 3

ENGINEER: RICHARD D SEAMONS	###
EIT:	###
DRAWN BY: BW	###
CHKD BY:	###
PLOT DATE:	5/16/2025

FOOTING SCHEDULE					
ID	WIDTH	DEPTH	FOOTING TYPE	FOOTING REBAR	PIER (IF REQUIRED)
F1	16"	8"	CONTINUOUS FOOTING	(2) #4 BAR CONT.	---
F14	---	---	BIGFOOT 24	SEE PIER REBAR FOR SIZING	12" SONOTUBE (4) #4 BAR #3 TIES 8" O.C. W/ #3 TIES @ 3" O.C. IN TOP 12".

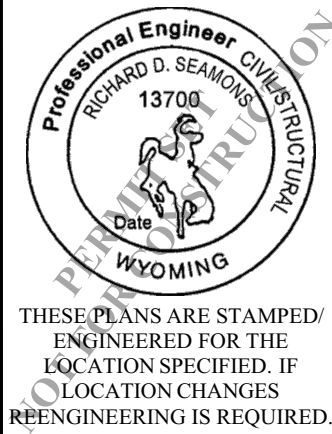
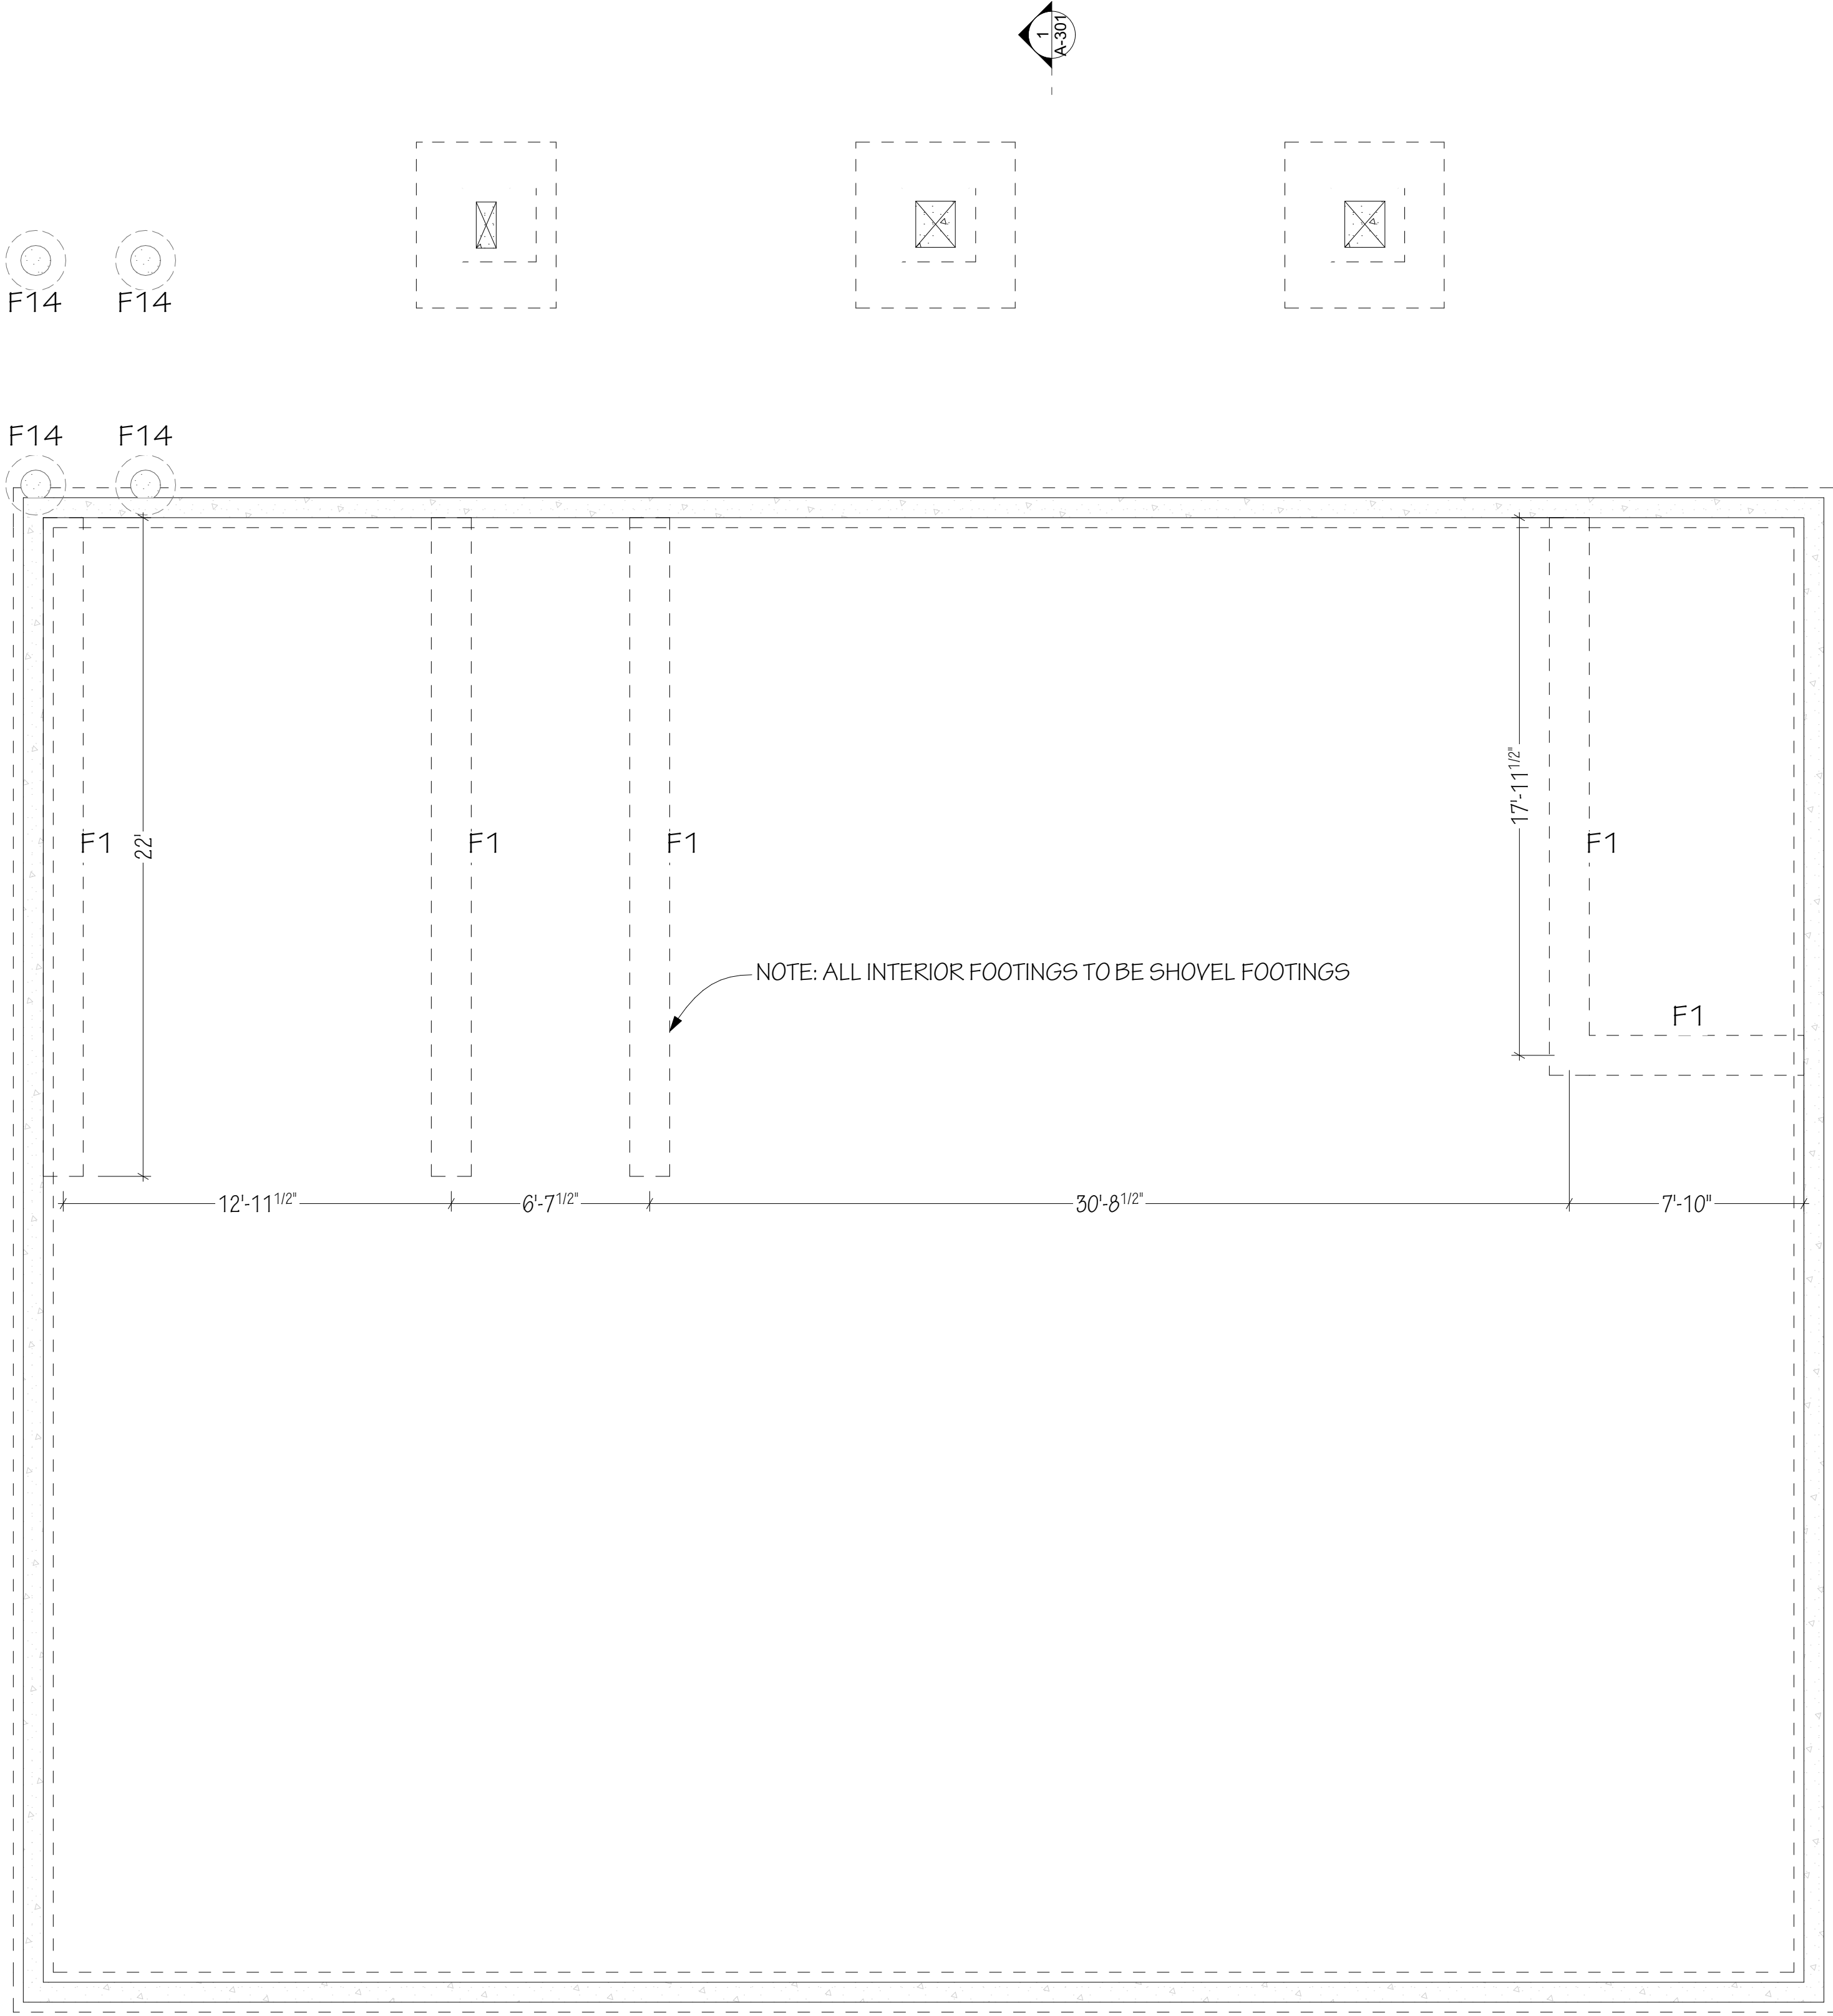


THESE PLANS ARE STAMPED
ENGINEERED FOR THE
LOCATION SPECIFIED. IF
LOCATION CHANGES
REENGINEERING IS REQUIRED.

FOUNDATION	
REVISION DATE	DESCRIPTION

2 SECOND LEVEL STORAGE LOFT
FRAMING

SCALE: 1/4" = 1'-0"

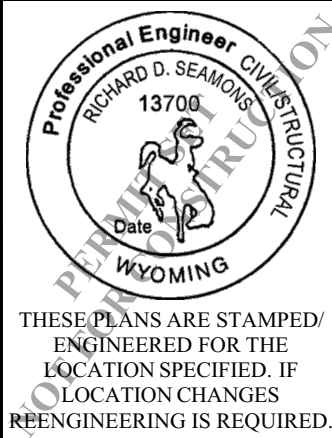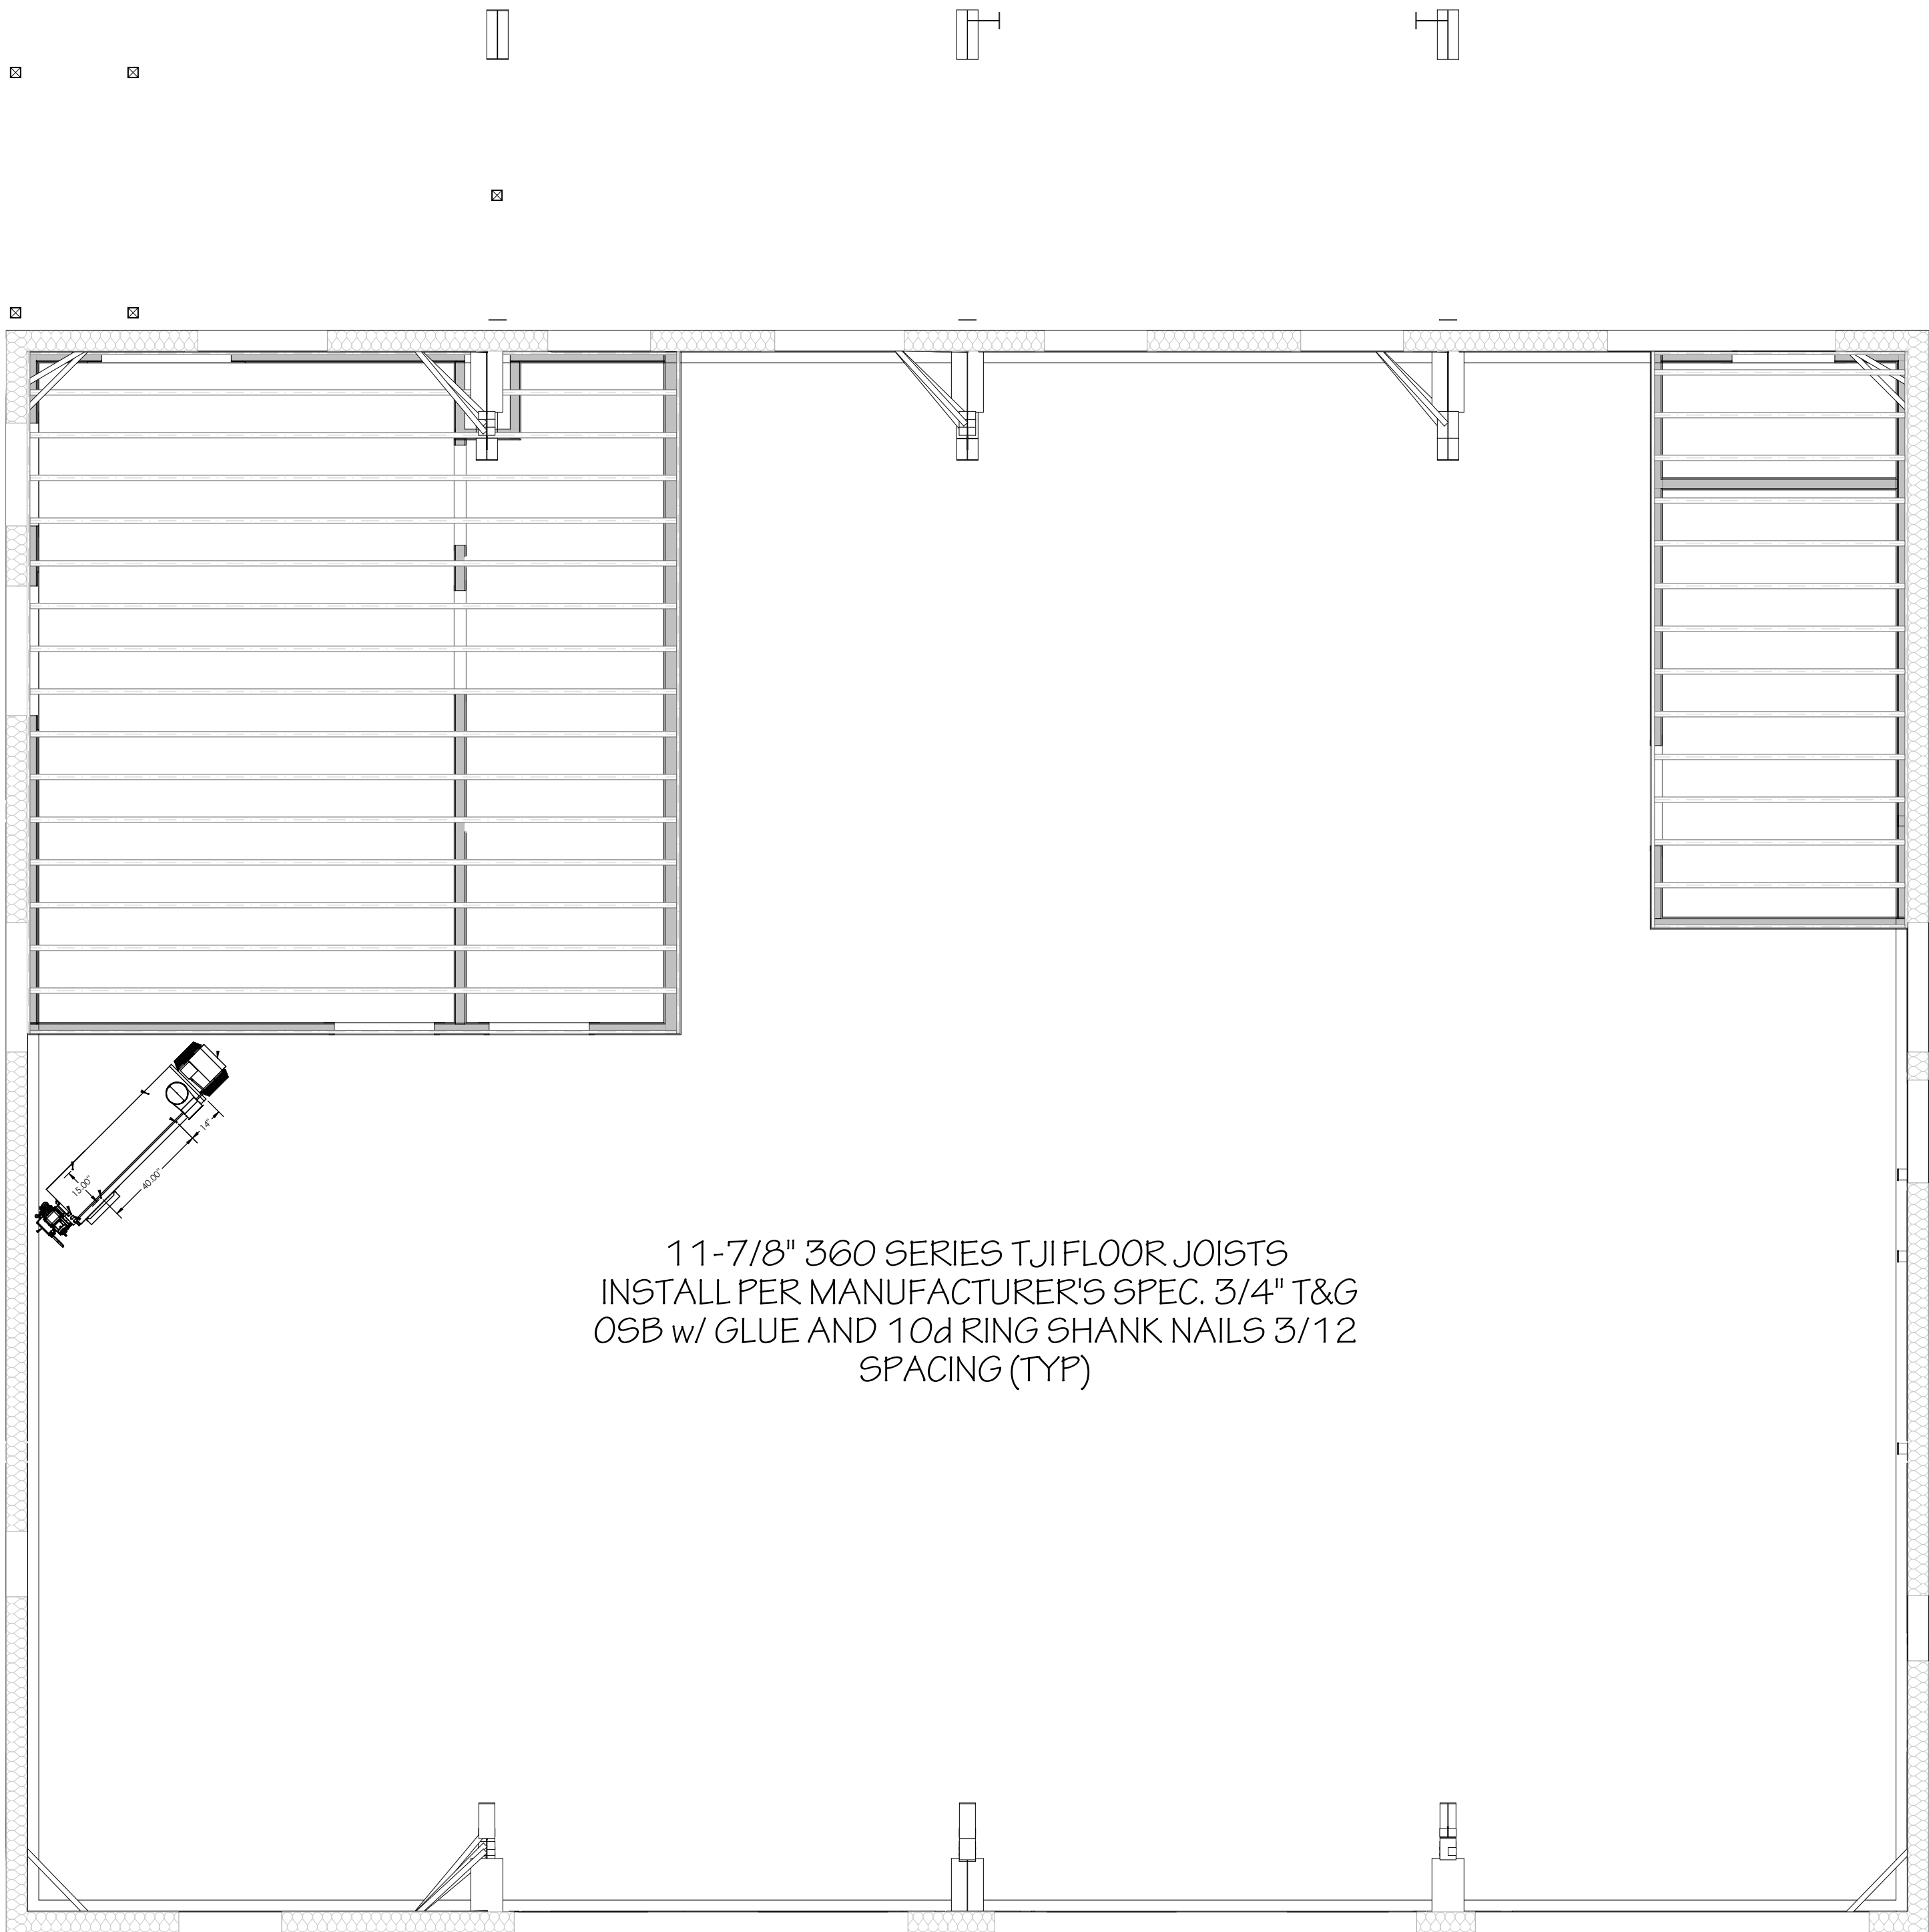

THESE PLANS ARE STAMPED
ENGINEERED FOR THE
LOCATION SPECIFIED. IF
LOCATION CHANGES
REENGINEERING IS REQUIRED.

STORAGE LOFT FRAMING

REVISION DATE DESCRIPTION

S-201

PLN# 25-01-009

South Fork Design Group, LLC

127 E. Main St. Suite 111
Rexburg, ID 83440
www.southforkdesign.com
208-852-6236



Copyright 2025 | South Fork Design | All Rights Reserved.

AFFITTAMI LLC - KATHERINE

KRESAN - AUTO SERVICE

ELEVATED

PARCEL NO: 37182030004500

ELK MEADOWS ADDITION LOT: 3

ENGINEER: RICHARD D SEAMONS

EIT: ###



DRAWN BY: BW

CHKD BY: ###

PLOT DATE: 5/16/2025

4 MAIN LEVEL WALL FRAMING

SCALE: 1/4" = 1'-0"

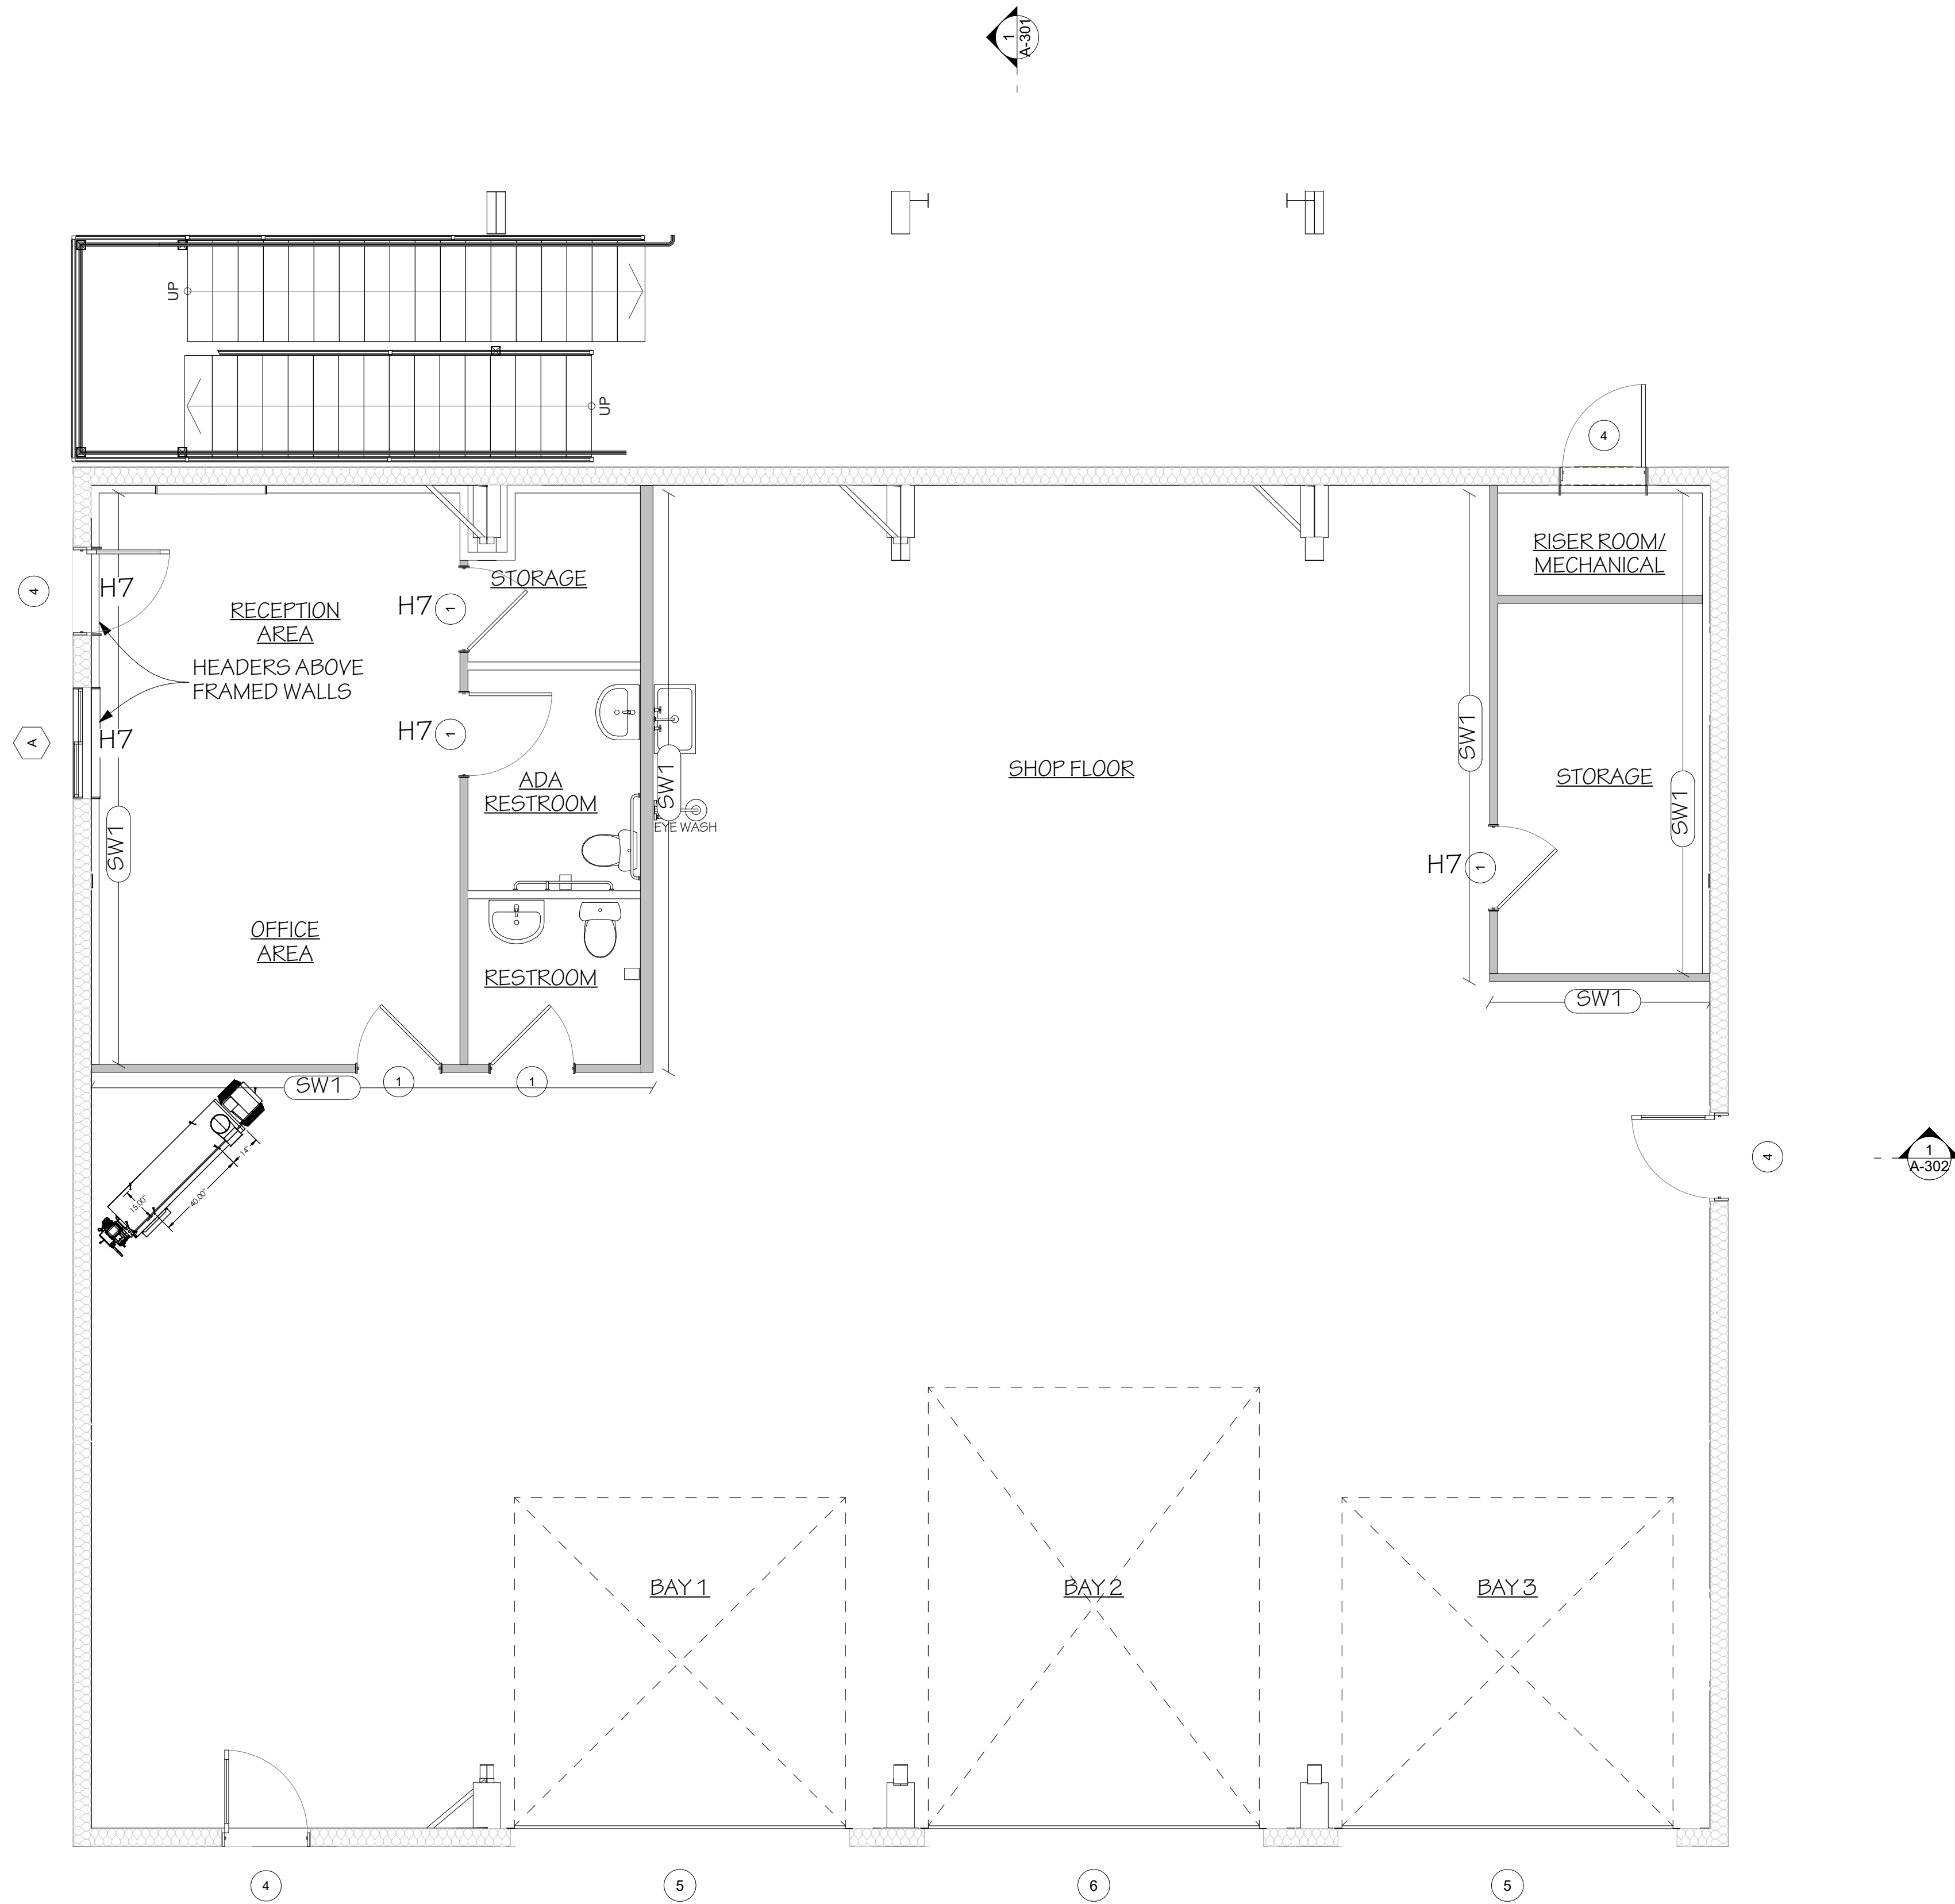

A-301


HEADERS			
ID	PLY	SIZE	NOTE
H7	2	2X8 SPF	

SHEAR WALL SCHEDULE		
ID	LOCATION	TYPE
SW1	INTERIOR	7/16" OSB W/ 8d @ 6" O.C. ALL PANEL EDGES & 12" O.C. FIELD (NO STAPLE OPTION)

WALL FRAMING	
REVISION DATE	DESCRIPTION

S-301

PLN# 25-01-009

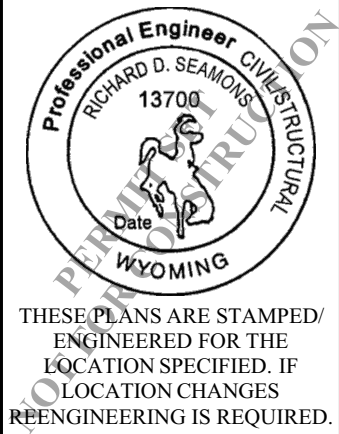

South Fork Design Group, LLC
127 E. Main St. Suite 111
Rexburg, ID 83440
www.southforkdesign.com
208-852-6236

AFFITTAMI LLC - KATHERINE
KRESAN - AUTO SERVICE
ELEVATED
PARCEL NO: 37182030004500
ELK MEADOWS ADDITION LOT: 3

ENGINEER: RICHARD D SEAMONS
EIT: ###
DRAWN BY: BW
CHKD BY: ###
PLOT DATE: 5/16/2025



COMcheck Software Version COMcheckWeb
Mechanical Compliance Certificate

Project Information

Energy Code: 2021 IECC
Project Title: Auto Service Elevated
Location: Alpine, Wyoming
Climate Zone: 7
Project Type: New Construction

Construction Site: Owner/Agent: Designer/Contractor:

Additional Efficiency Package(s)

Credits: 10.0 Required 0.0 Proposed

Mechanical Systems List

QuantitySystem Type & Description

- 3 HEAT PUMPS (Single Zone):
Split System Heat Pump
Heating Mode: Capacity = 24 kbtu/h,
Proposed Efficiency = 12.50 HSPF2, Required Efficiency = 7.50 HSPF2
Cooling Mode: Capacity = 24 kbtu/h,
Proposed Efficiency = 17.90 SEER2, Required Efficiency = 14.30 SEER2
Proposed Part Load Efficiency = 0.00 , Required Part Load Efficiency = 0.00
Fan System: FAN SYSTEM 1 -- Compliance (Motor nameplate HP and fan efficiency method) : Passes
Fans:
FAN 3 Supply, Constant Volume, 435 CFM, 0.1 motor nameplate hp, 0.00 fan energy index , fan exception: Fan array <= 5 total HP or <= 4.1 kW
FAN 2 Supply, Constant Volume, 350 CFM, 0.1 motor nameplate hp, 0.00 fan energy index , fan exception: Fan array <= 5 total HP or <= 4.1 kW
FAN 1 Supply, Constant Volume, 350 CFM, 0.1 motor nameplate hp, 0.00 fan energy index , fan exception: Fan array <= 5 total HP or <= 4.1 kW
- 1 UH-1 (Unknown w/ PerimeterSystem):
Heating: 1 each - Unit Heater, Oil, Capacity = 140 kbtu/h
Proposed Efficiency = 80.00% Ec, Required Efficiency: 80.00 % Ec
Fan System: FAN SYSTEM 2 -- Compliance (Motor nameplate HP and fan efficiency method) : Passes
Fans:
FAN 4 Supply, Constant Volume, 1000 CFM, 1.0 motor nameplate hp, 0.00 fan energy index , fan exception: Single fan < 1 HP or < 0.89 kW
- 4 WALL HEATERS (Single Zone):
Heating: 1 each - Other, Electric, Capacity = 3 kbtu/h
No minimum efficiency requirement applies
Fan System: FAN SYSTEM 3 -- Compliance (Motor nameplate HP and fan efficiency method) : Passes
Fans:
FAN 5 Supply, Constant Volume, 100 CFM, 0.1 motor nameplate hp, 0.00 fan energy index , fan exception: Single fan < 1 HP or < 0.89 kW
- 1 CEILING HEATER (Single Zone):
Heating: 1 each - Other, Electric, Capacity = 13 kbtu/h
No minimum efficiency requirement applies
Fan System: FAN SYSTEM 4 -- Compliance (Motor nameplate HP and fan efficiency method) : Passes
Fans:
FAN 6 Supply, Constant Volume, 150 CFM, 0.1 motor nameplate hp, 0.00 fan energy index , fan exception: Single fan < 1 HP or < 0.89 kW

Project Title: Auto Service Elevated Report date: 05/03/25
Data filename: Page 1 of 9

QuantitySystem Type & Description

- 3 Apartment Water Heaters:
Electric Storage Water Heater, Capacity: 30 gallons
No minimum efficiency requirement applies
- 1 Water Heater 1:
Electric Storage Water Heater, Capacity: 10 gallons
No minimum efficiency requirement applies

Mechanical Compliance Statement

Compliance Statement: The proposed mechanical design represented in this document is consistent with the building plans, specifications, and other calculations submitted with this permit application. The proposed mechanical systems have been designed to meet the 2021 IECC requirements in COMcheck Version COMcheckWeb and to comply with any applicable mandatory requirements listed in the Inspection Checklist.

Cailin Farris, P.E. 05/03/2025
Name - Title Signature Date

Project Title: Auto Service Elevated Report date: 05/03/25
Data filename: Page 2 of 9

HVAC SYMBOLS & ABBREVIATIONS

(NOT ALL SYMBOLS MAY BE USED)

	SUPPLY DIFFUSER (4-WAY U.N.O.)	AFF BDD C.O.D. EA EAT ESP FD LAT MD N.T.S. O.C. OA RA S.S. SA TA U.N.O.	ABOVE FINISHED FLOOR BACKDRAFT DAMPER CENTER OF DUCT EXHAUST AIR ENTERING AIR TEMPERATURE EXTERNAL STATIC PRESSURE FIRE DAMPER LEAVING AIR TEMPERATURE MANUAL (VOLUME) DAMPER NOT TO SCALE ON CENTER OUTSIDE (VENTILATION) AIR RETURN AIR STAINLESS STEEL SUPPLY AIR TRANSFER AIR UNLESS NOTED OTHERWISE
	2-WAY SUPPLY DIFFUSER		
	RETURN GRILLES		
	EXHAUST GRILLE		
	SUPPLY AIR RISER		
	RETURN AIR RISER		
	EXHAUST AIR RISER		
	FLEXIBLE DUCT (6'-0" MAX)		
	90° MITERED CORNER W/ TURNING VANES		
	45° BOOT FITTING W/ MANUAL VOLUME DAMPER		
	MANUAL VOLUME DAMPER		
	SQUARE-TO-ROUND TRANSITION		
	THERMOSTAT		
	SWITCH		
	FIRE DAMPER		
	COMBINATION FIRE/SMOKE DAMPER (A)		
	COMBINATION FIRE/SMOKE DAMPER WITH IN-DUCT SMOKE DETECTOR WITHIN 5'-0" OF DAMPER.		
	MOTORIZED DAMPER		
	CO/NO2 SENSOR		
EQUIPMENT TAG			
	AHU 100		EQUIPMENT TYPE EQUIPMENT TAG NUMBER ROOM NUMBER (IF APPLICABLE)

(A) THE SYSTEM SERVED BY THIS FIRE/SMOKE DAMPER INCLUDES A FULL COVERAGE SMOKE DETECTION SYSTEM WHICH WILL ACTIVATE THIS DAMPER TO CLOSE UPON THE PRESENCE OF SMOKE IN THE AREA SERVED BY THIS DUCT. PROVIDE IN-DUCT SMOKE DETECTOR WITHIN 5'-0" OF SMOKE DAMPER IF FULL COVERAGE SMOKE DETECTION SYSTEM IS NOT IN PLACE TO ACTIVATE DAMPER.

MECHANICAL GENERAL NOTES

- A. ALL ROOF PENETRATIONS SHALL BE COMPLETED IN ACCORDANCE WITH ROOFING SYSTEM REQUIREMENTS AND ROOF MANUFACTURER'S INSTRUCTIONS. COORDINATE ALL WORK WITH ROOFING CONTRACTOR.
- B. CONTRACTOR SHALL VERIFY EXACT HEIGHTS OF ALL CEILINGS PRIOR TO START OF WORK. SEE ARCHITECTURAL SHEETS FOR CEILING DETAILS AND CONSTRUCTION. COORDINATE EXACT DUCTWORK INSTALLATION WITH CEILING HEIGHTS AND STRUCTURE, AS REQUIRED.
- C. SEE ELECTRICAL LIGHTING SHEETS FOR EXACT LOCATION OF ALL LIGHT FIXTURES. COORDINATE EXACT DIFFUSER AND GRILLE LOCATIONS WITH LIGHTING FIXTURES, AS REQUIRED.
- D. INSTALL ALL DUCTWORK AS HIGH AS POSSIBLE WHILE COORDINATING WITH ALL OTHER TRADES. OFFSET AND TRANSITION DUCTWORK BETWEEN AND BENEATH STRUCTURAL MEMBERS, WHERE REQUIRED. DROP BRANCH DUCTS DOWN TO DIFFUSERS AND GRILLES.
- E. ALL DUCTWORK SHALL MEET SMACNA'S "HVAC DUCT CONSTRUCTION STANDARDS - METAL AND FLEXIBLE", CURRENT EDITION. DUCT GAUGES, REINFORCEMENTS, METHODS OF CONNECTION, TRANSITIONS AND CONSTRUCTION WILL BE FIELD-VERIFIED. MEASURED AND INSPECTED FOR COMPLIANCE. DUCTWORK NOT MEETING SMACNA'S STANDARDS WILL BE REMOVED AND REPLACED AT CONTRACTOR'S EXPENSE. UNLESS OTHERWISE ADDRESSED IN THE SPECIFICATIONS, THE PRESSURE CLASSIFICATION FOR ALL DUCTWORK SHALL BE 2" WATER GAUGE POSITIVE OR NEGATIVE. CONTRACTOR SHALL VERIFY ALL REQUIREMENTS PRIOR TO SUBMITTALS OR DUCT FABRICATION AND GIVE WRITTEN DOCUMENTATION OF COMPLIANCE IN ORIGINAL PRODUCT SUBMITTALS.
- F. ALL EXPOSED DUCTWORK SHALL BE SHEET METAL ONLY. NO FLEX DUCT ALLOWED. FINAL CONNECTIONS TO DIFFUSERS, GRILLES AND REGISTERS SHALL BE SHEET METAL DUCT ONLY. SUPPORT DUCTWORK PER SMACNA AND CODE. FURNISH WITH PAINT-LOC FINISH OR PRIME FOR PAINTING.
- G. ALL DIMENSIONS ARE LISTED IN INCHES UNLESS NOTED OTHERWISE. ALL DUCTWORK DIMENSIONS ARE INSIDE CLEAR.
- H. HVAC CONTRACTOR SHALL FIELD-COORDINATE ALL CONDITIONS, UNIT LOCATIONS, OBSTRUCTIONS AND DUCTWORK INSTALLATION PRIOR TO DUCT FABRICATION. TRANSITION AND OFFSET DUCTWORK, AS REQUIRED, TO MAKE FIT IN CEILING SPACES AND FIELD CONDITIONS. DUCTWORK FABRICATED BY THE HVAC CONTRACTOR PRIOR TO FIELD COORDINATION AND CONFLICT RESOLUTION SHALL BE AT THE RESPONSIBILITY AND COST OF THE HVAC CONTRACTOR. OWNER SHALL NOT BE RESPONSIBLE FOR SHOP-FABRICATED DUCTWORK SIZED DIRECTLY FROM THE HVAC DRAWINGS.
- I. DO NOT CUT, DRILL HOLES OR REMOVE ANY PORTION OF STRUCTURAL MEMBERS, BEAMS OR PURLINS. ROUTE ALL DUCTWORK, PIPING AND CONDUIT AROUND AND THROUGH STRUCTURAL MEMBERS AS REQUIRED. SEE STRUCTURAL DETAILS AND DRAWINGS FOR EXACT METHOD OF ATTACHING HANGERS TO BEAMS AND STRUCTURAL MEMBERS.
- J. DO NOT ATTACH SCREWS, NAILS, HANGERS OR FASTENERS OF ANY TYPE TO ROOF DECK. SUPPORT ALL MECHANICAL EQUIPMENT FROM STRUCTURE AND CONTRACTOR-INSTALLED KICKERS ONLY. PROVIDE AND INSTALL INTERMEDIATE KICKERS BETWEEN PURLINS AS REQUIRED TO HANG EQUIPMENT AND SHEET METAL DUCTWORK.
- K. ALL PLUMBING VENTS, EXHAUST OUTLETS AND GAS FLUES SHALL BE A MINIMUM OF 10'-0" FROM ANY AIR INTAKE INTO THE BUILDING, PER CODE.
- L. ALL EQUIPMENT PLACEMENT SHALL COMPLY WITH THE MECHANICAL CODE LISTED IN THE BASIS OF DESIGN SCHEDULE.
- M. MECHANICAL CONTRACTOR SHALL PROVIDE AND INSTALL PERMANENT ENGRAVED PLASTIC-LAMINATE SIGNS WITH MINIMUM 1"-TALL LETTERING AT ALL ROOFTOP UNITS, EXHAUST FANS AND HVAC EQUIPMENT LOCATIONS THROUGHOUT ENTIRE BUILDING AND ROOFTOP. MOUNT PERMANENTLY IN AN APPROPRIATE AND EFFECTIVE LOCATION, WITH UNIT DESIGNATION AND AREA SERVED SHOWN.
- N. SUPPLY AND RETURN DUCTWORK FROM ROOFTOP UNITS TO BE INTERNALLY INSULATED A MINIMUM OF TEN FEET FOR SOUND ATTENUATION.
- O. ALL BRANCH DUCTS OFF MAIN DUCT TO BE INSTALLED WITH 45° TIME-AND-A-HALF FITTING, RADIUS FITTING, OR SPIN-IN ONLY. NO STRAIGHT TAPS OR AIR SCOOPS ALLOWED, UNLESS NOTED OTHERWISE.
- P. FLEXIBLE DUCT RUNS SHALL BE NO LONGER THAN 6'-0".
- Q. BRANCH DUCTS TO SUPPLY DIFFUSERS SHALL BE THE SAME SIZE AS DIFFUSER INLET, UNLESS NOTED OTHERWISE.
- R. INSTALL THERMOSTATS AT 48" A.F.F.

MECHANICAL SHEET INDEX

SHEET NUMBER	SHEET NAME
M0.0	MECHANICAL COVER SHEET
M0.1	MECHANICAL SCHEDULES
M0.2	MECHANICAL SPECIFICATIONS
M1.1	MECHANICAL PLAN - LEVEL 1
M1.2	MECHANICAL PLAN - LEVEL 2
M5.0	MECHANICAL DETAILS

REVISION HISTORY

REV	DATE	DESCRIPTION

MECHANICAL ENGINEER
CAILIN FARRIS
(720) 319-1046
CAILIN@FARRISCONSULTANTS.COM

ELECTRICAL ENGINEER
MARK OWENS
(208) 709-3111
MOWENS@XLENGINEERING.NET



NAME AND DATE FOR
CURRENT RELEASE ONLY

DESIGN:	DATE:
CWF	5/5/25
APPROVED:	
CWF	5/5/25

XL ENGINEERING

IDAHO FALLS, IDAHO

AUTO SERVICE ELEVATED
PARCEL NO: 37182030004500
ELK MEADOWS ADDITION LOT: 3
MECHANICAL COVER SHEET

PROJECT NUMBER: 240139

DWG- M0.0

GAS-FIRED UNIT HEATER SCHEDULE									
SYMBOL	MANUFACTURER	MODEL	LOCATION	TYPE	SUPPLY FAN	HEATING		ELECTRICAL	REMARKS
					CFM	INPUT (MBH)	TEMP RISE (°F)	VIPH	
UH-1	ENERGY LOGIC	EL-140H	SHOP	WASTE OIL	1,000	140	100-120		

SYMBOL	MANUFACTURER	MODEL	SERVES	TYPE	CFM	ESP (IN. W.C.)	ELECTRICAL			RPM	SONES	CONTROL	WEIGHT	REMARKS
							V/Hz.PH	HP (W)	FLA					
EF-1	GREENHECK	SP-A90	RESTROOM	DIRECT DRIVE CEILING	70	0.2	120/1	(11)	0.17	832	0.3	LIGHTS	12	1-2
EF-2	GREENHECK	SP-A90	ADA RESTROOM	DIRECT DRIVE CEILING	70	0.2	120/1	(11)	0.17	832	0.3	LIGHTS	12	1-2
EF-3	GREENHECK	SP-A90	STORAGE	DIRECT DRIVE CEILING	70	0.2	120/1	(11)	0.17	832	0.3	CONTINUOUS	12	1-2
EF-4	GREENHECK	SE1-16-426	SHOP	DIRECT DRIVE SIDEWALL	1,700	0.1	208/1	1/2	4	1,061	5.6	CARBON MONOXIDE SENSOR	34	1
EF-1-1	GREENHECK	SP-A90	RESTROOM	DIRECT DRIVE CEILING	70	0.2	120/1	(11)	0.17	832	0.3	LIGHTS	12	1-2
EF-2-1	GREENHECK	SP-A90	RESTROOM	DIRECT DRIVE CEILING	70	0.2	120/1	(11)	0.17	832	0.3	LIGHTS	12	1-2
EF-3-1	GREENHECK	SP-A90	RESTROOM	DIRECT DRIVE CEILING	70	0.2	120/1	(11)	0.17	832	0.3	LIGHTS	12	1-2

1. PROVIDE WITH SOLID STATE SPEED CONTROLLER MOUNTED ON FAN HOUSING AND FACTORY BACKDRAFT DAMPER. BACKDRAFT DAMPER NOT REQUIRED FOR FANS THAT OPERATE CONTINUOUSLY.
2. PROVIDE WITH WALL EXHAUST CAP.

ENERGY RECOVERY VENTILATOR SCHEDULE										
SYMBOL	MANUFACTURER	MODEL	FAN		EFFECTIVENESS			ELECTRICAL		
			CFM	ESP (IN. W.C.)	TOTAL (SUMMER)	TOTAL (WINTER)	SENSIBLE	FAN WATTS	MOCp	V/PH
ERV-1	PANASONIC	FV-06VE1	30	0.25	60%	70%	70%	39	15	120/1
ERV-1-1	PANASONIC	FV-06VE1	30	0.25	60%	70%	70%	39	15	120/1
ERV-2-1	PANASONIC	FV-06VE1	30	0.25	60%	70%	70%	39	15	120/1
ERV-3-1	PANASONIC	FV-06VE1	30	0.25	60%	70%	70%	39	15	120/1

ELECTRIC HEATER SCHEDULE								
SYMBOL	MANUFACTURER	MODEL	LOCATION	TYPE	CFM	ELECTRICAL		REMARKS
						V/PH	WATTS	
EH-1	QMARK	EFF	OFFICE	CEILING MOUNTED FAN-FORCED HEATER	150	208/1	4,000	2
EH-2	BERKO	GFR1000F	ADA RESTROOM	WALL HEATER	100	120/1	1,000	1
EH-3	BERKO	GFR1000F	FIRE RISER	WALL HEATER	100	120/1	1,000	1
EH-1-1	BERKO	GFR1000F	APARTMENT 1	WALL HEATER	100	120/1	1,000	2
EH-3-1	BERKO	GFR1000F	APARTMENT 3	WALL HEATER	100	120/1	1,000	2

1. PROVIDE WITH SURFACE-MOUNTING FRAME AND INTEGRAL SINGLE-POLE THERMOSTAT
2. PROVIDE WITH MOUNTING HARDWARE AND REMOTE THERMOSTAT.

SYMBOL	MANUFACTURER	MODEL	OUTDOOR UNIT TAG	SERVES	TYPE	NOMINAL TONS	MAX CFM	TOTAL COOLING CAPACITY	SENSIBLE COOLING CAPCITY	HEATING CAPACITY	CONDENSATE CONNECTION SIZE (IN)	WEIGHT (LBS)	REMARKS
FC-1-1	DAIKIN	CTXS07LVJU	HP-1	APARTMENT 1	WALL MOUNTED	0.5	350	28.8	18.0	13.0	5/8	20	1-5
FC-1-2	DAIKIN	CTXS07LVJU			WALL MOUNTED	0.5	350				5/8	20	1-5
FC-1-3	DAIKIN	FTXS12LVJU			WALL MOUNTED	1	435				5/8	22	1-5
FC-2-1	DAIKIN	CTXS07LVJU	HP-2	APARTMENT 2	WALL MOUNTED	0.5	350	28.8	18.0	13.0	5/8	20	1-5
FC-2-2	DAIKIN	CTXS07LVJU			WALL MOUNTED	0.5	350				5/8	20	1-5
FC-2-3	DAIKIN	FTXS12LVJU			WALL MOUNTED	1	435				5/8	22	1-5
FC-3-1	DAIKIN	CTXS07LVJU	HP-3	APARTMENT 3	WALL MOUNTED	0.5	350	28.8	18.0	13.0	5/8	20	1-5
FC-3-2	DAIKIN	CTXS07LVJU			WALL MOUNTED	0.5	350				5/8	20	1-5
FC-3-3	DAIKIN	FTXS12LVJU			WALL MOUNTED	1	435				5/8	22	1-5

1. RATED COOLING CAPACITY, IN MBH, BASED ON 80°F DB/67°F WB INDOOR CONDITIONS AND 95°F AMBIENT. COOLING CAPACITY IS SHOWN AS A COMBINED TOTAL FOR THE ASSOCIATED HEAT PUMP.
2. RATED HEATING CAPACITY, IN MBH, BASED ON 70°F DB/60°F WB INDOOR CONDITIONS AND -13°F AMBIENT. HEATING CAPACITY IS SHOWN AS A COMBINED TOTAL FOR THE ASSOCIATED HEAT PUMP.
3. PROVIDE UNIT WITH REFRIGERANT. MECHANICAL CONTRACTOR SHALL PROVIDE AND INSTALL REFRIGERANT LINE SETS, SIZED AND INSTALLED PER MANUFACTURER'S RECOMMENDATIONS.
4. PROVIDE WITH FACTORY WIRED THERMOSTAT.
5. PROVIDE WITH ASPEN PUMPS MINI BLANC CONDENSATE PUMP.

HEAT PUMP SCHEDULE										
SYMBOL	MANUFACTURER	MODEL	SERVES	TYPE	NOMINAL TONS	ELECTRICAL		EFFICIENCY (1)		REMARKS
						V/HZ/PH	RLA	SEER (SEER 2)	HSPF	
HP-1-1	DAIKIN	3MXL24	APARTMENT 1	HEAT PUMP, AIR-COOLED	2	208/60/1	9.3	17.9	12.5	1-4
HP-2-1	DAIKIN	3MXL24	APARTMENT 2	HEAT PUMP, AIR-COOLED	2	208/60/1	9.3	17.9	12.5	1-4
HP-3-1	DAIKIN	3MXL24	APARTMENT 3	HEAT PUMP, AIR-COOLED	2	208/60/1	9.3	17.9	12.5	1-4

1. EFFICIENCY VALUES LISTED ARE BASED ON ARI CONDITIONS.
2. PIPING SIZED & INSTALLED PER MANUFACTURER'S REQUIREMENTS.
3. PROVIDE UNIT WITH HIGH PRESSURE SWITCH, LOW PRESSURE SWITCH, CRANKCASE HEATER, TIME-DELAY RELAY, AND CYCLE PROTECTOR.
4. CONDENSING UNIT TO SERVE MULTIPLE INDOOR UNITS. SEE FAN COIL SCHEDULE FOR MORE INFORMATION.

CEILING FAN SCHEDULE												
SYMBOL	MANUFACTURER	MODEL	DIAMETER (FT)	TYPE	CLEARANCE (FT)		ELECTRICAL		RPM	CONTROL	WEIGHT	REMARKS
					ABOVE	SIDE	VHZ/PH	MOPP				
CF-1	BIGASS FANS	POWERFOILD	8	DIRECT DRIVE CEILING	4	2	208/1	10	200	VFD	212	1

1. PROVIDE WITH LED LIGHT KID MODEL 009769 5000K, WALL MOUNTED LOCKABLE SPEED CONTROLS AND FIRE SUPPRESSION PANEL TIE-IN RELAY.


LOUVER SCHEDULE											
SYMBOL	MANUFACTURER	MODEL	SYSTEM	TYPE	FLOW (CFM)	SIZE		MIN. FREE AREA (FT2)	VELOCITY (FPM)	MOUNTING ELEVATION (IN) (3)	REMARKS
						WIDTH (IN)	HEIGHT (IN)				
L-1	GREENHECK	ESD-635	INTAKE	DRAINABLE FIXED BLADE	1,700	32	32	3.8	453	6	1.2

1. PROVIDE WITH FLANGED FRAME AND BIRDSCREEN. INSTALLED COMPLETE W/ SILL FLASHINGS TO SUIT WALL CONSTRUCTION. FACTORY PRIME COAT FINISH.
2. PROVIDE W/ 120V MOTORIZED DAMPER WITH END SWITCH.
3. MOUNT LOUVER WITH TOP OF LOUVER THIS DISTANCE BELOW THE CEILING. CONFIRM CEILING ELEVATION WITH ARCHITECTURAL PLANS.

[illegible]

MECHANICAL ENGINEER
CAILIN FARRIS
(720) 319-1046
CAILIN@FARRISCONSULTANTS.COM

ELECTRICAL ENGINEER
MARK OWENS
(208) 709-3111
MOWENS@XLENGINEERING.NET

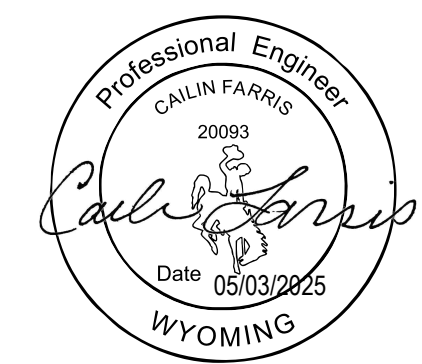

NAME AND DATE FOR
CURRENT RELEASE ONLY


DESIGN:	DATE:
CWF	5/5/25
APPROVED:	
CWF	5/5/25

XL ENGINEERING
IDAHO FALLS, IDAHO

AUTO SERVICE ELEVATED
PARCEL NO: 37182030004500
ELK MEADOWS ADDITION LOT: 3
MECHANICAL SCHEDULES

PROJECT NUMBER: 240139

DWG- MO.1



M1	TERMINATE DUCT AT WALL OR SOFFIT WITH APPROVED SCREENED CAP UNLESS NOTED OTHERWISE.
M5	INSTALL CONDENSERS ON CONCRETE EQUIPMENT PAD. MAINTAIN CLEARANCE PER MANUFACTURER'S RECOMMENDATION. AVOID ROOF DRIP LINE.
M8	THERMOSTAT TO BE LOCATED 48" A.F.F. VERIFY LOCATION WITH OWNER BEFORE INSTALLING.

MECHANICAL ENGINEER
CAILIN FARRIS
(720) 319-1046
CAILIN@FARRISCONSULTANTS.COM


ELECTRICAL ENGINEER
MARK OWENS
(208) 709-3111
MOWENS@XLENGINEERING.NET



DESIGN: CWF	DATE: 5/5/25
APPROVED: CWF	5/5/25

PROJECT NUMBER:	240139
-----------------	--------

DWG- M1.1



M1	TERMINATE DUCT AT WALL OR SOFFIT WITH APPROVED SCREENED CAP UNLESS NOTED OTHERWISE.
M8	THERMOSTAT TO BE LOCATED 48" A.F.F. VERIFY LOCATION WITH OWNER BEFORE INSTALLING.

MECHANICAL ENGINEER
CAILIN FARRIS
(720) 319-1046
CAILIN@FARRISCONSULTANTS.COM

ELECTRICAL ENGINEER
MARK OWENS
(208) 709-3111
MOWENS@XLENGINEERING.NET

























DESIGN: CWF	DATE: 5/5/25
APPROVED: CWF	5/5/25

PROJECT NUMBER:	240139
-----------------	--------

DWG- M1.2

PLUMBING LEGEND

SYMBOLS	ABBREV.	DESCRIPTION
	GW	GREASE WASTE
	W	WASTE
	V	VENT
	CW	COLD WATER
	HW	HOT WATER
	HWR	HOT WATER RETURN
	CD	CONDENSATE DRAIN
	RD	ROOF DRAIN
	FD	FLOOR DRAIN
	FS	FLOOR SINK
	HD	HUB DRAIN
	RD	ROOF DRAIN
	VTR	VENT THROUGH ROOF
	HB	HOSE BIBB
	S.O.V.	SHUT OFF VALVE
	DCBP	DOUBLE CHECK BACKFLOW PREVENTION
		CIRCULATING PUMP
	FCO/COTG	FLOOR CLEANOUT OR CLEANOUT TO GRADE
	WCO	WALL CLEANOUT
		PIPE UP
		PIPE DOWN
		PIPE TEE DOWN
	A.F.F.	ABOVE FINISHED FLOOR
	B.F.F.	BELOW FINISHED FLOOR
	I.E.	INVERT ELEVATION
	T&P	TEMPERATURE AND PRESSURE

PLUMBING GENERAL NOTES

- A. ALL WORK AND MATERIALS SHALL CONFORM TO THE CODES LISTED IN THE BASIS OF DESIGN AND ALL REQUIREMENTS OF THE AUTHORITIES HAVING JURISDICTION.
- B. OBTAIN FIELD APPROVAL FOR PLUMBING INSTALLATION FROM AUTHORITIES HAVING JURISDICTION.
- C. NO WORK SHALL BE COVERED UP UNTIL IT HAS BEEN INSPECTED, TESTED AND APPROVED BY AUTHORITIES HAVING JURISDICTION.
- D. VERIFY LOCATION, SIZE, DEPTH AND AVAILABILITY OF ALL UTILITIES INCLUDING SEWER, WATER AND GAS PRIOR TO START OF ANY WORK
- E. DRAWINGS AND SPECIFICATIONS GOVERN WHERE THEY EXCEED CODE REQUIREMENTS.
- F. ALL PLUMBING FIXTURE LOCATIONS (WATER CLOSETS, LAVATORIES, ETC) ARE DIAGRAMMATIC. CONTRACTOR SHALL REFER TO ARCHITECTURAL DRAWINGS FOR EXACT LOCATIONS.
- G. ALL PLUMBING FIXTURES AND EQUIPMENT SHALL HAVE ISOLATION VALVES ON WATER SUPPLY LINE. VALVES SHALL BE FULL PORT LINE SIZED UNLESS NOTED OTHERWISE.
- H. PROVIDE ACCESS DOORS TO ALL LINE CONNECTIONS, STRAINERS, TRAP PRIMERS, WATER HAMMER ARRESTORS, ETC.
- I. PROVIDE FLOOR DRAINS AND FLOOR SINKS WITH AN APPROVED AUTOMATIC TRAP PRIMER WHERE REQUIRED BY AUTHORITIES HAVING JURISDICTION.
- J. CONTRACTOR SHALL PROVIDE CLEAN-OUTS WHERE SHOWN AND AS REQUIRED BY CODE. CLEAN-OUTS SHALL BE ACCESSIBLE.
- K. UNDERGROUND PIPING SHALL BE LOCATED AWAY FROM BEARING FOOTINGS AND SHALL COMPLY WITH DETAILS ON STRUCTURAL DRAWINGS.
- L. ALL PIPING IN FINISHED AREAS SHALL BE RUN CONCEALED UNLESS NOTED OTHERWISE ON DRAWINGS. EXPOSED PIPING, WHEN NOTED AS SUCH, SHALL BE RUN AS HIGH AS POSSIBLE AND TIGHT TO STRUCTURE.
- M. ALL PIPING PENETRATING WALL, CEILING AND FLOOR SHALL BE ISOLATED FROM BUILDING STRUCTURES WITH RESILIENT SLEEVES.
- N. ALL OPENINGS FOR PIPING THROUGH FIRE RATED ENCLOSURES SHALL BE CAULKED AS REQUIRED BY CODE TO MAINTAIN FIRE RATING.
- O. COORDINATE ALL WORK WITH OTHER TRADES AND CONTRACTORS PRIOR TO START OF WORK.
- P. ALL EQUIPMENT SHALL BE U.L.-LISTED.
- Q. BRING TO THE ATTENTION OF THE OWNER'S REPRESENTATIVE ANY OMISSIONS OR CONFLICTS BETWEEN THE DRAWING AND SPECIFICATIONS BEFORE PROCEEDING WITH THE WORK.
- R. CONTRACTOR TO PROVIDE ROUGH-INS AND FINAL CONNECTIONS FOR FIXTURES AND EQUIPMENT FURNISHED BY OTHERS.
- S. NO VENT OUTLET SHALL TERMINATE CLOSER THAN FOUR FEET TO OR ONE FOOT ABOVE ANY DOOR, WINDOW OR GRAVITY AIR INTAKE. NOR CLOSER THAN TEN FEET TO OR LESS THAN THREE FEET ABOVE ANY FORCED OR MECHANICAL AIR INTAKE. VENT OUTLETS SHALL BE A MINIMUM OF TWO FEET FROM THE EDGE OF THE ROOF.
- T. VENT WASTES SHALL RISE VERTICALLY TO A POINT NOT LESS THAN 6" IN HEIGHT ABOVE THE FLOOR LINE. THE RIM OF THE FIXTURE THEREFORE BEING CONNECTED TO ANY OTHER VENT.
- U. FAUCET AND PLUMBING FIXTURES SHALL BE OF THE WATER CONSERVATION TYPE.
- V. ALL PIPE SHALL BE TIGHTLY SECURED TO THE STRUCTURE AND SHALL BE SUPPORTED PER CODE REQUIREMENTS.
- W. ACCESSIBLE FIXTURES SHALL BE INSTALLED IN ACCORDANCE WITH THE CODE AND AUTHORITIES HAVING JURISDICTION.
- X. ALL POTABLE WATER OUTLETS WITH HOSE ATTACHMENTS, SUCH AS HOSE BIBBS AND MOP SINKS, SHALL BE PROVIDED WITH A BACKFLOW/ANTI-SIPHON VALVES.
- Y. ALL WASTE AND GREASE WASTE PIPING SHALL BE A MINIMUM 1/4" PER FOOT SLOPE, UNLESS OTHERWISE NOTED.
- Z. DRAINAGE PIPING SERVING FIXTURES WHICH HAVE FLOOD WATER RISKS LOCATED BELOW THE ELEVATION OF THE NEXT UPSTAIR MANHOLE COVER OF THE RISER SERVING SUCH DRAINAGE PIPING SHALL BE PROTECTED FROM BACKFLOW OF SEWAGE BY INSTALLING AN APPROVED BACKWATER VALVE.
- AA. ALL DIMENSIONS SHOWN ARE IN INCHES UNLESS NOTED OTHERWISE.
- AB. ALL ROOF PENETRATIONS SHALL BE SEALED WATER-TIGHT. ALL SEALING OF THE ROOF SHALL BE COMPLETED IN ACCORDANCE WITH ROOFING SYSTEM REQUIREMENTS AND ROOF MANUFACTURER'S WARRANTY. COORDINATE ALL NEW WORK WITH ROOFING CONTRACTOR.
- AC. ALL NEW PLUMBING, EXCEPT ALL NEW OR REPAIRED POTABLE WATER SYSTEMS PRIOR TO USE PER AUTHORITIES HAVING JURISDICTION.
- AD. ALL WATER HEATERS SHALL BE SET AT 140°F. UNLESS NOTED OTHERWISE.
- AE. INSULATION SHALL BE PROVIDED AT ALL HOT WATER AND HOT WATER RECIRCULATION PIPING AND THE FIRST 9' OF COLD WATER PIPING FROM THE WATER HEATER.
- AF. ALL WATER PIPING DROPS ALONG EXTERIOR WALLS SHALL BE ROUTED DOWN WARM SIDE OF INSULATION.
- AG. RUN ALL WATER PIPING AS HIGH AS POSSIBLE IN CEILING SPACE OR TIGHT TO STRUCTURE UNLESS OTHERWISE NOTED.
- AH. RUN ALL GAS PIPING ON ROOF UNLESS OTHERWISE NOTED. SUPPORT WITH MIRO BLOCK SUPPORT.
- II. FAN COIL CONDENSATE PIPING SHALL NOT DECREASE IN SIZE FROM THE DRAIN PAN CONNECTION TO THE PLACE OF CONDENSATE DISPOSAL. SEE MANUFACTURER SUBMITTAL FOR CONNECTION SIZE.

PLUMBING SHEET INDEX


SHEET NUMBER	SHEET NAME
P0.0	PLUMBING COVER SHEET
P0.1	PLUMBING SCHEDULES
P0.2	PLUMBING SPECIFICATIONS
P1.1	WASTE AND VENT PLAN - LEVEL 1
P1.2	WASTE AND VENT PLAN - LEVEL 2
P2.1	WATER AND GAS PLAN - LEVEL 1
P2.2	WATER AND GAS PLAN - LEVEL 2
P5.0	PLUMBING DETAILS AND DIAGRAMS

REVISION HISTORY

[illegible]

MECHANICAL ENGINEER
 CAILIN FARRIS
 (720) 319-1046
 CAILIN@FARRISCONSULTANTS.COM

ELECTRICAL ENGINEER
MARK OWENS
(208) 709-3111
MOWENS@XLENGINEERING.NET

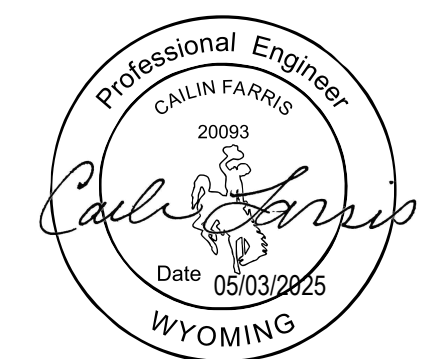

NAME AND DATE FOR
CURRENT RELEASE ONLY

DESIGN:	DATE:
CWF	5/5/25
APPROVED:	
CWF	5/5/25

XL ENGINEERING

IDAHO FALLS, IDAHO

AUTO SERVICE ELEVATED
PARCEL NO: 37182030004500
ELK MEADOWS ADDITION LOT: 3

PROJECT NUMBER: 240139

DWG- P0.0

SYMBOL	LOCATION	DESCRIPTION	MANUFACTURER & MODEL NUMBER	SANITARY CONNECTIONS (IN)		WATER CONNECTIONS (IN)		REMARKS
				WASTE	VENT	HOT	COLD	
BT-1	DWELLING UNITS	TUB / SHOWER	KOHLER K-837 OR K-838	2	2	1/2	1/2	LEFT OR RIGHT HAND CONFIGURATION BASED ON UNIT TYPE. CONTRACTOR SHALL BE RESPONSIBLE FOR COUNTING THE NUMBER OF REQUIRED LEFT AND RIGHT HAND DRAIN CONFIGURATIONS PRIOR TO ORDERING.
		TRIM / SPOUT / SHOWER HEAD	KOHLER K-TS27421-4					CHROME FINISH.
		MIXING VALVE	KOHLER K-8304-K					-
		DRAIN & OVERFLOW PROTECTION	WATCO 900-PPSF-0-CP					CHROME FINISH.
DW-1	DWELLING UNITS	DISHWASHER	GE PDT15SYNFS	-	-	1/2	-	-
HB-1	SEE PLANS	FROST-PROOF HOSE BIBB	WOODFORD B65	-	-	-	3/4	PROVIDE WITH ISOLATION VALVE AND VACUUM BREAKER.
IM-1	SEE PLANS	ICE MAKER OUTLET BOX	SIOUX CHIEF 696 SERIES	-	-	-	1/2	PROVIDE WITH NO-LEAD BRASS VALVES, HAMMER ARRESTER AND STANDARD FRAME PACK.
KS-1	DWELLING UNITS	DROP IN KITCHEN SINK	ELKAY DSE233223DFBG	2	2	1/2	1/2	PROVIDE WITH MXV-1.
		STRAINER	INCLUDED WITH UNIT					-
		FAUCET	INCLUDED WITH UNIT					-
		GARBAGE DISPOSAL	BADGER 500					1/2 HP / 120 V / 6.3 AMPS.
LAV-1	DWELLING UNITS	DROP IN LAVATORY SINK	KOHLER K-2196-4	2	2	1/2	1/2	WHITE FINISH. PROVIDE WITH MXV-1.
		FAUCET & DRAIN	KOHLER K-27389-4N					CHROME FINISH.
LAV-2	RESTROOMS	WALL HUNG LAVATORY SINK	KOHLER K-2007	2	2	1/2	1/2	WHITE FINISH. PROVIDE WITH MXV-1.
		FAUCET	CHICAGO FAUCET 116.606 AB.1					CHROME FINISH.
		STRAINER	KOHLER K-7129					CHROME FINISH.
		P-TRAP COVER	TRUEBROS EZ-102					-
		PLATE CARRIER	ZURN Z1224-2					-
MXV-1	SEE PLANS	4 PORT THERMOSTATIC MIXING VALVE	LEONARD 170D-LF	-	-	3/8	3/8	PROVIDE WITH CHECKSTOPS, OUTLET BALL VALVE AND DIAL THERMOMETER. SET TO 110°F DELIVERY TEMPERATURE.
PRV-1	SEE PLANS	PRESSURE REDUCING VALVE	WATTS LF223 SERIES	-	-	-	2	PRESSURE SET TO 80 PSI.
RPZ-1	SEE PLANS	REDUCED PRESSURE BACKFLOW PREVENTER	WATTS LF009	-	-	-	2	-
S-1	SEE PLANS	UTILITY SINK	ELKAY B1C18X18X	2	2	1/2	1/2	-
		FAUCET	ELKAY LK940BP03T4S					-
SH-1	SEE PLANS	SHOWER BASE	KOHLER K-8649	2	2	1/2	1/2	WHITE FINISH.
		DRAIN	KOHLER K-9132					CHROME FINISH.
		SHOWER KIT	KOHLER K-TS27420-4					CHROME FINISH.
		MIXING VALVE	KOHLER K-8304-K					-
WB-1	LAUNDRY ROOM	WASHING MACHINE OUTLET BOX	SIOUX CHIEF 696 SERIES	2	2	1/2	1/2	PROVIDE WITH NO-LEAD BRASS VALVES, HAMMER ARRESTER, STANDARD FRAME PACK AND DRAINAGE BOX.
WC-1	RESTROOMS	TANK TYPE WATER CLOSET	KOHLER K-31621-0	3	2	-	1/2	WHITE FINISH.
		SEAT	KOHLER K-20110-0					WHITE FINISH.
WC-2	RESTROOMS	TANK TYPE WATER CLOSET (ACCESSIBLE)	KOHLER K-3999-0	3	2	-	1/2	WHITE FINISH.
		SEAT	KOHLER K-20110-0					WHITE FINISH.

EXPANSION TANK SCHEDULE							
SYMBOL	MANUFACTURER	MODEL	LOCATION	TANK VOLUME (GAL)	ACCEPTANCE VOLUME (GAL)	WATER CONNECTION (IN)	REMARKS
ET-1	AMTROL	ST-5-C	MECHANICAL ROOM	2.1	0.9	1/2	1
ET-2	AMTROL	ST-5-C	MECHANICAL ROOM	2.1	0.9	1/2	1
ET-3	AMTROL	ST-5-C	MECHANICAL ROOM	2.1	0.9	1/2	1
ET-4	AMTROL	ST-5-C	MECHANICAL ROOM	2.1	0.9	1/2	1

1. THE CHARGE PRESSURE SHALL BE SET TO THE STATIC PRESSURE OF THE SYSTEM WHERE THE EXPANSION TANK IS INSTALLED.

ELECTRIC WATER HEATER SCHEDULE										
SYMBOL	MANUFACTURER	MODEL	LOCATION	CAPACITY					ELECTRICAL REQUIREMENTS	REMARKS
				KW	TANK VOLUME (GAL)	RECOVERY RATE AT 90°F RISE (GPH)	LEAVING WATER TEMPERATURE (°F)	UEF	VOLTS/PHASE	
WH-1	AO SMITH	EJC-10	ADA RESTROOM	1.65	10	8	120	N/A	120/1	1-2
WH-2	AO SMITH	ENSB-30	MECHANICAL CLOSET	4.5	30	21	120	0.91	240/1	1-2
WH-3	AO SMITH	ENSB-30	MECHANICAL CLOSET	4.5	30	21	120	0.91	240/1	1-2
WH-4	AO SMITH	ENSB-30	MECHANICAL CLOSET	4.5	30	21	120	0.91	240/1	1-2


1. PROVIDE WITH SEISMIC STRAPS AND DRAIN PAN. ROUTE T&P PIPING TO NEAREST MOP SINK OR FLOOR DRAIN WITHOUT CROSSING A WALKWAY.
2. PROVIDE WITH EXPANSION TANK. SEE EXPANSION TANK SCHEDULE FOR EXACT MANUFACTURER AND MODEL.

[illegible]

PRODUCTS		PLUMBING PROVISIONS	PLUMBING SPECIFICATIONS	4.	ALL INSULATED PIPING SHALL BE PROVIDED WITH MINIMUM 18 GAUGE GALVANIZED INSULATION SHIELDS, 12 INCHES LONG, AND OVERSIZED HANGERS. PIPE SIZES 2 INCHES AND OVER SHALL ALSO BE PROVIDED WITH 12 INCH LONG CALCIUM SILICATE INSULATING BLOCKS BETWEEN THE PIPING AND THE GALVANIZED INSULATION SHIELD.	
2.1	MATERIALS AND WORKMANSHIP					
A.	MATERIALS:					
1.	ALL MATERIALS AND EQUIPMENT SHALL BE OF FIRST QUALITY, NEW, FULL SIZE AND WEIGHT, STANDARD IN EVERY RESPECT, AND SUITABLE FOR THE SPACE REQUIRED. USE THE SAME MANUFACTURER FOR PRODUCTS OF SIMILAR CLASS OR SERVICE, SUCH AS VALVES, PUMPS, CONTROLS, AND AIR HANDLERS. PROTECT ALL MATERIALS AGAINST LOSS, THEFT, OR DAMAGE BEFORE AND AFTER INSTALLATION. FURNISH EQUIPMENT THAT WILL OPERATE UNDER ALL CONDITIONS OF LOAD WITHOUT ANY SOUND OR VIBRATION THAT IS OBJECTIONABLE IN THE OPINION OF THE ARCHITECT/ENGINEER. VIBRATION OR NOISE CONSIDERED OBJECTIONABLE WILL BE CORRECTED BY THE SUBCONTRACTOR AT HIS EXPENSE.					
2.	FURNISH AND INSTALL ALL NECESSARY FOUNDATIONS, SUPPORTS, PADS, BASES, AND PIERS REQUIRED FOR ALL MATERIALS AND EQUIPMENT FURNISHED UNDER THIS CONTRACT.					
3.	PROVIDE ALL REQUIRED FIRE STOPPING AT PIPING AND DUCT PENETRATIONS OF FIRE RATED WALLS, FLOORS, CEILINGS, AND ROOFS.					
4.	PROVIDE ALL REQUIRED FIRE STOPPING AT PIPING AND DUCT PENETRATIONS OF FIRE RATED WALLS, FLOORS, CEILINGS, AND ROOFS.					
B.	WORKMANSHIP:					
1.	ALL MATERIALS AND EQUIPMENT SHALL BE INSTALLED IN A NEAT AND WORKMANLIKE MANNER BY COMPETENT SPECIALISTS FOR EACH SUB TRADE. WORK SHALL BE INSTALLED TO THE SATISFACTION OF THE ARCHITECT/ENGINEER WITH UNSATISFACTORY WORK REMOVED AND REINSTALLED TO HIS SATISFACTION AT NO EXTRA COST TO THE OWNER.					
2.	PROVIDE ALL CUTTING AND PATCHING NECESSARY TO INSTALL THE WORK SPECIFIED IN THIS SECTION. PATCHING SHALL MATCH ADJACENT SURFACES. NO STRUCTURAL MEMBERS SHALL BE CUT WITHOUT THE APPROVAL OF THE ARCHITECT/ENGINEER. PROVIDE ALL SLEEVES AND INSERTS REQUIRED BEFORE THE FLOORS AND WALLS ARE BUILT.					
3.	LOCATE ALL EQUIPMENT THAT MUST BE SERVICED IN FULLY ACCESSIBLE POSITIONS. PROVIDE CLEARANCE FOR REMOVAL OF REPLACEMENT PARTS AND COMPONENTS, AND WITH NECESSARY COUPLINGS OR FLANGES TO REMOVE THE COMPONENT FOR MAINTENANCE.					
2.2	SUBMITTALS AND SUBSTITUTIONS					
A.	PREBID APPROVAL:					
1.	MANUFACTURER'S TRADE NAMES AND CATALOG NUMBERS STATED HEREIN ARE INTENDED TO INDICATE THE QUALITY OF EQUIPMENT OR MATERIALS DESIRED. ALL MANUFACTURERS NOT SPECIFICALLY LISTED REQUIRE PRIOR APPROVAL. SUBMIT CATALOG DATA, INCLUDING SPECIFICATIONS, OF THE PROPOSED EQUIPMENT TO THE ARCHITECT/ENGINEER FOR HIS APPROVAL AT LEAST 10 CALENDAR DAYS PRIOR TO BID OPENING. NOTICE OF SUCH APPROVALS WILL BE PUBLISHED IN AN ADDENDUM. APPROVAL OF LISTED ALTERNATE EQUIPMENT MANUFACTURERS IS FOR BIDDING ONLY. FINAL APPROVAL IS TO BE BASED ON REQUIREMENTS OF THE PLANS AND SPECIFICATIONS.					
B.	SUBMITTALS:					
1.	WITHIN THIRTY DAYS AFTER AWARD OF THIS CONTRACT, PROVIDE A COMPLETE LIST OF ALL MATERIALS AND EQUIPMENT PROPOSED FOR THIS PROJECT. LIST SHALL CONTAIN MAKE, TYPE, MANUFACTURER'S NAME, AND TRADE DESIGNATION OF ALL MATERIALS AND EQUIPMENT. SUBMITTAL SHALL ALSO INCLUDE MANUFACTURER'S COMPLETE SPECIFICATION FOR EACH ITEM, INCLUDING CAPACITIES, RATINGS, ETC. AND DIMENSIONS AS REQUIRED TO CHECK SPACE REQUIREMENTS. PROVIDE SIX PHYSICAL COPIES OR A DIGITAL COPY OF ALL SUBMITTALS. THE SCHEDULED EQUIPMENT IS THE BASIS OF DESIGN FOR CAPACITY, WEIGHTS, PHYSICAL SIZE, ETC. ALTERNATE MANUFACTURERS SHALL NOT EXCEED THE WEIGHT OR PHYSICAL SIZE. ANY CHANGES TO THE ARCHITECTURAL, STRUCTURAL, MECHANICAL, ELECTRICAL, AND CONTROL SYSTEMS DUE TO ALTERNATE MANUFACTURERS SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR AND SUPPLIER.					
2.	APPROVAL OF SUBMITTALS SHALL NOT RELIEVE THE CONTRACTOR FROM RESPONSIBILITY FOR DEVIATIONS FROM THE PLANS OR SPECIFICATIONS, UNLESS HE HAS, IN WRITING, CALLED THE ARCHITECT'S ENGINEER'S ATTENTION TO DEVIATIONS AT THE TIME OF SUBMISSION, AND OBTAINED HIS WRITTEN APPROVAL. APPROVAL OF SUBMITTALS DOES NOT RELIEVE THE CONTRACTOR FROM RESPONSIBILITY FOR ERRORS IN SHOP DRAWINGS OR LITERATURE.					
C.	EQUIPMENT REQUIRING SUBMITTALS:					
1.	PLUMBING FIXTURES AND TRIM					
2.	CAST IRON SOIL PIPE					
PART 3 - EXECUTION						
3.1	ACCESSIBILITY & SAFETY					
A.	ACCESSIBILITY:					
1.	ALL EQUIPMENT WHICH MUST BE SERVICED OR OPERATED SHALL BE LOCATED IN FULL, ACCESSIBLE POSITION. MINOR CHANGES FROM THE DRAWINGS MAY BE MADE TO ALLOW FOR BETTER ACCESSIBILITY. ALL CHANGES SHALL BE APPROVED PRIOR TO ACTUAL INSTALLATION.					
2.	ACCESS PANELS SHALL BE PROVIDED IF REQUIRED FOR ACCESSIBILITY. SUBCONTRACTOR SHALL FURNISH THE REQUIRED PANELS TO THE GENERAL CONTRACTOR AND THE REQUIRED LOCATION FOR ALL ACCESS PANELS. PANELS SHALL BE INSTALLED BY THE GENERAL CONTRACTOR.					
B.	SAFETY:					
1.	SUBCONTRACTOR SHALL PROVIDE GUARDS FOR ALL BELT DRIVES AND ROTATING MACHINERY. NO WATER PIPING SHALL RUN IMMEDIATELY OVER OR WITHIN A 3-FOOT PLAN VIEW CLEARANCE OF ANY ELECTRICAL PANEL OR MOTOR STARTER. WHERE PIPING MUST BE LOCATED WITHIN THESE ZONES, INSTALL PIPING INSIDE A CONDUIT TO PREVENT WATER ACCESS TO ELECTRICAL EQUIPMENT.					
3.2	COORDINATION					
A.	COORDINATE ALL WORK WITH THE VARIOUS TRADES INVOLVED TO PROVIDE A COMPLETE AND SATISFACTORY INSTALLATION. THE EXACT DETAILS OF PIPING, OUTWORK, AND EQUIPMENT ARE NOT SHOWN, NO ADDITIONAL COMPENSATION WILL BE MADE FOR OFFSETS OR RELOCATION REQUIRED IN COORDINATION WITH OTHER TRADES.					
B.	ALTERATIONS REQUIRED DUE TO IMPROPER SUPERVISION BY THE SUBCONTRACTOR SHALL BE MADE AT NO EXTRA COST, TO THE SATISFACTION OF THE ARCHITECT/ENGINEER.					
3.3	ELECTRICAL:					
A.	ELECTRIC MOTORS REQUIRED FOR EQUIPMENT SPECIFIED IN THIS SECTION SHALL BE PROVIDED AND INSTALLED BY THIS SUBCONTRACTOR. MOTOR STARTERS, RELAYS, PLOT LIGHTS, ETC., ARE, IN GENERAL, TO BE FURNISHED AND INSTALLED BY THE ELECTRICAL CONTRACTOR.					
B.	STARTERS, RELAYS, CONTROLS, DISCONNECTS, ETC., WHICH ARE FACTORY ASSEMBLED INTO OR PROVIDED WITH (PER SCHEDULES) PACKAGED EQUIPMENT SHALL BE FURNISHED BY THE MECHANICAL CONTRACTOR UNDER THIS SECTION OF THE SPECIFICATIONS.					
C.	ALL MOTORS SHALL BE PROVIDED WITH ADEQUATE STARTING AND PROTECTIVE EQUIPMENT AS SPECIFIED OR REQUIRED. MOTOR CAPACITY SHALL BE SUFFICIENT TO OPERATE DRIVEN DEVICE UNDER ALL CONDITIONS OF OPERATION AND LOAD WITHOUT OVERLOAD. MINIMUM HORSEPOWER SHALL BE AS SPECIFIED.					
3.4	EXCAVATION & BACKFILL					
A.	EXCAVATE TRENCHES REQUIRED FOR UNDERGROUND PIPING TO PROPER ELEVATION AND GRADE. PROVIDE TRENCHES WITH SOLID BOTTOMS TO ALLOW SUPPORT OF PIPING ALONG ENTIRE LENGTH WITH EXCAVATION AT BELLS AS REQUIRED FOR JOINTING AND INSPECTION. PROVIDE REPAIRING OF FINISHED SURFACES, AND ALL REQUIRED SHORING, BRACING, PUMPING, AND PROTECTION FOR SAFETY OF PERSONS AND PROPERTY. OBSERVE ALL LOCAL OR STATE SAFETY CODES. VERIFY THAT ELEVATIONS OF EXISTING UTILITIES WILL ALLOW FOR PROPER GRADING OF PIPING CONNECTING TO EXISTING UTILITIES.					
3.5	IDENTIFICATION & CODING					
A.	PIPING:					
1.	IDENTIFY ALL PIPING AS TO THE SERVICE OF THE PIPE AND THE DIRECTION OF FLOW. THE LETTERS SHALL BE 1/4-INCH HIGH ON PIPING 1-1/4 INCHES OR SMALLER, 3/4 INCH HIGH ON PIPING 1-1/2 TO TWO INCHES, 1-1/4 INCHES HIGH ON PIPING UP TO SIX INCHES, AND 2-1/2 INCHES HIGH ON 8 INCH PIPING OR LARGER. FLOW ARROWS SHALL BE AT LEAST SIX INCHES LONG. THE LETTERS AND FLOW ARROWS SHALL BE MADE BY PRECUT STENCILS OR OIL BASE PAINT, ONE INCH HIGH AND BLACK, OR FACTORY FABRICATED PLASTIC PIPE MARKERS. PIPING SHALL BE IDENTIFIED AT 25 FOOT MAXIMUM INTERVALS, ON LONG CONTINUOUS LINES, ADJACENT TO EACH ITEM OF EQUIPMENT, ON EACH RISER AND JUNCTION, AND ON BOTH SIDES OF ALL WALL AND FLOOR PENETRATIONS. UNDERGROUND PIPING SHALL BE IDENTIFIED WITH BRIGHT, COLORED CONTINUOUSLY PRINTED PLASTIC TAPE OF NOT LESS THAN 6" WIDE BY 4 MIL THICK, MANUFACTURED FOR DIRECT BURIAL SERVICE. INSTALL DIRECTLY ABOVE ALL BURIED PIPE, 6 TO 8 INCHES BELOW FINISHED GRADE. ALL PIPING SHALL BE LABELED PER THE APPLICABLE PLUMBING CODE, LATEST EDITION.					
B.	VALVES:					
1.	REGARDLESS OF SIZE, ALL VALVES SHALL BE TAGGED WITH A NUMBERED BRASS TAG, 1-1/2 INCHES BY 3 INCHES MINIMUM IN SIZE AND 0.051 INCH THICK, A VALVE CHART INDICATING VALVE TAG NUMBER, LOCATION, SERVICE, AND NORMAL POSITION SHALL BE MOUNTED IN A SUITABLE FRAMED AND GLASSED COVER IN THE MAIN MECHANICAL ROOM OR AS DIRECTED.					
1.1	GENERAL SCOPE					
A.	THIS SECTION COVERS THE WORK NECESSARY FOR THE PLUMBING SYSTEM. COMPLETE THE PLUMBING GENERAL PROVISIONS ARE TO BE INCLUDED AS A PART OF THIS SECTION OF THE SPECIFICATIONS.					
1.2	CODES					
A.	THE PLUMBING SYSTEM SHALL BE INSTALLED IN ACCORDANCE WITH THE APPLICABLE PLUMBING CODE, LATEST EDITION, APPLICABLE FUEL GAS CODE, LATEST EDITION, AND ALL LOCAL AND STATE CODES.					
1.3	FIXTURES & EQUIPMENT					
A.	GENERAL					

1

A

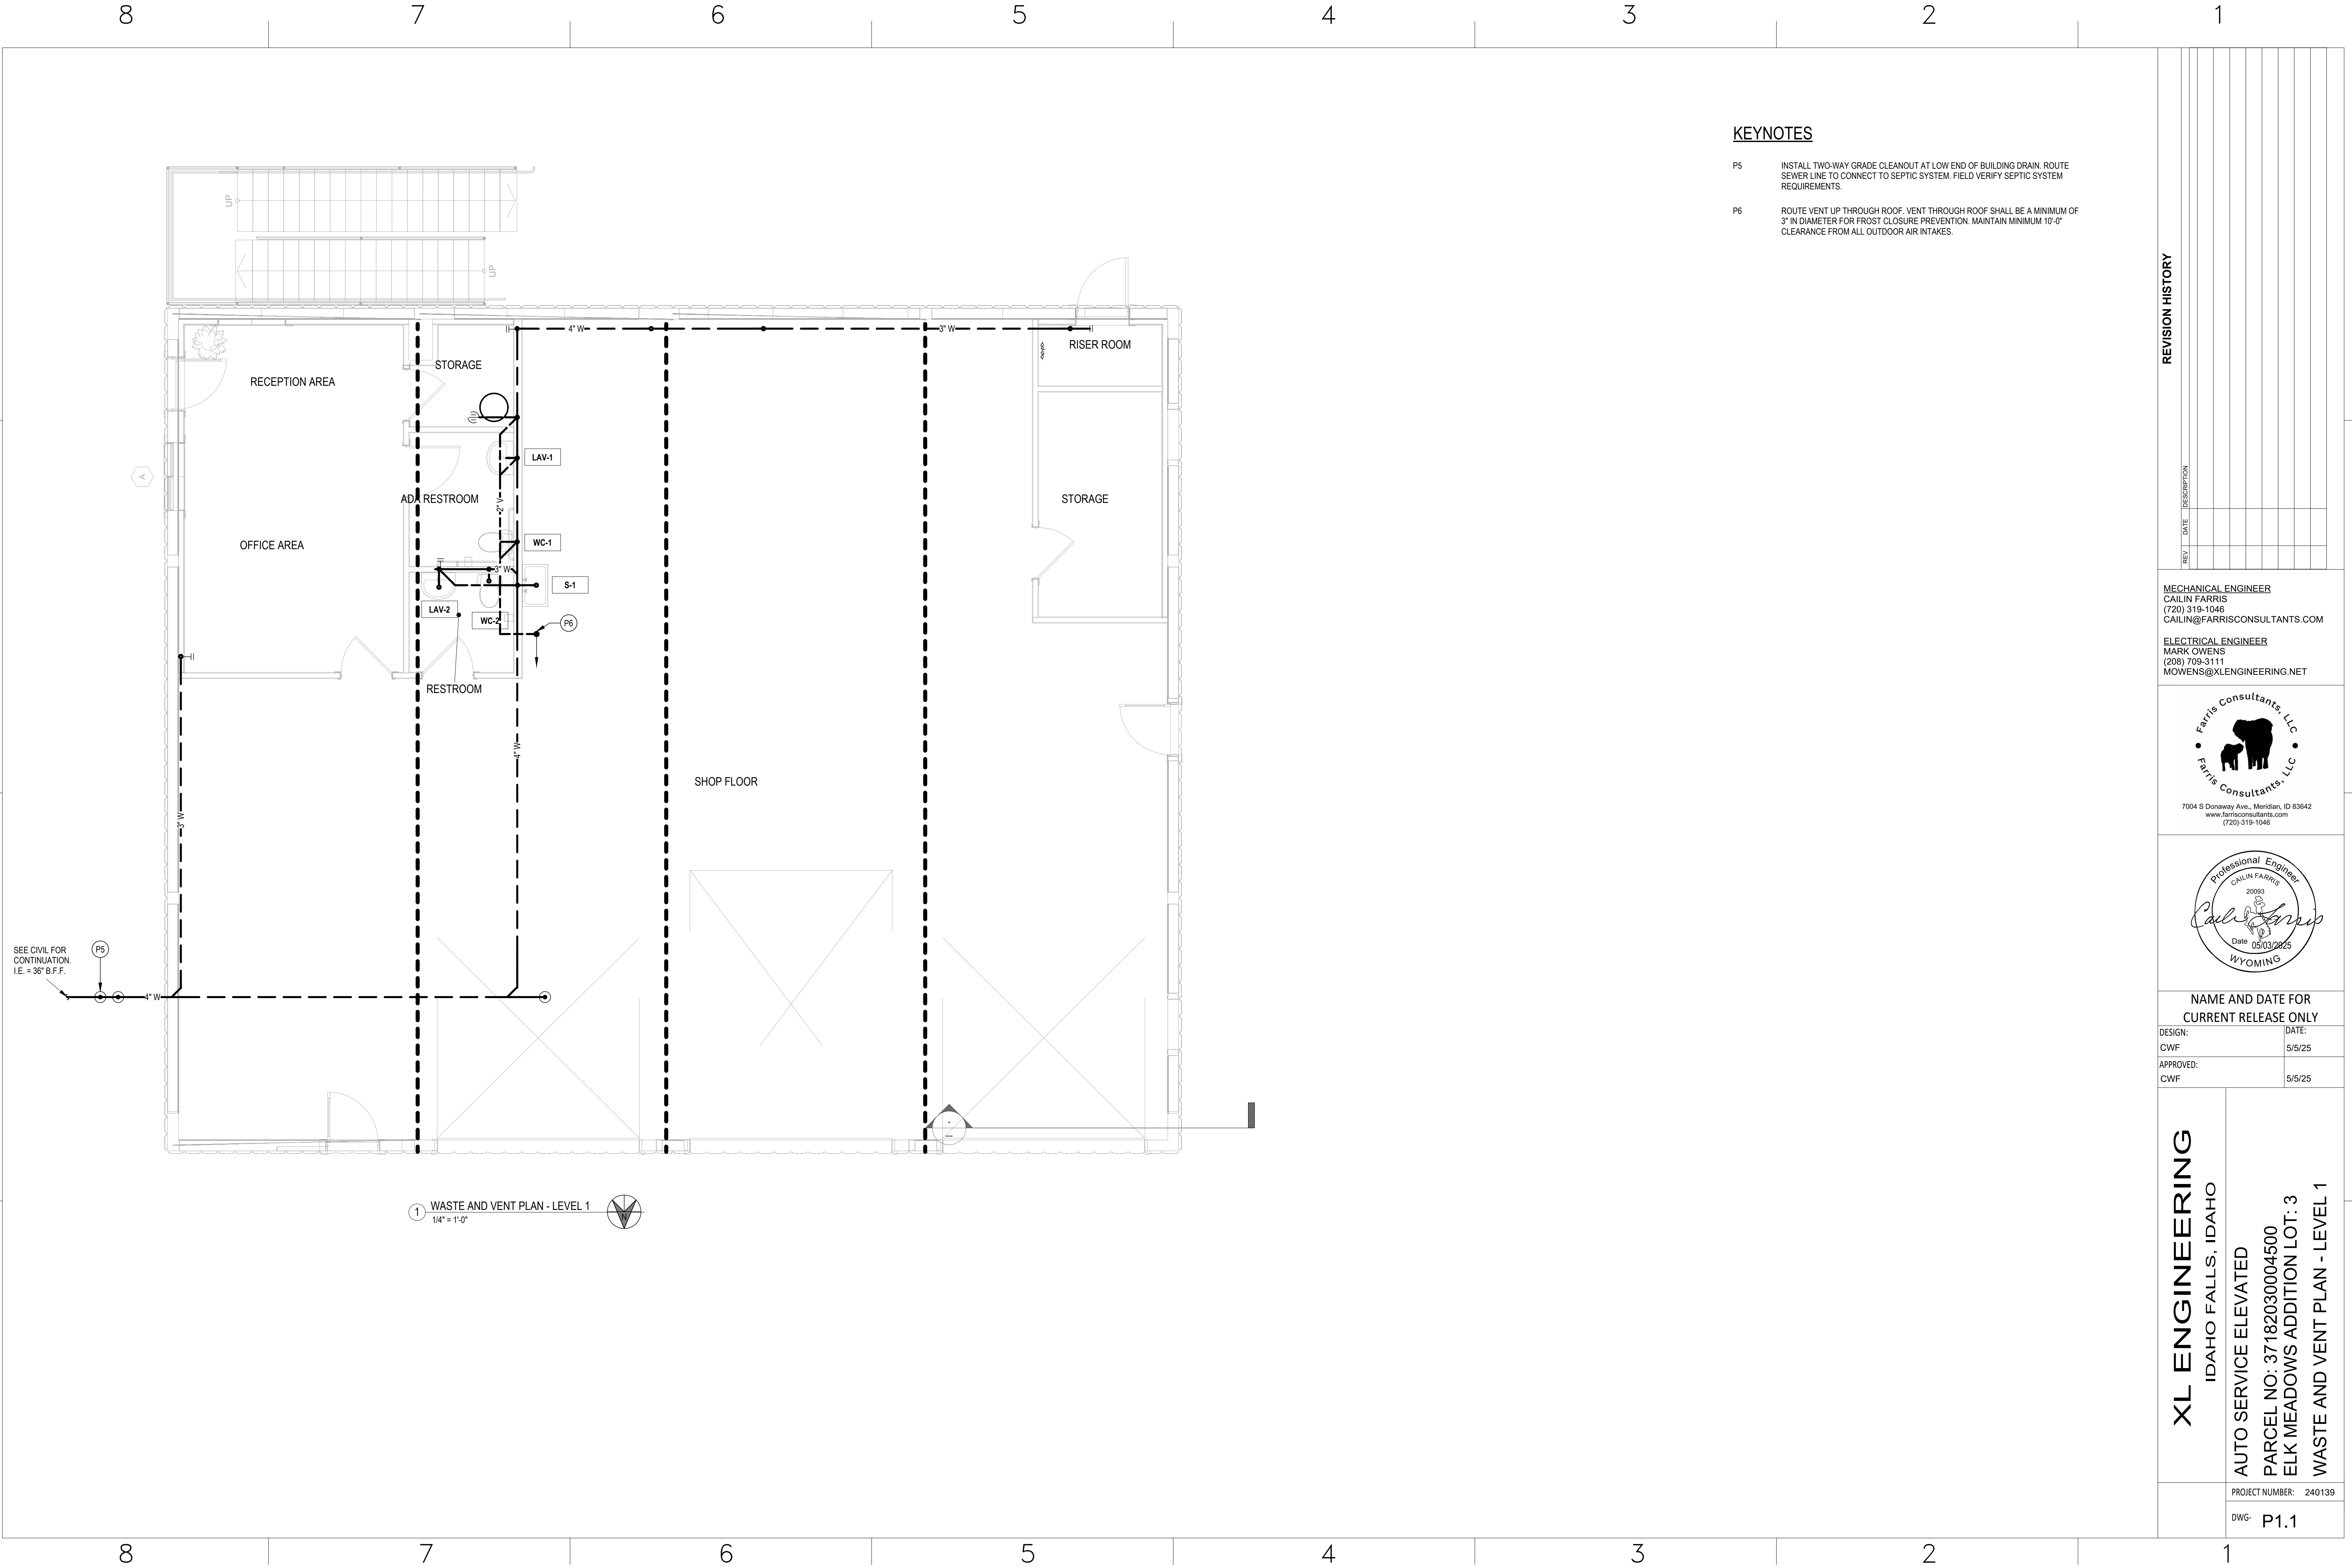

KEYNOTES

- P5

INSTALL TWO-WAY GRADE CLEANOUT AT LOW END OF BUILDING DRAIN. ROUTE SEWER LINE TO CONNECT TO SEPTIC SYSTEM. FIELD VERIFY SEPTIC SYSTEM REQUIREMENTS.
- P6


ROUTE VENT UP THROUGH ROOF. VENT THROUGH ROOF SHALL BE A MINIMUM OF 3" IN DIAMETER FOR FROST CLOSURE PREVENTION. MAINTAIN MINIMUM 10'-0" CLEARANCE FROM ALL OUTDOOR AIR INTAKES.

REVISION HISTORY

REV	DATE	DESCRIPTION

MECHANICAL ENGINEER
CAILIN FARRIS
(720) 319-1046
CAILIN@FARRISCONSULTANTS.COM

ELECTRICAL ENGINEER
MARK OWENS
(208) 709-3111
MOWENS@XLENGINEERING.NET

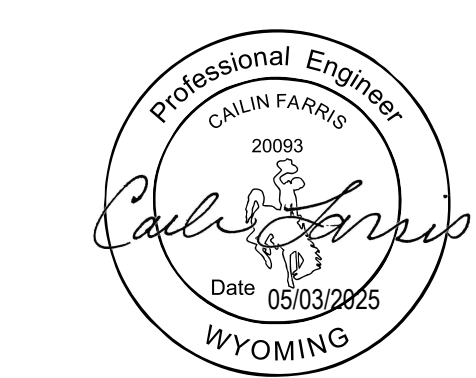


NAME AND DATE FOR CURRENT RELEASE ONLY	
DESIGN: CWF	DATE: 5/5/25
APPROVED: CWF	5/5/25


XL ENGINEERING
IDAHO FALLS, IDAHO

AUTO SERVICE ELEVATED
PARCEL NO: 37182030004500
ELK MEADOWS ADDITION LOT: 3
WASTE AND VENT PLAN - LEVEL 1

PROJECT NUMBER:	240139
DWG-	P1.1

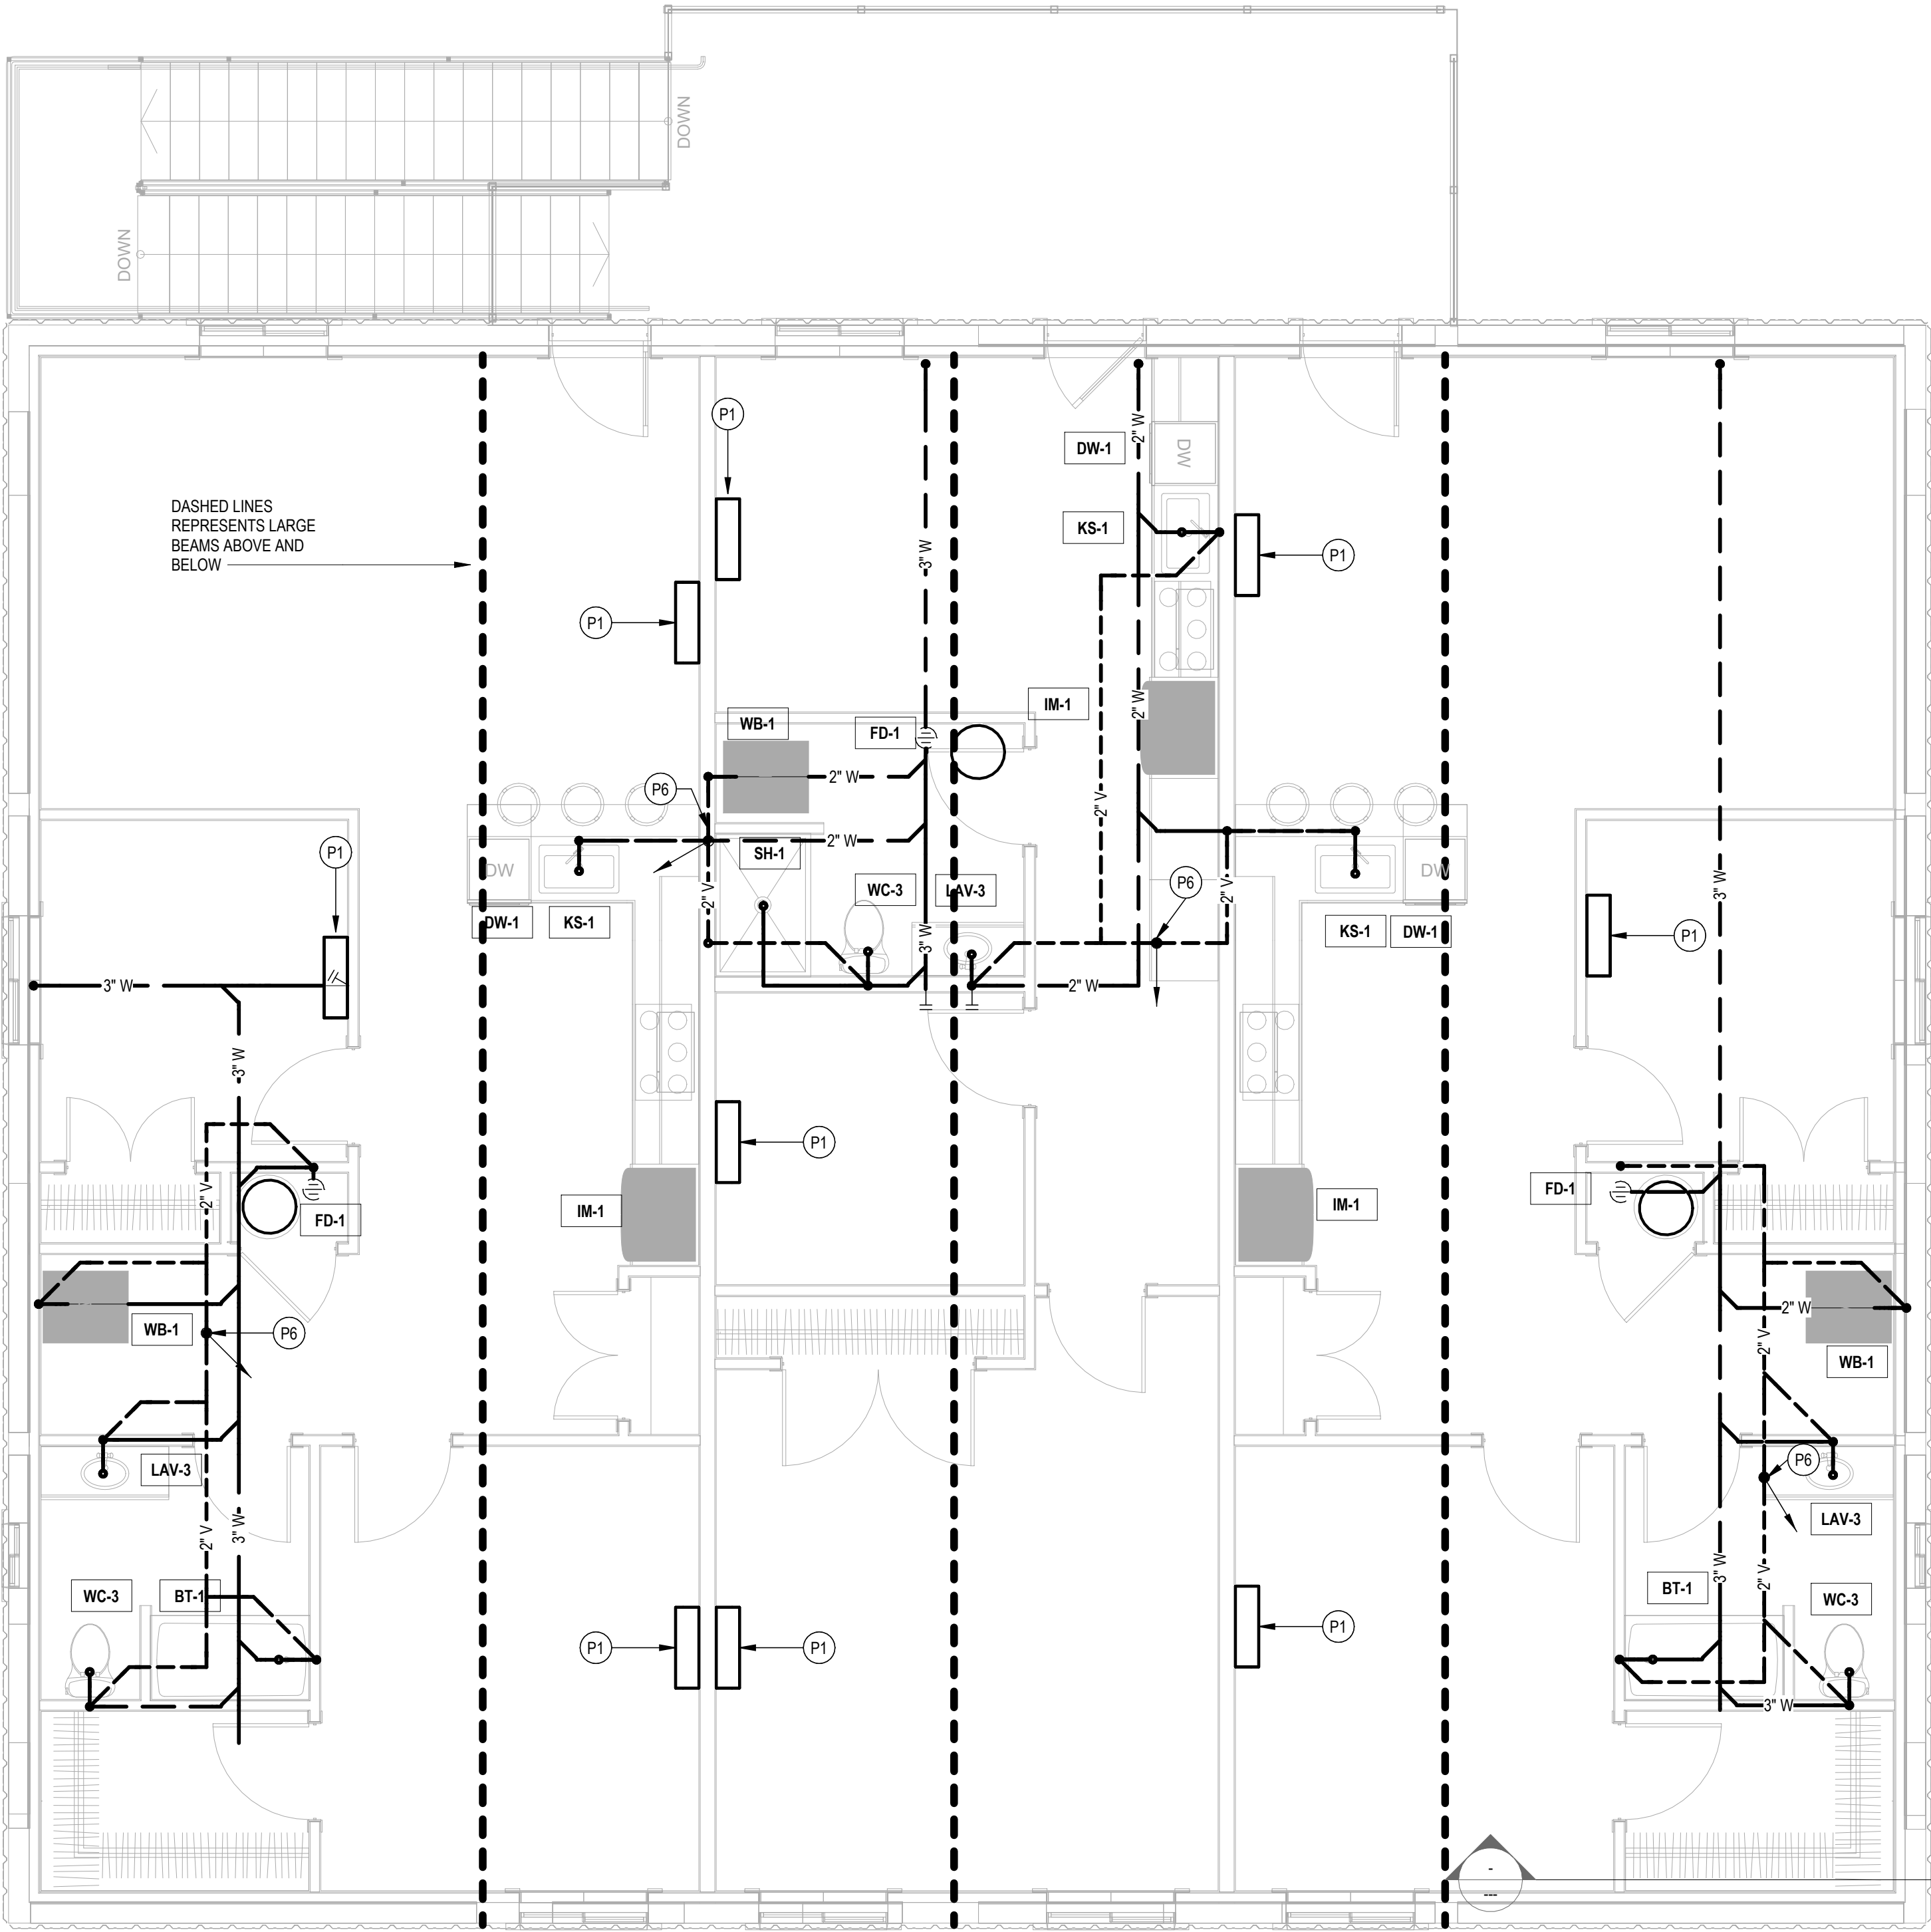

1 WASTE AND VENT PLAN - LEVEL 2
1/4" = 1'-0"



KEYNOTES


- P1 ROUTE CONDENSATE TO NEAREST SANITARY SEWER DRAIN.
- P6 ROUTE VENT UP THROUGH ROOF. VENT THROUGH ROOF SHALL BE A MINIMUM OF 3" IN DIAMETER FOR FROST CLOSURE PREVENTION. MAINTAIN MINIMUM 10'-0" CLEARANCE FROM ALL OUTDOOR AIR INTAKES.

REVISION HISTORY

REV	DATE	DESCRIPTION

MECHANICAL ENGINEER
CAILIN FARRIS
(720) 319-1046
CAILIN@FARRISCONSULTANTS.COM

ELECTRICAL ENGINEER
MARK OWENS
(208) 709-3111
MOWENS@XLENGINEERING.NET

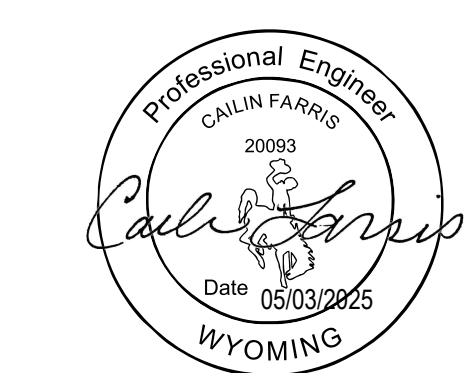


NAME AND DATE FOR CURRENT RELEASE ONLY	
DESIGN: CWF	DATE: 5/5/25
APPROVED: CWF	5/5/25

XL ENGINEERING
IDAHO FALLS, IDAHO

AUTO SERVICE ELEVATED
PARCEL NO: 37182030004500
ELK MEADOWS ADDITION LOT: 3
WASTE AND VENT PLAN - LEVEL 2

PROJECT NUMBER: 240139
DWG- P1.2

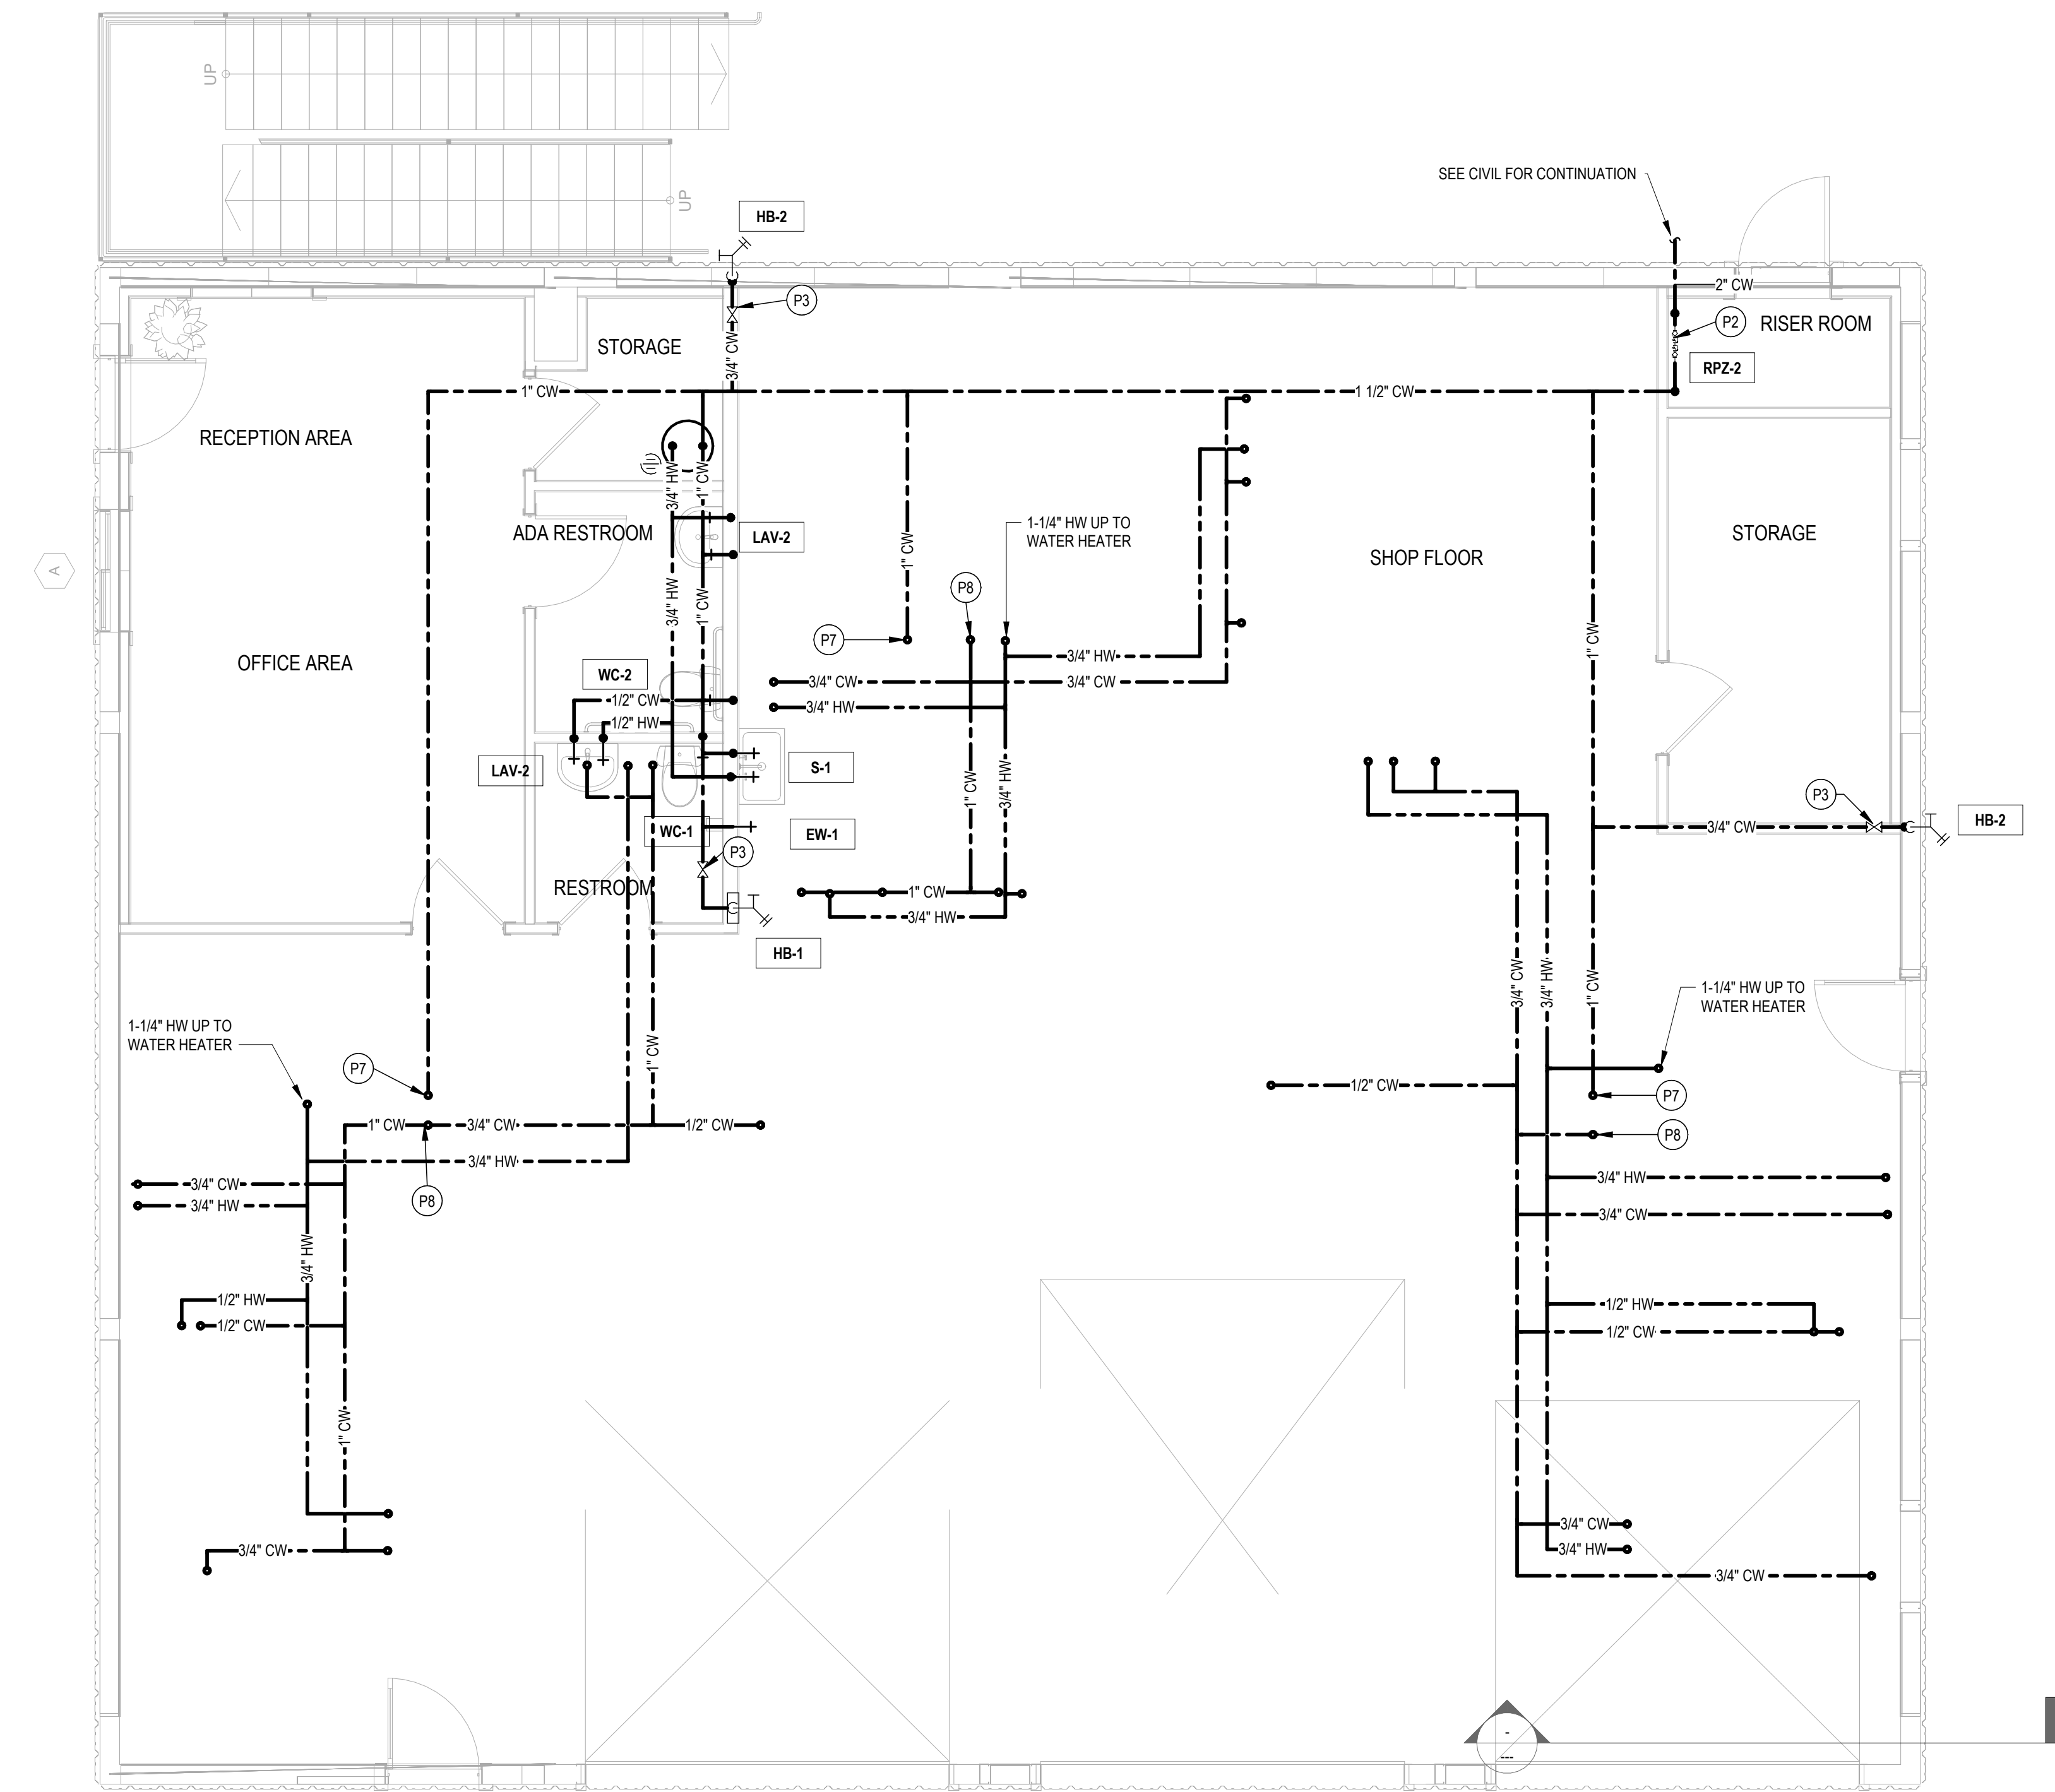

1 WATER AND GAS PLAN - LEVEL 1
1/4" = 1'-0"

KEYNOTES


- P2 INSTALL BACKFLOW PREVENTER ON WALL WITH ACCESS FOR MAINTENANCE AND TESTING. FUNNEL DRAIN TO NEAREST SANITARY SEWER.
- P3 PROVIDE SERVICE ISOLATION VALVE AND LABELED ACCESS FOR HOSE BIBB.
- P7 COLD WATER TO GO UP TO SHUTOFF VALVE IN WALL. PROVIDE ACCESS PANEL.
- P8 1" CW DOWN FROM ABOVE.

REVISION HISTORY

REV	DATE	DESCRIPTION

MECHANICAL ENGINEER
CAILIN FARRIS
(720) 319-1046
CAILIN@FARRISCONSULTANTS.COM

ELECTRICAL ENGINEER
MARK OWENS
(208) 709-3111
MOWENS@XLENGINEERING.NET

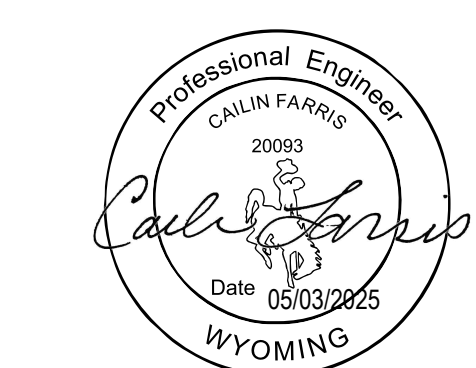

NAME AND DATE FOR CURRENT RELEASE ONLY	
DESIGN: CWF	DATE: 5/5/25
APPROVED: CWF	5/5/25

XL ENGINEERING
IDAHO FALLS, IDAHO

AUTO SERVICE ELEVATED
PARCEL NO: 37182030004500
ELK MEADOWS ADDITION LOT: 3
WATER AND GAS PLAN - LEVEL 1

PROJECT NUMBER: 240139
DWG- P2.1




REVISION HISTORY

[illegible]

MECHANICAL ENGINEER
CAILIN FARRIS
(720) 319-1046
CAILIN@FARRISCONSULTANTS.COM

ELECTRICAL ENGINEER
MARK OWENS
(208) 709-3111
MOWENS@XLENGINEERING.NET

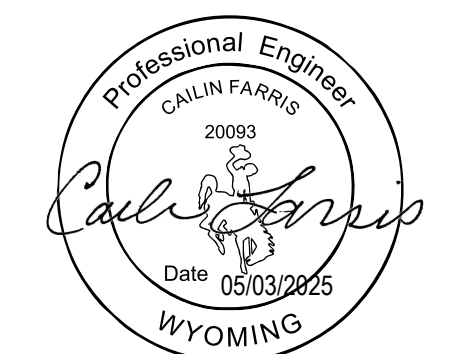

NAME AND DATE FOR CURRENT RELEASE ONLY


DESIGN:	DATE:
CWF	5/5/25
APPROVED:	
CWF	5/5/25

XL ENGINEERING
IDAHO FALLS, IDAHO


AUTO SERVICE ELEVATED
PARCEL NO: 37182030004500
ELK MEADOWS ADDITION LOT: 3
WATER AND GAS PLAN - LEVEL 2

PROJECT NUMBER:	240139
-----------------	--------


DWG- P2.2

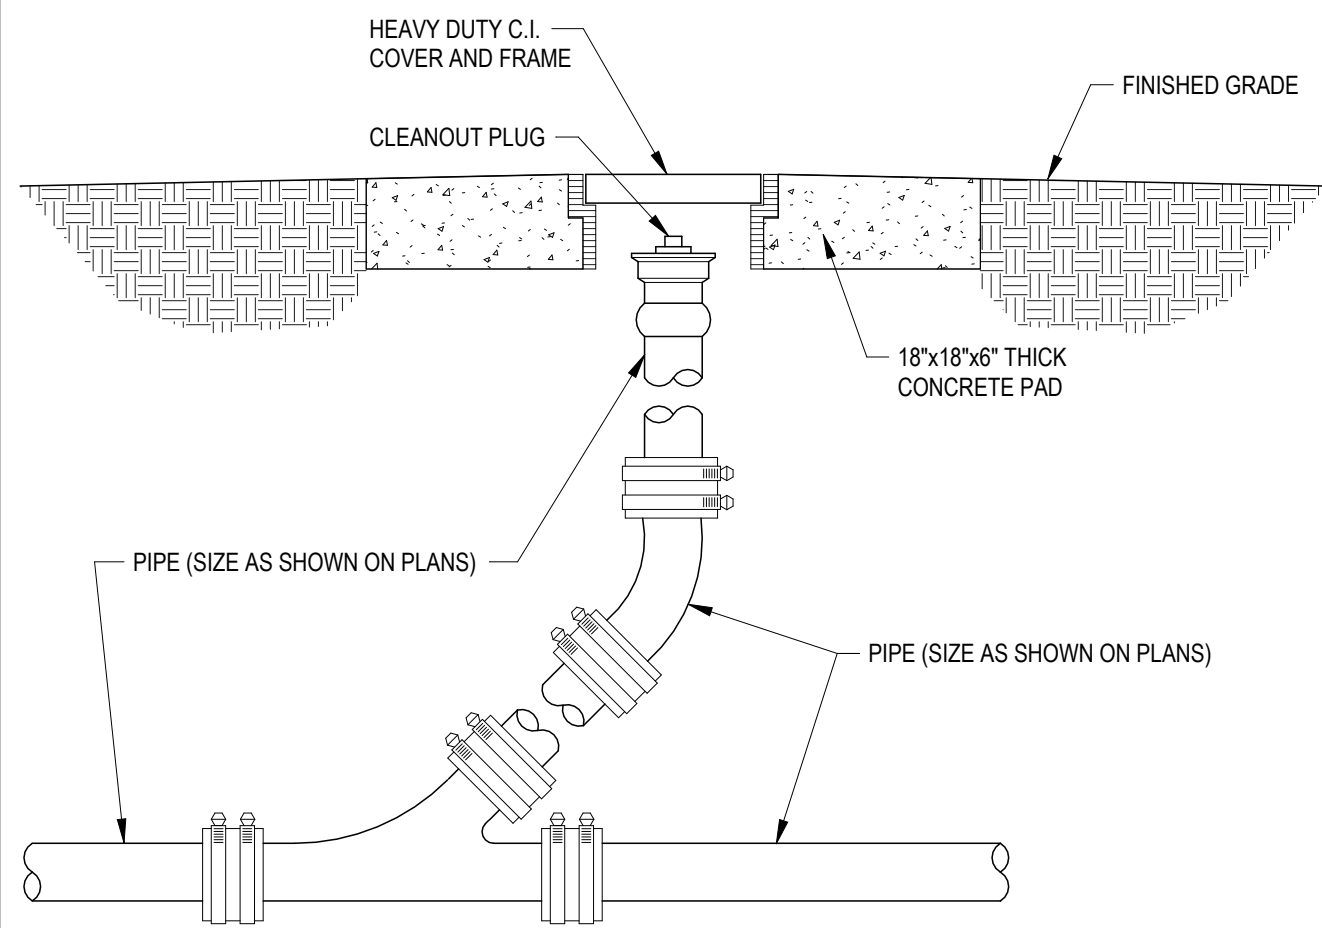


1 CLEANOUT TO GRADE DETAIL
NTS

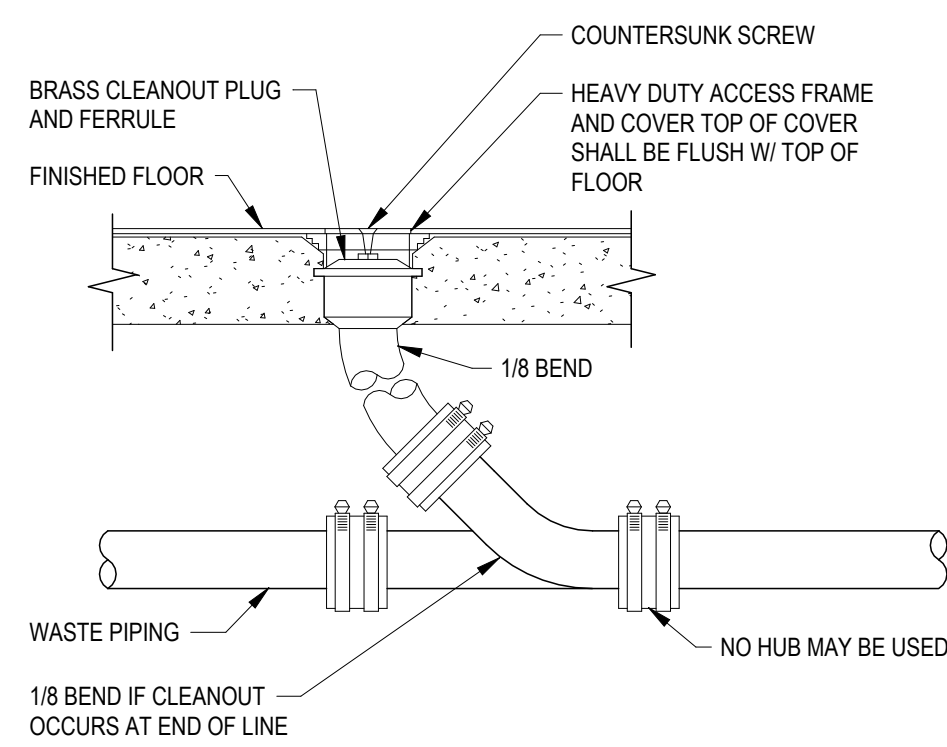


2 FLOOR CLEANOUT DETAIL
NTS

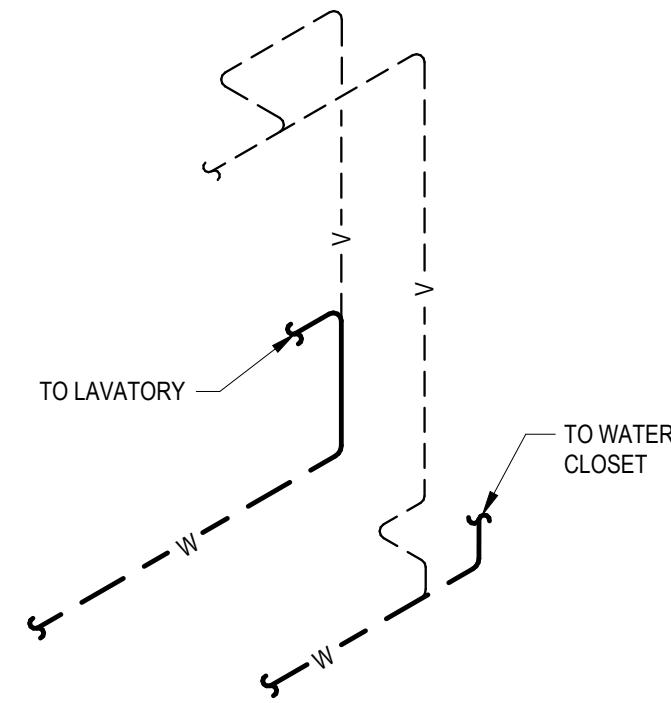


3 VENT PIPE RISER DETAIL
NTS

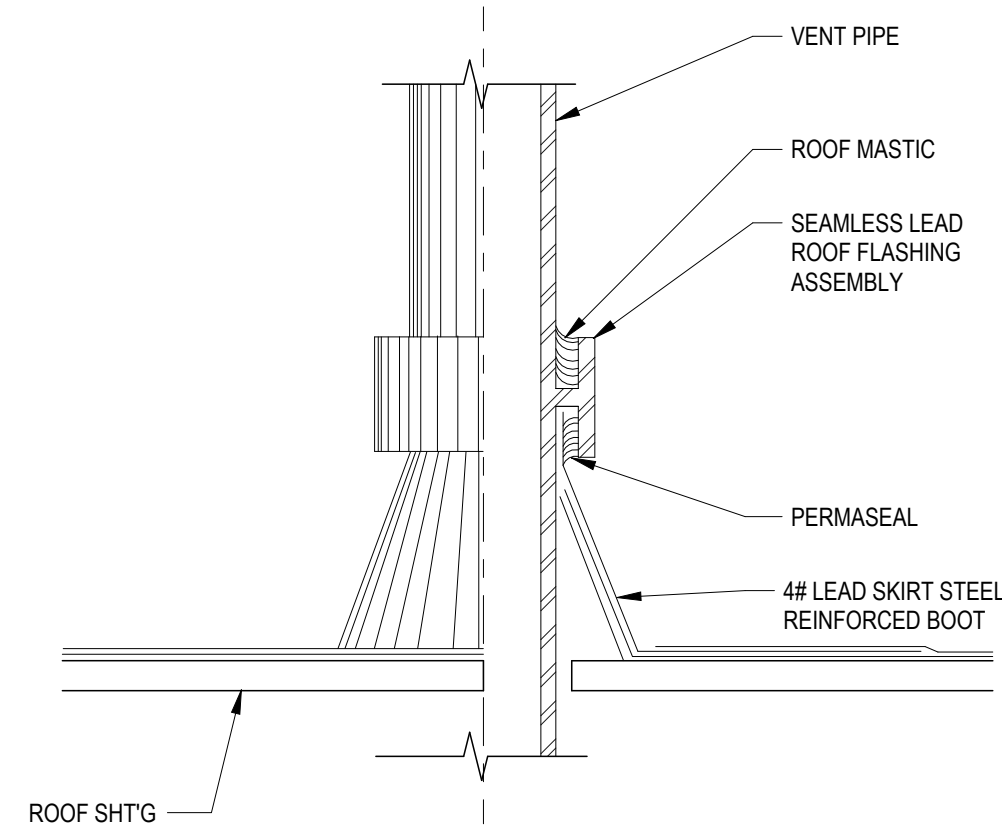

4 VENT THROUGH ROOF DETAIL
NTS

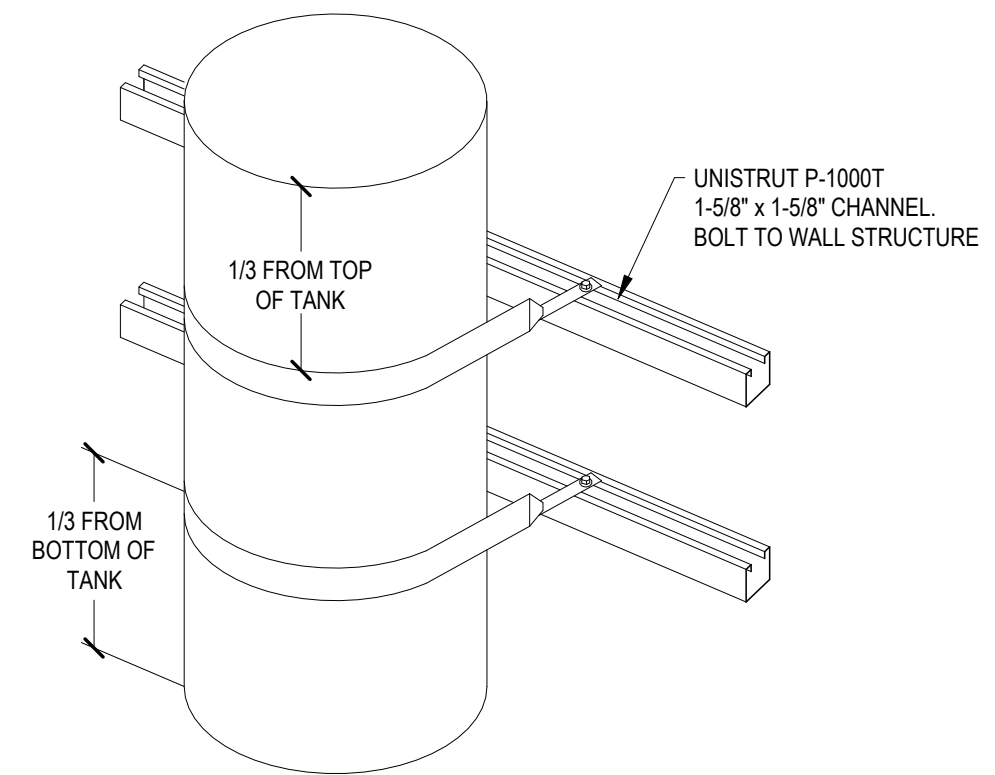

5 WATER HEATER SEISMIC BRACING DETAIL
NTS

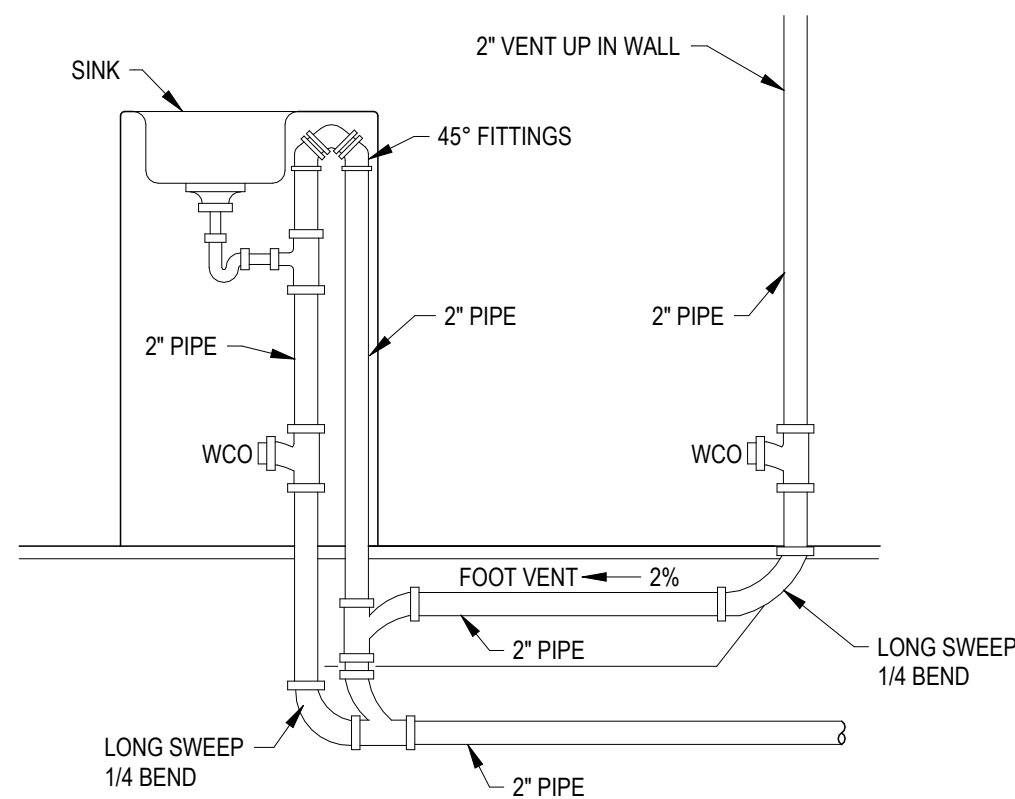

6 ISLAND VENT DETAIL
NTS

REVISION HISTORY

REV	DATE	DESCRIPTION

MECHANICAL ENGINEER
 CAILIN FARRIS
 (720) 319-1046
 CAILIN@FARRISCONSULTANTS.COM

ELECTRICAL ENGINEER
MARK OWENS
(208) 709-3111
MOWENS@XLENGINEERING.NET



7004 S Donaway Ave., Meridian, ID 83642
www.farrisconsultants.com
(720)-319-1046



NAME AND DATE FOR
CURRENT RELEASE ONLY

DESIGN: CWF	DATE: 5/5/25
APPROVED: CWF	5/5/25

XL ENGINEERING
IDAHO FALLS, IDAHO

IDAHO FALLS, IDAHO

AUTO SERVICE ELEVATED

PARCEL NO: 37182030004500
ELK MEADOWS ADDITION LOT: 3

PLUMBING DETAILS AND DIAGRAMS

PROJECT NUMBER: 240139

DWG- P5.0

[illegible]

°C	SIZE OF TRADE SIZE CONDUIT. # = 1/2", 2".	MLO	MAIN LUG ONLY
#P	NUMBER OF POLES. # = 1P, 2P, ETC.	N/A	NOT APPLICABLE
#W	NUMBER OF WIRES, # = 3W, 4W, ETC.	NC	NORMALLY CLOSED
A	AMPERE	NEC	NATIONAL ELECTRICAL CODE
AC	ALTERNATING CURRENT	NEMA	NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION
ADA	AMERICANS WITH DISABILITIES ACT	NESC	NATIONAL ELECTRICAL SAFETY CODE
AFF	ABOVE FINISHED FLOOR	NO	NORMALLY OPEN
AFG	ABOVE FINISHED GRADE	NO.	NUMBER
AHJ	AUTHORITY HAVING JURISDICTION	NRTL	NATIONALLY RECOGNIZED TESTING LABORATORY - AS DEFINED BY OSHA
AIC	AMPERE INTERRUPTING CAPACITY	O.H.	OPPOSITE HAND - MIRRORRED OR ROTATED LAYOUT
AL	ALUMINUM	OC	OVER COUNTER TOP BACKSPLASH - COORDINATE INSTALLATION
ANN	ANNUNCIATOR	OSHA	OCCUPATIONAL SAFETY AND HEALTH ADMINISTRATION
AUX	AUXILIARY	PF	POWER FACTOR
AWG	AMERICAN WIRE GAUGE	PH	PHASE
C	CONDUIT	REV	REVISION
CB	CIRCUIT BREAKER	RTU	ROOF TOP UNIT
CD	CANDELLA	SPDT	SINGLE POLE, DOUBLE THROW
CLG	CEILING	SPST	SINGLE POLE, SINGLE THROW
CT	CURRENT TRANSFORMER	SST	SOFT START/STOP MOTOR STARTER
CU	COPPER	TTB	TELEPHONE TERMINAL BOARD
DC	DIRECT CURRENT	TVSS	TRANSIENT VOLTAGE SURGE SUPPRESSOR
DDPT	DOUBLE POLE, DOUBLE THROW	TYP	TYPICAL
DPST	DOUBLE POLE, SINGLE THROW	UON	UNLESS OTHERWISE NOTED
EMT	ELECTRICAL METALLIC TUBING	UPS	UNINTERRUPTABLE POWER SUPPLY
EP	EXPLOSION PROOF	USB	UNIVERSAL SERIAL BUS
EWH	ELECTRIC WATER HEATER	V	VOLTAGE
F	FUSE	V	VOLT-AMPERE
FACP	FIRE ALARM CONTROL PANEL	VFD	VARIABLE FREQUENCY MOTOR DRIVE
GFCI	GROUND FAULT CIRCUIT INTERRUPTER	WPR	WEATHERPROOF
GFI	GROUND FAULT INTERRUPTER	XFMR	TRANSFORMER
GND	GROUND	XFR	TRANSFER SWITCH
HOA	HAND-OFF-AUTO		
HP	HORSE POWER		
HVAC	HEATING VENTILATION AND AIR CONDITIONING		
I/O	INPUT / OUTPUT		
IG	ISOLATED GROUND		
INC	INCANDESCENT		
J-BOX	JUNCTION BOX		
KCMIL	THOUSAND CIRCULAR MIL		
KO	KNOCK OUT		
KV	KILOVOLT		
KVA	KILOVOLT AMPERE		
KW	KILOWATT		
KWH	KILOWATT HOUR		
LV	LOW VOLTAGE		
MCC	MOTOR CONTROL CENTER		
MDSB	MAIN DISTRIBUTION SWITCHBOARD		
MFR	MANUFACTURER		

E00	ELECTRICAL SYMBOLS & ABBREV.
E01	RISER, SCHED., LOAD CALCS & DETAILS
E02	LIGHTING AND PANEL SCHEDULES
E03	ENERGY COMPLIANCE FORMS
E11	LIGHTING PLAN LEVEL 1
E12	LIGHTING PLAN LEVEL 2
E21	POWER PLAN LEVEL 1
E22	POWER PLAN LEVEL 2
E31	MECHANICAL POWER PLAN LEVEL 1
E32	MECHANICAL POWER PLAN LEVEL 2

A. ALL WORK SHALL BE IN ACCORDANCE WITH THE LATEST EDITION OF THE LOCALLY ADOPTED ELECTRICAL CODE, ALL LOCAL CODES, AND TO THE FULL ACCEPTANCE OF THE AUTHORITY HAVING JURISDICTION. WHENEVER THE REQUIREMENTS OF THE ELECTRICAL SPECIFICATIONS OR DRAWINGS EXCEED THOSE OF THE APPLICABLE CODES OR STANDARDS, THE REQUIREMENTS OF THE SPECIFICATIONS AND DRAWINGS SHALL GOVERN.

B. BIDDERS SHALL VIEW THE SITE AND SHALL INCLUDE ALL COSTS INCURRED BY EXISTING CONDITIONS IN THE BID PROPOSAL. THE CONTRACTOR SHALL FAMILIARIZE THEMSELVES WITH ALL RELEVANT BID DOCUMENTS, BID FORMS AND SPECIFICATIONS. ANY INCREASED COST INCURRED DUE TO FAILURE TO BECOME FAMILIAR WITH THESE DOCUMENTS SHALL BE BORNE BY THE CONTRACTOR. WORK SHALL INCLUDE ALL LABOR, EQUIPMENT, APPLIANCES, MATERIALS, TRANSPORTATION, FACILITIES AND SERVICES NECESSARY FOR AND/OR REASONABLY INCIDENTAL TO THE COMPLETION OF ALL ELECTRICAL WORK IN STRICT COMPLIANCE WITH THE DRAWINGS AND OTHER CONTRACT DOCUMENTS. WORK SHALL INCLUDE, BUT NOT BE NECESSARILY LIMITED TO, THE WORK SPECIFIED AND INDICATED ON DRAWINGS.

C. OBTAIN ALL PERMITS, COORDINATE, FURNISH, INSTALL, CONNECT AND TEST ALL ELECTRICAL EQUIPMENT REQUIRED FOR ALL THE SYSTEMS INSTALLED UNDER THIS CONTRACT TO INSURE COMPLETE AND FULLY OPERATIONAL SYSTEMS.

D. CONTRACTOR SHALL MAINTAIN A COMPLETE SET OF AS-BUILT DRAWINGS. AS-BUILT SET OF DRAWINGS SHALL BE UPDATED DAILY AND SHALL DOCUMENT THE ACTUAL INSTALLED CONDITION OF THE ENTIRE ELECTRICAL INSTALLATION. AS-BUILT SET OF DRAWINGS SHALL BE AVAILABLE AT ALL TIMES ON THE SITE FOR INSPECTION BY CODE OFFICIALS, OWNER, ARCHITECT, AND ENGINEER.

E. PROPOSED MODIFICATIONS OF ENGINEERED ELECTRICAL DRAWINGS SHALL BE APPROVED BY ENGINEER OF RECORD PRIOR TO PROCEEDING WITH WORK. PROPOSED CHANGES SHALL COMPLY WITH ALL APPLICABLE CODES/JURISDICTION REQUIREMENTS. COST OF ANY ENGINEERING/REVIEW REQUIRED BY PROPOSED CHANGES SHALL BE BORNE BY ENTITY PROPOSING CHANGE.

F. DESIGN IS BASED ON BEST AVAILABLE INFORMATION. CONTRACTOR SHALL FIELD VERIFY EXISTING CONDITIONS TO DETERMINE STATUS OF ACTUAL CONDITIONS AS THEY RELATE TO THE SCOPE OF WORK AS SHOWN ON THESE PLANS.

G. COORDINATE ALL ELECTRICAL WORK WITH ALL OTHER TRADES.

H. COORDINATE EXACT LOCATION AND MOUNTING HEIGHTS OF ALL ELECTRICAL EQUIPMENT AND DEVICES WITH THE ARCHITECTURAL ELEVATIONS AND DETAILS PRIOR TO ROUGH-IN.

I. CONTRACTOR SHALL COORDINATE WITH WALL TYPES AND FURNISH AND INSTALL EXTENSION RINGS AS REQUIRED. (I.E. WALLS WITH TWO LAYERS OF GYP BOARD).

J. ALL MATERIALS AND EQUIPMENT FURNISHED TO THE PROJECT SHALL BE NEW AND SHALL BEAR THE LISTING LABEL OF A NATIONALLY RECOGNIZED TESTING LABORATORY (NRTL), WHERE APPLICABLE.

K. ALL ELECTRICAL BOXES, FITTINGS AND CABINETS SHALL BE OF STEEL CONSTRUCTION, GALVANIZED OR POWDER COATED, NEMA 1 TYPE, UON.

L. ALL DEVICES (SWITCHES/RECEPTACLES/TELECOMMUNICATIONS) SHALL BE WHITE AND COVERPLATES SHALL BE WHITE, UON.

M. ALL CIRCUIT BREAKERS SUPPLYING MOTOR LOADS SHALL BE HACR RATED.

N. ALL ELECTRICAL DEVICES AND TERMINALS SHALL BE RATED 75°C MINIMUM.

O. ALL CONDUCTORS SHALL BE STRANDED COPPER, 600 VOLT RATED. INSULATION TYPE SHALL BE THHN/THWN, FULLY COLOR CODED WITH GAUGE, TYPE AND MANUFACTURER MARKED EVERY 24" ALONG. CONDUCTOR COLOR CODE SHALL BE AS FOLLOWS:

208Y/120 VOLT SYSTEM	480Y/277 VOLT SYSTEM
PHASE A - BLACK	PHASE A - BROWN
PHASE B - RED	PHASE B - ORANGE
PHASE C - BLUE	PHASE C - YELLOW
NEUTRAL - WHITE	NEUTRAL - GRAY
GROUND - GREEN	GROUND - GREEN

P. MINIMUM SIZE WIRE FOR POWER AND LIGHTING CIRCUITS SHALL BE #12 AWG, UON. CONDUCTOR SIZE SHALL BE CONTINUOUS THROUGHOUT THE ENTIRE LENGTH OF THE CIRCUIT.

Q. ALL CIRCUITS SHALL HAVE AN ALLOWED NEUTRAL CONDUCTOR. NO EDISON STYLE SHARED NEUTRAL CONDUCTORS ARE ALLOWED.

R. ALL CONDUITS SHALL CONTAIN A GROUND CONDUCTOR SIZED PER NEC.

S. ALL POWER AND LIGHTING CONDUCTORS SHALL BE ROUTED IN 3/4" CONDUIT MINIMUM. NO MC TYPE CABLE IS ALLOWED WITH THE EXCEPTION OF CEILING WHIPS 6" OR LESS.

T. CONDUIT AND WIRE FOR FEEDER OR BRANCH CIRCUITS SHALL NOT BE RUN ON OR ABOVE THE ROOF. ELECTRICAL SERVICE TO THE ROOF SHALL BE REQUIRED TO BE RUN IN A STRAIGHT LINE FROM THE ROOF PENETRATION TO THE ELECTRICAL CONNECTION FOR THE UNIT SERVED.

U. ROUTE ALL CONDUIT HOME RUNS TO PANELS OVERHEAD AND ABOVE ACCESSIBLE CEILINGS WHERE AVAILABLE.

V. INSTALL CONDUIT A MINIMUM OF 4" BELOW BOTTOM OF CONCRETE SLAB WHEN RUNNING UNDER FLOOR. ALL ELBOWS SHALL BE RIGID METAL CONDUIT OR INTERMEDIATE METAL CONDUIT.

W. ALL EQUIPMENT, SWITCHING DEVICES AND PANELS SHALL BE MOUNTED SO AS TO BE ACCESSIBLE AND SHALL BE MOUNTED PLUMB AND SQUARE WITH WALLS.

X. BOXES MOUNTED IN A COMMON WALL SHALL BE OFFSET A MINIMUM OF 12" OR MOUNTED IN ADJACENT STUD SPACES. BOXES MOUNTED BACK-TO-BACK ARE NOT ALLOWED.

Y. ALL ELECTRICAL EQUIPMENT, RACEWAY, FIXTURE AND DEVICE SUPPORTS SHALL BE CAPABLE OF SUSTAINING NOT LESS THAN FOUR (4) TIMES THE ULTIMATE WEIGHT OF THE OBJECT OR OBJECTS. FASTEN SUPPORTS TO THE BUILDING STRUCTURE. CONDUIT IS NOT PERMITTED TO BE SUPPORTED FROM THE CEILING FIXTURE WIRES.

Z. FURNISH AND INSTALL SAFETY WIRES AT ALL LIGHT FIXTURES INSTALLED IN A SUSPENDED CEILING.

AA. MOUNTING METHODS INSTALLED AND REFERRED TO ARE MINIMUM CODE REQUIREMENTS. COMPLY WITH LOCAL CODES FOR ADDITIONAL SEISMIC RESTRAINTS.

BB. DEVICES AND RACEWAYS PENETRATING FIRE RATED WALLS AND FLOORS SHALL BE SEALED WITH FIRE RESISTIVE MATERIAL, COMPATIBLE WITH CONSTRUCTION PENETRATED, TO MAINTAIN RATING OF THE WALL. SEALANT SYSTEM SHALL BE A NRTL APPROVED SYSTEM AND INSTALLED PER MANUFACTURER'S INSTRUCTIONS.

CC. FURNISH AND INSTALL A PULL CORD IN ALL EMPTY CONDUITS.

DD. MAKE ALL CONNECTIONS TO EQUIPMENT PER MANUFACTURER'S REQUIREMENTS.

EE. ALL CONDUCTORS IN ELECTRICAL PANELS, CABINETS AND EQUIPMENT SHALL BE NEATLY TRAINED AND LACED.

FF. CLEARLY LABEL ALL ACCESSIBLE CONDUIT STUBS WITH SYSTEM NAME AND LOCATION (ROOM NUMBER) WHERE THE OTHER END OF THE CONDUIT TERMINATES. USE INDELIBLE INK. THE LABELS SHALL BE LOCATED ON THE CONDUIT IN A POSITION THAT CAN BE EASILY READ BY THE OWNER IN THE FUTURE.

GG. ALL JUNCTION BOX COVERS WITH POWER WIRING SHALL HAVE THE PANEL AND CIRCUIT LABELED ON THE OUTSIDE SURFACE. ALL LABELS FOR EXPOSED JUNCTION BOXES IN "FINISHED AREAS" SHALL BE LABELED UTILIZING CLEAR SELF ADHESIVE LABELS PRODUCED BY A MECHANICAL LABELING MACHINE. LABELS FOR JUNCTION BOX COVERS IN CONCEALED LOCATIONS SHALL CONSIST OF THE INFORMATION BEING NEATLY HANDWRITTEN ON THE OUTSIDE SURFACE OF THE COVER WITH A PERMANENT STYLE MARKER. JUNCTION BOX COVERS FOR FIRE ALARM AND EMERGENCY SYSTEMS SHALL BE PAINTED RED AND LABELED "FA" FOR FIRE ALARM AND "E" FOR EMERGENCY.

HH. THE CONTRACTOR SHALL PROVIDE TYPED CIRCUIT PANEL DIRECTORY FOR ALL PANELS THAT CONTAIN CIRCUITS IMPACTED BY THIS PROJECT. OLD DIRECTORIES SHALL BE RETAINED BEHIND THE NEW.

II. THE CONTRACTOR SHALL PROVIDE SUBMITTALS TO THE GENERAL CONTRACTOR FOR APPROVAL BY ARCHITECT AND ENGINEER PRIOR TO ORDERING EQUIPMENT. SUBMITTALS SHALL CONSIST OF CATALOG CUT DESIGNATING PART NUMBERS TO BE SUPPLIED FOR EACH TYPE OF THE FOLLOWING: ELECTRICAL GEAR, LIGHT FIXTURES, BALLASTS, DRIVERS, LAMPS, DEVICES AND COVERPLATES.


[illegible]

**XL
ENGINEERING**

5257 Wild Dunes Ln., Idaho Falls, ID
208-339-4907 • www.xlengineering.net


XL

XL ENGINEERING
5257 WILD DUNES LN
IDAHO FALLS, ID 83404

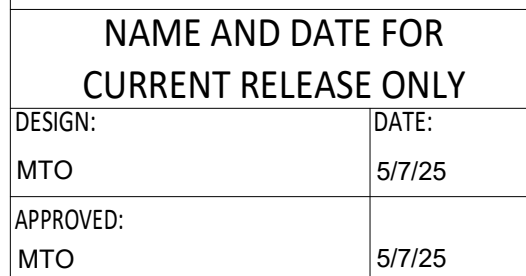

PROJECT NUMBER: 25014
DWG- E00

A

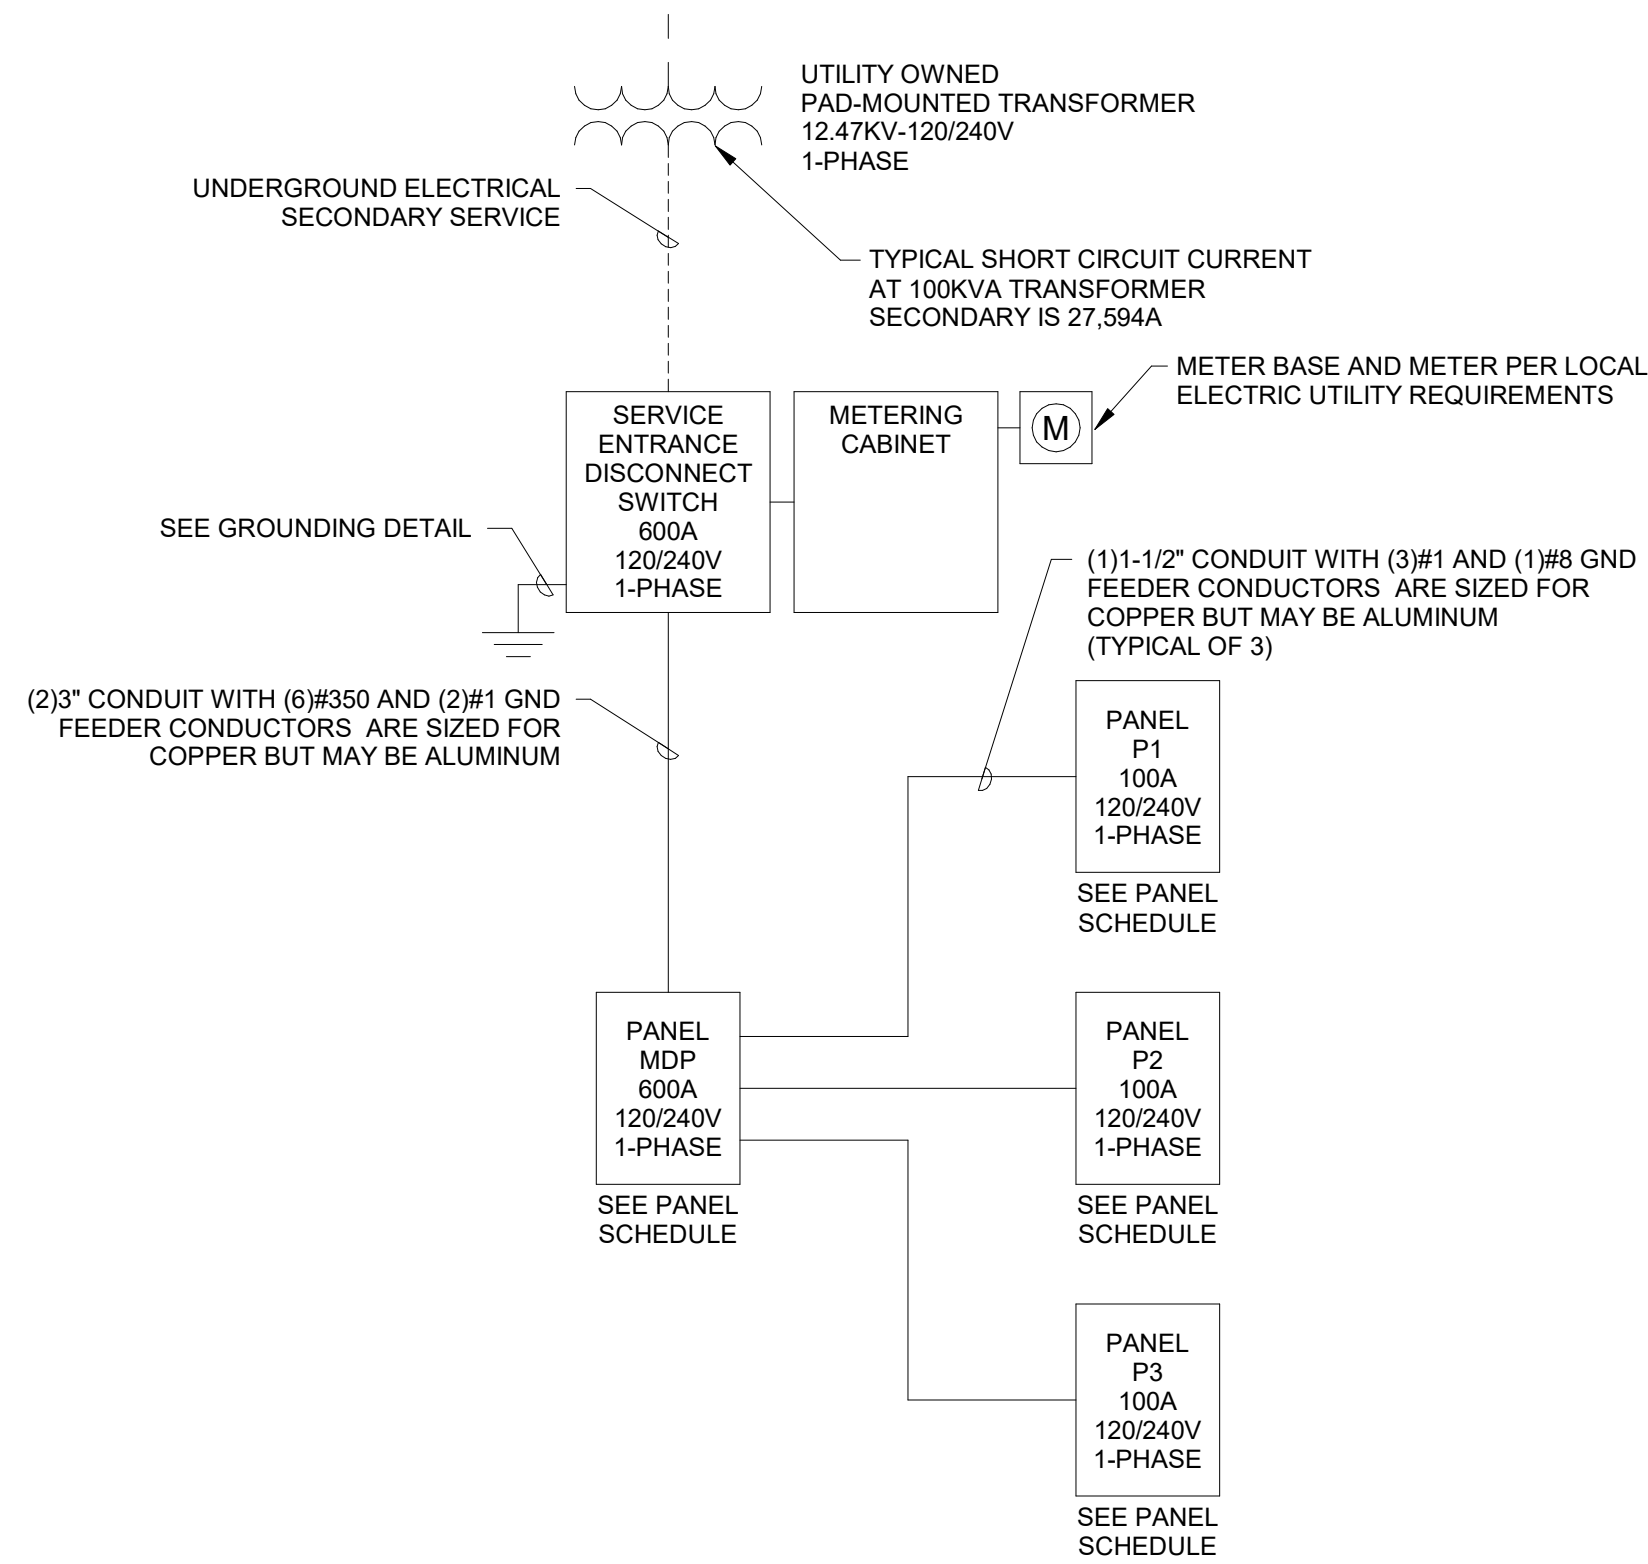

1 RISER DIAGRAM

NTS

Branch Panel: MDP


Location: SHOP FLOOR 6
Supply From:
Mounting: SURFACE
Enclosure: Type 1

Volts: 120/240
Phases: 1
Wires: 3

A.I.C. Rating:
Mains Type: MLO
Mains Rating: 600 A
MCB Rating: MLO


Notes:

CKT	Circuit Description	BRKR Type	BRKR AMPS	Poles	A		B		Poles	BRKR AMPS	BRKR Type	Circuit Description	CKT
1	P1		100 A	2	122.4	113.5			2	100 A		P2	2
3							119.8	112.1					4
5	P3		100 A	2	122.6	23.8			2	30 A		WELDING RECEPTACLE	6
7							119.8	23.8					8
9	COMPRESSOR RECEPTACLE		30 A	2	23.8	23.8			2	30 A		LIFT #1	10
11							23.8	23.8					12
13	CEILING FAN (CF-1)		15 A	2	8.0	4.0			2	15 A		EXHAUST FAN (EF-4)	14
15							8.0	4.0					16
17	WATER HEATER (WH-1)		20 A	1	13.8	16.7			2	25 A		ELECTRIC HEATER (EH-1)	18
19	ELECTRIC HEATER (EH-2)		20 A	1			8.3	16.7					20
21	ELECTRIC HEATER (EH-3)		20 A	1	8.3	4.6			1	20 A		UNIT HEATER	22
23							23.8	23.8					24
25	LIFT #2		30 A	2		23.8	23.8		2	30 A		LIFT #3	26
27	OVERHEAD DOOR #1		20 A	1			11.2	11.2	1	20 A		OVERHEAD DOOR #2	28
29	OVERHEAD DOOR #3		20 A	1	11.2	1.5			1	20 A		REC BLOCK HEATER #1	30
31	REC BLOCK HEATER #2		20 A	1			1.5	12.3	1	20 A		REC OFFICE	32
33	REC RESTROOMS		20 A	1	3.2	7.5			1	20 A		REC S SHOP	34
35	REC STORAGE		20 A	1			7.6	7.5	1	20 A		REC W SHOP	36
37	REC N SHOP		20 A	1	9.0	11.3			1	20 A		REC E SHOP	38
39	REC BAY #1		20 A	1			1.5	1.5	1	20 A		REC BAY #2	40
41	REC BAY #3		20 A	1	1.5	2.6			1	20 A		LIGHTING, OFFICE/STORAGE	42
43	SPARE	--	20 A	1			0.0	14.6	1	20 A		LIGHTING, SHOP	44
45	LIGHTING, EXTERIOR		20 A	1	2.3	0.0			1	20 A	--	SPARE	46
47	SPARE	--	20 A	1			0.0	0.0	1	20 A	--	SPARE	48
49	SPARE	--	20 A	1	0.0	0.0			1	20 A	--	SPARE	50
51	SPARE	--	20 A	1			0.0	0.0	1	20 A	--	SPARE	52
53	SPARE	--	20 A	1	0.0	0.0			1	20 A	--	SPARE	54
			Total Amps:		583 A		576 A						
Load Classification			Connected Load		Demand Factor		Estimated Demand		Panel Totals				
Motor			4032 VA		108.33%		4368 VA						
Receptacle			54450 VA		59.18%		32225 VA		Total Conn. Load:		139073 VA		
Lighting			3301 VA		125.00%		4126 VA		Total Est. Demand:		118009 VA		
Power			77290 VA		100.00%		77290 VA		Total Conn.:		579 A		
									Total Est. Demand:		492 A		

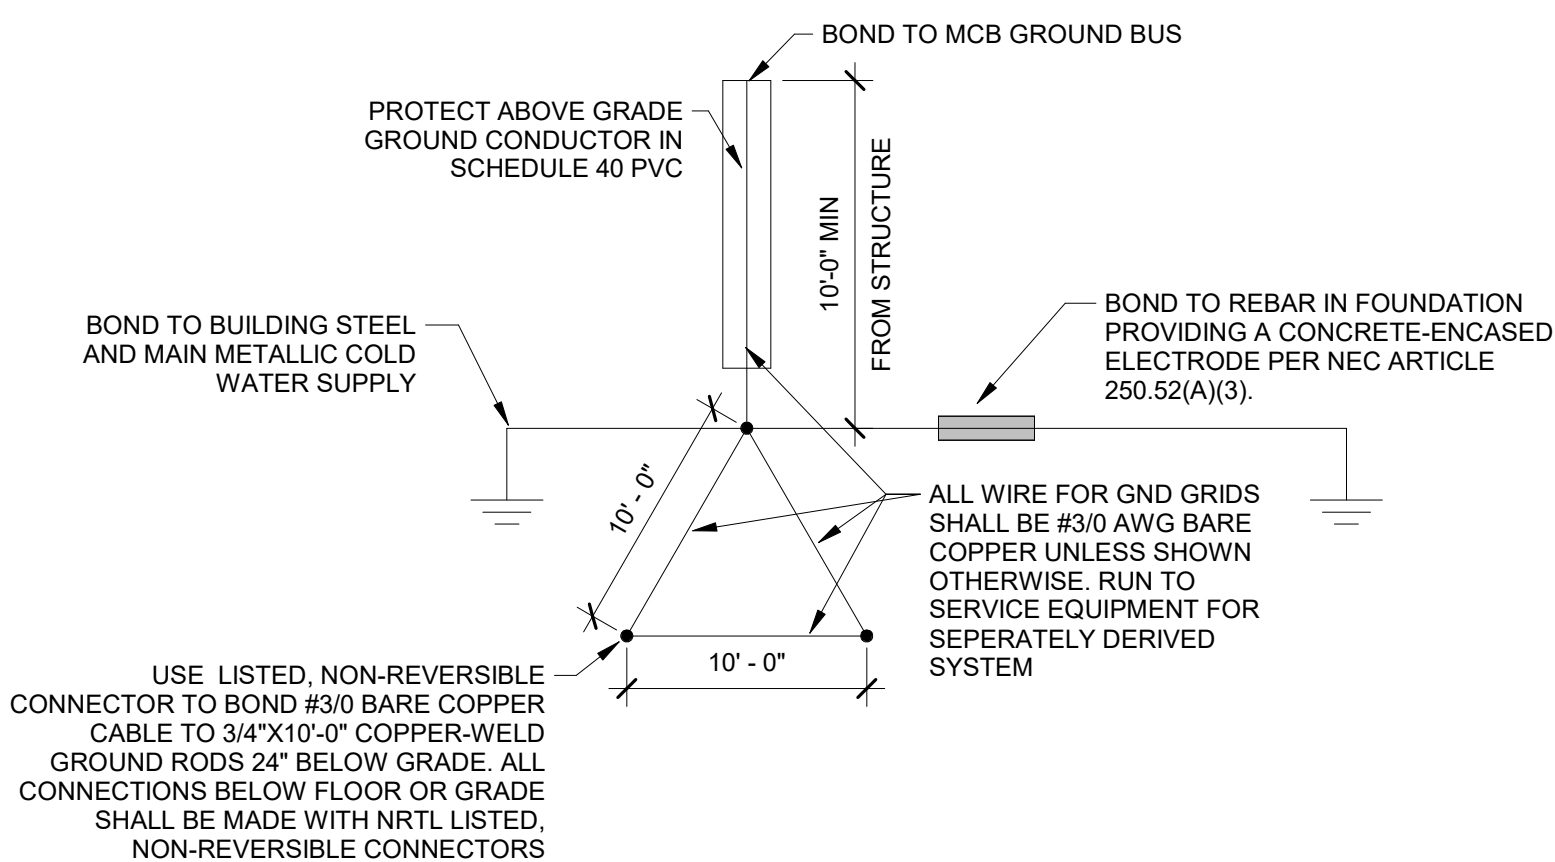

2 GROUNDING DETAIL

NTS

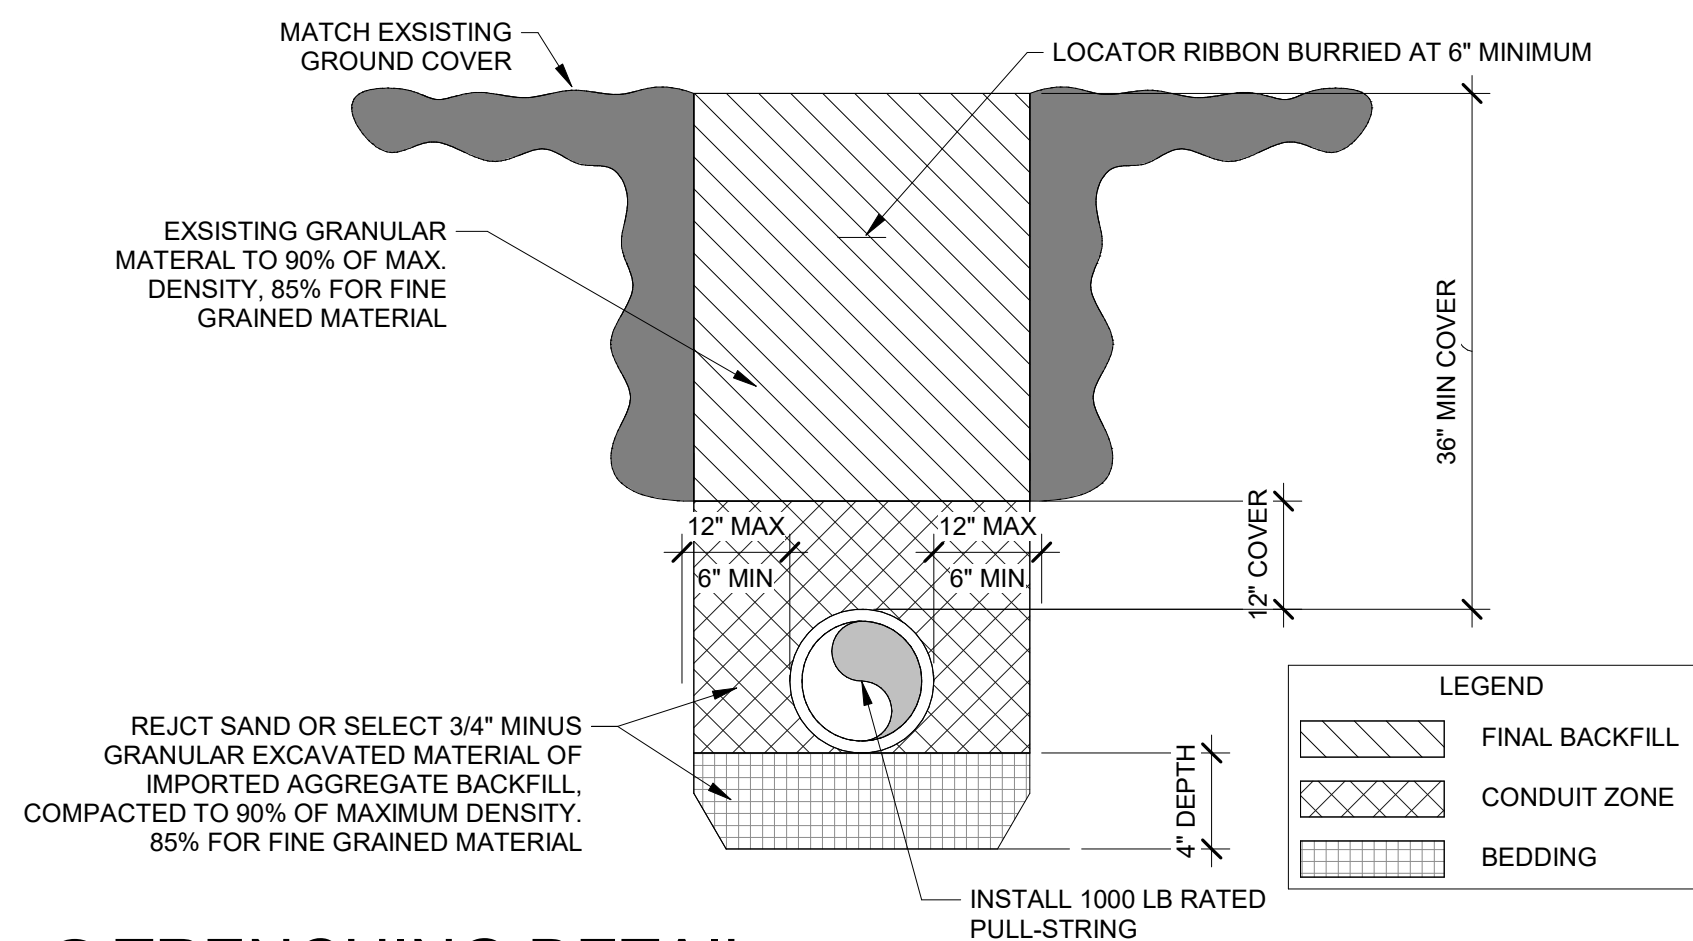

3 TRENCHING DETAIL

NTS

WY AUTO SHOP DWELLING UNIT (REPRESENTATIVE OF 3) PARCEL NO: 37182030004500, ELK MEADOWS ADDITION LOT: 3 ALPINE, WY 83128		
FEEDER AND SERVICE LOAD CALCULATIONS FOR DWELLING UNIT PER NEC ARTICLE 220.82		
120/240 VOLT, 1-PHASE, 3-WIRE, > 100 AMPERES		
AREA (SQUARE FOOTAGE)		1056 FT ²
AREA X 3 VA/SQ FT FOR GENERAL LIGHTING AND RECEPTACLES		3168 VA
(2) SMALL APPLIANCE CIRCUITS AT (1,500 VA EACH)		3000 VA
ITEM	VA	QTY
ELECTRIC RANGE / OVEN AT:	8000	1
RANGE HOOD AT:	250	1
MICROWAVE AT:	1250	1
ELECTRIC DRYER AT:	3400	1
CLOTHES WASHER AT:	180	1
DISHWASHER AT:	1500	0
REFRIGERATOR/FREEZER AT:	800	2
DISPOSER AT:	450	1
WATER HEATER AT:	4500	2
100% OF FIRST 10,000 VA		
PLUS 40% OF BALANCE		
OTHER PERMANENTLY CONNECTED MOTORS		
ERV	39	1
EF	11	1
HEATING AND AIR CONDITIONING LOAD		
100% OF AIR CONDITIONING & COOLING		
N/A	0	0
100% OF HEAT PUMPS		
HP & FCs	2232	1
65% OF ELECTRIC SPACE HEATING IF < 4 UNITS		
EH	1000	1
40% OF ELECTRIC SPACE HEATING IF ≥ 4 UNITS		
N/A	0	0
21051 VA		
CALCULATED FEEDER AND SERVICE LOAD = VA/240V		88 A
MINIMUM SERVICE SIZE		100 A

REVISION HISTORY


REV	DATE	DESCRIPTION
0	5/7/25	RELEASED FOR PERMIT

MECHANICAL ENGINEER
CAILIN FARRIS
(720) 319-1046
CAILIN@FARRISCONSULTANTS.COM

ELECTRICAL ENGINEER
MARK OWENS
(208) 709-3111
MOWENS@XLENGINEERING.NET



XL ENGINEERING
5257 WILD DUNES LN
IDAHO FALLS, ID 83404

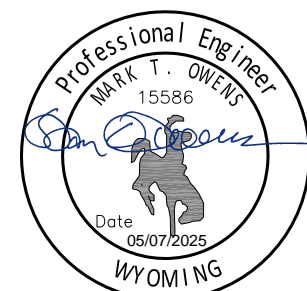

NAME AND DATE FOR CURRENT RELEASE ONLY

DESIGN:	DATE:
MTO	5/7/25
APPROVED:	
MTO	5/7/25

XL ENGINEERING
IDAHO FALLS, IDAHO

AUTO SERVICE ELEVATED
PARCEL NO: 37182030004500
ELK MEADOWS ADDITION LOT: 3
RISER, SCHED., LOAD CALCS & DETAILS



PROJECT NUMBER: 25014
DWG: E01



COMcheck Software Version COMcheckWeb
Interior Lighting Compliance Certificate

Project Information

Energy Code: 2021 IECC
Project Title: WY Auto Shop
Project Type: New Construction

Construction Site: Parcel No.: 37182030004500, Elk Meadows Addition Lot: 3 Alpine, Wyoming 83128
Owner/Agent:
Designer/Contractor:

Additional Efficiency Package(s)
Credits: 10.0 Required 0.0 Proposed

Allowed Interior Lighting Power

A Area Category	B Floor Area (ft2)	C Allowed Watts / ft2	D Allowed Watts
1-Shop (Automotive Facility)	3000	0.75	2250
		Total Allowed Watts =	2250

Proposed Interior Lighting Power

A Fixture ID : Description / Lamp / Wattage Per Lamp / Ballast	B Lamps/ Fixture	C # of Fixture	D Fixture Watt.	E (C X D)
1-Shop (Automotive Facility) LED: E: EXIT/EGRESS: LED Linear 8W: LED: HB/HBE: HIGH BAY: LED Panel 80W: LED: S4/S4E: 4' STRIP: LED Linear 20W: LED: V2: 2' VANITY: LED Linear 15W: LED: D: 6' DOWNLIGHT: LED Panel 19W:	1 2 2 1 1	3 12 8 2 4	2 134 30 16 15	6 1608 240 32 60
			Total Proposed Watts =	1946

Interior Lighting PASSES: Design 14% better than code

Interior Lighting Compliance Statement

Compliance Statement: The proposed interior lighting design represented in this document is consistent with the building plans, specifications, and other calculations submitted with this permit application. The proposed interior lighting systems have been designed to meet the 2021 IECC requirements in COMcheck Version COMcheckWeb and to comply with any applicable mandatory requirements listed in the Inspection Checklist.



COMcheck Software Version COMcheckWeb
Exterior Lighting Compliance Certificate

Project Information

Energy Code: 2021 IECC
Project Title: WY Auto Shop
Project Type: New Construction
Exterior Lighting Zone: 2 (Light industrial area with limited nighttime use (LZ2))

Construction Site: Parcel No.: 37182030004500, Elk Meadows Addition Lot: 3 Alpine, Wyoming 83128
Owner/Agent:
Designer/Contractor:

Allowed Exterior Lighting Power

A Area/Surface Category	B Quantity	C Allowed Watts /	D Tradable Wattage	E Allowed Watts (B X C)
OH & Man Doors (Pedestrian and vehicular entrances and exits)	48 ft of	14	Yes	672
		Total Tradable Watts (a) =		672
		Total Allowed Watts =		672
		Total Allowed Supplemental Watts (b) =		400

(a) Wattage tradeoffs are only allowed between tradable areas/surfaces.

(b) A supplemental allowance equal to 400 watts may be applied toward compliance of both non-tradable and tradable areas/surfaces.

Proposed Exterior Lighting Power

A Fixture ID : Description / Lamp / Wattage Per Lamp / Ballast	B Lamps/ Fixture	C # of Fixture	D Fixture Watt.	E (C X D)
OH & Man Doors (Pedestrian and vehicular entrances and exits, 48 ft of door width): Tradable Wattage LED: W1: WALL PACK - MAN DOOR: LED Linear 11W: LED: W2: WALL PACK - OVERHEAD DOOR: LED Panel 80W:	1 1	7 3	10 60	70 180
			Total Tradable Proposed Watts =	250

Exterior Lighting PASSES: Design 77% better than code

Exterior Lighting Compliance Statement

Compliance Statement: The proposed exterior lighting design represented in this document is consistent with the building plans, specifications, and other calculations submitted with this permit application. The proposed exterior lighting systems have been designed to meet the 2021 IECC requirements in COMcheck Version COMcheckWeb and to comply with any applicable mandatory requirements listed in the Inspection Checklist.



COMcheck Software Version COMcheckWeb
Inspection Checklist

Energy Code: 2021 IECC

Requirements: 0.0% were addressed directly in the COMcheck software

Text in the "Comments/Assumptions" column is provided by the user in the COMcheck Requirements screen. For each requirement, the user certifies that a code requirement will be met and how that is documented, or that an exception is being claimed. Where compliance is itemized in a separate table, a reference to that table is provided.

Section # & Req.ID	Plan Review	Complies?	Comments/Assumptions
C103.2 [PR4] ¹	Plans, specifications, and/or calculations provide all information with which compliance can be determined for the interior lighting and electrical systems and equipment and document where exceptions to the standard are claimed. Information provided should include interior lighting power calculations, wattage of bulbs and ballasts, transformers and control devices.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	
C103.2 [PR8] ¹	Plans, specifications, and/or calculations provide all information with which compliance can be determined for the exterior lighting and electrical systems and equipment and document where exceptions to the standard are claimed. Information provided should include exterior lighting power calculations, wattage of bulbs and ballasts, transformers and control devices.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	
C406 [PR9] ¹	Plans, specifications, and/or calculations provide all information with which compliance can be determined for the additional energy efficiency package options.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	
Section # & Req.ID	Rough-In Electrical Inspection	Complies?	Comments/Assumptions
C405.2.3.1 [EL22] ¹	Spaces required to have light-reduction controls have a manual control that allows the occupant to reduce the connected lighting load in a reasonably uniform illumination pattern >= 50 percent.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	
C405.2.1.1 [EL18] ¹	Occupancy sensors installed in classrooms/lecture/training rooms, conference/meeting/multipurpose rooms, copy/print rooms, lounges/breakrooms, enclosed offices, open plan office areas, restrooms, storage rooms, locker rooms, corridors, warehouse storage areas, and other spaces <= 300 sq ft that are enclosed by floor-to-ceiling height partitions. Reference section language C405.2.1.2 for control function in warehouses and section C405.2.1.3 for open plan office spaces.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	
C405.2.1.2 [EL19] ¹	Occupancy sensors control function in warehouses: In warehouses, the lighting in aiseways and open areas is controlled with occupant sensors that automatically reduce lighting power by 50% or more within 20 minutes of when the areas are unoccupied. The occupant sensors control lighting in each aisleway independently and do not control lighting beyond the aisleway being controlled by the sensor. Lights not turned off by occupant sensors is done so by time-switch.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	
C405.2.1.3 [EL20] ¹	Occupant sensor control function in open plan office areas: Occupant sensor controls in open office spaces >= 300 sq ft. have controls 1) configured so that general lighting can be controlled separately in control zones with floor areas <= 600 sq ft. within the space, 2) general lighting in each zone permitted to turn on upon occupancy in control zone, 3) automatically turn off general lighting in all control zones within 20 minutes after all occupants have left the space, 4) are configured so that general lighting power in each control zone is reduced by >= 80% of the full zone general lighting power within 20 minutes of all occupants leaving that control zone.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	
C405.2.2.1 [EL21] ¹	Each area not served by occupancy sensors (per C405.2.1.1) have time-switch controls and functions detailed in sections C405.2.2.1.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	

Section # & Req.ID	Rough-In Electrical Inspection	Complies?	Comments/Assumptions
C405.2.4.1 [EL23] ²	Daylight zones provided with individual controls that control the lights independent of general area lighting. See code section C405.2.3 Daylight-responsive controls for applicable spaces. C405.2.3.1 Daylight-responsive control function and section C405.2.3.2 Sidelit zone.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	
C405.2.5 [EL27] ¹	Additional interior lighting power allowed for special functions per the approved lighting plans and is automatically controlled and separated from general lighting.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	
C405.2.7 [EL28] ¹	Automatic lighting controls for exterior lighting installed. Controls will be daylight controlled, set based on business operation time-of-day, or reduce connected lighting > 30%.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	
C405.7 [EL26] ¹	Low-voltage dry-type distribution electric transformers meet the minimum efficiency requirements of Table C405.6.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	
C405.8 [EL27] ¹	Electric motors meet the minimum efficiency requirements of Tables C405.7(1) through C405.7(4). Efficiency verified through certification under an approved certification program or the equipment efficiency ratings shall be provided by motor manufacturer (where certification programs do not exist).	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	
C405.9.1, C405.9.2 [EL28] ¹	Escalators and moving walks comply with ASME A17.1/CSA B44 and have automatic controls configured to reduce speed to the minimum permitted speed in accordance with ASME A17.1/CSA B44 or applicable local code when not conveying passengers.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	
C405.10 [EL29] ¹	Total voltage drop across the combination of feeders and branch circuits <= 5%.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	
C405.1.1 [EL30] ²	At least 90% of dwelling unit permanently installed lighting shall have lamp efficacy >= 65 lm/W or luminaires with efficacy >= 45 lm/W or comply with C405.2.4 or C405.3.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	
C405.11, C405.11.1 [EL31] ²	50% of 15/20 amp receptacles installed in enclosed offices, conference rooms, copy rooms, break rooms, classrooms and workstations and > 25% of branch circuit feeders for modular furniture will have automatic receptacle control in accordance with C405.11.1.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	
Section # & Req.ID	Final Inspection	Complies?	Comments/Assumptions
C303.3, C408.2.5.2 [FI17] ³	Furnished O&M instructions for systems and equipment to the building owner or designated representative.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	
C405.5.1 [FI19] ¹	Exterior lighting power is consistent with what is shown on the approved lighting plans, demonstrating proposed watts are less than or equal to allowed watts.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	See the Exterior Lighting fixture schedule for values.
C408.1.1 [FI57] ¹	Building operations and maintenance documents will be provided to the owner. Documents will cover manufacturers' information, specifications, programming procedures and means of illustrating to owner how building, equipment and systems are intended to be installed, maintained, and operated.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	
C408.2.5 [FI16] ³	Furnished as-built drawings for electric power systems within 90 days of system acceptance.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	
C408.3 [FI33] ¹	Lighting systems have been tested to ensure proper calibration, adjustment, programming, and operation.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	


REVISION HISTORY

REV.	DATE	DESCRIPTION	RELEASED FOR PERMIT
0	5/7/25		

MECHANICAL ENGINEER
CAILIN FARRIS
(720) 319-1046
CAILIN@FARRISCONSULTANTS.COM

ELECTRICAL ENGINEER
MARK OWENS
(208) 709-3111
MOWENS@XLENGINEERING.NET

XL ENGINEERING
5257 Wild Dunes Ln, Idaho Falls, ID 208-339-4907 - www.xlengineering.net
XL ENGINEERING
5257 WILD DUNES LN
IDAHO FALLS, ID 83404

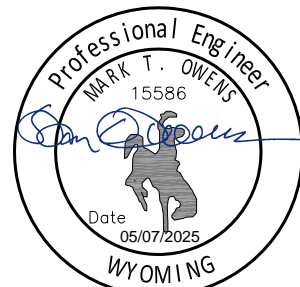

NAME AND DATE FOR
CURRENT RELEASE ONLY

DESIGN: MTO DATE: 5/7/25
APPROVED: MTO
DATE: 5/7/25


XL ENGINEERING
IDAHO FALLS, IDAHO
AUTO SERVICE ELEVATED
PARCEL NO: 37182030004500
ELK MEADOWS ADDITION LOT: 3
ENERGY COMPLIANCE FORMS



PROJECT NUMBER: 25014

DWG: E03

1 LIGHTING PLAN - LEVEL 1
1/4" = 1'-0"

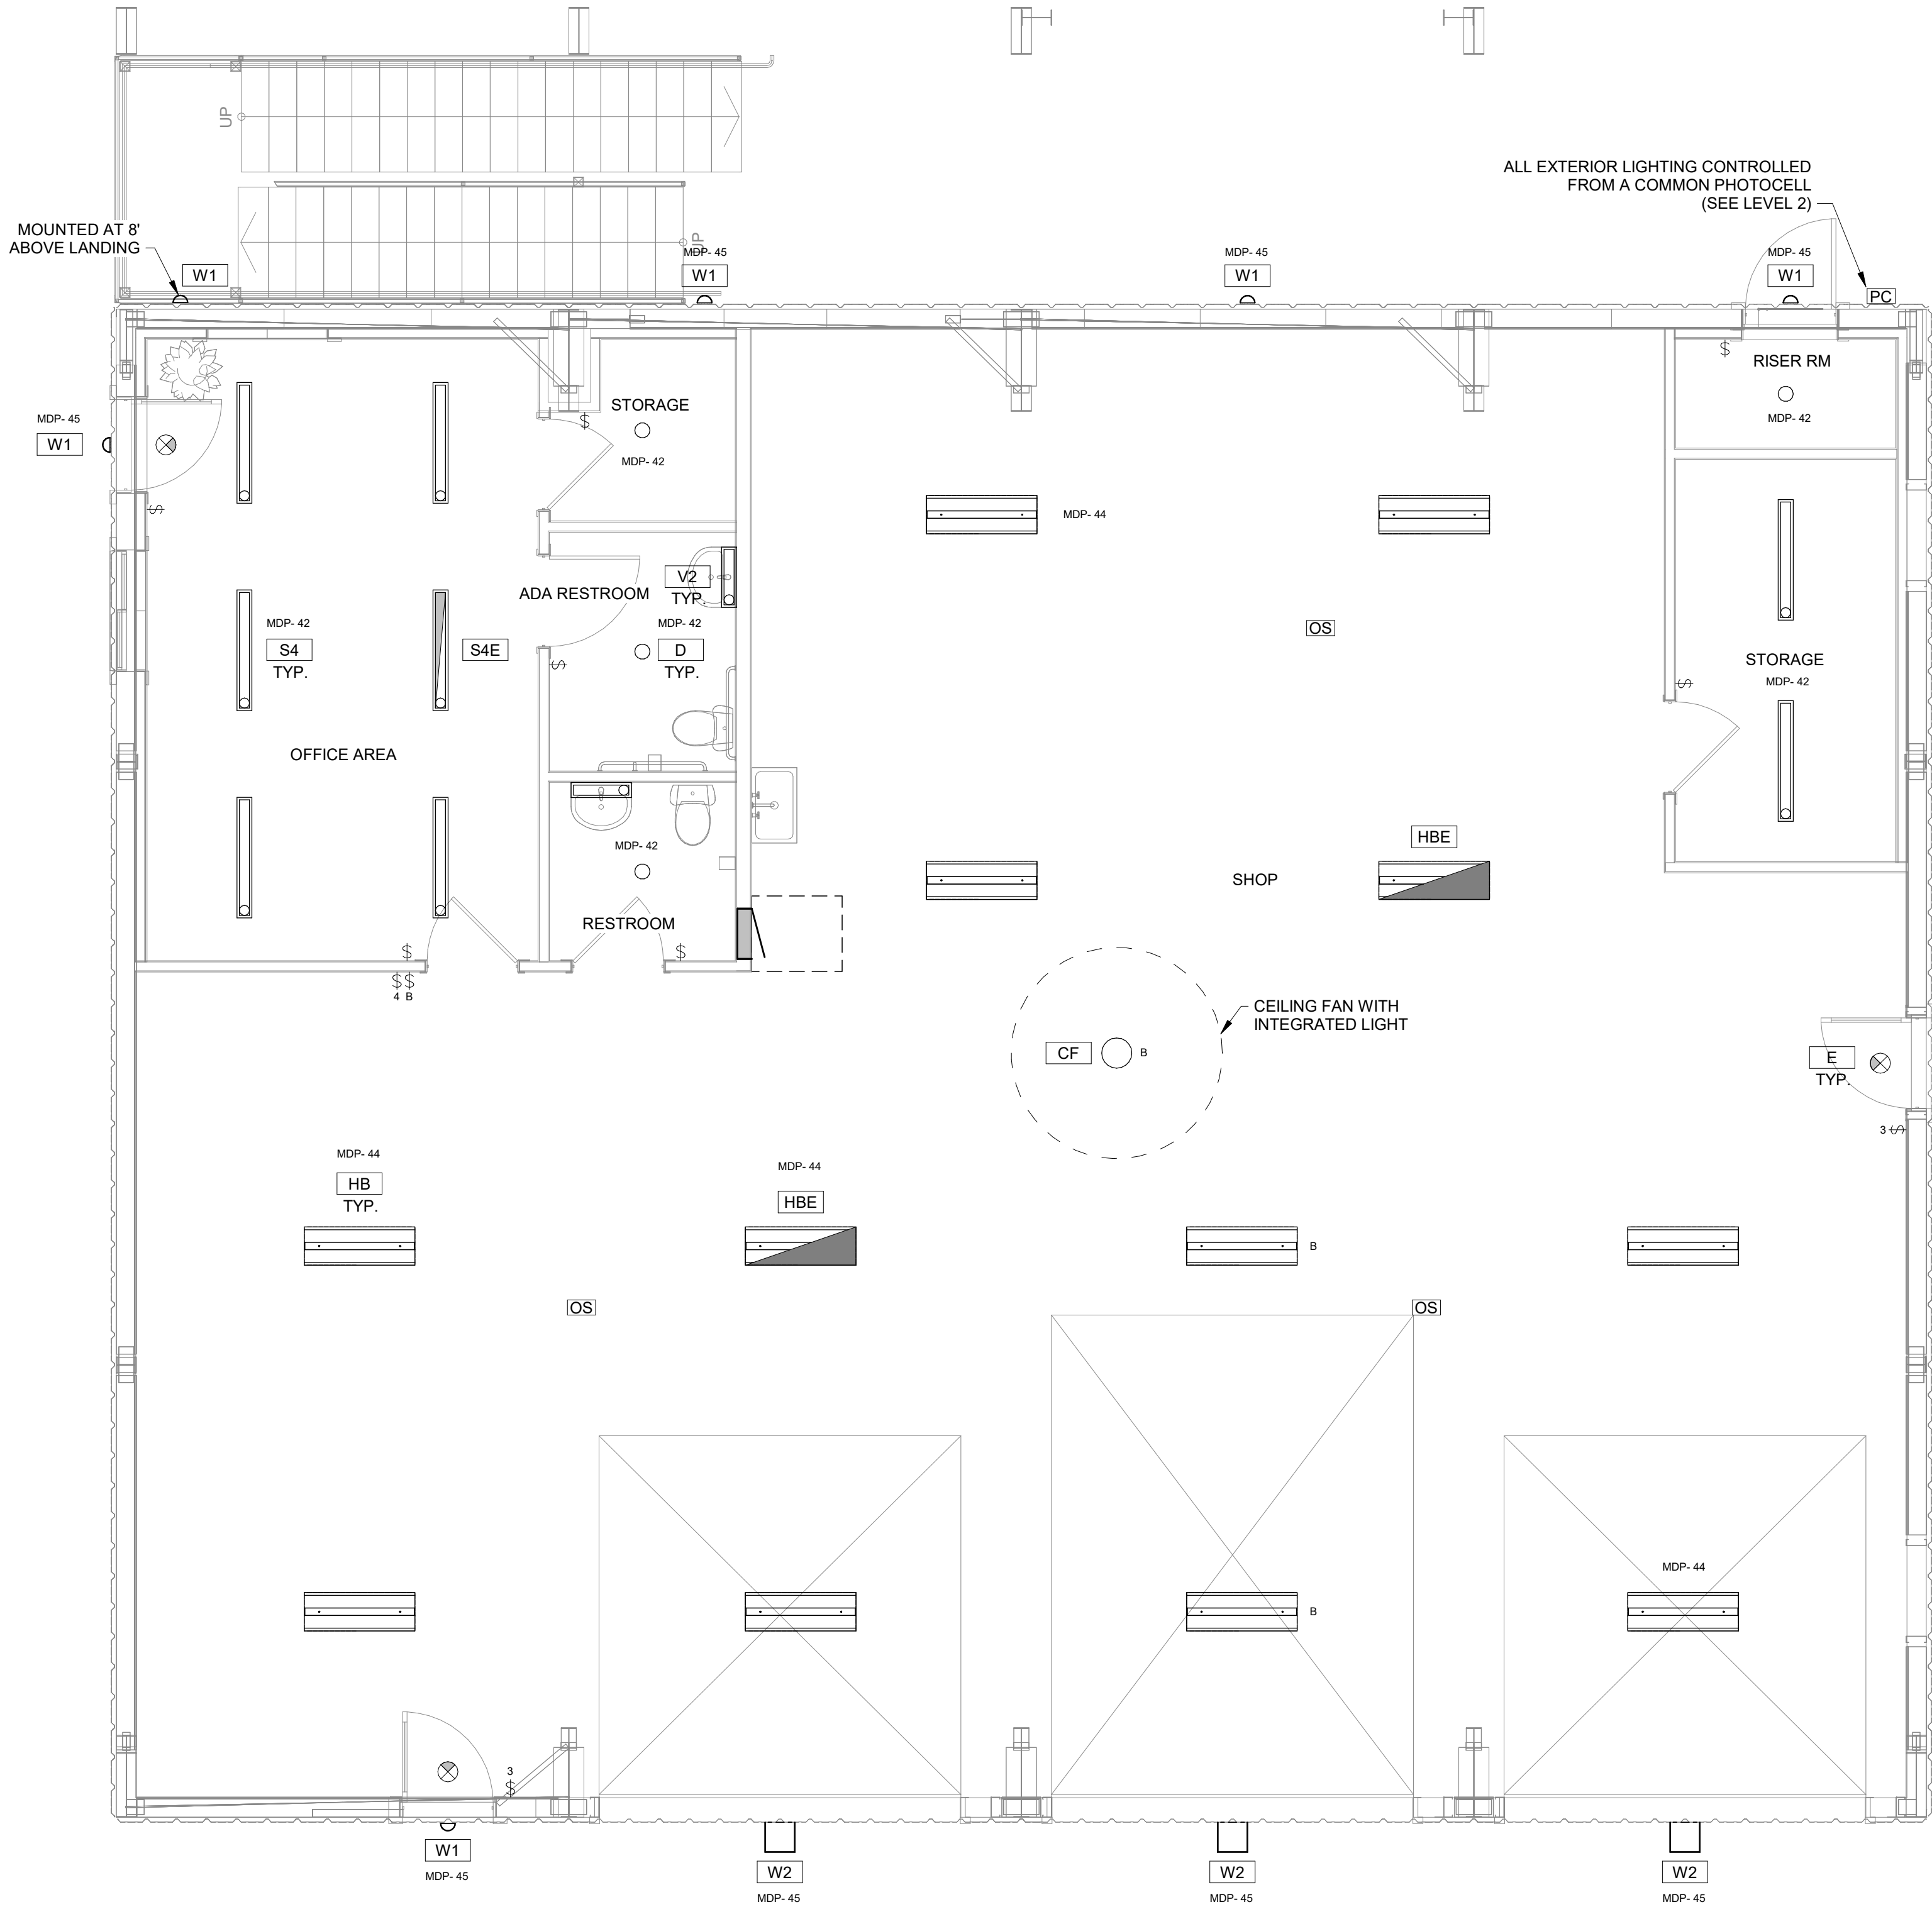

- CONSTRUCTION NOTES:
1. PER IECC R404.1 - ALL PERMANENTLY INSTALLED LIGHTING FIXTURES, EXCLUDING KITCHEN APPLANCE LIGHTING FIXTURES, SHALL CONTAIN ONLY HIGH-EFFICIENCY LIGHTING SOURCES.
 2. PER IECC R404.2 - PERMANENTLY INSTALLED LIGHTING FIXTURES SHALL BE CONTROLLED WITH EITHER DIMMER, AND OCCUPANT SENSOR CONTROL OR OTHER CONTROL THAT IS INSTALLED OR BUILT INTO THE FIXTURE. EXCEPTION: LIGHTING CONTROLS SHALL NOT BE REQUIRED FOR BATHROOMS, HALLWAYS, EXTERIOR LIGHTING FIXTURES, OR LIGHTING DESIGNED FOR SAFETY OR SECURITY.
 3. COORDINATE ANY PENETRATIONS FOR ELECTRICAL EQUIPMENT THROUGH FIRE BARRIERS WITH STRUCTURAL AND MECHANICAL SYSTEMS TO MINIMIZE PENETRATIONS.
 4. ALL PENETRATIONS THROUGH FIRE BARRIERS SHALL BE PROPERLY SEALED TO MAINTAIN THE FIRE RATING OF THE BARRIER.
 5. ALL ELECTRICAL EQUIPMENT INSTALLED IN A FIRE BARRIER SHALL BE FIRE RATED AND SEALED TO AN EQUIVALENT LEVEL AS THE FIRE BARRIER BEING PENETRATED.

GENERAL NOTES

- ALL CONDUITS WITH CIRCUIT CONDUCTORS SHALL HAVE A COPPER EQUIPMENT GROUNDING CONDUCTOR SIZED IN ACCORDANCE WITH NEC 250.
- CONTRACTOR TO VERIFY EQUIPMENT ELECTRICAL REQUIREMENTS PRIOR TO INSTALLATION OF RELATED CIRCUIT. CIRCUIT(S) ARE TO BE SIZED AS REQUIRED BY LABEL RATING.
- ELECTRICAL DEVICES NOTED WITH AN 'OC' SUBSCRIPT ARE TO BE MOUNTED ABOVE THE COUNTER BACK SPLASH. THE BOTTOM OF THE DEVICE COVERPLATE SHALL CLEAR THE TOP OF THE BACK SPLASH. COORDINATE THE MOUNTING HEIGHT WITH THE MILLWORK BEING INSTALLED.
- COORDINATE HOMERUN CIRCUIT NUMBERS WITH PANEL SCHEDULES.
- THIS PLAN DOES NOT REFLECT COMMUNICATION EQUIPMENT. COORDINATE WITH ARCHITECT FOR THE QUANTITY AND LOCATION OF RJ-45 PORTS. THE SERVER SHALL BE LOCATED NEAR THE ELECTRICAL SERVICE ENTRANCE. ALL RJ-45 PORTS SHALL BE CONNECTED TO THE SERVER VIA DEDICATED CAT. 6A ETHERNET CABLE. CONFIRM WITH THE ARCHITECT THAT TELEPHONE AND TV WILL BE INTERNET BASED AND THAT NO COAXIAL OR COPPER TELEPHONE WIRE IS NECESSARY.
- ELECTRICAL CONTRACTOR IS RESPONSIBLE TO FURNISH AND INSTALL TAMPER-RESISTANT (TR) RECEPTACLES IN ALL 15A AND 20A LOCATIONS PER NEC 406.12(1).
- ELECTRICAL CONTRACTOR IS RESPONSIBLE TO FURNISH AND INSTALL ARC-FAULT CIRCUIT-INTERRUPTER (AFCI) PROTECTION PER IN ALL 15A AND 20A LOCATIONS PER NEC 210.12(A).
- ELECTRICAL CONTRACTOR IS RESPONSIBLE TO FURNISH AND INSTALL GROUND-FAULT CIRCUIT-INTERRUPTER (GFCI OR GFI) PROTECTION PER NEC 210.08(A). ALL SINGLE-PHASE RECEPTACLES RATED 125-VOLT, 50 AMPS OR LESS AND THREE-PHASE RECEPTACLES RATED 125-VOLT, 100 AMPS OR LESS SHALL BE GFCI PROTECTED. RECEPTACLES THAT ARE INACCESSIBLE ABOVE OR BEHIND APPLIANCES SHALL BE PROTECTED WITH GFCI PROTECTED CIRCUIT BREAKERS AT THE SOURCE PANEL.
- PROVIDE COMBINATION EXIT/EGRESS LIGHTING AS SHOWN. LIGHT BARS SHALL BE AIMED TO ILLUMINATE THE EGRESS PATH WITH ARROW/CHEVRON INDICATING THE DIRECTION TO THE EXIT.
- DAYLIGHT ZONE(S) ARE NOT REQUIRED TO HAVE DAYLIGHT-RESPONSIVE CONTROLS DUE TO AREA CONTAINING LESS THAN 150 TOTAL WATTS OF GENERAL LIGHTING PER IECC C405.2.3
- INTERIOR LIGHTING IS CONTROLLED BY OCCUPANCY SENSOR OR DAYLIGHT SENSOR CONTROLS (SOME CEILING MOUNTED WIDE-AREA CONTROLS AND OTHERS WALL MOUNTED CONTROLS). A LOWER CASE LETTER "X" INDICATES THE ZONE OF CONTROL WHEN MORE THAN ONE CONTROLLER IS PRESENT IN A COMMON SPACE.
- OCCUPANT SENSOR CONTROL FUNCTION:
 - AUTOMATICALLY TURN OFF LIGHTS WITHIN 30 MINUTES OF ALL OCCUPANTS LEAVING THE SPACE.
 - BE MANUAL ON OR CONTROLLED TO AUTOMATICALLY TURN THE LIGHTING ON TO NOT MORE THAN 50 PERCENT POWER.
 - SHALL INCORPORATE MANUAL CONTROL TO ALLOW OCCUPANTS TO TURN LIGHTS OFF.


KEYED NOTES

REVISION HISTORY

REV	DATE	DESCRIPTION	RELEASED FOR PERMIT
0	5/7/25		

MECHANICAL ENGINEER
CAILIN FARRIS
(720) 319-1046
CAILIN@FARRISCONSULTANTS.COM

ELECTRICAL ENGINEER
MARK OWENS
(208) 709-3111
MOWENS@XLENGINEERING.NET

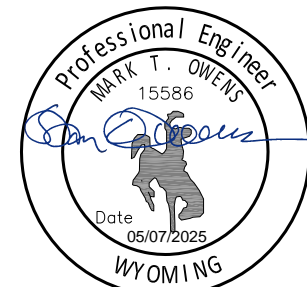

NAME AND DATE FOR
CURRENT RELEASE ONLY

DESIGN:	DATE:
MTO	5/7/25
APPROVED:	
MTO	5/7/25

XL ENGINEERING
IDAHO FALLS, IDAHO

AUTO SERVICE ELEVATED
PARCEL NO: 37182030004500
ELK MEADOWS ADDITION LOT: 3
LIGHTING PLAN LEVEL 1



PROJECT NUMBER: 25014
DWG: E11

1 LIGHTING PLAN - LEVEL 2

1/4" = 1'-0"

CONSTRUCTION NOTES:

1. PER IECC R404.1 - ALL PERMANENTLY INSTALLED LIGHTING FIXTURES, EXCLUDING KITCHEN APPLIANCE LIGHTING FIXTURES, SHALL CONTAIN ONLY HIGH-EFFICIENCY LIGHTING SOURCES.
2. PER IECC R404.2 - PERMANENTLY INSTALLED LIGHTING FIXTURES SHALL BE CONTROLLED WITH EITHER DIMMER, AND OCCUPANT SENSOR CONTROL OR OTHER CONTROL THAT IS INSTALLED OR BUILT INTO THE FIXTURE. EXCEPTION: LIGHTING CONTROLS SHALL NOT BE REQUIRED FOR BATHROOMS, HALLWAYS, EXTERIOR LIGHTING FIXTURES, OR LIGHTING DESIGNED FOR SAFETY OR SECURITY.
3. COORDINATE ANY PENETRATIONS FOR ELECTRICAL EQUIPMENT THROUGH FIRE BARRIERS WITH STRUCTURAL AND MECHANICAL SYSTEMS TO MINIMIZE PENETRATIONS.
4. ALL PENETRATIONS THROUGH FIRE BARRIERS SHALL BE PROPERLY SEALED TO MAINTAIN THE FIRE RATING OF THE BARRIER.
5. ALL ELECTRICAL EQUIPMENT INSTALLED IN A FIRE BARRIER SHALL BE FIRE RATED AND SEALED TO AN EQUIVALENT LEVEL AS THE FIRE BARRIER BEING PENETRATED.

GENERAL NOTES

- A ALL CONDUITS WITH CIRCUIT CONDUCTORS SHALL HAVE A COPPER EQUIPMENT GROUNDING CONDUCTOR SIZED IN ACCORDANCE WITH NEC 250.
- B CONTRACTOR TO VERIFY EQUIPMENT ELECTRICAL REQUIREMENTS PRIOR TO INSTALLATION OF RELATED CIRCUIT. CIRCUIT(S) ARE TO BE SIZED AS REQUIRED BY LABEL RATING.
- C ELECTRICAL DEVICES NOTED WITH AN 'OC' SUBSCRIPT ARE TO BE MOUNTED ABOVE THE COUNTER BACK SPLASH. THE BOTTOM OF THE DEVICE COVERPLATE SHALL CLEAR THE TOP OF THE BACK SPLASH. COORDINATE THE MOUNTING HEIGHT WITH THE MILLWORK BEING INSTALLED.
- D COORDINATE HOMERUN CIRCUIT NUMBERS WITH PANEL SCHEDULES.
- E THIS PLAN DOES NOT REFLECT COMMUNICATION EQUIPMENT. COORDINATE WITH ARCHITECT FOR THE QUANTITY AND LOCATION OF RJ-45 PORTS. THE SERVER SHALL BE LOCATED NEAR THE ELECTRICAL SERVICE ENTRANCE. ALL RJ-45 PORTS SHALL BE CONNECTED TO THE SERVER VIA DEDICATED CAT. 6A ETHERNET CABLE. CONFIRM WITH THE ARCHITECT THAT TELEPHONE AND TV WILL BE INTERNET BASED AND THAT NO COAXIAL OR COPPER TELEPHONE WIRE IS NECESSARY.
- F ELECTRICAL CONTRACTOR IS RESPONSIBLE TO FURNISH AND INSTALL TAMPER-RESISTANT (TR) RECEPTACLES IN ALL 15A AND 20A LOCATIONS PER NEC 406.12(1).
- G ELECTRICAL CONTRACTOR IS RESPONSIBLE TO FURNISH AND INSTALL ARC-FAULT CIRCUIT-INTERRUPTER (AFCI) PROTECTION PER IN ALL 15A AND 20A LOCATIONS PER NEC 210.12(A).
- H ELECTRICAL CONTRACTOR IS RESPONSIBLE TO FURNISH AND INSTALL GROUND-FAULT CIRCUIT-INTERRUPTER (GFCI OR GFI) PROTECTION PER NEC 210.08(A). ALL SINGLE-PHASE RECEPTACLES RATED 125-VOLT, 50 AMPS OR LESS AND THREE-PHASE RECEPTACLES RATED 125-VOLT, 100 AMPS OR LESS SHALL BE GFCI PROTECTED. RECEPTACLES THAT ARE INACCESSIBLE ABOVE OR BEHIND APPLIANCES SHALL BE PROTECTED WITH GFCI PROTECTED CIRCUIT BREAKERS AT THE SOURCE PANEL.
- I PROVIDE COMBINATION EXIT/EGRESS LIGHTING AS SHOWN. LIGHT BARS SHALL BE AIMED TO ILLUMINATE THE EGRESS PATH WITH ARROW/CHEVRON INDICATING THE DIRECTION TO THE EXIT.
- J DAYLIGHT ZONE(S) ARE NOT REQUIRED TO HAVE DAYLIGHT-RESPONSIVE CONTROLS DUE TO AREA CONTAINING LESS THAN 150 TOTAL WATTS OF GENERAL LIGHTING PER IECC C405.2.3
- K INTERIOR LIGHTING IS CONTROLLED BY OCCUPANCY SENSOR OR DAYLIGHT SENSOR CONTROLS (SOME CEILING MOUNTED WIDE-AREA CONTROLS AND OTHERS WALL MOUNTED CONTROLS). A LOWER CASE LETTER "X" INDICATES THE ZONE OF CONTROL WHEN MORE THAN ONE CONTROLLER IS PRESENT IN A COMMON SPACE.
- L OCCUPANT SENSOR CONTROL FUNCTION:
 - L a AUTOMATICALLY TURN OFF LIGHTS WITHIN 30 MINUTES OF ALL OCCUPANTS LEAVING THE SPACE.
 - L b BE MANUAL ON OR CONTROLLED TO AUTOMATICALLY TURN THE LIGHTING ON TO NOT MORE THAN 50 PERCENT POWER.
 - L c SHALL INCORPORATE MANUAL CONTROL TO ALLOW OCCUPANTS TO TURN LIGHTS OFF.


KEYED NOTES

REVISION HISTORY

REV	DATE	DESCRIPTION
0	5/7/25	RELEASED FOR PERMIT

MECHANICAL ENGINEER
CAILIN FARRIS
(720) 319-1046
CAILIN@FARRISCONSULTANTS.COM

ELECTRICAL ENGINEER
MARK OWENS
(208) 709-3111
MOWENS@XLENGINEERING.NET

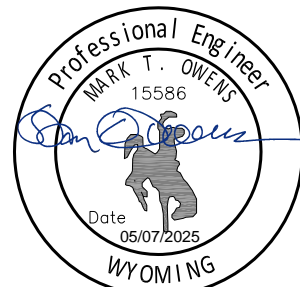

NAME AND DATE FOR CURRENT RELEASE ONLY


DESIGN:	DATE:
MTO	5/7/25
APPROVED:	
MTO	5/7/25

XL ENGINEERING
IDAHO FALLS, IDAHO

AUTO SERVICE ELEVATED
PARCEL NO: 37182030004500
ELK MEADOWS ADDITION LOT: 3
LIGHTING PLAN LEVEL 2



PROJECT NUMBER: 25014
DWG: E12

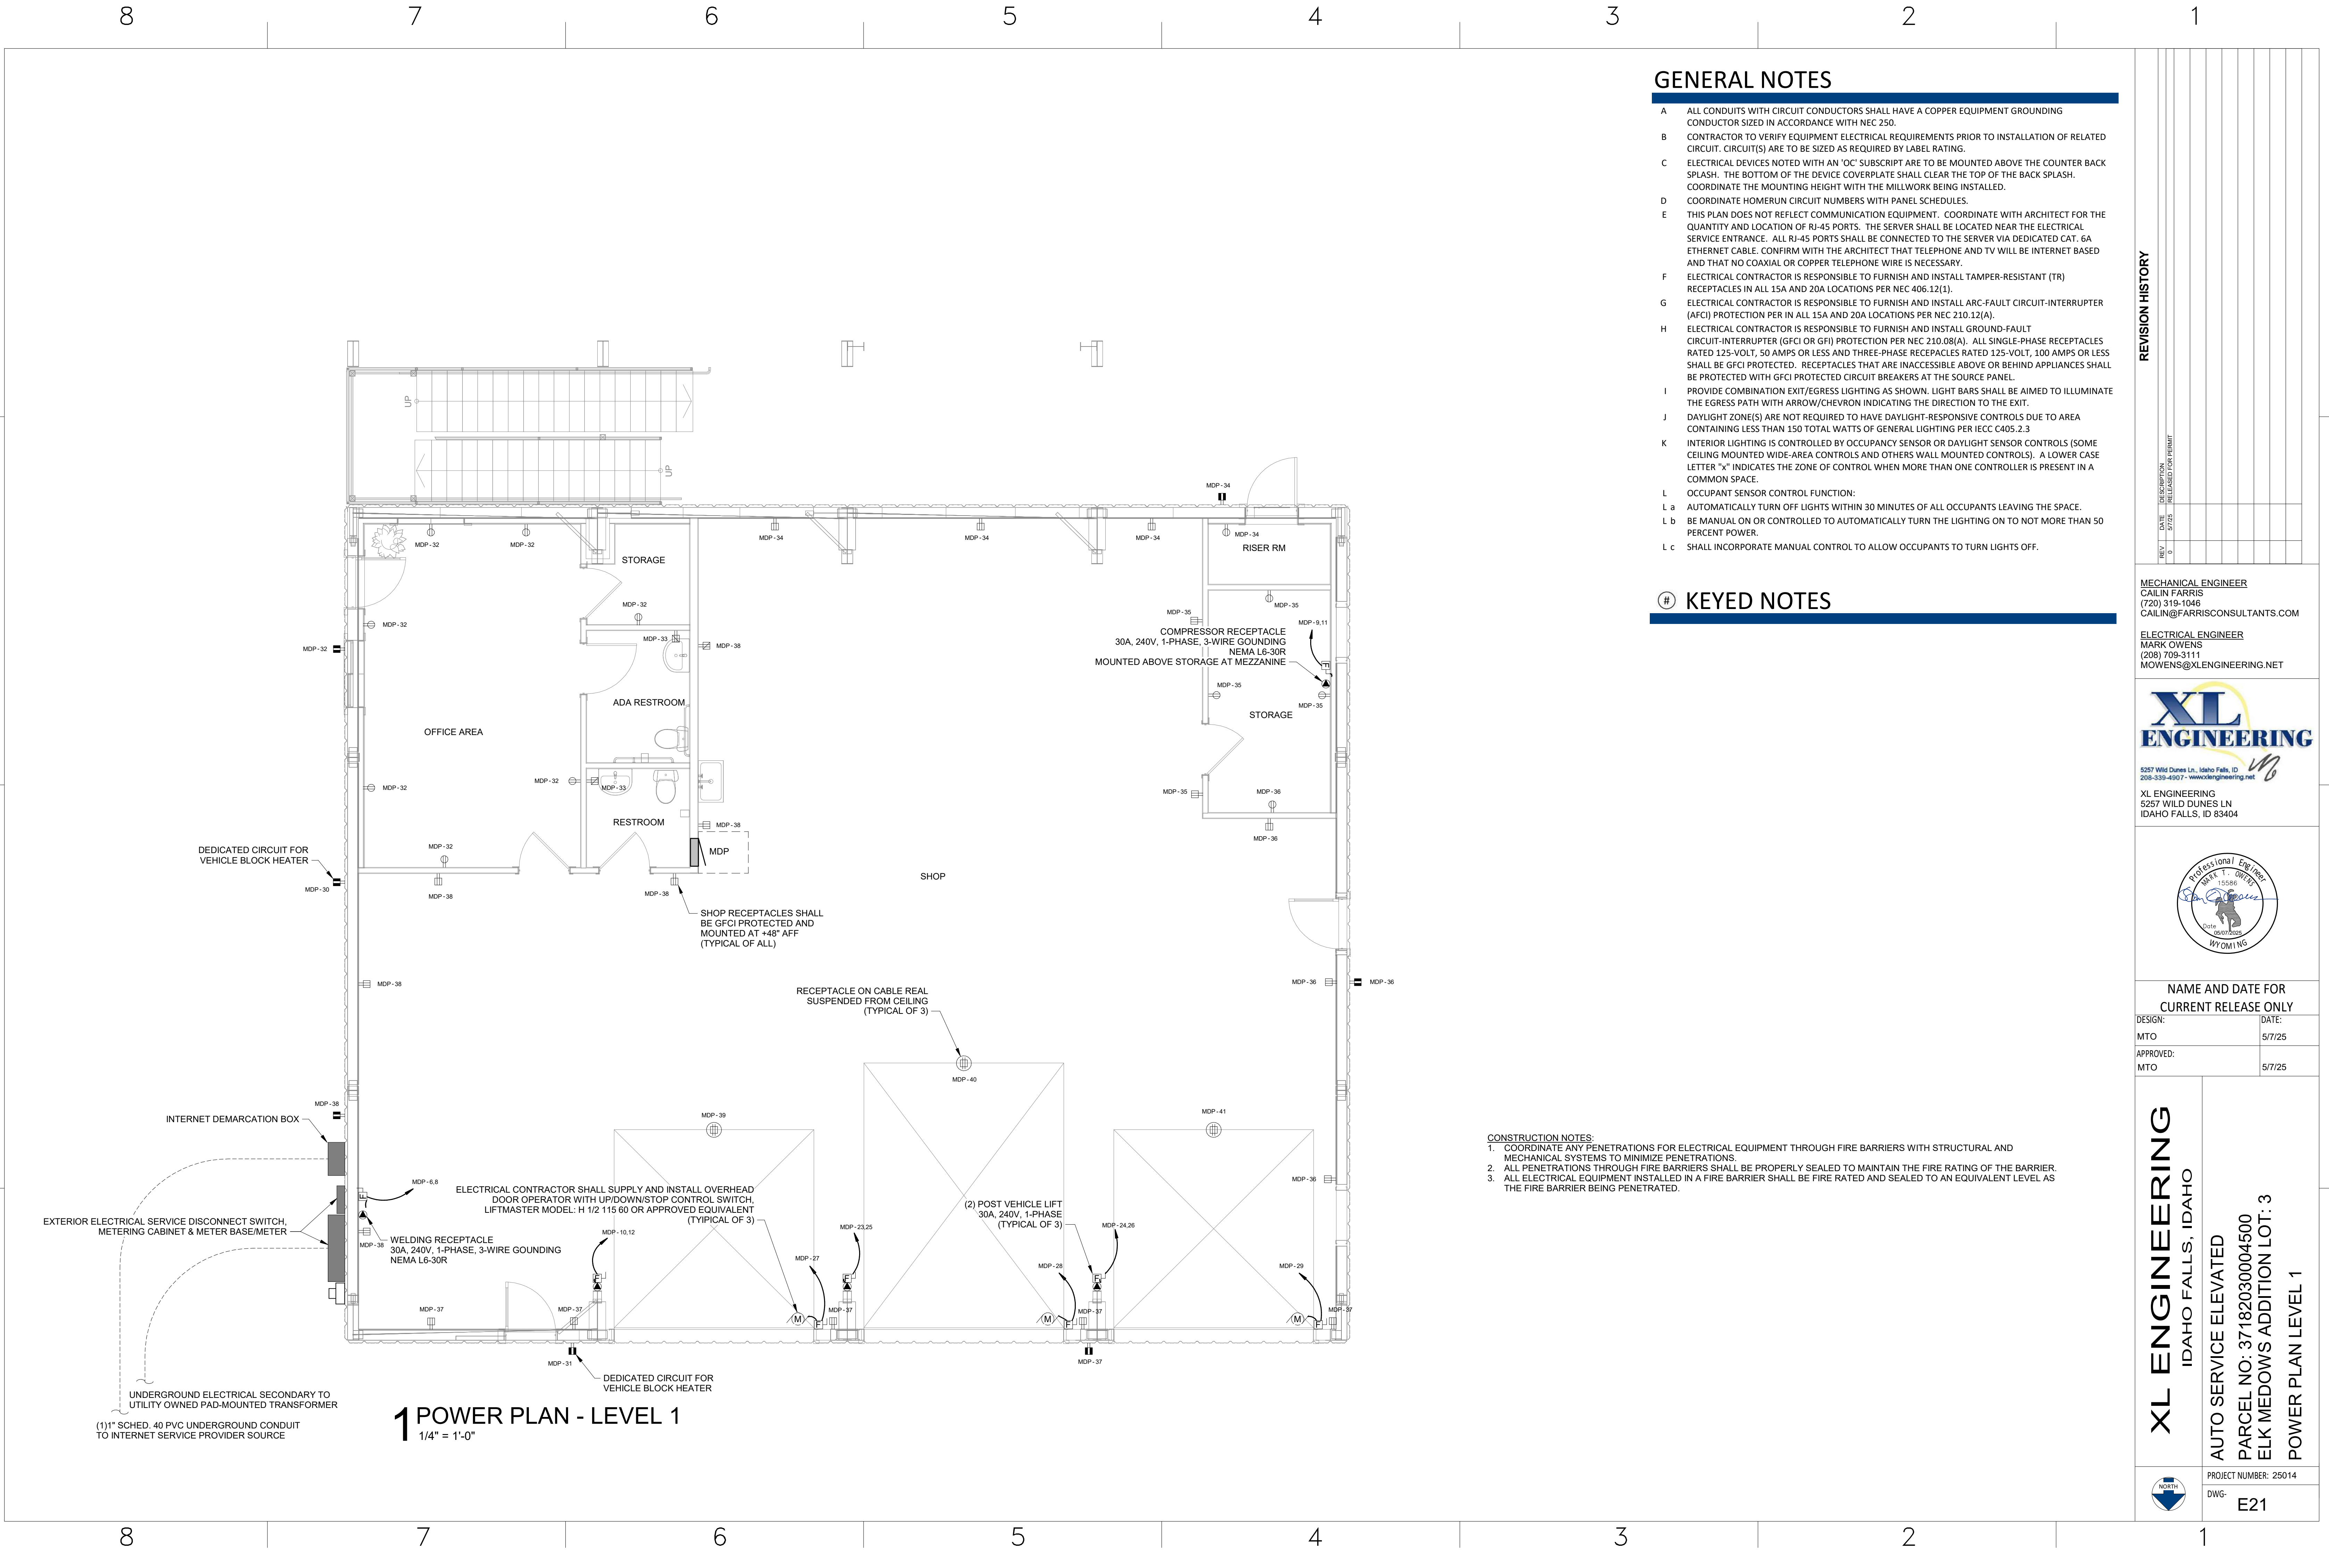

GENERAL NOTES

- A ALL CONDUITS WITH CIRCUIT CONDUCTORS SHALL HAVE A COPPER EQUIPMENT GROUNDING CONDUCTOR SIZED IN ACCORDANCE WITH NEC 250.
- B CONTRACTOR TO VERIFY EQUIPMENT ELECTRICAL REQUIREMENTS PRIOR TO INSTALLATION OF RELATED CIRCUIT. CIRCUIT(S) ARE TO BE SIZED AS REQUIRED BY LABEL RATING.
- C ELECTRICAL DEVICES NOTED WITH AN 'OC' SUBSCRIPT ARE TO BE MOUNTED ABOVE THE COUNTER BACK SPLASH. THE BOTTOM OF THE DEVICE COVERPLATE SHALL CLEAR THE TOP OF THE BACK SPLASH. COORDINATE THE MOUNTING HEIGHT WITH THE MILLWORK BEING INSTALLED.
- D COORDINATE HOMERUN CIRCUIT NUMBERS WITH PANEL SCHEDULES.
- E THIS PLAN DOES NOT REFLECT COMMUNICATION EQUIPMENT. COORDINATE WITH ARCHITECT FOR THE QUANTITY AND LOCATION OF RJ-45 PORTS. THE SERVER SHALL BE LOCATED NEAR THE ELECTRICAL SERVICE ENTRANCE. ALL RJ-45 PORTS SHALL BE CONNECTED TO THE SERVER VIA DEDICATED CAT. 6A ETHERNET CABLE. CONFIRM WITH THE ARCHITECT THAT TELEPHONE AND TV WILL BE INTERNET BASED AND THAT NO COAXIAL OR COPPER TELEPHONE WIRE IS NECESSARY.
- F ELECTRICAL CONTRACTOR IS RESPONSIBLE TO FURNISH AND INSTALL TAMPER-RESISTANT (TR) RECEPTACLES IN ALL 15A AND 20A LOCATIONS PER NEC 406.12(1).
- G ELECTRICAL CONTRACTOR IS RESPONSIBLE TO FURNISH AND INSTALL ARC-FAULT CIRCUIT-INTERRUPTER (AFCI) PROTECTION PER IN ALL 15A AND 20A LOCATIONS PER NEC 210.12(A).
- H ELECTRICAL CONTRACTOR IS RESPONSIBLE TO FURNISH AND INSTALL GROUND-FAULT CIRCUIT-INTERRUPTER (GFCI OR GFI) PROTECTION PER NEC 210.08(A). ALL SINGLE-PHASE RECEPTACLES RATED 125-VOLT, 50 AMPS OR LESS AND THREE-PHASE RECEPTACLES RATED 125-VOLT, 100 AMPS OR LESS SHALL BE GFCI PROTECTED. RECEPTACLES THAT ARE INACCESSIBLE ABOVE OR BEHIND APPLIANCES SHALL BE PROTECTED WITH GFCI PROTECTED CIRCUIT BREAKERS AT THE SOURCE PANEL.
- I PROVIDE COMBINATION EXIT/EGRESS LIGHTING AS SHOWN. LIGHT BARS SHALL BE AIMED TO ILLUMINATE THE EGRESS PATH WITH ARROW/CHEVRON INDICATING THE DIRECTION TO THE EXIT.
- J DAYLIGHT ZONE(S) ARE NOT REQUIRED TO HAVE DAYLIGHT-RESPONSIVE CONTROLS DUE TO AREA CONTAINING LESS THAN 150 TOTAL WATTS OF GENERAL LIGHTING PER IECC C405.2.3
- K INTERIOR LIGHTING IS CONTROLLED BY OCCUPANCY SENSOR OR DAYLIGHT SENSOR CONTROLS (SOME CEILING MOUNTED WIDE-AREA CONTROLS AND OTHERS WALL MOUNTED CONTROLS). A LOWER CASE LETTER "x" INDICATES THE ZONE OF CONTROL WHEN MORE THAN ONE CONTROLLER IS PRESENT IN A COMMON SPACE.
- L OCCUPANT SENSOR CONTROL FUNCTION:
 - L a AUTOMATICALLY TURN OFF LIGHTS WITHIN 30 MINUTES OF ALL OCCUPANTS LEAVING THE SPACE.
 - L b BE MANUAL ON OR CONTROLLED TO AUTOMATICALLY TURN THE LIGHTING ON TO NOT MORE THAN 50 PERCENT POWER.
 - L c SHALL INCORPORATE MANUAL CONTROL TO ALLOW OCCUPANTS TO TURN LIGHTS OFF.

KEYED NOTES

- CONSTRUCTION NOTES:
- 1. COORDINATE ANY PENETRATIONS FOR ELECTRICAL EQUIPMENT THROUGH FIRE BARRIERS WITH STRUCTURAL AND MECHANICAL SYSTEMS TO MINIMIZE PENETRATIONS.
 - 2. ALL PENETRATIONS THROUGH FIRE BARRIERS SHALL BE PROPERLY SEALED TO MAINTAIN THE FIRE RATING OF THE BARRIER.
 - 3. ALL ELECTRICAL EQUIPMENT INSTALLED IN A FIRE BARRIER SHALL BE FIRE RATED AND SEALED TO AN EQUIVALENT LEVEL AS THE FIRE BARRIER BEING PENETRATED.

REVISION HISTORY


REV	DATE	DESCRIPTION
0	5/7/25	RELEASED FOR PERMIT

MECHANICAL ENGINEER
CAILIN FARRIS
(720) 319-1046
CAILIN@FARRISCONSULTANTS.COM

ELECTRICAL ENGINEER
MARK OWENS
(208) 709-3111
MOWENS@XLENGINEERING.NET

5257 Wild Dunes Ln, Idaho Falls, ID 208-339-4907 - www.xlengineering.net

XL ENGINEERING
5257 WILD DUNES LN
IDAHO FALLS, ID 83404

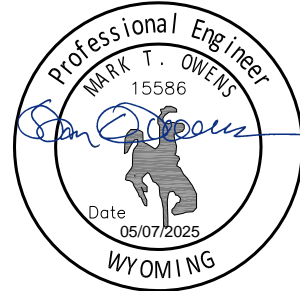

NAME AND DATE FOR CURRENT RELEASE ONLY	
DESIGN:	DATE:
MTD	5/7/25
APPROVED:	
MTD	5/7/25

XL ENGINEERING

IDAHO FALLS, IDAHO

AUTO SERVICE ELEVATED

PARCEL NO: 37182030004500

ELK MEADOWS ADDITION LOT: 3


POWER PLAN LEVEL 1

PROJECT NUMBER: 25014

DWG: E21

1 POWER PLAN - LEVEL 2

1/4" = 1'-0"

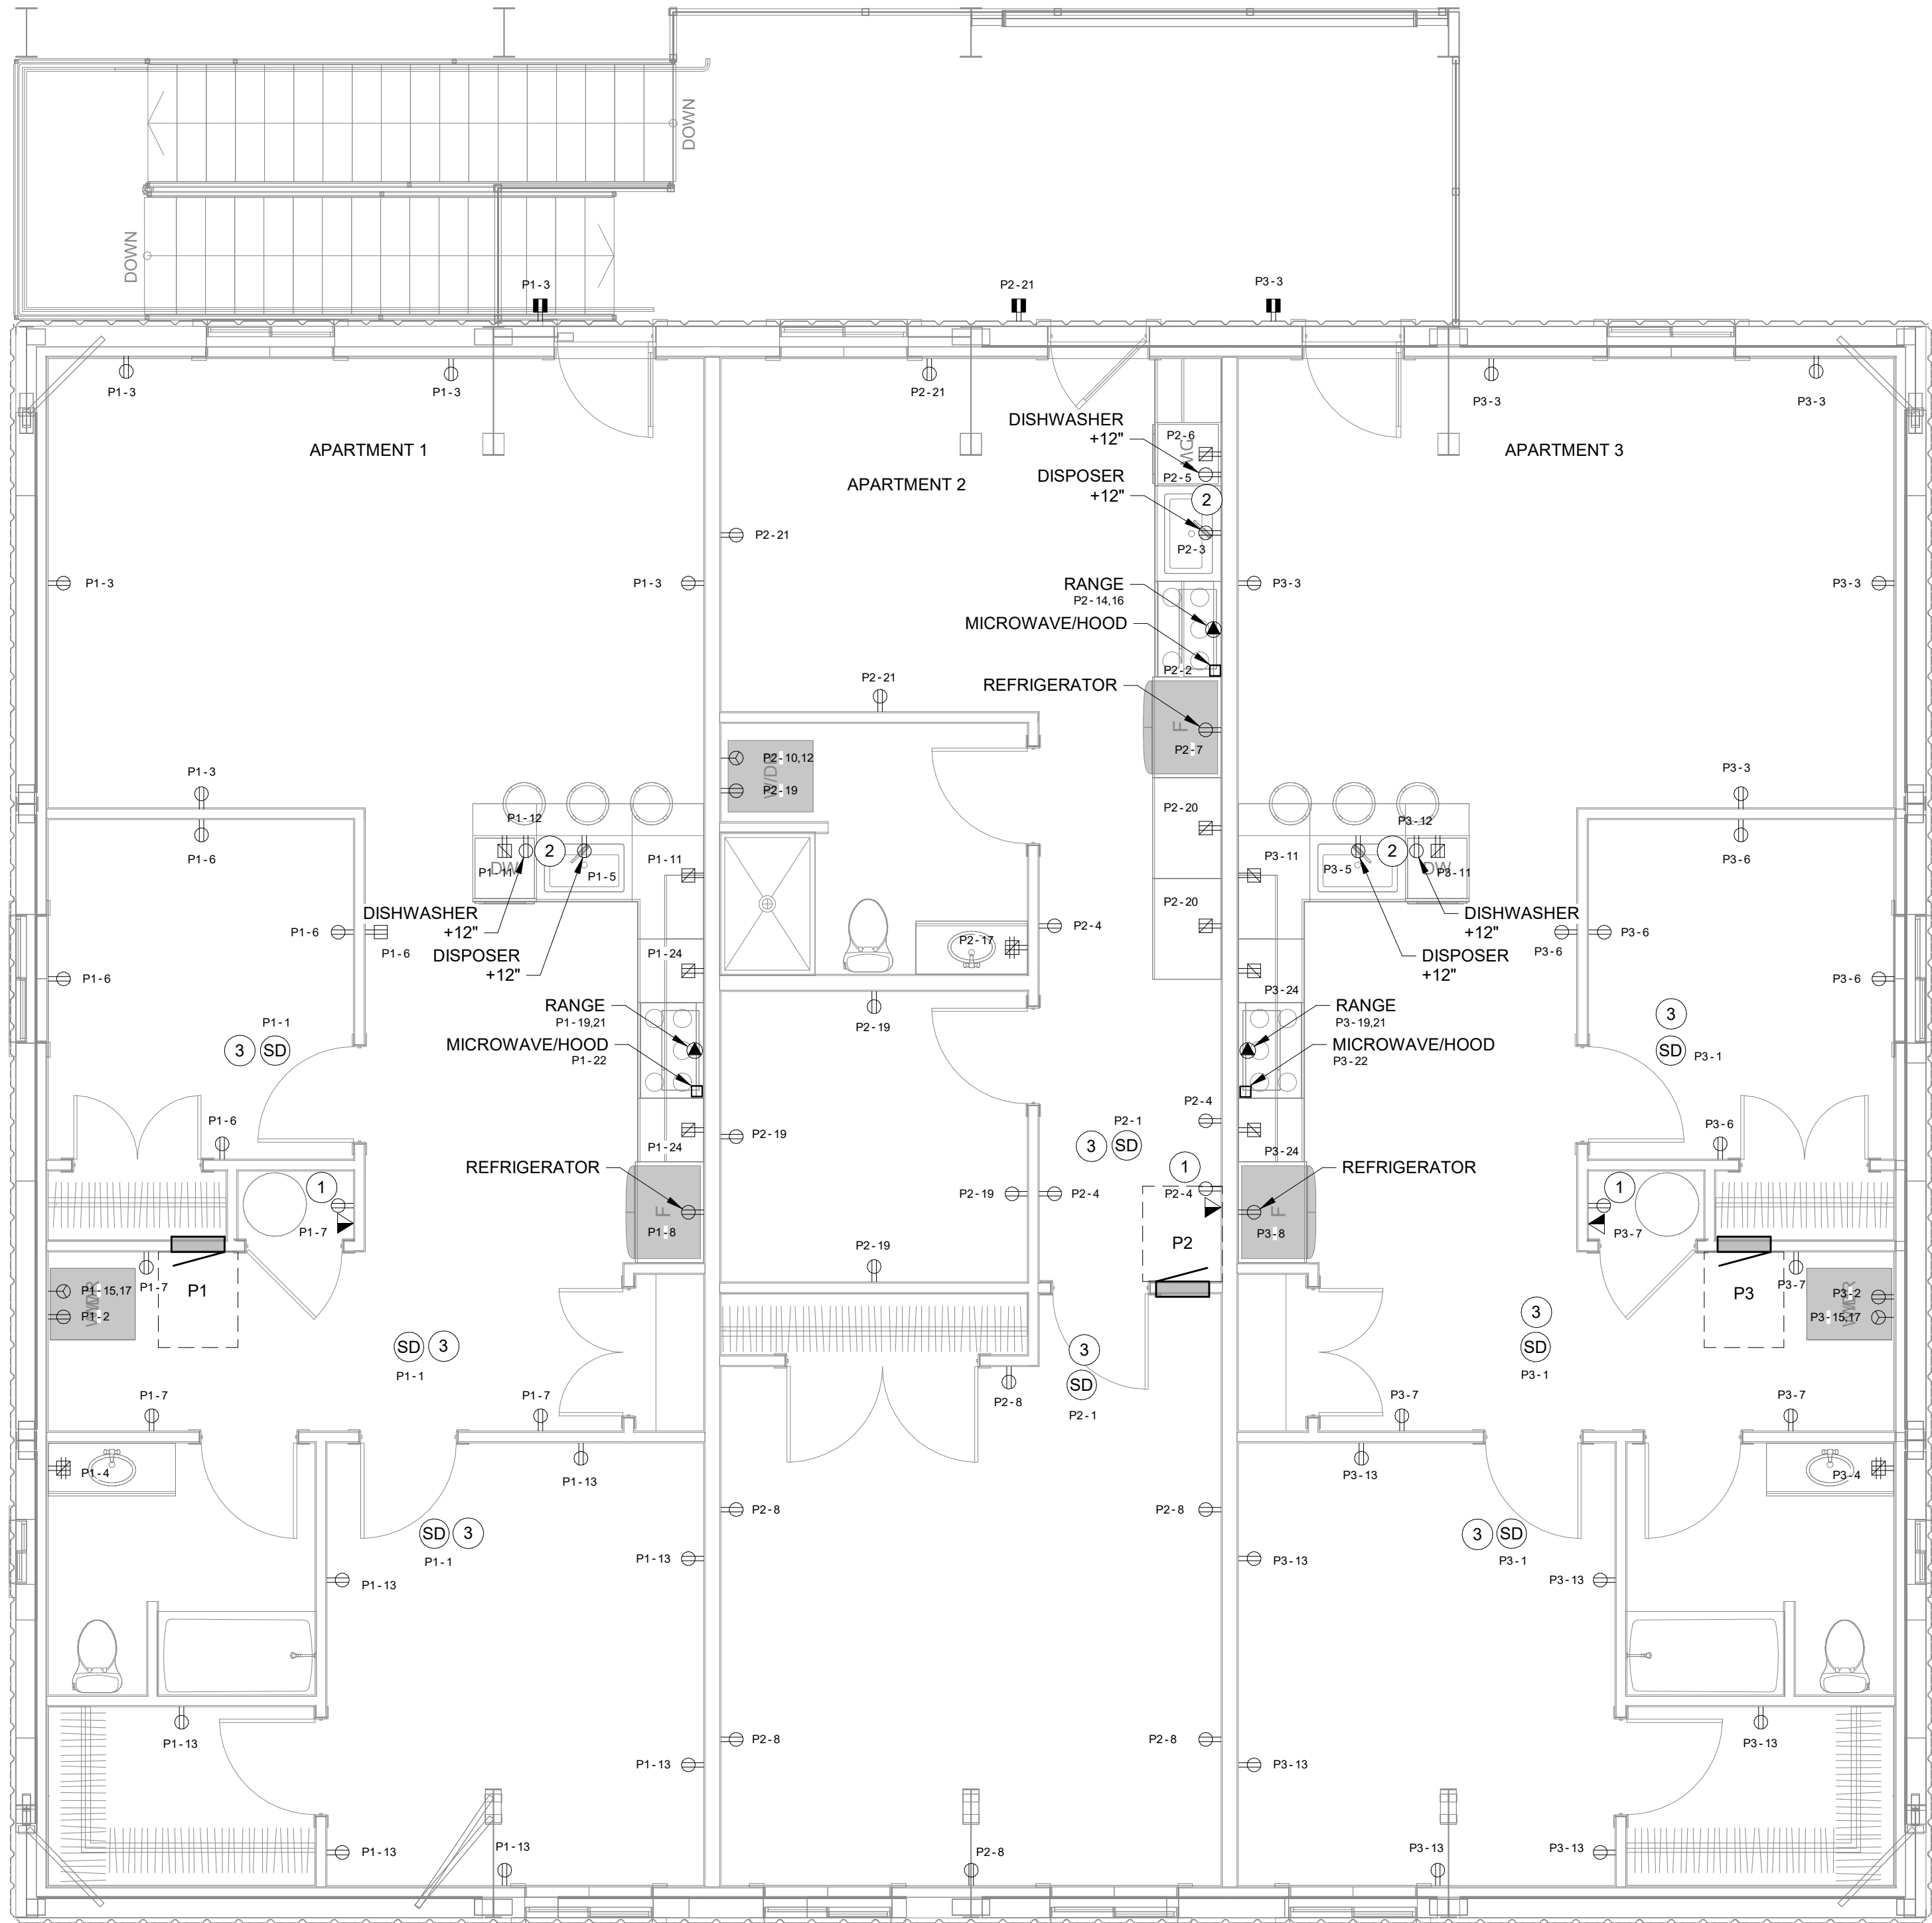

GENERAL NOTES

- A ALL CONDUITS WITH CIRCUIT CONDUCTORS SHALL HAVE A COPPER EQUIPMENT GROUNDING CONDUCTOR SIZED IN ACCORDANCE WITH NEC 250.
- B CONTRACTOR TO VERIFY EQUIPMENT ELECTRICAL REQUIREMENTS PRIOR TO INSTALLATION OF RELATED CIRCUIT. CIRCUIT(S) ARE TO BE SIZED AS REQUIRED BY LABEL RATING.
- C ELECTRICAL DEVICES NOTED WITH AN 'OC' SUBSCRIPT ARE TO BE MOUNTED ABOVE THE COUNTER BACK SPLASH. THE BOTTOM OF THE DEVICE COVERPLATE SHALL CLEAR THE TOP OF THE BACK SPLASH. COORDINATE THE MOUNTING HEIGHT WITH THE MILLWORK BEING INSTALLED.
- D COORDINATE HOMERUN CIRCUIT NUMBERS WITH PANEL SCHEDULES.
- E THIS PLAN DOES NOT REFLECT COMMUNICATION EQUIPMENT. COORDINATE WITH ARCHITECT FOR THE QUANTITY AND LOCATION OF RJ-45 PORTS. THE SERVER SHALL BE LOCATED NEAR THE ELECTRICAL SERVICE ENTRANCE. ALL RJ-45 PORTS SHALL BE CONNECTED TO THE SERVER VIA DEDICATED CAT. 6A ETHERNET CABLE. CONFIRM WITH THE ARCHITECT THAT TELEPHONE AND TV WILL BE INTERNET BASED AND THAT NO COAXIAL OR COPPER TELEPHONE WIRE IS NECESSARY.
- F ELECTRICAL CONTRACTOR IS RESPONSIBLE TO FURNISH AND INSTALL TAMPER-RESISTANT (TR) RECEPTACLES IN ALL 15A AND 20A LOCATIONS PER NEC 406.12(1).
- G ELECTRICAL CONTRACTOR IS RESPONSIBLE TO FURNISH AND INSTALL ARC-FAULT CIRCUIT-INTERRUPTER (AFCI) PROTECTION PER IN ALL 15A AND 20A LOCATIONS PER NEC 210.12(A).
- H ELECTRICAL CONTRACTOR IS RESPONSIBLE TO FURNISH AND INSTALL GROUND-FAULT CIRCUIT-INTERRUPTER (GFCI OR GFI) PROTECTION PER NEC 210.08(A). ALL SINGLE-PHASE RECEPTACLES RATED 125-VOLT, 50 AMPS OR LESS AND THREE-PHASE RECEPTACLES RATED 125-VOLT, 100 AMPS OR LESS SHALL BE GFCI PROTECTED. RECEPTACLES THAT ARE INACCESSIBLE ABOVE OR BEHIND APPLIANCES SHALL BE PROTECTED WITH GFCI PROTECTED CIRCUIT BREAKERS AT THE SOURCE PANEL.
- I PROVIDE COMBINATION EXIT/EGRESS LIGHTING AS SHOWN. LIGHT BARS SHALL BE AIMED TO ILLUMINATE THE EGRESS PATH WITH ARROW/CHEVRON INDICATING THE DIRECTION TO THE EXIT.
- J DAYLIGHT ZONE(S) ARE NOT REQUIRED TO HAVE DAYLIGHT-RESPONSIVE CONTROLS DUE TO AREA CONTAINING LESS THAN 150 TOTAL WATTS OF GENERAL LIGHTING PER IECC C405.2.3
- K INTERIOR LIGHTING IS CONTROLLED BY OCCUPANCY SENSOR OR DAYLIGHT SENSOR CONTROLS (SOME CEILING MOUNTED WIDE-AREA CONTROLS AND OTHERS WALL MOUNTED CONTROLS). A LOWER CASE LETTER "X" INDICATES THE ZONE OF CONTROL WHEN MORE THAN ONE CONTROLLER IS PRESENT IN A COMMON SPACE.
- L OCCUPANT SENSOR CONTROL FUNCTION:
 - L a AUTOMATICALLY TURN OFF LIGHTS WITHIN 30 MINUTES OF ALL OCCUPANTS LEAVING THE SPACE.
 - L b BE MANUAL ON OR CONTROLLED TO AUTOMATICALLY TURN THE LIGHTING ON TO NOT MORE THAN 50 PERCENT POWER.
 - L c SHALL INCORPORATE MANUAL CONTROL TO ALLOW OCCUPANTS TO TURN LIGHTS OFF.

KEYED NOTES

- 1 POWER RECEPTACLE AND DATA PORT (RJ-45 ETHERNET CONNECTOR) MOUNTED AT 60" FOR WIFI ROUTER.
- 2 RECEPTACLE FOR DISHWASHER SHOWN IN THIS LOCATION FOR ASSOCIATION WITH EQUIPMENT BUT MUST BE PHYSICALLY LOCATED IN ADJACENT COMPARTMENT.
- 3 ELECTRICAL CONTRACTOR SHALL INSTALL UL217 RATED COMBINATION SMOKE/CO DETECTOR IN ALL SLEEPING/LIVING SPACES. DETECTORS SHALL BE NETWORKED AND POWERED FROM A COMMON SOURCE.

- CONSTRUCTION NOTES:
- 1. COORDINATE ANY PENETRATIONS FOR ELECTRICAL EQUIPMENT THROUGH FIRE BARRIERS WITH STRUCTURAL AND MECHANICAL SYSTEMS TO MINIMIZE PENETRATIONS.
 - 2. ALL PENETRATIONS THROUGH FIRE BARRIERS SHALL BE PROPERLY SEALED TO MAINTAIN THE FIRE RATING OF THE BARRIER.
 - 3. ALL ELECTRICAL EQUIPMENT INSTALLED IN A FIRE BARRIER SHALL BE FIRE RATED AND SEALED TO AN EQUIVALENT LEVEL AS THE FIRE BARRIER BEING PENETRATED.

REVISION HISTORY

REV	DATE	DESCRIPTION	RELEASED FOR PERMIT
0	5/7/25		

MECHANICAL ENGINEER
CAILIN FARRIS
(720) 319-1046
CAILIN@FARRISCONSULTANTS.COM


ELECTRICAL ENGINEER
MARK OWENS
(208) 709-3111
MOWENS@XLENGINEERING.NET



NAME AND DATE FOR CURRENT RELEASE ONLY	
DESIGN:	DATE:
MTD	5/7/25
APPROVED:	
MTD	5/7/25

XL ENGINEERING
IDAHO FALLS, IDAHO
AUTO SERVICE ELEVATED
PARCEL NO: 37182030004500
ELK MEADOWS ADDITION LOT: 3
POWER PLAN LEVEL 2

PROJECT NUMBER: 25014
DWG: E22

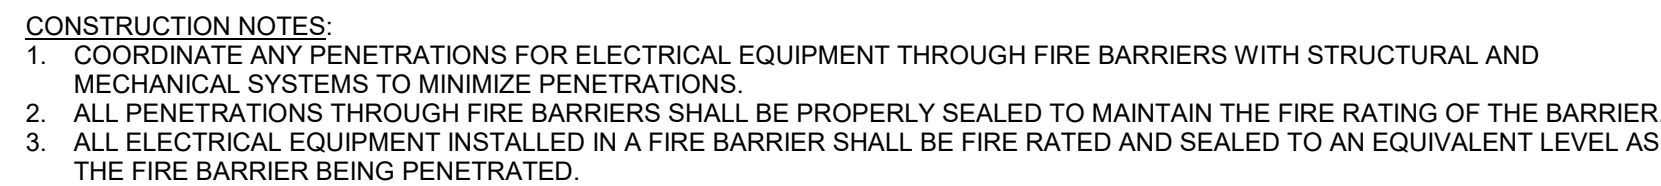

A ALL CONDUITS WITH CIRCUIT CONDUCTORS SHALL HAVE A COPPER EQUIPMENT GROUNDING CONDUCTOR SIZED IN ACCORDANCE WITH NEC 250.

B CONTRACTOR TO VERIFY EQUIPMENT ELECTRICAL REQUIREMENTS PRIOR TO INSTALLATION OF RELATED CIRCUIT. CIRCUIT(S) ARE TO BE SIZED AS REQUIRED BY LABEL RATING.

C ELECTRICAL DEVICES NOTED WITH AN 'OC' SUBSCRIPT ARE TO BE MOUNTED ABOVE THE COUNTER BACK SPLASH. THE BOTTOM OF THE DEVICE COVERPLATE SHALL CLEAR THE TOP OF THE BACK SPLASH. COORDINATE THE MOUNTING HEIGHT WITH THE MILLWORK BEING INSTALLED.

D COORDINATE HOMERUN CIRCUIT NUMBERS WITH PANEL SCHEDULES.

E THIS PLAN DOES NOT REFLECT COMMUNICATION EQUIPMENT. COORDINATE WITH ARCHITECT FOR THE QUANTITY AND LOCATION OF RJ-45 PORTS. THE SERVER SHALL BE LOCATED NEAR THE ELECTRICAL SERVICE ENTRANCE. ALL RJ-45 PORTS SHALL BE CONNECTED TO THE SERVER VIA DEDICATED CAT. 6A ETHERNET CABLE. CONFIRM WITH THE ARCHITECT THAT TELEPHONE AND TV WILL BE INTERNET BASED AND THAT NO COAXIAL OR COPPER TELEPHONE WIRE IS NECESSARY.

F ELECTRICAL CONTRACTOR IS RESPONSIBLE TO FURNISH AND INSTALL TAMPER-RESISTANT (TR) RECEPTACLES IN ALL 15A AND 20A LOCATIONS PER NEC 406.12(1).

G ELECTRICAL CONTRACTOR IS RESPONSIBLE TO FURNISH AND INSTALL ARC-FAULT CIRCUIT-INTERRUPTER (AFCI) PROTECTION PER IN ALL 15A AND 20A LOCATIONS PER NEC 210.12(A).

H ELECTRICAL CONTRACTOR IS RESPONSIBLE TO FURNISH AND INSTALL GROUND-FAULT CIRCUIT-INTERRUPTER (GFCI OR GFI) PROTECTION PER NEC 210.08(A). ALL SINGLE-PHASE RECEPTACLES RATED 125-VOLT, 50 AMPS OR LESS AND THREE-PHASE RECEPTACLES RATED 125-VOLT, 100 AMPS OR LESS SHALL BE GFCI PROTECTED. RECEPTACLES THAT ARE INACCESSIBLE ABOVE OR BEHIND APPLIANCES SHALL BE PROTECTED WITH GFCI PROTECTED CIRCUIT BREAKERS AT THE SOURCE PANEL.

I PROVIDE COMBINATION EIT/EGRESS LIGHTING AS SHOWN. LIGHT BARS SHALL BE AIMED TO ILLUMINATE THE EGRESS PATH WITH ARROW/CHEVRON INDICATING THE DIRECTION TO THE EXIT.

J DAYLIGHT ZONE(S) ARE NOT REQUIRED TO HAVE DAYLIGHT-RESPONSIVE CONTROLS DUE TO AREA CONTAINING LESS THAN 150 TOTAL WATTS OF GENERAL LIGHTING PER IECC 405.2.3

K INTERIOR LIGHTING IS CONTROLLED BY OCCUPANCY SENSOR OR DAYLIGHT SENSOR CONTROLS (SOME CEILING MOUNTED WIDE-AREA CONTROLS AND OTHERS WALL MOUNTED CONTROLS). A LOWER CASE LETTER "X" INDICATES THE ZONE OF CONTROL WHEN MORE THAN ONE CONTROLLER IS PRESENT IN A COMMON SPACE.

L OCCUPANT SENSOR CONTROL FUNCTION:

L a AUTOMATICALLY TURN OFF LIGHTS WITHIN 30 MINUTES OF ALL OCCUPANTS LEAVING THE SPACE.


L b BE MANUAL ON OR CONTROLLED TO AUTOMATICALLY TURN THE LIGHTING ON TO NOT MORE THAN 50 PERCENT POWER.

L c SHALL INCORPORATE MANUAL CONTROL TO ALLOW OCCUPANTS TO TURN LIGHTS OFF.

1. CIRCUIT ALL EXHAUST FANS (EF) TO ADJACENT RECEPTACLE CIRCUIT. PROVIDE INDEPENDENT SWITCHING COORDINATED WITH THE LOCATION OF LIGHTING SWITCHES.

[illegible]

ELECTRICAL ENGINEER
MARK OWENS
(208) 709-3111
MOWENS@XLENGINEERING.NET

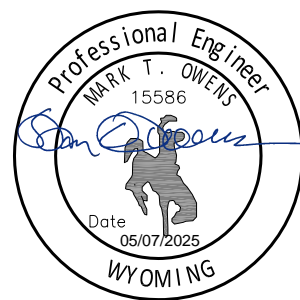


DESIGN:	DATE:
MTO	5/7/23
APPROVED:	
MTO	5/7/23

PROJECT NUMBER: 25014
DWG- **E31**

1 MECHANICAL POWER PLAN - LEVEL 1

1 MECHANICAL POWER PLAN - LEVEL 2

1/4" = 1'-0"

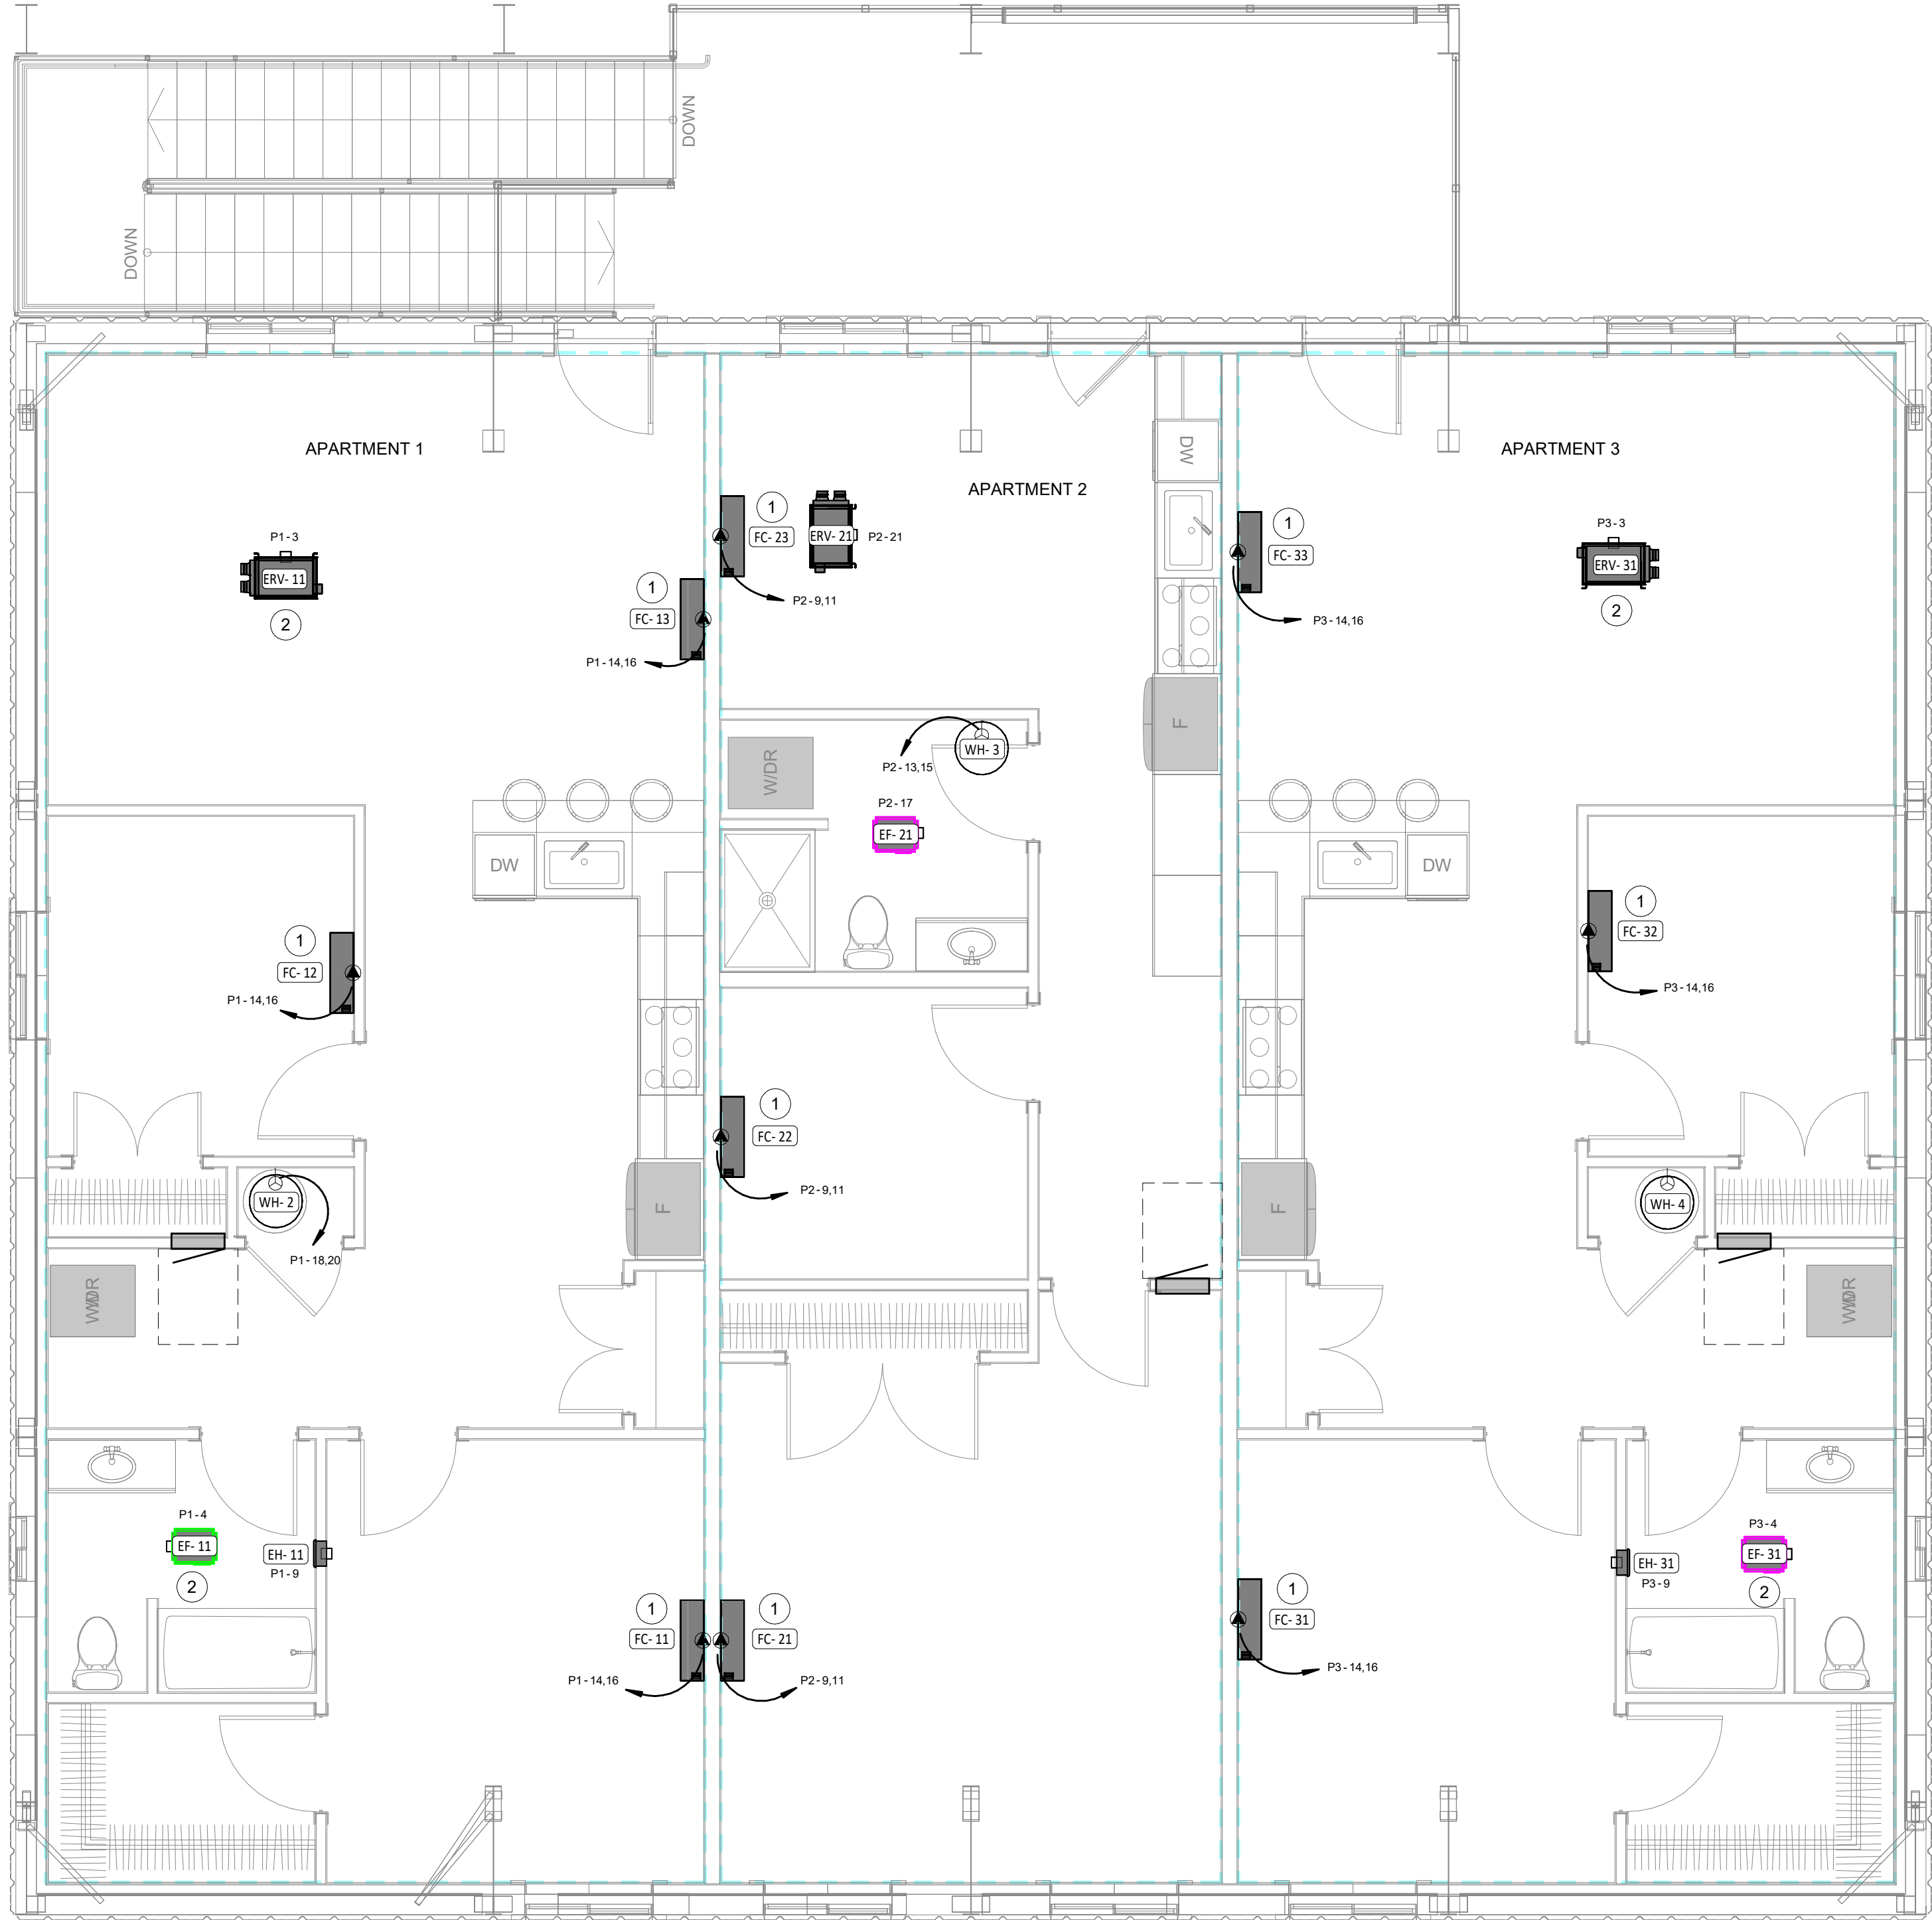

GENERAL NOTES

- A ALL CONDUITS WITH CIRCUIT CONDUCTORS SHALL HAVE A COPPER EQUIPMENT GROUNDING CONDUCTOR SIZED IN ACCORDANCE WITH NEC 250.
- B CONTRACTOR TO VERIFY EQUIPMENT ELECTRICAL REQUIREMENTS PRIOR TO INSTALLATION OF RELATED CIRCUIT. CIRCUIT(S) ARE TO BE SIZED AS REQUIRED BY LABEL RATING.
- C ELECTRICAL DEVICES NOTED WITH AN 'OC' SUBSCRIPT ARE TO BE MOUNTED ABOVE THE COUNTER BACK SPLASH. THE BOTTOM OF THE DEVICE COVERPLATE SHALL CLEAR THE TOP OF THE BACK SPLASH. COORDINATE THE MOUNTING HEIGHT WITH THE MILLWORK BEING INSTALLED.
- D COORDINATE HOMERUN CIRCUIT NUMBERS WITH PANEL SCHEDULES.
- E THIS PLAN DOES NOT REFLECT COMMUNICATION EQUIPMENT. COORDINATE WITH ARCHITECT FOR THE QUANTITY AND LOCATION OF RJ-45 PORTS. THE SERVER SHALL BE LOCATED NEAR THE ELECTRICAL SERVICE ENTRANCE. ALL RJ-45 PORTS SHALL BE CONNECTED TO THE SERVER VIA DEDICATED CAT. 6A ETHERNET CABLE. CONFIRM WITH THE ARCHITECT THAT TELEPHONE AND TV WILL BE INTERNET BASED AND THAT NO COAXIAL OR COPPER TELEPHONE WIRE IS NECESSARY.
- F ELECTRICAL CONTRACTOR IS RESPONSIBLE TO FURNISH AND INSTALL TAMPER-RESISTANT (TR) RECEPTACLES IN ALL 15A AND 20A LOCATIONS PER NEC 406.12(1).
- G ELECTRICAL CONTRACTOR IS RESPONSIBLE TO FURNISH AND INSTALL ARC-FAULT CIRCUIT-INTERRUPTER (AFCI) PROTECTION PER IN ALL 15A AND 20A LOCATIONS PER NEC 210.12(A).
- H ELECTRICAL CONTRACTOR IS RESPONSIBLE TO FURNISH AND INSTALL GROUND-FAULT CIRCUIT-INTERRUPTER (GFCI OR GFI) PROTECTION PER NEC 210.08(A). ALL SINGLE-PHASE RECEPTACLES RATED 125-VOLT, 50 AMPS OR LESS AND THREE-PHASE RECEPTACLES RATED 125-VOLT, 100 AMPS OR LESS SHALL BE GFCI PROTECTED. RECEPTACLES THAT ARE INACCESSIBLE ABOVE OR BEHIND APPLIANCES SHALL BE PROTECTED WITH GFCI PROTECTED CIRCUIT BREAKERS AT THE SOURCE PANEL.
- I PROVIDE COMBINATION EXIT/EGRESS LIGHTING AS SHOWN. LIGHT BARS SHALL BE AIMED TO ILLUMINATE THE EGRESS PATH WITH ARROW/CHEVRON INDICATING THE DIRECTION TO THE EXIT.
- J DAYLIGHT ZONE(S) ARE NOT REQUIRED TO HAVE DAYLIGHT-RESPONSIVE CONTROLS DUE TO AREA CONTAINING LESS THAN 150 TOTAL WATTS OF GENERAL LIGHTING PER IECC C405.2.3
- K INTERIOR LIGHTING IS CONTROLLED BY OCCUPANCY SENSOR OR DAYLIGHT SENSOR CONTROLS (SOME CEILING MOUNTED WIDE-AREA CONTROLS AND OTHERS WALL MOUNTED CONTROLS). A LOWER CASE LETTER "x" INDICATES THE ZONE OF CONTROL WHEN MORE THAN ONE CONTROLLER IS PRESENT IN A COMMON SPACE.
- L OCCUPANT SENSOR CONTROL FUNCTION:
 - L a AUTOMATICALLY TURN OFF LIGHTS WITHIN 30 MINUTES OF ALL OCCUPANTS LEAVING THE SPACE.
 - L b BE MANUAL ON OR CONTROLLED TO AUTOMATICALLY TURN THE LIGHTING ON TO NOT MORE THAN 50 PERCENT POWER.
 - L c SHALL INCORPORATE MANUAL CONTROL TO ALLOW OCCUPANTS TO TURN LIGHTS OFF.

KEYED NOTES

- 1 POWER FOR SPLIT SYSTEM FAN COIL UNITS (FCU) SUPPLIED FROM SPLIT SYSTEM HEAT PUMP (HP) OR SPLIT SYSTEM CONDENSING UNIT (CU). SEE MECHANICAL SHEETS/SCHEDULES FOR ASSOCIATION
- 2 CIRCUIT ALL EXHAUST FANS (EF) TO ADJACENT RECEPTACLE CIRCUIT. PROVIDE INDEPENDENT SWITCHING COORDINATED WITH THE LOCATION OF LIGHTING SWITCHES.


- CONSTRUCTION NOTES:
- 1. COORDINATE ANY PENETRATIONS FOR ELECTRICAL EQUIPMENT THROUGH FIRE BARRIERS WITH STRUCTURAL AND MECHANICAL SYSTEMS TO MINIMIZE PENETRATIONS.
 - 2. ALL PENETRATIONS THROUGH FIRE BARRIERS SHALL BE PROPERLY SEALED TO MAINTAIN THE FIRE RATING OF THE BARRIER.
 - 3. ALL ELECTRICAL EQUIPMENT INSTALLED IN A FIRE BARRIER SHALL BE FIRE RATED AND SEALED TO AN EQUIVALENT LEVEL AS THE FIRE BARRIER BEING PENETRATED.

REVISION HISTORY

REV	DATE	DESCRIPTION	RELEASED FOR PERMIT
0	5/7/25		

MECHANICAL ENGINEER
CAILIN FARRIS
(720) 319-1046
CAILIN@FARRISCONSULTANTS.COM

ELECTRICAL ENGINEER
MARK OWENS
(208) 709-3111
MOWENS@XLENGINEERING.NET

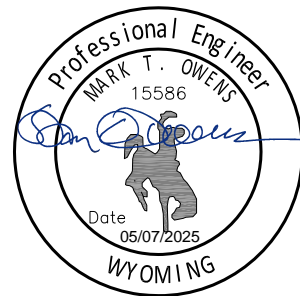

NAME AND DATE FOR CURRENT RELEASE ONLY	
DESIGN:	DATE:
MTO	5/7/25
APPROVED:	
MTO	5/7/25

XL ENGINEERING
IDAHO FALLS, IDAHO
AUTO SERVICE ELEVATED
PARCEL NO: 37182030004500
ELK MEADOWS ADDITION LOT: 3
MECHANICAL POWER PLAN LEVEL 2

PROJECT NUMBER: 25014
DWG: E32