



AGENDA ITEM SUMMARY FORM

MEETING DATE: April 28, 2026

PREPARED BY: Hector Renteria

AGENDA CONTENT: 1. Discussion and possible action on the proposed alignment for the BWA 36" Transfer Water Main.

AGENDA ITEM SECTION: Regular Agenda

BUDGETED AMOUNT: NA **FUNDS REQUESTED: NA**

FUND:


EXECUTIVE SUMMARY:

BWA has begun to identify a route for a proposed 36" water transmission main from their Water Treatment Plant to the existing 42" water line located just north of CR 44. B&L has provided a potential route and has asked Council to review and make comments on the proposed alignment. Please review the attached exhibits for discussion at Council.


RECOMMENDATION:

Provide feed back to HDR on the proposed BWA 36" Water Transmission Main.



Angleton City Limits
Proposed 36" Water Line

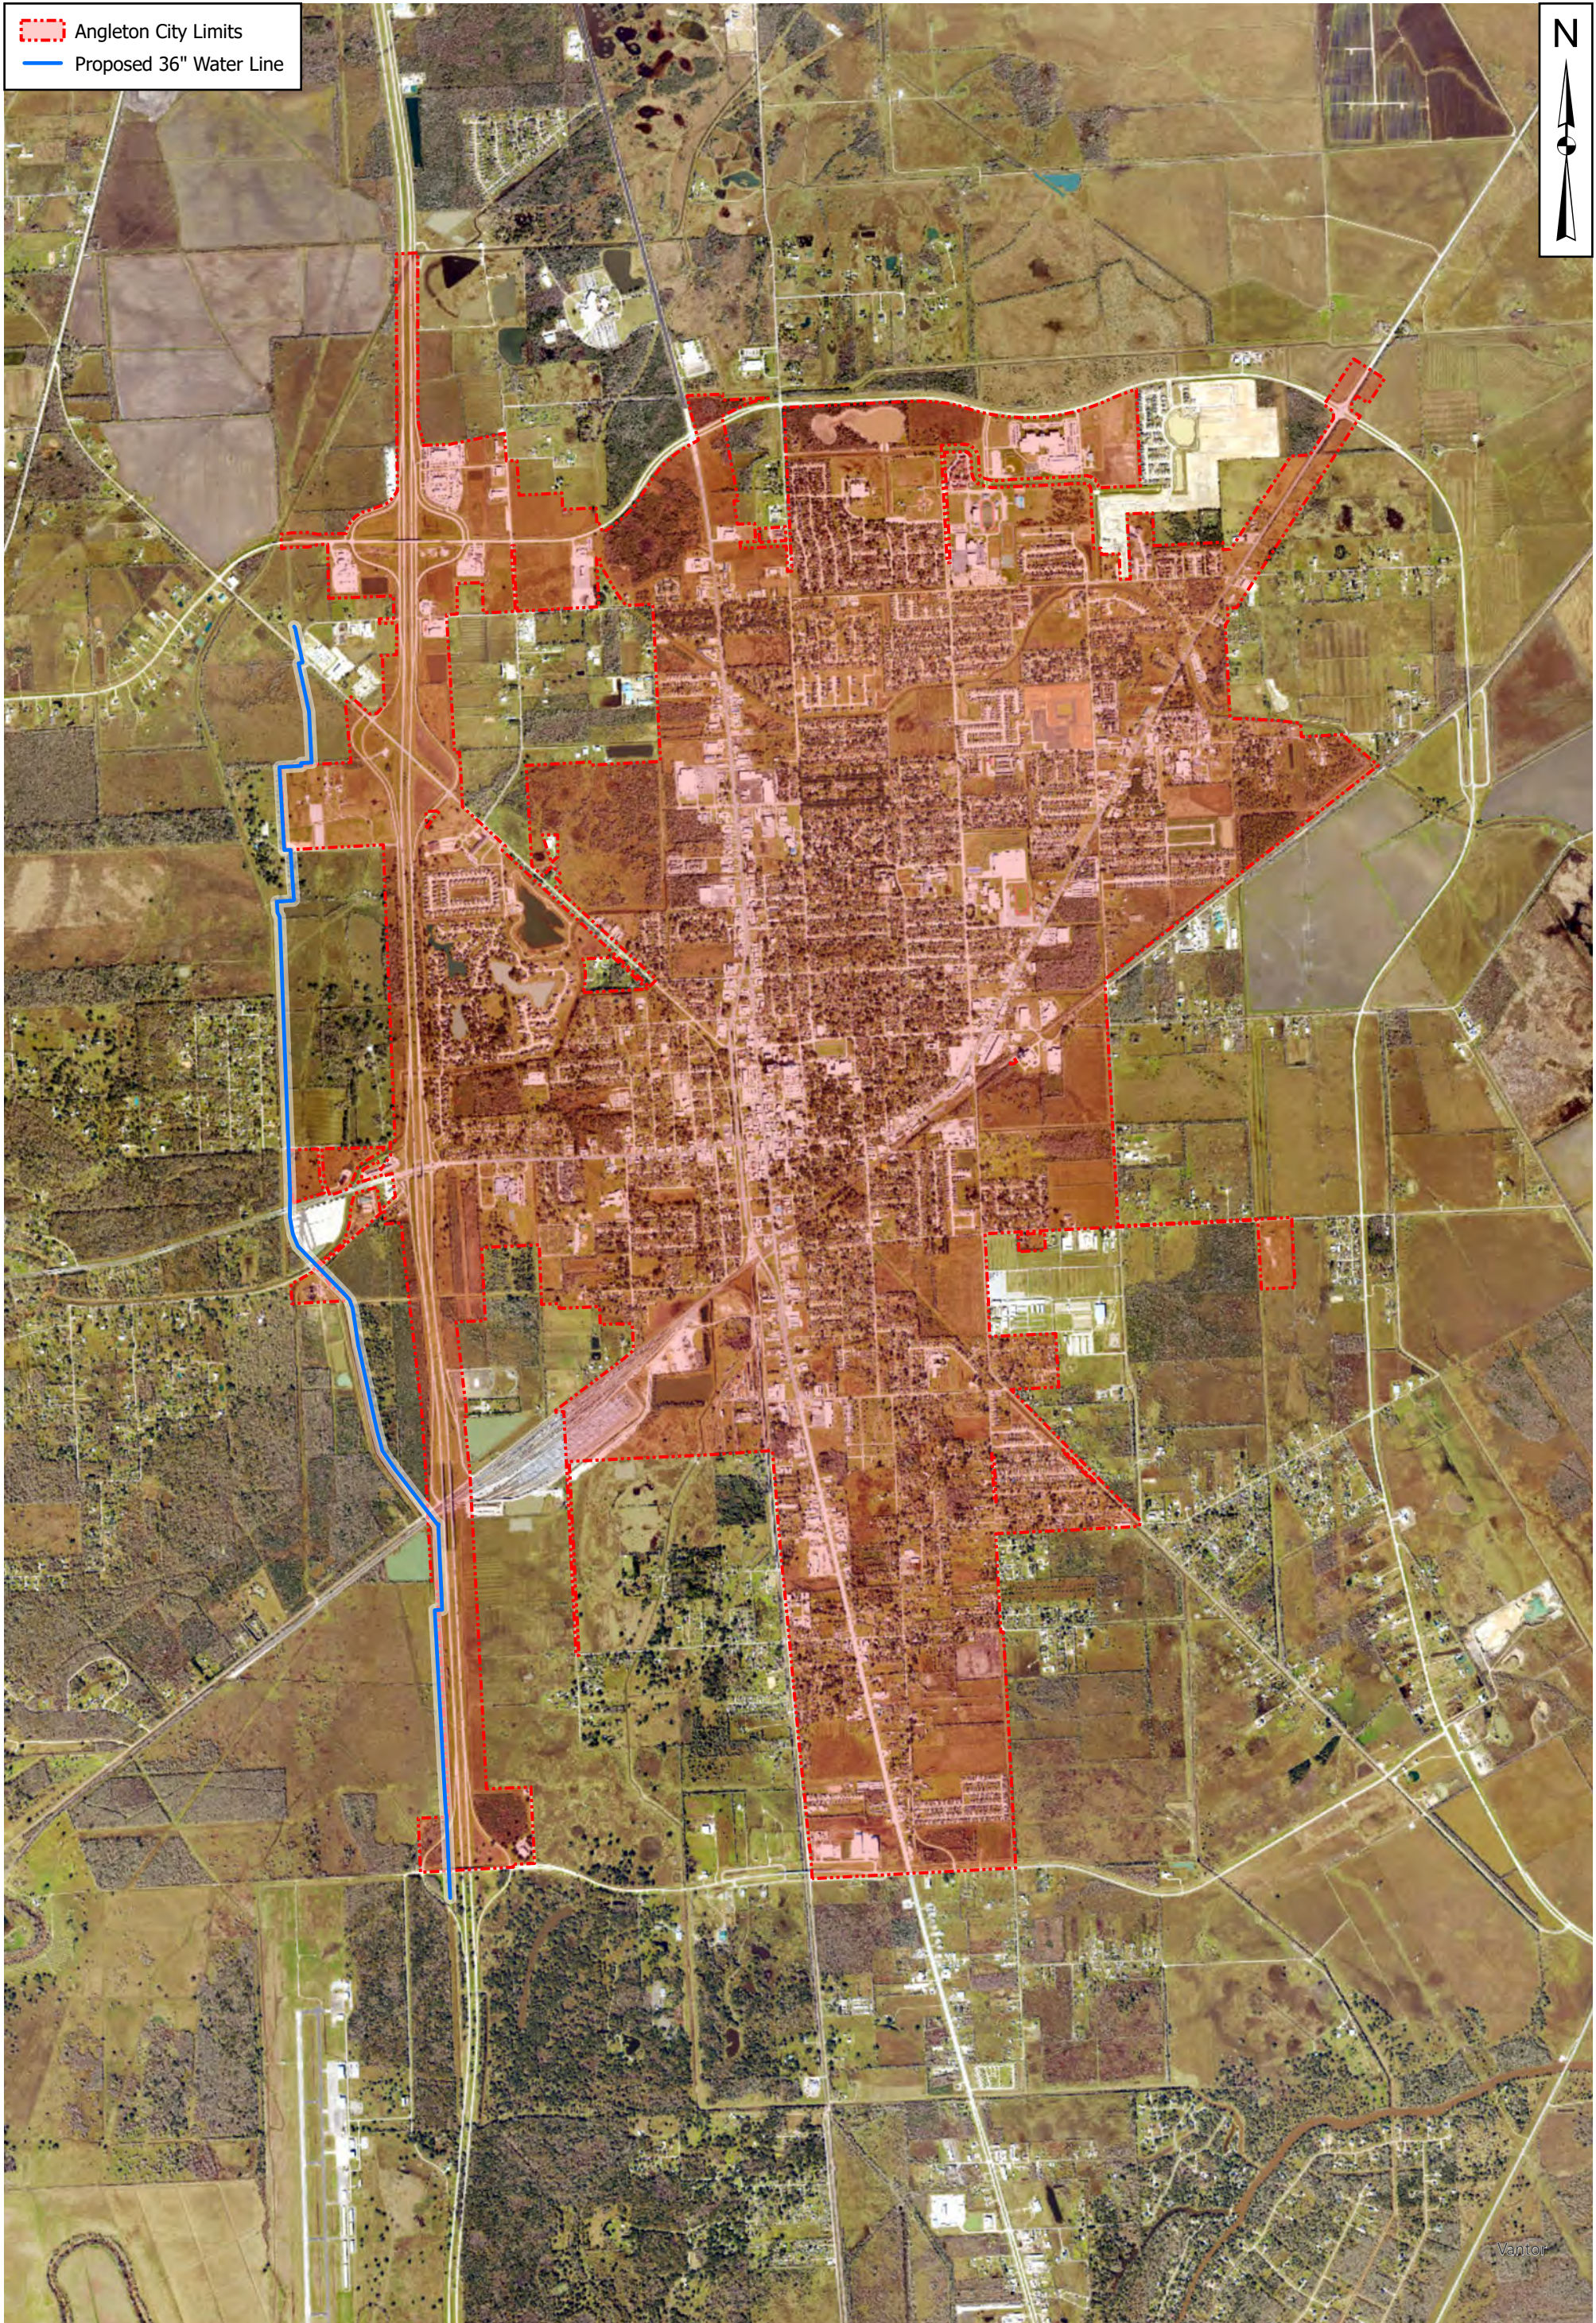

Vantor




PROPOSED 36" WATER LINE
BRAZOSPORT WATER AUTHORITY
OVERVIEW MAP

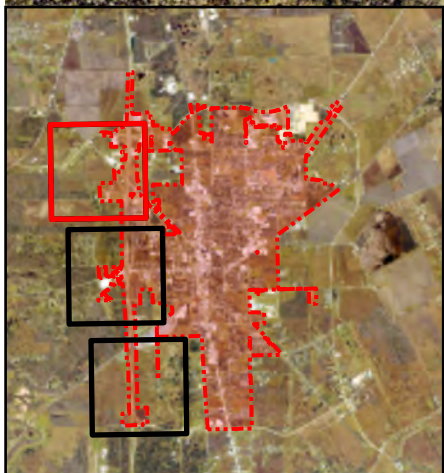


PROPOSED 36" WATER LINE
BRAZOSPORT WATER AUTHORITY
SHEET 1 OF 3

- Angleton City Limits
- Parcels
- Proposed 36" Water Line

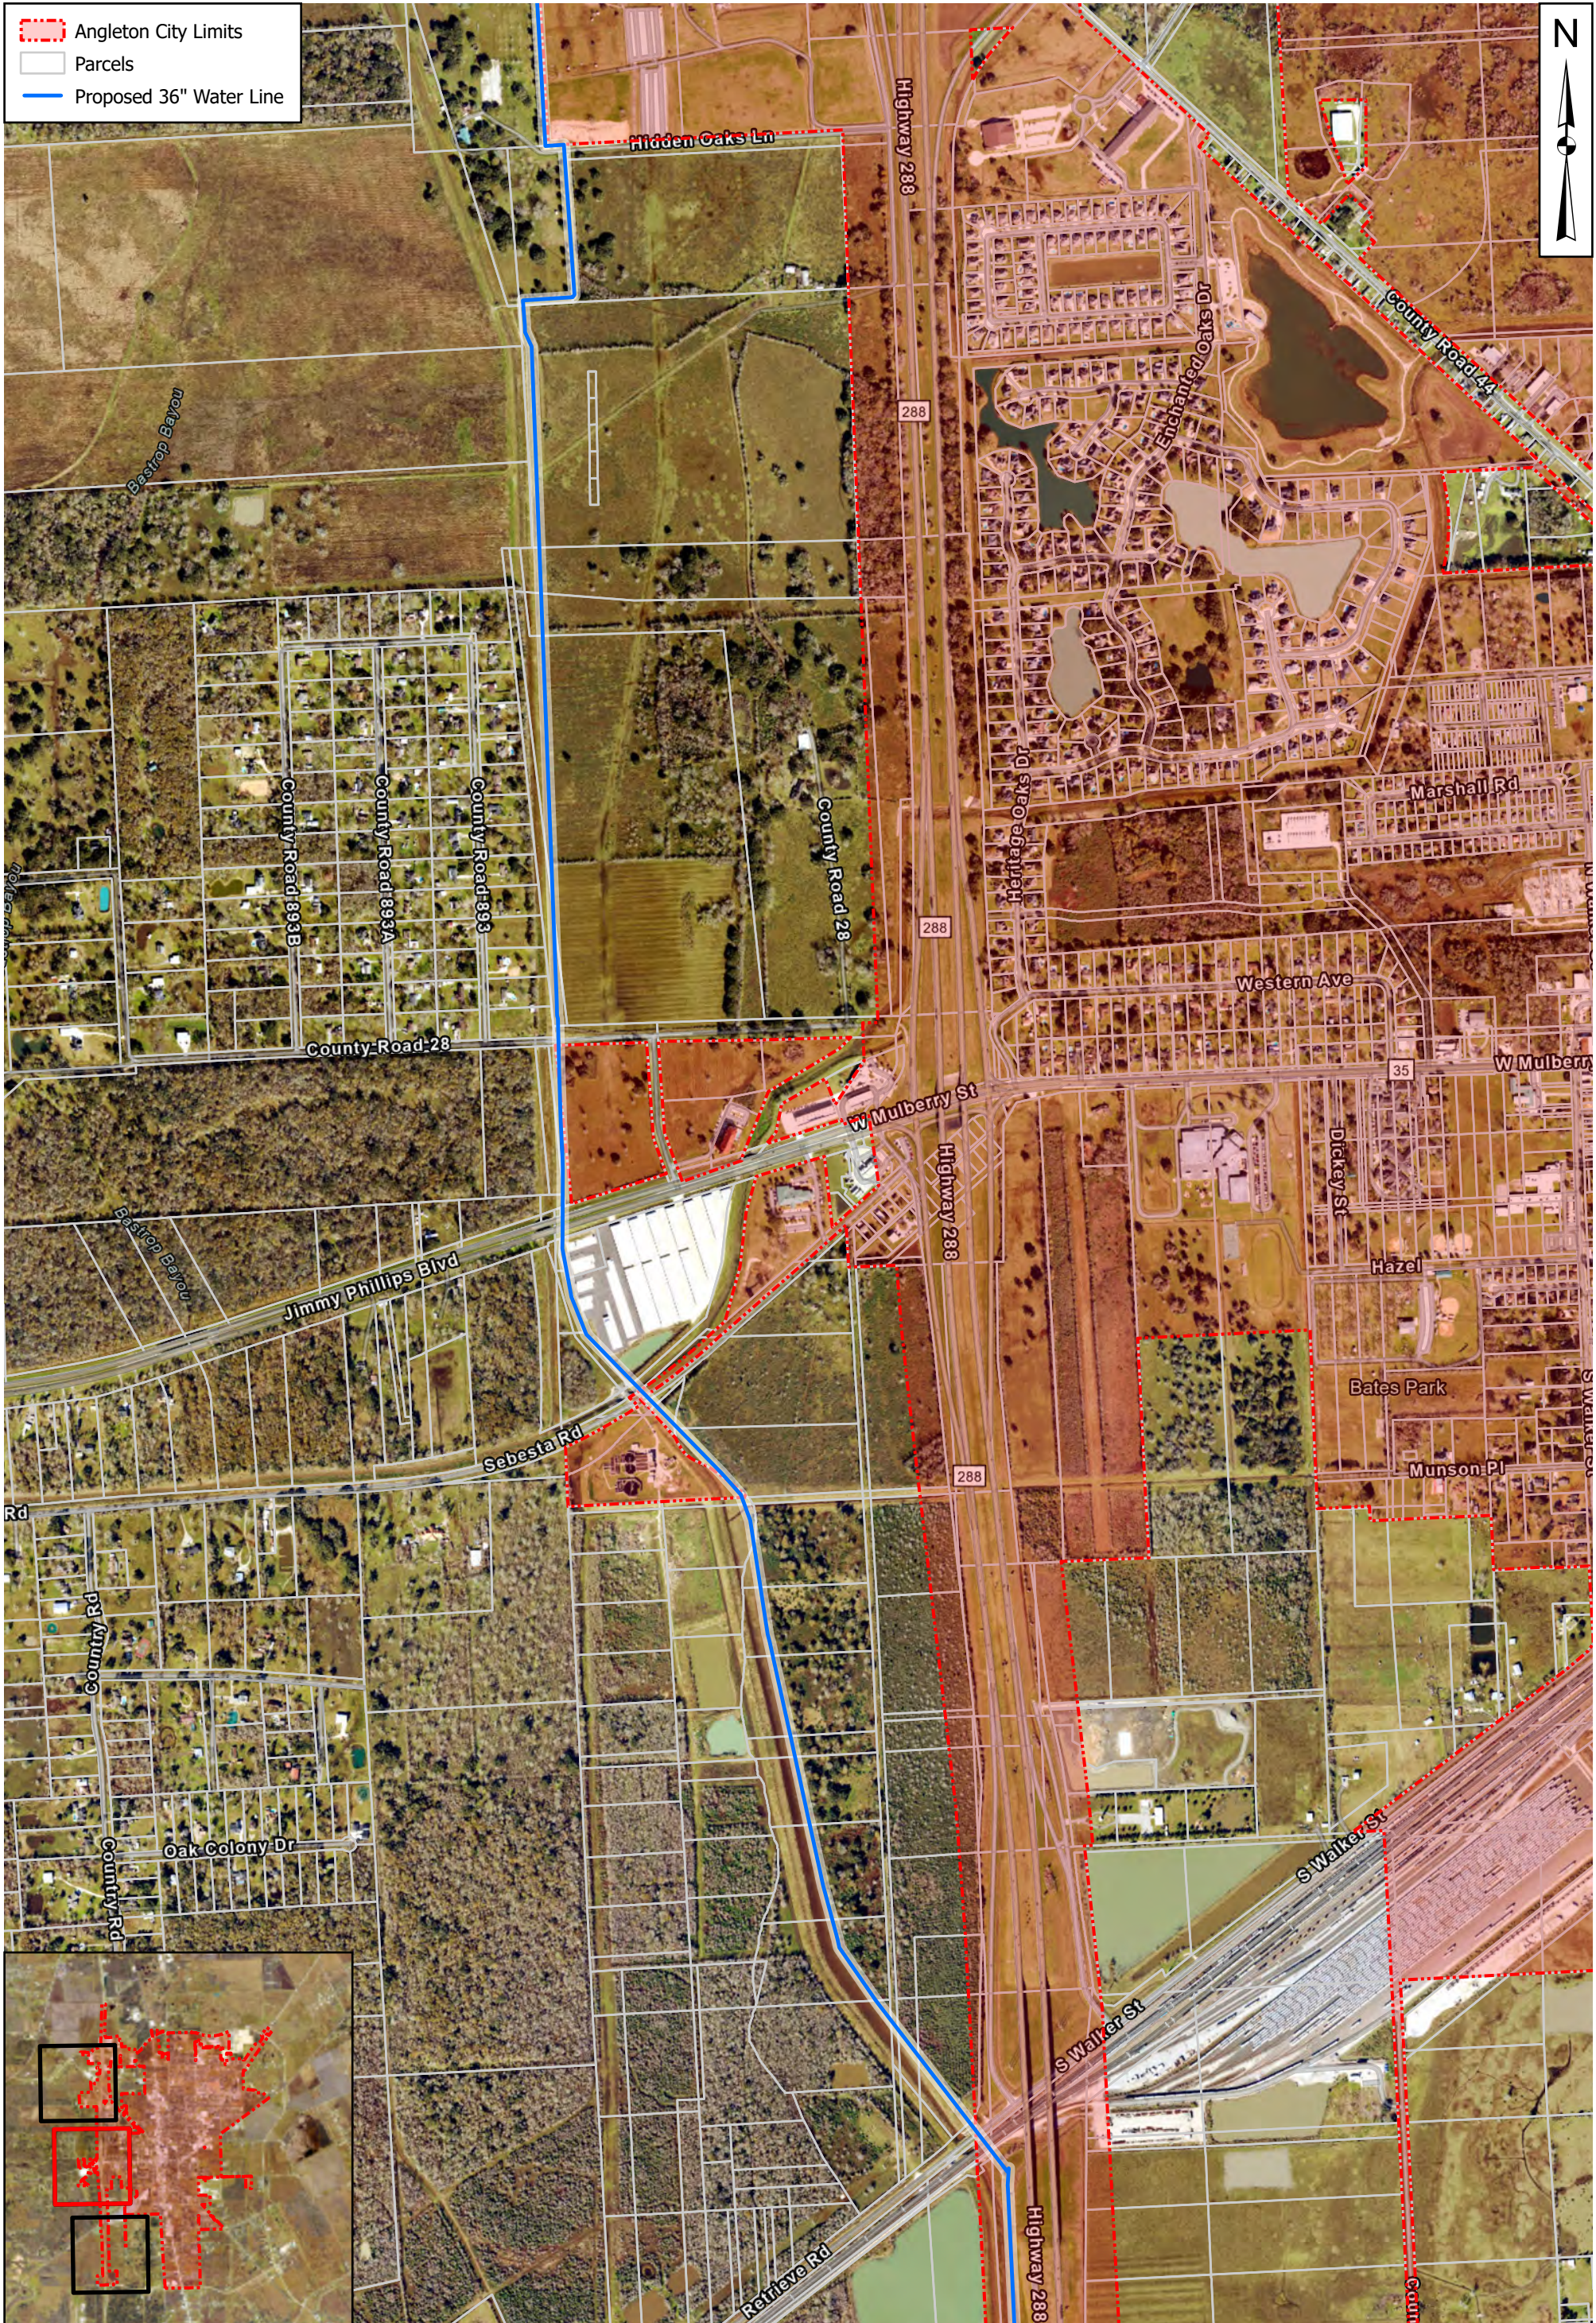

PROPOSED 36" WATER LINE
BRAZOSPORT WATER AUTHORITY
SHEET 2 OF 3

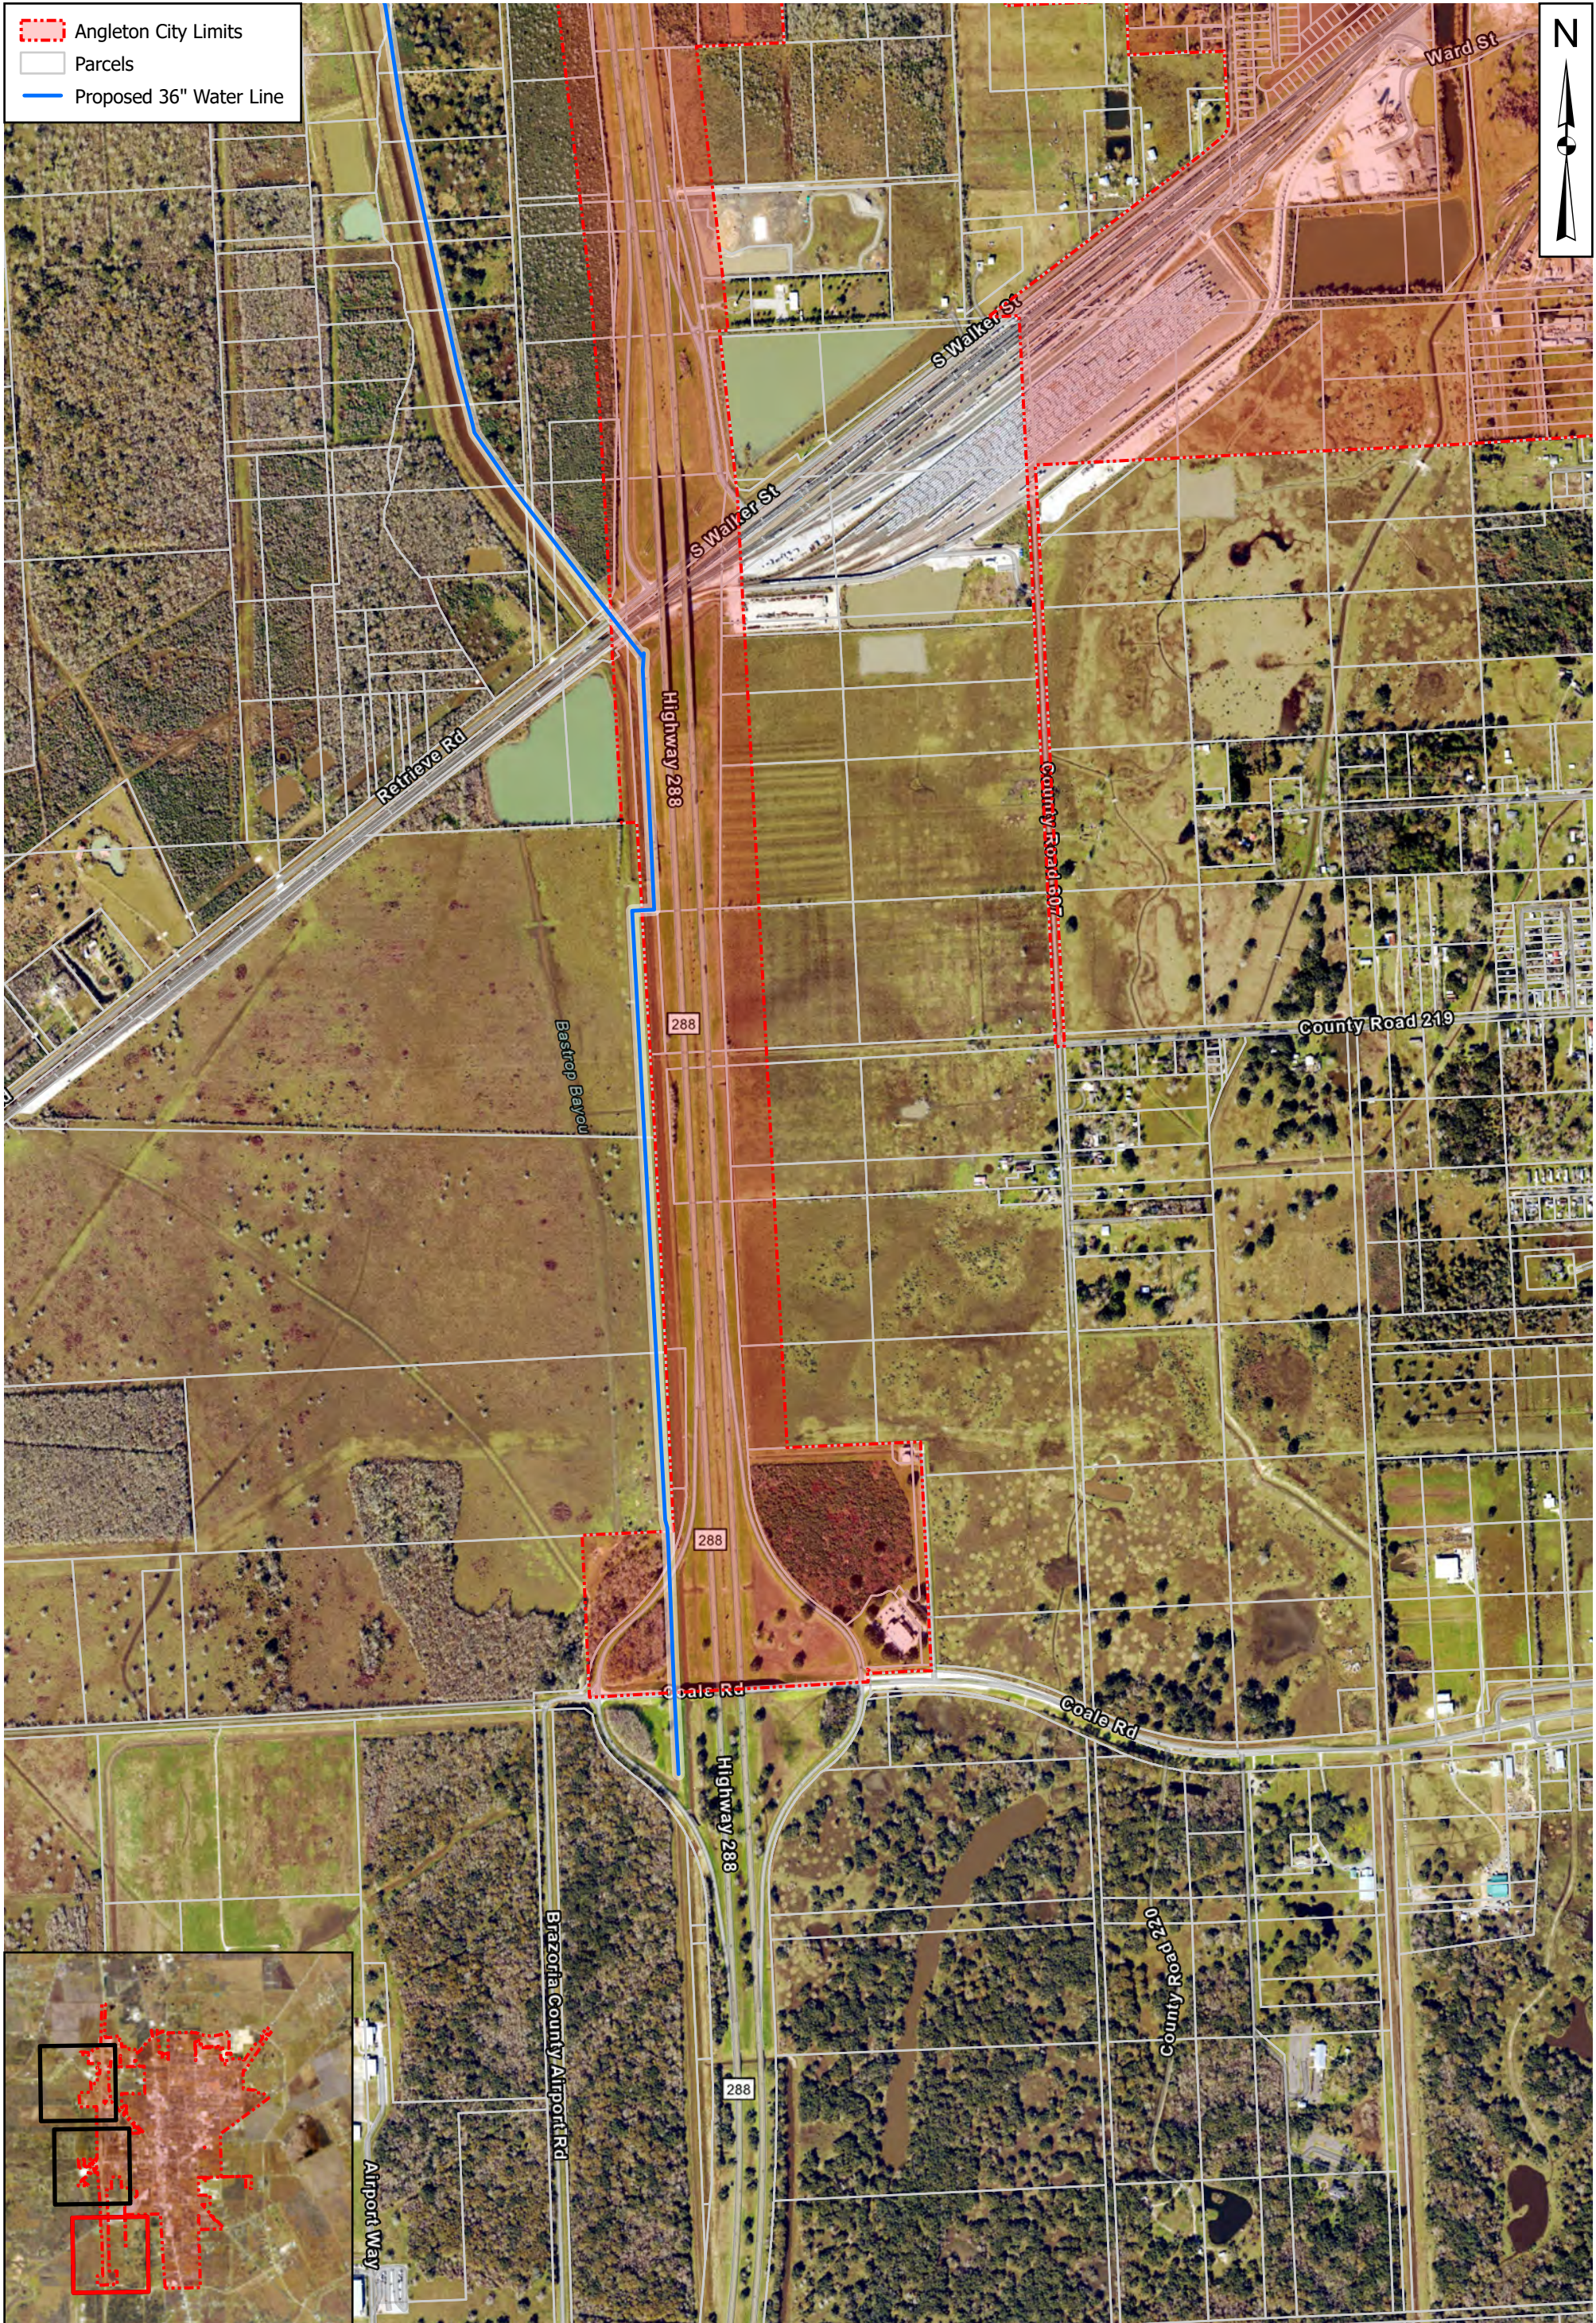

Angleton City Limits
 Parcels
 Proposed 36" Water Line



PROPOSED 36" WATER LINE
BRAZOSPORT WATER AUTHORITY
SHEET 3 OF 3