**HYDRANT.COM** 

Fire Hydrant Inspection Report

Fire Hydrant Inspections 5380 West 34th Street # 214 Houston, Texas 77092 Phone: 281-407-6161

Prepared for: Hector Renteria Director of Public Works



## City of Angleton

Fire Hydrant Pressure Testing, Inspections, and Flushing January, 2025

## CITY OF ANGLETON JANUARY 2025 HYDRANT SAFETY PROJECT SUMMARY **INSPECTIONS, PRESSURE TESTING, AND FLUSHING**

Page 1



The City Angleton has approximately 784 hydrants as of January 2025. The following report reflects 412 hydrant locations. All public hydrants are fire flow tested every 2 years. Fire flow tests were conducted on 396 hydrants gathering static, flow, and residual pressures per NFPA 291 4.5.1. Fire flow tests for determining the available water supply for the design of a water-based protection system per NFPA 291 4.4 were conducted at 26 locations. Test locations and results can be integrated into GIS and used for flow modeling purposes.

Recording static and flow pressures for each hydrant provides a representation of the pressures in the community's water system.

To achieve the maximum points available for the "Frequency of Inspection" per ISO, all fire hydrants must be inspected annually, flushed annually, and subjected to full system pressure during inspection. Each hydrant is assigned an individual ISO Condition Classification\* rating per ISO guidelines. NFPA and AWWA also state that all public hydrants should be inspected, operated, pressure tested, and flushed at least annually.

Hydrants were fully exercised, fully pressurized, and fully flowed to verify the hydrant is safe and currently working. Hydrant testing involved fully opening each hydrant without flowing to notate static pressure and check for leaks. Hydrant was then fully flowed through a 2.5in nozzle and flushed.

All hydrants were flushed at a minimum for 1 minute. Any additional dirty flows were recorded for the duration of the time each hydrant was flushed.

16 Out of Service hydrants were identified and immediately reported to the city.

16 Out of Service hydrants remain as of January 27<sup>th</sup>, 2025.

Static pressures varied throughout the system from 50-69 PSI, and single 2.5in nozzle flow pressures ranged from 4-52 PSI (336-1210 GPM).

The following reports provided allow the City of Angleton to prioritize repairs and remedy issues uncovered during the hydrant project.

## HYDRANT.COM

#### CITY OF ANGLETON JANUARY 2025 HYDRANT SAFETY PROJECT SUMMARY INSPECTIONS, PRESSURE TESTING, AND FLUSHING Page 2

PUPERTY ON THE PUPERT

## 412 Hydrants out of the total 784 hydrants are reflected within the following reports.

#### Sections 1-25

1. Out of Service Hydrants

16 OUT OF SERVICE hydrants located during project were immediately reported to the city.

- 9 hydrants were tagged **OUT OF SERVICE** prior to inspection and were not tested.
- 7 hydrants were tagged OUT OF SERVICE during inspection/testing

16 hydrants remain **OUT OF SERVICE** as of January 27<sup>th</sup>, 2025.

#### 2. Low Pressure Hydrants

(under 20 PSI flow or significantly lower flow than nearby hydrants)

• 8 hydrants

#### 3. Hydrant Valves Which Increase the Possibility of a Water Hammer

• 9 Hydrant valves have issues.

#### 4. Extremely Difficult to Operate

- 22 Hydrants in extreme need of oil or grease to operate properly
  - $\circ$  9 hydrants were unable to fully open

#### 5. General Lubrication

- 72 Hydrants are in general need of lubrication
- 6. Dirty Flow Locations
  - 21 Hydrants flowed dirty over 1 minute.
    6 Hydrants flowed dirty over 5 minutes and were reported to the city.

#### 7. Flange Repairs

- 74 Hydrants
- 8. Inspect/Replace Main Valve
  - 2 Hydrant main valve does not seal properly and is leaking a small amount of water.
- 9. Seized Pumper and/or Hose Caps
  - 23 hydrants have seized pumper and/or hose caps.

#### 10. Pumper and Hose Caps/Nozzles

10 Hydrants need pumper and hose caps/nozzle repairs.

#### **HYDRANT.COM**

### CITY OF ANGLETON JANUARY 2025 HYDRANT SAFETY PROJECT SUMMARY INSPECTIONS, PRESSURE TESTING, AND FLUSHING

Page 3



#### 11. Bonnet Repairs

• 51 Hydrants

#### 12. Hydrant Accessibility

• 8 Hydrants have impediments to their operation and/or accessibility.

#### 13. Extensions Required

• 12 Hydrants need to be raised.

#### 14. Missing Blue Markers

387 blue markers.

#### 15. Chains and S-Hooks

220 Hydrants need chains and/or S-hooks.

#### 16. Hydrants Needing Paint

• 40 Hydrants.

#### 17. Missing/Replace Isolation Valve Cover

9 hydrants need an isolation valve cover.

#### 18. ISO Condition\* Classifications

412 Hydrants are assigned Conditions per ISO guidelines.

\*(Hydrant.com assessed condition of hydrants. Conditions are not assigned by Insurance Services Office).

- 16 Hydrants rated as Not Usable (Hydrants Out of Service).
- 108 Hydrants rated as Usable (hydrants which have some defects, and/or impediments to use).
- 288 Hydrants rated as Standard (no leaks, open easily, are conspicuous and well located for use by pumper).

#### 19. Fire Flow Test Data

• 396 hydrants fire flow tested

#### 20. Testing Available Water Supply In Water-Mains

- 26 tests.
- Reports are provided both numerically and graphically.

#### 21. Make/Model/Year

## **HYDRANT.COM**

#### CITY OF ANGLETON JANUARY 2025 HYDRANT SAFETY PROJECT SUMMARY INSPECTIONS, PRESSURE TESTING, AND FLUSHING

Page 4



#### 22. Estimated Gallons Used to Flow Test Hydrants and Flush Dirty Lines

An estimated 406,691 gallons were used to flow test hydrants and 80,242 additional gallons were used to flush dirty lines. An estimated total of 486,933 gallons were used during the hydrant project.

#### 23. New Hydrant Locations Added During 2025 Project

• 13 new hydrant locations added to the system during 2025 hydrant project

#### 24. Hydrants with GIS/Map Anomalies as of Jan. 2025 Project

26 Hydrants
 \*\*Update GIS

#### 25. Notes Not Associated With Other Reports

#### Files included on USB:

- Access file with 2025 hydrants inspected, flow tested, & flushed
- 2025 Excel file with all hydrant data
- 2025 Hydrant Summary
- 2025 Soft Copy Report

\* Data Hydrant Inc. dba Hydrant.com assessed the condition of hydrants. Conditions are not assigned by ISO (Insurance Services Office).

\*\* Reports require updating maps to reflect current field conditions. Operational conditions of hydrants and test results reflect conditions of the hydrants and system at the time of the inspections/tests.

Data Hydrant Inc. dba Hydrant.com does not guarantee, certify, or imply future pressures or operability of the hydrants at any time before, during, or after tests are conducted.

Data Hydrant Inc. dba Hydrant.com does not guarantee or imply comprehensive inclusion of all hydrant data within the system. While Data Hydrant Inc. strives to provide accurate and reliable data, discrepancies or errors may occur in the data collection, entry, or interpretation stages.

### **HYDRANT.COM**

## TABLE OF CONTENTS JANUARY 2025 CITY OF ANGLETON INSPECTIONS, TESTING, AND FLUSHING



## CATEGORY

## TAB

	1110
OUT OF SERVICE HYDRANTS	1
LOW FLOW PRESSURES	2
HYDRANT VALVES WHICH INCREASE THE POSSIBILITY OF A WATER HAMMER	3
EXTREMELY DIFFICULT TO OPERATE	4
GENERAL LUBRICATION	5
DIRTY FLOW LOCATIONS	6
FLANGE REPAIRS	7
INSPECT/REPLACE MAIN VALVE	8
SEIZED PUMPER AND/OR HOSE CAPS	9
PUMPER AND HOSE CAPS/NOZZLE REPAIRS	10
BONNET REPAIRS	11
HYDRANT ACCESSIBILITY	12
EXTENSIONS REQUIRED	13
MISSING BLUE MARKERS	14
CHAINS & S-HOOKS	15
HYDRANTS NEEDING PAINT	16
MISSING/REPLACE HYDRANT ISOLATION VALVE COVER	17
ISO CONDITION CLASSICIATIONS* (NOT USABLE, USABLE, STANDARD)	18
FIRE FLOW TEST DATA	19
TESTING AVAILABLE WATER SUPPLY IN WATER MAINS	20
MAKE, MODEL, & YEAR	21
ESTIMATED GALLONS USED TO FLOW TEST HYDRANTS AND FLUSH LINES	22
NEW LOCATIONS ADDED DURING JAN. 2025 PROJECT	23
HYDRANTS WITH GIS/MAP ANOMALIES AS OF JAN. 2025	24
NOTES NOT ASSOCIATED WITH OTHER REPORTS	25

Fire Hydrant Inspections 5380 West #34th Street #214 Houston, Texas 77092 All fire hydrants should be inspected, operated, and flushed at least annually.

# **1. OUT OF SERVICE HYDRANTS**

## **Fire Hydrants Out of Service**

30-Jan-25

HYDRANT	MAKE	MODEL	YEAR	NOTES/LOCATION
43	MUELLER	CENTURION	2024	CITY TAGGED HYDRANT OUT OF SERVICE - NOT TESTED
				ACROSS FROM 103 W MUNSON ST
547	MUELLER	IMPROVED	1953	CITY TAGGED HYDRANT OUT OF SERVICE - NOT TESTED
				NORTHWEST CORNER OF E MAGNOLIA ST AND N ANDERSON ST
53	MUELLER	IMPROVED	1976	CITY TAGGED HYDRANT OUT OF SERVICE - NOT TESTED
				NORTHEAST CORNER OF W PLUM ST AND S ERSKINE ST
156	MUELLER	CENTURION	1981	CITY TAGGED HYDRANT OUT OF SERVICE - NOT TESTED
				2609 S VELASCO ST
513	MUELLER	IMPROVED	1972	CITY TAGGED HYDRANT OUT OF SERVICE - NOT TESTED
				NORTHWEST CORNER OF N VALDERAS ST AND MILLER ST
407	MUELLER	IMPROVED	1974	CITY TAGGED HYDRANT OUT OF SERVICE - NOT TESTED
				1524 E MULBERRY ST - NORTH SIDE OF BUILDING
480	MUELLER	IMPROVED	1975	CITY TAGGED HYDRANT OUT OF SERVICE - NOT TESTED
				NORTHWEST CORNER OF N DOWNING AN E MILLER
305	MUELLER	CENTURION		CITY TAGGED HYDRANT OUT OF SERVICE - NOT TESTED
				237 BASTROP ST
582	MUELLER	CENTURION	2005	CITY TAGGED HYDRANT OUT OF SERVICE - NOT TESTED
				NORTHEAST CORNER OF E ORANGE ST AND S ANDERSON ST
264	MUELLER	CENTURION	1970	HYDRANT IS PRESSURIZED - OP NUT SPINS FREELY
				NORTHEAST CORNER OF S FRONT AND CEMETERY RD
176	MUELLER	CENTURION	1987	HYDRANT IS PRESSURIZED & WILL NOT SHUT DOWN - UNABLE TO SAFELY REMOVE HOSE CAPS
				ACROSS FROM 725 CAHILL RD

Operational conditions of hydrants and test results reflect conditions of the hydrants and system at the time of the inspections/tests. Data Hydrant Inc. dba Hydrant.com does not guarantee, certify, or imply future pressures or operability of the hydrants at any time before, during, or after tests are conducted.

Page 1 of 2

**CITY OF ANGLETON** 

## **Fire Hydrants Out of Service**

30-Jan-25

HYDRANT	MAKE	MODEL	YEAR	NOTES/LOCATION
929	MUELLER	CENTURION	2023	NO WATER AVAILABLE WHEN HYDRANT IS FULLY OPEN
				1320 E KIBER ST
140	MUELLER	IMPROVED	1946	NO WATER AVAILABLE WHEN HYDRANT IS FULLY OPEN
				NORTHWEST CORNER OF SIMS AND E KIBER ST
580	WATEROUS	PACER	1927	OP NUT SEIZED
				NORTHEAST CORNER OF S ARCOLA ST AND E ORANGE ST
194	MUELLER	CENTURION	1978	OP NUT SEIZED
				1000 KADERA RD
570	WATEROUS	PACER	1927	OP NUT SEIZED AND HYDRANT IS PRESSURIZED
				SOUTHWEST CORNER OF S CHENANGO ST AND MURRAY ST

Total: 16

GENERATE INDIVIDUAL WORK ORDERS FOR THESE HYDRANTS

Operational conditions of hydrants and test results reflect conditions of the hydrants and system at the time of the inspections/tests. Data Hydrant Inc. dba Hydrant.com does not guarantee, certify, or imply future pressures or operability of the hydrants at any time before, during, or after tests are conducted.

Page 2 of 2

# 2. LOW FLOW PRESSURES

## Low Flow Pressures

View Associated Work Orders

#### FLOW PRESSURE FROM 2.5IN HOSE NOZZLE IS UNDER 20 PSI (750 GPM) OR SIGNIFICANTLY LOWER THAN NEARBY HYDRANTS

29-Jan-25

HYDRANT	MAIN SIZE	STATIC PSI	FLOW PSI	HOSE GPM	LOCATION NOTES
555	8 INCH	58	4	336	ACROSS FROM 500 N CHENANGO
556		60	5	375	111 E LOCUS ST - NEXT TO NO PARKING SIGN
2	6 INCH	56	6	411	913 WESTERN AVE ONLY ABLE TO OPEN HYDRANT 1 ROUND
153		60	15	650	2816 S VELASCO ST
					ONLY ABLE TO OPEN HYDRANT 2 ROUNDS
578		55	15	650	234 S ARCOLA ST
579		56	15	650	504 E PEACH ST
157		58	16	671	2521 S VELASCO
					ONLY ABLE TO OPEN HYDRANT 2 ROUNDS
284	12 INCH	60	20	750	2760 BRAZOS PKWY - SOUTH EAST SIDE OF PROPERTY

Total: 8

Page 1 of 1

# 3. HYDRANT VALVES WHICH INCREASE THE POSSIBILITY OF A WATER HAMMER

## Hydrant Valves Which Increase The Possibility of a Water Hammer

```
29-Jan-25
```

\*\*These hydrant main valves issues prevent proper operation of hydrant and may increase the possibility of a water hammer\*\* View Associated Work Orders

HYDRANT	MAKE	MODEL	YEAR	LOCATION	HYDRANT VALVE SLAMS SHUT	REDUCED FLOW PRESSURE TO SHU DOWN HYDRANT	
75	MUELLER	CENTURION	1981	629 W LOCUS ST	Х		
38	MUELLER	CENTURION	1981	504 BRYAN ST	Х		
269	MUELLER	CENTURION	1981	1203 S FRONT ST	Х		
201	MUELLER	CENTURION	1976	1200 GIFFORD RD	Х		
908	MUELLER	CENTURION	2021	201 LAURA LEIGH LN	Х		
905	MUELLER	CENTURION	1983	820 S ANDERSON ST	Х		
305	MUELLER	CENTURION		237 BASTROP ST	Х		
640	MUELLER	CENTURION	2014	901 ROBINHOOD LN	Х		
560	WATEROUS		1927	126 N VELASCO ST		Х	
					VALVES THAT SLAM SHUT:	REDUCED FLOW PRESSURE TO CLOSE VALVE:	HYDRANTS NEEDING 4+ REVOLUTIONS TO PRESSURIZE:
		Total	Hydran	ıts: 9	8	1	0

Page 1 of 1

**CITY OF ANGLETON** 

# 4. EXTREMELY DIFFICULT TO OPERATE

#### 30-Jan-25

## **Extremely Difficult to Operate**

View Associated Work Orders

HYDRANT	MAKE	MODEL	YEAR	LOCATION NOTES	LUBE OP NUT
570	WATEROUS	PACER	1927	SOUTHWEST CORNER OF S CHENANGO ST AND MURRAY ST OP NUT SEIZED AND HYDRANT IS PRESSURIZED	Х
194	MUELLER	CENTURION	1978	1000 KADERA RD OP NUT SEIZED	Х
580	WATEROUS	PACER	1927	NORTHEAST CORNER OF S ARCOLA ST AND E ORANGE ST OP NUT SEIZED	х
28	MUELLER	CENTURION	2007	2400 W MULBERRY ST ONLY ABLE TO OPEN HYDRANT 6 ROUNDS	Х
544	MUELLER	CENTURION	2002	445 E MULBERRY ST ONLY ABLE TO OPEN HYDRANT 6 ROUNDS	х
203	MUELLER	CENTURION	1980	16 GRACE ST ONLY ABLE TO OPEN HYDRANT 5 ROUNDS	Х
149	MUELLER	CENTURION	1981	SOUTH INTERSECTION OF BEECHNUT ST AND CHESTNUT ST ONLY ABLE TO OPEN HYDRANT 4 ROUNDS	х
231	MUELLER	CENTURION	1983	SOUTHWEST CORNER OF DWYER ST AND S ANDERSON ST ONLY ABLE TO OPEN HYDRANT 4 ROUNDS	Х
110	MUELLER	CENTURION	1982	109 E KIBER ST ONLY ABLE TO OPEN HYDRANT 2 ROUNDS	х
153	MUELLER	CENTURION	1981	2816 S VELASCO ST ONLY ABLE TO OPEN HYDRANT 2 ROUNDS	Х

GENERATE INDIVIDUAL WORK ORDERS FOR THESE HYDRANTS

CITY OF ANGLETON

Page 1 of 3

#### 30-Jan-25

## **Extremely Difficult to Operate**

View Associated Work Orders

HYDRANT	MAKE	MODEL	YEAR	LOCATION NOTES	LUBE OP NUT
157	MUELLER	CENTURION	1981	2521 S VELASCO	Х
				ONLY ABLE TO OPEN HYDRANT 2 ROUNDS	
2	MUELLER	IMPROVED	1957	913 WESTERN AVE	Х
				ONLY ABLE TO OPEN HYDRANT 1 ROUND	
1	MUELLER	IMPROVED	1962	1105 WESTERN AVE	Х
13	MUELLER	CENTURION	2003	1 OAK PARK DR	Х
201	MUELLER	CENTURION	1976	1200 GIFFORD RD	Х
269	MUELLER	CENTURION	1981	1203 S FRONT ST	Х
276	MUELLER	CENTURION	1981	173 WEST PHILLIPS	х
553	MUELLER	CENTURION	2012	SOUTHEAST CORNER OF E CEDAR ST AND N VALDERAS ST	Х
66	MUELLER	CENTURION	1981	18 T J WRIGHT ST	х
67	MUELLER	CENTURION	1981	612 T J WRIGHT ST	Х

Page 2 of 3

**CITY OF ANGLETON** 

## **Extremely Difficult to Operate**

View Associated Work Orders

HYDRANT	MAKE	MODEL	YEAR	LOCATION NOTES	LUBE OP NUT
71	MUELLER	IMPROVED	1946	SOUTHEAST CORNER OF N COLUMBUS ST AND W LIVE OAK ST	Х
78	MUELLER	STANDARD	1957	700 W LIVE OAK ST	Х

Total: 22

Page 3 of 3

**CITY OF ANGLETON** 

# 5. GENERAL LUBRICATION

HYDRANT	MAKE	HYDRANT LOCATION	ADD OIL	ADD GREASE	LUBE NOZZLES
118	MUELLER	712 S ANDERSON ST			X
119	MUELLER	SW CORNER OF S ANDERSON ST AND RICE ST	X		
127	MUELLER	620 E PLUM ST			X
128	MUELLER	621E MURRAY ST		X	X
129	MUELLER	600 EARLS CT		X	
16	MUELLER	1116 W MULBERRY ST			X
161	MUELLER	2123 S VELASCO ST			Х
167	MUELLER	1725 S VELASCO ST			X
169	MUELLER	1423 S VELASCO ST			X
172	MUELLER	ACROSS FROM 105 CEMETERY RD		X	
183	MUELLER	1712 SHANKS RD			X
188	MUELLER	2600 SHANKS RD	X		
189	MUELLER	ACROSS FROM 2615 SHANKS RD			Х
190	MUELLER	2412 SHANKS RD			X
201	MUELLER	1200 GIFFORD RD	Х		Х

HYDRANT	MAKE	HYDRANT LOCATION	ADD OIL	ADD GREASE	LUBE NOZZLES
204	MUELLER	238 E PHILLIPS RD			Х
21	MUELLER	305 W PEACH ST	X		X
211	CLOW	1301 GIFFORD LN			X
212	CLOW	1325 GIFFORD LN			X
218	MUELLER	137 BALD PRAIRIE DR			Х
222	MUELLER	137 PRAIRIE LEA DR			Х
227	MUELLER	NORTHWEST CORNER OF CEMETERY RD AND PARK LN	X		
230	MUELLER	328 CEMETERY RD - ACROSS FROM FLAG DISPOSAL BOX	X		
235	MUELLER	SOUTHWEST CORNER OF E KIBER ST AND S VELASCO	X		х
266	MUELLER	SOUTHWEST CORNER OF S FRONT ST AND WAYNE DR			Х
279	MUELLER	217 WALLER LOOP	X		
283	MUELLER	ACROSS FROM 2609 S FRONT ST	X		
284	MUELLER	2760 BRAZOS PKWY - SOUTH EAST SIDE OF PROPERTY			X
285	MUELLER	2760 BRAZOS PKWY - NORTH SIDE OF PROPERTY	X		
287	MUELLER	1034 S VELASCO ST	X		X

HYDRANT	MAKE	HYDRANT LOCATION	ADD OIL	ADD GREASE	LUBE NOZZLES
291	MUELLER	1212 S VELASCO ST	X		X
292	MUELLER	1404 S VELASCO ST			X
293	MUELLER	288 S VELASCO ST - UNIT B			X
296	MUELLER	145 W PHILLIPS ST	X		
297	MUELLER	SOUTHWEST CORNER OF W PHILLIPS AND S VELASCO ST			X
300	MUELLER	20799 COUNTY RD 171 - NEXT TO SIGN	X		
309	MUELLER	172 HOUSTON ST		Х	
312	CLOW	SOUTHEAST CORNER OF JAMISON RD AND E MULBERRY ST			X
314	MUELLER	108 KNIGHT DR	X		
321	MUELLER	132 E HOSPITAL DR			X
327	MUELLER	224 E HOSPITAL DR		х	
328	MUELLER	2700 TX-35			X
37	MUELLER	520 BRYAN ST	X		
39	MUELLER	726 S ERSKINE ST			X
4	MUELLER	NORTHWEST CORNER OF HERITAGE OAKS DR AND WESTERN AVE	X		

HYDRANT	MAKE	HYDRANT LOCATION	ADD OIL	ADD GREASE	LUBE NOZZLES
40	MUELLER	624 S HANCOCK ST	X		X
403	MUELLER	SOUTHWEST CORNER OF CEDAR ST AND E MULBERRY ST			X
404	MUELLER	SOUTH INTERSECTION OF E CEDAR ST AND E MIMOSA ST			X
41	MUELLER	222 W MUNSON ST	Х		
42	MUELLER	NORTHEAST CORNER OF S FRONT ST AND W MUNSON ST			X
44	MUELLER	600 S HANCOCK ST	х		
45	MUELLER	ACROSS FROM 700 S WALKER ST			Х
46	MUELLER	727 S WALKER ST	Х		
50	MUELLER	500 CATALPA ST	x		
535	MUELLER	600 E CEDAR ST			X
54	MUELLER	220 W ORANGE ST			X
555	MUELLER	ACROSS FROM 500 N CHENANGO			X
562	MUELLER	100 N VELASCO ST	Х		
564	MUELLER	NORTHEAST CORNER OF W MYRTLE ST AND N FRONT ST			X
565	MUELLER	SOUTHEAST CORNER OF W MAGNOLIA ST AND N FRONT ST			X

HYDRANT	MAKE	HYDRANT LOCATION	ADD OI	L ADD GREASE	LUBE NOZZLES
58	MUELLER	SOUTHWEST CORNER OF W MULBERRY AND COLUMBIA ST	) S	Х	
61	MUELLER	SOUTHEAST CORNER OF W MYRTLE ST AND WRIGHT ST	ΤJ	х	
63	MUELLER	324 W MAGNOLIA ST			X
634	MUELLER	1317 LAUREL LOOP			X
64	MUELLER	NORTHEAST CORNER OF T J WRIGHT ST ANI LOCUS ST	) W		X
648	MUELLER	1117 ROBINHOOD LN			X
649	MUELLER	608 HERITAGE OAKS DR	Х		
7	MUELLER	ACROSS FROM 904 HERITAGE OAKS DR	Х		
714	MUELLER	ACROSS FROM 409 N PARISH ST	Х		
75	MUELLER	629 W LOCUS ST			X
76	MUELLER	705 N COLUMBIA ST	X		
9	CLOW	ACROSS FROM 1007 SPREADING OAKS DR			Х
	HYDRANTS:	72	1000050	O OILADD GREASE277	LUBE NOZZLES 45

# 6. DIRTY FLOW LOCATIONS

**CITY OF ANGLETON** 

# **Dirty Flow Locations**

**View Associated Work Orders** 

29-Jan-25

#### HYDRANTS WERE FLUSHED UP TO 5 MINUTES.

#### **RECOMMENDED TO FLUSH REGULARLY AND MONITOR DIRTY WATER**

HYDRANT ADD	DITIONAL MINUTES FLOWED	LOCATION
308	5	128 HOUSTON ST
559	5	300 N VELASCO ST
560	5	126 N VELASCO ST
562	5	100 N VELASCO ST
569	5	NORTHEAST CORNER OF W PEACH ST AND S FRONT ST
576	5	NORTHEAST CORNER OF HWY 288 BUSINESS AND E ORANGE ST
210	4	NORTHEAST CORNER OF SUNNY MEADOWS AND GIFFORD RD
214	4	1516 GIFFORD LN
22	4	ACROSS FROM 300 S WALKER ST
223	4	205 PRAIRIE LEA DR
321	4	132 E HOSPITAL DR
573	4	103 E PEACH ST
579	4	504 E PEACH ST
133	3	408 EVANS ST
221	3	101 PRAIRIE LEA DR
27	3	2304 W MULBERRY ST
35	3	1020 HERITAGE OAKS DR
56	3	600 W PEACH ST
151	2	2288 S VELASCO ST
571	2	421 S VELASCO ST
920	2	1013 CHEVY CHASE DR

Total: 21

# 7. FLANGE REPAIRS

View Associated Work Orders

29-Jan-25

#### HYDRANTS REQUIRING A FLANGE GASKET AND/OR MULTIPLE FLANGE BOLTS ARE MORE LIKELY TO FAIL IN THE FUTURE

HYDRANT	MAKE	MODEL	YEAR	LOCATION	FLANGE	BOLTS	GASKET
135	MUELLER	CENTURION	1986	1380 E KIBER ST		3	1
276	MUELLER	CENTURION	1981	173 WEST PHILLIPS			1
553	MUELLER	CENTURION	2012	SOUTHEAST CORNER OF E CEDAR ST AND N VALDERAS ST			1
309	MUELLER	IMPROVED	1966	172 HOUSTON ST		8	
579	MUELLER	IMPROVED	1960	504 E PEACH ST		8	
21	MUELLER	CENTURION	1983	305 W PEACH ST		8	
132	MUELLER	IMPROVED	1951	NORTHEAST INTERSECTION OF E KIBER ST AND FARRER ST		8	
279	MUELLER	CENTURION	1992	217 WALLER LOOP		8	
80	MUELLER	CENTURION	1976	828 W LIVE OAK ST		8	
79	MUELLER	CENTURION	1980	819 MARSHALL RD		8	
221	MUELLER	CENTURION	1983	101 PRAIRIE LEA DR		8	
76	MUELLER	CENTURION	2006	705 N COLUMBIA ST		8	

Page 1 of 6

**CITY OF ANGLETON** 

View Associated Work Orders

29-Jan-25

#### HYDRANTS REQUIRING A FLANGE GASKET AND/OR MULTIPLE FLANGE BOLTS ARE MORE LIKELY TO FAIL IN THE FUTURE

HYDRANT	MAKE	MODEL	YEAR	LOCATION	FLANGE	BOLTS	GASKET
222	MUELLER	CENTURION	1983	137 PRAIRIE LEA DR		8	
65	MUELLER	IMPROVED	1946	NORTHWEST CORNER OF N HANCOCK ST AND W LIVE OAK ST		8	
78	MUELLER	STANDARD	1957	700 W LIVE OAK ST		8	
318	MUELLER	CENTURION	1984	108 DEBORAH DR		8	
219	MUELLER	CENTURION	1983	205 BALD PRAIRIE DR		8	
119	MUELLER	CENTURION	1983	SW CORNER OF S ANDERSON ST AND RICE ST		8	
905	MUELLER	CENTURION	1983	820 S ANDERSON ST		8	
223	MUELLER	CENTURION	1983	205 PRAIRIE LEA DR		8	
554	MUELLER	IMPROVED	1946	131 E LIVE OAK ST		7	
220	MUELLER	CENTURION	1983	245 BALD PRARIE DR		7	
34	MUELLER	CENTURION	2003	1009 ENCHANTED OAKS DR		7	
11	CLOW	MEDALLION	2000	800 ENCHANTED OAKS DR		6	
3	MUELLER	IMPROVED	1957	801 WESTERN AVE		6	

Page 2 of 6

**CITY OF ANGLETON** 

View Associated Work Orders

29-Jan-25

#### HYDRANTS REQUIRING A FLANGE GASKET AND/OR MULTIPLE FLANGE BOLTS ARE MORE LIKELY TO FAIL IN THE FUTURE

HYDRANT	MAKE	MODEL	YEAR	LOCATION	FLANGE	BOLTS	GASKET
532	MUELLER	IMPROVED	1957	501 N PECAN ST		6	
573	MUELLER	IMPROVED	1956	103 E PEACH ST		6	
278	MUELLER	CENTURION	1992	111 WALLER LOOP		5	
196	MUELLER	CENTURION	1980	824 KADERA		5	
23	MUELLER	IMPROVED	1953	629 HOLLY ST		5	
72	MUELLER	IMPROVED	1946	300 N COLUMBIA ST		5	
303	MUELLER	CENTURION	1976	276 AUSTIN ST		5	
564	MUELLER	CENTURION	1998	NORTHEAST CORNER OF W MYRTLE ST AND N FRONT ST		5	
534	MUELLER	CENTURION	1994	804 CINCINNATI		5	
20	MUELLER	CENTURION	1983	202 S WALKER ST		5	
203	MUELLER	CENTURION	1980	16 GRACE ST		4	
120	MUELLER	CENTURION	1990	1011 S ANDERSON ST		4	
150	MUELLER	CENTURION	1981	97 LOSTROCCO ST		4	

Page 3 of 6

**CITY OF ANGLETON** 

View Associated Work Orders

29-Jan-25

#### HYDRANTS REQUIRING A FLANGE GASKET AND/OR MULTIPLE FLANGE BOLTS ARE MORE LIKELY TO FAIL IN THE FUTURE

HYDRANT	MAKE	MODEL	YEAR	LOCATION	FLANGE	BOLTS	GASKET
327	MUELLER	IMPROVED	1966	224 E HOSPITAL DR		4	
204	MUELLER	CENTURION	1981	238 E PHILLIPS RD		4	
547	MUELLER	IMPROVED	1953	NORTHWEST CORNER OF E MAGNOLIA ST AND N ANDERSON ST		4	
112	MUELLER	IMPROVED	1964	321 SANDS ST		4	
474	MUELLER	IMPROVED	1975	1200 CHEVY CHASE DR		3	
134	MUELLER	IMPROVED	1962	901 S DOWNING RD		3	
139	MUELLER	IMPROVED	1953	NORTHEAST INTERSECTION OF S DOWNING ST AND E ORANGE ST		3	
24	MUELLER	CENTURION	1980	713 BETTY ST		3	
307	MUELLER	CENTURION	1976	109 BASTROP ST		3	
1	MUELLER	IMPROVED	1962	1105 WESTERN AVE		3	
555	MUELLER	IMPROVED	1978	ACROSS FROM 500 N CHENANGO		3	
50	MUELLER	STANDARD	1955	500 CATALPA ST		3	
292	MUELLER	CENTURION	1981	1404 S VELASCO ST		2	

Page 4 of 6

**CITY OF ANGLETON** 

View Associated Work Orders

29-Jan-25

#### HYDRANTS REQUIRING A FLANGE GASKET AND/OR MULTIPLE FLANGE BOLTS ARE MORE LIKELY TO FAIL IN THE FUTURE

HYDRANT	MAKE	MODEL	YEAR	LOCATION	FLANGE	BOLTS	GASKET
479	MUELLER	CENTURION	1997	NORTHWEST CORNER OF MORNINGSIDE ST AND DANBURY ST		2	
538	MUELLER	CENTURION	1946	624 E MAGNOLIA ST		2	
633	MUELLER	CENTURION	2014	1233 LAUREL LOOP		2	
170	MUELLER	CENTURION	1981	1401 S VELASCO ST		2	
288	MUELLER	CENTURION	1973	NORTHWEST CORNER OF S VELASCO AND CEMETERY RD		2	
13	MUELLER	CENTURION	2003	1 OAK PARK DR		2	
290	MUELLER	CENTURION	1981	1128 S VELASCO		2	
83	MUELLER	IMPROVED	1967	700 W ASH ST		2	
51	MUELLER	STANDARD		608 CATALPA ST		2	
53	MUELLER	IMPROVED	1976	NORTHEAST CORNER OF W PLUM ST AND S ERSKINE ST		1	
328	MUELLER	CENTURION	1994	2700 TX-35		1	
311	MUELLER	IMPROVED	1969	133 DALLAS ST		1	
28	MUELLER	CENTURION	2007	2400 W MULBERRY ST		1	

Page 5 of 6

**CITY OF ANGLETON** 

View Associated Work Orders

29-Jan-25

#### HYDRANTS REQUIRING A FLANGE GASKET AND/OR MULTIPLE FLANGE BOLTS ARE MORE LIKELY TO FAIL IN THE FUTURE

HYDRANT	MAKE	MODEL	YEAR	LOCATION	FLANGE	BOLTS	GASKET
289	MUELLER	CENTURION	1981	SOUTHWEST CORNER OF S VELASCO AND CEMETERY RD		1	
37	MUELLER	CENTURION	1980	520 BRYAN ST		1	
218	MUELLER	CENTURION	1983	137 BALD PRAIRIE DR		1	
146	MUELLER	CENTURION	1982	134 WALNUT ST		1	
147	MUELLER	CENTURION	1981	217 BEECHNUT ST		1	
110	MUELLER	CENTURION	1982	109 E KIBER ST		1	
153	MUELLER	CENTURION	1981	2816 S VELASCO ST		1	
197	MUELLER	CENTURION	1987	SOUTHEAST CORNER OF KADERA RD AND WILBERT ST		1	
227	MUELLER	CENTURION	1989	NORTHWEST CORNER OF CEMETERY RD AND PARK LN		1	
52	MUELLER	IMPROVED	1955	641 W MIMOSA ST		1	
					FLANGES	BOLTS	GASKETS
H	Iydrants: 7	4		Totals:	0	310	3

Page 6 of 6

**CITY OF ANGLETON** 

# 8. INSPECT/REPLACE MAIN VALVE

## **Inspect/Replace Main Valve**

View Associated Work Orders

29-Jan-25

HYDRANT	MAKE	MODEL	YEAR	LOCATION NOTES	LEAKING SMALL AMOUNT OF WATER
513	MUELLER	IMPROVED	1972	NORTHWEST CORNER OF N VALDERAS ST AND MILLER ST CITY TAGGED HYDRANT OUT OF SERVICE - NOT TESTED	Х
579	MUELLER	IMPROVED	1960	504 E PEACH ST	Х

Total: 2

CITY OF ANGLETON

Page 1 of 1

# 9. SEIZED PUMPER, AND/OR HOSE CAPS

## **Seized Pumper and/or Hose Caps**

29-Jan-25

HYDRANT	MAKE	MODEL	YEAR	LOCATION	SEIZED PUMER CAP	SEIZED HOSE CAPS
165	MUELLER	CENTURION	1981	2021 S VELASCO ST	Х	
319	MUELLER	CENTURION	1984	112 DEBORAH DR	Х	
313	MUELLER	CENTURION	2004	1980 E MULBERRY ST	Х	
116	MUELLER	CENTURION	1995	501 S MORGAN ST	Х	
905	MUELLER	CENTURION	1983	820 S ANDERSON ST	Х	
203	MUELLER	CENTURION	1980	16 GRACE ST	Х	
205	MUELLER	CENTURION	1981	282 E PHILLIPS RD	Х	
160	MUELLER	CENTURION	1981	2213 S VELASCO ST	Х	
161	MUELLER	CENTURION	1981	2123 S VELASCO ST	Х	
289	MUELLER	CENTURION	1981	SOUTHWEST CORNER OF S VELASCO AND CEMETERY RD	Х	
283	MUELLER	CENTURION	1981	ACROSS FROM 2609 S FRONT ST	Х	
64	MUELLER	CENTURION	1981	NORTHEAST CORNER OF T J WRIGHT ST AND W LOCUS ST	Х	
72	MUELLER	IMPROVED	1946	300 N COLUMBIA ST	Х	
75	MUELLER	CENTURION	1981	629 W LOCUS ST	Х	
70	MUELLER	CENTURION	2003	SOUTHEAST CORNER OF W MILLER ST AND N PARISH ST	Х	
291	MUELLER	CENTURION	1981	1212 S VELASCO ST		R
20	MUELLER	CENTURION	1983	202 S WALKER ST		R
61	MUELLER	IMPROVED	1971	SOUTHEAST CORNER OF W MYRTLE ST AND T J WRIGHT ST		R
573	MUELLER	IMPROVED	1956	103 E PEACH ST		R

Page 1 of 2

#### **CITY OF ANGLETON**

#### GENERATE INDIVIDUAL WORK ORDERS FOR THESE HYDRANTS

View Associated Work Orders

## Seized Pumper and/or Hose Caps

29-Jan-25

View As	sociated
Work	Orders

HYDRANT	MAKE	MODEL	YEAR	LOCATION	SEIZED PUMER CAP	SEIZED HOSE CAPS
560	WATEROUS		1927	126 N VELASCO ST		L
461	MUELLER	IMPROVED	1966	SOUTHWEST CORNER OF E MULBERRY AND WILDCAT DR		L
306	MUELLER	CENTURION	1976	157 HOUSTON ST		L
168	MUELLER	CENTURION	1981	1417 S VELASCO ST		L

		PUMPER CAPS	HOSE CAPS
HYDRANTS: 23	TOTALS:	15	8

Page 2 of 2

**CITY OF ANGLETON** 

# 10. PUMPER AND HOSE CAPS/NOZZLE REPAIRS

## Pumper and Hose Caps/Nozzle Repairs

View Associated Work Orders

29-Jan-25

HYDRANT	LOCATION	RECAULK HOSE NZL		PUMPER L NOZZLE	PUMPER CAP	HOSE NOZZLE	HOSE CAP
124	SOUTHEAST CORNER OF S DOWNING AND FAIRGROUND LN	RD				1	
147	217 BEECHNUT ST					1	
168	1417 S VELASCO ST					1	
277	344 W PHILLIPS RD	1	Х				
289	SOUTHWEST CORNER OF S VELASCO . CEMETERY RD	AND				1	
305	237 BASTROP ST					1	
534	804 CINCINNATI					1	
630	ACROSS FROM 1260 LAUREL LOOP					1	1
68	NORTHWEST CORNER OF N PARISH ST AND W LIVE OAK				1		
73	220 N WALKER ST				1		
		RECAUL HOSE NOZZLI	PUMPER	PUMPER NOZZLE	PUMPER CAP	HOSE NOZZLE	HOSE CAPS
HYD	RANTS: 10 TO	TALS: 1	1	0	2	7	1

**CITY OF ANGLETON** 

# 11. BONNET REPAIRS

View Associated Work Orders

BONNET WEATHER OIL BONNET HOLD BOLTS BONNET GASKET HYD MAKE YEAR LOCATION OP PLUG **O-RING** CAP DOWN NUT NUT NOTES 277 MUELLER 1992 344 W PHILLIPS RD 1 1 1 SEVERE LEAK AT BONNET GASKET - RIGHT HOSE NOZZLE IS NOT SECURED TO HYDRANT 58 MUELLER 1953 SOUTHWEST CORNER OF 1 1 W MULBERRY AND S COLUMBIA ST 535 MUELLER 1960 600 E CEDAR ST 1 571 MUELLER 1953 421 S VELASCO ST 1 199 MUELLER 1983 1100 CEMETERY RD -1 HYDRANT ON GIFFORD 3 INCH ROCKS FLUSHED OUT OF PUMPER RD MUELLER 1971 SOUTHEAST CORNER OF 61 1 W MYRTLE ST AND T J WRIGHT ST

Page 1 of 9

**CITY OF ANGLETON** 

GENERATE INDIVIDUAL WORK ORDERS FOR THESE HYDRANTS

29-Jan-25

29-Jan-25			Bo	onnet ]	Repair	S			v Associa ork Orde		
HYD NOTES	MAKE	YEAR	LOCATION	BOLTS	WEATHER CAP	OIL PLUG	BONNET O-RING	BONNET	BONNET HOLD DOWN NUT	OP NUT	GASKET
125	MUELLER	1972	338 MUNSON CT				1				
37	MUELLER	1980	520 BRYAN ST				1				
327	MUELLER	1966	224 E HOSPITAL DR	7							
150	MUELLER	1981	97 LOSTROCCO ST	7							
168	MUELLER	1981	1417 S VELASCO ST	6							
635	MUELLER	2014	1333 LAUREL LOOP	6							

**CITY OF ANGLETON** 

## **Bonnet Repairs**

29-Jan-25

View Associated Work Orders

BONNET WEATHER OIL BONNET HOLD HYD MAKE YEAR LOCATION BOLTS BONNET OP GASKET PLUG **O-RING** CAP DOWN NUT NUT NOTES 123 MUELLER NORTHEAST CORNER OF 1983 6 E KIBER ST AND S ANDERSON ST 228 MUELLER 1060 VINE DR 5 20799 COUNTY RD 171 -300 MUELLER 1989 4 NEXT TO SIGN 112 MUELLER 1964 321 SANDS ST 4 MUELLER 1981 SOUTHWEST CORNER OF 4 289 S VELASCO AND LEFT HOSE NOZZLE IS CROSS THREADED CEMETERY RD MUELLER 2816 S VELASCO ST 153 1981 4 ONLY ABLE TO OPEN HYDRANT 2 ROUNDS

Page 3 of 9

**CITY OF ANGLETON** 

29-Jan-25		<b>Bonnet Repairs</b>							View Associated Work Orders			
HYD NOTES	MAKE	YEAR	LOCATION	BOLTS	WEATHER CAP	OIL PLUG	BONNET O-RING	BONNET	BONNET HOLD DOWN NUT	OP NUT	GASKET	
634	MUELLER	2014	1317 LAUREL LOOP	4								
72	MUELLER	1946	300 N COLUMBIA ST	3								
905	MUELLER	1983	820 S ANDERSON ST	3								
151	MUELLER	1981	2288 S VELASCO ST	3								
303	MUELLER	1976	276 AUSTIN ST	3								
160	MUELLER	1981	2213 S VELASCO ST	2								

Page 4 of 9

**CITY OF ANGLETON** 

29-	Jan-25			Bor	nnet ]	Repair	S		View Associated Work Orders				
	HYD NOTES	MAKE	YEAR	LOCATION	BOLTS	WEATHER CAP	OIL PLUG	BONNET O-RING	BONNET	BONNET HOLD DOWN NUT	OP NUT	GASKET	
	163	MUELLER	1981	2113 S VELASCO ST	2								
	534	MUELLER	1994	804 CINCINNATI	2 LEFI	Γ HOSE NOZZI	LE IS CRO	SS THREADI	ED				
	569	MUELLER	1960	NORTHEAST CORNER OF W PEACH ST AND S FRONT ST	2								
	130	MUELLER	1950	201 FARRER ST	2								
	279	MUELLER	1992	217 WALLER LOOP	2								
	646	MUELLER	2015	721 RUSTIC OAKS DR	2								

Page 5 of 9

et.

**CITY OF ANGLETON** 

29-Jan-25		<b>Bonnet Repairs</b>							View Associated Work Orders				
HYD NOTES	MAKE	YEAR	LOCATION	BOLTS	WEATHER CAP	OIL PLUG	BONNET O-RING	BONNET	BONNET HOLD DOWN NUT	OP NUT	GASKET		
636	MUELLER	2014	1349 LAUREL LOOP	2									
5	MUELLER	1998	400 HERITAGE OAKS DR	2									
554	MUELLER	1946	131 E LIVE OAK ST	2									
128	MUELLER	1960	621E MURRAY ST	1									
404	MUELLER	1974	SOUTH INTERSECTION OF E CEDAR ST AND E MIMOSA ST	7 1									
311	MUELLER	1969	133 DALLAS ST	1									

**CITY OF ANGLETON** 

29-Jan-25		<b>Bonnet Repairs</b>								View Associated Work Orders					
HYD NOTES	MAKE	YEAR	LOCATION	BOLTS	WEATHER CAP	OIL PLUG	BONNET O-RING	BONNET	BONNET HOLD DOWN NUT	OP NUT	GASKET				
317	MUELLER	1981	108 DEBORAH DR	1											
574	MUELLER	1946	NORTHWEST CORNER OF S CHENANGO AND E PEACH ST	1											
124	MUELLER	1979	SOUTHEAST CORNER OF S DOWNING RD AND FAIRGROUND LN	1											
155	MUELLER	1981	2713 S VELASCO	1											
170	MUELLER	1981	1401 S VELASCO ST	1											
294	MUELLER	1981	1500 S VELASCO ST	1											

Page 7 of 9

**CITY OF ANGLETON** 

29-Jan-25			Bor	nnet	Repairs	S			v Associa ork Ord		
HYD NOTES	MAKE	YEAR	LOCATION	BOLTS	WEATHER CAP	OIL PLUG	BONNET O-RING	BONNET	BONNET HOLD DOWN NUT	OP NUT	GASKET
290	MUELLER	1981	1128 S VELASCO	1							
293	MUELLER	1981	288 S VELASCO ST - UNIT B	1							
267	MUELLER	1981	1116 WAYNE ST	1							
146	MUELLER	1982	134 WALNUT ST	1							
296	MUELLER	1981	145 W PHILLIPS ST	1							
40	MUELLER	1981	624 S HANCOCK ST	1							

Page 8 of 9

**CITY OF ANGLETON** 

View Associated Work Orders

HYD NOTES	MAKE	YEAR	LOCATION	BOLTS	WEATHER CAP	OIL PLUG	BONNET O-RING	BONNET	BONNET HOLD DOWN NUT	OP NUT	GASKEI
633	MUELLER	2014	1233 LAUREL LOOP	1							
542	MUELLER	1946	911 E MULBERRY ST	1							
165	MUELLER	1081	2021 S VEL ASCO ST	1							

 165
 MUELLER
 1981
 2021 S VELASCO ST
 1

29-Jan-25

	HYDRANTS	OP NUTS	WEATHER CAPS	OIL PLUGS	BONNET O-RINGS	BONNETS	BONNET HOLD DOWN NUTS	BOLTS	GASKETS
Totals:	51	0	0	0	3	1	0	45	5

Page 9 of 9

**CITY OF ANGLETON** 

# **12. HYDRANT ACCESSIBILITY**

## Hydrant Accessibility

View Associated Work Orders

HYDRANT	LOCATION	WRENCH	OLUTION OF HYD I ON OPERATING IS IMPEDED	FULL REVOLUTION OF HY WRENCH ON HOSE/PUMPI CAP IS IMPEDED	
533	918 E CEDAR ST			Х	
567	SOUTHEAST CORNER OF N FRONT ST AND V LOCUS ST	N		Х	
58	SOUTHWEST CORNER OF W MULBERRY AN COLUMBIA ST	D S		Х	
152	2404 S VELASCO ST		Х		
705	110 YARDS WEST FROM THE NORTHWEST CORNER OF 288 BUSINESS AND CO RD 220				Х
266	SOUTHWEST CORNER OF S FRONT ST AND WAYNE DR				Х
183	1712 SHANKS RD				Х
235	SOUTHWEST CORNER OF E KIBER ST AND S VELASCO				Х
			OP NUT IMPEDIMENTS	HOSE/PUMPER CAP IMPEDIMENTS	CUT BRUSH
HYDRA	NTS: 8	Totals:	1	3	4

# **13. EXTENSIONS REQUIRED**

## **Extensions Required**

View Associated Work Orders

29-Jan-25

HYDRANT	MAKE	MODEL	YEAR	LOCATION	6''	12''	18''
567	MUELLER	CENTURION		SOUTHEAST CORNER OF N FRONT ST AND W LOCUS ST			Х
533	MUELLER	IMPROVED		918 E CEDAR ST		Х	
58	MUELLER	IMPROVED	1953	SOUTHWEST CORNER OF W MULBERRY AND S COLUMBIA ST		Х	
543	WATERMASTE	5CD250	2008	105 N ROCK ISLAND ST	Х		
541	MUELLER	IMPROVED	1953	901 E MULBERRY ST	Х		
200	MUELLER	CENTURION	1980	1361 GIFFORD RD	Х		
111	MUELLER	IMPROVED	1963	321 E KIBER ST	Х		
128	MUELLER	IMPROVED	1960	621E MURRAY ST	Х		
574	MUELLER	IMPROVED	1946	NORTHWEST CORNER OF S CHENANGO AND E PEACH ST	Х		
308	MUELLER	IMPROVED	1966	128 HOUSTON ST	Х		
928	MUELLER	CENTURION	2022	212 HOUSTON ST	Х		
927	MUELLER	CENTURION	2023	240 HOUSTON ST	Х		
					6''	12''	18''
				Total Hydrants: 12	9	2	1

Page 1 of 1

CITY OF ANGLETON

# 14. MISSING BLUE MARKERS

HYDRANT NUMBER	LOCATION
935	304 E LIVE OAK
934	303 E LOCUST ST
933	SOUTHWEST CORNER OF N ARCOLA ST AND E LOCUST ST
932	301 E MAGNOLIA ST
931	1393 S VELASCO ST
930	1040 S ANDERSON ST
929	1320 E KIBER ST
927	240 HOUSTON ST
926	1925 ALAMO DR
925	1901 ALAMO DR
924	241 DALLAS ST
923	213 DALLAS ST
914	ACROSS FROM 1302 LAUREL LOOP
913	1281 LAUREL LOOP
912	709 RUSTIC OAKS DR
911	904 SPREADING OAKS DR
910	2113 C.R. 220
909	COALE RD FEEDER BETWEEN 288 AND S FRONT ST - SOUTHWEST CORNER OF WAREHOUSE DEVELOPMENT PROPERTY
907	237 LAURA LEIGH LN
906	235 LISA MARIE DR
905	820 S ANDERSON ST
904	444 E MULBERRY ST
900	130 AUSTIN RD
9	ACROSS FROM 1007 SPREADING OAKS DR
831	500 WARD RD
830	800 PATTEN RD
83	700 W ASH ST
82	WEST END OF W MILLER ST
81	SOUTHEAST CORNER OF W MILLER ST AND N WALKER ST
80	828 W LIVE OAK ST
8	805 HERITAGE OAKS DR

HYDRANT NUMBER	LOCATION
79	819 MARSHALL RD
78	700 W LIVE OAK ST
773	308 BRYAN WAY
77	NORTHEAST CORNER OF CEDAR AND W COLUMBIA
76	705 N COLUMBIA ST
753	838 OAK RIDGE DR
752	854 OAK RIDGE DR
750,751	870 OAK RIDGE DR
75	629 W LOCUS ST
749	883 OAK RIDGE DR
747	ACROSS FROM 825 SOUTHSIDE DR
746	1009 SOUTHSIDE DR
745	1000 SOUTHSIDE DR
74	110 N WALKER ST
73	220 N WALKER ST
714	ACROSS FROM 409 N PARISH ST
713	ACROSS FROM 221 N PARISH ST
712	206 N PARISH ST
71	SOUTHEAST CORNER OF N COLUMBUS ST AND W LIVE OAK ST
706	COALE RD FEEDER BETWEEN 288 AND S FRONT ST - EASTERN ENTRANCE TO WAREHOUSE DEVELOPMENT
705	110 YARDS WEST FROM THE NORTHWEST CORNER OF 288 BUSINESS AND CO RD 220
70	SOUTHEAST CORNER OF W MILLER ST AND N PARISH ST
7	ACROSS FROM 904 HERITAGE OAKS DR
69	523 N PARISH ST
68	NORTHWEST CORNER OF N PARISH ST AND W LIVE OAK
67	612 T J WRIGHT ST
66	18 T J WRIGHT ST
65	NORTHWEST CORNER OF N HANCOCK ST AND W LIVE OAK ST
649	608 HERITAGE OAKS DR
648	1117 ROBINHOOD LN
647	1009 ROBINHOOD LN

HYDRANT NUMBER	LOCATION
646	721 RUSTIC OAKS DR
645	976 ANCHOR RD - SOUTH EAST CORNER OF PROPERTY NEXT TO ENTRANCE - HYD ON ENCHANTED OAKS
644	821 MILLER ST
641	132 E HOSPITAL DR - SOUTHWEST CORNER OF PROPERTY NEXT TO TREE
640	901 ROBINHOOD LN
64	NORTHEAST CORNER OF T J WRIGHT ST AND W LOCUS ST
636	1349 LAUREL LOOP
635	1333 LAUREL LOOP
634	1317 LAUREL LOOP
633	1233 LAUREL LOOP
632	1217 LAUREL LOOP
631	1249 LAUREL LOOP
630	ACROSS FROM 1260 LAUREL LOOP
63	324 W MAGNOLIA ST
626	883 SPREADING OAKS DR
625	ACROSS FROM 899 SPREADING OAKS DR
624	810 OAK RIDGE DR
622	1233 CALDWELL RD
62	NORTHEAST CORNER OF W MULBERRY ST AND T J WRIGHT ST
61	SOUTHEAST CORNER OF W MYRTLE ST AND T J WRIGHT ST
60	NORTHWEST CORNER OF N HANCOCK ST AND W MYRTLE ST
6	305 HERITAGE OAKS DR
59	SOUTHWEST CORNER OF W MULBERRY ST AND S PARISH ST
582	NORTHEAST CORNER OF E ORANGE ST AND S ANDERSON ST
581	445 E ORANGE ST
580	NORTHEAST CORNER OF S ARCOLA ST AND E ORANGE ST
58	SOUTHWEST CORNER OF W MULBERRY AND S COLUMBIA ST
579	504 E PEACH ST
578	234 S ARCOLA ST
577	SOUTHWEST CORNER OF E MULBERRY ST AND S CHENANGO ST
576	NORTHEAST CORNER OF HWY 288 BUSINESS AND E ORANGE ST

HYDRANT NUMBER	LOCATION
575	NORTHWEST CORNER OF E ORANGE ST AND S CHENANGO ST
574	NORTHWEST CORNER OF S CHENANGO AND E PEACH ST
573	103 E PEACH ST
572	216 E PLUM ST
571	421 S VELASCO ST
570	SOUTHWEST CORNER OF S CHENANGO ST AND MURRAY ST
57	601 W ORANGE ST
569	NORTHEAST CORNER OF W PEACH ST AND S FRONT ST
568	SOUTHEAST CORNER OF W ORANGE ST AND S FRONT ST
567	SOUTHEAST CORNER OF N FRONT ST AND W LOCUS ST
566	SOUTHWEST CORNER OF W LOCUS ST AND N VELASCO ST
565	SOUTHEAST CORNER OF W MAGNOLIA ST AND N FRONT ST
564	NORTHEAST CORNER OF W MYRTLE ST AND N FRONT ST
563	130 W MULBERRY ST
562	100 N VELASCO ST
561	136 E MYRTLE ST
560	126 N VELASCO ST
56	600 W PEACH ST
559	300 N VELASCO ST
558	NORTHWEST CORNER OF N CHENANGO ST AND E MAGNOLIA ST
557	136 E LOCUS ST
556	111 E LOCUS ST - NEXT TO NO PARKING SIGN
555	ACROSS FROM 500 N CHENANGO
554	131 E LIVE OAK ST
553	SOUTHEAST CORNER OF E CEDAR ST AND N VALDERAS ST
552	301 E MAGNOLIA ST
551	305 E MULBERRY ST
550	1208 N VELASCO ST
55	504 W PEACH ST
549	427 E MAGNOLIA ST
548	SOUTHEAST CORNER OF N MORGAN ST AND E LOCUS ST

HYDRANT NUMBER	LOCATION
547	NORTHWEST CORNER OF E MAGNOLIA ST AND N ANDERSON ST
546	503 E MYRTLE ST
545	601 E MYRTLE ST
544	445 E MULBERRY ST
543	105 N ROCK ISLAND ST
542	911 E MULBERRY ST
541	901 E MULBERRY ST
540	909 E MYRTLE ST
54	220 W ORANGE ST
539	937 E MULBERRY ST
538	624 E MAGNOLIA ST
537	603 E LOCUS ST
536	604 E LIVE OAK
535	600 E CEDAR ST
534	804 CINCINNATI
533	918 E CEDAR ST
532	501 N PECAN ST
53	NORTHEAST CORNER OF W PLUM ST AND S ERSKINE ST
52	641 W MIMOSA ST
513	NORTHWEST CORNER OF N VALDERAS ST AND MILLER ST
511	723 N ROCK ISLAND
510	603 N TINSLEY
51	608 CATALPA ST
50	500 CATALPA ST
5	400 HERITAGE OAKS DR
49	937 S WALKER ST
481	615 DANBURY ST
480	NORTHWEST CORNER OF N DOWNING AN E MILLER
48	41885 HWY 288 - STEPHEN F AUSTIN MEMORIAL PARK
477	SOUTHWEST CORNER OF E PECAN ST AND E MULBERRY ST
476	SOUTHWEST CORNER OF WALCIK LN AND E MULBERRY ST

HYDRANT NUMBER	LOCATION
474	1200 CHEVY CHASE DR
473	SOUTHWEST CORNER OF E MULBERRY ST AND SAN FELIPE ST
47	716 MUNSON PL
465	901 NOTTINGHAM DR
464	1117 NOTTINGHAM DR
461	SOUTHWEST CORNER OF E MULBERRY AND WILDCAT DR
46	727 S WALKER ST
45	ACROSS FROM 700 S WALKER ST
44	600 S HANCOCK ST
43	ACROSS FROM 103 W MUNSON ST
42	NORTHEAST CORNER OF S FRONT ST AND W MUNSON ST
41	222 W MUNSON ST
409	1739 E MULBERRY ST
407	1524 E MULBERRY ST - NORTH SIDE OF BUILDING
406	1524 E MULBERRY ST - ACROSS FROM SOUTHEAST CORNER OF BUILDING
403	SOUTHWEST CORNER OF CEDAR ST AND E MULBERRY ST
40	624 S HANCOCK ST
4	NORTHWEST CORNER OF HERITAGE OAKS DR AND WESTERN AVE
39	726 S ERSKINE ST
38	504 BRYAN ST
37	520 BRYAN ST
36	ACROSS FROM 1005 HERITAGE OAKS DR
35	1020 HERITAGE OAKS DR
34	1009 ENCHANTED OAKS DR
33	1100 SOUTHERN OAKS DR
328	2700 TX-35
327	224 E HOSPITAL DR
326	220 E HOSPITAL DR
324	ACROSS FROM 170 E HOSPITAL DR
323	140 E HOSPITAL DR
322	132 E HOSPITAL DR -

HYDRANT NUMBER	LOCATION
321	132 E HOSPITAL DR
32	1112 SHADY OAK DR
319	112 DEBORAH DR
318	108 DEBORAH DR
317	108 DEBORAH DR
316	124 KNIGHT ST
315	116 KNIGHT ST
314	108 KNIGHT DR
313	1980 E MULBERRY ST
312	SOUTHEAST CORNER OF JAMISON RD AND E MULBERRY ST
311	133 DALLAS ST
310	6 DALLAS CT
31	1016 SHADY OAK DR
309	172 HOUSTON ST
308	128 HOUSTON ST
307	109 BASTROP ST
306	157 HOUSTON ST
303	276 AUSTIN ST
302	240 AUSTIN ST
301	SOUTHEAST CORNER OF ANGLETON BLVD AND AUSTIN ST
300	20799 COUNTY RD 171 - NEXT TO SIGN
30	1000 SHADY OAK DR
3	801 WESTERN AVE
299	21039 COUNTY RD 171
298	SOUTH CORNER OF FM 210 AND ANGLETON DANBURY RD
296	145 W PHILLIPS ST
295	1600 S VELASCO ST
294	1500 S VELASCO ST
293	288 S VELASCO ST - UNIT B
292	1404 S VELASCO ST
291	1212 S VELASCO ST

## **Missing Blue Markers**

HYDRANT NUMBER	LOCATION
290	1128 S VELASCO
289	SOUTHWEST CORNER OF S VELASCO AND CEMETERY RD
288	NORTHWEST CORNER OF S VELASCO AND CEMETERY RD
287	1034 S VELASCO ST
286	NORTH END OF BRAZOS PKWY
285	2760 BRAZOS PKWY - NORTH SIDE OF PROPERTY
284	2760 BRAZOS PKWY - SOUTH EAST SIDE OF PROPERTY
283	ACROSS FROM 2609 S FRONT ST
282	ACROSS FROM 2329 S FRONT ST
281	ACROSS FROM 2221 S FRONT ST
280	NORTHEAST CORNER OF LOSTRACCO ST AND S FRONT ST
28	2400 W MULBERRY ST
279	217 WALLER LOOP
278	111 WALLER LOOP
277	344 W PHILLIPS RD
276	173 WEST PHILLIPS
275	SOUTHWEST INTERSECTION OF S FRONT ST AND JOHN DR
274	NORTHWEST INTERSECTION OF S FRONT ST AND KETCHUM DR
273	SOUTHWEST CORNER OF S FRONT ST AND YANCY RD
272	ACROSS FROM 1501 S FRONT ST
271	ACROSS FROM 1429 S FRONT ST
270	1421 S FRONT ST - ACROSS FROM NW CORNER OF PROPERTY
27	2304 W MULBERRY ST
269	1203 S FRONT ST
268	1306 WAYNE ST
267	1116 WAYNE ST
266	SOUTHWEST CORNER OF S FRONT ST AND WAYNE DR
265	ACROSS FROM 1099 S FRONT ST
264	NORTHEAST CORNER OF S FRONT AND CEMETERY RD
263	1050 CRYSTAL ST
26	217 SEBESTA RD

Page 8 of 13

### **CITY OF ANGLETON**

Page 9 of 13

234	901 S VELASCO ST - SOUTH OF PROPERTY
233	1009 S VELASCO ST - NEXT TO DRAINAGE DITCH
232	502 DWYER ST
231	SOUTHWEST CORNER OF DWYER ST AND S ANDERSON ST
230	328 CEMETERY RD - ACROSS FROM FLAG DISPOSAL BOX
23	629 HOLLY ST
229	1060 GROVE DR
228	1060 VINE DR
227	NORTHWEST CORNER OF CEMETERY RD AND PARK LN
226	ACROSS FROM 928 CEMETERY RD
225	NORTHWEST CORNER OF SOUTHSIDE DR AND E CEMETERY F
224	237 PRAIRIE LEA DR
223	205 PRAIRIE LEA DR

101 BALD PRAIRIE DR

1304 FAIR DR

1505 GIFFORD RD

1516 GIFFORD LN 1408 GIFFORD LN

1325 GIFFORD LN

1301 GIFFORD LN

305 W PEACH ST

NORTHEAST CORNER OF SUNNY MEADOWS AND GIFFORD RD

24 713 BETTY ST 235 SOUTHWEST CORNER OF E KIBER ST AND S VELASCO RD

222 137 PRAIRIE LEA DR 221 101 PRAIRIE LEA DR 220 245 BALD PRARIE DR 22 ACROSS FROM 300 S WALKER ST 205 BALD PRAIRIE DR 219 218 137 BALD PRAIRIE DR

25 474 COUTY RD 609 - WATER TREATMENT PLANT

HYDRANT NUMBER LOCATION

217

216

215 214

213 212

211

210

21

**Missing Blue Markers** 

**View Associated Work Orders** 

29-Jan-25

HYDRANT NUMBER	LOCATION
209	SOUTHEAST CORNER OF ROBERT ST AND GIFFORD RD
208	1811 GIFFORD RD - SOUTH OF PROPERTY
207	403 MEADOW ACRES DR
206	ACROSS FROM 321 E PHILLIPS RD
205	282 E PHILLIPS RD
204	238 E PHILLIPS RD
202	1024 HOELEWYN DR
201	1200 GIFFORD RD
200	1361 GIFFORD RD
20	202 S WALKER ST
2	913 WESTERN AVE
199	1100 CEMETERY RD - HYDRANT ON GIFFORD RD
198	1621 WILBERT RD
197	SOUTHEAST CORNER OF KADERA RD AND WILBERT ST
196	824 KADERA
195	1629 ALENA RD
194	1000 KADERA RD
193	SOUTHWEST CORNER OF KADERA DR AND GIFFORD RD
192	1503 ALENA RD
191	SOUTH END OF OF SHANKS RD
190	2412 SHANKS RD
19	SOUTHEAST CORNER OF S WALKER ST AND W MULBERRY
189	ACROSS FROM 2615 SHANKS RD
188	2600 SHANKS RD
187	2801 SHANKS RD
186	2218 SHANKS RD - SOUTH OF PROPERTY
185	2328 SHANKS RD
184	2218 SHANKS RD
182	1820 SHANKS RD
181	1916 SHANKS RD
180	NORTHWEST CORNER OF SHANKS RD AND E PHILLIPS RD

HYDRANT NUMBER	LOCATION
18	ACROSS FROM 724 W MULBERRY ST
179	SOUTHEAST CORNER OF SHANKS RD AND KADERA RD
178	1500 SHANKS RD
177	328 CEMETERY RD - HYDRANT ON SHANKS RD - NEXT TO SOUTH EAST ENTRANCE TO CEMETERY
176	ACROSS FROM 725 CAHILL RD
175	614 CAHILL RD
174	WEST INTERSECTION OF SHANKS RD AND CAHILL RD
173	328 CEMETERY RD - ENTRANCE TO CEMETERY
172	ACROSS FROM 105 CEMETERY RD
171	SOUTHEAST CORNER OF S VELASCO ST AND CEMETERY RD
170	1401 S VELASCO ST
17	721 W MULBERRY ST
169	1423 S VELASCO ST
168	1417 S VELASCO ST
167	1725 S VELASCO ST
166	2005 S VELASCO ST
165	2021 S VELASCO ST
164	120 E PHILLIPS RD
163	2113 S VELASCO ST
162	SOUTHWEST CORNER OF SHANKS RD AND IDEN RD
161	2123 S VELASCO ST
160	2213 S VELASCO ST
16	1116 W MULBERRY ST
159	2317 S VELASCO ST
158	2425 S VELASCO ST
157	2521 S VELASCO
156	2609 S VELASCO ST
155	2713 S VELASCO
154	2825 S VELASCO
153	2816 S VELASCO ST
152	2404 S VELASCO ST

HYDRANT NUMBER	LOCATION
151	2288 S VELASCO ST
150	97 LOSTROCCO ST
15	1008 W MULBERRY
149	SOUTH INTERSECTION OF BEECHNUT ST AND CHESTNUT ST
148	113 LOSTRACCO ST
147	217 BEECHNUT ST
146	134 WALNUT ST
145	100 WALNUT ST
144	NORTHEAST CORNER OF E KIBER ST AND DOWNING RD
143	509 S DOWNING RD
142	1258 PYBURN ST
141	NORTHWEST CORNER OF RAMONA AND SIMS
140	NORTHWEST CORNER OF SIMS AND E KIBER ST
14	820 W MULBERRY ST
139	NORTHEAST INTERSECTION OF S DOWNING ST AND E ORANGE ST
138	901 S DOWNING ST - NORTH SIDE OF LIVESTOCK JUDGE SEATING AREA
137	901 S DOWNING ST - NORTH SIDE OF COUNTY ARENA
136	1716 COUNTY RD 428 - NORTH WEST SIDE OF PROPERTY
135	1380 E KIBER ST
134	901 S DOWNING RD
133	408 EVANS ST
131	409 FARRER ST
130	201 FARRER ST
13	1 OAK PARK DR
129	600 EARLS CT
128	621E MURRAY ST
127	620 E PLUM ST
126	330 S ANDERSON ST
125	338 MUNSON CT
124	SOUTHEAST CORNER OF S DOWNING RD AND FAIRGROUND LN
123	NORTHEAST CORNER OF E KIBER ST AND S ANDERSON ST

## **Missing Blue Markers**

HYDRANT NUMBER	LOCATION
121	1020 PARK LN
120	1011 S ANDERSON ST
12	904 ENCHANTED OAKS DR
119	SW CORNER OF S ANDERSON ST AND RICE ST
118	712 S ANDERSON ST
117	853 S VALDERAS ST
116	501 S MORGAN ST
115	301 RICE ST
113	305 BERT ST
112	321 SANDS ST
111	321 E KIBER ST
110	109 E KIBER ST
11	800 ENCHANTED OAKS DR
10	1 SPREADING OAKS CT
1	1105 WESTERN AVE

Total Blue Markers Needed: 387

# 15. CHAINS & S-HOOKS

### View Associated Work Orders

CHAINS S-HOOKS CONNECT HYDRANT MAKE MODEL YEAR HYDRANT LOCATION NEEDED NEEDED S-HOOKS 1 MUELLER IMPROVED 1105 WESTERN AVE 2 2 Х 1962 110 MUELLER CENTURION 1982 109 E KIBER ST 1 111 MUELLER IMPROVED 1963 321 E KIBER ST 3 3 112 MUELLER IMPROVED 1964 321 SANDS ST 3 3 113 MUELLER **IMPROVED** 1953 305 BERT ST 1 3 Х 114 MUELLER CENTURION 1992 301 LAURIE LN Х MUELLER 301 RICE ST 3 3 115 **IMPROVED** 1962 MUELLER CENTURION 712 S ANDERSON ST 3 118 1983 Х 119 MUELLER CENTURION 1983 SW CORNER OF S ANDERSON ST AND RICE ST Х 120 MUELLER CENTURION 1990 1011 S ANDERSON ST Х 123 MUELLER CENTURION 1983 NORTHEAST CORNER OF E KIBER ST AND S ANDERSON ST 1 1 Х 125 MUELLER IMPROVED 1972 338 MUNSON CT Х MUELLER 2 127 IMPROVED 1960 620 E PLUM ST 128 MUELLER IMPROVED 1960 621E MURRAY ST 3 2 130 MUELLER IMPROVED 1950 3 3 201 FARRER ST 3 3 131 MUELLER IMPROVED 1950 409 FARRER ST Х 132 MUELLER IMPROVED NORTHEAST INTERSECTION OF E KIBER ST AND FARRER ST 3 3 Х 1951 134 MUELLER **IMPROVED** 1962 901 S DOWNING RD 3 2 135 MUELLER CENTURION 1986 1380 E KIBER ST 3 1 901 S DOWNING ST - NORTH SIDE OF LIVESTOCK JUDGE 138 MUELLER **IMPROVED** 1950 3 3 SEATING AREA 139 MUELLER IMPROVED 1953 NORTHEAST INTERSECTION OF S DOWNING ST AND E Х ORANGE ST MUELLER IMPROVED NORTHWEST CORNER OF SIMS AND E KIBER ST 3 3 140 1946 141 MUELLER IMPROVED 1962 NORTHWEST CORNER OF RAMONA AND SIMS 2 2 Х 142 MUELLER CENTURION 2022 1258 PYBURN ST 3 1 143 MUELLER IMPROVED 1953 509 S DOWNING RD 3 3 Х 144 MUELLER IMPROVED 1953 NORTHEAST CORNER OF E KIBER ST AND DOWNING RD 3 3 Х 145 MUELLER CENTURION 1981 100 WALNUT ST Х

### **CITY OF ANGLETON**

### 29-Jan-25

View Associated Work Orders 

HYDRAN	IT MAKE	MODEL	YEAR	HYDRANT LOCATION	CHAINS NEEDED	S-HOOKS NEEDED	CONNECT S-HOOKS
146	MUELLER	CENTURION	1982	134 WALNUT ST		1	
147	MUELLER	CENTURION	1981	217 BEECHNUT ST		1	
148	MUELLER	CENTURION	1981	113 LOSTRACCO ST		1	
149	MUELLER	CENTURION	1981	SOUTH INTERSECTION OF BEECHNUT ST AND CHESTNUT ST	2		Х
150	MUELLER	CENTURION	1981	97 LOSTROCCO ST			Х
151	MUELLER	CENTURION	1981	2288 S VELASCO ST			Х
152	MUELLER	CENTURION	2022	2404 S VELASCO ST	3	1	
153	MUELLER	CENTURION	1981	2816 S VELASCO ST		1	Х
154	MUELLER	CENTURION	1981	2825 S VELASCO	3		Х
155	MUELLER	CENTURION	1981	2713 S VELASCO			Х
157	MUELLER	CENTURION	1981	2521 S VELASCO			Х
16	MUELLER	IMPROVED	1966	1116 W MULBERRY ST		3	Х
162	MUELLER	CENTURION	1981	SOUTHWEST CORNER OF SHANKS RD AND IDEN RD	3	1	
164	MUELLER	CENTURION	1981	120 E PHILLIPS RD			Х
165	MUELLER	CENTURION	1981	2021 S VELASCO ST		1	
166	MUELLER	CENTURION	1981	2005 S VELASCO ST		1	Х
167	MUELLER	CENTURION	1981	1725 S VELASCO ST		1	
168	MUELLER	CENTURION	1981	1417 S VELASCO ST			Х
169	MUELLER	CENTURION	1981	1423 S VELASCO ST		1	Х
17	MUELLER	CENTURION	1982	721 W MULBERRY ST			Х
170	MUELLER	CENTURION	1981	1401 S VELASCO ST			Х
171	MUELLER	CENTURION	2022	SOUTHEAST CORNER OF S VELASCO ST AND CEMETERY RD	3		
172	MUELLER	CENTURION	2023	ACROSS FROM 105 CEMETERY RD		2	
173	MUELLER	IMPROVED	1967	328 CEMETERY RD - ENTRANCE TO CEMETERY		3	Х
174	MUELLER	CENTURION	1980	WEST INTERSECTION OF SHANKS RD AND CAHILL RD	1		Х
175	MUELLER	CENTURION	1981	614 CAHILL RD	3	1	Х
177	MUELLER	CENTURION	1980	328 CEMETERY RD - HYDRANT ON SHANKS RD - NEXT TO SOUTH EAST ENTRANCE TO CEMETERY	1		Х

Page 2 of 9

## **CITY OF ANGLETON**

### 29-Jan-25

View Associated Work Orders \_

HYDRA	NT MAKE	MODEL	YEAR	HYDRANT LOCATION	CHAINS NEEDED	S-HOOKS NEEDED	CONNECT S-HOOKS
178	MUELLER	CENTURION	1980	1500 SHANKS RD		1	
18	MUELLER	CENTURION	2010	ACROSS FROM 724 W MULBERRY ST	3	1	
182	MUELLER	CENTURION	1982	1820 SHANKS RD			Х
184	MUELLER	CENTURION	1982	2218 SHANKS RD	3	1	
185	MUELLER	CENTURION	1981	2328 SHANKS RD	3		Х
186	MUELLER	CENTURION	1981	2218 SHANKS RD - SOUTH OF PROPERTY			Х
187	MUELLER	CENTURION	1981	2801 SHANKS RD			Х
188	MUELLER	CENTURION	1981	2600 SHANKS RD	3		
19	MUELLER	IMPROVED	1953	SOUTHEAST CORNER OF S WALKER ST AND W MULBERRY		1	Х
192	MUELLER	CENTURION	2022	1503 ALENA RD	3	1	
194	MUELLER	CENTURION	1978	1000 KADERA RD			Х
195	MUELLER	CENTURION	1981	1629 ALENA RD			Х
196	MUELLER	CENTURION	1980	824 KADERA	3	1	Х
197	MUELLER	CENTURION	1987	SOUTHEAST CORNER OF KADERA RD AND WILBERT ST			Х
198	MUELLER	CENTURION	1981	1621 WILBERT RD	3	1	
199	MUELLER	CENTURION	1983	1100 CEMETERY RD - HYDRANT ON GIFFORD RD			Х
2	MUELLER	IMPROVED	1957	913 WESTERN AVE		1	
20	MUELLER	CENTURION	1983	202 S WALKER ST		1	
200	MUELLER	CENTURION	1980	1361 GIFFORD RD			Х
201	MUELLER	CENTURION	1976	1200 GIFFORD RD	3		Х
203	MUELLER	CENTURION	1980	16 GRACE ST		1	Х
204	MUELLER	CENTURION	1981	238 E PHILLIPS RD			Х
205	MUELLER	CENTURION	1981	282 E PHILLIPS RD			Х
207	MUELLER	CENTURION	1981	403 MEADOW ACRES DR			Х
208	MUELLER	CENTURION	1982	1811 GIFFORD RD - SOUTH OF PROPERTY		1	
209	MUELLER	CENTURION	1982	SOUTHEAST CORNER OF ROBERT ST AND GIFFORD RD			Х
21	MUELLER	CENTURION	1983	305 W PEACH ST	3	1	

### Page 3 of 9

### **CITY OF ANGLETON**

29-Jan-25

Ξ

View Associated Work Orders \_

HYDRA	NT MAKE	MODEL	YEAR	HYDRANT LOCATION	CHAINS NEEDED	S-HOOKS NEEDED	CONNECT S-HOOKS
210	MUELLER	CENTURION	1981	NORTHEAST CORNER OF SUNNY MEADOWS AND GIFFORD RD		1	Х
212	CLOW	MEDALLION	2000	1325 GIFFORD LN	3	1	Х
214	CLOW	MEDALLION	2000	1516 GIFFORD LN			Х
215	MUELLER	CENTURION	1980	1505 GIFFORD RD	3	1	Х
216	MUELLER	CENTURION	1984	1304 FAIR DR			Х
217	MUELLER	CENTURION	1983	101 BALD PRAIRIE DR	3	1	Х
218	MUELLER	CENTURION	1983	137 BALD PRAIRIE DR		1	
219	MUELLER	CENTURION	1983	205 BALD PRAIRIE DR		1	
221	MUELLER	CENTURION	1983	101 PRAIRIE LEA DR	3	1	Х
222	MUELLER	CENTURION	1983	137 PRAIRIE LEA DR	1	1	
223	MUELLER	CENTURION	1983	205 PRAIRIE LEA DR			Х
226	MUELLER	CENTURION	1981	ACROSS FROM 928 CEMETERY RD			Х
227	MUELLER	CENTURION	1989	NORTHWEST CORNER OF CEMETERY RD AND PARK LN			Х
229	MUELLER	CENTURION	1983	1060 GROVE DR			Х
23	MUELLER	IMPROVED	1953	629 HOLLY ST	3	2	
230	MUELLER	CENTURION	1983	328 CEMETERY RD - ACROSS FROM FLAG DISPOSAL BOX			Х
232	MUELLER	IMPROVED	1966	502 DWYER ST	3	3	Х
24	MUELLER	CENTURION	1980	713 BETTY ST	3	1	Х
264	MUELLER	CENTURION	1970	NORTHEAST CORNER OF S FRONT AND CEMETERY RD			Х
265	MUELLER	CENTURION	1981	ACROSS FROM 1099 S FRONT ST		1	
267	MUELLER	CENTURION	1981	1116 WAYNE ST		1	
268	MUELLER	CENTURION	1981	1306 WAYNE ST		1	Х
269	MUELLER	CENTURION	1981	1203 S FRONT ST		1	
271	MUELLER	CENTURION	1981	ACROSS FROM 1429 S FRONT ST			Х
274	MUELLER	CENTURION	2022	NORTHWEST INTERSECTION OF S FRONT ST AND KETCHUM DR			Х
276	MUELLER	CENTURION	1981	173 WEST PHILLIPS			Х
277	MUELLER	CENTURION	1992	344 W PHILLIPS RD			Х

### **CITY OF ANGLETON**

### 29-Jan-25

View Associated Work Orders \_

HYDRA	NT MAKE	MODEL	YEAR	HYDRANT LOCATION	CHAINS NEEDED	S-HOOKS NEEDED	CONNECT S-HOOKS
278	MUELLER	CENTURION	1992	111 WALLER LOOP			Х
28	MUELLER	CENTURION	2007	2400 W MULBERRY ST			Х
280	MUELLER	CENTURION	1981	NORTHEAST CORNER OF LOSTRACCO ST AND S FRONT ST			Х
283	MUELLER	CENTURION	1981	ACROSS FROM 2609 S FRONT ST	1		Х
284	MUELLER	CENTURION	2004	2760 BRAZOS PKWY - SOUTH EAST SIDE OF PROPERTY			Х
286	MUELLER	CENTURION	2004	NORTH END OF BRAZOS PKWY	3	1	Х
288	MUELLER	CENTURION	1973	NORTHWEST CORNER OF S VELASCO AND CEMETERY RD			Х
291	MUELLER	CENTURION	1981	1212 S VELASCO ST	3	1	Х
292	MUELLER	CENTURION	1981	1404 S VELASCO ST			Х
293	MUELLER	CENTURION	1981	288 S VELASCO ST - UNIT B			Х
294	MUELLER	CENTURION	1981	1500 S VELASCO ST	3	1	Х
295	MUELLER	CENTURION	1981	1600 S VELASCO ST		1	Х
296	MUELLER	CENTURION	1981	145 W PHILLIPS ST	1	1	
3	MUELLER	IMPROVED	1957	801 WESTERN AVE		3	Х
300	MUELLER	CENTURION	1989	20799 COUNTY RD 171 - NEXT TO SIGN		1	
302	MUELLER	CENTURION	2014	240 AUSTIN ST	3	1	
303	MUELLER	CENTURION	1976	276 AUSTIN ST			Х
304	MUELLER	CENTURION	1973	EAST END OF BASTROP ST	3		Х
306	MUELLER	CENTURION	1976	157 HOUSTON ST			Х
307	MUELLER	CENTURION	1976	109 BASTROP ST			Х
308	MUELLER	IMPROVED	1966	128 HOUSTON ST	3		
309	MUELLER	IMPROVED	1966	172 HOUSTON ST	3		Х
311	MUELLER	IMPROVED	1969	133 DALLAS ST	3	3	Х
312	CLOW	MEDALLION	1999	SOUTHEAST CORNER OF JAMISON RD AND E MULBERRY ST	1		Х
314	MUELLER	CENTURION	1985	108 KNIGHT DR	1		Х
315	MUELLER	CENTURION	1985	116 KNIGHT ST	1	1	
317	MUELLER	CENTURION	1981	108 DEBORAH DR			Х

#### Page 5 of 9

#### **CITY OF ANGLETON**

29-Jan-25

View Associated Work Orders \_

HYDRAM	NT MAKE	MODEL	YEAR	HYDRANT LOCATION	CHAINS NEEDED	S-HOOKS NEEDED	CONNECT S-HOOKS
318	MUELLER	CENTURION	1984	108 DEBORAH DR			Х
319	MUELLER	CENTURION	1984	112 DEBORAH DR	2		Х
320	MUELLER	IMPROVED	1967	120 E HOSPITAL DR (NORTHEAST CORNER OF PROPERTY)		1	Х
321	MUELLER	CENTURION	1980	132 E HOSPITAL DR			х
322	MUELLER	CENTURION	1987	132 E HOSPITAL DR -			Х
324	MUELLER	IMPROVED	1967	ACROSS FROM 170 E HOSPITAL DR	3	3	Х
325	MUELLER	IMPROVED	1966	7 RAYBURN RIDGE	3	3	
326	MUELLER	CENTURION	1984	220 E HOSPITAL DR			Х
327	MUELLER	IMPROVED	1966	224 E HOSPITAL DR	2		Х
37	MUELLER	CENTURION	1980	520 BRYAN ST			Х
38	MUELLER	CENTURION	1981	504 BRYAN ST			Х
4	MUELLER	CENTURION	1998	NORTHWEST CORNER OF HERITAGE OAKS DR AND WESTERN AVE			Х
404	MUELLER	IMPROVED	1974	SOUTH INTERSECTION OF E CEDAR ST AND E MIMOSA ST	3		
407	MUELLER	IMPROVED	1974	1524 E MULBERRY ST - NORTH SIDE OF BUILDING	3	2	Х
409	MUELLER	IMPROVED	1966	1739 E MULBERRY ST	3	3	
41	MUELLER	CENTURION	1976	222 W MUNSON ST			Х
42	MUELLER	CENTURION	1980	NORTHEAST CORNER OF S FRONT ST AND W MUNSON ST		1	
44	MUELLER	CENTURION	1980	600 S HANCOCK ST			Х
46	MUELLER	CENTURION	1995	727 S WALKER ST	3	1	
461	MUELLER	IMPROVED	1966	SOUTHWEST CORNER OF E MULBERRY AND WILDCAT DR	3	3	
465	CLOW	MEDALLION	2000	901 NOTTINGHAM DR			Х
477	MUELLER	IMPROVED	1953	SOUTHWEST CORNER OF E PECAN ST AND E MULBERRY ST			Х
479	MUELLER	CENTURION	1997	NORTHWEST CORNER OF MORNINGSIDE ST AND DANBURY ST			Х
48	MUELLER	CENTURION	2005	41885 HWY 288 - STEPHEN F AUSTIN MEMORIAL PARK	2		
49	MUELLER	CENTURION	1981	937 S WALKER ST	3	1	Х
50	MUELLER	STANDARD	1955	500 CATALPA ST	2	3	Х
51	MUELLER	STANDARD		608 CATALPA ST			Х

#### **CITY OF ANGLETON**

#### 29-Jan-25

View Associated Work Orders \_

HYDRAM	NT MAKE	MODEL	YEAR	HYDRANT LOCATION	CHAINS NEEDED	S-HOOKS NEEDED	CONNECT S-HOOKS
511	MUELLER	IMPROVED	1970	723 N ROCK ISLAND		1	
512	MUELLER	IMPROVED	1970	510 MILLER ST			Х
52	MUELLER	IMPROVED	1955	641 W MIMOSA ST	3	3	
53	MUELLER	IMPROVED	1976	NORTHEAST CORNER OF W PLUM ST AND S ERSKINE ST			Х
532	MUELLER	IMPROVED	1957	501 N PECAN ST			Х
533	MUELLER	IMPROVED		918 E CEDAR ST	3	2	
535	MUELLER	IMPROVED	1960	600 E CEDAR ST	1	2	Х
538	MUELLER	CENTURION	1946	624 E MAGNOLIA ST	3	3	Х
54	MUELLER	IMPROVED	1973	220 W ORANGE ST			Х
540	MUELLER	IMPROVED	1953	909 E MYRTLE ST			Х
541	MUELLER	IMPROVED	1953	901 E MULBERRY ST			Х
542	MUELLER	IMPROVED	1946	911 E MULBERRY ST	3	3	
545	MUELLER	CENTURION	2006	601 E MYRTLE ST	3	1	
547	MUELLER	IMPROVED	1953	NORTHWEST CORNER OF E MAGNOLIA ST AND N ANDERSON ST		3	Х
549	MUELLER	IMPROVED	1959	427 E MAGNOLIA ST			Х
552	MUELLER	IMPROVED	1953	301 E MAGNOLIA ST			Х
554	MUELLER	IMPROVED	1946	131 E LIVE OAK ST	3		
555	MUELLER	IMPROVED	1978	ACROSS FROM 500 N CHENANGO			Х
557	MUELLER	IMPROVED	2022	136 E LOCUS ST	3	1	
558	MUELLER	CENTURION	2023	NORTHWEST CORNER OF N CHENANGO ST AND E MAGNOLIA ST	3	1	
559	MUELLER	IMPROVED	1953	300 N VELASCO ST			Х
564	MUELLER	CENTURION	1998	NORTHEAST CORNER OF W MYRTLE ST AND N FRONT ST	3		Х
568	MUELLER	IMPROVED	1960	SOUTHEAST CORNER OF W ORANGE ST AND S FRONT ST		3	
569	MUELLER	IMPROVED	1960	NORTHEAST CORNER OF W PEACH ST AND S FRONT ST			Х
57	MUELLER	CENTURION	1984	601 W ORANGE ST		1	
571	MUELLER	IMPROVED	1953	421 S VELASCO ST		3	
572	MUELLER	CENTURION	1979	216 E PLUM ST		1	Х

Page 7 of 9

#### **CITY OF ANGLETON**

#### 29-Jan-25

Ξ

View Associated Work Orders \_

HYDRA	NT MAKE	MODEL	YEAR	HYDRANT LOCATION	CHAINS NEEDED	S-HOOKS NEEDED	CONNECT S-HOOKS
573	MUELLER	IMPROVED	1956	103 E PEACH ST			Х
574	MUELLER	IMPROVED	1946	NORTHWEST CORNER OF S CHENANGO AND E PEACH ST	3	3	
578	MUELLER	IMPROVED	1953	234 S ARCOLA ST			Х
579	MUELLER	IMPROVED	1960	504 E PEACH ST		3	
581	MUELLER	IMPROVED	1953	445 E ORANGE ST	3	3	Х
59	MUELLER	CENTURION	1981	SOUTHWEST CORNER OF W MULBERRY ST AND S PARISH ST			Х
61	MUELLER	IMPROVED	1971	SOUTHEAST CORNER OF W MYRTLE ST AND T J WRIGHT ST			Х
62	MUELLER	IMPROVED	1953	NORTHEAST CORNER OF W MULBERRY ST AND T J WRIGHT ST			Х
624	MUELLER	CENTURION	2014	810 OAK RIDGE DR	3		
63	MUELLER	CENTURION	1981	324 W MAGNOLIA ST			Х
630	MUELLER	CENTURION	2014	ACROSS FROM 1260 LAUREL LOOP	3		
636	MUELLER	CENTURION	2014	1349 LAUREL LOOP	3		
64	MUELLER	CENTURION	1981	NORTHEAST CORNER OF T J WRIGHT ST AND W LOCUS ST			Х
65	MUELLER	IMPROVED	1946	NORTHWEST CORNER OF N HANCOCK ST AND W LIVE OAK ST	2	2	
66	MUELLER	CENTURION	1981	18 T J WRIGHT ST			Х
67	MUELLER	CENTURION	1981	612 T J WRIGHT ST		1	
68	MUELLER	CENTURION	1981	NORTHWEST CORNER OF N PARISH ST AND W LIVE OAK			Х
69	MUELLER	CENTURION	1981	523 N PARISH ST			Х
72	MUELLER	IMPROVED	1946	300 N COLUMBIA ST		2	Х
73	MUELLER	CENTURION	1981	220 N WALKER ST			Х
747	MUELLER	CENTURION	2019	ACROSS FROM 825 SOUTHSIDE DR	2		
77	MUELLER	CENTURION	1981	NORTHEAST CORNER OF CEDAR AND W COLUMBIA		1	
774	MUELLER	CENTURION	2021	216 BRYAN WAY	3		
775	MUELLER	CENTURION	2021	3 LAGO CT			Х
78	MUELLER	STANDARD	1957	700 W LIVE OAK ST		1	
79	MUELLER	CENTURION	1980	819 MARSHALL RD		1	Х
80	MUELLER	CENTURION	1976	828 W LIVE OAK ST			Х

Page 8 of 9

#### **CITY OF ANGLETON**

#### 29-Jan-25

View Associated Work Orders \_

29-Jan-25

Ξ

HYDRA	NT MAKE	MODEL	YEAR	HYDRANT LOCATION		CHAINS NEEDED		CONNECT S-HOOKS
83	MUELLER	IMPROVED	1967	700 W ASH ST				Х
830	MUELLER	CENTURION	2017	800 PATTEN RD		3		
900	MUELLER	CENTURION	2019	130 AUSTIN RD				Х
902	MUELLER	CENTURION	2021	42 YARDS EAST FROM THE SOUTHEAST C GREENBRIAR LP AND BRYAN WAY	ORNER OF	2		
					HYDRANTS	CHAINS NEEDED		CONNECT S-HOOKS
				TOTALS:	220	235	176	146

# **16. HYDRANTS NEEDING PAINT**

## **Hydrants Needing Paint**

29-Jan-25

HYDRANT	MAKE	MODEL	LOCATION
116	MUELLER	CENTURION	501 S MORGAN ST
119	MUELLER	CENTURION	SW CORNER OF S ANDERSON ST AND RICE ST
14	MUELLER	CENTURION	820 W MULBERRY ST
147	MUELLER	CENTURION	217 BEECHNUT ST
156	MUELLER	CENTURION	2609 S VELASCO ST
164	MUELLER	CENTURION	120 E PHILLIPS RD
183	MUELLER	CENTURION	1712 SHANKS RD
191	MUELLER	CENTURION	SOUTH END OF OF SHANKS RD
222	MUELLER	CENTURION	137 PRAIRIE LEA DR
224	MUELLER	CENTURION	237 PRAIRIE LEA DR
25	MUELLER	CENTURION	474 COUTY RD 609 - WATER TREATMENT PLANT
267	MUELLER	CENTURION	1116 WAYNE ST
278	MUELLER	CENTURION	111 WALLER LOOP
28	MUELLER	CENTURION	2400 W MULBERRY ST
284	MUELLER	CENTURION	2760 BRAZOS PKWY - SOUTH EAST SIDE OF PROPERTY
288	MUELLER	CENTURION	NORTHWEST CORNER OF S VELASCO AND CEMETERY RD
289	MUELLER	CENTURION	SOUTHWEST CORNER OF S VELASCO AND CEMETERY RD
290	MUELLER	CENTURION	1128 S VELASCO
295	MUELLER	CENTURION	1600 S VELASCO ST
296	MUELLER	CENTURION	145 W PHILLIPS ST
305	MUELLER	CENTURION	237 BASTROP ST

## **Hydrants Needing Paint**

29-Jan-25

HYDRANT	MAKE	MODEL	LOCATION
310	MUELLER	CENTURION	6 DALLAS CT
327	MUELLER	IMPROVED	224 E HOSPITAL DR
406	MUELLER	IMPROVED	1524 E MULBERRY ST - ACROSS FROM SOUTHEAST CORNER OF BUILDING
43	MUELLER	CENTURION	ACROSS FROM 103 W MUNSON ST
48	MUELLER	CENTURION	41885 HWY 288 - STEPHEN F AUSTIN MEMORIAL PARK
51	MUELLER	STANDARD	608 CATALPA ST
510	MUELLER	CENTURION	603 N TINSLEY
547	MUELLER	IMPROVED	NORTHWEST CORNER OF E MAGNOLIA ST AND N ANDERSON ST
555	MUELLER	IMPROVED	ACROSS FROM 500 N CHENANGO
571	MUELLER	IMPROVED	421 S VELASCO ST
58	MUELLER	IMPROVED	SOUTHWEST CORNER OF W MULBERRY AND S COLUMBIA ST
59	MUELLER	CENTURION	SOUTHWEST CORNER OF W MULBERRY ST AND S PARISH ST
749	MUELLER	CENTURION	883 OAK RIDGE DR
750,751	MUELLER	CENTURION	870 OAK RIDGE DR
752	MUELLER	CENTURION	854 OAK RIDGE DR
905	MUELLER	CENTURION	820 S ANDERSON ST
913	DARLING	B84B-5	1281 LAUREL LOOP
929	MUELLER	CENTURION	1320 E KIBER ST
931	MUELLER	CENTURION	1393 S VELASCO ST

Total: 40

## 17. MISSING/REPLACE ISOLATION VALVE COVER

## **Missing/Replace Isolation Valve Covers**

29-Jan-25

HYDRANT	ISO VALVE LOCATION	LOCATION
115	F1	301 RICE ST
622	F1	1233 CALDWELL RD
198	F2	1621 WILBERT RD
169	F1	1423 S VELASCO ST
295	F1	1600 S VELASCO ST
272	F1	ACROSS FROM 1501 S FRONT ST
47	F3	716 MUNSON PL
407	F2	1524 E MULBERRY ST - NORTH SIDE OF BUILDING
406	F2	1524 E MULBERRY ST - ACROSS FROM SOUTHEAST CORNER OF BUILDING

Total: 9

## 18. ISO CONDITION CLASSIFICATIONS

NOT USABLE USABLE STANDARD

# NOT USABLE

## Not Usable Report

View Associated Work Orders

HYDRANT	MAKE	MODEL	YEAR	LOCATION
140	MUELLER	IMPROVED	1946	NORTHWEST CORNER OF SIMS AND E KIBER ST
156	MUELLER	CENTURION	1981	2609 S VELASCO ST
176	MUELLER	CENTURION	1987	ACROSS FROM 725 CAHILL RD
194	MUELLER	CENTURION	1978	1000 KADERA RD
264	MUELLER	CENTURION	1970	NORTHEAST CORNER OF S FRONT AND CEMETERY RD
305	MUELLER	CENTURION		237 BASTROP ST
407	MUELLER	IMPROVED	1974	1524 E MULBERRY ST - NORTH SIDE OF BUILDING
43	MUELLER	CENTURION	2024	ACROSS FROM 103 W MUNSON ST
480	MUELLER	IMPROVED	1975	NORTHWEST CORNER OF N DOWNING AN E MILLER
513	MUELLER	IMPROVED	1972	NORTHWEST CORNER OF N VALDERAS ST AND MILLER ST
53	MUELLER	IMPROVED	1976	NORTHEAST CORNER OF W PLUM ST AND S ERSKINE ST
547	MUELLER	IMPROVED	1953	NORTHWEST CORNER OF E MAGNOLIA ST AND N ANDERSON ST
570	WATEROUS	PACER	1927	SOUTHWEST CORNER OF S CHENANGO ST AND MURRAY ST
580	WATEROUS	PACER	1927	NORTHEAST CORNER OF S ARCOLA ST AND E ORANGE ST
582	MUELLER	CENTURION	2005	NORTHEAST CORNER OF E ORANGE ST AND S ANDERSON ST
929	MUELLER	CENTURION	2023	1320 E KIBER ST

#### \* HYDRANT.COM ASSESSED CONDITION OF HYDRANTS. CONDITIONS ARE NOT ASSIGNED BY INSURANCE SERVICES OFFICE

Total: 16

30-Jan-25

Page 1 of 1

# USABLE

View Associated Work Orders

#### HYDRANTS WHICH HAVE SOME DEFECTS AND/OR IMPEDIMENTS TO USE

#### \* HYDRANT.COM ASSESSED CONDITION OF HYDRANTS. CONDITIONS ARE NOT ASSIGNED BY INSURANCE SERVICES OFFICE

29-Jan-25

HYDRANT	MAKE	MODEL	YEAR	LOCATION
11	CLOW	MEDALLION	2000	800 ENCHANTED OAKS DR
196	MUELLER	CENTURION	1980	824 KADERA
571	MUELLER	IMPROVED	1953	421 S VELASCO ST
228	MUELLER	IMPROVED		1060 VINE DR
124	MUELLER	CENTURION	1979	SOUTHEAST CORNER OF S DOWNING RD AND FAIRGROUND LN
199	MUELLER	CENTURION	1983	1100 CEMETERY RD - HYDRANT ON GIFFORD RD
200	MUELLER	CENTURION	1980	1361 GIFFORD RD
201	MUELLER	CENTURION	1976	1200 GIFFORD RD
221	MUELLER	CENTURION	1983	101 PRAIRIE LEA DR
222	MUELLER	CENTURION	1983	137 PRAIRIE LEA DR
223	MUELLER	CENTURION	1983	205 PRAIRIE LEA DR
220	MUELLER	CENTURION	1983	245 BALD PRARIE DR
461	MUELLER	IMPROVED	1966	SOUTHWEST CORNER OF E MULBERRY AND WILDCAT DR
174	MUELLER	CENTURION	1980	WEST INTERSECTION OF SHANKS RD AND CAHILL RD
905	MUELLER	CENTURION	1983	820 S ANDERSON ST
203	MUELLER	CENTURION	1980	16 GRACE ST
206	MUELLER	CENTURION	1981	ACROSS FROM 321 E PHILLIPS RD
205	MUELLER	CENTURION	1981	282 E PHILLIPS RD
183	MUELLER	CENTURION	2008	1712 SHANKS RD

Page 1 of 6

View Associated Work Orders

#### HYDRANTS WHICH HAVE SOME DEFECTS AND/OR IMPEDIMENTS TO USE

#### \* HYDRANT.COM ASSESSED CONDITION OF HYDRANTS. CONDITIONS ARE NOT ASSIGNED BY INSURANCE SERVICES OFFICE

29-Jan-25

HYDRANT	MAKE	MODEL	YEAR	LOCATION
153	MUELLER	CENTURION	1981	2816 S VELASCO ST
157	MUELLER	CENTURION	1981	2521 S VELASCO
152	MUELLER	CENTURION	2022	2404 S VELASCO ST
160	MUELLER	CENTURION	1981	2213 S VELASCO ST
161	MUELLER	CENTURION	1981	2123 S VELASCO ST
150	MUELLER	CENTURION	1981	97 LOSTROCCO ST
165	MUELLER	CENTURION	1981	2021 S VELASCO ST
219	MUELLER	CENTURION	1983	205 BALD PRAIRIE DR
128	MUELLER	IMPROVED	1960	621E MURRAY ST
927	MUELLER	CENTURION	2023	240 HOUSTON ST
928	MUELLER	CENTURION	2022	212 HOUSTON ST
327	MUELLER	IMPROVED	1966	224 E HOSPITAL DR
318	MUELLER	CENTURION	1984	108 DEBORAH DR
319	MUELLER	CENTURION	1984	112 DEBORAH DR
313	MUELLER	CENTURION	2004	1980 E MULBERRY ST
309	MUELLER	IMPROVED	1966	172 HOUSTON ST
308	MUELLER	IMPROVED	1966	128 HOUSTON ST
306	MUELLER	CENTURION	1976	157 HOUSTON ST
303	MUELLER	CENTURION	1976	276 AUSTIN ST

View Associated Work Orders

#### HYDRANTS WHICH HAVE SOME DEFECTS AND/OR IMPEDIMENTS TO USE

#### \* HYDRANT.COM ASSESSED CONDITION OF HYDRANTS. CONDITIONS ARE NOT ASSIGNED BY INSURANCE SERVICES OFFICE

29-Jan-25

HYDRANT	MAKE	MODEL	YEAR	LOCATION
579	MUELLER	IMPROVED	1960	504 E PEACH ST
231	MUELLER	CENTURION	1983	SOUTHWEST CORNER OF DWYER ST AND S ANDERSON ST
573	MUELLER	IMPROVED	1956	103 E PEACH ST
119	MUELLER	CENTURION	1983	SW CORNER OF S ANDERSON ST AND RICE ST
123	MUELLER	CENTURION	1983	NORTHEAST CORNER OF E KIBER ST AND S ANDERSON ST
132	MUELLER	IMPROVED	1951	NORTHEAST INTERSECTION OF E KIBER ST AND FARRER ST
133	MUELLER	CENTURION	2021	408 EVANS ST
135	MUELLER	CENTURION	1986	1380 E KIBER ST
125	MUELLER	IMPROVED	1972	338 MUNSON CT
111	MUELLER	IMPROVED	1963	321 E KIBER ST
110	MUELLER	CENTURION	1982	109 E KIBER ST
235	MUELLER	CENTURION	1996	SOUTHWEST CORNER OF E KIBER ST AND S VELASCO
113	MUELLER	IMPROVED	1953	305 BERT ST
116	MUELLER	CENTURION	1995	501 S MORGAN ST
290	MUELLER	CENTURION	1981	1128 S VELASCO
574	MUELLER	IMPROVED	1946	NORTHWEST CORNER OF S CHENANGO AND E PEACH ST
1	MUELLER	IMPROVED	1962	1105 WESTERN AVE
78	MUELLER	STANDARD	1957	700 W LIVE OAK ST
168	MUELLER	CENTURION	1981	1417 S VELASCO ST

Page 3 of 6

View Associated Work Orders

#### HYDRANTS WHICH HAVE SOME DEFECTS AND/OR IMPEDIMENTS TO USE

#### \* HYDRANT.COM ASSESSED CONDITION OF HYDRANTS. CONDITIONS ARE NOT ASSIGNED BY INSURANCE SERVICES OFFICE

29-Jan-25

HYDRANT	MAKE	MODEL	YEAR	LOCATION
79	MUELLER	CENTURION	1980	819 MARSHALL RD
76	MUELLER	CENTURION	2006	705 N COLUMBIA ST
70	MUELLER	CENTURION	2003	SOUTHEAST CORNER OF W MILLER ST AND N PARISH ST
65	MUELLER	IMPROVED	1946	NORTHWEST CORNER OF N HANCOCK ST AND W LIVE OAK ST
28	MUELLER	CENTURION	2007	2400 W MULBERRY ST
750,751	MUELLER	CENTURION	2021	870 OAK RIDGE DR
635	MUELLER	CENTURION	2014	1333 LAUREL LOOP
630	MUELLER	CENTURION	2014	ACROSS FROM 1260 LAUREL LOOP
289	MUELLER	CENTURION	1981	SOUTHWEST CORNER OF S VELASCO AND CEMETERY RD
13	MUELLER	CENTURION	2003	1 OAK PARK DR
75	MUELLER	CENTURION	1981	629 W LOCUS ST
2	MUELLER	IMPROVED	1957	913 WESTERN AVE
3	MUELLER	IMPROVED	1957	801 WESTERN AVE
564	MUELLER	CENTURION	1998	NORTHEAST CORNER OF W MYRTLE ST AND N FRONT ST
567	MUELLER	CENTURION		SOUTHEAST CORNER OF N FRONT ST AND W LOCUS ST
554	MUELLER	IMPROVED	1946	131 E LIVE OAK ST
553	MUELLER	CENTURION	2012	SOUTHEAST CORNER OF E CEDAR ST AND N VALDERAS ST
541	MUELLER	IMPROVED	1953	901 E MULBERRY ST
544	MUELLER	CENTURION	2002	445 E MULBERRY ST

Page 4 of 6

View Associated Work Orders

#### HYDRANTS WHICH HAVE SOME DEFECTS AND/OR IMPEDIMENTS TO USE

#### \* HYDRANT.COM ASSESSED CONDITION OF HYDRANTS. CONDITIONS ARE NOT ASSIGNED BY INSURANCE SERVICES OFFICE

29-Jan-25

HYDRANT	MAKE	MODEL	YEAR	LOCATION
535	MUELLER	IMPROVED	1960	600 E CEDAR ST
534	MUELLER	CENTURION	1994	804 CINCINNATI
532	MUELLER	IMPROVED	1957	501 N PECAN ST
34	MUELLER	CENTURION	2003	1009 ENCHANTED OAKS DR
705	MUELLER	CENTURION	2016	110 YARDS WEST FROM THE NORTHWEST CORNER OF 288 BUSINESS AND CO RD 220
533	MUELLER	IMPROVED		918 E CEDAR ST
291	MUELLER	CENTURION	1981	1212 S VELASCO ST
266	MUELLER	CENTURION	1981	SOUTHWEST CORNER OF S FRONT ST AND WAYNE DR
269	MUELLER	CENTURION	1981	1203 S FRONT ST
270	MUELLER	CENTURION	1981	1421 S FRONT ST - ACROSS FROM NW CORNER OF PROPERTY
277	MUELLER	CENTURION	1992	344 W PHILLIPS RD
278	MUELLER	CENTURION	1992	111 WALLER LOOP
279	MUELLER	CENTURION	1992	217 WALLER LOOP
147	MUELLER	CENTURION	1981	217 BEECHNUT ST
80	MUELLER	CENTURION	1976	828 W LIVE OAK ST
283	MUELLER	CENTURION	1981	ACROSS FROM 2609 S FRONT ST
74	MUELLER	CENTURION	1976	110 N WALKER ST
276	MUELLER	CENTURION	1981	173 WEST PHILLIPS
37	MUELLER	CENTURION	1980	520 BRYAN ST

Page 5 of 6

View Associated Work Orders

#### HYDRANTS WHICH HAVE SOME DEFECTS AND/OR IMPEDIMENTS TO USE

### \* HYDRANT.COM ASSESSED CONDITION OF HYDRANTS. CONDITIONS ARE NOT ASSIGNED BY INSURANCE SERVICES OFFICE

29-Jan-25

HYDRANT	MAKE	MODEL	YEAR	LOCATION
23	MUELLER	IMPROVED	1953	629 HOLLY ST
21	MUELLER	CENTURION	1983	305 W PEACH ST
20	MUELLER	CENTURION	1983	202 S WALKER ST
58	MUELLER	IMPROVED	1953	SOUTHWEST CORNER OF W MULBERRY AND S COLUMBIA ST
61	MUELLER	IMPROVED	1971	SOUTHEAST CORNER OF W MYRTLE ST AND T J WRIGHT ST
64	MUELLER	CENTURION	1981	NORTHEAST CORNER OF T J WRIGHT ST AND W LOCUS ST
66	MUELLER	CENTURION	1981	18 T J WRIGHT ST
67	MUELLER	CENTURION	1981	612 T J WRIGHT ST
72	MUELLER	IMPROVED	1946	300 N COLUMBIA ST
71	MUELLER	IMPROVED	1946	SOUTHEAST CORNER OF N COLUMBUS ST AND W LIVE OAK ST
149	MUELLER	CENTURION	1981	SOUTH INTERSECTION OF BEECHNUT ST AND CHESTNUT ST
543	WATERMASTER	5CD250	2008	105 N ROCK ISLAND ST
560	WATEROUS		1927	126 N VELASCO ST

#### \* HYDRANT.COM ASSESSED CONDITION OF HYDRANTS. CONDITIONS ARE NOT ASSIGNED BY INSURANCE SERVICES OFFICE

**Total: 108** 

Page 6 of 6

# STANDARD

HYDRANTS HAVE NO LEAKS, OPEN EASILY, ARE CONSPICUOUS AND WELL LOCATED FOR USE BY PUMPER \* HYDRANT.COM ASSESSED CONDITION OF HYDRANTS. CONDITIONS ARE NOT ASSIGNED BY INSURANCE SERVICES OFFICE

29-Jan-25

HYDRANT	MAKE	MODEL	YEAR	LOCATION
12	CLOW	MEDALLION	2000	904 ENCHANTED OAKS DR
645	CLOW	MEDALLION	2013	976 ANCHOR RD - SOUTH EAST CORNER OF PROPERTY NEXT TO ENTRANCE - HYD ON ENCHANTED OAKS
214	CLOW	MEDALLION	2000	1516 GIFFORD LN
312	CLOW	MEDALLION	1999	SOUTHEAST CORNER OF JAMISON RD AND E MULBERRY ST
213	CLOW	MEDALLION	2000	1408 GIFFORD LN
212	CLOW	MEDALLION	2000	1325 GIFFORD LN
211	CLOW	MEDALLION	2000	1301 GIFFORD LN
9	CLOW	MEDALLION	2000	ACROSS FROM 1007 SPREADING OAKS DR
10	CLOW	MEDALLION	2000	1 SPREADING OAKS CT
465	CLOW	MEDALLION	2000	901 NOTTINGHAM DR
914	DARLING	B84B-5	2016	ACROSS FROM 1302 LAUREL LOOP
913	DARLING	B84B-5	2016	1281 LAUREL LOOP
121	MUELLER	CENTURION	2019	1020 PARK LN
173	MUELLER	IMPROVED	1967	328 CEMETERY RD - ENTRANCE TO CEMETERY
230	MUELLER	CENTURION	1983	328 CEMETERY RD - ACROSS FROM FLAG DISPOSAL BOX
171	MUELLER	CENTURION	2022	SOUTHEAST CORNER OF S VELASCO ST AND CEMETERY RD
745	MUELLER	CENTURION	2019	1000 SOUTHSIDE DR
747	MUELLER	CENTURION	2019	ACROSS FROM 825 SOUTHSIDE DR
746	MUELLER	CENTURION	2019	1009 SOUTHSIDE DR
225	MUELLER	CENTURION	2019	NORTHWEST CORNER OF SOUTHSIDE DR AND E CEMETERY RD
172	MUELLER	CENTURION	2023	ACROSS FROM 105 CEMETERY RD
114	MUELLER	CENTURION	1992	301 LAURIE LN
773	MUELLER	CENTURION	2021	308 BRYAN WAY
775	MUELLER	CENTURION	2021	3 LAGO CT
774	MUELLER	CENTURION	2021	216 BRYAN WAY
141	MUELLER	IMPROVED	1962	NORTHWEST CORNER OF RAMONA AND SIMS

HYDRANTS HAVE NO LEAKS, OPEN EASILY, ARE CONSPICUOUS AND WELL LOCATED FOR USE BY PUMPER \* HYDRANT.COM ASSESSED CONDITION OF HYDRANTS. CONDITIONS ARE NOT ASSIGNED BY INSURANCE SERVICES OFFICE 29-Jan-25

HYDRANT	MAKE	MODEL	YEAR	LOCATION
142	MUELLER	CENTURION	2022	1258 PYBURN ST
144	MUELLER	IMPROVED	1953	NORTHEAST CORNER OF E KIBER ST AND DOWNING RD
143	MUELLER	IMPROVED	1953	509 S DOWNING RD
120	MUELLER	CENTURION	1990	1011 S ANDERSON ST
112	MUELLER	IMPROVED	1964	321 SANDS ST
229	MUELLER	CENTURION	1983	1060 GROVE DR
115	MUELLER	IMPROVED	1962	301 RICE ST
117	MUELLER	CENTURION	1976	853 S VALDERAS ST
118	MUELLER	CENTURION	1983	712 S ANDERSON ST
232	MUELLER	IMPROVED	1966	502 DWYER ST
233	MUELLER	CENTURION	2018	1009 S VELASCO ST - NEXT TO DRAINAGE DITCH
234	MUELLER	CENTURION	2016	901 S VELASCO ST - SOUTH OF PROPERTY
42	MUELLER	CENTURION	1980	NORTHEAST CORNER OF S FRONT ST AND W MUNSON ST
771	MUELLER	CENTURION	2021	77 YARDS EAST FROM THE NORTHEAST CORNER OF LISA MARIE DR AND GIFFORD RD
134	MUELLER	IMPROVED	1962	901 S DOWNING RD
204	MUELLER	CENTURION	1981	238 E PHILLIPS RD
227	MUELLER	CENTURION	1989	NORTHWEST CORNER OF CEMETERY RD AND PARK LN
192	MUELLER	CENTURION	2022	1503 ALENA RD
195	MUELLER	CENTURION	1981	1629 ALENA RD
193	MUELLER	CENTURION	1978	SOUTHWEST CORNER OF KADERA DR AND GIFFORD RD
210	MUELLER	CENTURION	1981	NORTHEAST CORNER OF SUNNY MEADOWS AND GIFFORD RD
209	MUELLER	CENTURION	1982	SOUTHEAST CORNER OF ROBERT ST AND GIFFORD RD
197	MUELLER	CENTURION	1987	SOUTHEAST CORNER OF KADERA RD AND WILBERT ST
207	MUELLER	CENTURION	1981	403 MEADOW ACRES DR
179	MUELLER	CENTURION	1980	SOUTHEAST CORNER OF SHANKS RD AND KADERA RD
182	MUELLER	CENTURION	1982	1820 SHANKS RD

HYDRANTS HAVE NO LEAKS, OPEN EASILY, ARE CONSPICUOUS AND WELL LOCATED FOR USE BY PUMPER \* HYDRANT.COM ASSESSED CONDITION OF HYDRANTS. CONDITIONS ARE NOT ASSIGNED BY INSURANCE SERVICES OFFICE 29-Jan-25

HYDRANT	MAKE	MODEL	YEAR	LOCATION
181	MUELLER	CENTURION	1982	1916 SHANKS RD
180	MUELLER	CENTURION	1981	NORTHWEST CORNER OF SHANKS RD AND E PHILLIPS RD
164	MUELLER	CENTURION	1981	120 E PHILLIPS RD
162	MUELLER	CENTURION	1981	SOUTHWEST CORNER OF SHANKS RD AND IDEN RD
184	MUELLER	CENTURION	1982	2218 SHANKS RD
186	MUELLER	CENTURION	1981	2218 SHANKS RD - SOUTH OF PROPERTY
208	MUELLER	CENTURION	1982	1811 GIFFORD RD - SOUTH OF PROPERTY
224	MUELLER	CENTURION	2024	237 PRAIRIE LEA DR
772	MUELLER	CENTURION	2022	NORTHWEST INTERSECTION OF GREENBRIAR LP AND BRYAN WAY
622	MUELLER	CENTURION	2014	1233 CALDWELL RD
126	MUELLER	CENTURION	2023	330 S ANDERSON ST
906	MUELLER	CENTURION	2021	235 LISA MARIE DR
770	MUELLER	CENTURION	2021	ACROSS FROM 272 LAURA LEIGH LN
907	MUELLER	CENTURION	2021	237 LAURA LEIGH LN
198	MUELLER	CENTURION	1981	1621 WILBERT RD
202	MUELLER	CENTURION	2023	1024 HOELEWYN DR
226	MUELLER	CENTURION	1981	ACROSS FROM 928 CEMETERY RD
218	MUELLER	CENTURION	1983	137 BALD PRAIRIE DR
217	MUELLER	CENTURION	1983	101 BALD PRAIRIE DR
215	MUELLER	CENTURION	1980	1505 GIFFORD RD
216	MUELLER	CENTURION	1984	1304 FAIR DR
175	MUELLER	CENTURION	1981	614 CAHILL RD
177	MUELLER	CENTURION	1980	328 CEMETERY RD - HYDRANT ON SHANKS RD - NEXT TO SOUTH EAST ENTRANCE TO CEMETERY
178	MUELLER	CENTURION	1980	1500 SHANKS RD
908	MUELLER	CENTURION	2021	201 LAURA LEIGH LN
909	MUELLER	CENTURION	2015	COALE RD FEEDER BETWEEN 288 AND S FRONT ST - SOUTHWEST CORNER OF WAREHOUSE DEVELOPMENT PROPERTY

Page 3 of 12

HYDRANTS HAVE NO LEAKS, OPEN EASILY, ARE CONSPICUOUS AND WELL LOCATED FOR USE BY PUMPER \* HYDRANT.COM ASSESSED CONDITION OF HYDRANTS. CONDITIONS ARE NOT ASSIGNED BY INSURANCE SERVICES OFFICE

29-Jan-25

HYDRANT	MAKE	MODEL	YEAR	LOCATION
479	MUELLER	CENTURION	1997	NORTHWEST CORNER OF MORNINGSIDE ST AND DANBURY ST
464	MUELLER	IMPROVED	1974	1117 NOTTINGHAM DR
648	MUELLER	CENTURION	2014	1117 ROBINHOOD LN
647	MUELLER	CENTURION	2014	1009 ROBINHOOD LN
644	MUELLER	CENTURION	2022	821 MILLER ST
511	MUELLER	IMPROVED	1970	723 N ROCK ISLAND
324	MUELLER	IMPROVED	1967	ACROSS FROM 170 E HOSPITAL DR
926	MUELLER	CENTURION	2023	1925 ALAMO DR
476	MUELLER	CENTURION	2012	SOUTHWEST CORNER OF WALCIK LN AND E MULBERRY ST
328	MUELLER	CENTURION	1994	2700 TX-35
320	MUELLER	IMPROVED	1967	120 E HOSPITAL DR (NORTHEAST CORNER OF PROPERTY)
641	MUELLER	CENTURION	1987	132 E HOSPITAL DR - SOUTHWEST CORNER OF PROPERTY NEXT TO TREE
321	MUELLER	CENTURION	1980	132 E HOSPITAL DR
322	MUELLER	CENTURION	1987	132 E HOSPITAL DR -
129	MUELLER	IMPROVED	1976	600 EARLS CT
512	MUELLER	IMPROVED	1970	510 MILLER ST
930	MUELLER	CENTURION	2022	1040 S ANDERSON ST
640	MUELLER	CENTURION	2014	901 ROBINHOOD LN
920	MUELLER	CENTURION	2023	1013 CHEVY CHASE DR
921	MUELLER	CENTURION	2023	1117 CHEVY CHASE DR
474	MUELLER	IMPROVED	1975	1200 CHEVY CHASE DR
931	MUELLER	CENTURION	2018	1393 S VELASCO ST
932	MUELLER	CENTURION	2022	301 E MAGNOLIA ST
481	MUELLER	IMPROVED	1946	615 DANBURY ST
934	MUELLER	CENTURION	2022	303 E LOCUST ST
477	MUELLER	IMPROVED	1953	SOUTHWEST CORNER OF E PECAN ST AND E MULBERRY ST

HYDRANTS HAVE NO LEAKS, OPEN EASILY, ARE CONSPICUOUS AND WELL LOCATED FOR USE BY PUMPER \* HYDRANT.COM ASSESSED CONDITION OF HYDRANTS. CONDITIONS ARE NOT ASSIGNED BY INSURANCE SERVICES OFFICE 29-Jan-25

2 <b>9-</b> Jun-2J				
HYDRANT	MAKE	MODEL	YEAR	LOCATION
935	MUELLER	CENTURION	2022	304 E LIVE OAK
923	MUELLER	CENTURION	2023	213 DALLAS ST
924	MUELLER	CENTURION	2023	241 DALLAS ST
925	MUELLER	CENTURION	2023	1901 ALAMO DR
409	MUELLER	IMPROVED	1966	1739 E MULBERRY ST
473	MUELLER	CENTURION	1998	SOUTHWEST CORNER OF E MULBERRY ST AND SAN FELIPE ST
325	MUELLER	IMPROVED	1966	7 RAYBURN RIDGE
933	MUELLER	CENTURION	2022	SOUTHWEST CORNER OF N ARCOLA ST AND E LOCUST ST
572	MUELLER	CENTURION	1979	216 E PLUM ST
130	MUELLER	IMPROVED	1950	201 FARRER ST
581	MUELLER	IMPROVED	1953	445 E ORANGE ST
575	MUELLER	IMPROVED	1978	NORTHWEST CORNER OF E ORANGE ST AND S CHENANGO ST
576	MUELLER	IMPROVED	1953	NORTHEAST CORNER OF HWY 288 BUSINESS AND E ORANGE ST
568	MUELLER	IMPROVED	1960	SOUTHEAST CORNER OF W ORANGE ST AND S FRONT ST
578	MUELLER	IMPROVED	1953	234 S ARCOLA ST
323	MUELLER	CENTURION	1999	140 E HOSPITAL DR
577	MUELLER	CENTURION	2002	SOUTHWEST CORNER OF E MULBERRY ST AND S CHENANGO ST
404	MUELLER	IMPROVED	1974	SOUTH INTERSECTION OF E CEDAR ST AND E MIMOSA ST
904	MUELLER	CENTURION	2013	444 E MULBERRY ST
187	MUELLER	CENTURION	1981	2801 SHANKS RD
127	MUELLER	IMPROVED	1960	620 E PLUM ST
185	MUELLER	CENTURION	1981	2328 SHANKS RD
131	MUELLER	IMPROVED	1950	409 FARRER ST
902	MUELLER	CENTURION	2021	42 YARDS EAST FROM THE SOUTHEAST CORNER OF GREENBRIAR LP AND BRYAN WAY
569	MUELLER	IMPROVED	1960	NORTHEAST CORNER OF W PEACH ST AND S FRONT ST
304	MUELLER	CENTURION	1973	EAST END OF BASTROP ST

HYDRANTS HAVE NO LEAKS, OPEN EASILY, ARE CONSPICUOUS AND WELL LOCATED FOR USE BY PUMPER \* HYDRANT.COM ASSESSED CONDITION OF HYDRANTS. CONDITIONS ARE NOT ASSIGNED BY INSURANCE SERVICES OFFICE 29-Jan-25

HYDRANT	MAKE	MODEL	YEAR	LOCATION
326	MUELLER	CENTURION	1984	220 E HOSPITAL DR
317	MUELLER	CENTURION	1981	108 DEBORAH DR
316	MUELLER	CENTURION	1983	124 KNIGHT ST
315	MUELLER	CENTURION	1985	116 KNIGHT ST
314	MUELLER	CENTURION	1985	108 KNIGHT DR
311	MUELLER	IMPROVED	1969	133 DALLAS ST
139	MUELLER	IMPROVED	1953	NORTHEAST INTERSECTION OF S DOWNING ST AND E ORANGE ST
307	MUELLER	CENTURION	1976	109 BASTROP ST
403	MUELLER	IMPROVED	1974	SOUTHWEST CORNER OF CEDAR ST AND E MULBERRY ST
302	MUELLER	CENTURION	2014	240 AUSTIN ST
900	MUELLER	CENTURION	2019	130 AUSTIN RD
901	MUELLER	CENTURION	2020	106 AUSTIN RD
299	MUELLER	CENTURION	2018	21039 COUNTY RD 171
300	MUELLER	CENTURION	1989	20799 COUNTY RD 171 - NEXT TO SIGN
298	MUELLER	IMPROVED	1978	SOUTH CORNER OF FM 210 AND ANGLETON DANBURY RD
903	MUELLER	CENTURION	2021	NORTHEAST CORNER OF GREENBRIAR LOOP
310	MUELLER	CENTURION	2023	6 DALLAS CT
634	MUELLER	CENTURION	2014	1317 LAUREL LOOP
749	MUELLER	CENTURION	2021	883 OAK RIDGE DR
748	MUELLER	CENTURION	2021	303 OAK RIDGE DR
29	MUELLER	CENTURION	2003	SOUTH CORNER OF OAK RIDGE DR AND ENCHANTED OAKS DR
30	MUELLER	CENTURION	2003	1000 SHADY OAK DR
				1016 SHADY OAK DR
31	MUELLER	CENTURION	2007	
32	MUELLER	CENTURION	2007	1112 SHADY OAK DR
4	MUELLER	CENTURION	1998	NORTHWEST CORNER OF HERITAGE OAKS DR AND WESTERN AVE
636	MUELLER	CENTURION	2014	1349 LAUREL LOOP

HYDRANTS HAVE NO LEAKS, OPEN EASILY, ARE CONSPICUOUS AND WELL LOCATED FOR USE BY PUMPER \* HYDRANT.COM ASSESSED CONDITION OF HYDRANTS. CONDITIONS ARE NOT ASSIGNED BY INSURANCE SERVICES OFFICE 29-Jan-25

29-Jun-23				
HYDRANT	MAKE	MODEL	YEAR	LOCATION
624	MUELLER	CENTURION	2014	810 OAK RIDGE DR
631	MUELLER	CENTURION	2014	1249 LAUREL LOOP
649	MUELLER	CENTURION	1999	608 HERITAGE OAKS DR
8	MUELLER	CENTURION	1998	805 HERITAGE OAKS DR
7	MUELLER	CENTURION	1998	ACROSS FROM 904 HERITAGE OAKS DR
36	MUELLER	CENTURION	2015	ACROSS FROM 1005 HERITAGE OAKS DR
189	MUELLER	CENTURION	1981	ACROSS FROM 2615 SHANKS RD
33	MUELLER	CENTURION	2007	1100 SOUTHERN OAKS DR
27	MUELLER	CENTURION	2003	2304 W MULBERRY ST
73	MUELLER	CENTURION	1981	220 N WALKER ST
82	MUELLER	CENTURION	2004	WEST END OF W MILLER ST
83	MUELLER	IMPROVED	1967	700 W ASH ST
81	MUELLER	CENTURION	2003	SOUTHEAST CORNER OF W MILLER ST AND N WALKER ST
60	MUELLER	CENTURION	1998	NORTHWEST CORNER OF N HANCOCK ST AND W MYRTLE ST
14	MUELLER	CENTURION	2023	820 W MULBERRY ST
752	MUELLER	CENTURION	2021	854 OAK RIDGE DR
16	MUELLER	IMPROVED	1966	1116 W MULBERRY ST
753	MUELLER	CENTURION	2021	838 OAK RIDGE DR
25	MUELLER	CENTURION	2023	474 COUTY RD 609 - WATER TREATMENT PLANT
626	MUELLER	CENTURION	2015	883 SPREADING OAKS DR
625	MUELLER	CENTURION	2015	ACROSS FROM 899 SPREADING OAKS DR
911	MUELLER	CENTURION	2015	904 SPREADING OAKS DR
912	MUELLER	CENTURION	2015	709 RUSTIC OAKS DR
646	MUELLER	CENTURION	2015	721 RUSTIC OAKS DR
5	MUELLER	CENTURION	1998	400 HERITAGE OAKS DR
15	MUELLER	IMPROVED	1967	1008 W MULBERRY

HYDRANTS HAVE NO LEAKS, OPEN EASILY, ARE CONSPICUOUS AND WELL LOCATED FOR USE BY PUMPER \* HYDRANT.COM ASSESSED CONDITION OF HYDRANTS. CONDITIONS ARE NOT ASSIGNED BY INSURANCE SERVICES OFFICE 29-Jan-25

HYDRANT	MAKE	MODEL	YEAR	LOCATION
538	MUELLER	CENTURION	1946	624 E MAGNOLIA ST
542	MUELLER	IMPROVED	1946	911 E MULBERRY ST
540	MUELLER	IMPROVED	1953	909 E MYRTLE ST
546	MUELLER	CENTURION	2006	503 E MYRTLE ST
549	MUELLER	IMPROVED	1959	427 E MAGNOLIA ST
548	MUELLER	CENTURION	2003	SOUTHEAST CORNER OF N MORGAN ST AND E LOCUS ST
545	MUELLER	CENTURION	2006	601 E MYRTLE ST
35	MUELLER	CENTURION	2005	1020 HERITAGE OAKS DR
536	MUELLER	CENTURION	2003	604 E LIVE OAK
550	MUELLER	CENTURION	2006	1208 N VELASCO ST
510	MUELLER	CENTURION	2023	603 N TINSLEY
406	MUELLER	IMPROVED	1974	1524 E MULBERRY ST - ACROSS FROM SOUTHEAST CORNER OF BUILDING
284	MUELLER	CENTURION	2004	2760 BRAZOS PKWY - SOUTH EAST SIDE OF PROPERTY
285	MUELLER	CENTURION	2005	2760 BRAZOS PKWY - NORTH SIDE OF PROPERTY
286	MUELLER	CENTURION	2004	NORTH END OF BRAZOS PKWY
138	MUELLER	IMPROVED	1950	901 S DOWNING ST - NORTH SIDE OF LIVESTOCK JUDGE SEATING AREA
537	MUELLER	IMPROVED	1960	603 E LOCUS ST
558	MUELLER	CENTURION	2023	NORTHWEST CORNER OF N CHENANGO ST AND E MAGNOLIA ST
6	MUELLER	CENTURION	1998	305 HERITAGE OAKS DR
632	MUELLER	CENTURION	2014	1217 LAUREL LOOP
633	MUELLER	CENTURION	2014	1233 LAUREL LOOP
26	MUELLER	CENTURION	1993	217 SEBESTA RD
563	MUELLER	IMPROVED	1946	130 W MULBERRY ST
565	MUELLER	CENTURION	1998	SOUTHEAST CORNER OF W MAGNOLIA ST AND N FRONT ST
539	MUELLER	IMPROVED	1953	937 E MULBERRY ST
557	MUELLER	IMPROVED	2022	136 E LOCUS ST

HYDRANTS HAVE NO LEAKS, OPEN EASILY, ARE CONSPICUOUS AND WELL LOCATED FOR USE BY PUMPER \* HYDRANT.COM ASSESSED CONDITION OF HYDRANTS. CONDITIONS ARE NOT ASSIGNED BY INSURANCE SERVICES OFFICE 29-Jan-25

HYDRANT	MAKE	MODEL	YEAR	LOCATION
552	MUELLER	IMPROVED	1953	301 E MAGNOLIA ST
561	MUELLER	IMPROVED	1978	136 E MYRTLE ST
562	MUELLER	CENTURION	2002	100 N VELASCO ST
559	MUELLER	IMPROVED	1953	300 N VELASCO ST
556	MUELLER	CENTURION	1976	111 E LOCUS ST - NEXT TO NO PARKING SIGN
555	MUELLER	IMPROVED	1978	ACROSS FROM 500 N CHENANGO
551	MUELLER	CENTURION	2002	305 E MULBERRY ST
68	MUELLER	CENTURION	1981	NORTHWEST CORNER OF N PARISH ST AND W LIVE OAK
566	MUELLER	IMPROVED	1960	SOUTHWEST CORNER OF W LOCUS ST AND N VELASCO ST
275	MUELLER	CENTURION	2022	SOUTHWEST INTERSECTION OF S FRONT ST AND JOHN DR
293	MUELLER	CENTURION	1981	288 S VELASCO ST - UNIT B
265	MUELLER	CENTURION	1981	ACROSS FROM 1099 S FRONT ST
267	MUELLER	CENTURION	1981	1116 WAYNE ST
268	MUELLER	CENTURION	1981	1306 WAYNE ST
271	MUELLER	CENTURION	1981	ACROSS FROM 1429 S FRONT ST
272	MUELLER	CENTURION	1981	ACROSS FROM 1501 S FRONT ST
77	MUELLER	CENTURION	1981	NORTHEAST CORNER OF CEDAR AND W COLUMBIA
274	MUELLER	CENTURION	2022	NORTHWEST INTERSECTION OF S FRONT ST AND KETCHUM DR
295	MUELLER	CENTURION	1981	1600 S VELASCO ST
281	MUELLER	CENTURION	2021	ACROSS FROM 2221 S FRONT ST
148	MUELLER	CENTURION	1981	113 LOSTRACCO ST
145	MUELLER	CENTURION	1981	100 WALNUT ST
145	MUELLER	CENTURION	1982	134 WALNUT ST
280	MUELLER	CENTURION	1981	NORTHEAST CORNER OF LOSTRACCO ST AND S FRONT ST
282	MUELLER	CENTURION	1981	ACROSS FROM 2329 S FRONT ST
273	MUELLER	CENTURION	2022	SOUTHWEST CORNER OF S FRONT ST AND YANCY RD

Page 9 of 12

HYDRANTS HAVE NO LEAKS, OPEN EASILY, ARE CONSPICUOUS AND WELL LOCATED FOR USE BY PUMPER \* HYDRANT.COM ASSESSED CONDITION OF HYDRANTS. CONDITIONS ARE NOT ASSIGNED BY INSURANCE SERVICES OFFICE 29-Jan-25

HYDRANT	MAKE	MODEL	YEAR	LOCATION
163	MUELLER	CENTURION	1981	2113 S VELASCO ST
919	MUELLER	CENTURION	2022	901 CHEVY CHASE DR
188	MUELLER	CENTURION	1981	2600 SHANKS RD
136	MUELLER	CENTURION	2022	1716 COUNTY RD 428 - NORTH WEST SIDE OF PROPERTY
191	MUELLER	CENTURION	2023	SOUTH END OF OF SHANKS RD
154	MUELLER	CENTURION	1981	2825 S VELASCO
155	MUELLER	CENTURION	1981	2713 S VELASCO
292	MUELLER	CENTURION	1981	1404 S VELASCO ST
159	MUELLER	CENTURION	1981	2317 S VELASCO ST
288	MUELLER	CENTURION	1973	NORTHWEST CORNER OF S VELASCO AND CEMETERY RD
151	MUELLER	CENTURION	1981	2288 S VELASCO ST
166	MUELLER	CENTURION	1981	2005 S VELASCO ST
167	MUELLER	CENTURION	1981	1725 S VELASCO ST
169	MUELLER	CENTURION	1981	1423 S VELASCO ST
170	MUELLER	CENTURION	1981	1401 S VELASCO ST
294	MUELLER	CENTURION	1981	1500 S VELASCO ST
296	MUELLER	CENTURION	1981	145 W PHILLIPS ST
158	MUELLER	CENTURION	1981	2425 S VELASCO ST
19	MUELLER	IMPROVED	1953	SOUTHEAST CORNER OF S WALKER ST AND W MULBERRY
706	MUELLER	CENTURION	2022	COALE RD FEEDER BETWEEN 288 AND S FRONT ST - EASTERN ENTRANCE TO WAREHOUSE DEVELOPMENT
22	MUELLER	CENTURION	1983	ACROSS FROM 300 S WALKER ST
56	MUELLER	CENTURION	1983	600 W PEACH ST
55	MUELLER	CENTURION	1981	504 W PEACH ST
57	MUELLER	CENTURION	1984	601 W ORANGE ST
830	MUELLER	CENTURION	2017	800 PATTEN RD
50	MUELLER	STANDARD	1955	500 CATALPA ST

Page 10 of 12

HYDRANTS HAVE NO LEAKS, OPEN EASILY, ARE CONSPICUOUS AND WELL LOCATED FOR USE BY PUMPER \* HYDRANT.COM ASSESSED CONDITION OF HYDRANTS. CONDITIONS ARE NOT ASSIGNED BY INSURANCE SERVICES OFFICE

20	La	. 25
29.	Jai	n-25

HYDRANT	MAKE	MODEL	YEAR	LOCATION
18	MUELLER	CENTURION	2010	ACROSS FROM 724 W MULBERRY ST
51	MUELLER	STANDARD		608 CATALPA ST
59	MUELLER	CENTURION	1981	SOUTHWEST CORNER OF W MULBERRY ST AND S PARISH ST
62	MUELLER	IMPROVED	1953	NORTHEAST CORNER OF W MULBERRY ST AND T J WRIGHT ST
63	MUELLER	CENTURION	1981	324 W MAGNOLIA ST
712	MUELLER	CENTURION	2016	206 N PARISH ST
713	MUELLER	CENTURION	2015	ACROSS FROM 221 N PARISH ST
714	MUELLER	CENTURION	2016	ACROSS FROM 409 N PARISH ST
190	MUELLER	CENTURION	1981	2412 SHANKS RD
17	MUELLER	CENTURION	1982	721 W MULBERRY ST
38	MUELLER	CENTURION	1981	504 BRYAN ST
69	MUELLER	CENTURION	1981	523 N PARISH ST
297	MUELLER	CENTURION	1981	SOUTHWEST CORNER OF W PHILLIPS AND S VELASCO ST
287	MUELLER	CENTURION	2004	1034 S VELASCO ST
54	MUELLER	IMPROVED	1973	220 W ORANGE ST
44	MUELLER	CENTURION	1980	600 S HANCOCK ST
41	MUELLER	CENTURION	1976	222 W MUNSON ST
24	MUELLER	CENTURION	1980	713 BETTY ST
39	MUELLER	CENTURION	1976	726 S ERSKINE ST
910	MUELLER	CENTURION	2016	2113 C.R. 220
49	MUELLER	CENTURION	1981	937 S WALKER ST
263	MUELLER	CENTURION	2013	1050 CRYSTAL ST
47	MUELLER	CENTURION	2005	716 MUNSON PL
831	MUELLER	CENTURION	2017	500 WARD RD
46	MUELLER	CENTURION	1995	727 S WALKER ST
45	MUELLER	CENTURION	1983	ACROSS FROM 700 S WALKER ST

HYDRANTS HAVE NO LEAKS, OPEN EASILY, ARE CONSPICUOUS AND WELL LOCATED FOR USE BY PUMPER

\* HYDRANT.COM ASSESSED CONDITION OF HYDRANTS. CONDITIONS ARE NOT ASSIGNED BY INSURANCE SERVICES OFFICE

HYDRANT	MAKE	MODEL	YEAR	LOCATION
52	MUELLER	IMPROVED	1955	641 W MIMOSA ST
40	MUELLER	CENTURION	1981	624 S HANCOCK ST

#### HYDRANT.COM ASSESSED CONDITION OF HYDRANTS. CONDITIONS ARE NOT ASSIGNED BY INSURANCE SERVICES OFFICE

**Total: 288** 

## 19. FIRE FLOW TEST DATA

Sorted by GPM available at 20 PSI

## **Fire Flow Test Data**

30-Jan-25

#### SORTED BY GPM @ 20 PSI

#### SINGLE HYDRANT USED FOR STATIC, RESIDUAL, AND FLOW READINGS PER NFPA 291 4.5.1

HYD	MAIN SIZE	DATE	STATIC PSI	FLOW PSI	HOSE GPM	GPM @ 20 PSI
286	12 INCH	1/27/2025	60	52	1210	2886
291	10 INCH	1/17/2025	57	49	1175	2687
174		1/17/2025	59	48	1163	2304
304	8 INCH	1/15/2025	60	48	1163	2228
773	8 INCH	1/15/2025	57	46	1140	2195
902		1/15/2025	58	46	1140	2124
177		1/17/2025	58	46	1138	2121
225	12 INCH	1/16/2025	57	45	1125	2066
906	8 INCH	1/16/2025	54	43	1101	2025
210	12 INCH	1/17/2025	54	43	1100	2023
121		1/16/2025	56	44	1110	2009
200		1/16/2025	58	45	1125	2008
147		1/23/2025	53	42	1088	1969
134		1/16/2025	55	43	1100	1961
205	12 INCH	1/17/2025	59	45	1126	1958
40		1/23/2025	50	40	1062	1922
116	6 INCH	1/16/2025	60	45	1126	1912
208		1/17/2025	54	42	1088	1909
148	6 INCH	1/23/2025	54	42	1088	1909
473		1/27/2025	54	42	1088	1909
546	8 NCH	1/27/2025	58	44	1113	1908
193	8 INCH	1/17/2025	56	43	1101	1908

Page 1 of 19

## **Fire Flow Test Data**

30-Jan-25

#### SORTED BY GPM @ 20 PSI

#### SINGLE HYDRANT USED FOR STATIC, RESIDUAL, AND FLOW READINGS PER NFPA 291 4.5.1

НҮД	MAIN SIZE	DATE	STATIC PSI	FLOW PSI	HOSE GPM	GPM @ 20 PSI
173	8 INCH	1/16/2025	56	43	1100	1907
230		1/16/2025	56	43	1100	1907
904	12 INCH	1/16/2025	56	43	1100	1907
705		1/23/2025	61	45	1126	1872
199		1/16/2025	55	42	1090	1861
644	6 INCH	1/27/2025	55	42	1088	1857
477	8 INCH	1/27/2025	60	44	1113	1826
648	8 INCH	1/27/2025	60	44	1113	1826
545		1/27/2025	60	44	1113	1826
267	8 INCH	1/23/2025	60	44	1113	1826
403		1/15/2025	60	44	1110	1821
216	8 INCH	1/16/2025	58	43	1101	1819
223		1/16/2025	58	43	1101	1819
117		1/16/2025	58	43	1101	1819
935		1/27/2025	58	43	1101	1819
562		1/27/2025	56	42	1090	1815
234	8 INCH	1/16/2025	56	42	1090	1815
771	8 INCH	1/16/2025	56	42	1088	1812
61		1/24/2025	54	41	1075	1807
155		1/17/2025	50	39	1050	1805
474		1/27/2025	59	43	1101	1781
119	8 INCH	1/16/2025	59	43	1101	1781

Page 2 of 19

30-Jan-25

#### SORTED BY GPM @ 20 PSI

#### SINGLE HYDRANT USED FOR STATIC, RESIDUAL, AND FLOW READINGS PER NFPA 291 4.5.1

HYD	MAIN SIZE	DATE	STATIC PSI	FLOW PSI	HOSE GPM	GPM @ 20 PSI
713	8 INCH	1/24/2025	57	42	1090	1775
64		1/24/2025	57	42	1090	1775
196	8 INCH	1/17/2025	57	42	1090	1775
227	12 INCH	1/16/2025	57	42	1090	1775
171		1/16/2025	57	42	1088	1772
76	12 INCH	1/24/2025	57	42	1088	1772
172		1/16/2025	57	42	1088	1772
923		1/15/2025	57	42	1088	1772
905	8 INCH	1/16/2025	55	41	1075	1763
42	8 INCH	1/16/2025	55	41	1075	1763
479	6 INCH	1/27/2025	53	40	1062	1756
568	8 INCH	1/15/2025	53	40	1062	1756
269		1/23/2025	53	40	1060	1753
270	12 INCH	1/23/2025	53	40	1060	1753
540	6 INCH	1/27/2025	60	43	1101	1748
197	8 INCH	1/17/2025	60	43	1101	1748
166	10 INCH	1/17/2025	60	43	1101	1748
233	8 INCH	1/16/2025	58	42	1090	1739
218		1/16/2025	58	42	1090	1739
179		1/17/2025	58	42	1088	1736
290		1/17/2025	58	42	1088	1736
907		1/16/2025	58	42	1088	1736

Page 3 of 19

30-Jan-25

#### SORTED BY GPM @ 20 PSI

#### SINGLE HYDRANT USED FOR STATIC, RESIDUAL, AND FLOW READINGS PER NFPA 291 4.5.1

HYD	MAIN SIZE	DATE	STATIC PSI	FLOW PSI	HOSE GPM	GPM @ 20 PSI
215		1/16/2025	58	42	1088	1736
926		1/15/2025	56	41	1075	1725
226	12 INCH	1/16/2025	56	41	1075	1725
557	8 INCH	1/27/2025	56	41	1075	1725
274		1/23/2025	56	41	1075	1725
566		1/27/2025	56	41	1075	1725
77		1/24/2025	54	40	1062	1715
63	8 INCH	1/24/2025	54	40	1060	1712
112	8 INCH	1/16/2025	54	40	1060	1712
322	8 INCH	1/15/2025	54	40	1060	1712
167		1/17/2025	59	42	1088	1704
920		1/27/2025	59	42	1088	1704
124		1/16/2025	57	41	1075	1690
712		1/24/2025	57	41	1075	1690
532	6 INCH	1/27/2025	57	41	1075	1690
220	6 INCH	1/16/2025	55	40	1062	1678
476		1/27/2025	55	40	1062	1678
465	8 INCH	1/27/2025	55	40	1062	1678
647	8 INCH	1/27/2025	55	40	1062	1678
212	8 INCH	1/17/2025	55	40	1062	1678
217		1/16/2025	60	42	1090	1678
571	8 INCH	1/16/2025	55	40	1060	1675

Page 4 of 19

30-Jan-25

#### SORTED BY GPM @ 20 PSI

#### SINGLE HYDRANT USED FOR STATIC, RESIDUAL, AND FLOW READINGS PER NFPA 291 4.5.1

НҮД	MAIN SIZE	DATE	STATIC PSI	FLOW PSI	HOSE GPM	GPM @ 20 PSI
297		1/23/2025	55	40	1060	1675
510	6 INCH	1/27/2025	60	42	1088	1675
324		1/15/2025	60	42	1088	1675
191	8 INCH	1/17/2025	60	42	1088	1675
163		1/17/2025	60	42	1088	1675
189		1/17/2025	60	42	1088	1675
235		1/16/2025	53	39	1048	1665
551		1/27/2025	63	43	1101	1665
83	12 INCH	1/24/2025	58	41	1075	1660
554		1/27/2025	58	41	1075	1660
111	8 INCH	1/16/2025	58	41	1075	1660
745	8 INCH	1/16/2025	58	41	1075	1660
219		1/16/2025	58	41	1075	1660
141	6 INCH	1/16/2025	56	40	1062	1646
409	8 INCH	1/27/2025	56	40	1062	1646
481	6 INCH	1/27/2025	56	40	1062	1646
464		1/27/2025	56	40	1062	1646
921		1/27/2025	56	40	1062	1646
747	8 INCH	1/16/2025	56	40	1062	1646
746	8 INCH	1/16/2025	56	40	1062	1646
292	10 INCH	1/17/2025	56	40	1060	1642
66	6 INCH	1/27/2025	56	40	1060	1642

Page 5 of 19

30-Jan-25

#### SORTED BY GPM @ 20 PSI

#### SINGLE HYDRANT USED FOR STATIC, RESIDUAL, AND FLOW READINGS PER NFPA 291 4.5.1

НҮД	MAIN SIZE	DATE	STATIC PSI	FLOW PSI	HOSE GPM	GPM @ 20 PSI
65		1/24/2025	56	40	1060	1642
188	8 INCH	1/17/2025	64	43	1101	1642
908		1/16/2025	59	41	1075	1632
930		1/16/2025	54	39	1048	1630
512	8 INCH	1/27/2025	54	39	1048	1630
72		1/24/2025	54	39	1048	1630
640	8 INCH	1/27/2025	54	39	1048	1630
178		1/17/2025	54	39	1048	1630
919	8 INCH	1/27/2025	54	39	1048	1630
296		1/23/2025	62	42	1088	1624
162		1/17/2025	62	42	1088	1624
271	12 INCH	1/23/2025	62	42	1088	1624
934		1/27/2025	57	40	1062	1616
120	6 INCH	1/17/2025	57	40	1060	1613
774	8 INCH	1/16/2025	57	40	1060	1613
714	8 INCH	1/24/2025	57	40	1060	1613
181		1/17/2025	57	40	1060	1613
320		1/15/2025	60	41	1075	1607
281		1/23/2025	60	41	1075	1607
927		1/15/2025	60	41	1075	1607
275		1/23/2025	60	41	1075	1607
538	6 INCH	1/27/2025	60	41	1075	1607

Page 6 of 19

30-Jan-25

#### SORTED BY GPM @ 20 PSI

#### SINGLE HYDRANT USED FOR STATIC, RESIDUAL, AND FLOW READINGS PER NFPA 291 4.5.1

НҮД	MAIN SIZE	DATE	STATIC PSI	FLOW PSI	HOSE GPM	GPM @ 20 PSI
204	12 INCH	1/17/2025	60	41	1075	1607
321	8 INCH	1/15/2025	60	41	1075	1607
272		1/23/2025	60	41	1075	1607
165		1/17/2025	55	39	1050	1602
268	8 INCH	1/23/2025	55	39	1050	1602
74		1/24/2025	55	39	1048	1599
213	8 INCH	1/17/2025	58	40	1062	1590
221		1/16/2025	58	40	1062	1590
170	8 INCH	1/17/2025	58	40	1062	1590
224	6 INCH	1/16/2025	58	40	1062	1590
550		1/27/2025	58	40	1062	1590
229		1/16/2025	58	40	1062	1590
314	8 INCH	1/15/2025	58	40	1062	1590
198	8 INCH	1/17/2025	58	40	1060	1587
574		1/15/2025	58	40	1060	1587
287	8 INCH	1/23/2025	58	40	1060	1587
289		1/17/2025	58	40	1060	1587
17		1/24/2025	53	38	1035	1584
73		1/24/2025	53	38	1035	1584
278		1/23/2025	53	38	1035	1584
187	8 INCH	1/17/2025	61	41	1075	1584
277	8 INCH	1/23/2025	56	39	1050	1575

Page 7 of 19

30-Jan-25

#### SORTED BY GPM @ 20 PSI

#### SINGLE HYDRANT USED FOR STATIC, RESIDUAL, AND FLOW READINGS PER NFPA 291 4.5.1

НҮД	MAIN SIZE	DATE	STATIC PSI	FLOW PSI	HOSE GPM	GPM @ 20 PSI
283		1/23/2025	56	39	1050	1575
130	6 INCH	1/15/2025	56	39	1050	1575
19	8 INCH	1/23/2025	56	39	1050	1575
169		1/17/2025	56	39	1048	1572
22		1/23/2025	56	39	1048	1572
933		1/27/2025	59	40	1062	1566
931		1/17/2025	59	40	1062	1566
626		1/24/2025	59	40	1062	1566
185		1/17/2025	62	41	1075	1563
55	8 INCH	1/23/2025	59	40	1060	1563
151	8 INCH	1/17/2025	54	38	1040	1562
576	8 INCH	1/15/2025	54	38	1040	1562
38	8 INCH	1/23/2025	54	38	1040	1562
62	8 INCH	1/24/2025	54	38	1035	1555
575		1/15/2025	54	38	1035	1555
69	6 INCH	1/24/2025	54	38	1035	1555
143	8 INCH	1/16/2025	57	39	1048	1546
770	8 INCH	1/16/2025	57	39	1048	1546
81	12 INCH	1/24/2025	57	39	1048	1546
928		1/15/2025	57	39	1048	1546
160		1/17/2025	60	40	1062	1544
192	6 INCH	1/17/2025	60	40	1062	1544

Page 8 of 19

30-Jan-25

#### SORTED BY GPM @ 20 PSI

#### SINGLE HYDRANT USED FOR STATIC, RESIDUAL, AND FLOW READINGS PER NFPA 291 4.5.1

HYD	MAIN SIZE	DATE	STATIC PSI	FLOW PSI	HOSE GPM	GPM @ 20 PSI
280		1/23/2025	60	40	1062	1544
313	8 INCH	1/15/2025	60	40	1062	1544
158		1/17/2025	60	40	1062	1544
300		1/15/2025	60	40	1062	1544
154		1/17/2025	60	40	1062	1544
542		1/27/2025	60	40	1062	1544
539	8 INCH	1/27/2025	60	40	1062	1544
534	6 INCH	1/27/2025	60	40	1062	1544
561		1/27/2025	60	40	1062	1544
535	6 INCH	1/27/2025	60	40	1062	1544
207		1/17/2025	60	40	1062	1544
161		1/17/2025	60	40	1062	1544
206		1/17/2025	60	40	1062	1544
232		1/16/2025	60	40	1062	1544
266	8 INCH	1/23/2025	60	40	1060	1541
294	8 INCH	1/17/2025	60	40	1060	1541
209		1/17/2025	60	40	1060	1541
706		1/23/2025	60	40	1060	1541
288		1/17/2025	60	40	1060	1541
307	6 INCH	1/15/2025	55	38	1040	1536
544	8 INCH	1/27/2025	55	38	1035	1529
772	8 INCH	1/15/2025	55	38	1035	1529

Page 9 of 19

30-Jan-25

#### SORTED BY GPM @ 20 PSI

#### SINGLE HYDRANT USED FOR STATIC, RESIDUAL, AND FLOW READINGS PER NFPA 291 4.5.1

НҮД	MAIN SIZE	DATE	STATIC PSI	FLOW PSI	HOSE GPM	GPM @ 20 PSI
319	8 INCH	1/15/2025	61	40	1062	1524
180		1/17/2025	61	40	1062	1524
164		1/17/2025	61	40	1062	1524
168		1/17/2025	58	39	1048	1524
641	8 INCH	1/15/2025	53	37	1025	1515
625	8 INCH	1/24/2025	53	37	1025	1515
308	6 INCH	1/15/2025	59	39	1050	1506
909		1/23/2025	62	40	1062	1506
131	6 INCH	1/15/2025	62	40	1062	1506
184		1/17/2025	62	40	1062	1506
903		1/15/2025	62	40	1062	1506
51	8 INCH	1/23/2025	56	38	1035	1505
144	8 INCH	1/16/2025	56	38	1035	1505
901		1/15/2025	59	39	1048	1503
558	8 INCH	1/27/2025	59	39	1048	1503
552	8 INCH	1/27/2025	59	39	1048	1503
541		1/27/2025	59	39	1048	1503
41	8 INCH	1/23/2025	59	39	1048	1503
559		1/27/2025	57	38	1040	1491
318	8 INCH	1/15/2025	57	38	1040	1491
70		1/24/2025	63	40	1062	1489
295		1/17/2025	60	39	1050	1487

Page 10 of 19

30-Jan-25

#### SORTED BY GPM @ 20 PSI

#### SINGLE HYDRANT USED FOR STATIC, RESIDUAL, AND FLOW READINGS PER NFPA 291 4.5.1

HYD	MAIN SIZE	DATE	STATIC PSI	FLOW PSI	HOSE GPM	GPM @ 20 PSI
75		1/24/2025	54	37	1021	1485
54		1/23/2025	60	39	1048	1484
316	8 INCH	1/15/2025	60	39	1048	1484
533	6 INCH	1/27/2025	60	39	1048	1484
228		1/16/2025	60	39	1048	1484
543	8 INCH	1/27/2025	60	39	1048	1484
306		1/15/2025	57	38	1035	1483
60	8 INCH	1/24/2025	57	38	1035	1483
23		1/23/2025	57	38	1035	1483
900		1/15/2025	57	38	1035	1483
78		1/24/2025	57	38	1035	1483
135		1/16/2025	57	38	1035	1483
646	8 INCH	1/24/2025	57	38	1035	1483
82	12 INCH	1/24/2025	57	38	1035	1483
328		1/16/2025	58	38	1040	1471
138		1/16/2025	58	38	1040	1471
311	6 INCH	1/15/2025	61	39	1048	1467
323		1/15/2025	58	38	1035	1464
298		1/15/2025	58	38	1035	1464
911	8 INCH	1/24/2025	58	38	1035	1464
565		1/27/2025	58	38	1035	1464
159		1/17/2025	58	38	1035	1464

Page 11 of 19

30-Jan-25

#### SORTED BY GPM @ 20 PSI

#### SINGLE HYDRANT USED FOR STATIC, RESIDUAL, AND FLOW READINGS PER NFPA 291 4.5.1

HYD	MAIN SIZE	DATE	STATIC PSI	FLOW PSI	HOSE GPM	GPM @ 20 PSI
45		1/23/2025	56	37	1025	1447
312	6 INCH	1/15/2025	59	38	1035	1446
118	8 INCH	1/16/2025	59	38	1035	1446
139		1/15/2025	59	38	1035	1446
404		1/15/2025	59	38	1035	1446
309	6 INCH	1/15/2025	59	38	1035	1446
310	6 INCH	1/15/2025	59	38	1035	1446
924		1/15/2025	59	38	1035	1446
932		1/27/2025	59	38	1035	1446
190	8 INCH	1/17/2025	53	36	1010	1445
44		1/23/2025	53	36	1010	1445
293		1/17/2025	56	37	1021	1442
49	8 INCH	1/23/2025	53	36	1007	1441
577		1/15/2025	53	36	1007	1441
11	8 INCH	1/24/2025	60	38	1040	1436
461		1/27/2025	60	38	1035	1429
231		1/16/2025	60	38	1035	1429
20		1/23/2025	60	38	1035	1429
145	6 INCH	1/23/2025	60	38	1035	1429
315	8 INCH	1/15/2025	57	37	1025	1429
549		1/27/2025	54	36	1010	1424
152		1/17/2025	54	36	1010	1424

Page 12 of 19

30-Jan-25

#### SORTED BY GPM @ 20 PSI

#### SINGLE HYDRANT USED FOR STATIC, RESIDUAL, AND FLOW READINGS PER NFPA 291 4.5.1

НҮД	MAIN SIZE	DATE	STATIC PSI	FLOW PSI	HOSE GPM	GPM @ 20 PSI
125	6 INCH	1/15/2025	54	36	1010	1424
21		1/23/2025	57	37	1021	1423
9	8 INCH	1/24/2025	57	37	1021	1423
265		1/17/2025	57	37	1021	1423
910	12 INCH	1/23/2025	68	40	1062	1421
753	8 INCH	1/24/2025	54	36	1007	1420
80		1/24/2025	54	36	1007	1420
302	8 INCH	1/15/2025	61	38	1035	1414
563	8 INCH	1/27/2025	58	37	1021	1406
126		1/15/2025	55	36	1010	1405
175		1/16/2025	55	36	1007	1401
511	8 INCH	1/27/2025	55	36	1007	1401
775	8 INCH	1/15/2025	55	36	1007	1401
123		1/15/2025	55	36	1007	1401
925		1/15/2025	62	38	1035	1400
303		1/15/2025	59	37	1021	1391
195	8 INCH	1/17/2025	56	36	1010	1387
79		1/24/2025	56	36	1010	1387
831	6 INCH	1/23/2025	56	36	1010	1387
186		1/17/2025	63	38	1035	1387
749	8 INCH	1/24/2025	56	36	1007	1383
202	8 INCH	1/16/2025	56	36	1007	1383

Page 13 of 19

30-Jan-25

#### SORTED BY GPM @ 20 PSI

#### SINGLE HYDRANT USED FOR STATIC, RESIDUAL, AND FLOW READINGS PER NFPA 291 4.5.1

HYD	MAIN SIZE	DATE	STATIC PSI	FLOW PSI	HOSE GPM	GPM @ 20 PSI
34	8 INCH	1/24/2025	56	36	1007	1383
624	8 INCH	1/24/2025	53	35	993	1378
16		1/27/2025	60	37	1021	1377
52		1/23/2025	60	37	1021	1377
10		1/24/2025	60	37	1021	1377
325		1/15/2025	60	37	1021	1377
146	6 INCH	1/23/2025	60	37	1021	1377
560		1/27/2025	57	36	1010	1371
569		1/15/2025	57	36	1007	1367
299		1/15/2025	57	36	1007	1367
47	8 INCH	1/23/2025	57	36	1007	1367
567		1/27/2025	69	39	1048	1366
406	6 INCH	1/27/2025	65	38	1035	1364
572		1/15/2025	54	35	993	1360
59		1/24/2025	54	35	993	1360
68		1/24/2025	54	35	993	1360
573		1/15/2025	58	36	1010	1357
748	8 INCH	1/24/2025	51	34	980	1356
37	8 INCH	1/23/2025	58	36	1007	1353
1	6 INCH	1/24/2025	58	36	1007	1353
222		1/16/2025	58	36	1007	1353
113	6 INCH	1/16/2025	58	36	1007	1353

Page 14 of 19

30-Jan-25

#### SORTED BY GPM @ 20 PSI

#### SINGLE HYDRANT USED FOR STATIC, RESIDUAL, AND FLOW READINGS PER NFPA 291 4.5.1

HYD	MAIN SIZE	DATE	STATIC PSI	SI FLOW PSI HOSE GPM		GPM @ 20 PSI	
57		1/23/2025	58	36	1007	1353	
128	6 INCH	1/15/2025	55	35	993	1343	
24	6 INCH	1/23/2025	59	36	1007	1339	
912	8 INCH	1/24/2025	59	36	1007	1339	
142	6 INCH	1/16/2025	59	36	1007	1339	
201	8 INCH	1/16/2025	59	36	1007	1339	
50	8 INCH	1/23/2025	59	36	1007	1339	
114	6 INCH	1/16/2025	59	36	1007	1339	
35	8 INCH	1/24/2025	60	36	1010	1331	
27	8 INCH	1/27/2025	60	36	1007	1327	
15		1/27/2025	60	36	1007	1327	
183		1/17/2025	60	36	1007	1327	
136	8 INCH	1/27/2025	60	36	1007	1327	
39		1/23/2025	53	34	980	1320	
6	7:13 AM	1/24/2025	61	36	1010	1319	
326		1/15/2025	61	36	1007	1315	
182		1/17/2025	62	36	1007	1305	
327		1/15/2025	62	36	1007	1305	
46		1/23/2025	58	35	993	1302	
263	8 INCH	1/23/2025	63	36	1007	1295	
564		1/27/2025	59	35	993	1291	
279	6 INCH	1/23/2025	64	36	1007	1285	

Page 15 of 19

30-Jan-25

#### SORTED BY GPM @ 20 PSI

#### SINGLE HYDRANT USED FOR STATIC, RESIDUAL, AND FLOW READINGS PER NFPA 291 4.5.1

HYD	MAIN SIZE	DATE	STATIC PSI	STATIC PSI FLOW PSI HOSE GPM		GPM @ 20 PSI
7	8 INCH	1/24/2025	60	35	993	1280
649	8 INCH	1/24/2025	60	60 35 993 1280		1280
8	8 INCH	1/24/2025	60	35	993	1280
636	8 INCH	1/24/2025	60	35	993	1280
4	8 INCH	1/24/2025	60	35	993	1280
536	6 INCH	1/27/2025	60	35	993	1280
317	8 INCH	1/15/2025	61	35	993	1270
14	8 INCH	1/24/2025	62	35	993	1261
133	6 INCH	1/15/2025	58	34 980 1256		1256
750,751		1/24/2025	54	33	964	1250
752	8 INCH	1/24/2025	54	33	964	1250
127	6 INCH	1/15/2025	54	33	964	1250
71	6 INCH	1/24/2025	55	55 33 964 123		1239
12	8 INCH	1/24/2025	60	34	979	1235
150		1/17/2025	60	34	979	1235
132	8 INCH	1/15/2025	56	33	964	1228
18	8 INCH	1/24/2025	52	32	950	1224
36	8 INCH	1/24/2025	62	34	979	1219
56	8 INCH	1/23/2025	58	33	964	1209
211		1/17/2025	58	33	964	1209
67	6 INCH	1/24/2025	54	32	950	1202
58		1/24/2025	54	32	950	1202

Page 16 of 19

30-Jan-25

#### SORTED BY GPM @ 20 PSI

#### SINGLE HYDRANT USED FOR STATIC, RESIDUAL, AND FLOW READINGS PER NFPA 291 4.5.1

НҮД	MAIN SIZE	DATE	STATIC PSI	FLOW PSI HOSE GPM		GPM @ 20 PSI
3	6 INCH	1/24/2025	60	33	964	1192
282		1/23/2025	55	55 32 950 1192		1192
5	8 INCH	1/24/2025	62	33	964	1177
115	6 INCH	1/16/2025	60	32	950	1152
273		1/23/2025	61	32	950	1145
129	6 INCH	1/15/2025	56	31	935	1138
31	8 INCH	1/24/2025	59	31	935	1118
553		1/27/2025	54	30	920	1110
203	8 INCH	1/17/2025	55	30	919	1102
26	8 INCH	1/27/2025	56	30	920	1097
214	8 INCH	1/17/2025	56	30	919	1096
30	12 8 INCH	1/24/2025	58	30	919	1084
29	8 INCH	1/24/2025	58	30	919	1084
645	12 INCH	1/24/2025	59	30	920	1080
630		1/24/2025	59	30	919	1078
635	8 INCH	1/24/2025	60	30	920	1075
631	8 INCH	1/24/2025	60	30	919	1073
634	8 INCH	1/24/2025	60	30	919	1073
632	8 INCH	1/24/2025	60	30	919	1073
633	8 INCH	1/24/2025	60	30	919	1073
32	8 INCH	1/24/2025	60	30	919	1073
276		1/23/2025	61	30	919	1069

Page 17 of 19

30-Jan-25

#### SORTED BY GPM @ 20 PSI

#### SINGLE HYDRANT USED FOR STATIC, RESIDUAL, AND FLOW READINGS PER NFPA 291 4.5.1

HYD	MAIN SIZE	DATE	STATIC PSI	FIC PSI FLOW PSI HOSE GPM		GPM @ 20 PSI	
13	8 INCH	1/24/2025	56	29	904	1056	
830	8 INCH	1/24/2025	65	30	919	1053	
285	8 INCH	1/27/2025	58	29	904	1046	
581	4 INCH	1/15/2025	54	28	888	1026	
110	8 INCH	1/16/2025	57	28	888	1013	
28		1/27/2025	58	28	888	1009	
25	8 INCH	1/27/2025	58	28	888	1009	
548	6 INCH	1/27/2025	58	28	888	1009	
537	6 INCH	1/27/2025	60	28	888	1002	
33	8 INCH	1/24/2025	57	27	875	980	
913		1/24/2025	58	26	856	939	
914		1/24/2025	58	25	839	905	
149	6 INCH	1/23/2025	52	21	769	782	
622		1/16/2025	58	20	750	750	
284	12 INCH	1/23/2025	60	20	750	750	
157		1/17/2025	58	16	671	636	
153		1/17/2025	60	15	650	610	
579		1/15/2025	56	15	650	606	
578		1/15/2025	55	15	650	605	
2	6 INCH	1/24/2025	56	6	411	344	
556		1/27/2025	60	5	375	316	
555	8 INCH	1/27/2025	58	4	336 278		

Page 18 of 19

30-Jan-25

#### SORTED BY GPM @ 20 PSI

#### SINGLE HYDRANT USED FOR STATIC, RESIDUAL, AND FLOW READINGS PER NFPA 291 4.5.1

HYD MAIN SIZE DATE STATIC PSI FLOW PSI HOSE GPM GPM @ 20 PSI
--

Total Static and Flow Tests: 396

Page 19 of 19

# 20. TESTING AVAILABLE WATER SUPPLY IN WATER-MAINS

Data provided both numerically and graphically

30-Jan-25

HYDRANT	MAIN SIZE	MATCHING HYD	STATIC PSI	RESIDUAL PSI	FLOW GPM DURING RESIDUAL TEST	GPM @ 20 PSI	NEAREST CROSS ST
321	8 INCH	322			1424	1837	DEBORAH ST
322	8 INCH	321	60	35			DEBORAH DR
900		901	57	37			ANGLETON BLVD
901		900			1384	1924	S BUTCHA RD
575		576	54	40			S CHENANGO ST
576	8 INCH	575			1256	2022	ORANGE ST
50	8 INCH	51	58	40			GARDENIA ST
51	8 INCH	50		40	1162	1743	S WALKER ST
131	6 INCH	133	62	23			E KIBER ST
133	6 INCH	131			1256	1306	E KIBER ST
773	8 INCH	775	55	35			LAGO CT
775	8 INCH	773			1424	1922	BRYAN WAY
746	8 INCH	747			1644	2745	SMITH PL
747	8 INCH	746	56	42			PARK LN
222		223	52	40			GIFFORD RD
223		222			1538	2615	BALD PRAIRIE DR
219		218	58	36			PRAIRIE LEA DR
218		219			1500	2010	GIFFORD RD
229		228			1644	2121	CEMETERY RD
228		229	60	35			CEMETERY RD
197	8 INCH	198	60	45			WILBERT ST
198	8 INCH	197			1574	2676	KADERA RD

30-Jan-25

HYDRANT	MAIN SIZE	MATCHING HYD	STATIC PSI	RESIDUAL PSI	FLOW GPM DURING RESIDUAL TEST	GPM @ 20 PSI	NEAREST CROSS ST
182		183			1712	2482	E PHILLIPS RD
183		182	60	40			KADERA RD
295		294			1610	2335	FOX LN
294	8 INCH	295	60	40			FOX LN
289		288			1644	2532	CEMETERY RD
288		289	60	42			S VELASCO
146	6 INCH	145			1300	1885	BEECHNUT ST
145	6 INCH	146	60	40			LOSTRACCO ST
46		47	62	40			BRYAN ST
47	8 INCH	46			1424	2022	S WALKER ST
23		22	57	40			S WALKER ST
22		23			1574	2392	HOLLY ST
66	6 INCH	67	54	45			W LIVE OAKS ST
67	6 INCH	66			1210	2481	W CEDAR ST
151	8 INCH	150			1256	1620	LOSTRACCO ST
150		151	60	35			S VELASCO ST
557	8 INCH	566			1162	1766	N CHENANGO ST
566		557	57	40			N VELASCO ST
549		548	60	55			N MORGAN ST
548	6 INCH	549			1008	3095	E LOCUS ST
714	8 INCH	713			1538	2476	W LOCUS ST
713	8 INCH	714	54	40			W MAGNOLIA ST

30-Jan-25

HYDRANT	MAIN SIZE	MATCHING HYD	STATIC PSI	RESIDUAL PSI	FLOW GPM DURING RESIDUAL TEST	GPM @ 20 PSI	NEAREST CROSS ST
537	6 INCH	536	60	23			N ANDERSON ST
536	6 INCH	537			1162	1208	N ANDERSON ST
465	8 INCH	464	55	48			N TINSLEY ST
464		465			1162	2766	N DOWNING ST
932		552			1678	2064	N ARCOLA ST
552	8 INCH	932	58	32			N ARCOLA ST
285	8 INCH	284			1162	1208	COALE RD
284	12 INCH	285	60	23			COALE RD

Total residual tests: 26



Contained within are fire flow test results for determining the available water supply for the design of a water based protection system using two hydrants per NFPA 4.4. The test was conducted on at 2:25 PM

#### RESIDUAL HYDRANT #: 480

RESIDUAL HYDRANT LOCATION: NORTHWEST CORNER OF N DOWNING AN E MILLER

#### STATIC PSI: 0

**RESIDUAL PSI: 0** while flowing hydrant # 919

FLOW HYDRANT #: 919


FLOW HYD LOCATION: 901 CHEVY CHASE DR

2.5IN PRIMARY HOSE NOZZLE FLOW PSI #: 0

2.5IN SECONDARY HOSE NOZZLE FLOW PSI #: 0

GPM FLOWED DURING TEST: 0 GPM

#### FIRE FLOW CALCULATION (AVAILABLE GPM @ 20 PSI): 0 GPM

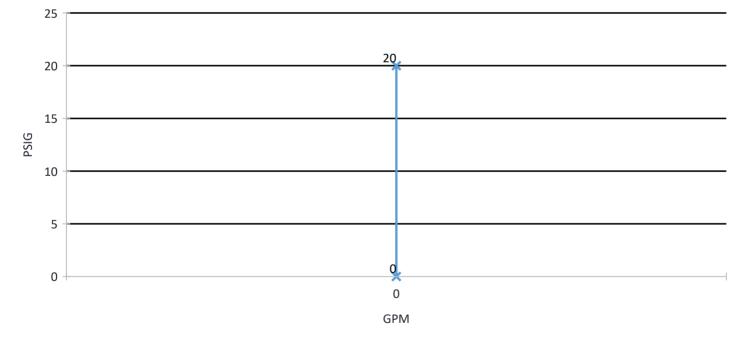

#### FLOW TEST CHART

Graph data should always be independently calculated and reviewed

Operational conditions of hydrants and test results reflect conditions of the hydrants and system at the time of the inspections/tests. Data Hydrant Inc. dba Hydrant.com does not guarantee, certify, or imply future pressures or operability of the hydrants at any time before, during, or after tests are conducted.

### All fire hydrants should be inspected, operated, and flushed at least annually.

### Data Hydrant Inc. dba Hydrant.com



Contained within are fire flow test results for determining the available water supply for the design of a water based protection system using two hydrants per NFPA 4.4. The test was conducted on 1/15/2025 at 7:17 AM

RESIDUAL HYDRANT #: 322 RESIDUAL HYDRANT LOCATION: 132 E HOSPITAL DR -

#### **STATIC PSI: 60**

**RESIDUAL PSI: 35** while flowing hydrant # 321

FLOW HYDRANT #: 321


FLOW HYD LOCATION: 132 E HOSPITAL DR

2.5IN PRIMARY HOSE NOZZLE FLOW PSI #: 18

2.5IN SECONDARY HOSE NOZZLE FLOW PSI #: 18

GPM FLOWED DURING TEST: 1424 GPM

#### FIRE FLOW CALCULATION (AVAILABLE GPM @ 20 PSI): 1837 GPM

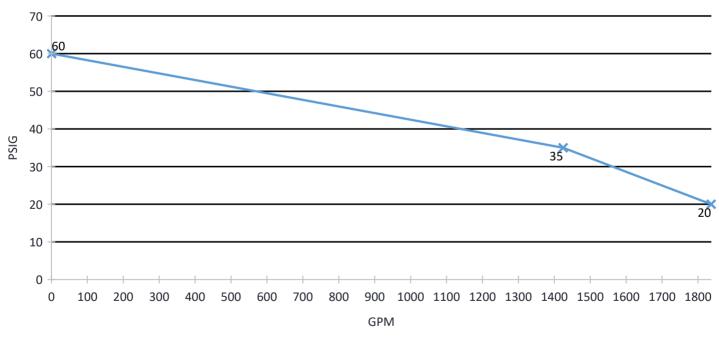

FLOW TEST CHART

Graph data should always be independently calculated and reviewed

Operational conditions of hydrants and test results reflect conditions of the hydrants and system at the time of the inspections/tests. Data Hydrant Inc. dba Hydrant.com does not guarantee, certify, or imply future pressures or operability of the hydrants at any time before, during, or after tests are conducted.

### All fire hydrants should be inspected, operated, and flushed at least annually.

### Data Hydrant Inc. dba Hydrant.com



Contained within are fire flow test results for determining the available water supply for the design of a water based protection system using two hydrants per NFPA 4.4. The test was conducted on 1/15/2025 at 10:20 AM

RESIDUAL HYDRANT #: 900 RESIDUAL HYDRANT LOCATION: 130 AUSTIN RD

**STATIC PSI: 57** 

**RESIDUAL PSI: 37** while flowing hydrant # 901

FLOW HYDRANT #: 901


FLOW HYD LOCATION: 106 AUSTIN RD

2.5IN PRIMARY HOSE NOZZLE FLOW PSI #: 17

2.5IN SECONDARY HOSE NOZZLE FLOW PSI #: 17

GPM FLOWED DURING TEST: 1384 GPM

FIRE FLOW CALCULATION (AVAILABLE GPM @ 20 PSI): 1924 GPM

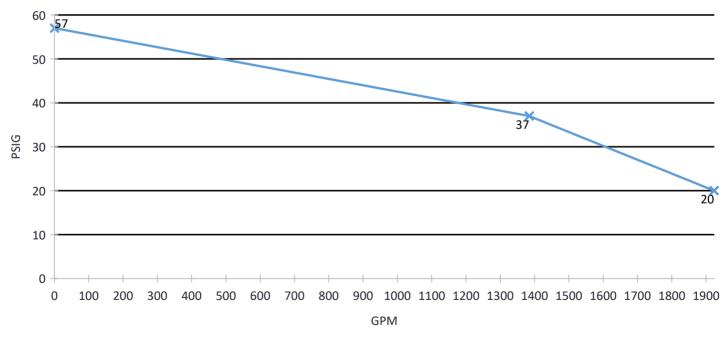

FLOW TEST CHART

Graph data should always be independently calculated and reviewed

Operational conditions of hydrants and test results reflect conditions of the hydrants and system at the time of the inspections/tests. Data Hydrant Inc. dba Hydrant.com does not guarantee, certify, or imply future pressures or operability of the hydrants at any time before, during, or after tests are conducted.

### All fire hydrants should be inspected, operated, and flushed at least annually.

### Data Hydrant Inc. dba Hydrant.com



Contained within are fire flow test results for determining the available water supply for the design of a water based protection system using two hydrants per NFPA 4.4. The test was conducted on 1/15/2025 at 11:40 AM

#### RESIDUAL HYDRANT #: 575

RESIDUAL HYDRANT LOCATION: NORTHWEST CORNER OF E ORANGE ST AND S CHENANGO ST

#### STATIC PSI: 54

**RESIDUAL PSI: 40** while flowing hydrant # 576

FLOW HYDRANT #: 576


FLOW HYD LOCATION: NORTHEAST CORNER OF HWY 288 BUSINESS AND E ORANGE ST

2.5IN PRIMARY HOSE NOZZLE FLOW PSI #: 14

2.5IN SECONDARY HOSE NOZZLE FLOW PSI #: 14

**GPM FLOWED DURING TEST: 1256 GPM** 

#### FIRE FLOW CALCULATION (AVAILABLE GPM @ 20 PSI): 2022 GPM

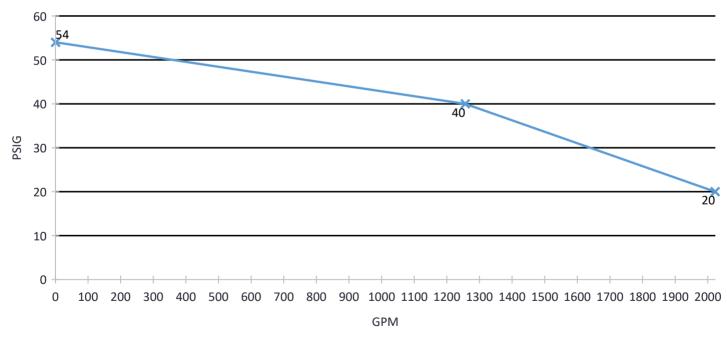

#### FLOW TEST CHART

Graph data should always be independently calculated and reviewed

Operational conditions of hydrants and test results reflect conditions of the hydrants and system at the time of the inspections/tests. Data Hydrant Inc. dba Hydrant.com does not guarantee, certify, or imply future pressures or operability of the hydrants at any time before, during, or after tests are conducted.

### All fire hydrants should be inspected, operated, and flushed at least annually.

### Data Hydrant Inc. dba Hydrant.com



Contained within are fire flow test results for determining the available water supply for the design of a water based protection system using two hydrants per NFPA 4.4. The test was conducted on 1/15/2025 at 1:43 PM

RESIDUAL HYDRANT #: 50 RESIDUAL HYDRANT LOCATION: 500 CATALPA ST

#### **STATIC PSI: 58**

**RESIDUAL PSI: 40** while flowing hydrant # 51

FLOW HYDRANT #: 51


FLOW HYD LOCATION: 608 CATALPA ST

2.5IN PRIMARY HOSE NOZZLE FLOW PSI #: 12

2.5IN SECONDARY HOSE NOZZLE FLOW PSI #: 12

GPM FLOWED DURING TEST: 1162 GPM

#### FIRE FLOW CALCULATION (AVAILABLE GPM @ 20 PSI): 1743 GPM

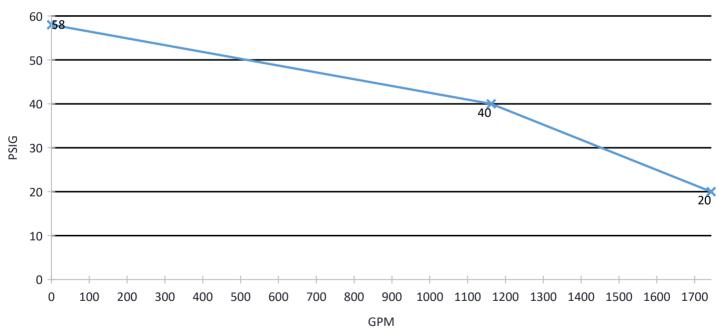

FLOW TEST CHART

Graph data should always be independently calculated and reviewed

Operational conditions of hydrants and test results reflect conditions of the hydrants and system at the time of the inspections/tests. Data Hydrant Inc. dba Hydrant.com does not guarantee, certify, or imply future pressures or operability of the hydrants at any time before, during, or after tests are conducted.

### All fire hydrants should be inspected, operated, and flushed at least annually.

### Data Hydrant Inc. dba Hydrant.com



Contained within are fire flow test results for determining the available water supply for the design of a water based protection system using two hydrants per NFPA 4.4. The test was conducted on 1/15/2025 at 2:02 PM

RESIDUAL HYDRANT #: 131 RESIDUAL HYDRANT LOCATION: 409 FARRER ST

**STATIC PSI: 62** 

**RESIDUAL PSI: 23** while flowing hydrant # 133

FLOW HYDRANT #: 133


FLOW HYD LOCATION: 408 EVANS ST

2.5IN PRIMARY HOSE NOZZLE FLOW PSI #: 14

2.5IN SECONDARY HOSE NOZZLE FLOW PSI #: 14

GPM FLOWED DURING TEST: 1256 GPM

FIRE FLOW CALCULATION (AVAILABLE GPM @ 20 PSI): 1306 GPM

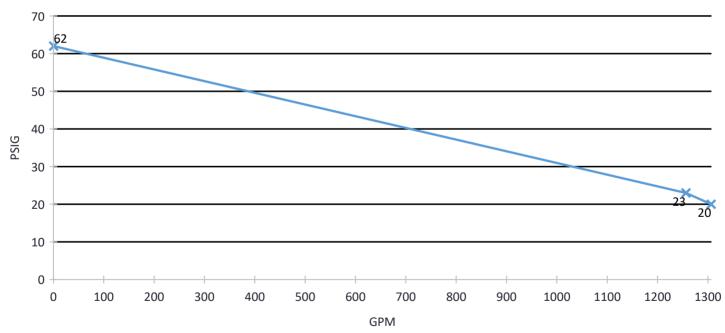

FLOW TEST CHART

Graph data should always be independently calculated and reviewed

Operational conditions of hydrants and test results reflect conditions of the hydrants and system at the time of the inspections/tests. Data Hydrant Inc. dba Hydrant.com does not guarantee, certify, or imply future pressures or operability of the hydrants at any time before, during, or after tests are conducted.

### All fire hydrants should be inspected, operated, and flushed at least annually.

### Data Hydrant Inc. dba Hydrant.com



Contained within are fire flow test results for determining the available water supply for the design of a water based protection system using two hydrants per NFPA 4.4. The test was conducted on 1/15/2025 at 2:35 PM

RESIDUAL HYDRANT #: 773 RESIDUAL HYDRANT LOCATION: 308 BRYAN WAY

**STATIC PSI: 55** 

**RESIDUAL PSI: 35** while flowing hydrant # 775

FLOW HYDRANT #: 775


FLOW HYD LOCATION: 3 LAGO CT

2.5IN PRIMARY HOSE NOZZLE FLOW PSI #: 18

2.5IN SECONDARY HOSE NOZZLE FLOW PSI #: 18

GPM FLOWED DURING TEST: 1424 GPM

FIRE FLOW CALCULATION (AVAILABLE GPM @ 20 PSI): 1922 GPM

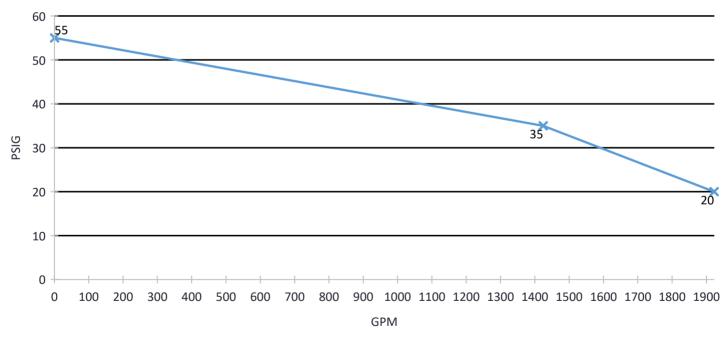

FLOW TEST CHART

Graph data should always be independently calculated and reviewed

Operational conditions of hydrants and test results reflect conditions of the hydrants and system at the time of the inspections/tests. Data Hydrant Inc. dba Hydrant.com does not guarantee, certify, or imply future pressures or operability of the hydrants at any time before, during, or after tests are conducted.

### All fire hydrants should be inspected, operated, and flushed at least annually.

### Data Hydrant Inc. dba Hydrant.com



Contained within are fire flow test results for determining the available water supply for the design of a water based protection system using two hydrants per NFPA 4.4. The test was conducted on 1/16/2025 at 11:27 AM

RESIDUAL HYDRANT #: 747 RESIDUAL HYDRANT LOCATION: ACROSS FROM 825 SOUTHSIDE DR

**STATIC PSI: 56** 

**RESIDUAL PSI: 42** while flowing hydrant # 746

FLOW HYDRANT #: 746


FLOW HYD LOCATION: 1009 SOUTHSIDE DR

2.5IN PRIMARY HOSE NOZZLE FLOW PSI #: 24

2.5IN SECONDARY HOSE NOZZLE FLOW PSI #: 24

**GPM FLOWED DURING TEST: 1644 GPM** 

FIRE FLOW CALCULATION (AVAILABLE GPM @ 20 PSI): 2745 GPM

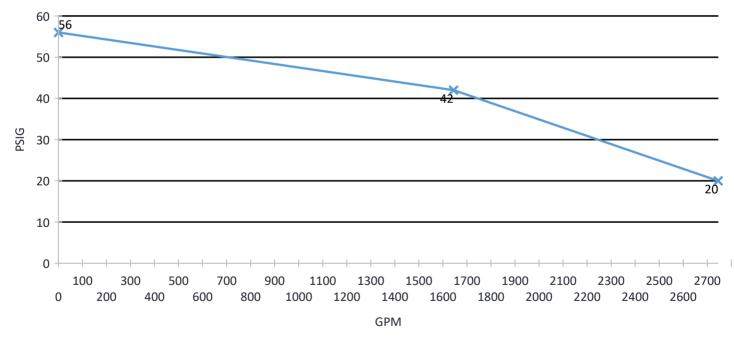

FLOW TEST CHART

Graph data should always be independently calculated and reviewed

Operational conditions of hydrants and test results reflect conditions of the hydrants and system at the time of the inspections/tests. Data Hydrant Inc. dba Hydrant.com does not guarantee, certify, or imply future pressures or operability of the hydrants at any time before, during, or after tests are conducted.

### All fire hydrants should be inspected, operated, and flushed at least annually.

### Data Hydrant Inc. dba Hydrant.com



Contained within are fire flow test results for determining the available water supply for the design of a water based protection system using two hydrants per NFPA 4.4. The test was conducted on 1/16/2025 at 1:56 PM

RESIDUAL HYDRANT #: 222 RESIDUAL HYDRANT LOCATION: 137 PRAIRIE LEA DR

**STATIC PSI: 52** 

**RESIDUAL PSI: 40** while flowing hydrant # 223

FLOW HYDRANT #: 223


FLOW HYD LOCATION: 205 PRAIRIE LEA DR

2.5IN PRIMARY HOSE NOZZLE FLOW PSI #: 21

2.5IN SECONDARY HOSE NOZZLE FLOW PSI #: 21

GPM FLOWED DURING TEST: 1538 GPM

FIRE FLOW CALCULATION (AVAILABLE GPM @ 20 PSI): 2615 GPM

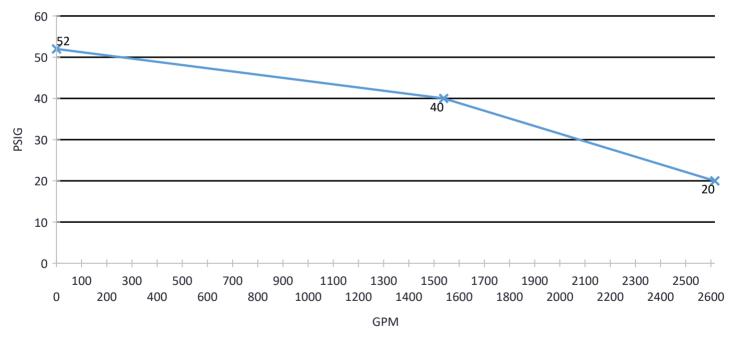

FLOW TEST CHART

Graph data should always be independently calculated and reviewed

Operational conditions of hydrants and test results reflect conditions of the hydrants and system at the time of the inspections/tests. Data Hydrant Inc. dba Hydrant.com does not guarantee, certify, or imply future pressures or operability of the hydrants at any time before, during, or after tests are conducted.

### All fire hydrants should be inspected, operated, and flushed at least annually.

### Data Hydrant Inc. dba Hydrant.com



Contained within are fire flow test results for determining the available water supply for the design of a water based protection system using two hydrants per NFPA 4.4. The test was conducted on 1/16/2025 at 2:23 PM

RESIDUAL HYDRANT #: 219 RESIDUAL HYDRANT LOCATION: 205 BALD PRAIRIE DR

#### **STATIC PSI: 58**

**RESIDUAL PSI: 36** while flowing hydrant # 218

FLOW HYDRANT #: 218


FLOW HYD LOCATION: 137 BALD PRAIRIE DR

2.5IN PRIMARY HOSE NOZZLE FLOW PSI #: 20

2.5IN SECONDARY HOSE NOZZLE FLOW PSI #: 20

**GPM FLOWED DURING TEST: 1500 GPM** 

#### FIRE FLOW CALCULATION (AVAILABLE GPM @ 20 PSI): 2010 GPM

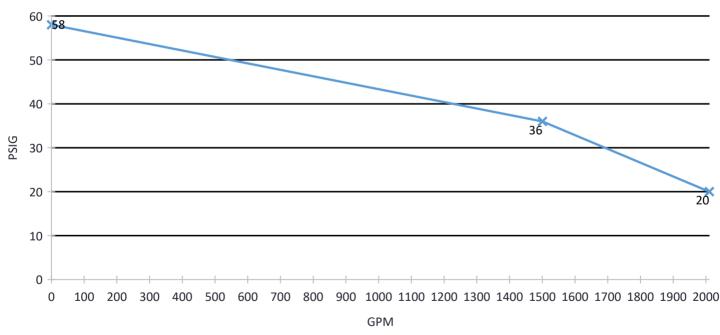

FLOW TEST CHART

Graph data should always be independently calculated and reviewed

Operational conditions of hydrants and test results reflect conditions of the hydrants and system at the time of the inspections/tests. Data Hydrant Inc. dba Hydrant.com does not guarantee, certify, or imply future pressures or operability of the hydrants at any time before, during, or after tests are conducted.

### All fire hydrants should be inspected, operated, and flushed at least annually.

### Data Hydrant Inc. dba Hydrant.com



Contained within are fire flow test results for determining the available water supply for the design of a water based protection system using two hydrants per NFPA 4.4. The test was conducted on 1/16/2025 at 10:29 AM

RESIDUAL HYDRANT #: 228 RESIDUAL HYDRANT LOCATION: 1060 VINE DR

#### **STATIC PSI: 60**

**RESIDUAL PSI: 35** while flowing hydrant # 229

FLOW HYDRANT #: 229


FLOW HYD LOCATION: 1060 GROVE DR

2.5IN PRIMARY HOSE NOZZLE FLOW PSI #: 24

2.5IN SECONDARY HOSE NOZZLE FLOW PSI #: 24

**GPM FLOWED DURING TEST: 1644 GPM** 

#### FIRE FLOW CALCULATION (AVAILABLE GPM @ 20 PSI): 2121 GPM

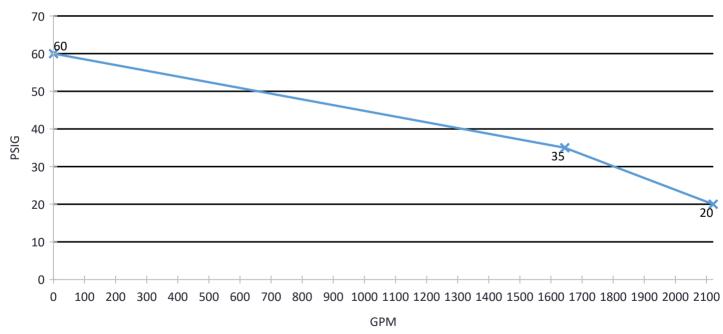

#### FLOW TEST CHART

Graph data should always be independently calculated and reviewed

Operational conditions of hydrants and test results reflect conditions of the hydrants and system at the time of the inspections/tests. Data Hydrant Inc. dba Hydrant.com does not guarantee, certify, or imply future pressures or operability of the hydrants at any time before, during, or after tests are conducted.

### All fire hydrants should be inspected, operated, and flushed at least annually.

### Data Hydrant Inc. dba Hydrant.com



Contained within are fire flow test results for determining the available water supply for the design of a water based protection system using two hydrants per NFPA 4.4. The test was conducted on 1/17/2025 at 7:48 AM

#### RESIDUAL HYDRANT #: 197

RESIDUAL HYDRANT LOCATION: SOUTHEAST CORNER OF KADERA RD AND WILBERT ST

#### STATIC PSI: 60

**RESIDUAL PSI: 45** while flowing hydrant # 198

FLOW HYDRANT #: 198


FLOW HYD LOCATION: 1621 WILBERT RD

2.5IN PRIMARY HOSE NOZZLE FLOW PSI #: 22

2.5IN SECONDARY HOSE NOZZLE FLOW PSI #: 22

GPM FLOWED DURING TEST: 1574 GPM

#### FIRE FLOW CALCULATION (AVAILABLE GPM @ 20 PSI): 2676 GPM

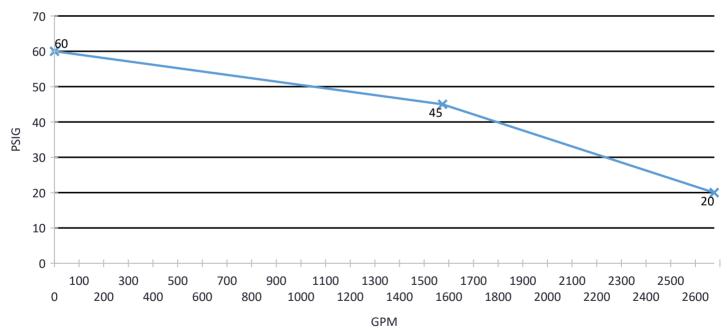

#### FLOW TEST CHART

Graph data should always be independently calculated and reviewed

Operational conditions of hydrants and test results reflect conditions of the hydrants and system at the time of the inspections/tests. Data Hydrant Inc. dba Hydrant.com does not guarantee, certify, or imply future pressures or operability of the hydrants at any time before, during, or after tests are conducted.

### All fire hydrants should be inspected, operated, and flushed at least annually.

### Data Hydrant Inc. dba Hydrant.com



Contained within are fire flow test results for determining the available water supply for the design of a water based protection system using two hydrants per NFPA 4.4. The test was conducted on 1/17/2025 at 9:49 AM

RESIDUAL HYDRANT #: 183 RESIDUAL HYDRANT LOCATION: 1712 SHANKS RD

#### **STATIC PSI: 60**

**RESIDUAL PSI: 40** while flowing hydrant # 182

FLOW HYDRANT #: 182


FLOW HYD LOCATION: 1820 SHANKS RD

2.5IN PRIMARY HOSE NOZZLE FLOW PSI #: 26

2.5IN SECONDARY HOSE NOZZLE FLOW PSI #: 26

GPM FLOWED DURING TEST: 1712 GPM

#### FIRE FLOW CALCULATION (AVAILABLE GPM @ 20 PSI): 2482 GPM

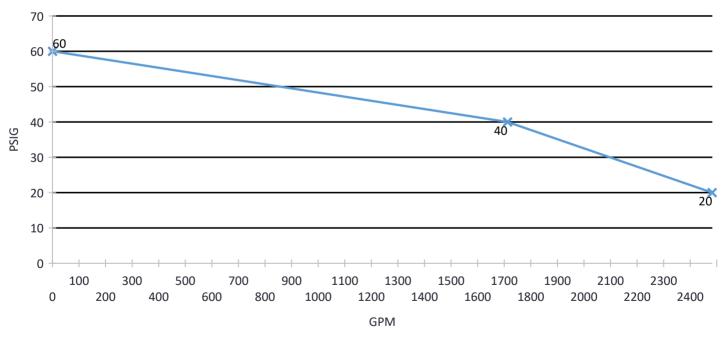

FLOW TEST CHART

Graph data should always be independently calculated and reviewed

Operational conditions of hydrants and test results reflect conditions of the hydrants and system at the time of the inspections/tests. Data Hydrant Inc. dba Hydrant.com does not guarantee, certify, or imply future pressures or operability of the hydrants at any time before, during, or after tests are conducted.

### All fire hydrants should be inspected, operated, and flushed at least annually.

### Data Hydrant Inc. dba Hydrant.com



Contained within are fire flow test results for determining the available water supply for the design of a water based protection system using two hydrants per NFPA 4.4. The test was conducted on 1/17/2025 at 2:11 PM

RESIDUAL HYDRANT #: 294 RESIDUAL HYDRANT LOCATION: 1500 S VELASCO ST

#### **STATIC PSI: 60**

**RESIDUAL PSI: 40** while flowing hydrant # 295

FLOW HYDRANT #: 295


FLOW HYD LOCATION: 1600 S VELASCO ST

2.5IN PRIMARY HOSE NOZZLE FLOW PSI #: 23

2.5IN SECONDARY HOSE NOZZLE FLOW PSI #: 23

GPM FLOWED DURING TEST: 1610 GPM

#### FIRE FLOW CALCULATION (AVAILABLE GPM @ 20 PSI): 2335 GPM

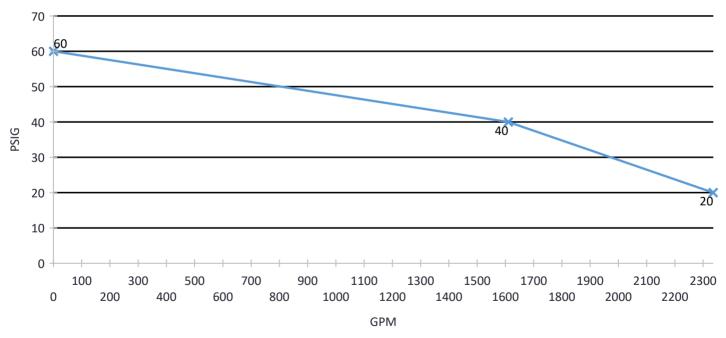

#### FLOW TEST CHART

Graph data should always be independently calculated and reviewed

Operational conditions of hydrants and test results reflect conditions of the hydrants and system at the time of the inspections/tests. Data Hydrant Inc. dba Hydrant.com does not guarantee, certify, or imply future pressures or operability of the hydrants at any time before, during, or after tests are conducted.

### All fire hydrants should be inspected, operated, and flushed at least annually.

### Data Hydrant Inc. dba Hydrant.com



Contained within are fire flow test results for determining the available water supply for the design of a water based protection system using two hydrants per NFPA 4.4. The test was conducted on 1/17/2025 at 2:25 PM

#### RESIDUAL HYDRANT #: 288

RESIDUAL HYDRANT LOCATION: NORTHWEST CORNER OF S VELASCO AND CEMETERY RD

#### STATIC PSI: 60

RESIDUAL PSI: 42 while flowing hydrant # 289

FLOW HYDRANT #: 289


#### FLOW HYD LOCATION: SOUTHWEST CORNER OF S VELASCO AND CEMETERY RD

2.5IN PRIMARY HOSE NOZZLE FLOW PSI #: 24

2.5IN SECONDARY HOSE NOZZLE FLOW PSI #: 24

**GPM FLOWED DURING TEST: 1644 GPM** 

#### FIRE FLOW CALCULATION (AVAILABLE GPM @ 20 PSI): 2532 GPM

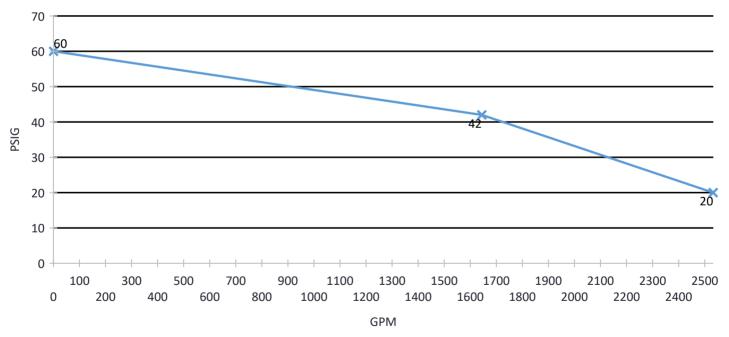

FLOW TEST CHART

Graph data should always be independently calculated and reviewed

Operational conditions of hydrants and test results reflect conditions of the hydrants and system at the time of the inspections/tests. Data Hydrant Inc. dba Hydrant.com does not guarantee, certify, or imply future pressures or operability of the hydrants at any time before, during, or after tests are conducted.

### All fire hydrants should be inspected, operated, and flushed at least annually.

### Data Hydrant Inc. dba Hydrant.com



Contained within are fire flow test results for determining the available water supply for the design of a water based protection system using two hydrants per NFPA 4.4. The test was conducted on 1/23/2025 at 10:28 AM

RESIDUAL HYDRANT #: 145 RESIDUAL HYDRANT LOCATION: 100 WALNUT ST

### **STATIC PSI: 60**

**RESIDUAL PSI: 40** while flowing hydrant # 146

FLOW HYDRANT #: 146


FLOW HYD LOCATION: 134 WALNUT ST

2.5IN PRIMARY HOSE NOZZLE FLOW PSI #: 15

2.5IN SECONDARY HOSE NOZZLE FLOW PSI #: 15

GPM FLOWED DURING TEST: 1300 GPM

### FIRE FLOW CALCULATION (AVAILABLE GPM @ 20 PSI): 1885 GPM

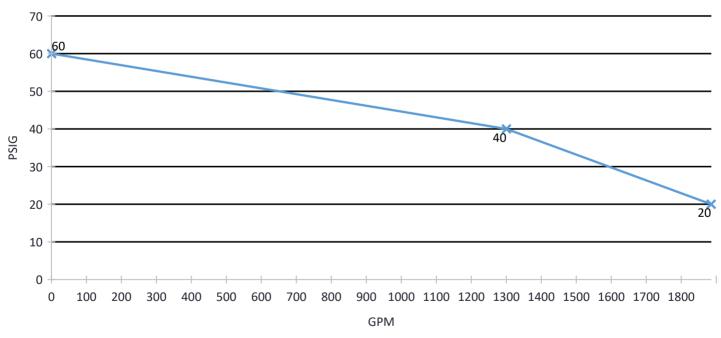

### FLOW TEST CHART

Graph data should always be independently calculated and reviewed

Operational conditions of hydrants and test results reflect conditions of the hydrants and system at the time of the inspections/tests. Data Hydrant Inc. dba Hydrant.com does not guarantee, certify, or imply future pressures or operability of the hydrants at any time before, during, or after tests are conducted.

## All fire hydrants should be inspected, operated, and flushed at least annually.

## Data Hydrant Inc. dba Hydrant.com



Contained within are fire flow test results for determining the available water supply for the design of a water based protection system using two hydrants per NFPA 4.4. The test was conducted on 1/23/2025 at 1:25 PM

RESIDUAL HYDRANT #: 46 RESIDUAL HYDRANT LOCATION: 727 S WALKER ST

### **STATIC PSI: 62**

**RESIDUAL PSI: 40** while flowing hydrant # 47

FLOW HYDRANT #: 47


FLOW HYD LOCATION: 716 MUNSON PL

2.5IN PRIMARY HOSE NOZZLE FLOW PSI #: 18

2.5IN SECONDARY HOSE NOZZLE FLOW PSI #: 18

GPM FLOWED DURING TEST: 1424 GPM

### FIRE FLOW CALCULATION (AVAILABLE GPM @ 20 PSI): 2022 GPM

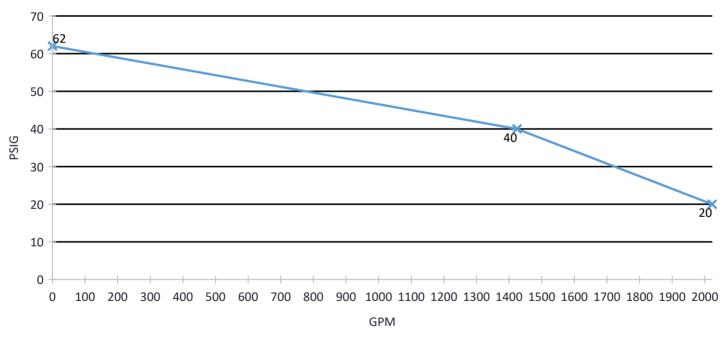

FLOW TEST CHART

Graph data should always be independently calculated and reviewed

Operational conditions of hydrants and test results reflect conditions of the hydrants and system at the time of the inspections/tests. Data Hydrant Inc. dba Hydrant.com does not guarantee, certify, or imply future pressures or operability of the hydrants at any time before, during, or after tests are conducted.

## All fire hydrants should be inspected, operated, and flushed at least annually.

## Data Hydrant Inc. dba Hydrant.com



Contained within are fire flow test results for determining the available water supply for the design of a water based protection system using two hydrants per NFPA 4.4. The test was conducted on 1/23/2025 at 1:57 PM

RESIDUAL HYDRANT #: 23 RESIDUAL HYDRANT LOCATION: 629 HOLLY ST

**STATIC PSI: 57** 

**RESIDUAL PSI: 40** while flowing hydrant # 22

FLOW HYDRANT #: 22


FLOW HYD LOCATION: ACROSS FROM 300 S WALKER ST

2.5IN PRIMARY HOSE NOZZLE FLOW PSI #: 22

2.5IN SECONDARY HOSE NOZZLE FLOW PSI #: 22

GPM FLOWED DURING TEST: 1574 GPM

FIRE FLOW CALCULATION (AVAILABLE GPM @ 20 PSI): 2392 GPM

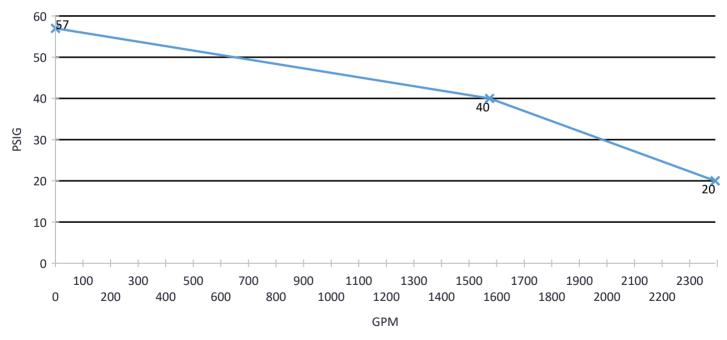

FLOW TEST CHART

Graph data should always be independently calculated and reviewed

Operational conditions of hydrants and test results reflect conditions of the hydrants and system at the time of the inspections/tests. Data Hydrant Inc. dba Hydrant.com does not guarantee, certify, or imply future pressures or operability of the hydrants at any time before, during, or after tests are conducted.

## All fire hydrants should be inspected, operated, and flushed at least annually.

## Data Hydrant Inc. dba Hydrant.com



Contained within are fire flow test results for determining the available water supply for the design of a water based protection system using two hydrants per NFPA 4.4. The test was conducted on 1/24/2025 at 9:03 AM

RESIDUAL HYDRANT #: 66 RESIDUAL HYDRANT LOCATION: 18 T J WRIGHT ST

### **STATIC PSI: 54**

**RESIDUAL PSI: 45** while flowing hydrant # 67

FLOW HYDRANT #: 67


FLOW HYD LOCATION: 612 T J WRIGHT ST

2.5IN PRIMARY HOSE NOZZLE FLOW PSI #: 13

2.5IN SECONDARY HOSE NOZZLE FLOW PSI #: 13

GPM FLOWED DURING TEST: 1210 GPM

### FIRE FLOW CALCULATION (AVAILABLE GPM @ 20 PSI): 2481 GPM

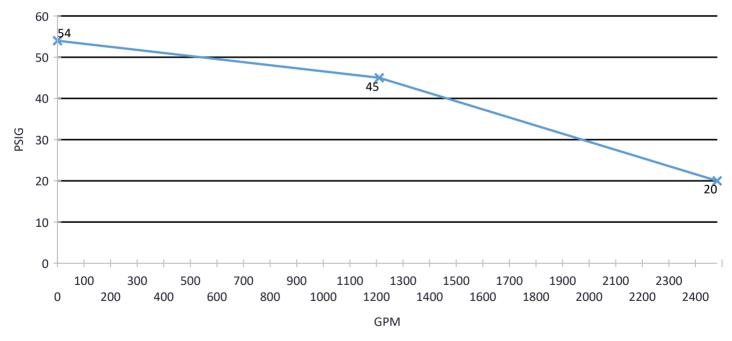

### FLOW TEST CHART

Graph data should always be independently calculated and reviewed

Operational conditions of hydrants and test results reflect conditions of the hydrants and system at the time of the inspections/tests. Data Hydrant Inc. dba Hydrant.com does not guarantee, certify, or imply future pressures or operability of the hydrants at any time before, during, or after tests are conducted.

## All fire hydrants should be inspected, operated, and flushed at least annually.

## Data Hydrant Inc. dba Hydrant.com



Contained within are fire flow test results for determining the available water supply for the design of a water based protection system using two hydrants per NFPA 4.4. The test was conducted on 1/17/2025 at 1:06 PM

RESIDUAL HYDRANT #: 150 RESIDUAL HYDRANT LOCATION: 97 LOSTROCCO ST

### **STATIC PSI: 60**

**RESIDUAL PSI: 35** while flowing hydrant # 151

FLOW HYDRANT #: 151


FLOW HYD LOCATION: 2288 S VELASCO ST

2.5IN PRIMARY HOSE NOZZLE FLOW PSI #: 14

2.5IN SECONDARY HOSE NOZZLE FLOW PSI #: 14

GPM FLOWED DURING TEST: 1256 GPM

### FIRE FLOW CALCULATION (AVAILABLE GPM @ 20 PSI): 1620 GPM

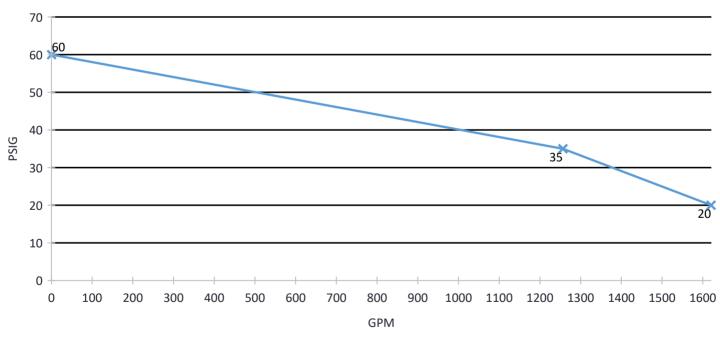

FLOW TEST CHART

Graph data should always be independently calculated and reviewed

Operational conditions of hydrants and test results reflect conditions of the hydrants and system at the time of the inspections/tests. Data Hydrant Inc. dba Hydrant.com does not guarantee, certify, or imply future pressures or operability of the hydrants at any time before, during, or after tests are conducted.

## All fire hydrants should be inspected, operated, and flushed at least annually.

## Data Hydrant Inc. dba Hydrant.com



Contained within are fire flow test results for determining the available water supply for the design of a water based protection system using two hydrants per NFPA 4.4. The test was conducted on 1/27/2025 at 8:12 AM

### RESIDUAL HYDRANT #: 566

RESIDUAL HYDRANT LOCATION: SOUTHWEST CORNER OF W LOCUS ST AND N VELASCO ST

### STATIC PSI: 57

**RESIDUAL PSI: 40** while flowing hydrant # 557

FLOW HYDRANT #: 557


FLOW HYD LOCATION: 136 E LOCUS ST

2.5IN PRIMARY HOSE NOZZLE FLOW PSI #: 12

2.5IN SECONDARY HOSE NOZZLE FLOW PSI #: 12

GPM FLOWED DURING TEST: 1162 GPM

### FIRE FLOW CALCULATION (AVAILABLE GPM @ 20 PSI): 1766 GPM

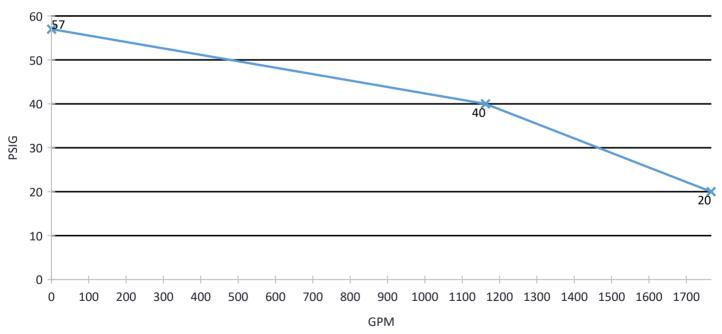

FLOW TEST CHART

Graph data should always be independently calculated and reviewed

Operational conditions of hydrants and test results reflect conditions of the hydrants and system at the time of the inspections/tests. Data Hydrant Inc. dba Hydrant.com does not guarantee, certify, or imply future pressures or operability of the hydrants at any time before, during, or after tests are conducted.

## All fire hydrants should be inspected, operated, and flushed at least annually.

## Data Hydrant Inc. dba Hydrant.com



Contained within are fire flow test results for determining the available water supply for the design of a water based protection system using two hydrants per NFPA 4.4. The test was conducted on 1/27/2025 at 10:55 AM

RESIDUAL HYDRANT #: 549 RESIDUAL HYDRANT LOCATION: 427 E MAGNOLIA ST

### **STATIC PSI: 60**

**RESIDUAL PSI: 55** while flowing hydrant # 548

FLOW HYDRANT #: 548


### FLOW HYD LOCATION: SOUTHEAST CORNER OF N MORGAN ST AND E LOCUS ST

2.5IN PRIMARY HOSE NOZZLE FLOW PSI #: 9

2.5IN SECONDARY HOSE NOZZLE FLOW PSI #: 9

GPM FLOWED DURING TEST: 1008 GPM

### FIRE FLOW CALCULATION (AVAILABLE GPM @ 20 PSI): 3095 GPM

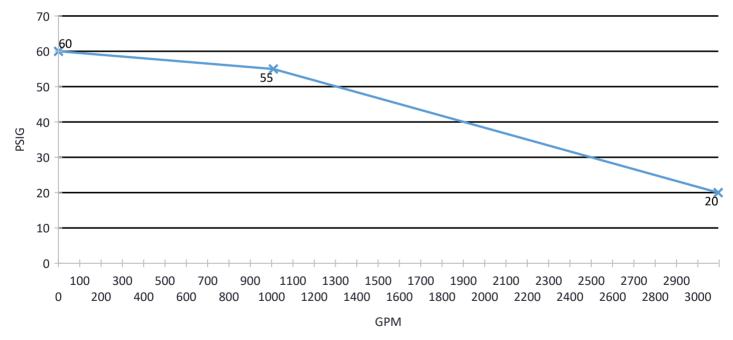

### FLOW TEST CHART

Graph data should always be independently calculated and reviewed

Operational conditions of hydrants and test results reflect conditions of the hydrants and system at the time of the inspections/tests. Data Hydrant Inc. dba Hydrant.com does not guarantee, certify, or imply future pressures or operability of the hydrants at any time before, during, or after tests are conducted.

## All fire hydrants should be inspected, operated, and flushed at least annually.

## Data Hydrant Inc. dba Hydrant.com



Contained within are fire flow test results for determining the available water supply for the design of a water based protection system using two hydrants per NFPA 4.4. The test was conducted on 1/24/2025 at 9:21 AM

RESIDUAL HYDRANT #: 713 RESIDUAL HYDRANT LOCATION: ACROSS FROM 221 N PARISH ST

**STATIC PSI: 54** 

**RESIDUAL PSI: 40** while flowing hydrant # 714

FLOW HYDRANT #: 714


FLOW HYD LOCATION: ACROSS FROM 409 N PARISH ST

2.5IN PRIMARY HOSE NOZZLE FLOW PSI #: 21

2.5IN SECONDARY HOSE NOZZLE FLOW PSI #: 21

GPM FLOWED DURING TEST: 1538 GPM

FIRE FLOW CALCULATION (AVAILABLE GPM @ 20 PSI): 2476 GPM

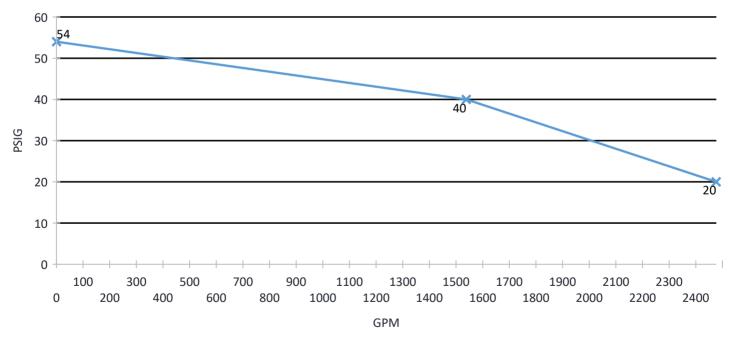

FLOW TEST CHART

Graph data should always be independently calculated and reviewed

Operational conditions of hydrants and test results reflect conditions of the hydrants and system at the time of the inspections/tests. Data Hydrant Inc. dba Hydrant.com does not guarantee, certify, or imply future pressures or operability of the hydrants at any time before, during, or after tests are conducted.

## All fire hydrants should be inspected, operated, and flushed at least annually.

## Data Hydrant Inc. dba Hydrant.com



Contained within are fire flow test results for determining the available water supply for the design of a water based protection system using two hydrants per NFPA 4.4. The test was conducted on 1/27/2025 at 11:24 AM

RESIDUAL HYDRANT #: 537 RESIDUAL HYDRANT LOCATION: 603 E LOCUS ST

### **STATIC PSI: 60**

**RESIDUAL PSI: 23** while flowing hydrant # 536

FLOW HYDRANT #: 536


FLOW HYD LOCATION: 604 E LIVE OAK

2.5IN PRIMARY HOSE NOZZLE FLOW PSI #: 12

2.5IN SECONDARY HOSE NOZZLE FLOW PSI #: 12

GPM FLOWED DURING TEST: 1162 GPM

### FIRE FLOW CALCULATION (AVAILABLE GPM @ 20 PSI): 1208 GPM

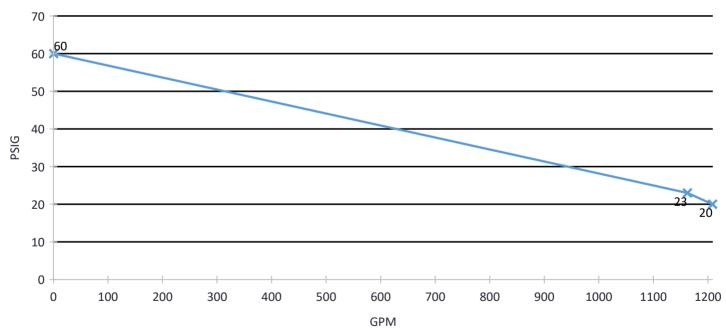

### FLOW TEST CHART

Graph data should always be independently calculated and reviewed

Operational conditions of hydrants and test results reflect conditions of the hydrants and system at the time of the inspections/tests. Data Hydrant Inc. dba Hydrant.com does not guarantee, certify, or imply future pressures or operability of the hydrants at any time before, during, or after tests are conducted.

## All fire hydrants should be inspected, operated, and flushed at least annually.

## Data Hydrant Inc. dba Hydrant.com



Contained within are fire flow test results for determining the available water supply for the design of a water based protection system using two hydrants per NFPA 4.4. The test was conducted on 1/27/2025 at 3:03 PM

RESIDUAL HYDRANT #: 465 RESIDUAL HYDRANT LOCATION: 901 NOTTINGHAM DR

**STATIC PSI: 55** 

**RESIDUAL PSI: 48** while flowing hydrant # 464

FLOW HYDRANT #: 464


FLOW HYD LOCATION: 1117 NOTTINGHAM DR

2.5IN PRIMARY HOSE NOZZLE FLOW PSI #: 12

2.5IN SECONDARY HOSE NOZZLE FLOW PSI #: 12

GPM FLOWED DURING TEST: 1162 GPM

FIRE FLOW CALCULATION (AVAILABLE GPM @ 20 PSI): 2766 GPM

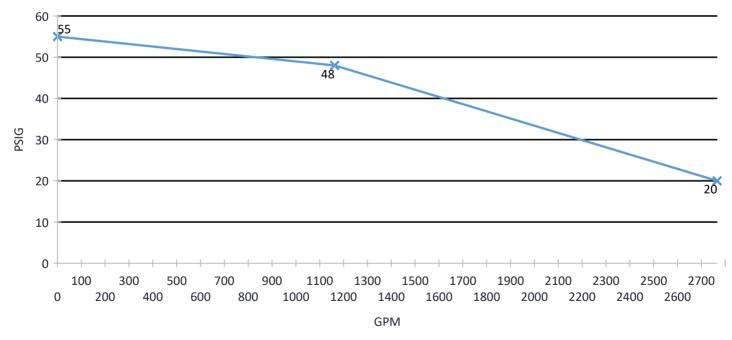

FLOW TEST CHART

Graph data should always be independently calculated and reviewed

Operational conditions of hydrants and test results reflect conditions of the hydrants and system at the time of the inspections/tests. Data Hydrant Inc. dba Hydrant.com does not guarantee, certify, or imply future pressures or operability of the hydrants at any time before, during, or after tests are conducted.

## All fire hydrants should be inspected, operated, and flushed at least annually.

## Data Hydrant Inc. dba Hydrant.com



Contained within are fire flow test results for determining the available water supply for the design of a water based protection system using two hydrants per NFPA 4.4. The test was conducted on 1/27/2025 at 9:33 AM

RESIDUAL HYDRANT #: 552 RESIDUAL HYDRANT LOCATION: 301 E MAGNOLIA ST

### **STATIC PSI: 58**

**RESIDUAL PSI: 32** while flowing hydrant # 932

FLOW HYDRANT #: 932


FLOW HYD LOCATION: 301 E MAGNOLIA ST

2.5IN PRIMARY HOSE NOZZLE FLOW PSI #: 25

2.5IN SECONDARY HOSE NOZZLE FLOW PSI #: 25

**GPM FLOWED DURING TEST: 1678 GPM** 

### FIRE FLOW CALCULATION (AVAILABLE GPM @ 20 PSI): 2064 GPM

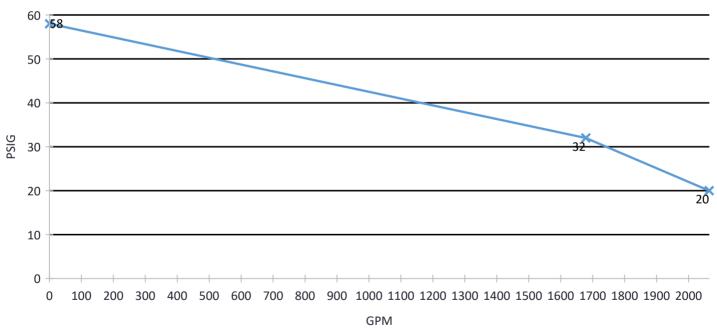

FLOW TEST CHART

Graph data should always be independently calculated and reviewed

Operational conditions of hydrants and test results reflect conditions of the hydrants and system at the time of the inspections/tests. Data Hydrant Inc. dba Hydrant.com does not guarantee, certify, or imply future pressures or operability of the hydrants at any time before, during, or after tests are conducted.

## All fire hydrants should be inspected, operated, and flushed at least annually.

## Data Hydrant Inc. dba Hydrant.com



Contained within are fire flow test results for determining the available water supply for the design of a water based protection system using two hydrants per NFPA 4.4. The test was conducted on 1/27/2025 at 1:58 PM

### RESIDUAL HYDRANT #: 284

RESIDUAL HYDRANT LOCATION: 2760 BRAZOS PKWY - SOUTH EAST SIDE OF PROPERTY

### STATIC PSI: 60

**RESIDUAL PSI: 23** while flowing hydrant # 285

FLOW HYDRANT #: 285


### FLOW HYD LOCATION: 2760 BRAZOS PKWY - NORTH SIDE OF PROPERTY

2.5IN PRIMARY HOSE NOZZLE FLOW PSI #: 12

2.5IN SECONDARY HOSE NOZZLE FLOW PSI #: 12

### **GPM FLOWED DURING TEST: 1162 GPM**

### FIRE FLOW CALCULATION (AVAILABLE GPM @ 20 PSI): 1208 GPM

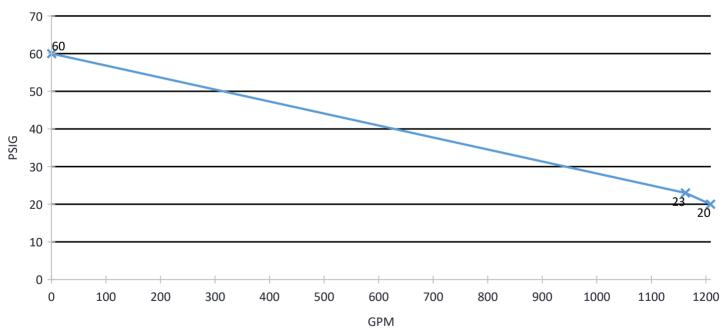

### FLOW TEST CHART

Graph data should always be independently calculated and reviewed

Operational conditions of hydrants and test results reflect conditions of the hydrants and system at the time of the inspections/tests. Data Hydrant Inc. dba Hydrant.com does not guarantee, certify, or imply future pressures or operability of the hydrants at any time before, during, or after tests are conducted.

## All fire hydrants should be inspected, operated, and flushed at least annually.

## Data Hydrant Inc. dba Hydrant.com

# 21. MAKE, MODEL, & YEAR

### 29-Jan-25

HYDRANT	MAKE	MODEL	YEAR	LOCATION
224	MUELLER	CENTURION	2024	237 PRAIRIE LEA DR
43	MUELLER	CENTURION	2024	ACROSS FROM 103 W MUNSON ST
202	MUELLER	CENTURION	2023	1024 HOELEWYN DR
14	MUELLER	CENTURION	2023	820 W MULBERRY ST
925	MUELLER	CENTURION	2023	1901 ALAMO DR
924	MUELLER	CENTURION	2023	241 DALLAS ST
172	MUELLER	CENTURION	2023	ACROSS FROM 105 CEMETERY RD
926	MUELLER	CENTURION	2023	1925 ALAMO DR
923	MUELLER	CENTURION	2023	213 DALLAS ST
927	MUELLER	CENTURION	2023	240 HOUSTON ST
558	MUELLER	CENTURION	2023	NORTHWEST CORNER OF N CHENANGO ST AND E MAGNOLIA ST
929	MUELLER	CENTURION	2023	1320 E KIBER ST
510	MUELLER	CENTURION	2023	603 N TINSLEY
921	MUELLER	CENTURION	2023	1117 CHEVY CHASE DR
920	MUELLER	CENTURION	2023	1013 CHEVY CHASE DR
126	MUELLER	CENTURION	2023	330 S ANDERSON ST
25	MUELLER	CENTURION	2023	474 COUTY RD 609 - WATER TREATMENT PLANT
310	MUELLER	CENTURION	2023	6 DALLAS CT
191	MUELLER	CENTURION	2023	SOUTH END OF OF SHANKS RD
274	MUELLER	CENTURION	2022	NORTHWEST INTERSECTION OF S FRONT ST AND KETCHUM DR
142	MUELLER	CENTURION	2022	1258 PYBURN ST
275	MUELLER	CENTURION	2022	SOUTHWEST INTERSECTION OF S FRONT ST AND JOHN DR
557	MUELLER	IMPROVED	2022	136 E LOCUS ST
706	MUELLER	CENTURION	2022	COALE RD FEEDER BETWEEN 288 AND S FRONT ST - EASTERN ENTRANCE TO WAREHOUSE DEVELOPMENT
772	MUELLER	CENTURION	2022	NORTHWEST INTERSECTION OF GREENBRIAR LP AND BRYAN WAY
644	MUELLER	CENTURION	2022	821 MILLER ST
928	MUELLER	CENTURION	2022	212 HOUSTON ST

Page 1 of 16

HYDRANT	MAKE	MODEL	YEAR	LOCATION
152	MUELLER	CENTURION	2022	2404 S VELASCO ST
273	MUELLER	CENTURION	2022	SOUTHWEST CORNER OF S FRONT ST AND YANCY RD
919	MUELLER	CENTURION	2022	901 CHEVY CHASE DR
192	MUELLER	CENTURION	2022	1503 ALENA RD
136	MUELLER	CENTURION	2022	1716 COUNTY RD 428 - NORTH WEST SIDE OF PROPERTY
932	MUELLER	CENTURION	2022	301 E MAGNOLIA ST
934	MUELLER	CENTURION	2022	303 E LOCUST ST
171	MUELLER	CENTURION	2022	SOUTHEAST CORNER OF S VELASCO ST AND CEMETERY RD
933	MUELLER	CENTURION	2022	SOUTHWEST CORNER OF N ARCOLA ST AND E LOCUST ST
935	MUELLER	CENTURION	2022	304 E LIVE OAK
930	MUELLER	CENTURION	2022	1040 S ANDERSON ST
774	MUELLER	CENTURION	2021	216 BRYAN WAY
775	MUELLER	CENTURION	2021	3 LAGO CT
903	MUELLER	CENTURION	2021	NORTHEAST CORNER OF GREENBRIAR LOOP
902	MUELLER	CENTURION	2021	42 YARDS EAST FROM THE SOUTHEAST CORNER OF GREENBRIAR LP AND BRYAN WAY
133	MUELLER	CENTURION	2021	408 EVANS ST
773	MUELLER	CENTURION	2021	308 BRYAN WAY
281	MUELLER	CENTURION	2021	ACROSS FROM 2221 S FRONT ST
908	MUELLER	CENTURION	2021	201 LAURA LEIGH LN
907	MUELLER	CENTURION	2021	237 LAURA LEIGH LN
770	MUELLER	CENTURION	2021	ACROSS FROM 272 LAURA LEIGH LN
906	MUELLER	CENTURION	2021	235 LISA MARIE DR
771	MUELLER	CENTURION	2021	77 YARDS EAST FROM THE NORTHEAST CORNER OF LISA MARIE DR AND GIFFORD RD
749	MUELLER	CENTURION	2021	883 OAK RIDGE DR
748	MUELLER	CENTURION	2021	303 OAK RIDGE DR
752	MUELLER	CENTURION	2021	854 OAK RIDGE DR
750,751	MUELLER	CENTURION	2021	870 OAK RIDGE DR

### 29-Jan-25

HYDRANT	MAKE	MODEL	YEAR	LOCATION
753	MUELLER	CENTURION	2021	838 OAK RIDGE DR
901	MUELLER	CENTURION	2020	106 AUSTIN RD
900	MUELLER	CENTURION	2019	130 AUSTIN RD
745	MUELLER	CENTURION	2019	1000 SOUTHSIDE DR
747	MUELLER	CENTURION	2019	ACROSS FROM 825 SOUTHSIDE DR
746	MUELLER	CENTURION	2019	1009 SOUTHSIDE DR
225	MUELLER	CENTURION	2019	NORTHWEST CORNER OF SOUTHSIDE DR AND E CEMETERY RD
121	MUELLER	CENTURION	2019	1020 PARK LN
931	MUELLER	CENTURION	2018	1393 S VELASCO ST
299	MUELLER	CENTURION	2018	21039 COUNTY RD 171
233	MUELLER	CENTURION	2018	1009 S VELASCO ST - NEXT TO DRAINAGE DITCH
831	MUELLER	CENTURION	2017	500 WARD RD
830	MUELLER	CENTURION	2017	800 PATTEN RD
914	DARLING	B84B-5	2016	ACROSS FROM 1302 LAUREL LOOP
913	DARLING	B84B-5	2016	1281 LAUREL LOOP
234	MUELLER	CENTURION	2016	901 S VELASCO ST - SOUTH OF PROPERTY
910	MUELLER	CENTURION	2016	2113 C.R. 220
712	MUELLER	CENTURION	2016	206 N PARISH ST
714	MUELLER	CENTURION	2016	ACROSS FROM 409 N PARISH ST
705	MUELLER	CENTURION	2016	110 YARDS WEST FROM THE NORTHWEST CORNER OF 288 BUSINESS AND CO RD 220
625	MUELLER	CENTURION	2015	ACROSS FROM 899 SPREADING OAKS DR
909	MUELLER	CENTURION	2015	COALE RD FEEDER BETWEEN 288 AND S FRONT ST - SOUTHWEST CORNER OF WAREHOUSE DEVELOPMENT PROPERTY
646	MUELLER	CENTURION	2015	721 RUSTIC OAKS DR
36	MUELLER	CENTURION	2015	ACROSS FROM 1005 HERITAGE OAKS DR
713	MUELLER	CENTURION	2015	ACROSS FROM 221 N PARISH ST
626	MUELLER	CENTURION	2015	883 SPREADING OAKS DR
911	MUELLER	CENTURION	2015	904 SPREADING OAKS DR

### 29-Jan-25

HYDRANT	MAKE	MODEL	YEAR	LOCATION
912	MUELLER	CENTURION	2015	709 RUSTIC OAKS DR
633	MUELLER	CENTURION	2014	1233 LAUREL LOOP
635	MUELLER	CENTURION	2014	1333 LAUREL LOOP
634	MUELLER	CENTURION	2014	1317 LAUREL LOOP
624	MUELLER	CENTURION	2014	810 OAK RIDGE DR
631	MUELLER	CENTURION	2014	1249 LAUREL LOOP
647	MUELLER	CENTURION	2014	1009 ROBINHOOD LN
302	MUELLER	CENTURION	2014	240 AUSTIN ST
648	MUELLER	CENTURION	2014	1117 ROBINHOOD LN
636	MUELLER	CENTURION	2014	1349 LAUREL LOOP
632	MUELLER	CENTURION	2014	1217 LAUREL LOOP
640	MUELLER	CENTURION	2014	901 ROBINHOOD LN
630	MUELLER	CENTURION	2014	ACROSS FROM 1260 LAUREL LOOP
622	MUELLER	CENTURION	2014	1233 CALDWELL RD
645	CLOW	MEDALLION	2013	976 ANCHOR RD - SOUTH EAST CORNER OF PROPERTY NEXT TO ENTRANCE - HYD ON ENCHANTED OAKS
904	MUELLER	CENTURION	2013	444 E MULBERRY ST
263	MUELLER	CENTURION	2013	1050 CRYSTAL ST
476	MUELLER	CENTURION	2012	SOUTHWEST CORNER OF WALCIK LN AND E MULBERRY ST
553	MUELLER	CENTURION	2012	SOUTHEAST CORNER OF E CEDAR ST AND N VALDERAS ST
18	MUELLER	CENTURION	2010	ACROSS FROM 724 W MULBERRY ST
183	MUELLER	CENTURION	2008	1712 SHANKS RD
543	WATERMASTER	5CD250	2008	105 N ROCK ISLAND ST
33	MUELLER	CENTURION	2007	1100 SOUTHERN OAKS DR
32	MUELLER	CENTURION	2007	1112 SHADY OAK DR
31	MUELLER	CENTURION	2007	1016 SHADY OAK DR
28	MUELLER	CENTURION	2007	2400 W MULBERRY ST
550	MUELLER	CENTURION	2006	1208 N VELASCO ST

Page 4 of 16

HYDRANT	MAKE	MODEL	YEAR	LOCATION
545	MUELLER	CENTURION	2006	601 E MYRTLE ST
546	MUELLER	CENTURION	2006	503 E MYRTLE ST
76	MUELLER	CENTURION	2006	705 N COLUMBIA ST
47	MUELLER	CENTURION	2005	716 MUNSON PL
285	MUELLER	CENTURION	2005	2760 BRAZOS PKWY - NORTH SIDE OF PROPERTY
582	MUELLER	CENTURION	2005	NORTHEAST CORNER OF E ORANGE ST AND S ANDERSON ST
48	MUELLER	CENTURION	2005	41885 HWY 288 - STEPHEN F AUSTIN MEMORIAL PARK
35	MUELLER	CENTURION	2005	1020 HERITAGE OAKS DR
82	MUELLER	CENTURION	2004	WEST END OF W MILLER ST
287	MUELLER	CENTURION	2004	1034 S VELASCO ST
313	MUELLER	CENTURION	2004	1980 E MULBERRY ST
284	MUELLER	CENTURION	2004	2760 BRAZOS PKWY - SOUTH EAST SIDE OF PROPERTY
286	MUELLER	CENTURION	2004	NORTH END OF BRAZOS PKWY
13	MUELLER	CENTURION	2003	1 OAK PARK DR
81	MUELLER	CENTURION	2003	SOUTHEAST CORNER OF W MILLER ST AND N WALKER ST
548	MUELLER	CENTURION	2003	SOUTHEAST CORNER OF N MORGAN ST AND E LOCUS ST
536	MUELLER	CENTURION	2003	604 E LIVE OAK
30	MUELLER	CENTURION	2003	1000 SHADY OAK DR
27	MUELLER	CENTURION	2003	2304 W MULBERRY ST
29	MUELLER	CENTURION	2003	SOUTH CORNER OF OAK RIDGE DR AND ENCHANTED OAKS DR
34	MUELLER	CENTURION	2003	1009 ENCHANTED OAKS DR
70	MUELLER	CENTURION	2003	SOUTHEAST CORNER OF W MILLER ST AND N PARISH ST
562	MUELLER	CENTURION	2002	100 N VELASCO ST
544	MUELLER	CENTURION	2002	445 E MULBERRY ST
577	MUELLER	CENTURION	2002	SOUTHWEST CORNER OF E MULBERRY ST AND S CHENANGO ST
551	MUELLER	CENTURION	2002	305 E MULBERRY ST
465	CLOW	MEDALLION	2000	901 NOTTINGHAM DR

HYDRANT	MAKE	MODEL	YEAR	LOCATION
9	CLOW	MEDALLION	2000	ACROSS FROM 1007 SPREADING OAKS DR
10	CLOW	MEDALLION	2000	1 SPREADING OAKS CT
211	CLOW	MEDALLION	2000	1301 GIFFORD LN
212	CLOW	MEDALLION	2000	1325 GIFFORD LN
213	CLOW	MEDALLION	2000	1408 GIFFORD LN
214	CLOW	MEDALLION	2000	1516 GIFFORD LN
12	CLOW	MEDALLION	2000	904 ENCHANTED OAKS DR
11	CLOW	MEDALLION	2000	800 ENCHANTED OAKS DR
312	CLOW	MEDALLION	1999	SOUTHEAST CORNER OF JAMISON RD AND E MULBERRY ST
649	MUELLER	CENTURION	1999	608 HERITAGE OAKS DR
323	MUELLER	CENTURION	1999	140 E HOSPITAL DR
564	MUELLER	CENTURION	1998	NORTHEAST CORNER OF W MYRTLE ST AND N FRONT ST
8	MUELLER	CENTURION	1998	805 HERITAGE OAKS DR
473	MUELLER	CENTURION	1998	SOUTHWEST CORNER OF E MULBERRY ST AND SAN FELIPE ST
60	MUELLER	CENTURION	1998	NORTHWEST CORNER OF N HANCOCK ST AND W MYRTLE ST
565	MUELLER	CENTURION	1998	SOUTHEAST CORNER OF W MAGNOLIA ST AND N FRONT ST
6	MUELLER	CENTURION	1998	305 HERITAGE OAKS DR
5	MUELLER	CENTURION	1998	400 HERITAGE OAKS DR
4	MUELLER	CENTURION	1998	NORTHWEST CORNER OF HERITAGE OAKS DR AND WESTERN AVE
7	MUELLER	CENTURION	1998	ACROSS FROM 904 HERITAGE OAKS DR
479	MUELLER	CENTURION	1997	NORTHWEST CORNER OF MORNINGSIDE ST AND DANBURY ST
235	MUELLER	CENTURION	1996	SOUTHWEST CORNER OF E KIBER ST AND S VELASCO
46	MUELLER	CENTURION	1995	727 S WALKER ST
116	MUELLER	CENTURION	1995	501 S MORGAN ST
534	MUELLER	CENTURION	1994	804 CINCINNATI
328	MUELLER	CENTURION	1994	2700 TX-35
26	MUELLER	CENTURION	1993	217 SEBESTA RD

HYDRANT	MAKE	MODEL	YEAR	LOCATION
114	MUELLER	CENTURION	1992	301 LAURIE LN
277	MUELLER	CENTURION	1992	344 W PHILLIPS RD
278	MUELLER	CENTURION	1992	111 WALLER LOOP
279	MUELLER	CENTURION	1992	217 WALLER LOOP
120	MUELLER	CENTURION	1990	1011 S ANDERSON ST
227	MUELLER	CENTURION	1989	NORTHWEST CORNER OF CEMETERY RD AND PARK LN
300	MUELLER	CENTURION	1989	20799 COUNTY RD 171 - NEXT TO SIGN
641	MUELLER	CENTURION	1987	132 E HOSPITAL DR - SOUTHWEST CORNER OF PROPERTY NEXT TO TREE
176	MUELLER	CENTURION	1987	ACROSS FROM 725 CAHILL RD
197	MUELLER	CENTURION	1987	SOUTHEAST CORNER OF KADERA RD AND WILBERT ST
322	MUELLER	CENTURION	1987	132 E HOSPITAL DR -
135	MUELLER	CENTURION	1986	1380 E KIBER ST
315	MUELLER	CENTURION	1985	116 KNIGHT ST
314	MUELLER	CENTURION	1985	108 KNIGHT DR
326	MUELLER	CENTURION	1984	220 E HOSPITAL DR
216	MUELLER	CENTURION	1984	1304 FAIR DR
57	MUELLER	CENTURION	1984	601 W ORANGE ST
319	MUELLER	CENTURION	1984	112 DEBORAH DR
318	MUELLER	CENTURION	1984	108 DEBORAH DR
223	MUELLER	CENTURION	1983	205 PRAIRIE LEA DR
218	MUELLER	CENTURION	1983	137 BALD PRAIRIE DR
219	MUELLER	CENTURION	1983	205 BALD PRAIRIE DR
20	MUELLER	CENTURION	1983	202 S WALKER ST
220	MUELLER	CENTURION	1983	245 BALD PRARIE DR
123	MUELLER	CENTURION	1983	NORTHEAST CORNER OF E KIBER ST AND S ANDERSON ST
217	MUELLER	CENTURION	1983	101 BALD PRAIRIE DR
118	MUELLER	CENTURION	1983	712 S ANDERSON ST

### 29-Jan-25

HYDRANT	MAKE	MODEL	YEAR	LOCATION
119	MUELLER	CENTURION	1983	SW CORNER OF S ANDERSON ST AND RICE ST
222	MUELLER	CENTURION	1983	137 PRAIRIE LEA DR
316	MUELLER	CENTURION	1983	124 KNIGHT ST
905	MUELLER	CENTURION	1983	820 S ANDERSON ST
21	MUELLER	CENTURION	1983	305 W PEACH ST
230	MUELLER	CENTURION	1983	328 CEMETERY RD - ACROSS FROM FLAG DISPOSAL BOX
231	MUELLER	CENTURION	1983	SOUTHWEST CORNER OF DWYER ST AND S ANDERSON ST
45	MUELLER	CENTURION	1983	ACROSS FROM 700 S WALKER ST
199	MUELLER	CENTURION	1983	1100 CEMETERY RD - HYDRANT ON GIFFORD RD
22	MUELLER	CENTURION	1983	ACROSS FROM 300 S WALKER ST
56	MUELLER	CENTURION	1983	600 W PEACH ST
221	MUELLER	CENTURION	1983	101 PRAIRIE LEA DR
229	MUELLER	CENTURION	1983	1060 GROVE DR
184	MUELLER	CENTURION	1982	2218 SHANKS RD
182	MUELLER	CENTURION	1982	1820 SHANKS RD
208	MUELLER	CENTURION	1982	1811 GIFFORD RD - SOUTH OF PROPERTY
209	MUELLER	CENTURION	1982	SOUTHEAST CORNER OF ROBERT ST AND GIFFORD RD
110	MUELLER	CENTURION	1982	109 E KIBER ST
17	MUELLER	CENTURION	1982	721 W MULBERRY ST
146	MUELLER	CENTURION	1982	134 WALNUT ST
181	MUELLER	CENTURION	1982	1916 SHANKS RD
158	MUELLER	CENTURION	1981	2425 S VELASCO ST
195	MUELLER	CENTURION	1981	1629 ALENA RD
210	MUELLER	CENTURION	1981	NORTHEAST CORNER OF SUNNY MEADOWS AND GIFFORD RD
317	MUELLER	CENTURION	1981	108 DEBORAH DR
175	MUELLER	CENTURION	1981	614 CAHILL RD
207	MUELLER	CENTURION	1981	403 MEADOW ACRES DR

### 29-Jan-25

HYDRANT	MAKE	MODEL	YEAR	LOCATION
206	MUELLER	CENTURION	1981	ACROSS FROM 321 E PHILLIPS RD
205	MUELLER	CENTURION	1981	282 E PHILLIPS RD
204	MUELLER	CENTURION	1981	238 E PHILLIPS RD
226	MUELLER	CENTURION	1981	ACROSS FROM 928 CEMETERY RD
198	MUELLER	CENTURION	1981	1621 WILBERT RD
269	MUELLER	CENTURION	1981	1203 S FRONT ST
290	MUELLER	CENTURION	1981	1128 S VELASCO
280	MUELLER	CENTURION	1981	NORTHEAST CORNER OF LOSTRACCO ST AND S FRONT ST
145	MUELLER	CENTURION	1981	100 WALNUT ST
148	MUELLER	CENTURION	1981	113 LOSTRACCO ST
149	MUELLER	CENTURION	1981	SOUTH INTERSECTION OF BEECHNUT ST AND CHESTNUT ST
147	MUELLER	CENTURION	1981	217 BEECHNUT ST
272	MUELLER	CENTURION	1981	ACROSS FROM 1501 S FRONT ST
283	MUELLER	CENTURION	1981	ACROSS FROM 2609 S FRONT ST
270	MUELLER	CENTURION	1981	1421 S FRONT ST - ACROSS FROM NW CORNER OF PROPERTY
38	MUELLER	CENTURION	1981	504 BRYAN ST
266	MUELLER	CENTURION	1981	SOUTHWEST CORNER OF S FRONT ST AND WAYNE DR
268	MUELLER	CENTURION	1981	1306 WAYNE ST
267	MUELLER	CENTURION	1981	1116 WAYNE ST
265	MUELLER	CENTURION	1981	ACROSS FROM 1099 S FRONT ST
293	MUELLER	CENTURION	1981	288 S VELASCO ST - UNIT B
292	MUELLER	CENTURION	1981	1404 S VELASCO ST
291	MUELLER	CENTURION	1981	1212 S VELASCO ST
271	MUELLER	CENTURION	1981	ACROSS FROM 1429 S FRONT ST
180	MUELLER	CENTURION	1981	NORTHWEST CORNER OF SHANKS RD AND E PHILLIPS RD
69	MUELLER	CENTURION	1981	523 N PARISH ST
68	MUELLER	CENTURION	1981	NORTHWEST CORNER OF N PARISH ST AND W LIVE OAK

Page 9 of 16

### 29-Jan-25

HYDRANT	MAKE	MODEL	YEAR	LOCATION
67	MUELLER	CENTURION	1981	612 T J WRIGHT ST
66	MUELLER	CENTURION	1981	18 T J WRIGHT ST
64	MUELLER	CENTURION	1981	NORTHEAST CORNER OF T J WRIGHT ST AND W LOCUS ST
63	MUELLER	CENTURION	1981	324 W MAGNOLIA ST
77	MUELLER	CENTURION	1981	NORTHEAST CORNER OF CEDAR AND W COLUMBIA
282	MUELLER	CENTURION	1981	ACROSS FROM 2329 S FRONT ST
156	MUELLER	CENTURION	1981	2609 S VELASCO ST
276	MUELLER	CENTURION	1981	173 WEST PHILLIPS
73	MUELLER	CENTURION	1981	220 N WALKER ST
75	MUELLER	CENTURION	1981	629 W LOCUS ST
49	MUELLER	CENTURION	1981	937 S WALKER ST
55	MUELLER	CENTURION	1981	504 W PEACH ST
40	MUELLER	CENTURION	1981	624 S HANCOCK ST
297	MUELLER	CENTURION	1981	SOUTHWEST CORNER OF W PHILLIPS AND S VELASCO ST
296	MUELLER	CENTURION	1981	145 W PHILLIPS ST
59	MUELLER	CENTURION	1981	SOUTHWEST CORNER OF W MULBERRY ST AND S PARISH ST
160	MUELLER	CENTURION	1981	2213 S VELASCO ST
185	MUELLER	CENTURION	1981	2328 SHANKS RD
289	MUELLER	CENTURION	1981	SOUTHWEST CORNER OF S VELASCO AND CEMETERY RD
155	MUELLER	CENTURION	1981	2713 S VELASCO
153	MUELLER	CENTURION	1981	2816 S VELASCO ST
154	MUELLER	CENTURION	1981	2825 S VELASCO
187	MUELLER	CENTURION	1981	2801 SHANKS RD
188	MUELLER	CENTURION	1981	2600 SHANKS RD
159	MUELLER	CENTURION	1981	2317 S VELASCO ST
157	MUELLER	CENTURION	1981	2521 S VELASCO
189	MUELLER	CENTURION	1981	ACROSS FROM 2615 SHANKS RD

#### 29-Jan-25

HYDRANT	MAKE	MODEL	YEAR	LOCATION
162	MUELLER	CENTURION	1981	SOUTHWEST CORNER OF SHANKS RD AND IDEN RD
161	MUELLER	CENTURION	1981	2123 S VELASCO ST
163	MUELLER	CENTURION	1981	2113 S VELASCO ST
150	MUELLER	CENTURION	1981	97 LOSTROCCO ST
190	MUELLER	CENTURION	1981	2412 SHANKS RD
151	MUELLER	CENTURION	1981	2288 S VELASCO ST
186	MUELLER	CENTURION	1981	2218 SHANKS RD - SOUTH OF PROPERTY
168	MUELLER	CENTURION	1981	1417 S VELASCO ST
295	MUELLER	CENTURION	1981	1600 S VELASCO ST
170	MUELLER	CENTURION	1981	1401 S VELASCO ST
169	MUELLER	CENTURION	1981	1423 S VELASCO ST
164	MUELLER	CENTURION	1981	120 E PHILLIPS RD
294	MUELLER	CENTURION	1981	1500 S VELASCO ST
167	MUELLER	CENTURION	1981	1725 S VELASCO ST
166	MUELLER	CENTURION	1981	2005 S VELASCO ST
165	MUELLER	CENTURION	1981	2021 S VELASCO ST
321	MUELLER	CENTURION	1980	132 E HOSPITAL DR
37	MUELLER	CENTURION	1980	520 BRYAN ST
42	MUELLER	CENTURION	1980	NORTHEAST CORNER OF S FRONT ST AND W MUNSON ST
203	MUELLER	CENTURION	1980	16 GRACE ST
24	MUELLER	CENTURION	1980	713 BETTY ST
196	MUELLER	CENTURION	1980	824 KADERA
79	MUELLER	CENTURION	1980	819 MARSHALL RD
200	MUELLER	CENTURION	1980	1361 GIFFORD RD
215	MUELLER	CENTURION	1980	1505 GIFFORD RD
179	MUELLER	CENTURION	1980	SOUTHEAST CORNER OF SHANKS RD AND KADERA RD
178	MUELLER	CENTURION	1980	1500 SHANKS RD

### 29-Jan-25

HYDRANT	MAKE	MODEL	YEAR	LOCATION
177	MUELLER	CENTURION	1980	328 CEMETERY RD - HYDRANT ON SHANKS RD - NEXT TO SOUTH EAST ENTRANCE TO CEMETERY
174	MUELLER	CENTURION	1980	WEST INTERSECTION OF SHANKS RD AND CAHILL RD
44	MUELLER	CENTURION	1980	600 S HANCOCK ST
572	MUELLER	CENTURION	1979	216 E PLUM ST
124	MUELLER	CENTURION	1979	SOUTHEAST CORNER OF S DOWNING RD AND FAIRGROUND LN
555	MUELLER	IMPROVED	1978	ACROSS FROM 500 N CHENANGO
561	MUELLER	IMPROVED	1978	136 E MYRTLE ST
575	MUELLER	IMPROVED	1978	NORTHWEST CORNER OF E ORANGE ST AND S CHENANGO ST
193	MUELLER	CENTURION	1978	SOUTHWEST CORNER OF KADERA DR AND GIFFORD RD
194	MUELLER	CENTURION	1978	1000 KADERA RD
298	MUELLER	IMPROVED	1978	SOUTH CORNER OF FM 210 AND ANGLETON DANBURY RD
74	MUELLER	CENTURION	1976	110 N WALKER ST
303	MUELLER	CENTURION	1976	276 AUSTIN ST
306	MUELLER	CENTURION	1976	157 HOUSTON ST
129	MUELLER	IMPROVED	1976	600 EARLS CT
53	MUELLER	IMPROVED	1976	NORTHEAST CORNER OF W PLUM ST AND S ERSKINE ST
201	MUELLER	CENTURION	1976	1200 GIFFORD RD
556	MUELLER	CENTURION	1976	111 E LOCUS ST - NEXT TO NO PARKING SIGN
39	MUELLER	CENTURION	1976	726 S ERSKINE ST
117	MUELLER	CENTURION	1976	853 S VALDERAS ST
307	MUELLER	CENTURION	1976	109 BASTROP ST
41	MUELLER	CENTURION	1976	222 W MUNSON ST
80	MUELLER	CENTURION	1976	828 W LIVE OAK ST
474	MUELLER	IMPROVED	1975	1200 CHEVY CHASE DR
480	MUELLER	IMPROVED	1975	NORTHWEST CORNER OF N DOWNING AN E MILLER
404	MUELLER	IMPROVED	1974	SOUTH INTERSECTION OF E CEDAR ST AND E MIMOSA ST
403	MUELLER	IMPROVED	1974	SOUTHWEST CORNER OF CEDAR ST AND E MULBERRY ST

Page 12 of 16

HYDRANT	MAKE	MODEL	YEAR	LOCATION
407	MUELLER	IMPROVED	1974	1524 E MULBERRY ST - NORTH SIDE OF BUILDING
406	MUELLER	IMPROVED	1974	1524 E MULBERRY ST - ACROSS FROM SOUTHEAST CORNER OF BUILDING
464	MUELLER	IMPROVED	1974	1117 NOTTINGHAM DR
54	MUELLER	IMPROVED	1973	220 W ORANGE ST
304	MUELLER	CENTURION	1973	EAST END OF BASTROP ST
288	MUELLER	CENTURION	1973	NORTHWEST CORNER OF S VELASCO AND CEMETERY RD
513	MUELLER	IMPROVED	1972	NORTHWEST CORNER OF N VALDERAS ST AND MILLER ST
125	MUELLER	IMPROVED	1972	338 MUNSON CT
61	MUELLER	IMPROVED	1971	SOUTHEAST CORNER OF W MYRTLE ST AND T J WRIGHT ST
264	MUELLER	CENTURION	1970	NORTHEAST CORNER OF S FRONT AND CEMETERY RD
512	MUELLER	IMPROVED	1970	510 MILLER ST
511	MUELLER	IMPROVED	1970	723 N ROCK ISLAND
311	MUELLER	IMPROVED	1969	133 DALLAS ST
173	MUELLER	IMPROVED	1967	328 CEMETERY RD - ENTRANCE TO CEMETERY
320	MUELLER	IMPROVED	1967	120 E HOSPITAL DR (NORTHEAST CORNER OF PROPERTY)
324	MUELLER	IMPROVED	1967	ACROSS FROM 170 E HOSPITAL DR
15	MUELLER	IMPROVED	1967	1008 W MULBERRY
83	MUELLER	IMPROVED	1967	700 W ASH ST
308	MUELLER	IMPROVED	1966	128 HOUSTON ST
327	MUELLER	IMPROVED	1966	224 E HOSPITAL DR
16	MUELLER	IMPROVED	1966	1116 W MULBERRY ST
232	MUELLER	IMPROVED	1966	502 DWYER ST
409	MUELLER	IMPROVED	1966	1739 E MULBERRY ST
461	MUELLER	IMPROVED	1966	SOUTHWEST CORNER OF E MULBERRY AND WILDCAT DR
309	MUELLER	IMPROVED	1966	172 HOUSTON ST
325	MUELLER	IMPROVED	1966	7 RAYBURN RIDGE
112	MUELLER	IMPROVED	1964	321 SANDS ST

### 29-Jan-25

HYDRANT	MAKE	MODEL	YEAR	LOCATION
111	MUELLER	IMPROVED	1963	321 E KIBER ST
141	MUELLER	IMPROVED	1962	NORTHWEST CORNER OF RAMONA AND SIMS
115	MUELLER	IMPROVED	1962	301 RICE ST
1	MUELLER	IMPROVED	1962	1105 WESTERN AVE
134	MUELLER	IMPROVED	1962	901 S DOWNING RD
568	MUELLER	IMPROVED	1960	SOUTHEAST CORNER OF W ORANGE ST AND S FRONT ST
579	MUELLER	IMPROVED	1960	504 E PEACH ST
566	MUELLER	IMPROVED	1960	SOUTHWEST CORNER OF W LOCUS ST AND N VELASCO ST
569	MUELLER	IMPROVED	1960	NORTHEAST CORNER OF W PEACH ST AND S FRONT ST
127	MUELLER	IMPROVED	1960	620 E PLUM ST
128	MUELLER	IMPROVED	1960	621E MURRAY ST
535	MUELLER	IMPROVED	1960	600 E CEDAR ST
537	MUELLER	IMPROVED	1960	603 E LOCUS ST
549	MUELLER	IMPROVED	1959	427 E MAGNOLIA ST
532	MUELLER	IMPROVED	1957	501 N PECAN ST
2	MUELLER	IMPROVED	1957	913 WESTERN AVE
3	MUELLER	IMPROVED	1957	801 WESTERN AVE
78	MUELLER	STANDARD	1957	700 W LIVE OAK ST
573	MUELLER	IMPROVED	1956	103 E PEACH ST
52	MUELLER	IMPROVED	1955	641 W MIMOSA ST
50	MUELLER	STANDARD	1955	500 CATALPA ST
547	MUELLER	IMPROVED	1953	NORTHWEST CORNER OF E MAGNOLIA ST AND N ANDERSON ST
552	MUELLER	IMPROVED	1953	301 E MAGNOLIA ST
540	MUELLER	IMPROVED	1953	909 E MYRTLE ST
541	MUELLER	IMPROVED	1953	901 E MULBERRY ST
539	MUELLER	IMPROVED	1953	937 E MULBERRY ST
477	MUELLER	IMPROVED	1953	SOUTHWEST CORNER OF E PECAN ST AND E MULBERRY ST

### 29-Jan-25

HYDRANT	MAKE	MODEL	YEAR	LOCATION
559	MUELLER	IMPROVED	1953	300 N VELASCO ST
62	MUELLER	IMPROVED	1953	NORTHEAST CORNER OF W MULBERRY ST AND T J WRIGHT ST
571	MUELLER	IMPROVED	1953	421 S VELASCO ST
113	MUELLER	IMPROVED	1953	305 BERT ST
143	MUELLER	IMPROVED	1953	509 S DOWNING RD
144	MUELLER	IMPROVED	1953	NORTHEAST CORNER OF E KIBER ST AND DOWNING RD
23	MUELLER	IMPROVED	1953	629 HOLLY ST
19	MUELLER	IMPROVED	1953	SOUTHEAST CORNER OF S WALKER ST AND W MULBERRY
139	MUELLER	IMPROVED	1953	NORTHEAST INTERSECTION OF S DOWNING ST AND E ORANGE ST
58	MUELLER	IMPROVED	1953	SOUTHWEST CORNER OF W MULBERRY AND S COLUMBIA ST
581	MUELLER	IMPROVED	1953	445 E ORANGE ST
578	MUELLER	IMPROVED	1953	234 S ARCOLA ST
576	MUELLER	IMPROVED	1953	NORTHEAST CORNER OF HWY 288 BUSINESS AND E ORANGE ST
132	MUELLER	IMPROVED	1951	NORTHEAST INTERSECTION OF E KIBER ST AND FARRER ST
138	MUELLER	IMPROVED	1950	901 S DOWNING ST - NORTH SIDE OF LIVESTOCK JUDGE SEATING AREA
130	MUELLER	IMPROVED	1950	201 FARRER ST
131	MUELLER	IMPROVED	1950	409 FARRER ST
72	MUELLER	IMPROVED	1946	300 N COLUMBIA ST
563	MUELLER	IMPROVED	1946	130 W MULBERRY ST
65	MUELLER	IMPROVED	1946	NORTHWEST CORNER OF N HANCOCK ST AND W LIVE OAK ST
538	MUELLER	CENTURION	1946	624 E MAGNOLIA ST
542	MUELLER	IMPROVED	1946	911 E MULBERRY ST
71	MUELLER	IMPROVED	1946	SOUTHEAST CORNER OF N COLUMBUS ST AND W LIVE OAK ST
140	MUELLER	IMPROVED	1946	NORTHWEST CORNER OF SIMS AND E KIBER ST
554	MUELLER	IMPROVED	1946	131 E LIVE OAK ST
574	MUELLER	IMPROVED	1946	NORTHWEST CORNER OF S CHENANGO AND E PEACH ST
481	MUELLER	IMPROVED	1946	615 DANBURY ST

29-Jan-25

HYDRANT	MAKE	MODEL	YEAR	LOCATION
570	WATEROUS	PACER	1927	SOUTHWEST CORNER OF S CHENANGO ST AND MURRAY ST
560	WATEROUS		1927	126 N VELASCO ST
580	WATEROUS	PACER	1927	NORTHEAST CORNER OF S ARCOLA ST AND E ORANGE ST
228	MUELLER	IMPROVED		1060 VINE DR
533	MUELLER	IMPROVED		918 E CEDAR ST
51	MUELLER	STANDARD		608 CATALPA ST
567	MUELLER	CENTURION		SOUTHEAST CORNER OF N FRONT ST AND W LOCUS ST
305	MUELLER	CENTURION		237 BASTROP ST

Total: 413

Page 16 of 16

# 22. ESTIMATED GALLONS USED TO FLOW TEST HYDRANTS AND FLUSH DIRTY LINES

Estimated Gallons Used To Flow Test Hydrants and Flush Dirty Lines

29-Jan-25

## ESTIMATED GALLONS USED TO FLOW TEST HYDRANTS: 406,691 ESTIMATE IS BASED ON 1 MINUTE OF FLOW AT EACH HYDRANT LOCATION REFER TO ESTIMATED GALLONS USED TO FLOW TEST REPORT

## **ESTIMATED GALLONS USED TO FLUSH DIRTY LINES: 80,242**

ESTIMATE IS BASED ON ADDITIONAL TIME SPENT FLUSHING HYDRANTS REFER TO ESTIMATED GALLONS USED TO FLUSH LINES REPORT

ESTIMATED GALLONS USED DURING 2025 HYDRANT PROJECT: 486,933

# 23. NEW LOCATIONS ADDED DURING JAN. 2025 PROJECT

# New Hydrant Locations Added During Jan. 2025 Project

29-Jan-25

HYDRANT	LOCATION
923	213 DALLAS ST
924	241 DALLAS ST
925	1901 ALAMO DR
926	1925 ALAMO DR
927	240 HOUSTON ST
928	212 HOUSTON ST
929	1320 E KIBER ST
930	1040 S ANDERSON ST
931	1393 S VELASCO ST
932	301 E MAGNOLIA ST
933	SOUTHWEST CORNER OF N ARCOLA ST AND E LOCUST ST
934	303 E LOCUST ST
935	304 E LIVE OAK

Total: 13

# 24. HYDRANTS WITH GIS/MAP ANOMALIES AS OF JAN. 2025

## Hydrants With GIS/Map Anomalies as of Jan. 2025 Project

29-Jan-25

29-Jan-25				
HYDRANT	YEAR	NEW LOCATION	NOT IN GIS	NOTES/LOCATION
927	2023	2025	2025	240 HOUSTON ST
931	2018	2025	2025	1393 S VELASCO ST
932	2022	2025	2025	301 E MAGNOLIA ST
933	2022	2025	2025	SOUTHWEST CORNER OF N ARCOLA ST AND E LOCUST ST
934	2022	2025	2025	303 E LOCUST ST
930	2022	2025	2025	1040 S ANDERSON ST
935	2022	2025	2025	304 E LIVE OAK
923	2023	2025	2025	213 DALLAS ST
924	2023	2025	2025	241 DALLAS ST
925	2023	2025	2025	1901 ALAMO DR
926	2023	2025	2025	1925 ALAMO DR
928	2022	2025	2025	212 HOUSTON ST

CITY OF ANGLETON

## View Associated Work Orders

## Hydrants With GIS/Map Anomalies as of Jan. 2025 Project

29-Jan-25

HYDRANT	YEAR	NEW LOCATION	NOT IN GIS	NOTES/LOCATION
919	2022	2024	2025	901 CHEVY CHASE DR
920	2023	2024	2025	1013 CHEVY CHASE DR
909	2015	2023	2025	COALE RD FEEDER BETWEEN 288 AND S FRONT ST - SOUTHWEST CORNER OF WAREHOUSE DEVELOPMENT PROPERTY
906	2021	2023	2025	235 LISA MARIE DR
907	2021	2023	2025	237 LAURA LEIGH LN
908	2021	2023	2025	201 LAURA LEIGH LN
910	2016	2023	2025	2113 C.R. 220
911	2015	2023	2025	904 SPREADING OAKS DR
905	1983		2025	820 S ANDERSON ST
914	2016			ACROSS FROM 1302 LAUREL LOOP DUPLICATED HYDRANT NUMBER
644	2022			821 MILLER ST GIS SHOWS HYDRANT ON WRONG SIDE OF ROAD - HYD ON EAST SIDE
929	2023	2025	2025	1320 E KIBER ST NO WATER AVAILABLE WHEN HYDRANT IS FULLY OPEN

# CITY OF ANGLETON

**View Associated** 

Work Orders

Page 2 of 3

## Hydrants With GIS/Map Anomalies as of Jan. 2025 Project

View Associated Work Orders

HYDRANT	YEAR	NEW LOCATION	NOT IN GIS	NOTES/LOCATION
900	2019	2023	2025	130 AUSTIN RD
750,751	2021			870 OAK RIDGE DR VERIFY HYDRANT NUMBER IN GIS - HYDRANT IS NUMBERED TWICE

Total: 26

### GENERATE INDIVIDUAL WORK ORDERS FOR THESE HYDRANTS

Page 3 of 3

# 25. NOTES NOT ASSOCIATED WITH OTHER REPORTS

## Notes Not Associated with Other Reports

29-Jan-25

HYDRANT	MAKE	MODEL	YEAR	NOTES/LOCATION
199	MUELLER	CENTURION	1983	3 INCH ROCKS FLUSHED OUT OF PUMPER
				1100 CEMETERY RD - HYDRANT ON GIFFORD RD
51	MUELLER	STANDARD		BONNET IS PAINTED RED - SHOULD BE BLUE
				608 CATALPA ST
48	MUELLER	CENTURION	2005	HYDRANT IS PRIVATE - NOT TESTED
				41885 HWY 288 - STEPHEN F AUSTIN MEMORIAL PARK
299	MUELLER	CENTURION	2018	HYDRANT TAGGED OUT OF SERVICE BY THE CITY BUT TESTED FULLY FUNCTIONAL
				21039 COUNTY RD 171
135	MUELLER	CENTURION	1986	LEAKING FLANGE - TIGHTEN 3 FLANGE BOLTS
				1380 E KIBER ST
298	MUELLER	IMPROVED	1978	MIGHT SET OFF FIRE ALARM AT 3M
				SOUTH CORNER OF FM 210 AND ANGLETON DANBURY RD
301				NO HYDRANT PRESENT
				SOUTHEAST CORNER OF ANGLETON BLVD AND AUSTIN ST
137				NO HYDRANT PRESENT
				901 S DOWNING ST - NORTH SIDE OF COUNTY ARENA

Total: 8

### GENERATE INDIVIDUAL WORK ORDERS FOR THESE HYDRANTS

Page 1 of 1