

SECTION 300 STREETS

301 General

302 Design

- A. General**
- B. Pavement & Right-of-Way Widths**
- C. Geometric Standards**
- D. Intersection Sight Distance**
- E. Stopping Sight Distance**
- F. Apex Peakway Development**
- G. Pavement Design**
- H. Curb, Sidewalk, Driveways**
- I. Entranceway Islands**
- J. Trench Drains**
- K. Alleys**

303 Construction Requirements

- A. General**
- B. Placement of Asphalt Pavements**
- C. Curb and Sidewalk**
- D. Utility Conduits**
- E. Pavement Markings**

304 Inspection

- A. Proof-Rolling**
- B. Compaction Testing - Subgrade**
- C. Base Course & Surface Course Inspection Requirements**
- D. Curb and Sidewalk**

305 Certification

301 General

Unless otherwise provided herein, all materials and street construction methods shall conform to the applicable requirements as outlined in the Standard Specifications for Roads & Structures, latest edition, as published by the NCDOT.

Whenever the following terms are used in said NCDOT specifications, the intended meaning of such terms shall be as follows:

“State” or “Commission” shall be replaced by “Town of Apex”.

“Resident Engineer” shall be replaced by “ENGINEER”.

“Sampling and testing by Commission” shall be replaced by the words “sampling and testing by the TOWN or its authorized testing agent”.

“Inspection by Commission” shall be replaced by “Inspection by TOWN or its duly authorized representative”.

302 Design

A. General

Street design shall conform to the standards set forth in A Policy on Geometric Design of Highways and Streets as published by AASHTO, the Unified Development Ordinance, Standard Specifications for Roads and Structures as published by the NCDOT, Roadway Design Manual as published by the NCDOT, or the Town Standard Specifications and Details, whichever, in the opinion of the ENGINEER, is applicable.

Design vehicles and minimum edge of pavement radii shall be based on street classification per the following table. Compound curves may be considered to accommodate turning movements.

Street Classification	Design Vehicle	Control Vehicle	Edge of Pavement Radius
4 & 6 Lane Thoroughfares	WB-40	WB-62	40 feet
2 & 3 Lane Thoroughfares	WB-40	WB-50	40 feet
Major Collector	SU-30	WB-40	30 feet
Minor Collector	DL-23 ³	FIRE ⁴	25 feet
Residential Street	DL-23 ³	FIRE ⁴	25 feet
Alleys	P ⁷	DL-23 ^{3,7}	10 feet ⁷

Notes:

1. Design Vehicle shall not encroach on adjacent lanes for turning movements.
2. Control Vehicle may encroach on adjacent lanes for turning movements.
3. DL-23: 22.6' length Delivery Truck, 13' wheelbase, 23' inside turning radius, 29' outside turning radius (refer to Urban Street Design Guide published by the National Association of City Transportation Officials).
4. Fire Truck: 21.25' wheelbase, 33.33' outside turning radius w/ 5.34' overhang (Town of Apex).
5. All designated Truck Routes shall meet WB-50 design vehicle.
6. All designated Go Triangle Bus Routes shall meet BUS-40 control vehicle.
7. Alleys that serve solid waste collection and/or provide fire access must meet the same criteria as a Residential Street.

8. Where different street types intersect, the ENGINEER shall be allowed to use the lesser of the two radii.

All proposed roadways shall conform to the Apex Transportation Plan, and the Apex Peakway Development Policy.

B. Pavement & Right-of-Way Widths

Standard street widths are shown in the Standard Details. Actual street widths shall be in accordance with the Apex Transportation Plan or any interim plan effective at the time of plan submittal. Transitions and tapers between sections or at widenings shall be made in accordance with Section 302(A) of these Specifications. The ENGINEER may, at his discretion, require additional widening and related work as deemed necessary to provide for the safety and quality of roadway for the traveling public.

C. Geometric Standards

Unless necessitated by exceptional topography, street grades shall not be less than one half percent (0.5%).

The maximum grade allowed for a local street when approaching an intersection is five percent (5%) for the last 100 feet of pavement before the intersection.

The maximum grade allowed for a collector street or thoroughfare when approaching an intersection is two percent (2%) for the last 100 feet of pavement before the intersection. The beginning of the minimum grade allowed for a street approaching an intersection is measured at the curb-line extension of the intersecting street.

Street grades at pedestrian crossing locations shall meet the following criteria or the latest approved Federal Access Board standards whichever is more stringent.

1. 2% maximum cross slope for crossings located at approaches with a stop or yield condition; and
2. 5% maximum cross slope for crossings located at approaches without stop control.

The following table outlines geometric standards for roadway design. Sound engineering judgement should be exercised when using minimum or maximum design standards for roads. Alternate designs shall be in accordance with the current edition of A Policy on Geometric Design of Highways and Streets as published by AASHTO.

CLASSIFICATION	DESIGN SPEED (MPH)	HORIZONTAL CURVE CONTROLS		MIN. TANGENT B/W REVERSE CURVES (FT)	MAX. GRADE (%)	MIN. VERTICAL CURVE LENGTH (FT)	VERTICAL CURVE CONTROLS	
		MAX. SUPER ELEV. (%)	MIN. CL RADIUS (FT)				MIN. LENGTH CREST (FT)	MIN. LENGTH SAG (FT)
THOROUGHFARE	50	4	926	400	7	150	84A	96A
MAJOR COLLECTOR	35	4	371	200	9	100	29A	49A
MINOR COLLECTOR	30	NC	333	150	10	100	19A	37A
RESIDENTIAL STREET	25	NC	198	0	10	50	12A	26A
ALLEY	--	RC	50	0	10	50	12A	26A

A = ALGEBRAIC DIFFERENCE IN GRADES

NC / RC = NORMAL CROWN / REVERSE CROWN

D. Intersection Sight Distance

All stop-controlled intersections shall meet minimum AASHTO sight distance requirements. A 10-foot x 70-foot sight triangle easement shall be provided at all intersections except where the ENGINEER is provided a plan illustrating such easements are not required or can be reduced in size based on AASHTO minimum sight line projections in cases where the typical 10-foot x 70-foot sight triangle easement would otherwise create a conflict with proposed structures. The 10-foot dimension shall be the setback from the right-of-way of the major street, and the 70-foot dimension shall be measured along the right-of-way of the major street. Sight triangle easements shall be increased if necessary to meet AASHTO minimum guidelines based on the projection of sight lines from the intersection. Sight triangle easements shall be shown on the final plat for the developed tract.

Plant materials placed within the sight triangle shall be limited to a mature height of 30 inches. Signs or other structures shall not be allowed.

Intersection Sight Distance for Left Turn from Stop (Passenger Cars)

Design Speed (Major Road)	Posted Speed (Major Road)	2-lane Undivided		3-lane Undivided or 2-lane Divided w/ 12' median		4-lane Undivided		5-lane Undivided or 4 lane Divided w/ 12' median	
		Calculated	Design	Calculated	Design	Calculated	Design	Calculated	Design
25	20	275.6	280	294.0	300	312.4	315	330.8	335
30	25	330.8	335	352.8	355	374.9	375	396.9	400
35	30	385.9	390	411.6	415	437.3	440	463.1	465
40	35	441.0	445	470.4	475	499.8	500	529.2	530
45	40	496.1	500	529.2	530	562.3	565	595.4	600
50	45	551.3	555	588.0	590	624.8	625	661.5	665
55	50	606.4	610	646.8	650	687.2	690	727.7	730
60	55	661.5	665	705.6	710	749.7	750	793.8	795

Reference: Table derived from AASHTO Table 9.7 (Case B1) using the following parameters:

ISD = $1.47 \cdot V \cdot t_g$ where:

ISD = Intersection sight distance (length of leg of sight triangle along major road)

V = design speed of major road (mph)

t_g = 7.5s time gap for 2-lane plus 0.5s for each additional lane

Method of measurement

1. Driver's eye height shall be a minimum of 3.5 feet above pavement.
2. Driver's eye shall be placed 15 feet from edge of pavement.
3. Object height (approaching vehicle) shall be 4.25 feet above center of traffic lane.

Minimum Intersection Sight Distance for Right Turn from Stop

Design Speed (Major Road)	Posted Speed (Major Road)	Calculated	Design
25	20	238.9	240
30	25	286.7	290
35	30	334.4	335
40	35	382.2	385
45	40	430.0	430
50	45	477.8	480
55	50	525.5	530
60	55	573.3	575

Reference: Table derived from AASHTO Table 9.9 (Case B2) using the following parameters:

ISD = $1.47 \cdot V \cdot t_g$ where:

ISD = Intersection sight distance (length of leg of sight triangle along major road)

V = design speed of major road (mph)

t_g = 6.5s time gap for 2-lane plus 0.5s for each additional lane

Method of measurement

1. Driver's eye height shall be a minimum of 3.5 feet above pavement.
2. Driver's eye shall be placed 15 feet from edge of pavement.
3. Object height (approaching vehicle) shall be 4.25 feet above center of traffic lane.


E. Stopping Sight Distance

Minimum Stopping Sight Distance (feet), Street Grade (%)							
Design Speed	Upgrades			Flat	Downgrades		
	9%	6%	3%	0%	-3%	-6%	-9%
60	495	515.0	540	570.0	600	640.0	690
55	435	450.0	470	495.0	520	555.0	595
50	375	390.0	405	425.0	450	475.0	510
45	320	335.0	345	360.0	380	400.0	430
40	270	280.0	290	305.0	315	335.0	355
35	225	230.0	240	250.0	260	275.0	290
30	180	185.0	200	200.0	205	215.0	230
25	140	145.0	150	155.0	160	165.0	175


Reference: Table derived from AASHTO 2018 (Tables 3.1 and 3-2) and distances rounded to nearest 5 feet.

SOURCE: A Policy on Geometric Design of Highways and Streets American Association of State Highway and Transportation Officials

PLAN VIEW

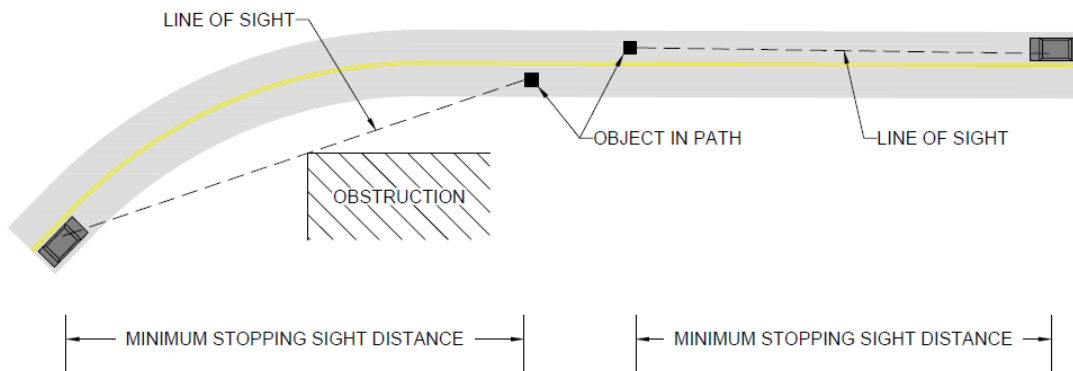

PROFILE VIEW

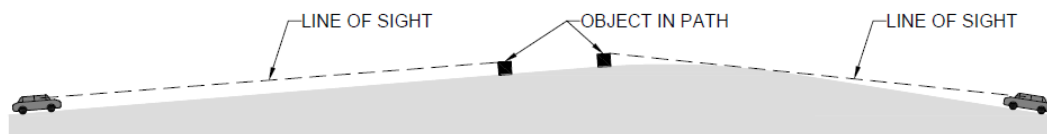

NOTE:

1. DRIVER'S EYE HEIGHT SHALL BE 3.5 FEET ABOVE PAVEMENT.
2. OBJECT HEIGHT SHALL BE 0.5 FEET ABOVE CENTER OF TRAVEL LANE.

F. Apex Peakway Development (Apex Peakway)

Refer to the *Planning Department* for the Apex Peakway Development Policy.

G. Pavement Design

The pavement designs presented in the standard details shall be considered the minimum design requirements. The DEVELOPER shall furnish a pavement design report produced and certified by a professional engineer, using AASHTO methodology. The report shall be based on field and lab testing of in place subgrade materials by a qualified geotechnical firm and shall incorporate the following criteria: 20-year design life, 4% annual growth rate, and appropriate traffic projections. Soil sample locations shall be as directed by the INSPECTOR. If the design structural coefficient exceeds that of the standard, the design structure shall be used.

H. Curb, Sidewalk, Driveways

Concrete for curb and gutter, driveways, or sidewalks shall be portland cement concrete having a 28-day strength of 3000 psi when tested in accordance with ASTM C39. Detailed specifications for concrete shall conform to the specifications contained in Section 200. Joint fillers shall be a non-extruding joint material conforming to ASTM D1751.

The minimum thickness of a sidewalk shall be 4 inches. Sidewalks shall have a uniform slope perpendicular to the curb of 1/4-inch per foot toward the roadway. Sidewalks shall be installed during roadway construction and/or widening.

Where a sidewalk intersects with a driveway access, the sidewalk section shall be 6-inches thick. All sidewalks and greenways shall meet the current Americans With Disabilities Act (ADA) requirements.

Sidewalks shall be constructed ~~on the north or east side of the roadway, and~~ at locations as indicated by the Unified Development Ordinance and these specifications.

Curb and gutter, where required, shall be standard 30-inch combination curb and gutter. Upon the approval of the Town, 30-inch valley curb and gutter may be permitted in townhome developments. Standard 18-inch median curb and gutter may be used on entrance islands and medians when deemed appropriate by the ENGINEER.

I. Entranceway Islands

Islands shall be limited to such a size as to allow adequate turning room for larger vehicles. The minimum pavement width for both the entrance and exit lanes shall be 20 feet. Islands shall accommodate the turn radius of a WB-62 design vehicle, as outlined in A Policy on Geometric Design of Highways and Streets, AASHTO, current edition. The island shall not extend into the turnout of the intersection.

J. Trench Drains

All entrances with irrigation systems shall require a trench drain directly behind the curb and gutter. The trench shall be a minimum of 12 inches wide and 18 inches deep. A 4-inch perforated pipe shall be laid at the bottom of the ditch in the center. The ditch shall then be backfilled with washed stone wrapped in the appropriate geotextile fabric. The perforated pipe shall drain to a catch basin.

K. Alleys

All alleys shall either connect to the street right of way at each end or include a cul-de-sac.

303 Construction Requirements

A. General

All roadway subgrade, alley subgrade, storm sewer, and utility construction shall be inspected and approved by the TOWN prior to placement of base course materials.

All streets shall be cleared and graded for the full width of the right-of-way within 50 feet of any street intersection. Additional street clearing and grading shall be as follows:

Future Development - where planned roadways are to be built (i.e. the Peakway, roads in other phases, or roads by other developers), the rough grading shall be completed in areas where it shall impact homeowners or businesses in the phase currently under construction.

Major Streets & Thoroughfares - the full width of the right-of-way.

Collector Streets - the full width of the right-of-way.

Urban Street & Urban Cul-de-Sac - the full width of the right-of-way on the sidewalk side, and 8 feet back of curb on the "non-sidewalk" side.

B. Placement of Asphalt Pavements

Typical surface course shall have a total thickness of not less than as shown on the Standard Details, and shall be placed in 2 lifts.

Following initial lift, the CONTRACTOR shall provide temporary drains at catch basins to allow streets to drain and to eliminate ponding at the low points. Catch basin modifications shall be repaired at the time of final surface paving.

The second lift placement shall be delayed during the period of initial residential

construction activity and until such time as its placement is approved by the ENGINEER, subject to the following conditions:

Placement of the second lift shall be no earlier than 12 months after placement of the first lift and only after 75 percent of the Certificates of Occupancy have been issued for the subdivision or phase of subdivision under construction.

Prior to placement of the final lift of pavement, the existing initial lift shall be thoroughly cleaned and all cracks, spalling, and other failure shall be repaired to the satisfaction of the ENGINEER. A tack coat shall be used on the road surface and the curb face. Furthermore, any cracked concrete that is around valve covers and manhole covers shall be replaced prior to paving.

Asphalt materials shall not be produced or placed under any of the following conditions:

- during rainy weather or whenever moisture on the surface to be paved would prevent proper bond;
- when the subgrade or base course is frozen or wet;
- when temperatures, measured in the shade away from artificial heat at the location of the paving operation, do not meet the following criteria;

Material Type	Minimum Air Temperature	Minimum Ground Temperature
Prime & Tack Coat	40° F	40° F
Asphalt Base Course	40° F	40° F
Asphalt Intermediate Course	40° F	40° F
Asphalt Surface Course	50° F	50° F

- between December 15 and March 16 for surface course material that is to be the final layer of pavement;
- when intermediate or base course will not be covered with surface course during the same calendar year or within 15 days of placement if the plant mix is placed in January or February; a sand seal is required when the intermediate or base is not covered as required.

C. Curb and Sidewalk

The subgrade shall be excavated to the required depth, and shaped to the proper cross-section. Where tree roots are encountered, they shall be removed to a depth of 1 foot for the full width of the excavation. The subgrade shall be stable and thoroughly compacted.

Forms shall be set and maintained true to the required lines, grades, and dimensions. Forms shall be constructed with material of such strength and with such rigidity to prevent any appreciable deflection between supports. Straight forms shall be within a tolerance of 1/2-inch in 10 feet from a true line horizontally or vertically. Forms shall be thoroughly cleaned of all dirt, mortar and foreign material before being used. All inside form surfaces shall be thoroughly coated with commercial quality form oil.

Contraction joints shall be cut to a depth equal to at least 1/3 of the total slab thickness. The contraction joint shall be no less than 1/8 inch in width. Contraction joints shall be spaced at 5-foot intervals for sidewalk and spaced at 10-foot intervals for curb and gutter, or 15-foot intervals when a machine is used. A 1/2-inch expansion joint filled with joint filler shall be placed between all rigid objects and placed no farther than 50 feet apart for sidewalks and curb and gutter, extending the full depth of the concrete with the top of the filler 1/4-inch below the finished surface. The surface of sidewalks shall be finished to grade and cross-section with a float, troweled smooth and finished with a broom. Refer to the Standard Detail.

D. Utility Conduits

Buried conduits for low voltage utility installations shall be installed in accordance with the Standard Detail. All residential and commercial driveways shall have at minimum one 3-inch diameter Schedule 40 PVC conduit installed across the entire width of the driveway, extending 1 foot beyond the edges of the driveway. Conduits shall be sealed at each end with an unglued PVC cap.

For all lots that require sidewalk along the road frontage, conduits shall be installed below the sidewalk in accordance with the Standard Detail. All sidewalks, along a lot frontage, shall have at minimum 2 individual 3-inch diameter Schedule 40 PVC conduits installed across the entire width of the sidewalk, extending 1 foot beyond the edges of the sidewalk. Sidewalk conduits shall be installed on both sides of the lot and at a location of approximately 1 foot inside of the lot's property line. Conduits shall be sealed at each end with an unglued PVC cap.

All conduits shall be marked with a 2-inch brass cap, cast into the concrete curb and/or the sidewalk to indicate the location of the buried conduit. Brass caps shall be stamped with the words "Utility Conduit Crossing" in 3/8-inch tall lettering. All caps shall be held true to final elevation, within the forms, prior to and during placement of concrete, by the use of a 12-inch long rebar stake. One cap shall be installed at each individual utility conduit installation.

E. Pavement Markings

All pavement markings shall be thermoplastic material meeting NCDOT specifications, unless otherwise directed by the Engineer.

304 Inspection

A. Proof-Rolling

Street embankments shall be graded and compacted as described in Section 200 of these Specifications. After all utilities and storm sewers have been installed, the subgrade shall be fine graded and restored to required grade, and then proof-rolled by using a fully loaded tandem dump truck or a fully loaded water truck. Should any “pumping” or displacement be observed during the proof-rolling, the defective area(s) shall be repaired by replacing defective material w/suitable material, alternative stabilization methods such as fabric, Geo-Grid, lime, etc., or any combination thereof to the satisfaction of the TOWN and thoroughly compacted. The proof rolling shall be repeated until there is no evidence of “pumping” or displacement.

Recommendations from outside sources such as soils engineers and technicians may be suggested. However, the TOWN shall have authority for approval of additional measures.

B. Compaction Testing - Subgrade

Upon completion of the proof rolling, the DEVELOPER/CONTRACTOR shall furnish to the ENGINEER a report from a certified soils testing laboratory. The report shall present the results of a Proctor analysis demonstrating that the subgrade compaction is acceptable in accordance with standard requirements of NCDOT in all of the significant fill areas. The subgrade shall then be inspected by the INSPECTOR, and upon its acceptance and approval, the stone base course may be placed. However, no stone base may be placed prior to backfilling behind the curb.

The cost of laboratory testing of subgrade compaction shall be borne by the DEVELOPER/ CONTRACTOR.

C. Base Course & Surface Course Inspection Requirements

The Town reserves the right to require that quarry tickets be presented to the INSPECTOR to enable a check for yield at the specified final thickness. The base material shall then be inspected by the INSPECTOR, and upon acceptance and approval, the surface course may be placed.

Surface course shall be placed and compacted in accordance with NCDOT requirements. Copies of delivery tickets shall be furnished to the INSPECTOR to enable a check for yield at the specified final thickness. Density testing shall be performed for each lift of asphalt and reports shall be furnished to the INSPECTOR.

Should there be a question as to the final thickness of aggregate base course or surface course, the INSPECTOR reserves the right to require the DEVELOPER/CONTRACTOR to provide random core samples by an independent testing laboratory to demonstrate actual thickness of base and surface courses. A certified testing laboratory shall take core

samples and the results shall be presented to the INSPECTOR. Should the cores reveal insufficient thickness, the CONTRACTOR shall provide additional surface course as may be required or shall furnish other remedial measures as may be acceptable to the INSPECTOR. The cost of compaction testing and coring work shall be borne by the DEVELOPER.

D. Curb and Sidewalk

No concrete shall be placed until the forms, necessary conduits, and subgrades have been inspected and approved by the INSPECTOR. Where stone is used underneath the driveway and/or over conduits, it shall be compacted ABC stone. Washed stone shall not be permitted.

Conduits shall be installed to the depths and locations indicated in the Standard Detail prior to inspection. Conduit trenches shall be left open until inspection. Trenches shall be backfilled with excavated material after inspection and prior to placing concrete. Brass location caps shall be in place prior to inspection.

NO EXCEPTION: For all lots that require sidewalk along the road frontage, sidewalk shall be formed and ready for inspection at the time of the driveway inspection. Sidewalk may be installed prior to, but under no circumstances later than the time of the driveway installation.

305 Certification

The Town of Apex shall require the following certification from an engineer registered in the state of North Carolina prior to final acceptance of any TOWN maintained streets:

I _____, PE hereby certify that the construction of (<u>Street Names</u>) in (<u>Phase #</u>) of (<u>Development Name</u>) is/are in accordance with the minimum pavement design standards and layout submitted and approved by the Town of Apex on (<u>Date of Approval</u>).	
S E A L	_____ Name
	_____ Date