



Ely Concrete LLC Martin L. Ely

City of Bay St Louis					
Construction Repairs to Sidewalks and Driveways					
Construction Cost Estimate					
Item NO.	Desription	Unit	Unit Cost	QTY	Total Cost
1	Sidewalks (4" Thick)	SY	80.00	67	5360.00
2	Driveways (6" Thick)	SY	95.00	300	28,500.00
3	Saw cutting Asp/Concrete	INLF	1.00	400	400.00
4	2.5' x 2.5' Concrete Pad (4" Thick)	EA	70.00	30	2100.00
					36,360
Notes:	All listed below are include in sy price of concrete				
	SW and DW will be 3500 PSI with Fiber or wire mesh				
	Remove temp rock and deliver to City Yard at St Francis St and Bookter St				
	Compact subgrade, fine grade, expansion material, forms, remove forms, backfill and dress up				

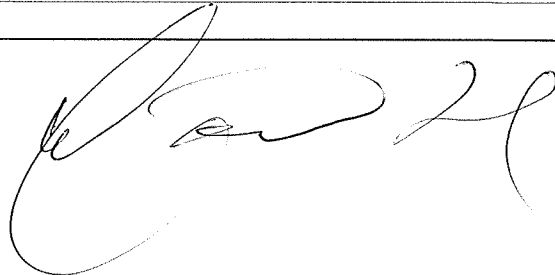


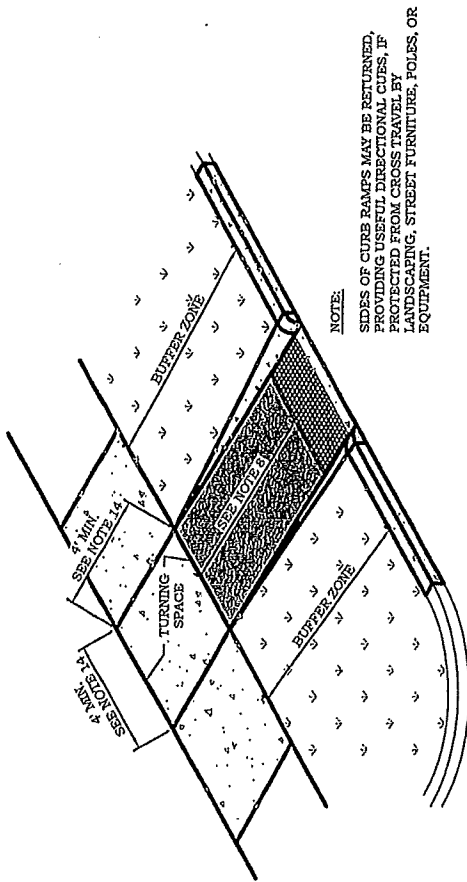

PERPENDICULAR RETURNED CURB RAMP


N.T.S.

SCORE JOINTS AT WIDTH OF SIDEWALK O.C. WITH 1/2" EXPANSION JOINTS AT 40'-0" O.C. WITH PRE-MOLDED FILLER (TYP.)

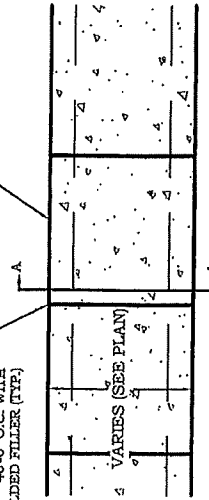

SIDEWALK PLAN

SCALE 1/2"=1'-0"

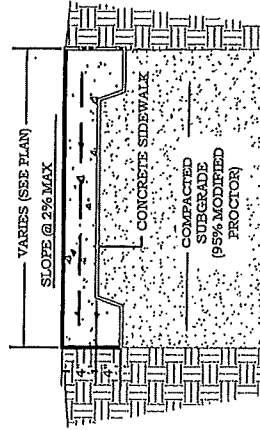

SECTION A-A

SCALE 1"=1'-0"

GENERAL NOTES:





1. THE DIMENSIONS AND SLOPES PRESENTED IN THE DETAILS ARE THE MINIMUM NECESSARY TO COMPLY WITH THE ADA AND MDOT STANDARDS. ANY DEVIATION LESS THAN THE MINIMUM WIDTH OR GREATER THAN THE MAXIMUM SLOPE FROM THESE STANDARDS MUST BE DOCUMENTED WITH THE STANDARD BEING MET TO THE GREATEST EXTENT PRACTICABLE AND CONSISTENT WITH THE MOST CURRENT PUBLIC ACCESSIBILITY GUIDELINES.
2. CURB RAMPS, LANDINGS, AND BLENDED TRANSITIONS MAY REQUIRE THE USE OF DETECTABLE WARNING DETAILS FOR WARNINGS ON THIS SHEET ARE SHOWN FOR ILLUSTRATION ONLY. REFER TO THE DETECTABLE WARNING DETAILS FOR DETAILS ON PLACEMENT, ORIENTATION AND DIMENSIONS.
3. THE LOCATION, ORIENTATION, AND TYPE OF CURB RAMPS SHOULD BE AS SHOWN IN THE PLANS.
4. ANY COMBINATION OF PERPENDICULAR, PERPENDICULAR RETURNED, AND PARALLEL CURB RAMPS MAY BE USED TO ACHIEVE AN ACCESSIBLE DESIGN AS LONG AS THE BASIC REQUIREMENTS FOR CURB RAMPS ARE MET.
5. CURB RAMPS SHALL BE PAID FOR AS SIDEWALK.
6. THE THICKNESS OF THE CURB RAMP SHALL BE A MINIMUM OF 4".
7. BEYOND THE BOTTOM GRADE BREAK, A CLEAR SPACE OF 4" MINIMUM BY 4" MINIMUM SHALL BE PROVIDED WITHIN THE WIDTH OF THE PEDESTRIAN STREET CROSSING AND WHOLLY OUTSIDE THE PARALLEL VEHICLE TRAVEL LANE.

CURB RAMP NOTES:

7. THE CLEAR WIDTH OF CURB RAMP RUNS (EXCLUDING ANY FLARED SIDES), BLENDED TRANSITIONS, AND TURNING SPACES SHALL BE THE WIDTH OF THE SIDEWALK OR A 4' MINIMUM. THE RUNNING SLOPE OF A CURB RAMP SHALL BE 5% MINIMUM, AND 8.33% THE CURB LENGTH IS THE LENGTH NECESSARY TO MEET THE EXISTING SIDEWALK. IT IS NOT NECESSARY THAT THE RAMP EXCEED 15%.
8. WHERE THE SLOPE OF THE ROADWAY EXCEEDS 8.33%, THE CURB RAMP LENGTH IS THE LENGTH NECESSARY TO MEET THE EXISTING SIDEWALK. IT IS NOT NECESSARY THAT THE RAMP EXCEED 15%.
9. THE CROSS SLOPE OF THE CURB RAMPS, BLENDED TRANSITIONS AND TURNING SPACES SHALL BE 2% MAXIMUM (1.5% PREFERRED) AT PEDESTRIAN STREET CROSSINGS WITHOUT YIELD OR STOP CONTROL AND AT MIDDLEBLOCK PEDESTRIAN STREET CROSSINGS, THE CROSS SLOPE IS PERMITTED TO EQUAL THE STREET OR HIGHWAY GRADE.
10. CURB RAMPS AT THE TOP AND BOTTOM OF CURB RAMP RUNS SHALL BE PERPENDICULAR TO THE DIRECTION OF THE RAMP RUNS.
11. SURFACE SLOPES THAT RESULT IN GRADE BREAKS SHALL BE FLUSH.
12. RAMP TRANSITIONS BETWEEN WALKS, TURNING SPACES, LANDINGS, GUTTERS, OR STREETS SHALL BE FLUSH AND FREE OF ABRUPT VERTICAL CHANGES.
13. WHERE A PEDESTRIAN CIRCULATION PATH CROSSES THE CURB RAMP, FLARED SIDES SHALL BE SLOPED 10% MAXIMUM, MEASURED PARALLEL TO THE CURB LINE.

TURNING SPACE NOTES:

13. A TURNING SPACE 4' MINIMUM BY 4' MINIMUM SHALL BE PROVIDED AT THE TOP OF PERPENDICULAR RAMPS AND AT THE BOTTOM OF PARALLEL RAMPS. TURNING SPACES ARE ALLOWED TO OVERLAP OTHER TURNING SPACES AND CLEAR SPACES. THE TURNING SPACE IS CONSTRAINED BY A CURB, WALL, OR OTHER OBSTRUCTION, THE TURNING SPACE SHALL BE 4' MINIMUM BY 5' MINIMUM, WITH THE 5' DIMENSION PROVIDED IN THE DIRECTION OF TRAVEL TOWARD THE OBSTRUCTION.
14. THE RUNNING SLOPE OF TURNING SPACES SHALL BE 2% MAXIMUM (1.5% PREFERRED). THE CROSS SLOPE OF TURNING SPACES SHALL BE 2% MAXIMUM (1.5% PREFERRED). AT PEDESTRIAN STREET CROSSINGS WITHOUT YIELD OR STOP CONTROL AND AT MIDDLEBLOCK PEDESTRIAN STREET CROSSINGS, THE CROSS SLOPE SHALL BE PERMITTED TO EQUAL THE STREET OR HIGHWAY GRADE.
15. BEYOND THE BOTTOM GRADE BREAK, A CLEAR SPACE 4' MINIMUM BY 4' MINIMUM SHALL BE PROVIDED WITHIN THE WIDTH OF THE PEDESTRIAN STREET CROSSING AND WHOLLY OUTSIDE THE PARALLEL VEHICLE TRAVEL LANE.
16. THE COUNTER SLOPE OF THE GUTTER OR STREET AT THE FOOT OF CURB RAMP RUNS, BLENDED TRANSITIONS, AND TURNING SPACES SHALL BE 5% MAXIMUM. IT IS BEST PRACTICE TO PROVIDE A 2' LEVEL STRIP AT THE GUTTER IF THE GRADE BREAK EXCEEDS 11%.

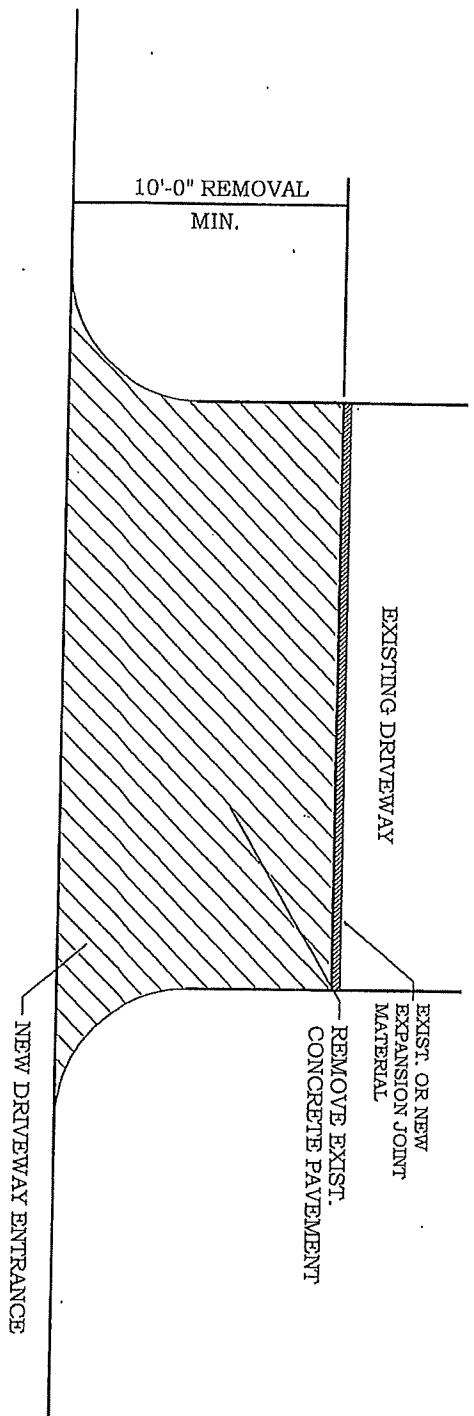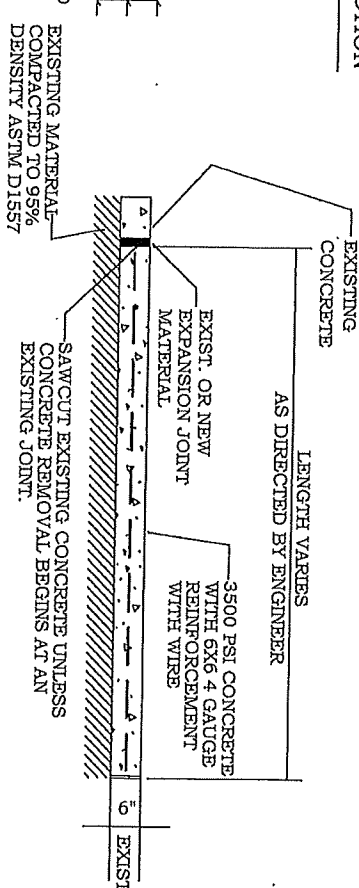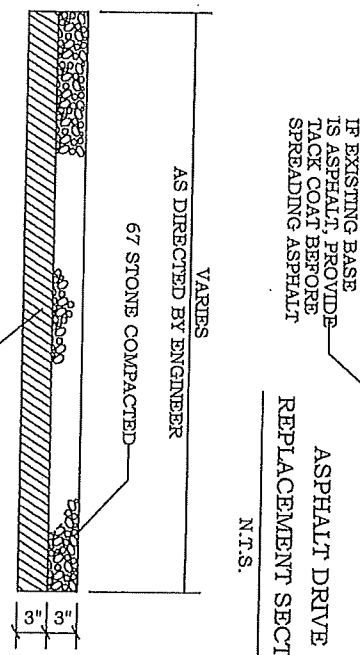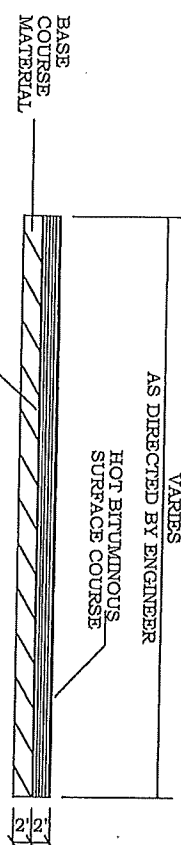

DRIVEWAY REMOVAL & REPLACEMENT DETAIL

N.T.S.

