Basic Gov (Sales Force) # PW2020-0611 File # 3387

#### AGREEMENT TO PROVIDE SECURITY FOR IMPROVEMENTS FOR TRACT MAP OR PARCEL MAP OR PLOT PLAN

(Tract Map/Parcel Map/Plot Plan No. PP2018-0134)
For Beaumont Crossroads II Sewer Lift Station

THIS AGREEMENT TO PROVIDE SECURITY FOR IMPROVEMENTS ("Security Agreement") is made by and between CITY OF BEAUMONT ("CITY") and MPLD II INLAND EMPIRE, LLC, a Delaware limited liability company ("DEVELOPER").

#### **RECITALS**

- A. DEVELOPER has applied to the CITY for permission to develop certain real property, pursuant to that certain Tract Map/Parcel Map/Plot Plan #36426 ("Map"). DEVELOPER has also asked the CITY to accept the dedication of the street or streets and other proposed public rights-of-way, parks and recreation facilities, and easements as depicted on the Map and to otherwise approve the Map so that it may be recorded as required by law; and
- B. The CITY requires, as a condition precedent to the acceptance and approval of the Map and the dedication of the public rights-of-way and easements depicted thereon, that such rights-of-way be improved with (for example) grading, paving, site walls, storm drain, sanitary sewers and appurtenances thereto, electrical and telecommunications, water pipes, water mains, fire hydrants and appurtenances thereto, and landscaping, including any warranty work for all such improvements (collectively, "Improvements"); and
- C. The Improvements have not yet been constructed and completed and it is the purpose of this Security Agreement to set forth the terms and conditions by which the DEVELOPER shall guarantee that such Improvements shall be constructed and completed within the time set forth herein.

#### **AGREEMENT**

NOW, THEREFORE, in consideration of the acceptance of the DEVELOPER's offer of dedication and the approval of the Map for filing and recording as provided and required by law, the CITY and the DEVELOPER hereby agree as follows:

- 1. <u>Provision of Improvements.</u> DEVELOPER shall provide, at the DEVELOPER's sole cost and expense, all necessary labor and materials to complete the construction of the Improvements depicted on the Map and described in the conditions of approval of the Map within one (1) year of the date of this Security Agreement.
- 2. <u>Inspection by the CITY.</u> The CITY shall inspect, at the DEVELOPER's sole cost and expense, all of the work, labor and materials performed and provided by the DEVELOPER in connection with the Improvements.
- 3. <u>Compliance with Plans and Specifications.</u> The Improvements shall be constructed and installed in strict accordance with the CITY-approved plans and specifications.

- 4. Security for Performance. Concurrently with the execution of this Security Agreement by DEVELOPER, DEVELOPER shall deliver to the CITY a performance bond issued by a corporate surety in substantially the form required by California Government Code 66499.1 and attached hereto as **Exhibit "A"**, in an amount that is not less than 100% of the total estimated cost of the Improvements and any warranty therefor. The performance bond shall be issued by an "admitted" corporate surety insurer authorized to do business in the State of California and the surety insurer shall have an A.M. Best rating of at least "A, XV". The surety insurer shall have assets exceeding its liabilities in the amount equal to or in excess of the amount of the bond, and the bond shall not be in excess of 10% of the surety insurer's assets. The security or bond shall also insure against any and all defects in the Improvements for a period of not less than one full year after the date of acceptance thereof by the CITY. The bond shall be duly executed and shall meet all the requirements of Section 995.660 of the California Code of Civil Procedure.
- 5. Security for Contractors, Subcontractors, Laborers and Materialmen. The DEVELOPER shall also provide a payment bond issued by a corporate surety for the security of laborers and materialmen, which bond or bonds shall be in substantially the form required by California Government Code Section 66499.2 attached hereto as **Exhibit "B"** and made a part hereof. The amount of the bond(s) shall be no less than 100% of the total estimated amount needed to secure payment to the contractor, to the subcontractors, and to the persons furnishing labor, materials, or equipment to them for the Improvements. The laborers and materialmen bond shall be provided by an "admitted" corporate surety insurer authorized to transact surety insurance in the State of California with an A.M. Best rating of "A, XV", and with assets exceeding its liabilities in the amount equal to or in excess of the amount of the bond, and the bond shall not be in excess of 10% of the surety insurer's assets. The bond shall be duly executed and shall meet all the requirements of Section 995.660 of the California Code of Civil Procedure.
- 6. General Liability and Worker's Compensation Insurance. The DEVELOPER shall, before commencing any work, obtain commercial general liability insurance (primary) of not less than \$2,000,000.00 per occurrence for all coverages and \$2,000,000.00 general aggregate. The CITY and its employees and agents shall be added as additional insureds. Coverage shall apply on a primary non-contributing basis in relation to any other insurance or self-insurance, primary or excess, available to the CITY or any employee or agent of the CITY. Coverage shall not be limited to the vicarious liability or supervisory role of any additional insured. Coverage shall contain no contractors' limitation endorsement. There shall be no endorsement or modification limiting the scope of coverage for liability arising from pollution, explosion, collapse, underground property damage or employment-related practices. Such insurance shall not prohibit the DEVELOPER, and its employees or agents, from waiving the right of subrogation prior to a loss. The DEVELOPER waives its right of subrogation against the CITY. Unless otherwise approved by the CITY, the DEVELOPER's insurance shall be written by insurers authorized to do business in the State of California and with a minimum A.M. Best rating of "A, XV." Self-insurance shall not be considered to comply with these insurance specifications. The DEVELOPER agrees to require all contractors, subcontractors and other parties hired for the Improvements to purchase and maintain insurance of the types specified herein, naming as additional insureds all of the parties to this Security Agreement. The DEVELOPER shall, before commencing any work, obtain Worker's Compensation Insurance in an amount required by law and, failing to do so, the CITY may procure such insurance at the cost of the DEVELOPER.

- 7. Comprehensive Commercial General and Automobile Liability Insurance. The DEVELOPER, before commencing any work shall, at its own expense, maintain comprehensive commercial general and automobile liability insurance issued by a California-admitted surety company with an A.M. Best rating of no less than "A, XV" for \$2,000,000 per occurrence. Coverage shall be for the entire duration of the permitted activities. Such liability insurance policy shall name, by endorsement, the CITY as an additional insured.
- 8. <u>Indemnification.</u> Notwithstanding the provisions of Government Code, Section 66474.9 or any other statutes of similar import, and to the full extent permitted by law, the DEVELOPER shall defend, indemnify and hold harmless the CITY, its employees, agents, officials and attorneys, from and against any liability, claims, suits, actions, arbitration proceedings, administrative proceedings, regulatory proceedings, losses, expenses or costs of any kind or nature, whether actual, alleged or threatened, reasonable attorneys' fees, court costs, interest, expert witness fees and any other costs or expenses of any kind whatsoever, without restriction or limitation, incurred in relation to, as a consequence of, or arising out of or in any way attributable actually, allegedly or impliedly, in whole or in part, to the Map, the Improvements, this Agreement, or any matter related to the same; provided, however, that the indemnification to be provided by DEVELOPER to the CITY pursuant to the terms of this paragraph shall not be applicable where the aforementioned liability, claim, suit or action is the result of the sole negligence or sole willful misconduct of the CITY.
- 9. <u>Procedure for Release of Performance Bond Security.</u> The security furnished by the DEVELOPER shall be released in whole or in part in the following manner:
  - a. Security shall be released upon final completion and acceptance of the Improvements. If the security furnished by the DEVELOPER is documentary evidence of security, such as a surety bond, the CITY shall release the documentary evidence and return the original to the Surety upon final completion and acceptance of the Improvements. In the event the CITY is unable to return the original documentary evidence to the Surety, the security shall be released by written notice sent by certified mail to the DEVELOPER and to the Surety within 30 days of the CITY's acceptance of the Improvements. The written notice shall contain a statement that the work for which security was furnished has been completed and accepted, a description of the Improvements, and the notarized signature of an authorized CITY official.
  - b. At such time as the DEVELOPER believes that the work for which the security was required is complete and makes payment of the partial exoneration fee of \$350 to the CITY, the DEVELOPER shall notify the CITY in writing of the completed work, including a list of work completed. Upon receipt of the written notice, the CITY shall have 45 days to review and comment or approve the completion of the Improvements. If the CITY does not agree that all work has been completed in accordance with the plans and specifications for the Improvements, it shall supply a list of all remaining work to be completed.
    - c. Within 45 days of receipt of the CITY's list of remaining work, the

DEVELOPER may then provide cost estimates for all remaining work for review and approval by the CITY.

- d Upon receipt of the cost estimates, the CITY shall then have 45 days to review, comment, and approve, modify or disapprove those cost estimates. The CITY shall not be required to engage in this process of partial release more than once between the start of work and the completion and acceptance of all work.
- e. The DEVELOPER shall complete the works of Improvement until all remaining items are accepted by the CITY. Upon completion of the Improvements, the DEVELOPER shall be notified in writing by the CITY within 45 days and, within 45 days of the date of the CITY's notice, the release of any remaining performance security shall be made within 60 days of the recording of the Notice of Completion.
- 10. Procedure for Release of Payment Bond Security. Security securing the payment to the contractor, his or her subcontractors and persons furnishing labor, materials or equipment may, after passage of the time within which mechanic's liens and stop notices are required to be recorded and after acceptance of the Improvements, be reduced by Surety to an amount equal to the total claimed by all claimants for whom mechanic's liens and stop notices have been recorded and notice thereof given in writing to the CITY, and if no claims have been recorded, the security may be released in full.
- Security for One-Year Warranty Period, DEVELOPER shall guarantee or warranty the work done pursuant to this Agreement for a period of one year after final formal acceptance of the SUBDIVISION by the City Council against any defective work or labor done or defective materials furnished. If within the warranty period any work or improvement or part of any work or improvement done, furnished, installed, or constructed by DEVELOER fails to fulfill any of the requirements of this Agreement or the improvement plans and specifications referred to herein, DEVELOPER shall without delay and without any cost to CITY, repair or replace or reconstruct any defective or otherwise unsatisfactory part or parts of the work or structure. Should DEVELOPER fail to act promptly or in accordance with this requirement, DEVELOPER hereby authorizes CITY, at CITY's option, to perform the work twenty (20) days after mailing written notice of default to DEVELOPER and to DEVELOPER's surety, and agrees to pay the cost of such work by CITY. Should CITY determine that an urgency requires repairs or replacements to be made before DEVELOPER can be notified, CITY may, in its sole discretion, make the necessary repairs or replacement or perform the necessary work and DEVELOPER shall pay to CITY the cost of such repairs. If no claims have been made under the warranty bond during the warranty period, CITY shall release the warranty bond. The release procedures described in paragraphs 9 and 10 above shall not apply to the required guarantee and warranty period nor to the amount of the performance bond security deemed necessary by the CITY for the guarantee and warranty period nor to costs and reasonable expenses and fees, including reasonable attorney's fees.
- 12 <u>Binding Effect.</u> This Security Agreement shall be binding upon and shall inure to the benefit of the parties hereto, their legal representatives and their successors and assigns.

- 13. <u>Authority to Execute.</u> The DEVELOPER hereby warrants and represents to the CITY that the individual signing this Security Agreement on behalf of the DEVELOPER is vested with the unconditional authority to do so pursuant to, and in accordance with, all applicable legal requirements, and has the authority bind the DEVELOPER hereto.
- 14. <u>No Assignment.</u> The DEVELOPER may not assign this Security Agreement, or any part thereof, to another without the prior written consent of the CITY.
- 15. <u>Attorneys' Fees.</u> In the event of legal action to enforce or interpret this Agreement or any of its provisions, the prevailing party shall be entitled, in addition to any other form of relief, to recover its reasonable attorneys' fees and out-of-pocket costs of suit.
- 16. <u>Execution in Counterparts.</u> This Agreement may be executed in counterparts, each of which shall be deemed an original, but which together shall constitute a single agreement.

IN WITNESS WHEREOF, the parties have caused this Agreement to be executed on the dates listed below.

<u>CITY</u> :		
CITY OF B	EAUMONT	
By: Mayor	-	
Date:		

#### **DEVELOPER:**

#### MPLD II INLAND EMPIRE, LLC,

a Delaware limited liability company

By: MPLD II REIT A,

a Texas real estate investment trust,

its sole member

Name: DAVID J. BUCK

Title: Executive Managing Director

Date: (0 - 8 - 21

Address: 9830 Colonnade Boulevard, Suite 600, San Antonio, TX 78230-2239

Basic Gov (Sales Force) #	
File#	

#### **EXHIBIT "A"**

Bond No. 107506778

#### PERFORMANCE BOND

WHEREAS, the City Council of the City of Beaumont, State of California (the "City"),
and MPLD II Inland Empire, LLC, a Delaware limited liability company ("Principal") have
entered into Agreement To Provide Security For Improvements for Tract Map or Parcel Map or
Plot Plan, dated, 2021 (the "Agreement"), whereby Principal agrees to
install and complete certain designated public improvements which is hereby incorporated herein
and made a part hereof; and

WHEREAS, Principal is required under the terms of the said Agreement to furnish a bond for the faithful performance of said Agreement.

NOW, THEREFORE, we, the Principal and Travelers Casualty and Surety Company of America ("Surety") are held and firmly bound unto the City, in the penal sum of **Two Million Nine Hundred Eighty Four Thousand Nine Hundred Twenty Three and 00/100 dollars** (\$2,984,923.00) lawful money of the United States, for the payment of which sum well and truly to be made, we bind ourselves, our heirs, successors, executors and administrators, jointly and severally, firmly by these presents.

The condition of this obligation is such that if the above bounded Principal, his or its heirs, executors, administrators, successors or assigns, shall in all things stand to and abide by, and well and truly keep and perform the covenants, conditions and provisions in the Agreement and any alteration thereof made as therein provided, on his or their part to be kept and performed at the time and in the manner therein specified, and in all respects according to their true intent and meaning, and shall indemnify and save harmless the City, its officers, agents and employees as therein stipulated, then this obligation shall become null and void; otherwise it shall be and remain in full force and effect.

As part of the obligation secured hereby and in addition to the face amount specified therefor, there shall be included costs and reasonable expenses and fees, including reasonable attorney's fees, incurred by the City in successfully enforcing such obligation, all to be taxed as costs and included in any judgment therein rendered.

The Surety hereby stipulates and agrees that no change, extension of time, alteration or addition to the terms of the agreement or to the work to be performed thereunder or the specifications accompanying the same shall in any way affect its obligations on this bond, and it does hereby waive notice of any such change, extension of time, alteration or addition to the terms of the Agreement or to the work or to the specifications.

[signatures on following page]

IN WITNESS WHEREOF, this instru	ument has been duly executed by the Principal and
Surety above named, on October 6th	
	PRINCIPAL:
	MPLD II INLAND EMPIRE, LLC, a Delaware limited liability company
	By: MPLD II REIT A, a Texas real estate investment trust.

its sole member

Address: 9330 Colonnade Boulevard, Suite 600 San Antonio, TX 78230-2239

#### **SURETY:**

Travelers Casualty and Surety Company of America, a Connecticut corporation

Name: Jeremy Polk


Title: Attorney-in-Fact

Address: 655 N Central Ave, Suite 1100, Glendale, CA 91203

ALL SIGNATURES MUST BE ACKNOWLEDGED BEFORE A NOTARY PUBLIC

#### **Acknowledgement Form**

State of Texas	)
	)ss.
County of <u>Bexar</u>	)



Notary Public


#### **ACKNOWLEDGEMENT**

State of Arizona

County of Maricopa

On 10/6/202 before me personally appeared <u>Jeremy Polk</u> whose identity was proven to me on the basis of satisfactory evidence to be the person who he or she claims to be, and acknowledged that he or she signed the attached document.

(Seal)



**Notary Signature** 

Matthew Stanton Erra Commission Expires March 9th, 2022



#### Travelers Casualty and Surety Company of America Travelers Casualty and Surety Company St. Paul Fire and Marine Insurance Company

#### **POWER OF ATTORNEY**

KNOW ALL MEN BY THESE PRESENTS: That Travelers Casualty and Surety Company of America, Travelers Casualty and Surety Company, and St. Paul Fire and Marine Insurance Company are corporations duly organized under the laws of the State of Connecticut (herein collectively called the "Companies"), and that the Companies do hereby make, constitute and appoint Jeremy Polk of PHOENIX

Arizona , their true and lawful Attorney-in-Fact to sign, execute, seal and acknowledge any and all bonds, recognizances, conditional undertakings and other writings obligatory in the nature thereof on behalf of the Companies in their business of guaranteeing the fidelity of persons, guaranteeing the performance of contracts and executing or guaranteeing bonds and undertakings required or permitted in any actions or proceedings allowed by law.

IN WITNESS WHEREOF, the Companies have caused this instrument to be signed, and their corporate seals to be hereto affixed, this 3rd day of February, 2017.







State of Connecticut

City of Hartford ss.

Robert L. Ranev. Senior Vice President

On this the **3rd** day of **February**, **2017**, before me personally appeared **Robert L. Raney**, who acknowledged himself to be the Senior Vice President of Travelers Casualty and Surety Company of America, Travelers Casualty and Surety Company, and St. Paul Fire and Marine Insurance Company, and that he, as such, being authorized so to do, executed the foregoing instrument for the purposes therein contained by signing on behalf of the corporations by himself as a duly authorized officer.

In Witness Whereof, I hereunto set my hand and official seal.

My Commission expires the 30th day of June, 2021



Marie C. Tetreault, Notary Public

This Power of Attorney is granted under and by the authority of the following resolutions adopted by the Boards of Directors of Travelers Casualty and Surety Company of America, Travelers Casualty and Surety Company, and St. Paul Fire and Marine Insurance Company, which resolutions are now in full force and effect, reading as follows:

RESOLVED, that the Chairman, the President, any Vice Chairman, any Executive Vice President, any Senior Vice President, any Vice President, any Second Vice President, the Treasurer, any Assistant Treasurer, the Corporate Secretary or any Assistant Secretary may appoint Attorneys-in-Fact and Agents to act for and on behalf of the Company and may give such appointee such authority as his or her certificate of authority may prescribe to sign with the Company's name and seal with the Company's seal bonds, recognizances, contracts of indemnity, and other writings obligatory in the nature of a bond, recognizance, or conditional undertaking, and any of said officers or the Board of Directors at any time may remove any such appointee and revoke the power given him or her; and it is

FURTHER RESOLVED, that the Chairman, the President, any Vice Chairman, any Executive Vice President, any Senior Vice President or any Vice President may delegate all or any part of the foregoing authority to one or more officers or employees of this Company, provided that each such delegation is in writing and a copy thereof is filed in the office of the Secretary; and it is

FURTHER RESOLVED, that any bond, recognizance, contract of indemnity, or writing obligatory in the nature of a bond, recognizance, or conditional undertaking shall be valid and binding upon the Company when (a) signed by the President, any Vice Chairman, any Executive Vice President, any Senior Vice President or any Vice President, any Second Vice President, the Treasurer, any Assistant Treasurer, the Corporate Secretary or any Assistant Secretary and duly attested and sealed with the Company's seal by a Secretary or Assistant Secretary; or (b) duly executed (under seal, if required) by one or more Attorneys-in-Fact and Agents pursuant to the power prescribed in his or her certificate or their certificates of authority or by one or more Company officers pursuant to a written delegation of authority; and it is

**FURTHER RESOLVED**, that the signature of each of the following officers: President, any Executive Vice President, any Senior Vice President, any Vice President, any Assistant Vice President, any Secretary, and the seal of the Company may be affixed by facsimile to any Power of Attorney or to any certificate relating thereto appointing Resident Vice Presidents, Resident Assistant Secretaries or Attorneys-in-Fact for purposes only of executing and attesting bonds and undertakings and other writings obligatory in the nature thereof, and any such Power of Attorney or certificate bearing such facsimile signature or facsimile seal shall be valid and binding upon the Company and any such power so executed and certified by such facsimile signature and facsimile seal shall be valid and binding on the Company in the future with respect to any bond or understanding to which it is attached.

I, Kevin E. Hughes, the undersigned, Assistant Secretary of Travelers Casualty and Surety Company of America, Travelers Casualty and Surety Company, and St. Paul Fire and Marine Insurance Company, do hereby certify that the above and foregoing is a true and correct copy of the Power of Attorney executed by said Companies, which remains in full force and effect.

Dated this 6th

day of October

2021







Kevin E. Hughes, Assistant Secretary

#### **EXHIBIT "B"**

Bond No. 107506778

#### PAYMENT BOND

WHEREAS, under the terms of the said Agreement, the Principal is required before entering upon the performance of the work, to file a good and sufficient payment bond with the City of Beaumont to secure the claims to which reference is made in Title 3 (commencing with Section 9000, et seq.) of Part 6 of Division 4 of the Civil Code of the State of California.

NOW, THEREFORE, the Principal and Travelers Casualty and Surety Company of America (the "Surety"), as corporate surety, are held firmly bound unto the City and all contractors, subcontractors, laborers, materialmen, and other persons employed in the performance of the Agreement and referred to Title 3 (commencing with Section 9000, et seq.) of Part 6 of Division 4 of the Civil Code of the State of California in the sum of **Two Million Nine Hundred Eighty Four Thousand Nine Hundred Twenty Three and 00/100 dollars (\$2,984,923.00)**, for materials furnished or labor of any kind, or for amounts due under the Unemployment Insurance Act with respect to this work or labor, that the Surety will pay the same in an amount not exceeding the amount hereinabove set forth, and also in case suit is brought upon this bond, will pay, in addition to the face amount thereof, costs and reasonable expenses and fees, including reasonable attorney's fees, incurred by the City in successfully enforcing this obligation, to be awarded and fixed by the court, and to be taxed as costs and to be included in any judgment therein rendered.

It is hereby expressly stipulated and agreed that this bond shall inure to the benefit of any and all persons, companies, and corporations entitled to file claims under Title 3 (commencing with Section 9000, et seq.) of Part 6 of Division 4 of the Civil Code of the State of California, so as to give a right of action to them or their assigns in any suit brought upon this bond.

Should the condition of this bond be fully performed, then this obligation shall become null and void, otherwise, it shall be and remain in full force and effect.

The surety hereby stipulates and agrees that no change, extension of time, alteration, or addition to the terms of the agreement or the specifications accompanying the same shall in any manner affect its obligations on this bond, and it does hereby waive notice of any such change, extension, alteration, or addition.

[signatures on following page]

IN WITNESS WHEREOF, this instrume Surety above named, on October 6th	nt has been duly executed by the Principal and, 2021.
	PRINCIPAL:
	MPLD II INLAND EMPIRE, LLC, a Delaware limited liability company
	By: MPLD II REIT A, a Texas real estate investment trust, its sole member
	By:
	Address: 9330 Colonnade Boulevard, Suite 600 San Antonio, TX 78230-2239
SURETY:  Travelers Casualty and Surety Company of An	nerica, a Connecticut corporation
By: Name: Jeremy Polk	

ALL SIGNATURES MUST BE ACKNOWLEDGED BEFORE A NOTARY PUBLIC


Attorney-in-Fact

Address: 655 N Central Ave, Suite 1100, Glendale, CA 91203

Title:\_\_\_

### **Acknowledgement Form**

State of Texas	)
	)ss.
County of Bexar	)



Mary Public


#### **ACKNOWLEDGEMENT**

State of Arizona

**County of Maricopa** 

On 10/6/202\ before me personally appeared Jeremy Polk whose identity was proven to me on the basis of satisfactory evidence to be the person who he or she claims to be, and acknowledged that he or she signed the attached document.

(Seal)



Notary Signature

Matthew Stanton Erra Commission Expires March 9<sup>th</sup>, 2022



Travelers Casualty and Surety Company of America Travelers Casualty and Surety Company St. Paul Fire and Marine Insurance Company

#### **POWER OF ATTORNEY**

KNOW ALL MEN BY THESE PRESENTS: That Travelers Casualty and Surety Company of America, Travelers Casualty and Surety Company, and St. Paul Fire and Marine Insurance Company are corporations duly organized under the laws of the State of Connecticut (herein collectively called the "Companies"), and that the Companies do hereby make, constitute and appoint Jeremy Polk of PHOENIX

Arizona , their true and lawful Attorney-in-Fact to sign, execute, seal and acknowledge any and all bonds, recognizances, conditional undertakings and other writings obligatory in the nature thereof on behalf of the Companies in their business of guaranteeing the fidelity of persons, guaranteeing the performance of contracts and executing or guaranteeing bonds and undertakings required or permitted in any actions or proceedings allowed by law.

IN WITNESS WHEREOF, the Companies have caused this instrument to be signed, and their corporate seals to be hereto affixed, this 3rd day of February, 2017.







State of Connecticut

City of Hartford ss.

By: Robert L. Raney. Senior Vice President

On this the **3rd** day of **February**, **2017**, before me personally appeared **Robert L. Raney**, who acknowledged himself to be the Senior Vice President of Travelers Casualty and Surety Company of America, Travelers Casualty and Surety Company, and St. Paul Fire and Marine Insurance Company, and that he, as such, being authorized so to do, executed the foregoing instrument for the purposes therein contained by signing on behalf of the corporations by himself as a duly authorized officer.

In Witness Whereof, I hereunto set my hand and official seal.

My Commission expires the 30th day of June. 2021



Marie C. Tetreault, Notary Public

This Power of Attorney is granted under and by the authority of the following resolutions adopted by the Boards of Directors of Travelers Casualty and Surety Company of America, Travelers Casualty and Surety Company, and St. Paul Fire and Marine Insurance Company, which resolutions are now in full force and effect, reading as follows:

RESOLVED, that the Chairman, the President, any Vice Chairman, any Executive Vice President, any Senior Vice President, any Vice President, any Second Vice President, the Treasurer, any Assistant Treasurer, the Corporate Secretary or any Assistant Secretary may appoint Attorneys-in-Fact and Agents to act for and on behalf of the Company and may give such appointee such authority as his or her certificate of authority may prescribe to sign with the Company's name and seal with the Company's seal bonds, recognizances, contracts of indemnity, and other writings obligatory in the nature of a bond, recognizance, or conditional undertaking, and any of said officers or the Board of Directors at any time may remove any such appointee and revoke the power given him or her; and it is

FURTHER RESOLVED, that the Chairman, the President, any Vice Chairman, any Executive Vice President, any Senior Vice President or any Vice President may delegate all or any part of the foregoing authority to one or more officers or employees of this Company, provided that each such delegation is in writing and a copy thereof is filed in the office of the Secretary; and it is

FURTHER RESOLVED, that any bond, recognizance, contract of indemnity, or writing obligatory in the nature of a bond, recognizance, or conditional undertaking shall be valid and binding upon the Company when (a) signed by the President, any Vice Chairman, any Executive Vice President, any Senior Vice President or any Vice President, any Second Vice President, the Treasurer, any Assistant Treasurer, the Corporate Secretary or any Assistant Secretary and duly attested and sealed with the Company's seal by a Secretary or Assistant Secretary; or (b) duly executed (under seal, if required) by one or more Attorneys-in-Fact and Agents pursuant to the power prescribed in his or her certificate or their certificates of authority or by one or more Company officers pursuant to a written delegation of authority; and it is

FURTHER RESOLVED, that the signature of each of the following officers: President, any Executive Vice President, any Senior Vice President, any Vice President, any Assistant Vice President, any Serior Vice President, any Serior Vice President, any Assistant Vice President, any Assistant Secretary, and the seal of the Company may be affixed by facsimile to any Power of Attorney or to any certificate relating thereto appointing Resident Vice Presidents, Resident Assistant Secretaries or Attorneys-in-Fact for purposes only of executing and attesting bonds and undertakings and other writings obligatory in the nature thereof, and any such Power of Attorney or certificate bearing such facsimile signature or facsimile seal shall be valid and binding upon the Company and any such power so executed and certified by such facsimile signature and facsimile seal shall be valid and binding on the Company in the future with respect to any bond or understanding to which it is attached.

I, Kevin E. Hughes, the undersigned, Assistant Secretary of Travelers Casualty and Surety Company of America, Travelers Casualty and Surety Company, and St. Paul Fire and Marine Insurance Company, do hereby certify that the above and foregoing is a true and correct copy of the Power of Attorney executed by said Companies, which remains in full force and effect.

Dated this 6th

day of October

2021







Kevin E. Hughes, Assistant Secretary

#### Beaumont Crossroads II Sewer Lift Station

Approved NV5 11/17/2021

### CITY OF BEAUMONT PUBLIC WORKS DEPARTMENT CONSTRUCTION COST WORKSHEET

#### **Beaumont Crossroads II Sewer Lift Station**

PARCEL MAP OR TRADATE:	ACT NO.:	I	Beaumont Crossroads	s II Sewer Lift S	Station
PP, CUP NO.:				BY:	Kimley-Horn
IMPROVEMENTS		LABOR &	UL PERFORMANCE MATERIALS SEC ated Construction Co	URITY 10	100% 00%
Streets/Drainage Sewer Total Warranty Retension (22) Street/Drainage Plan Ch Sewer Plan Check Fees Street Inspection Fees = Sewer Inspection Fees =	eck Fees =	\$ \$ \$ \$ \$ \$	2,984,923 2,984,923 671,608 500 59,698 750 89,548		
<u>I</u>	DESIGN ENGINEERS CA	LCULATION	S OF IMPROVEME	NT BONDING	COSTS
to construct the above pr	heir quantities as shown on roject and the mathematical an check and inspection cos	extensions us			required
Above amounts do	include additional 20	0% for recorda	tion prior to having s	signed plans	PROFESSIONAL
Above amounts do not	X include additional 20	0% for recorda	ation prior to having s	signed plans	No 61788 ES
Sam McWhorter		2	0-Oct-21		± Exp 6/30/23 ±
Engineer's Signature		Date			OF CALIFORNIA
Sam L. McW Name typed or printed	horter				Civil Engineer's Stamp
	COSTS REVISED 09/06				g

#### \*\*\*\*\*PLEASE READ INSTRUCTIONS BELOW\*\*\*\*\*

- 1. Quantities to be taken from improvement plans, Unit costs to be as provided on "City of Beaumont Improvement Requirement Worksheet".
- 2. Show Bond Amounts to the nearest \$500.
- 3. For construction items not covered by "City of Beaumont Improvement Worksheet", Design Engineer is to provide his opinion of construction cost and use of that cost. If City of Beaumont Unit Costs are determined to be too low in the opinion of the Design Engineer, the higher costs as provided by the Design Engineer should be used.

Page 1 of 8 10/20/2021

# CITY OF BEAUMONT PUBLIC WORKS DEPARTMENT IMPROVEMENT REQUIREMENT WORKSHEET FOR ON-SITE GRADING / IMPROVEMENTS

PROJECT: \_\_\_\_ Beaumont Crossroads II Sewer Lift Station DATE: 0-Jan-00

		STREET IMPROVEMENTS				
QTY.	UNIT	ITEM	UN	AM	OUNT	
	C.Y.	Roadway Excavation  1. Projects with a grading plan area x 0.50' (hinge point to hinge point)(262,230 sf)  2. Projects without a grading plan (road	\$	15.00	\$	-
		area and side slopes to daylight Cut (c) = 76,498 Fill (f) = 76,498				
	C.Y. (c - f)	(a.) Excavate and Fill	\$	0.40	\$	-
	C.Y. (c - f)	(b.) Excavate and Export	\$	1.10	\$	-
	C.Y. (f - c)	(c.) Import and Fill	\$	2.80	\$	-
		If balance, provide (a.) only, either cut or fill				
		If export, provide (a.) & (b.), $a = fill$ , $b = cut - fill$				
		If import, provide (a.) & (c.), a = cut, c= fill - cut				
		(Unit costs for (a.), (b.) & (c.) are 20% of actual				
		costs to assure that work will be corrected to				
		eliminate hazardous conditions.)				
	S.F.	Remove P.C.C. paving	\$	8.00	\$	-
	S.F.	Remove A.C. Pavement	\$	1.00	\$	-
	L.F.	Remove Curb and Gutter	\$	6.00	\$	-
	L.F.	Remove A.C. Dike	\$	3.00	\$	-
	S.F.	Remove Sidewalk	\$	3.00	\$	-
	L.F.	Sawcut & Remove Exist. A.C. Pavement	\$	2.00	\$	-
	S.F.	Cold Plane A.C. Pavement	\$	1.00	\$	-
	E.A.	Relocate Sewer M.H.	\$	6,000.00	\$	_
_	C.Y.	1. On-site grading	\$	5.00	\$	_
	S.F.	Remove existing driveway	\$	3.00	\$	_
	S.F.	Remove existing catch basin and appurtenances	\$	1,500.00	\$	-
_	L.F.	Curb & Gutter 12"	\$	21.00	\$	_
_	L.F.	P.C.C. 18" channel	\$	18.00	\$	_
_	L.F.	P.C.C. 54" channel	\$	40.00	\$	_
	S.F.	P.C.C. paving 5.5" over 12" compacted subgrade	\$	3.25	\$	_
	S.F.	P.C.C. paving 7" over 12" compacted subgrade	\$	4.00	\$	_
_	S.F.	Parkway drain per std. dwg 308	\$	25.00	\$	_
_	L.F.	P.C.C. Curb 4"	\$	6.00	\$	_
	L.F.	P.C.C. curb 12"	\$	14.00	\$	_

SUBTOTAL = \$ -

PROJECT: Beaumont Crossroads II Sewer Lift Station DATE: 0-Jan-00

QTY.	UNIT	ITEM	I IN	NIT COST	A 1. //	OUNT
QII.						OUNI
	L.F.	Remove Chain Link Fence	\$	2.50	\$	
	EA.	Remove Barricade	\$	200.00	\$	
	TON	Asphalt Concrete - 144 lbs/cu. Ft. (On-Site SF @ AC thickness Ft.)	\$	90.00	\$	
	C.Y.	Aggregate Base Class II (OnSite SF @ AB thickness Ft.)	\$	50.00	\$	
	C.1.	Asphalt Emulsion (Fog Seal/Paint Binder)	Φ	30.00	Þ	
	TON	(1 ton = 240 gals) (OnSite SF)	\$	600.00	\$	
		apply at 0.05 + 0.03 = 0.08 gal/SY AC overlay (min. 0.10)				
	S.F	If export, provide (a) & (b), a=fill, b=cut-fill				
		If import, provide (a) & (b), a=nn, b=cut-nn If import, provide (a) & (C), a=cut, c=fill-cut				
		(Unit costs for (a), (b) & (C) are 20% of				
		actual costs to assure that work will be				
		corrected to eliminate hazardous conditions.)	\$	1.00	\$	
	L.F.	Curb and Gutter (Wedge Curb)	\$	8.00	\$	
	L.F.	Curb and Gutter (Type A-6)	\$	10.00	\$	
	L.F.	Curb and Gutter (Type A-8)	\$	12.00	\$	
	L.F.	Type "C" Curb	\$	10.00	\$	
	L.F.	Type "D" Curb	\$	15.00	\$	
	L.F.	A.C. Dike (6") (incl. material & labor)	\$	8.00	\$	
	L.F.	A.C. Dike (8") (incl. Material & labor)	\$	10.00	\$	
	S.F.	P.C.C. Cross Gutter and Spandrels	\$	10.00	\$	
	S.F.	P.C.C. Sidewalk	\$	6.00	\$	
	S.F.	P.C.C. Drive Approach	\$	8.00	\$	
	EA.	Handicapped Access Ramp	\$	1,500.00	\$	
	S.F.	P.C.C. Drive Approach (individual lot driveway approach per finished grading plan)	\$	8.00	\$	
	S.F.	Cold Plane & Overlay Exist. A.C. Paving	\$	4.00	\$	
	L.F.	Redwood Header	\$	3.00	\$	
					\$	
					\$	

SUBTOTAL = \$ -

Page 3 of 8 10/20/2021

PROJECT: Beaumont Crossroads II Sewer Lift Station DATE: 0-Jan-00

		STREET IMPROVEMENTS (Cont'd.)	1			
QTY.	UNIT	ITEM	U	NIT COST	AMo	DUNT
	EA.	Street Name Sign	\$	275.00	\$	-
	EA.	Delineators-per Caltrans Std. A73C, Class 1, Type F	\$	45.00	\$	
	EA.	Object Markers - Modified Type F	φ	43.00	Ψ	
	EA.	Delineators, Riverside County	\$	60.00	\$	-
	L.F.	Barricades	\$	28.00	\$	-
	L.F.	Utility Trench, one side (Edison, Telephone, Cable) (Total length of streets)	\$	10.00	\$	-
	L.F.	Chain Link Fence (6')	\$	12.00	\$	-
	L.F.	Remove Fence	\$	4.00	\$	-
	EA.	Relocate Power Pole	\$	10,000.00	\$	-
	EA.	Street Lights (including conduit)	\$	5,000.00	\$	-
	EA.	Street Trees (15 gallon)	\$	150.00	\$	-
	L.S.	Landscape and Irrigation	\$	-	\$	-
	EA.	Concrete Bulkhead	\$	200.00	\$	-
	C.Y.	Structural Reinforced Concrete	\$	400.00	\$	-
	EA.	Slope Anchors for Pipes	\$	300.00	\$	-
	L.F.	Cut Off Wall (Std. 2')	\$	5.50	\$	-
	EA.	A.C. Overside Drain	\$	500.00	\$	-
	EA.	Under Sidewalk Drain Std. 309	\$	2,000.00	\$	-
	EA.	Flat Outlet Drainage Structure Std. 303	\$	500.00	\$	-
	EA.	Curb Outlet Drainage Structure Std. 308	\$	500.00	\$	-
	S.F.	Terrace Drains and Down Drains	\$	6.50	\$	-
	S.F.	Interceptor Drains	\$	6.50	\$	-
	EA.	Pavement Marking	\$	200.00	\$	-
	L.F.	Limit Line	\$	2.00	\$	
	EA.	R1 "STOP SIGN"	\$	250.00	\$	
	EA.	W53 "NOT A THROUGH STREET"	\$	250.00	\$	-
					\$	
					\$	-

SUBTOTAL = \$ -

Page 4 of 8 10/20/2021

PROJECT: Beaumont Crossroads II Sewer Lift Station DATE: 0-Jan-00

		STREET IMPROVEMENTS (Cont'd.)				
QTY.	UNIT	ITEM	Uì	NIT COST	AMO	DUNT
	C.Y.	12 inch non-grouted rip rap, 24 inch thick	\$	40.00	\$	-
	C.Y.	Rip Rap (1/2 Ton) Method B	\$	45.00	\$	-
	C.Y.	Rip Rap (1 Ton) Method B	\$	50.00	\$	-
	C.Y.	Rip Rap (2 Ton) Method B	\$	55.00	\$	-
	C.Y.	Grouted Rip Rap (1/4 Ton) Method B	\$	60.00	\$	-
	C.Y.	Grouted Rip Rap (1/2 Ton) Method B	\$	67.00	\$	-
	C.Y.	Grouted Rip Rap (1Ton) Method B	\$	75.00	\$	-
	C.Y.	Grouted Rip Rap (2 Ton) Method B	\$	80.00	\$	-
	L.F.	18" R.C.P.	\$	50.00	\$	-
	L.F.	24" R.C.P.	\$	60.00	\$	=
	L.F.	30" R.C.P.	\$	80.00	\$	-
	L.F.	36" R.C.P.	\$	90.00	\$	-
	L.F.	42" R.C.P.	\$	100.00	\$	-
	L.F.	48 " RCP	\$	110.00	\$	-
	L.F.	54" RCP	\$	135.00	\$	-
	L.F.	60" RCP	\$	160.00	\$	-
	L.F.	72" RCP	\$	200.00	\$	-
	L.F.	12 inch H.D.P.E. N-12	\$	36.00	\$	-
	L.F.	18 inch H.D.P.E. N-12	\$	50.00	\$	-
	L.F.	24 inch H.D.P.E. N-12	\$	60.00	\$	-
	L.F.	30 inch H.D.P.E. N-12	\$	75.00	\$	-
	L.F.	42 inch H.D.P.E. N-12	\$	100.00	\$	-
	L.F.	36 inch H.D.P.E. N-12	\$	90.00	\$	-
	L.F.	48 inch H.D.P.E. N-12	\$	120.00	\$	-
	EA.	H.D.P.E. Clean Out	\$	400.00	\$	=
	EA.	18" C.M.P. Wye	\$	500.00	\$	-
	EA.	Riprap Headwall	\$	1,000.00	\$	-
	EA.	Concrete collar per S.P.P.W.C. standard 380-4, L & T	\$	1,000.00	\$	-
	EA.	Outlet Structure	\$	10,000.00	\$	-
	EA.	C.M.P. riser	\$	1,000.00	\$	-
	EA.	Pre fabricated N-12 tee	\$	300.00	\$	=
	L.F.	12 inch concrete thickened edge	\$	7.50	\$	-

SUBTOTAL = \$ -

PROJECT: Beaumont Crossroads II Sewer Lift Station DATE: 0-Jan-00

		STREET IMPROVEMENTS (Cont'd.)			
QTY.	UNIT	ITEM	UNIT COST	AM	OUNT
	L.F.	60" C.S.P.	\$ 115.00	\$	-
	EA.	Catch Basin W = 4'	\$ 1,700.00	\$	-
	EA.	Catch Basin W = 7'	\$ 3,000.00	\$	-
	EA.	Catch Basin W = 10'	\$ 4,000.00	\$	-
	EA.	Catch Basin W = 14'	\$ 5,500.00	\$	-
	EA.	Catch Basin W = 28'	\$ 9,500.00	\$	-
	EA.	Catch Basin - Standard 301-2.	\$ 2,500.00	\$	-
	EA.	Grate Inlet Skimmer box - 24*24	\$ 500.00	\$	-
	EA.	Junction Structure No. 1	\$ 3,000.00	\$	-
	EA.	Junction Structure No. 2	\$ 2,500.00	\$	-
	EA.	Manhole No. 1	\$ 2,700.00	\$	-
	EA.	Manhole No. 2	\$ 3,300.00	\$	-
	EA.	Manhole No. 3	\$ 2,700.00	\$	-
	EA.	Manhole per S.P.P.W.C. standard 322-2	\$ 5,000.00	\$	-
	E.A.	Manhole per S.P.P.W.C. standard 320-2	\$ 4,500.00	\$	-
	E.A.	Manhole per S.P.P.W.C. standard 321-2	\$ 3,500.00	\$	-
	EA.	Adjust Water Valve (if no water plan)	\$ 150.00	\$	-
	EA.	Adjust MH to grade (if no sewer plan)	\$ 400.00	\$	-
	EA.	Concrete Headwall	\$ 865.00	\$	-
	EA.	Grating catch basin per S.P.P.W.C. standard 305-3			
	LA.	w/ 'Kristar FloGard Plus Catch Basin Insert Filter'	\$ 2,160.00	\$	-
	EA.	Remove & Dispose of RCB Headwall & Wingwall	\$ 10,000.00	\$	=
	L.F.	Concrete Bulkhead	\$ 25.00	\$	-
	EA.	Outlet Structure (Line A & B)	\$ 5,000.00	\$	-
	EA.	Remove Existing Headwall	\$ 1,000.00	\$	-
	EA.	Local Depression per RCTD Std 311 Case E	\$ 1,200.00	\$	-
	EA.	Local Depression per RCTD Std 311 Case B	\$ 1,500.00	\$	=
	L.F.	8 inch thick concrete channel	\$ 10.00	\$	-
	LF	5 feet deep, 6 inch thick concrete cut off wall	\$ 100.00	\$	-
	LF	3 feet deep, 6 inch thick concrete cut off wall	\$ 60.00	\$	-

SUBTOTAL = \$ -

Page 6 of 8 10/20/2021

PROJECT	:	Beaumont Crossroads II Sewer Lift Station		DATE:	0-Ja	n-00
		STREET IMPROVEMENTS (Cont'd	.)			
QTY.	Y. UNIT ITEM		U	UNIT COST		UNT
	EA.	Water Quality Structure	\$	2,500.00	\$	-
	LS	Concrete Inlet Apron	\$	11,000.00	\$	-
	LS	Emergency Spillway	\$	27,000.00	\$	-
	LS	84" Storm Drain Grate	\$	8,500.00	\$	-
	SF	3' Wide V-Gutter	\$	4.00	\$	-
	LS	Signal & Lighting	\$	100,000.00	\$	-
	EA.	Concrete Pipe Anchor	\$	500.00	\$	-
	SF	5' Wide Concrete V-Gutter	\$	12.00	\$	-
					\$	-
					\$	-
			Subt	otal:	\$	-
A.	Subtotal				\$	
В.	Continge	ency (15%)			\$	
C.	Streets/D	rainage Total (A + B)			\$	_

PC Fee \$0.00 50% of Table A Table A - 2% of cost

Page 7 of 8 10/20/2021

PROJECT:	Beaumont Crossroads II Sewer Lift Station	DATE: 0-Jan-00
PROJECT:	Beaumont Crossroads II Sewer Lift Station	DATE: 0-Jan-00

#### SEWER IMPROVEMENTS

Show quantities on this sheet only if project has a sewer plan. If no water plan, then show applicable

quantities as part of street improvements.

21	quantities as part of street improvements.						
21   L.F.   6" Force Main   \$ 622.00   \$ 13,1     1   EA.   60" Manhole   \$ 62,700.00   \$ 62,       35   L.F.   15" Sewer Main   \$ 511.00   \$ 17,       20   L.F.   16" Sewer Main   \$ 996.00   \$ 19,       1   L.S.   Wet Well   \$ 457,000.00   \$ 457,       14   EA.   Core/Saweut   \$ 574.00   \$ 8,       2   EA.   Pumps   \$ 150,000.00   \$ 300,       1   L.S.   Mechanical Piping   \$ 153,000.00   \$ 300,       2   EA.   Pumps   \$ 150,000.00   \$ 153,       36   L.F.   Chemical Feed Line   \$ 308.00   \$ 11,       2   EA.   Sewage Backflush   \$ 3,350.00   \$ 6,       60   L.F.   6" Vent Pipe   \$ 218.00   \$ 13,       60   L.F.   2" Water Service   \$ 332.00   \$ 19,       1   L.S.   4" PVC Storm Drain, Grates and other Appurtenances   \$ 23,000.00   \$ 23,       1   EA.   Eye Wash Station   \$ 8,060.00   \$ 8,       1   EA.   Air Vac   \$ 26,000.00   \$ 26,       2   EA.   Hose Bibbs   \$ 2,080.00   \$ 26,       8   EA.   Raise Utilities   \$ 1,350.00   \$ 10,       1,250   C.Y.   Earthwork   \$ 449.92   \$ 62,       5,290   S.F.   Aggregate Base and A.C. Paving   \$ 10.65   \$ 56,       584   L.F.   Site Walls   \$ 301.00   \$ 175,       515   S.F.   Concrete Pads   \$ 2,340.00   \$ 42,       7   EA.   Install Bollard   \$ 2,340.00   \$ 16,       100   L.F.   Fences and Gates   \$ 199.16   \$ 19,       11   L.S.   Building Roof and Awning   \$ 68,900.00   \$ 42,       1   L.S.   Building Roof and Awning   \$ 68,900.00   \$ 42,       1   L.S.   Building Roof and Awning   \$ 68,900.00   \$ 42,       1   L.S.   Electrical   \$ 740,000.00   \$ 740,       1   EA.   Generator   \$ 115,000.00   \$ 115,       1   EA.   EA.	QTY.	UNIT	ITEM	U	NIT COST	A	MOUNT
1         EA.         60" Manhole         \$ 62,700.00         \$ 62,           35         L.F.         15" Sewer Main         \$ 511.00         \$ 17,           20         L.F.         16" Sewer Main         \$ 996.00         \$ 19,           1         L.S.         Wet Well         \$ 457,000.00         \$ 457,           14         EA.         Core/Sawcut         \$ 574.00         \$ 8,           2         EA.         Pumps         \$ 150,000.00         \$ 300,           1         L.S.         Mechanical Piping         \$ 153,000.00         \$ 303,00           3         L.F.         Chemical Feed Line         \$ 3350.00         \$ 11,           2         EA.         Sewage Backflush         \$ 3,350.00         \$ 6,           60         L.F.         6" Vent Pipe         \$ 218.00         \$ 13,           60         L.F.         2" Water Service         \$ 332.00         \$ 19,           1         L.S.         4" PVC Storm Drain, Grates and other Appurtenances         \$ 23,000.00         \$ 23,           1         EA.         Eye Wash Station         \$ 8,060.00         \$ 8,           1         EA.         Hose Bibbs         \$ 2,080.00         \$ 26,           2	10	LF	Demo Existing 12" PVC Gravity Sewer main	\$	200.00	\$	2,000
35   L.F.   15" Sewer Main   \$   511.00   \$   17.	21	L.F.	6" Force Main	\$	622.00	\$	13,062
20   L.F.   16" Sewer Main   S   996.00   S   19.9	1	EA.	60" Manhole	\$	62,700.00	\$	62,700
1         L.S.         Wet Well         \$ 457,000.00         \$ 457,1           14         EA.         Core/Sawcut         \$ 574.00         \$ 8,1           2         EA.         Pumps         \$ 150,000.00         \$ 300,0           1         L.S.         Mechanical Piping         \$ 153,000.00         \$ 153,1           36         L.F.         Chemical Feed Line         \$ 308.00         \$ 11,1           2         EA.         Sewage Backflush         \$ 3,350.00         \$ 6,6           60         L.F.         G' Vent Pipe         \$ 218.00         \$ 13,4           60         L.F.         2" Water Service         \$ 332.00         \$ 19,9           1         L.S.         4" PVC Storm Drain, Grates and other Appurtenances         \$ 23,000.00         \$ 23,000.00           1         EA.         Eye Wash Station         \$ 8,660.00         \$ 8,1           1         EA.         Air Vac         \$ 26,000.00         \$ 26,1           2         EA.         Hose Bibbs         \$ 2,080.00         \$ 4.           8         EA.         Raise Utilities         \$ 1,350.00         \$ 10,1           1,250         C.Y.         Earthwork         \$ 49.92         \$ 62,2	35	L.F.	15" Sewer Main	\$	511.00	\$	17,885
14         EA.         Core/Sawcut         \$ 574.00         \$ 8,8           2         EA.         Pumps         \$ 150,000.00         \$ 300,0           1         L.S.         Mechanical Piping         \$ 153,000.00         \$ 153,000.00         \$ 153,000.00         \$ 113,0           36         L.F.         Chemical Feed Line         \$ 308.00         \$ 11,0         \$ 2         EA.         Sewage Backflush         \$ 3,350.00         \$ 6,0         \$ 6,0         \$ 218.00         \$ 13,1         \$ 60         L.F.         6" Vent Pipe         \$ 218.00         \$ 13,1         \$ 60         L.F.         2" Water Service         \$ 332.00         \$ 19,1         \$ 12,20<	20	L.F.	16" Sewer Main	\$	996.00	\$	19,920
2         EA.         Pumps         \$ 150,000.00         \$ 300,00           1         L.S.         Mechanical Piping         \$ 153,000.00         \$ 153,000.00         \$ 153,000.00         \$ 115,000	1	L.S.	Wet Well	\$	457,000.00	\$	457,000
1         L.S.         Mechanical Piping         \$ 153,000.00         \$ 153,           36         L.F.         Chemical Feed Line         \$ 308.00         \$ 11,           2         EA.         Sewage Backflush         \$ 3,350.00         \$ 6,           60         L.F.         6" Vent Pipe         \$ 218.00         \$ 13,           60         L.F.         2" Water Service         \$ 332.00         \$ 19,           1         L.S.         4" PVC Storm Drain, Grates and other Appurtenances         \$ 23,000.00         \$ 23,           1         EA.         Eye Wash Station         \$ 8,060.00         \$ 8,           1         EA.         Air Vac         \$ 26,000.00         \$ 26,           2         EA.         Hose Bibbs         \$ 2,080.00         \$ 4,           8         EA.         Raise Utilities         \$ 1,350.00         \$ 10,           1,250         C.Y.         Earthwork         \$ 49.92         \$ 62,           5,290         S.F.         Aggregate Base and A.C. Paving         \$ 10.65         \$ 56,           584         L.F.         Site Walls         \$ 301.00         \$ 175,           515         S.F.         Concrete Pads         \$ 82.00         \$ 42,	14	EA.	Core/Sawcut	\$	574.00	\$	8,036
36         L.F.         Chemical Feed Line         \$ 308.00         \$ 11,4           2         EA.         Sewage Backflush         \$ 3,350.00         \$ 6,6           60         L.F.         6" Vent Pipe         \$ 218.00         \$ 13,4           60         L.F.         2" Water Service         \$ 332.00         \$ 19,4           1         L.S.         4" PVC Storm Drain, Grates and other Appurtenances         \$ 23,000.00         \$ 23,4           1         EA.         Eye Wash Station         \$ 8,060.00         \$ 8,4           1         EA.         Air Vac         \$ 26,000.00<	2	EA.	Pumps	\$	150,000.00	\$	300,000
2         EA.         Sewage Backflush         \$ 3,350.00         \$ 6,6           60         L.F.         6" Vent Pipe         \$ 218.00         \$ 13,1           60         L.F.         2" Water Service         \$ 332.00         \$ 19,1           1         L.S.         4" PVC Storm Drain, Grates and other Appurtenances         \$ 23,000.00         \$ 23,1           1         EA.         Eye Wash Station         \$ 8,060.00         \$ 8,1           1         EA.         Air Vac         \$ 26,000.00         \$ 26,0           2         EA.         Hose Bibbs         \$ 2,080.00         \$ 4,           8         EA.         Raise Utilities         \$ 1,350.00         \$ 10,           1,250         C.Y.         Earthwork         \$ 49.92         \$ 62,           5,290         S.F.         Aggregate Base and A.C. Paving         \$ 10.65         \$ 56,           584         L.F.         Site Walls         \$ 301.00         \$ 175,           515         S.F.         Concrete Pads         \$ 82.00         \$ 42,           7         EA.         Install Bollard         \$ 2,340.00         \$ 16,           100         L.F.         Fences and Gates         \$ 199.16         \$ 19,	1	L.S.	Mechanical Piping	\$	153,000.00	\$	153,000
60         L.F.         6" Vent Pipe         \$ 218.00         \$ 13,           60         L.F.         2" Water Service         \$ 332.00         \$ 19,           1         L.S.         4" PVC Storm Drain, Grates and other Appurtenances         \$ 23,000.00         \$ 23,           1         EA.         Eye Wash Station         \$ 8,060.00         \$ 8,           1         EA.         Air Vac         \$ 26,000.00         \$ 26,           2         EA.         Hose Bibbs         \$ 2,080.00         \$ 4,           8         EA.         Raise Utilities         \$ 1,350.00         \$ 10,           1,250         C.Y.         Earthwork         \$ 49.92         \$ 62,           5,290         S.F.         Aggregate Base and A.C. Paving         \$ 10.65         \$ 56,           584         L.F.         Site Walls         \$ 301.00         \$ 175,           515         S.F.         Concrete Pads         \$ 82.00         \$ 42,           7         EA.         Install Bollard         \$ 2,340.00         \$ 16,           100         L.F.         Fences and Gates         \$ 199.16         \$ 19,           115         L.F.         Masonry and Foundation         \$ 391.00         \$ 44,	36	L.F.	Chemical Feed Line	\$	308.00	\$	11,088
60         L.F.         2" Water Service         \$ 332.00         \$ 199           1         L.S.         4" PVC Storm Drain, Grates and other Appurtenances         \$ 23,000.00         \$ 23,4           1         E.A.         Eye Wash Station         \$ 8,060.00         \$ 8,4           1         E.A.         Air Vac         \$ 26,000.00         \$ 26,0           2         E.A.         Hose Bibbs         \$ 2,080.00         \$ 4,           8         E.A.         Raise Utilities         \$ 1,350.00         \$ 10,1           1,250         C.Y.         Earthwork         \$ 49.92         \$ 62,5           5,290         S.F.         Aggregate Base and A.C. Paving         \$ 10.65         \$ 56,5           584         L.F.         Site Walls         \$ 301.00         \$ 175,5           515         S.F.         Concrete Pads         \$ 82.00         \$ 42,4           7         E.A.         Install Bollard         \$ 2,340.00         \$ 16,6           100         L.F.         Fences and Gates         \$ 199.16         \$ 19,9           115         L.F.         Masonry and Foundation         \$ 391.00         \$ 44,4           1         L.S.         Building Roof and Awning         \$ 68,900.00	2	EA.	Sewage Backflush	\$	3,350.00	\$	6,700
1         L.S.         4" PVC Storm Drain, Grates and other Appurtenances         \$ 23,000.00         \$ 23,           1         EA.         Eye Wash Station         \$ 8,060.00         \$ 8,           1         EA.         Air Vac         \$ 26,000.00         \$ 26,           2         EA.         Hose Bibbs         \$ 2,080.00         \$ 4,           8         EA.         Raise Utilities         \$ 1,350.00         \$ 10,           1,250         C.Y.         Earthwork         \$ 49.92         \$ 62,           5,290         S.F.         Aggregate Base and A.C. Paving         \$ 10.65         \$ 56,           584         L.F.         Site Walls         \$ 301.00         \$ 175,           515         S.F.         Concrete Pads         \$ 82.00         \$ 42,           7         EA.         Install Bollard         \$ 2,340.00         \$ 16,           100         L.F.         Fences and Gates         \$ 199.16         \$ 19,           115         L.F.         Masonry and Foundation         \$ 391.00         \$ 44,           1         L.S.         Building Roof and Awning         \$ 68,900.00         \$ 68,           1         L.S.         Doors         \$ 16,000.00         \$ 16, <td>60</td> <td>L.F.</td> <td>6" Vent Pipe</td> <td>\$</td> <td>218.00</td> <td>\$</td> <td>13,080</td>	60	L.F.	6" Vent Pipe	\$	218.00	\$	13,080
1       EA.       Eye Wash Station       \$ 8,060.00       \$ 8,         1       EA.       Air Vac       \$ 26,000.00       \$ 26,         2       EA.       Hose Bibbs       \$ 2,080.00       \$ 4,         8       EA.       Raise Utilities       \$ 1,350.00       \$ 10,         1,250       C.Y.       Earthwork       \$ 49.92       \$ 62,         5,290       S.F.       Aggregate Base and A.C. Paving       \$ 10.65       \$ 56,         584       L.F.       Site Walls       \$ 301.00       \$ 175,         515       S.F.       Concrete Pads       \$ 82.00       \$ 42,         7       EA.       Install Bollard       \$ 2,340.00       \$ 16,         100       L.F.       Fences and Gates       \$ 199.16       \$ 19,         115       L.F.       Masonry and Foundation       \$ 391.00       \$ 44,         1       L.S.       Building Slab       \$ 28,500.00       \$ 28,         1       L.S.       Building Roof and Awning       \$ 68,900.00       \$ 68,         1       L.S.       HVAC       \$ 42,000.00       \$ 740,         1       L.S.       Electrical       \$ 740,000.00       \$ 740,         1	60	L.F.	2" Water Service	\$	332.00	\$	19,920
1         EA.         Air Vac         \$ 26,000.00         \$ 26,1           2         EA.         Hose Bibbs         \$ 2,080.00         \$ 4,           8         EA.         Raise Utilities         \$ 1,350.00         \$ 10,1           1,250         C.Y.         Earthwork         \$ 49.92         \$ 62,5           5,290         S.F.         Aggregate Base and A.C. Paving         \$ 10.65         \$ 56,5           584         L.F.         Site Walls         \$ 301.00         \$ 175,5           515         S.F.         Concrete Pads         \$ 82.00         \$ 42,2           7         EA.         Install Bollard         \$ 2,340.00         \$ 16,6           100         L.F.         Fences and Gates         \$ 199.16         \$ 19,1           115         L.F.         Masonry and Foundation         \$ 391.00         \$ 44,1           1         L.S.         Building Slab         \$ 28,500.00         \$ 28,1           1         L.S.         Building Roof and Awning         \$ 68,900.00         \$ 68,1           1         L.S.         Doors         \$ 16,000.00         \$ 16,1           1         L.S.         Electrical         \$ 740,000.00         \$ 740,000.00	1	L.S.	4" PVC Storm Drain, Grates and other Appurtenances	\$	23,000.00	\$	23,000
2       EA.       Hose Bibbs       \$ 2,080.00       \$ 4,         8       EA.       Raise Utilities       \$ 1,350.00       \$ 10,3         1,250       C.Y.       Earthwork       \$ 49.92       \$ 62,         5,290       S.F.       Aggregate Base and A.C. Paving       \$ 10.65       \$ 56,         584       L.F.       Site Walls       \$ 301.00       \$ 175,         515       S.F.       Concrete Pads       \$ 82.00       \$ 42,         7       EA.       Install Bollard       \$ 2,340.00       \$ 16,         100       L.F.       Fences and Gates       \$ 199.16       \$ 19,         115       L.F.       Masonry and Foundation       \$ 391.00       \$ 44,         1       L.S.       Building Slab       \$ 28,500.00       \$ 28,         1       L.S.       Building Roof and Awning       \$ 68,900.00       \$ 68,9         1       L.S.       HVAC       \$ 42,000.00       \$ 740,000.00         1       L.S.       Electrical       \$ 740,000.00       \$ 740,000.00         1       E.A.       Generator       \$ 115,000.00       \$ 115,000.00	1	EA.	Eye Wash Station	\$	8,060.00	\$	8,060
8         EA.         Raise Utilities         \$ 1,350.00         \$ 10,1           1,250         C.Y.         Earthwork         \$ 49.92         \$ 62,1           5,290         S.F.         Aggregate Base and A.C. Paving         \$ 10.65         \$ 56,1           584         L.F.         Site Walls         \$ 301.00         \$ 175,7           515         S.F.         Concrete Pads         \$ 82.00         \$ 42,2           7         EA.         Install Bollard         \$ 2,340.00         \$ 16,1           100         L.F.         Fences and Gates         \$ 199.16         \$ 19,1           115         L.F.         Masonry and Foundation         \$ 391.00         \$ 44,4           1         L.S.         Building Slab         \$ 28,500.00         \$ 28,1           1         L.S.         Building Roof and Awning         \$ 68,900.00         \$ 68,9           1         L.S.         HVAC         \$ 42,000.00         \$ 740,0           1         L.S.         Electrical         \$ 740,000.00         \$ 740,0           1         EA.         Generator         \$ 115,000.00         \$ 115,0	1	EA.	Air Vac	\$	26,000.00	\$	26,000
1,250       C.Y.       Earthwork       \$ 49.92       \$ 62,         5,290       S.F.       Aggregate Base and A.C. Paving       \$ 10.65       \$ 56,         584       L.F.       Site Walls       \$ 301.00       \$ 175,         515       S.F.       Concrete Pads       \$ 82.00       \$ 42,         7       EA.       Install Bollard       \$ 2,340.00       \$ 16,         100       L.F.       Fences and Gates       \$ 199.16       \$ 19,         115       L.F.       Masonry and Foundation       \$ 391.00       \$ 44,         1       L.S.       Building Slab       \$ 28,500.00       \$ 28,         1       L.S.       Building Roof and Awning       \$ 68,900.00       \$ 68,9         1       L.S.       Doors       \$ 16,000.00       \$ 16,1         1       L.S.       HVAC       \$ 42,000.00       \$ 740,000.00         1       EA.       Generator       \$ 115,000.00       \$ 115,000.00	2	EA.	Hose Bibbs	\$	2,080.00	\$	4,160
5,290         S.F.         Aggregate Base and A.C. Paving         \$ 10.65         \$ 56,           584         L.F.         Site Walls         \$ 301.00         \$ 175,           515         S.F.         Concrete Pads         \$ 82.00         \$ 42,           7         EA.         Install Bollard         \$ 2,340.00         \$ 16,           100         L.F.         Fences and Gates         \$ 199.16         \$ 19,           115         L.F.         Masonry and Foundation         \$ 391.00         \$ 44,           1         L.S.         Building Slab         \$ 28,500.00         \$ 28,           1         L.S.         Building Roof and Awning         \$ 68,900.00         \$ 68,           1         L.S.         HVAC         \$ 42,000.00         \$ 740,000.00           1         L.S.         Electrical         \$ 740,000.00         \$ 740,000.00           1         EA.         Generator         \$ 115,000.00         \$ 115,000.00	8	EA.	Raise Utilities	\$	1,350.00	\$	10,800
584         L.F.         Site Walls         \$ 301.00         \$ 175,           515         S.F.         Concrete Pads         \$ 82.00         \$ 42,           7         EA.         Install Bollard         \$ 2,340.00         \$ 16,           100         L.F.         Fences and Gates         \$ 199.16         \$ 19,           115         L.F.         Masonry and Foundation         \$ 391.00         \$ 44,           1         L.S.         Building Slab         \$ 28,500.00         \$ 28,           1         L.S.         Building Roof and Awning         \$ 68,900.00         \$ 68,9           1         L.S.         Doors         \$ 16,000.00         \$ 16,           1         L.S.         HVAC         \$ 42,000.00         \$ 42,           1         L.S.         Electrical         \$ 740,000.00         \$ 740,           1         EA.         Generator         \$ 115,000.00         \$ 115,	1,250	C.Y.	Earthwork	\$	49.92	\$	62,400
515         S.F.         Concrete Pads         \$ 82.00         \$ 42,7           7         EA.         Install Bollard         \$ 2,340.00         \$ 16,5           100         L.F.         Fences and Gates         \$ 199.16         \$ 19,0           115         L.F.         Masonry and Foundation         \$ 391.00         \$ 44,0           1         L.S.         Building Slab         \$ 28,500.00         \$ 28,5           1         L.S.         Building Roof and Awning         \$ 68,900.00         \$ 68,9           1         L.S.         Doors         \$ 16,000.00         \$ 16,0           1         L.S.         HVAC         \$ 42,000.00         \$ 42,0           1         L.S.         Electrical         \$ 740,000.00         \$ 740,0           1         EA.         Generator         \$ 115,000.00         \$ 115,0	5,290	S.F.	Aggregate Base and A.C. Paving	\$	10.65	\$	56,343
7       EA.       Install Bollard       \$ 2,340.00       \$ 16,5         100       L.F.       Fences and Gates       \$ 199.16       \$ 199.16         115       L.F.       Masonry and Foundation       \$ 391.00       \$ 44,9         1       L.S.       Building Slab       \$ 28,500.00       \$ 28,5         1       L.S.       Building Roof and Awning       \$ 68,900.00       \$ 68,9         1       L.S.       Doors       \$ 16,000.00       \$ 16,000.00         1       L.S.       HVAC       \$ 42,000.00       \$ 42,000.00         1       L.S.       Electrical       \$ 740,000.00       \$ 740,000.00         1       EA.       Generator       \$ 115,000.00       \$ 115,000.00	584	L.F.	Site Walls	\$	301.00	\$	175,784
100       L.F.       Fences and Gates       \$ 199.16       \$ 199.16         115       L.F.       Masonry and Foundation       \$ 391.00       \$ 44,9         1       L.S.       Building Slab       \$ 28,500.00       \$ 28,5         1       L.S.       Building Roof and Awning       \$ 68,900.00       \$ 68,9         1       L.S.       Doors       \$ 16,000.00       \$ 16,0         1       L.S.       HVAC       \$ 42,000.00       \$ 740,0         1       L.S.       Electrical       \$ 740,000.00       \$ 740,0         1       EA.       Generator       \$ 115,000.00       \$ 115,0	515	S.F.	Concrete Pads	\$	82.00	\$	42,230
115       L.F.       Masonry and Foundation       \$ 391.00       \$ 44,9         1       L.S.       Building Slab       \$ 28,500.00       \$ 28,5         1       L.S.       Building Roof and Awning       \$ 68,900.00       \$ 68,9         1       L.S.       Doors       \$ 16,000.00       \$ 16,000.00         1       L.S.       HVAC       \$ 42,000.00       \$ 42,000.00         1       L.S.       Electrical       \$ 740,000.00       \$ 740,000.00         1       EA.       Generator       \$ 115,000.00       \$ 115,000.00	7	EA.	Install Bollard	\$	2,340.00	\$	16,380
1       L.S.       Building Slab       \$ 28,500.00       \$ 28,5         1       L.S.       Building Roof and Awning       \$ 68,900.00       \$ 68,9         1       L.S.       Doors       \$ 16,000.00       \$ 16,000.00         1       L.S.       HVAC       \$ 42,000.00       \$ 42,000.00         1       L.S.       Electrical       \$ 740,000.00       \$ 740,000.00         1       EA.       Generator       \$ 115,000.00       \$ 115,000.00	100	L.F.	Fences and Gates	\$	199.16	\$	19,916
1       L.S.       Building Roof and Awning       \$ 68,900.00       \$ 68,9         1       L.S.       Doors       \$ 16,000.00       \$ 16,0         1       L.S.       HVAC       \$ 42,000.00       \$ 42,0         1       L.S.       Electrical       \$ 740,000.00       \$ 740,0         1       EA.       Generator       \$ 115,000.00       \$ 115,0	115	L.F.	Masonry and Foundation	\$	391.00	\$	44,965
1       L.S.       Doors       \$ 16,000.00       \$ 16,0         1       L.S.       HVAC       \$ 42,000.00       \$ 42,0         1       L.S.       Electrical       \$ 740,000.00       \$ 740,0         1       EA.       Generator       \$ 115,000.00       \$ 115,0	1	L.S.	Building Slab	\$	28,500.00	\$	28,500
1       L.S.       HVAC       \$ 42,000.00 \$ 42,000.00         1       L.S.       Electrical       \$ 740,000.00 \$ 740,000.00         1       EA.       Generator       \$ 115,000.00 \$ 115,000.00	1	L.S.	Building Roof and Awning	\$	68,900.00	\$	68,900
1       L.S.       HVAC       \$ 42,000.00 \$ 42,000.00         1       L.S.       Electrical       \$ 740,000.00 \$ 740,000.00         1       EA.       Generator       \$ 115,000.00 \$ 115,000.00	1	L.S.	Doors	\$	16,000.00	\$	16,000
1       L.S.       Electrical       \$ 740,000.00       \$ 740,0         1       EA.       Generator       \$ 115,000.00       \$ 115,0	1	L.S.	HVAC	\$		\$	42,000
	1	L.S.	Electrical	\$		\$	740,000
1,010 S.F. 3/4" Rock over Filter Fabric \$10.65 \$ 10,000 \$10.65	1	EA.	Generator	\$	115,000.00	\$	115,000
	1,010	S.F.	3/4" Rock over Filter Fabric		\$10.65	\$	10,757
						\$	-

Page 8 of 8 10/20/2021

A.	Subtotal	\$ 2,595,585
B.	Contingency (15% x A)	\$ 389,338
C.	Sewer Total (A + B)	\$ 2,984,923

Page 8 of 8 10/20/2021

#### GENERAL NOTES

- THIS PLAN SUPERSEDES ALL OTHER PLANS PREVIOUSLY APPROVED BY THE CITY OF BEAUMONT REGARDING IMPROVEMENTS SHOWN ON THIS SET OF PLANS.
   APPROVAL OF THIS PLAN DOES NOT LESSEN OR WAIVE ANY PORTION OF THE APPROVAL OF THIS PLAN DOES NOT LESSEN OR WAIVE ANY PORTION OF THE BEAUMONT MUNICIPAL CODE, RESOLUTION OF CONDITIONAL APPROVAL, CITY STANDARDS OR OTHER ADDITIONAL DOCUMENTS LISTED HEREIN AS THEY MAY PERTAIN TO THIS PROJECT. THE ENGINEER IN RESPONSIBLE CHARGE SHALL REVISE THESE PLANS WHEN NON-CONFORMANCE IS DISCOVERED.
   CITY APPROVAL OF PLANS DOES NOT RELIEVE THE DEVELOPER OR ENGINEER-OF-WORK FROM RESPONSIBILITY FOR THE CORRECTION OF ERRORS AND OMISSIONS DISCOVERED DURING CONSTRUCTION. ALL PLAN REVISIONS SHALL BE PROMPTLY SUBMITTED TO THE CITY ENGINEER FOR APPROVAL.
   A RIGHT-OF-WAY PERMIT FROM THE BUILDING & SAFETY DEPARTMENT WILL BE REQUIRED FOR ANY WORK IN THE PUBLIC RIGHT OF WAY. PRIOR TO PERMIT ISSUANCE, A CERTIFICATE OF INSURANCE MUST BE FILED NAMING THE CITY OF BEALMONT AS AN ADDITIONAL INSURED ON. THE PERMITTE'S POLICY IN THE PERMINDIT AS AN ADDITIONAL INSURED ON. THE PERMITTE'S POLICY IN THE
- BEAUMONT AS AN ADDITIONAL INSURED ON THE PERMITTEE'S POLICY IN THE MINIMUM AMOUNT OF \$1,000,000.00 FOR EACH OCCURRENCE OF LIABILITY. THE MISURANCE COMPANY WRITING THE POLICY MUST HAVE A RATING OF "A=" OR BETTER AND A SIZE CATEGORY OF CLASS VII OR BETTER AS ESTABLISHED BY
- BETTER AND A SIZE CATEGORY OF CLASS VII ON BETTER AS ESTABLISHED BY
  "BESTS" KEY RATHING GUIDE.

  5. NO WORK SHALL BE COMMENCED UNTIL ALL PERMITS HAVE BEEN OBTAINED FROM
  THE CITY AND OTHER APPROPRIATE AGENCIES.

  6. REVISION OF THESE PLANS MAY BE REQUIRED IF THE PROPOSED IMPROVEMENTS
  ARE NOT CONSTRUCTED PRIOR TO THE DEADLINE DATE OF THE IMPROVEMENT
  AGREEMENT.

  1. NO BEVISIONS WILL BE MADE TO THESE PLANS WITHOUT THE WRITTEN APPROVAL OF
- AGREEMENT.

  1. NO REVISIONS WILL BE MADE TO THESE PLANS WITHOUT THE WRITTEN APPROVAL OF THE CITY ENGINEER, NOTED WITHIN THE REVISION BLOCK, ON THE APPROPRIATE SHEET OF THE PLANS AND TITLE SHEET.

  8. ORIGINAL DRAWINGS SHALL BECOME THE PROPERTY OF THE CITY UPON BEING SIGNED BY THE CITY ENGINEER.

  9. THE ORIGINAL DRAWING SHALL BE REVISED TO REFLECT AS—BUILT CONDITIONS BY THE ENGINEER—OF—WORK PRIOR TO FINAL ACCEPTANCE OF THE WORK BY THE CITY.

- 10. ACCESS FOR FIRE AND OTHER EMERGENCY VEHICLES SHALL BE MAINTAINED TO THE PROJECT SITE AT ALL TIMES DURING CONSTRUCTION.

  11. WHERE TRENCHES ARE WITHIN CITY EASEMENTS, A SOILS REPORT COMPRISED OF:
- A. SUMMARY SHEET B. LABORATORY WORK SHEETS C. COMPACTION CURVES, SHALL BE SUBMITTED BY A PROFESSIONAL ENGINEER OF
  - COMPACTOR CORVERS, SHALL BE SOBMITTED BY A PROFESSIONAL ENGINEER OF THE STATE OF CALIFORNIA, PRINCIPALLY DOING BUSINESS IN THE FIELD OF APPLIED SOILS MECHANICS. THE SOILS REPORT WILL BE SUBMITTED TO THE CITY ENGINEERING INSPECTOR WITHIN TWO WORKING DAYS OF COMPLETION OF FIELD TESTS. THE WRITTEN FIELD COMPACTION REPORT(S) SHALL BE IMMEDIATE
    SUBMITTED TO THE CITY ENGINEERING INSPECTOR UPON COMPLETION OF T
- 305MILESO THE CHIT ENGINEERING INSPECTOR OF ON COMPLETION OF THE FIELD TESTS.

  12. A PRECONSTRUCTION MEETING SHALL BE HELD AT THE SITE PRIOR TO THE BEGINNING OF WORK AND SHALL BE ATTENDED BY ALL REPRESENTATIVES RESPONSIBLE FOR CONSTRUCTION, INSPECTION, SUPERVISION, TESTING AND ALL OTHER ASPECTS OF THE WORK. THE CONTRACTOR SHALL SCHEDULE THE MEETING

- BEGINNING OF WORK AND SHALL BE ATTENDED BY ALL REPRESENTATIVES RESPONSIBLE FOR CONSTRUCTION, INSPECTION, SUPPERVISION, TESTING AND ALL OTHER ASPECTS OF THE WORK. THE CONTRACTOR SHALL SCHEDULE THE MEETING BY CALLING THE INSPECTION LINE AT (951) 572–3224 AT LEAST FIVE (6) WORKING DAYS PRIOR TO STARTING CONSTRUCTION. APPROVED DRAWINGS MUST BE AVAILABLE PRIOR TO SCHEDULING.

  13. ALL INSPECTION REQUESTS OTHER THAN FOR THE PRECONSTRUCTION MEETING WILL BE MADE BY CALLING THE BUILDING AND SAFETY INSPECTION REQUEST LINE AT (951) 572–3224. INSPECTION REQUESTS MUST BE RECEIVED PRIOR TO 2:00 P.M. ON THE DAY BEFORE THE INSPECTION IS NEEDED. INSPECTIONS WILL BE MADE THE NEXT WORK DAY UNLESS YOU REQUEST OTHERWISE. REQUESTS MADE AFTER 2:00 P.M. WILL BE SCHEDULED FOR TWO FULL WORK DAYS LATER.

  14. THE OWNER AND/OR APPLICANT THROUGH THE DEVELOPER AND/OR CONTRACTOR SHALL DESIGN, CONSTRUCT AND MAINTAIN ALL SAFETY DEVICES, INCLUDING SHORING, AND SHALL BE SOLELY RESPONSIBLE FOR CONFORMING TO ALL LOCAL, STATE AND FEDERAL SAFETY AND HEALTH STANDARDS, LAWS AND REQULATIONS. STATE AND FEDERAL SAFETY AND HEALTH STANDARDS, LAWS AND REQULATIONS. THE CONTRACTOR SHALL CONFORM TO LABOR CODE SECTION 6705 BY SUBMITTING A DETAILED PLAN TO THE CITY ENGINEER AND/OR CONCERNED AGENCY SHOWING THE DESIGN OF SHORING, BRACING SLOPE OR OTHER PROVISIONS TO BE MADE FOR WORKER PROTECTION FROM THE HAZARD OF CAVING GROUND DURING THE EXCAVATION OF SUCH TRENCH OR TRENCHES OR DURING THE PIPE INSTALLATION THEREIN. THIS PLAN MUST BE PREPARED FOR ALL TRENCHES FIVE FEET (5) OR MORE IN DEPTH AND APPROVED BY THE CITY ENGINEER AND/OR CONCERNED AGENCY PRIOR TO EXCAVATION. IF THE PLAN VARIES FROM THE SHORING SYSTEM STANDARDS ESTABLISHED BY THE CONSTRUCTION SAFETY ORDERS, TITLE 8 OF THE CALIFORNIA ADMINISTRATIVE CODE, THE PLAN VARIES FROM THE SHORING SYSTEM STANDARDS ESTABLISHED BY THE CONSTRUCTION SAFETY ORDERS, TITLE 8 OF THE CALIFORNIA ADMINISTRATIVE CODE, THE PLAN SHALL BE PREPARED BY A REGISTERED ENGINEER AT THE CONTRACTOR'S EXPENSE. A COPY OF THE OSHA EXCAVATION, THE

- 19 NO BLASTING SHALL BE COMMENCED WITHOUT A CITY ENGINEER APPROVED.
- 19. NO BLASTING SHALL BE COMMENCED WITHOUT A CITY ENGINEER APPROVED BLASTING PRORAM AND BLASTING PERBIT.
  20. THE EXISTENCE AND LOCATION OF UTILITY STRUCTURES AND FACILITIES SHOWN ON THE CONSTRUCTION PLANS WERE OBTAINED BY A SEARCH OF THE AVAILABLE RECORDS. ATTENTION IS CALLED TO THE POSSIBLE EXISTENCE OF OTHER UTILITY FACILITIES OR STRUCTURES NOT SHOWN OR IN A LOCATION DIFFERENT FROM THAT SHOWN ON THE PLANS. THE CONTRACTOR IS REQUIRED TO TAKE DUE PRECAUTIONARY MEASURES TO PROTECT THE UTILITIES SHOWN ON THE PLANS AND ANY OTHER EXISTING FACILITIES OR STRUCTURES NOT SHOWN.
  21. THE CONTRACTOR SHALL VERIFY THE LOCATION OF ALL EXISTING FACILITIES (APPROVED UNIT) WITHIN THE PROJECT SITE SLEED/CHRITY
- (ABOVEGROUND AND UNDERGROUND) WITHIN THE PROJECT SITE SUFFICIENTLY AHEAD OF THE CONSTRUCTION TO PERMIT THE REVISIONS OF THE CONSTRUCTION PLANS IF IT IS FOUND THAT THE ACTUAL LOCATIONS ARE IN CONFLICT WITH THE
- 22. THE CONTRACTOR SHALL NOTIFY AFFECTED UTILITY COMPANIES (SEE BELOW) AT LEAST TWO FULL WORKING DAYS PRIOR TO STARTING CONSTRUCTION NEAR THEIR FACILITIES AND SHALL COORDINATE WORK WITH A COMPANY REPRESENTATIVE.
  - UNDERGROUND SERVICE ALERT
    - (800) 422-4133 (800) 409-2365 (800) 892-0123 TIME WARNER CABLE (760) 340-2225
- IIME WARNER CABLE (760) 340-2225
  COX COMMUNICATIONS (888) 423-3913
  23. IN ACCORDANCE WITH THE CITY STORM WATER STANDARDS ALL STORM DRAIN
  INLETS CONSTRUCTED BY THIS PLAN SHALL INCLUDE "STENCILS" BE ADDED TO
  PROHIBIT WASTE DISCHARGE DOWNSTREAM. STENCILS SHALL BE ADDED TO THE
  SATISFACTION OF THE CITY ENGINEER.

### CITY OF BEAUMONT, CALIFORNIA BEAUMONT CROSSROADS LIFT STATION 100% SUBMITTAL

- SEWER SYSTEM CONSTRUCTION AND MATERIALS SHALL BE IN ACCORDANCE WITH EASTERN MUNICIPAL WATER DISTRICT (EMWD'S) STANDARDS AND
- GRAVITY SEWER PROFILE ELEVATIONS ARE TO FLOW LINE (CONDUIT INVERT).
- FORCE MAIN PROFILE ELEVATIONS ARE TO CENTIGRADE (CG).
  CONTRACTOR HAS THE OPTION TO INSTALL PLASTIC OR VCP SEWERS EXCEPT
  WHERE SPECIFICALLY DESIGNATED ON PLANS PER EMWD STANDARDS AND SPECIFICATIONS.
- MANHOLES SHALL BE CONSTRUCTED IN ACCORDANCE WITH STANDARD DRAWINGS SB-53, SB-58, AND SB-61, AS APPLICABLE. SEWER MAINS MAY BE LAID THROUGH THE MANHOLES AND USED AS A FORM FOR THE INVERT.
- MANHOLES OF DEPTHS LESS THAN FIVE FEET FROM FINISH STREET GRADE TO SEWER PIPE SHELF ARE TO BE CONSTRUCTED IN ACCORDANCE WITH STANDARD DRAWING SB-30.
- ALL LATERALS SHALL HAVE AN ON-SITE CLEANOUT IN ACCORDANCE WITH STANDARD DRAWING SB-52. IN ADDITION, FOR LATERALS SERVING INDUSTRIAL AND/OR COMMERCIAL DEVELOPMENTS, THE REQUIREMENTS FOR SAMPLING AND/OR PRETREATMENT FACILITIES SHALL BE DETERMINED BY CONTRACTING THE BUILDING AND SAFETY DEPARTMENT.
  MAINLINE CLEANOUTS, WHERE CALLED FOR ON THE PLANS, SHALL BE
- CONSTRUCTED IN ACCORDANCE WITH STANDARD DRAWING SB-52
- PRIOR TO CONSTRUCTION OF SEWER, CONTRACTOR SHALL EXPOSE EXISTING SEWER AND VERIFY ITS EXISTING ELEVATION AND LOCATION. WHEN CONNECTING TO EXISTING MANHOLES AND INLET STUB OF PROPER SIZE
- CONNECTING TO EXISTING MANHOLES AND INLET STUD OF PROPER SIZE EXISTS, NO ALTERATIONS SHALL BE MADE TO EXISTING MANHOLE BASE OR STUB EXCEPT AS SPECIFICALLY AUTHORIZED BY THE CITY INSPECTOR.

  9. ALL SEWER INLETS AT THE MANHOLE SHALL BE SUCH THAT ITS CROWN SHALL BE LEVEL WITH THE CROWN OF THE OUTLET PIPE, AT THEIR PROJECTIONS TO THE MANHOLE CENTERLINE.

  10. RECONSTRUCTION OF EXISTING MANHOLES SHALL BE SCHEDULED AT THE CONSTRUCTION OF EXISTING MANHOLES SHALL BE SCHEDULED AT THE
- CONVENIENCE OF THE CITY AND SHALL BE COMPLETED WITHIN FIVE WORKING DAYS FOLLOWING ITS COMMENCEMENT.

  SEWER LATERALS SHALL BE CONSTRUCTED IN ACCORDANCE WITH SB-177.
- LOCATIONS OF WYES AND LATERALS. WHERE NOT SHOWN ON THE PLANS. ARE TO BE DETERMINED IN THE FIELD PRIOR TO CONSTRUCTION TO MISS DRIVEWAYS. ALL LATERALS ARE TO BE 4" IN DIAMETER UNLESS OTHERWISE SHOWN ON PLANS, CONNECTIONS OF NEW LATERALS TO EXISTING SEWER ARE
- TO BE PER STANDARD DRAWING SB-176.

  THE CONTRACTOR IS ADVISED THAT THE WORK ON THIS PROJECT MAY INVOLVE WORKING IN A CONFINED AIR SPACE. CONTRACTOR SHALL BE RESPONSIBLE FOR "CONFINED AIR SPACE" ARTICLE 108, TITLE 8, CALIFORNIA ADMINISTRATIVE CODE.
- 13. WHERE GROUNDWATER IS ENCOUNTERED, ALL VCP PIPE SHALL BE TREATED FOR ABSORPTION RESISTANCE PER EMWD'S SPECIFICATIONS.

  14. BACKWATER VALVES SHALL BE INSTALLED PER SECTION 710.1 OF THE
- UNIFORM PLUMBING CODE.
- ALL PIPE ZONE BEDDING AND TRENCH BACKFILL ARE TO BE PER STANDARD DRAWING SB-157, SB-158, AND SB-159.

#### PRIVATE ENGINEERS NOTICE TO CONTRACTOR(S)

- THE EXISTENCE AND LOCATION OF ANY UNDERGROUND UTILITIES OR STRUCTURES SHOWN ON THESE PLANS ARE OBTAINED BY A SEARCH OF AVAILABLE RECORDS. TO THE BEST OF OUR KNOWLEDGE, THERE ARE NO EXISTING UTILITIES EXCEPT THOSE SHOWN ON THESE PLANS. THE CONTRACTOR IS REQUIRED TO TAKE ALL PRECAUTIONARY MEASURES TO PROTECT THE UTILITIES SHOWN, AND ANY OTHER LINES OR STRUCTURES NOT SHOWN ON THESE PLANS AND IS RESPONSIBLE FOR THE PROTECTION OF, AND ANY DAMAGE TO, THESE LINES OR STRUCTURES
- IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO NOTIFY THE OWNER OF ALL UTILITIES OR STRUCTURES CONCERNED BEFORE STARTING WORK.

  QUANTITIES SHOWN HEREON ARE PROVIDED FOR BIDDING PURPOSES ONLY.
- CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING ALL QUANTITIES PRIOR TO BIDDING FOR CONSTRUCTION.
- THE PRIVATE ENGINEER SIGNING THESE PLANS IS RESPONSIBLE FOR ASSURING THE ACCURACY AND ACCEPTABILITY OF THE DESIGN HEREON. IN THE EVENT OF DISCREPANCIES ARISING AFTER CITY APPROVAL OR DURING CONSTRUCTION THE PRIVATE ENGINEER SHALL BE RESPONSIBLE FOR DETERMINING AN ACCEPTABLE SOLUTION AND REVISING THE PLANS FOR

- APPROVAL OF THESE PLANS APPLIES ONLY WITHIN THE JURISDICTION OF THE CITY OF BEAUMONT.

  TRENCHING FOR UTILITIES AND STRUCTURES IS NOT ALLOWED UNTIL SOIL
- COMPACTION REPORT IS SUBMITTED AND APPROVED BY THE PUBLIC WORKS
- THE CITY RESERVES THE RIGHT TO REQUIRE REVISION OF THE APPROVED PLANS TO CONFORM WITH CURRENT STANDARDS AND TO POST A NEW BOND IF CONSTRUCTION HAS NOT COMMENCED WITHIN TWO YEARS AFTER PLANS
- SIDEWALK AND DRIVEWAY APPROACHES WILL BE POURED/CONSTRUCTED ONLY AFTER DRIVEWAY LOCATIONS ARE DETERMINED.

	Sheet List Table
Sheet Number	Sheet Title
1	TITLE SHEET
2	INDEX MAP
3	OVERALL SITE PLAN
4	LIFT STATION SITE PLAN
5	GRADING PLAN
6	MECHANICAL PLAN
7	LIFT STATION SECTION A
8	LIFT STATION SECTION B
9	LIFT STATION SECTION C
10	DETAILS
11	DETAILS
12	DETAILS
13	DETAILS
14	GENERAL ELECTRICAL NOTES
15	ELECTRICAL SITE PLAN
16	ELECTRICAL BUILDING FLOORPLAN
17	ELECTRICAL SINGLE LINE AND SCHEDULES
18	ELECTRICAL DETAILS 1
19	ELECTRICAL DETAILS 2
20	MOTOR CONTROL
21	ELECTRICAL SCHEDULES
22	GENERAL STRUCTURAL NOTES I
23	GENERAL STRUCTURAL NOTES II
24	STRUCTURAL SITE PLAN
25	MCC BUILDING FOUNDATION PLAN
26	MCC BUILDING ROOF PLAN
27	MCC BUILDING ELEVATION I
28	MCC BUILDING ELEVATION II
29	MCC BUILDING ELEVATION III
30	MCC BUILDING ELEVATION IV
31	STRUCTURAL DETAILS I
32	STRUCTURAL DETAILS II
33	WET WELL SLAB
34	WET WELL SLAB II
35	MECHANICAL NOTES AND SCHEDULES
36	MECHANICAL FLOORPLAN
37	FINISHES AND DOORS
38	ROOF DETAILS

"DECLARATION OF RESPONSIBLE CHARGE"
I HEREBY DECLARE THAT I AM THE ENGINEER OF WORK FOR THIS
PROJECT, THAT I HAVE EXERCISED RESPONSIBLE CHARGE OVER THE
DESIGN OF THE PROJECT AS DEFINED IN SECTION 6703 OF THE
BUSINESS AND PROFESSIONS CODE, AND THAT THE DESIGN IS
CONSISTENT WITH CURRENT STANDARDS. I UNDERSTAND THAT THE
CHECK OF PROJECT DRAWINGS AND SPECIFICATIONS BY THE CITY OF
BEAUMONT DOES NOT RELIEVE ME AS ENGINEER OF WORK OF MY
RESPONSIBILITIES FOR PROJECT DESIGN.

FIRM: KIMLEY-HORN & ASSOCIATES ADDRESS: 401 B STREET CITY ST: SAN DIEGO, CA 92101 TELEPHONE: (619)234-9411 BY: SAM. L MCWHORTER, R.C.E. 61788 DATE: 8/30/21 (NAME OF ENGINEER & RCE.

ALL STANDARD DRAWINGS ARE COUNTY OF RIVERSIDE ROAD IMPROVEMENT STANDARDS & SPECIFICATIONS UNLESS NOTED OTHERWISE:

- \* RCEC&WCD STANDARD MANUAL
- \*\* EMWD SEWER STANDARD DRAWINGS
  \*\*\* STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

#### LEGAL DESCRIPTION:

THAT PORTION OF PARCEL 1 OF PARCEL MAP NO. 36426, IN THE CITY OF BEAUMONT, COUNTY OF RIVERSIDE, STATE OF CALIFORNIA, AS PER MAP FILED IN BOOK 242, PAGES 24 THROUGH 29, INCLUSIVE, OF PARCEL MAPS, IN THE OFFICE OF THE COUNTY RECORDER OF SAID COUNTY, DESCRIBED AS FOLLOWS:

BEGINNING AT THE NORTHEAST CORNER OF SAID PARCEL 1:

THENCE WESTERLY ALONG THE NORTHERLY LINE OF SAID PARCEL 1, SOUTH 87' 44' 33" WEST 182.70 FEET TO A LINE PARALLEL WITH AND DISTANT WESTERLY 182.62 FEET MEASURED AT RIGHT ANGLES FROM THE EASTERLY LINE OF SAID PARCEL 1:

THENCE SOUTHERLY ALONG SAID PARALLEL LINE, SOUTH 00° 37' 01" FAST 65.03 FFFT TO A LINE PARALLEL WITH AND DISTANT SOUTHERLY 65.00 FEET MEASURED AT RIGHT ANGLES FROM SAID

THENCE EASTERLY ALONG LAST MENTIONED PARALLEL LINE, NORTH 87 44' 33" EAST 182.70 FEET TO SAID EASTERLY LINE;


THENCE NORTHERLY ALONG SAID EASTERLY LINE, NORTH 00° 37' 01" WEST 65.03 FEET TO THE POINT OF BEGINNING

#### ASSESSOR'S PARCEL NO. 36426

BEING A SUBDIVISION OF A PORTION OF THE NORTH HALF OF SECTION 7 AND THE SOUTHWEST CORNER OF SECTION 6, BOTH OF TOWNSHIP 3 SOUTH, RANGE 1 WEST, SAN BERNARDINO MERIDIAN, AS RECORDED MARCH 16, 2017, AS DOCUMENTED NO. 2017-0108002, OF OFFICIAL RECORDS OF SAID COUNTY.

SITE ADDRESS: 36523 HWY 60 CITY OF BEAUMONT, CA 92223

OWNER/APPLICANT: MCDONALD PROPERTY GROUP 1140 N. COAST HIGHWAY LAGUNA BEACH, CA 92651 PHONE: (949) 999-2800 FAX: (949) 999-2839

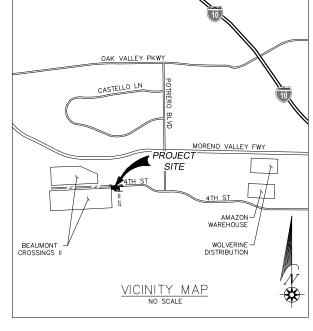

WORK TO BE DONE
THE IMPROVEMENT WORK SHALL BE PERFORMED IN ACCORDANCE WITH THE FOLLOWING DOCUMENTS, CURRENT AT THE TIME OF CONSTRUCTION, AS DIRECTED BY THE CITY ENGINEER.

BEAUMONT MUNICIPAL CODE

- BEAUMONT MUNICIPAL CODE.
  FOR STREETS: RIVERSIDE COUNTY ORDINANCE NO. 461.
  FLOOD CONTROL FACILITIES: THE RIVERSIDE COUNTY FLOOD CONTROL AND WATER
  CONSERVATION DISTRICT'S STANDARDS FOR FLOOD CONTROL FACILITIES.
  SANITARY SEWER FACILITIES: THE EASTERN MUNICIPAL WATER DISTRICT'S
  STANDARDS FOR SANITARY SEWER FACILITIES.
  ALL OTHER PUBLIC WORKS.
- CONSTRUCTION (GREEN BOOK).

DESCRIPTION REVISIONS



401 B Street, Suite 600, San Diego, CA 9210 Phone: (619) 234-9411 WWW.KIMLEY-HORN.COM

Sam McWkotto








Reviewed Bv: Administrative Engineer Approved By: \_\_\_\_\_City Engineer/Director of Public Works CITY OF BEAUMONT, PUBLIC WORKS DEPARTMENT

CITY OF BEAUMONT, CALIFORNIA SHEET IMPROVEMENT PLANS FOR: BEAUMONT CROSSROADS LIFT STATION

TITLE SHEET

OF 38 SHEETS 3387

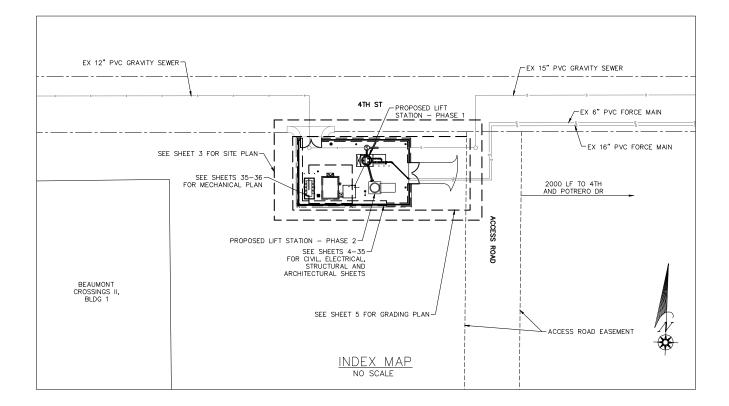

#### LEGEND

DESCRIPTION	DWG.	NO.	SYMBOL	QUANTITY
RIGHT-OF-WAY, R/W				
EASEMENT				
DAYLIGHT LINE				
PROP SEWER			s	
EXISTING SEWER			s	
PROP STORM DRAIN				
EXISTING STORM DRAIN				
PROP WATER			w	
EXISTING WATER			w	
GAS			— GAS —— GAS —— GAS —	
SEWER MANHOLE			S	
PROP CONTOUR			53.0	
EXISTING CONTOUR			53.0	
PROPOSED WALL				
EXISTING WALL				
CURB & GUTTER				
CENTERLINE, CL				
CONCRETE			4 - 94	
AC PAVING				
ACCESS ROAD				
SITE LIGHT			•—¤	
WATER METER			w	
BACKFLOW PREVENTION D	EVICE		®W	
ELECTRICAL ANTENNA				
REMOVE EXISTING			· X·X·X·X·X·X·X·X·X·X·	

#### **ABBREVIATIONS**

AB	AGGREGATE BASE
ASTM	AMERICAN SOCIETY FOR TESTING AND
	MATERIALS
AC	ASPHALTIC CONCRETE
BLDG	BUILDING
CF	CUBIC FEET
CMU	CONCRETE MASONRY UNIT
COMM	COMMUNICATIONS CONCRETE
DI	
DIP	DUCTILE IRON DUCTILE IRON PIPE
DIA, D	DIAMETER
DR	DRIVE
DWG	DRAWING
DWY	DRIVEWAY
EG ELEC	EXISTING GRADE
ELEV	ELECTRIC/ELECTRICAL ELEVATION
EMWD	EASTERN MUNICIPAL WATER DISTRICT
EX	EXISTING
FG	FINISHED GRADE
FLG	FLANGE
FM	FORCE MAIN
GAL	GALLONS DEB MINISTE
GPM HORIZ	GALLONS PER MINUTE HORIZONTAL
HP	HORSEPOWER
HRS	HOURS
HWL	HIGH WATER LEVEL
ID	INNER DIAMETER
IE	INVERT ELEVATION
IPS LF	IRON PIPE SIZE LINEAR FEET
LOL	LAYOUT LINE
LT	LEFT
LWL	LOW WATER LEVEL
MAX	MAXIMUM
MCC	MOTOR CONTROL CENTER
ME	MATCH EXISTING
MH MIN	MANHOLE MINIMUM
NO.	NUMBER
N.T.S.	NOT TO SCALE
O.C.	ON CENTER
PC	POINT OF CURVATURE
PE	PLAIN END
PI D. 4	POINT OF INTERSECTION
P/L PROP	PROPERTY LINE PROPOSED
PSI	POUNDS PER SQUARE INCH
PVC	POLYVINYL CHLORIDE
R/W	RIGHT-OF-WAY
RCFC&WCD	RIVERSIDE COUNTY FLOOD CONTROL AND
	WATER CONSERVATION DISTRICT
RCP	REINFORCED CONCRETE PIPE
RPM	REVOLUTIONS PER MINUTE REMOTE TELEMETRY UNIT
RTU SCH	SCHEDULE
SDR	STANDARD DIMENSION RATIO
SS	STAINLESS STEEL
ST	STREET
STL	STEEL
STD	STANDARD
SWR TDH	SEWER TOTAL DYNAMIC HEAD
TF	TOP OF FOOTING
TP	TOP OF PIPE
TW	TOP OF WALL
TYP	TYPICAL
V	VOLT
VOL VERT	VOLUME VERTICAL
v ⊏ ( 1	VENTIOAL



BENCHMARK:

MATIONAL GEOGETIC SURVEY BENCHMARK NO. '0 1311

I.M MLES WEST OF BEAUMONT ON INTERSTATE 10 TO SAN
TIMEOTED CANYON NEAR FRONTIAGE ROAD ON SOUTH(WEST)

PROVINGE ROAD, 2011 H CARRIES WEST OF SOUTH ON THE PROPERTY OF THE PROPERTY OF THE PROPERTY OF THE PROPERTY OF THE SOUTH OF THE CENTERIANE OF FRONTIAGE ROAD, 1.8 FEET WEST OF POWERING CONTROL OF THE WITH SOUTH OF THE WITH SOUTH

BY MARK DESCRIPTION APPR. DATE SAM L. MCWHORTER REVISIONS CITY R.E. 6.1788









Reviewed By:Staff Engineer	Date:	
Recommended for Approval By:	_ Date:	В
Approved By: City Engineer/Director of Public Works	_ Date:	
CITY OF BEAUMONT, PUBLIC WORKS DEPARTMENT ENGINEERING DIVISION	T 550E. 6th St Begument, CA 92223 769-8520 FAX: (951) 769-8526	


CITY OF BEAUMONT, CALIFORNIA
IMPROVEMENT PLANS FOR:
BEAUMONT CROSSROADS
LIFT STATION


INDEX MAP


OF 38 SHEETS
FILE NO:
3387

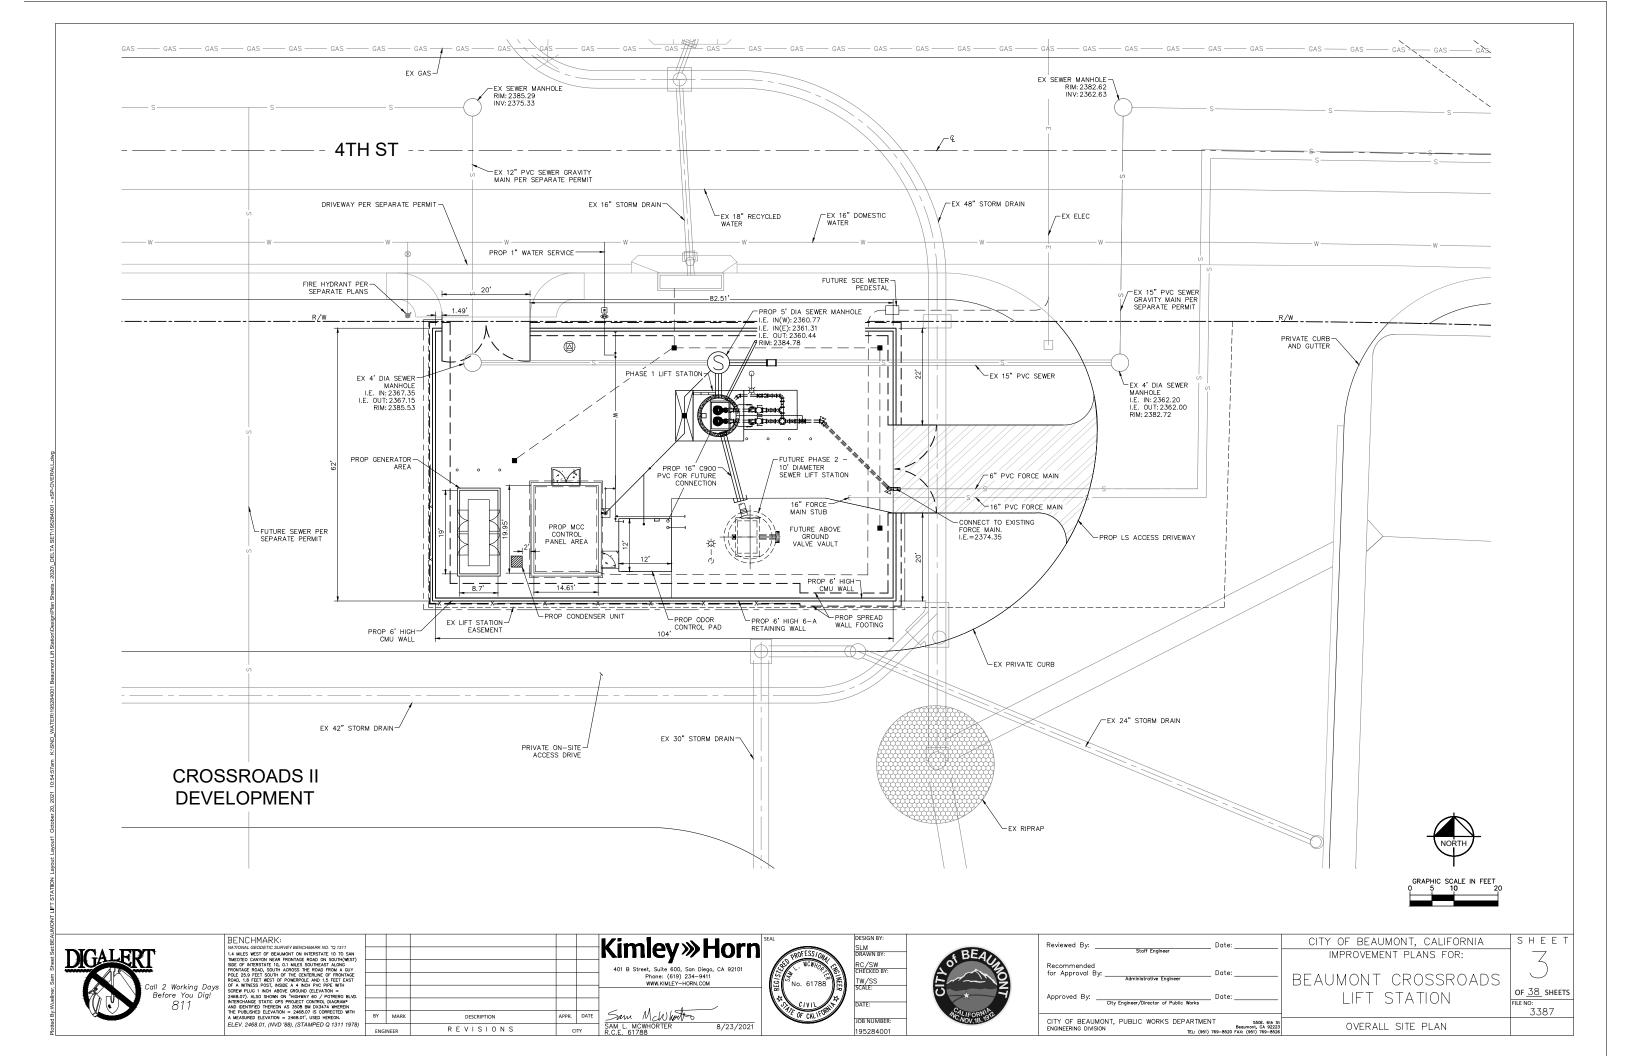


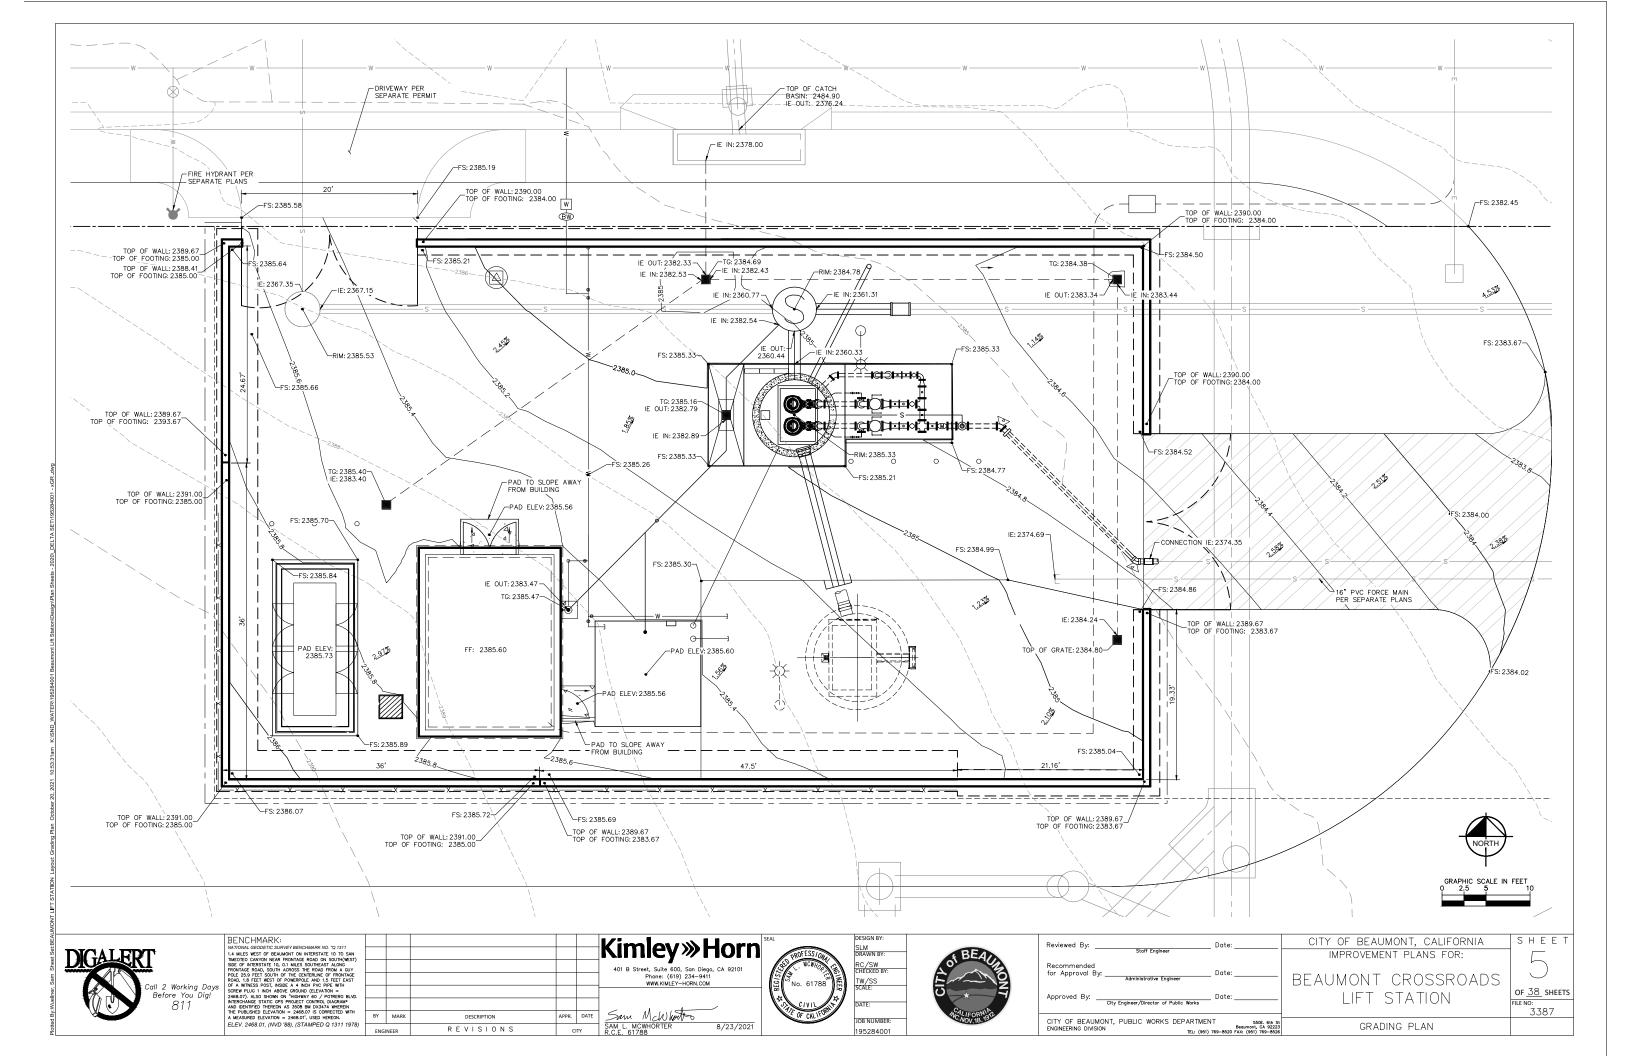

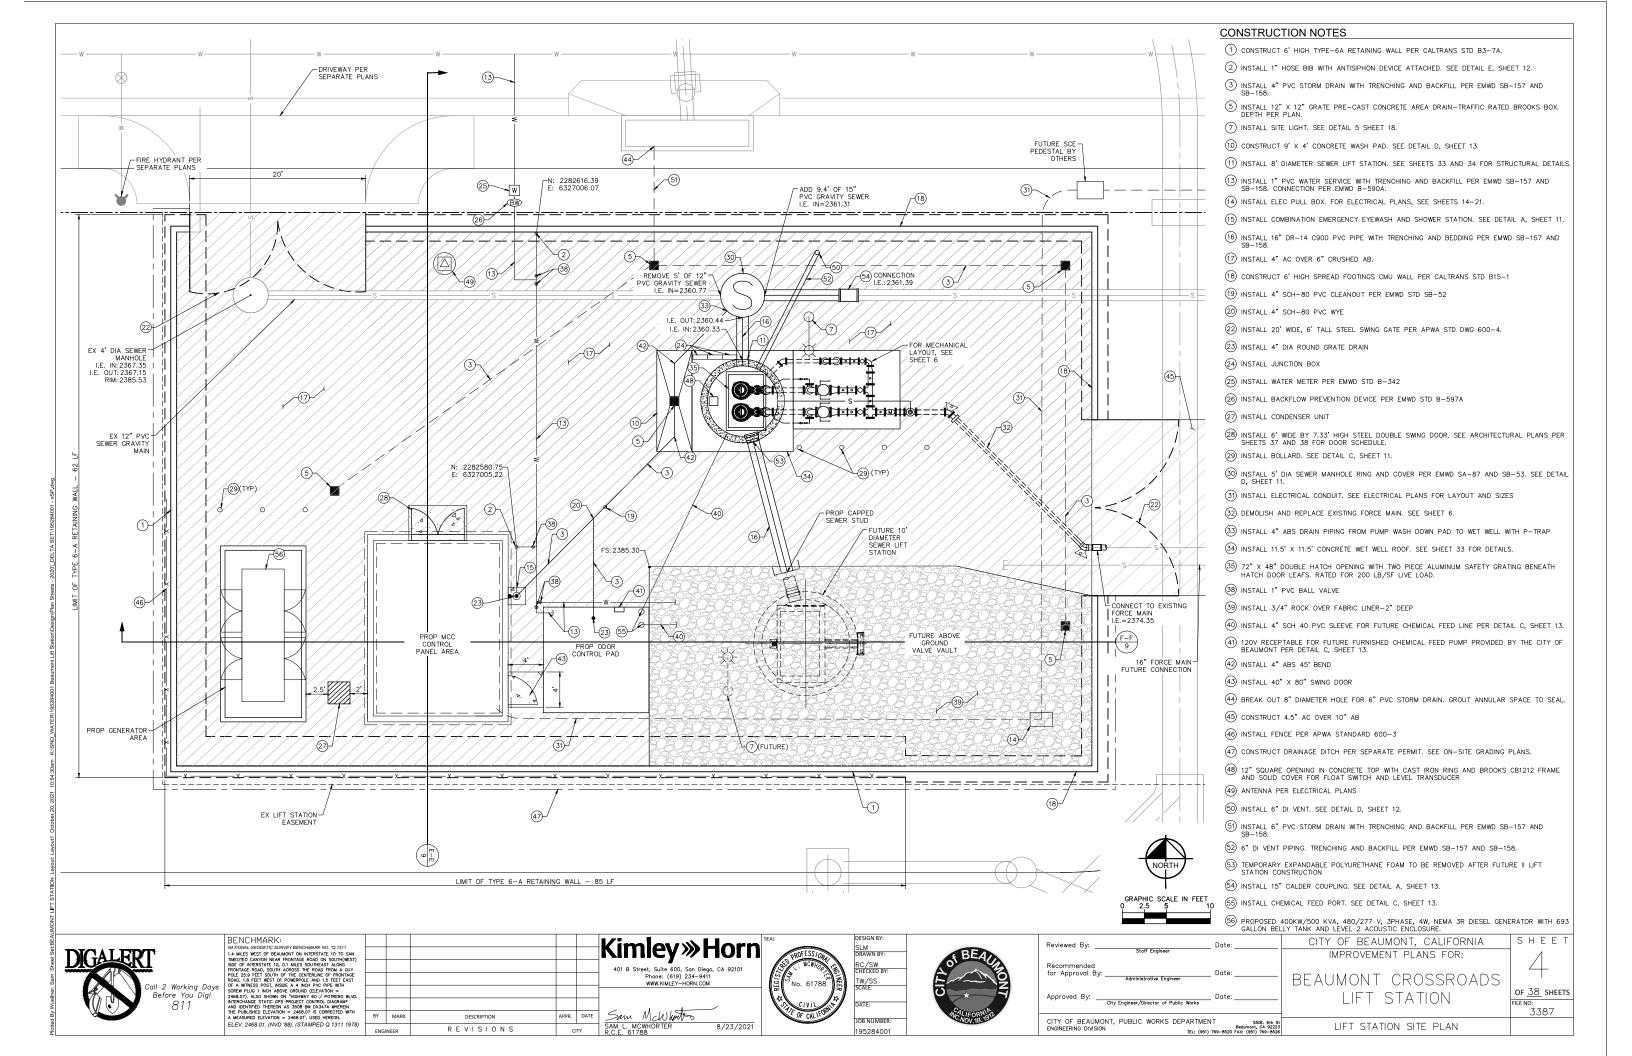

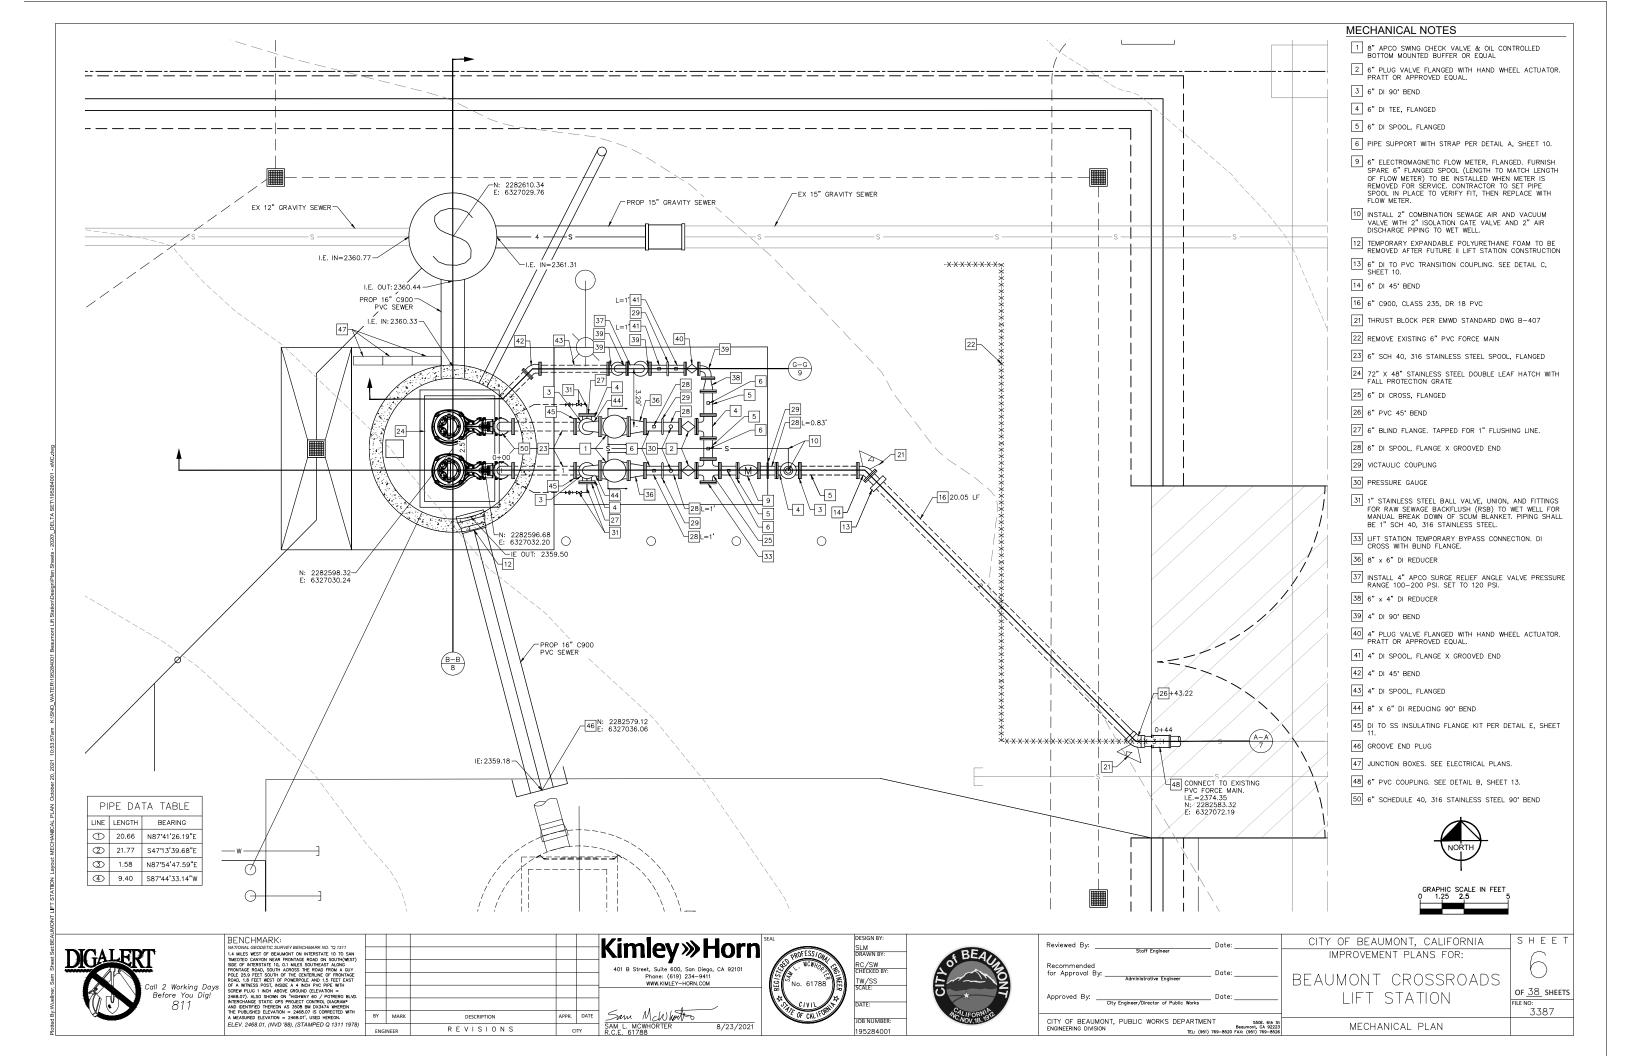

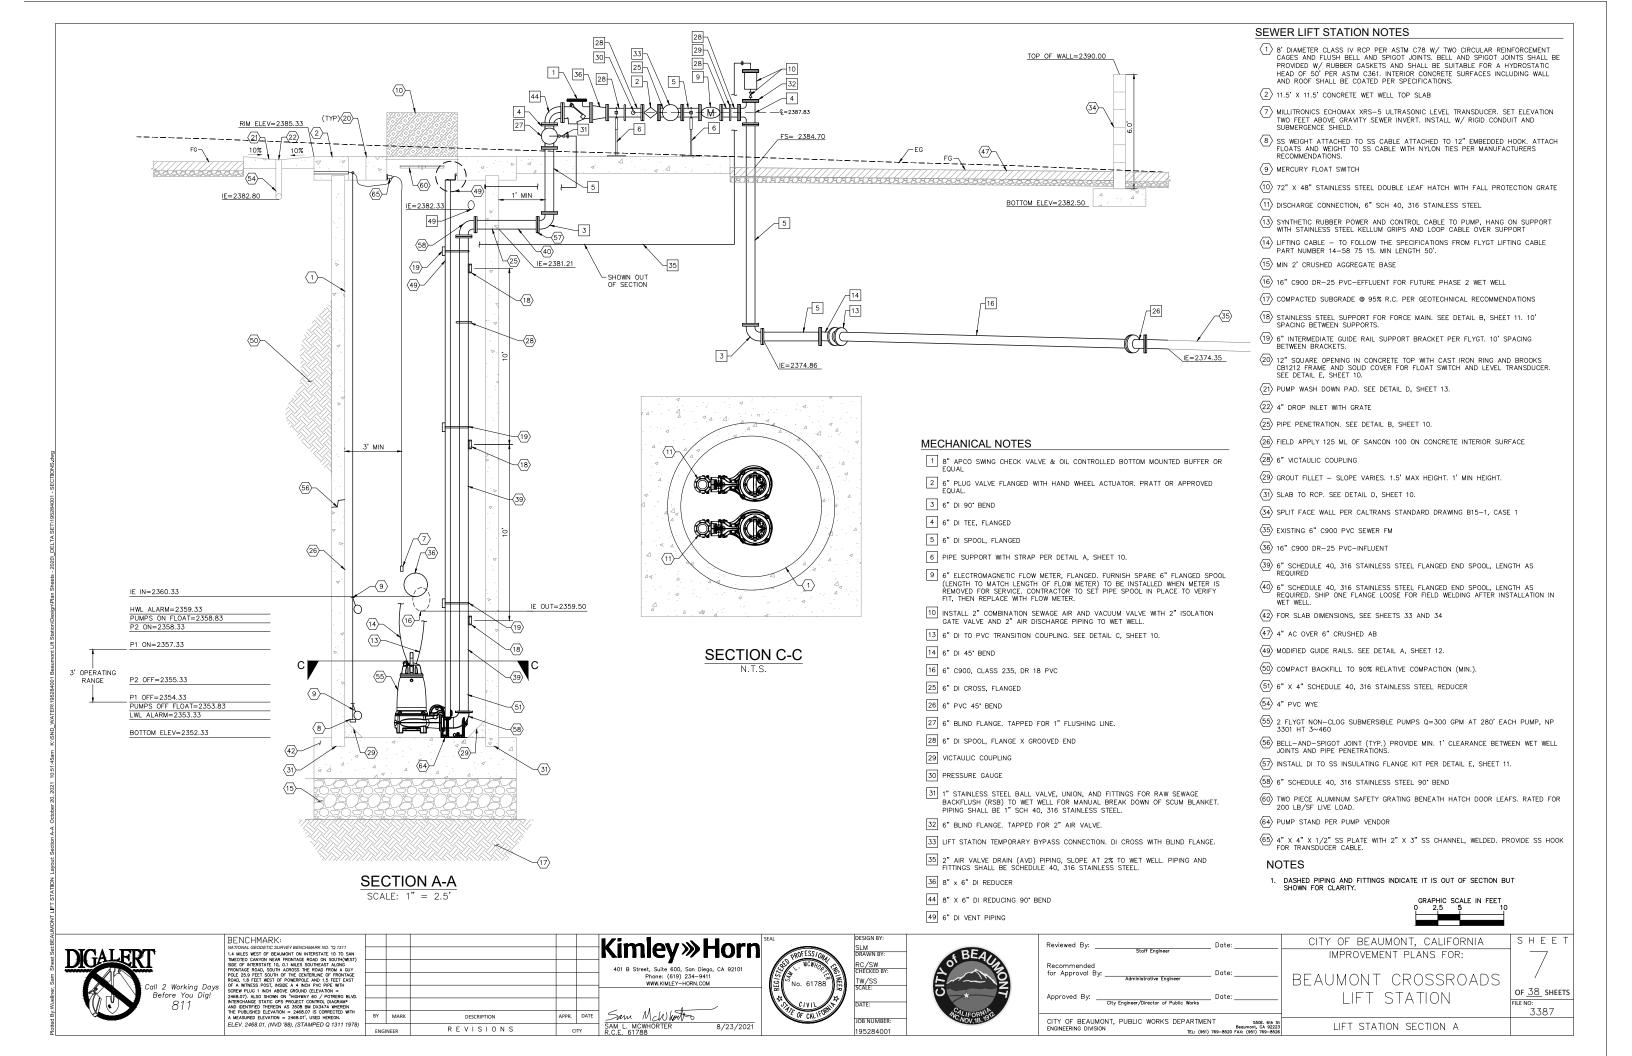

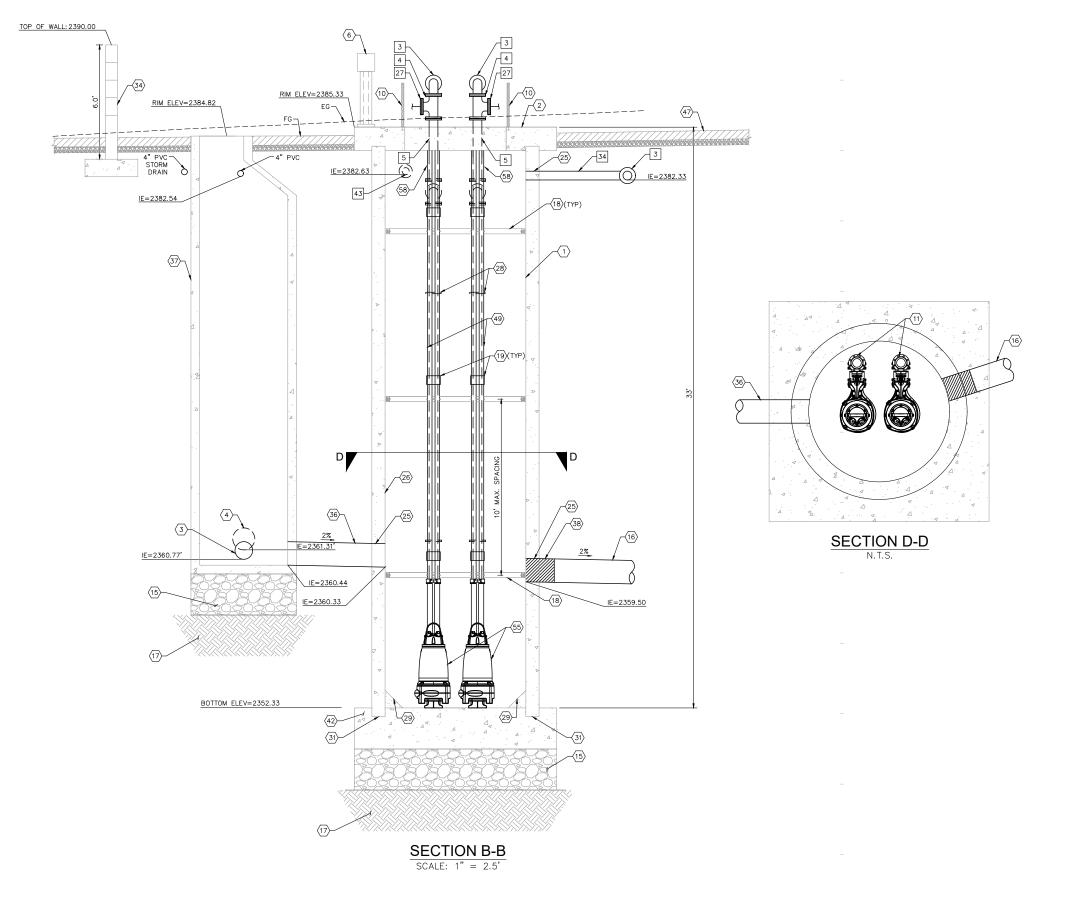

#### SEWER LIFT STATION NOTES

- 8' DIAMETER CLASS IV RCP PER ASTM C78 W/ TWO CIRCULAR REINFORCEMENT CAGES AND FLUSH BELL AND SPIGOT JOINTS. BELL AND SPIGOT JOINTS SHALL BE PROVIDED W/ RUBBER GASKETS AND SHALL BE SUITABLE FOR A HYDROSTATIC HEAD OF 50' PER ASTM C361. INTERIOR CONCRETE SURFACES INCLUDING WALL AND ROOF SHALL BE COATED PER SPECIFICATIONS.
- $\langle 2 \rangle$  11.5' X 11.5' CONCRETE WET WELL TOP SLAB
- 3 12" SDR-26 PVC INFLUENT
- 4 15" SDR-26 PVC INFLUENT
- 6 ELECTRIC JUNCTION BOX AND STANCHION FOR PUMP POWER/CONTROL CABLES, FLOATS, AND TRANDUCERS.
- $\overleftarrow{\text{10}}$  72" X 48" STAINLESS STEEL DOUBLE LEAF HATCH WITH FALL PROTECTION GRATE
- $\fbox{11}$  discharge connection, 6" sch 40, 316 stainless steel
- (15) MIN 2' CRUSHED AGGREGATE BASE
- (16) 16" C900 DR-25 PVC-EFFLUENT FOR FUTURE PHASE 2 WET WELL
- (17) COMPACTED SUBGRADE @ 95% R.C. PER GEOTECHNICAL RECOMMENDATIONS
- $\overleftarrow{\text{(18)}}$  STAINLESS STEEL SUPPORT FOR FORCE MAIN. SEE DETAIL B, SHEET 11. 10' SPACING BETWEEN SUPPORTS.
- $\stackrel{\textstyle (19)}{\sim}$  6" intermediate guide rail support bracket per flygt. 10' spacing between brackets.
- $\langle 25 \rangle$  PIPE PENETRATION. SEE DETAIL B, SHEET 10.
- (26) FIELD APPLY 125 ML OF SANCON 100 ON CONCRETE INTERIOR SURFACE
- 28 6" VICTAULIC COUPLING
- 29 GROUT FILLET SLOPE VARIES. 1.5' MAX HEIGHT. 1' MIN HEIGHT.
- $\langle 31 \rangle$  SLAB TO RCP. SEE DETAIL D, SHEET 10.
- 34 SPLIT FACE WALL PER CALTRANS STANDARD DRAWING B15-1, CASE 1
- 36 16" C900 DR-25 PVC-INFLUENT
- $\stackrel{\textstyle \overbrace{37}}{57}$  5' DIA SEWER MANHOLE, RING AND COVER PER EMWD SA-87 AND SB-53.
- $\ensuremath{\overline{\mbox{38}}}\xspace$  Temporary inflated nylon plug to be removed after future phase II lift station construction.
- $\langle 42 \rangle$  FOR SLAB DIMENSIONS, SEE SHEETS 33 AND 34
- 47 4" AC OVER 6" CRUSHED AB
- $\overline{\langle 49 \rangle}$  MODIFIED GUIDE RAILS. SEE DETAIL A, SHEET 12.
- $\stackrel{\textstyle \langle 55 \rangle}{}$  2 FLYGT NON-CLOG SUBMERSIBLE PUMPS Q=300 GPM AT 280' EACH PUMP, NP 3301 HT 3 $\sim$ 460
- (58) 6" SCHEDULE 40, 316 STAINLESS STEEL 90" BEND

#### MECHANICAL NOTES


- 3 6" DI 90" BEND
- 4 6" DI TEE, FLANGED
- 5 6" DI SPOOL, FLANGED
- 27 6" BLIND FLANGE. TAPPED FOR 1" FLUSHING LINE.
- 34 6" DI VENT PER DETAIL D, SHEET 12.
- 43 4" DI SPOOL, FLANGED


#### NOTES


DASHED PIPING AND FITTINGS INDICATE IT IS OUT OF SECTION BUT SHOWN FOR CLARITY.





















IMPROVEMENT PLANS FOR: BEAUMONT CROSSROADS LIFT STATION

of 38 sheets FILE NO: 3387


SHEET

LIFT STATION SECTION B

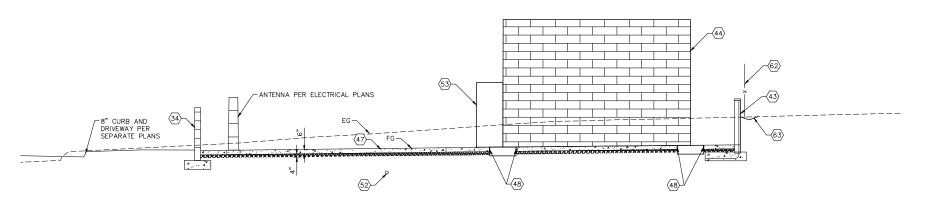


### **SECTION E-E**

SCALE: 1" = 5'

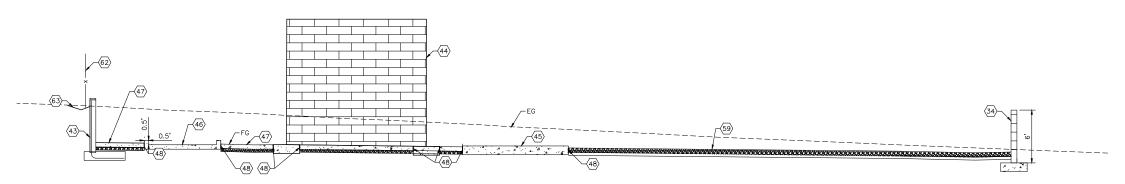


## SECTION F-F SCALE: 1" = 5'

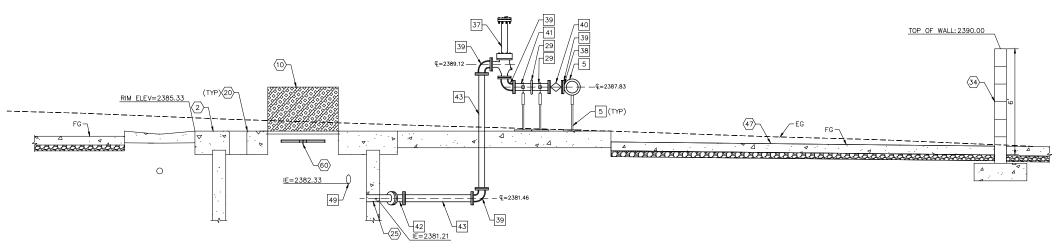


### **SECTION G-G**











Reviewed By:Staff Engineer	_ Date:	
Recommended for Approval By:Administrative Engineer	_ Date:	l E
Approved By:City Engineer/Director of Public Works	Date:	
CITY OF REALIMONT PUBLIC WORKS DEPARTMEN	JT sees on si	

IMPROVEMENT PLANS FOR: BEAUMONT CROSSROADS LIFT STATION LIFT STATION SECTION C

CITY OF BEAUMONT, CALIFORNIA


SHEET OF 38 SHEETS FILE NO: 3387

#### SEWER LIFT STATION NOTES

- 2 11.5' X 11.5' CONCRETE WET WELL TOP SLAB
- (10) INSTALL 72" X 48" STAINLESS STEEL DOUBLE LEAF HATCH WITH FALL PROTECTION GRATE
- 20 12" SQUARE OPENING IN CONCRETE TOP WITH CAST IRON RING AND BROOKS CB1212 FRAME AND SOLID COVER FOR FLOAT SWITCH AND LEVEL TRANSDUCER. SEE DETAIL E, SHEET 10.
- (25) PIPE PENETRATION. SEE DETAIL B, SHEET 10.
- $\langle \overline{34} \rangle$  SPLIT FACE WALL PER CALTRANS STANDARD DRAWING B15-1, CASE 1
- $\overbrace{43}$  construct 6' high type-6a retaining wall per caltrans STD B3-7a.
- 44 MCC BUILDING.
- $\overline{\left\langle 45\right\rangle }$  odor control pad. See detail B sheet 12.
- $\langle 46 \rangle$  ELECTRIC GENERATOR PAD. SEE DETAIL C SHEET 12.
- 47 4" AC OVER 6" CRUSHED AB
- 48 EXPANSION JOINT
- $\overleftarrow{\rm 52}$  install 4" PVC storm drain with trenching and backfill per EMWD SB-157 and SB-158. Invert per grading plan
- $\langle \overline{53} \rangle$  install 6' wide by 7.33' high steel double swing door
- 59 INSTALL 3/4" ROCK OVER MIRAFI LINER
- $\overleftarrow{\mbox{60}}$  Two piece aluminum safety grating beneath hatch door leafs. Rated for 200 Lb/sf live load.
- 62 INSTALL FENCE PER APWA STANDARD 600-3
- (63) DRAINAGE DITCH PER SEPARATE PLANS. SEE ON-SITE GRADING PLANS (PERMIT NUMBER PW2019-0339).

#### MECHANICAL NOTES

- 5 6" DI SPOOL, FLANGED
- 29 VICTAULIC COUPLING
- 37 INSTALL 4" APCO SURGE RELIEF ANGLE VALVE PRESSURE RANGE 100-200 PSI. SET TO 120 PSI.
- 38 6" x 4" DI REDUCER
- 39 4" DI 90° BEND
- 4" PLUG VALVE FLANGED WITH HAND WHEEL ACTUATOR. PRATT OR APPROVED EQUAL.
- 41 4" DI SPOOL, FLANGE X GROOVED END
- 42 4" DI 45" BEND
- 43 4" DI SPOOL, FLANGED
- 49 6" DI VENT PIPING

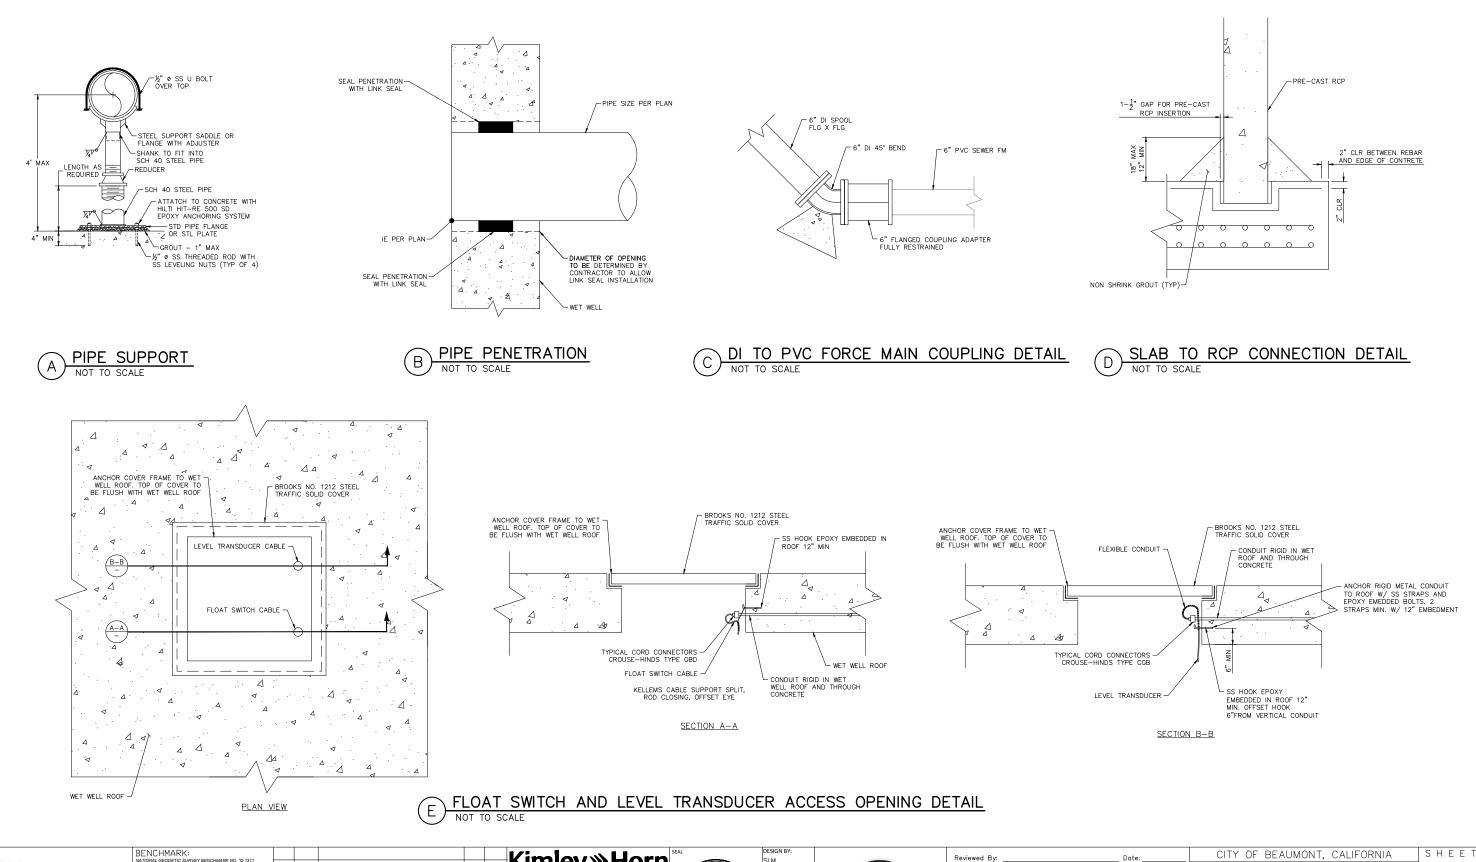

Plotted By/Wuelfrer, Sam Shreet Sett BEAUM

1.4 MILES WEST OF BEQUINOTT ON INTESTATE TO TO 35 DITHINE

IMEGITED CONTON MARE PROTITAGE ROAD ORS DUTHINE

FRONTAGE ROAD, SOUTH ACROSS THE ROAD FROM ACRO

POLE 229, FETE SOUTH OF THE CENTERINE OF PROTITAGE

POLE 239, FETE SOUTH OF THE CENTERINE OF PROTITAGE

POLE 239, FETE SOUTH OF THE CENTERINE OF PROTITAGE

OF A WITHINS POST, INSIDE A HICH POP PIEW WITH

SOCREW PULC 1 INCH ABOVE GROUND (ELEVATION –
2468.07), USD SIGNAD ON THEOMY OF J POPIEWO IS

AND IDENTIFIED THEREON AS 3500 BBM DASAFA WHEREON

AND IDENTIFIED THEREON AS 3500 BBM DASAFA WHEREON

A MEASURED ELEVATION – 2468.07, USD HEREON.

ELEV. 2468.07, INVO 280, STAMPED Q 1311 15

Kimley >>> Horn


401 B Street, Suite 600, San Diego, CA 92101
Phone: (619) 234—9411
WWW.KIMLEY-HORN.COM

BY MARK DESCRIPTION APPR. DATE
ENGINEER R E V I S I O N S

CITY R.C.E. 61788

SAM L. MCWHORTER 8/23/2021





Reviewed By:Staff Engineer	Date:	_
Recommended for Approval By:Administrative Engineer	Date:	_
Approved By:City Engineer/Director of Public Works	Date:	_
CITY OF BEAUMONT, PUBLIC WORKS DEPARTMEN	Т	Par


IMPROVEMENT PLANS FOR:


BEAUMONT CROSSROADS


LIFT STATION

DETAILS

OF 38 SHEETS
FILE NO:
3387

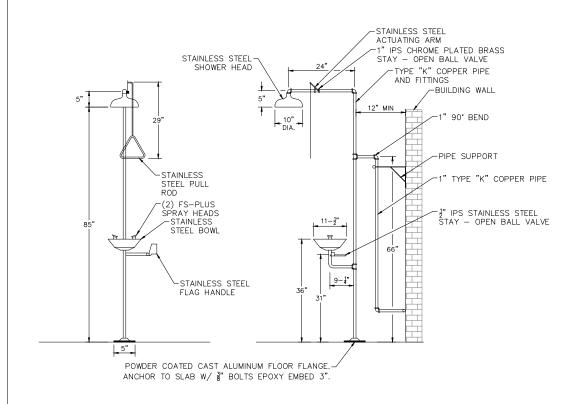


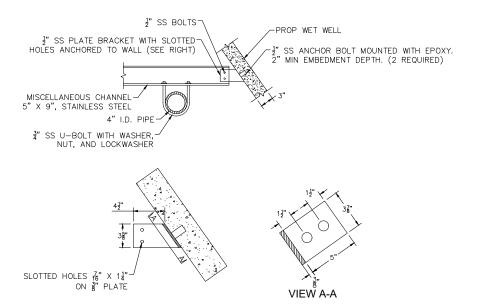


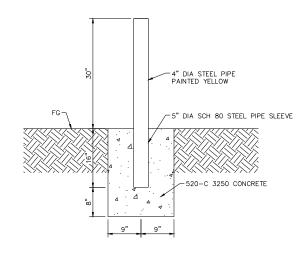

### COMBINATION EMERGENCY EYE WASH AND SHOWER STATION

### STAINLESS STEEL SUPPORT

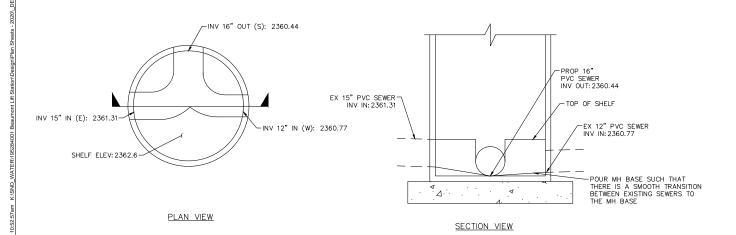




#### NOTES:

FULL LENGTH INSULATING SLEEVES REQUIRED AT ALL THRU-FLANGE BOLTS OR STUDS. INSULATING SLEEVES MUST EXTEND THROUGH THE RESTRAINING FLANGE, BOTH PIPE FLANGES, THE INSULATING GASKET, AND TWO INSULATING WASHERS.

### **BOLLARD SECTION DETAIL**

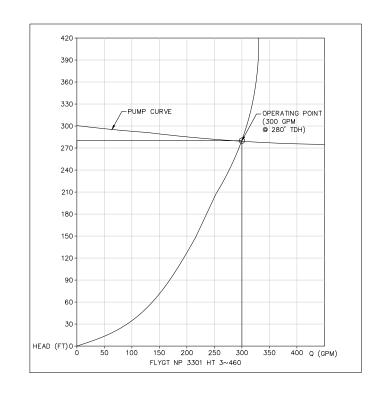


### PROPOSED MANHOLE SHELF

INSULATING FLANGE KIT NOT TO SCALE


## PUMP CURVE

DIGALERT  Call 2 Working Days  Before You Dig!  811	
811	

BENCHMARK: NATIONAL GEODETIC SURVEY BENCHMARK NO. "Q 1311
1.4 MILES WEST OF BEAUMONT ON INTERSTATE 10 TO SAN TIMEDICE CANYON NEAR FRONTAGE ROAD ON SOUTH(WEST) SIDE OF INTERSTATE 10, 0.1 MILES SOUTHEAST ALONG FRONTAGE ROAD, SOUTH ACROSS THE ROAD FROM A GUY POLE 2.5. PEET SOUTH OF THE CENTERURE OF FRONTAGE
ROAD, 1.8 FEET WEST OF POWERPOLE AND 1.5 FEET EAST OF A WITNESS POST, INSIDE A 4 INCH PVC PIPE WITH SCREW PLUG 1 INCH ABOVE GROUND (ELEVATION = 2468.07). ALSO SHOWN ON "HIGHWAY 60 / POTRERO BLVD.
INTERCHANCE STATIC GPS PROJECT CONTROL DIAGRAM* AND IDENTIFIED THEREON AS 3508 BM DX3474 WHEREIN THE PUBLISHED ELEVATION = 2468.07 IS CORRECTED WITH A MEASURED ELEVATION = 2468.01, USED HEREON. ELEV. 2468.01, (NVD '88), (STAMPED Q 1311 1978)










	R
AUMO	R
4	A
RNIA 8, 1912	C


Reviewed By: Staff Engineer Date:  Recommended for Approval By: Administrative Engineer Date:  Approved By: Date:  City Engineer/Director of Public Works  CITY OF BEAUMONT, PUBLIC WORKS DEPARTMENT Beaumont, CA 92232			
for Approval By:	Reviewed By:Staff Engineer	Date:	
City Engineer/Director of Public Works  CITY OF BEAUMONT, PUBLIC WORKS DEPARTMENT ENGINEERING PUMSION Beaumont, CA 9223	for Approval By:	_ Date:	Е
ENGINEERING DIVISION Begumont, CA 92223	Approved By:City Engineer/Director of Public Works	_ Date:	
TEL: (951) 769-8520 FAX: (951) 769-8526	ENGINEERING DIVISION	T 550E. 6th St Beaumont, CA 92223 769-8520 FAX: (951) 769-8526	

	CITY OF BEAUMONT, CALIFORNIA	SHEET
	IMPROVEMENT PLANS FOR:	111
_	BEAUMONT CROSSROADS	OF 38 SHEETS
_	LIFT STATION	FILE NO: 3387
St	DETAILS	

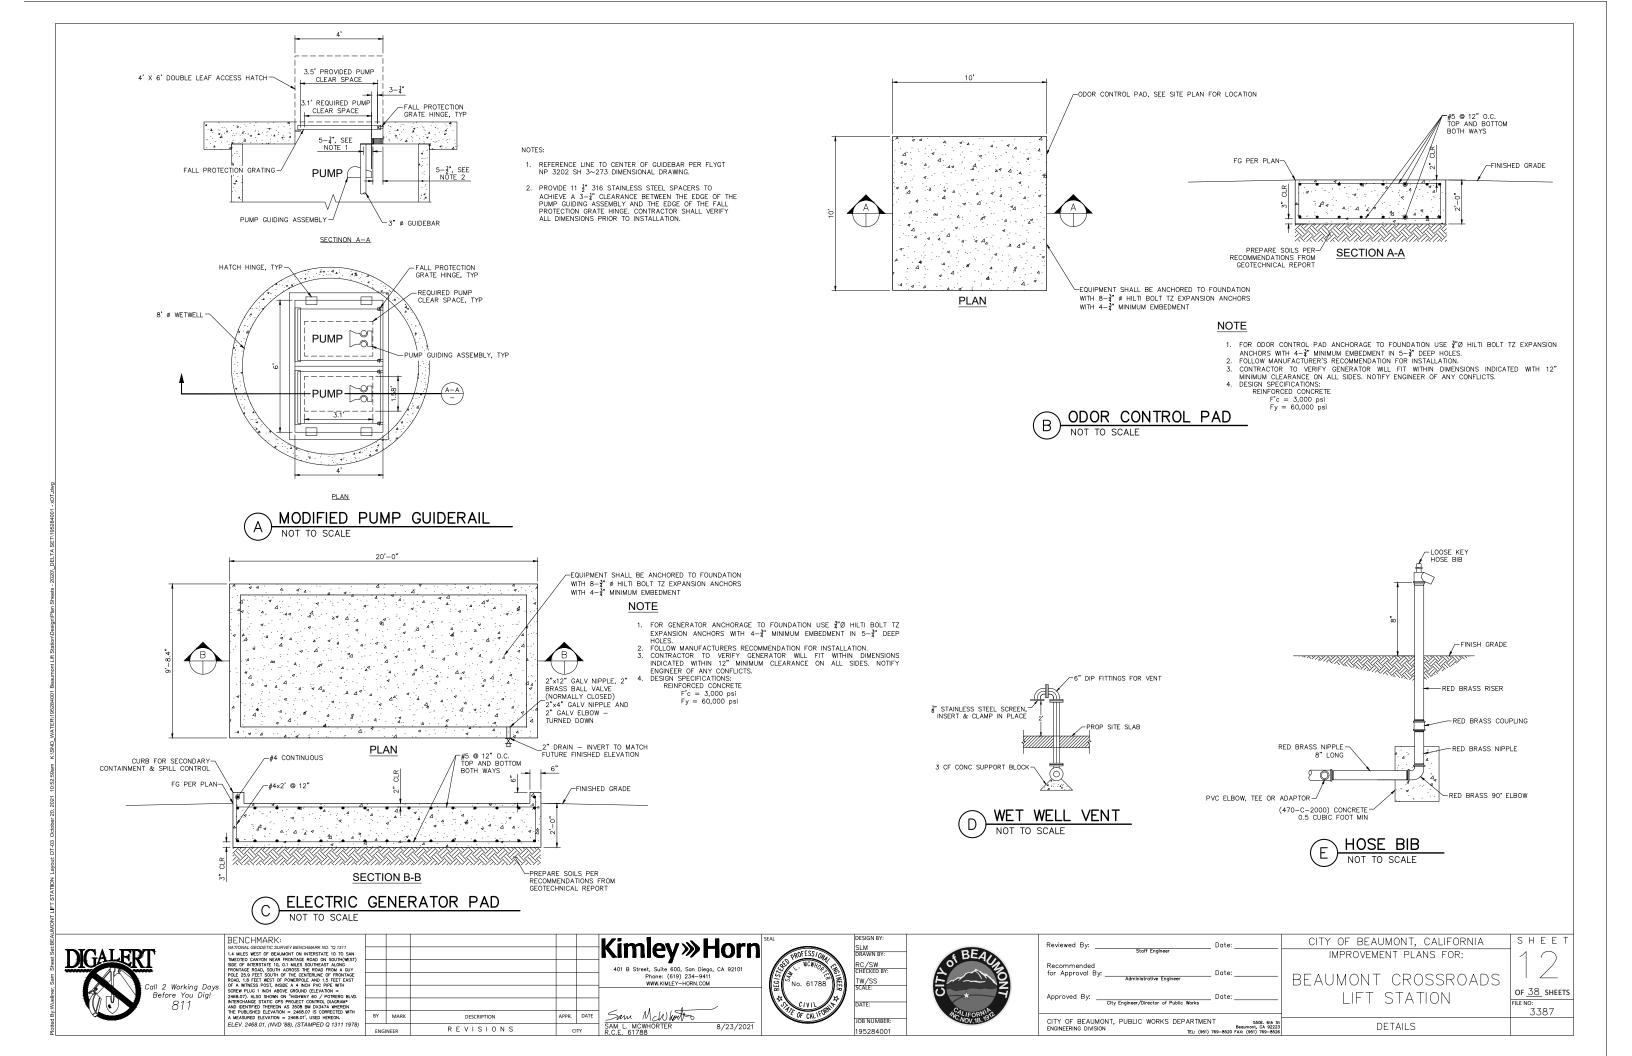













CHEMICAL FEED PORT
SCALE: 1" = 1'

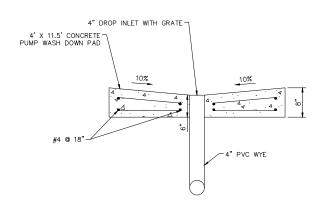

PUMP WASH DOWN PAD SCALE: 1" = 1'



BEAUMONT ON INTERSTATE 10 TO SAN	
NEAR FRONTAGE ROAD ON SOUTH(WEST)	_
E 10, 0.1 MILES SOUTHEAST ALONG OUTH ACROSS THE ROAD FROM A GUY	
OUTH OF THE CENTERLINE OF FRONTAGE	-
ST OF POWERPOLE AND 1.5 FEET EAST	
T, INSIDE A 4 INCH PVC PIPE WITH	
H ABOVE GROUND (ELEVATION =	
OWN ON "HIGHWAY 60 / POTRERO BLVD.	-
IC GPS PROJECT CONTROL DIAGRAM*	
REON AS 3508 BM DX3474 WHEREIN EVATION = 2468.07 IS CORRECTED WITH	_
TION = 2468.01', USED HEREON.	
'NVD '88), (STAMPED Q 1311 1978)	$\overline{}$

						Vimlow Uorn	S
)						Kimley»Horn	
•						401 B Street, Suite 600, San Diego, CA 92101	
						Phone: (619) 234-9411 WWW.KIMLEY-HORN.COM	
<b>o</b> .							
	BY	MARK	DESCRIPTION	APPR.	DATE	Sam McWhotto	
8)	ENGI	INEER	REVISIONS	CI	ITY	SAM L. MCWHORTER 8/23/2021 R.C.E. 61788	







Reviewed By: Date	e: CI -
Recommended for Approval By: Date	:  BEA
Approved By: Date	s:
CITY OF BEAUMONT, PUBLIC WORKS DEPARTMENT	550E. 6th St
ENGINEERING DIVISION	Beaumont, CA 92223 to FAX: (951) 769-8526

CITY OF BEAUMONT, CALIFORNIA SHEET IMPROVEMENT PLANS FOR: AUMONT CROSSROADS OF <u>38</u> SHEETS
FILE NO:
3387 LIFT STATION DETAILS

### **ELECTRICAL SYMBOLS** SINGLE LINE DIAGRAMS CONTROL WIRING DIAGRAMS NORMALLY NORMALLY DEVICE OPEN CLOSED A AMMETER CONDUIT RUN CONCEALED UNDER SLAB OR BELOW GRADE (CONCEALED IN SLAB WHERE SO NOTED OR WHERE ALLOWED PER SPECIFICATIONS). $\vee$ VOLTMETER CONDUIT RUN EXPOSED UNLESS OTHERWISE NOTED → → CONTACT (M)METER — EXISTING CONDUIT RUN 0 0 TO LIMIT SWITCH ----- GROUND WIRE (kwh) KILOWATT HOUR METER LIMIT SWITCH HELD CLOSED √6 OCONDUIT UP (OUT TOP OF EQUIPMENT) AS AMMETER SWITCH - CONDUIT DOWN (OUT BOTTOM OF EQUIPMENT) O LIMIT SWITCH HELD OPEN - — → CONDUIT STUBBED OUT AND CAPPED VOLTMETER SWITCH O O PRESSURE OR VACUUM SWITCH LIGHTING FIXTURE MOUNTED ON POLE OR POST OR ABOVE **--**-< **X** CEILING MOUNTED LIGHTING FIXTURE O O LIQUID LEVEL SWITCH GROUND FAULT PROTECTION BRACKET MOUNTED LIGHTING FIXTURE TEMPERATURE ACTUATED SWITCH $-\infty$ $\triangleleft$ FLOODLIGH" CURRENT TRANSFORMER LED STRIP 4' LIGHTING FIXTURE O O TO FLOW SWITCH (AIR, WATER, ETC.) POTENTIAL TRANSFORMER O- POLE MOUNTED LIGHT FIXTURE POWER TRANSFORMER SEE NOTE 1. PUSH BUTTON SINGLE CIRCUIT MOMENTARY CONTACT. RECESSED INCANDESCENT OR MERCURY VAPOR LIGHTING FIXTURE CONTROL TRANSFORMER SEE NOTE 2. PUSH BUTTON SINGLE CIRCUIT LOCK-OUT(LOCATED AT MOTOR UNLESS LIGHTING FIXTURES CONNECTED TO EMERGENCY CIRCUITS LIGHTING FIXTURE TYPE A, 100 WATTS, WITH 1 LAMP. SEE ■ DRAW OUT TYPE EQUIPMENT OTHERWISE NOTED) LIGHTING FIXTURE SCHEDULE TIMED CONTACT— CONTACT ACTION RELAY ON ENERGIZATION. - DRAW OUT TYPE HIGH VOLTAGE MOTOR \$ SINGLE POLE, SINGLE THROW TOGGLE SWITCH STARTER 0 0 0 TIMED CONTACT- CONTACT ACTION PLUG-IN TYPE EQUIPMENT \$2 DOUBLE POLE, SINGLE THROW TOGGLE SWITCH RELAY ON DE-ENERGIZATION. AT +48" CIRCUIT BREAKER, 3 POLE UNLESS OTHERWISE THREE-WAY TOGGLE SWITCH \$з A-24 \_ o ON-OFF SWITCH. \$4 DISCONNECT SWITCH, 3 POLE UNLESS OTHERWISE INDICATED EMERGENCY STOP PUSH BUTTON MANUAL MOTOR STARTER \$м (MAINTAINED CONTACT) OUTLETS SHOWN WITH SUBSCRIPT "a" ADJACENT TO THEM SHALL BE CONTROLLED BY S $\ensuremath{\mathtt{a}}$ \_&\_ OIL FUSE CUTOUTS STOP L O STOP -START PUSH-BUTTON STATION (MAINTAINED CONTACTS). START مله $-\Box$ FUSE SEE NOTE 3. DUPLEX CONVENIENCE RECEPTACLE AT +12" OR AS NOTED SINGLE CONVENIENCE RECEPTACLE AT +12" OR AS NOTED $\ominus$ TRANSFER SWITCH, AUTOMATIC SPECIAL PURPOSE RECEPTACLE AT +12" OR AS NOTED, RATING MAGNETIC MOTOR STARTER."1" INDICATES SIZE HAND-OFF-AUTO SELECTOR SWITCH SEE SIZE 1 1. RV INDICATES REDUCED VOLTAGE. 2S INDICATES 2 SPEED. R INDICATES REVERSING. NOTE 3. (THREE POSITION). JUNCTION BOX, SIZE AS REQUIRED BY CODE THERMOSTAT OUTLET AT +54" \_o⁻\_ō MAGNETIC CONTACTOR CLOCK OUTLET AT +7'-6" OR AS NOTED CONDUIT NUMBER 12. SEE CONDUIT AND WIRING SCHEDULE FOR SIZES AND QUANTITIES OF TELEPHONE OUTLET AT +12" OR AS NOTED TWO POSITION SELECTOR SWITCH SEE TELEPHONE FLOOR OUTLET CONDUIT AND WIRES. GROUNE PILOT LIGHT, Y=YELLOW, R=RED, A=AMBER, SEE NOTE 3. B=BLUE, W=WHITE, G=GREEN. Р CONTROL DEVICE -<del>0</del>R9-—\_к KIRK KEY INTERLOCKING OF EQUIPMENT P = PRESSURE SWITCH ZS = LIMIT SWITCH L = LEVEL SWITCH V = CONTROL VALVE EQUIPMENT FURNISHED, INSTALLED AND CONNECTED UNDER ANOTHER SECTION OF THE CONTRACT. BELL CONTROL STATION: PUSH-BUTTON STATION OR SELECTOR SWITCH. SEE CONTROL WIRING DIAGRAMS FOR REQUIREMENTS. HORN OR SIREN ← PFR PHASE FAILURE RELAY (CR) CONTROL RELAY ,(м)′ EXISTING MOTOR ⊱ SA I SURGE ARRESTER (м) NEW MOTOR STARTER COIL. EXISTING MOTOR (HP SHOWN) TIME DELAY RELAY. (0-30 SECONDS UNLESS OTHERWISE NOTED). (TDR) FUTURE MOTOR NEW MOTOR (ESTIMATED HP SHOWN) OL'S MOTOR STARTER OVERLOAD RELAY GROUND WELL $\otimes$ GROUND ROD $\mathcal{W}$ FUTURE MOTOR (ESTIMATED HP SHOWN) CONTROL TRANSFORMER. SEE NOTES 2 DISCONNECT SWITCH. SEE SINGLE LINE DIAGRAM FOR SIZE. MANUAL MOTOR STARTER EYS SEAL LIGHTING PANEL. SURFACE MOUNTED. SOLENOID OPERATED CONTROL VALVE SWITCHBOARD, DISTRIBUTION PANEL OR MOTOR CONTROL CENTER 120 VOLT, 1 PHASE, MOTOR (UNLESS OTHERWISE NOTED) CONDUIT NUMBER 12. SEE CONDUIT AND WIRING SCHEDULE FOR SIZES AND QUANTITIES OF CONDUIT AND WIRES. NOTES: (ELECTRICAL SYMBOLS) RUNNING TIME METER. (ELAPSED TIME RTM INDICATES HEIGHT FROM FINISHED FLOOR OR GRADE TO METER) POWER TRANSFORMERS SHALL BE DRY TYPE CENTERLINE OF DEVICE. SPACE HEATERS. (LOCATED AT MOTOR 480-208Y/120 VOLTS, 3 PHASE 4 WIRE UNLESS INDICATES TO REFER TO NOTE (1) ON DRAWING OTHERWISE INDICATED. UNLESS OTHERWISE NOTED). W.P. WEATHERPROOF. PROVIDE GASKETS AS REQUIRED 2. CONTROL TRANSFORMER SHALL BF DRY TYPE TERMINALS IN MOTOR CONTROL CONTROL TRANSFORMER STALL BE DRT 1TPE 480-120 VOLTS 1 PHASE UNLESS OTHERWISE INDICATED. SEE CONTROL WIRING DIAGRAMS FOR USE OF 120 VOLT CONTROL CIRCUITS CONTROL CENTER/MCP CONTACT OR DEVICE REMOTE FROM CONDUIT ONLY C.O. INSTRUMENTATION DEVICE. SEE PROCESS AND INSTRUMENTATION DRAWINGS FOR DESCRIPTIONS. MOTOR CONTROL CENTER/MCP TRANSFORMERS SHALL BE SIZED TO HANDLE THE LOADS OF ALL RELAYS, PILOT LIGHTS, ETC. CONNECTED THERE TO PLUS 50 VA EXTRA CAPACITY. TERMINALS IN MOTOR CONTROL CENTER/MCP CONTACT IN MOTOR CONTROL CENTER FOR CONNECTION TO REMOTE PULL BOX (SIZE AS REQUIRED) OUTPUT TERMINAL 3. LOCATED IN OR ON MOTOR CONTROL CENTER UNLESS OTHERWISE INDICATED. INPUT TERMINAL DEVICE SIGNAL OUTPUT $\oplus$ DEVICE SIGNAL INPUT **Kimley Morn** 401 B Street, Suite 600, San Diego, CA 9210 Phone: (619) 234-9411

# **ABBREVIATIONS**

AMP AMPERE	HZ HERTZ (CYCLES PER SECOND)	O & M OPERATIONS AND MAINTENAM
AL ALUMINUM	IC INTERRUPTING CAPACITY	P POLE
AT AMP TIP	JB JUNCTION BOX	PG&E PACIFIC GAS AND ELECTRIC
ATS AUTOMATIC TRANSFER SWITCH	KV KILOVOLTS	PLC PROGRAMMABLE LOGIC CONTROL
AWG AMERICAN WIRE GAUGE	LB ELBOW	PNL PANEL
B.C. BARE COPPER	LCL LONG CONTINUOUS LOAD	PR PAIR
BRK BREAKER	LSH LEVEL SWITCH HIGH	PVC POLYVINYL CHLORIDE
CAT CATALOG	LSHH LEVEL SWITCH HIGH HIGH	R RADIUS
CIRC.MIL CIRCULAR MILS (AWG)	LSL LEVEL SWITCH LOW	REC RECEPTACLE
CLR CLEARANCE	LSLL LEVEL SWITCH LOW LOW	RGS RIGID GALVANIZED STEEL
C.O. CONDUIT ONLY	LTG LIGHTING	RMS ROOT MEAN SQUARE
CKT CIRCUIT	MA MILLIAMPERE	R/W RIGHT OF WAY
CP CONTROL PANEL	MAX MAXIMUM	SCHED SCHEDULE
CU CONDENSER UNIT	MCC MOTOR CONTROL CENTER	SES SERVICE ENTRANCE SECTION
DIA DIAMETER	MCP MAIN CONTROL PANEL	SPECS SPECIFICATIONS
DWG DRAWING	MCM THOUSAND CIRCULAR MIL (AWG)	SQ SQUARE
EA EACH	MFR MANUFACTURER	SSS SOLID STATE STARTER
ELECT ELECTRICAL	MIN MINIMUM	STD STANDARD
ELEV ELEVATION	MIS MISCELLANEOUS	T THICK
EXIST EXISTING	MPZ MINI POWER ZONE	TB TERMINAL BLOCK
FLA FULL LOAD AMPS	MTG MOUNTING	TEL TELEPHONE
FUT FUTURE	MV MERCURY VAPOR	TDR TIME DELAY RELAY
GFCI GROUND FAULT CIRCUIT INTERRUPTER	N.C. NORMALLY CLOSED	TTB TELEPHONE TERMINAL BACKBOA
GND GROUND	NEC NATIONAL ELECTRICAL CODE	TYP TYPICAL
HOA HANDS-OFF-AUTO	N.O. NORMALLY OPEN	UCP UNIT CONTROL PANEL
HP HORSEPOWER	NO. NUMBER	UG UNDERGROUND
HPS HIGH PRESSURE SODIUM	O.C. ON CENTER	U.L. UNDERWRITERS LABORATORY

# GENERAL ELECTRICAL REQUIREMENTS

- 1. THE COMPLETED INSTALLATION SHALL CONFORM TO ALL APPLICABLE FEDERAL, STATE AND LOCAL CODE ORDINANCES AND REGULATIONS. CONTRACTOR SHALL OBTAIN NECESSARY PERMITS AND INSPECTIONS REQUIRED BY THE AUTHORITIES HAVING JURISDICTION. ALL WORK SHALL BE DONE IN A NEAT, WORKMANLIKE, FINISHED AND SAFE MANNER, ACCORDING TO THE LATEST PUBLISHED N.E.C.A. STANDARDS OF INSTALLATION, UNDER COMPETENT SUPERVISION. INSTALL GROUNDING AS REQUIRED BY THE CODE(S).
- 2. VISIT THE SITE PRIOR TO BIDDING TO BECOME FAMILIAR WITH EXISTING CONDITIONS AND ALL OTHER FACTORS WHICH MAY AFFECT THE EXECUTION OF THIS WORK. INCLUDE ALL RELATED COSTS IN THE INITIAL BID PROPOSAL.
- 3. ALL MATERIALS SHALL BE NEW AND OF THE BEST QUALITY, MANUFACTURED IN ACCORDANCE WITH NEMA, ANSI, U.L. OR OTHER APPLICABLE STANDARDS. THE USE OF MANUFACTURER'S NAMES, MODELS, AND NUMBERS IS INTENDED TO ESTABLISH STYLE, QUALITY, APPEARANCE, USEFULNESS AND BID PRICE. PROPOSED SUBSTITUTIONS SHALL BE SUBMITTED IN WRITING AND REVIEWED BY THE ENGINEER BEFORE ORDERING.
- 4. PROTECT ALL ELECTRICAL MATERIAL AND EQUIPMENT INSTALLED UNDER DIVISION 6 AGAINST DAMAGE BY OTHER TRADES, WEATHER CONDITIONS OR ANY OTHER CAUSES. EQUIPMENT FOUND DAMAGED OR IN OTHER THAN NEW CONDITION WILL BE REJECTED AS DEFECTIVE.
- 5. LEAVE THE SITE CLEAN, REMOVE ALL DEBRIS, EMPTY CARTONS, TOOLS, CONDUIT, WIRE SCRAPS AND ALL MISCELLANEOUS SPARE EQUIPMENT AND MATERIALS USED IN THE WORK DURING CONSTRUCTION. ALL COMPONENTS SHALL BE FREE OF DUST, GRIT AND FOREIGN MATERIALS, LEFT AS NEW BEFORE FINAL ACCEPTANCE OF WORK.
- 6. CIRCUIT CONDUCTORS #2 AWG OR SMALLER TO BE COPPER TYPE "XHHW" FOR BELOW GRADE INSTALLATION OR COPPER TYPE THHN/THWN FOR ABOVE GRADE INSTALLATIONS.
  #1 AWG OR LARGER SHALL BE COPPER TYPE "XHHW-2" STRANDED COPPER. MINIMUM CONDUCTOR SIZE TO BE #12 AWG WITH #12 GND.
- 7. UNDERGROUND CONDUITS TO BE SCHEDULE 40 PVC. MINIMUM DEPTH 30", MINIMUM SIZE 1", UNLESS OTHERWISE SHOWN ON THE PLANS. CONDUITS AS SHOWN ARE FOR INFORMATION ONLY. EXACT CONDUIT ROUTING SHALL BE DETERMINED IN THE FIELD BY THE CONTRACTOR.
- 8. OUTDOOR CONDUITS EXPOSED TO BE GALVANIZED RIGID STEEL, MINIMUM SIZE 3/4", UNLESS OTHERWISE NOTED ON THE PLANS. GRS CONDUIT SHALL EXTEND BELOW GRADE TO THE FIRST ELBOW. ALL RGS CONDUIT EXPOSED TO EARTH SHALL BE HALF LAPPED WRAPPED IN SCOTCHRAP 50 10 MIL TAPE OR EQUAL. EXTEND WRAP TO A HEIGHT OF 12" ABOVE GRADE. INDOOR CONDUITS SHALL BE IMC OR EMT UNLESS OTHERWISE SHOWN ON PLAN.
- 9. ALL SAFETY SWITCHES AND OTHER DISTRIBUTION AND CONTROL ELECTRICAL EQUIPMENT SHALL BE U.L. LISTED AND RATED FOR HEAVY DUTY SERVICE.
- 10. ALL WIRING DEVICES SHALL BE SPECIFICATION GRADE.
- 11. ALL ELECTRICAL EQUIPMENT, CONDUIT, WIRING, BOXES, ETC. SHALL BE SUBMITTED TO THE ENGINEER FOR REVIEW PRIOR TO ORDERING. THE SUBMITTALS SHALL BE NEATLY GROUPED AND ORGANIZED. PERTINENT INFORMATION SHALL BE HIGHLIGHTED, AND THE SPECIFIC PRODUCT SHALL BE IDENTIFIED. ALL SUBMITTALS SHALL BE COMPLETE, AND PRESENTED IN ONE PACKAGE. THE SUBMITTAL SHALL INCLUDE A COMPLETE LIST OF THE EQUIPMENT AND MATERIALS, INCLUDING THE MANUFACTURER'S NAME, PRODUCT SPECIFICATION, DESCRIPTIVE DATA, TECHNICAL LITERATURE, PERFORMANCE CHARTS, CATALOG CUTS, INSTALLATION INSTRUCTIONS, AND SPARE PART RECOMMENDATIONS FOR EACH DIFFERENT ITEM OF THE EQUIPMENT SPECIFIED.
- 12. IT IS THE OBLIGATION OF THE CONTRACTOR TO ORGANIZE HIS WORK, SO THAT A COMPLETE ELECTRICAL, INSTRUMENTATION, AND CONTROL SYSTEM FOR THE FACILITY WILL BE PROVIDED, AND WILL BE SUPPORTED BY ACCURATE SHOP AND RECORD DRAWINGS, AND O & M MANUALS.



APPR. DATE REVISIONS



WWW.KIMLEY-HORN.COM

8/23/2021

me ce

MICHAEL A. COLOMBO







ENGINEERING DIVISION

Reviewed By:Staff Engineer	Date:	
Recommended for Approval By:Administrative Engineer	Date:	BE
Approved By:City Engineer/Director of Public Works	_ Date:	
CITY OF BEAUMONT PUBLIC WORKS DEPARTMEN	JT 550E AH SH	

SHEE CITY OF BEAUMONT, CALIFORNIA IMPROVEMENT PLANS FOR: EAUMONT CROSSROADS LIFT STATION

GENERAL ELECTRICAL NOTES

V VOLTS


WP WEATHERPROO


XFMR TRANSFORMER


VAC VOLT ALTERNATING CURRENT

VFD VARIABLE FREQUENCY DRIVE

of 38 sheets 3387

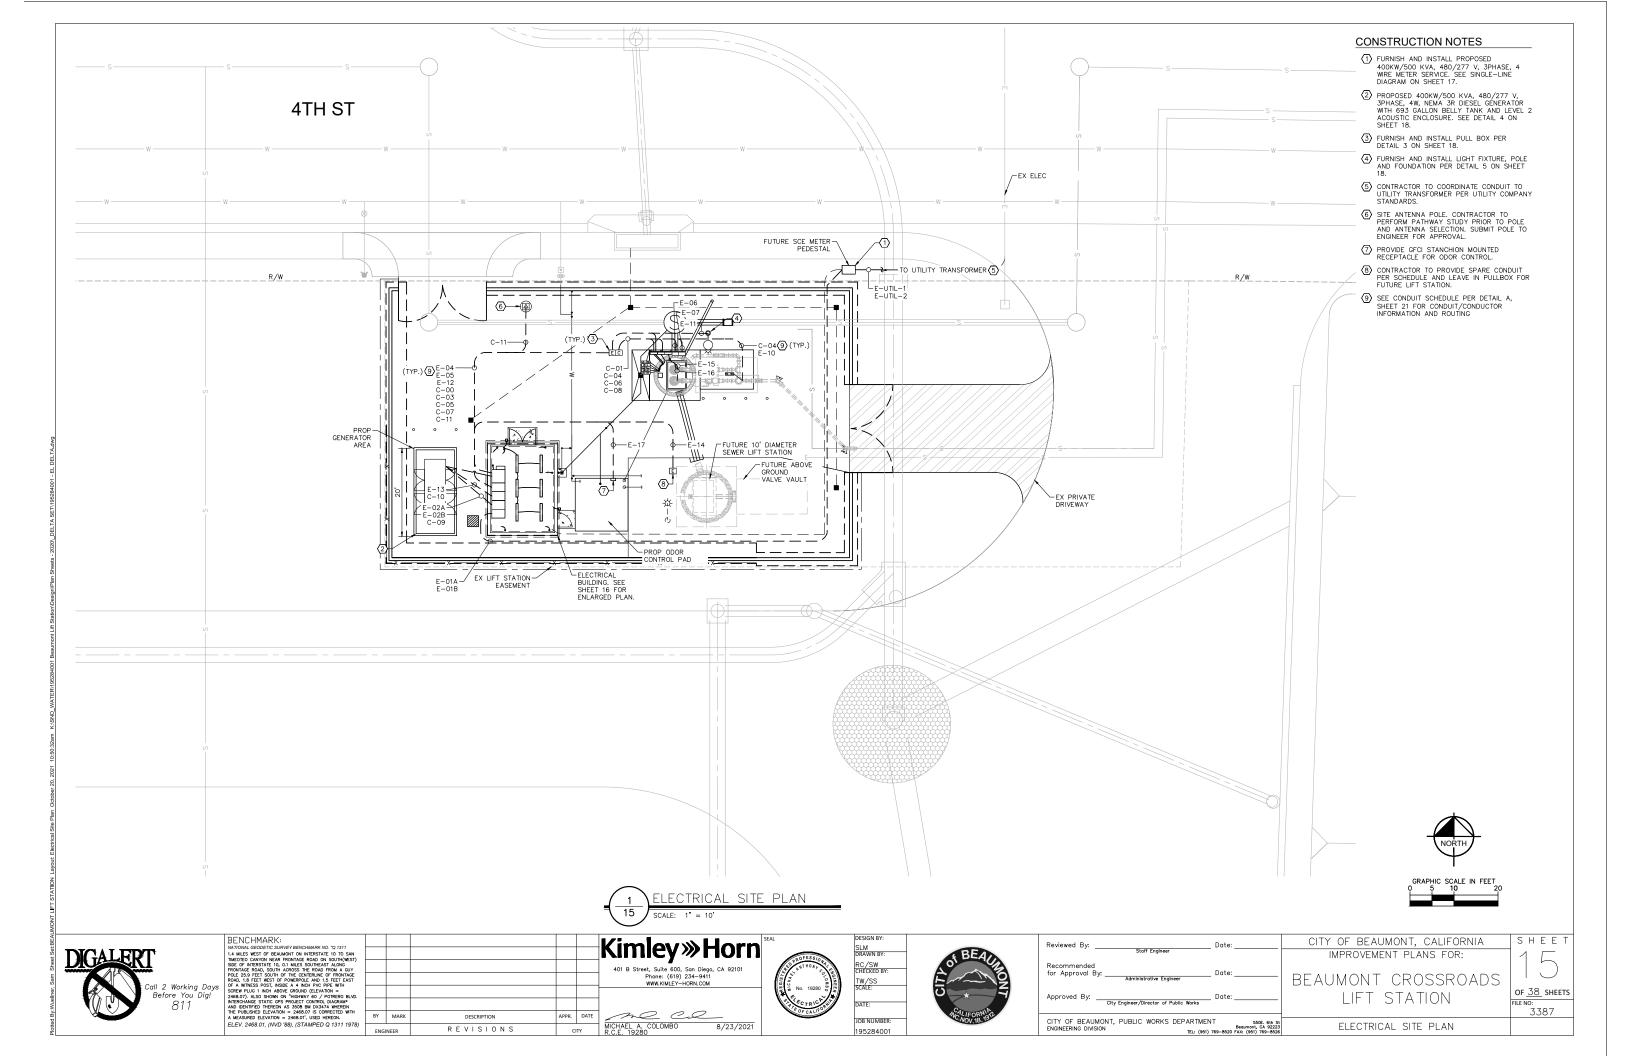

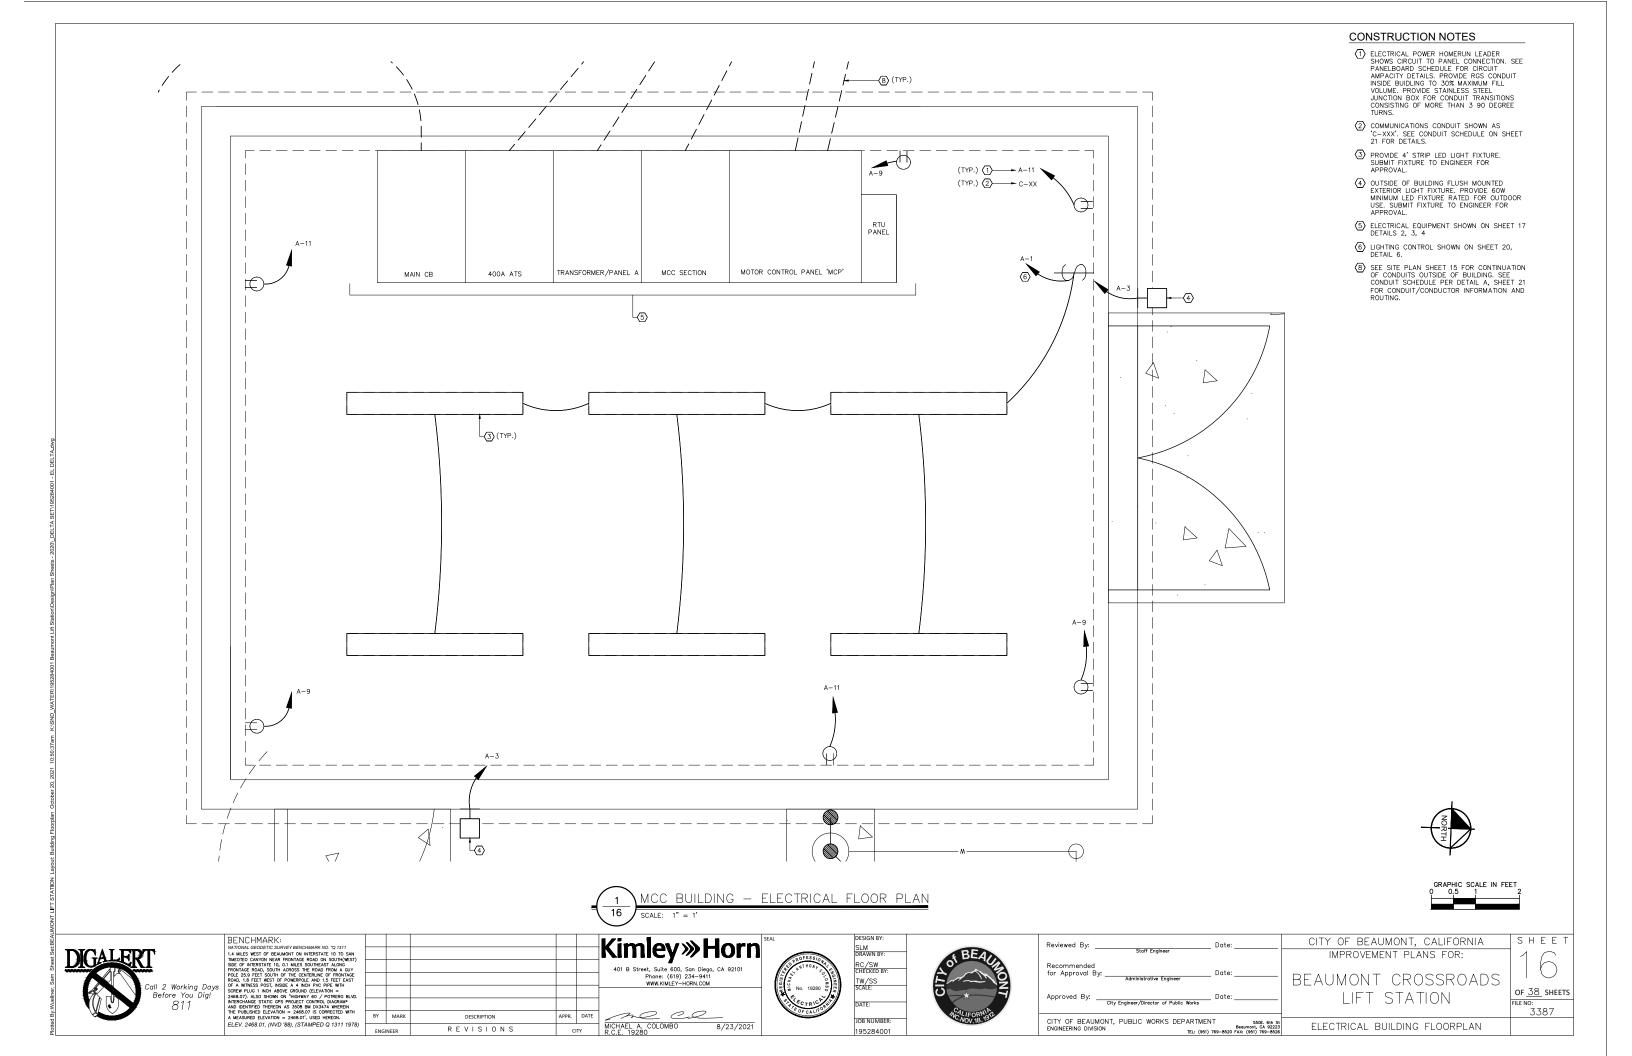

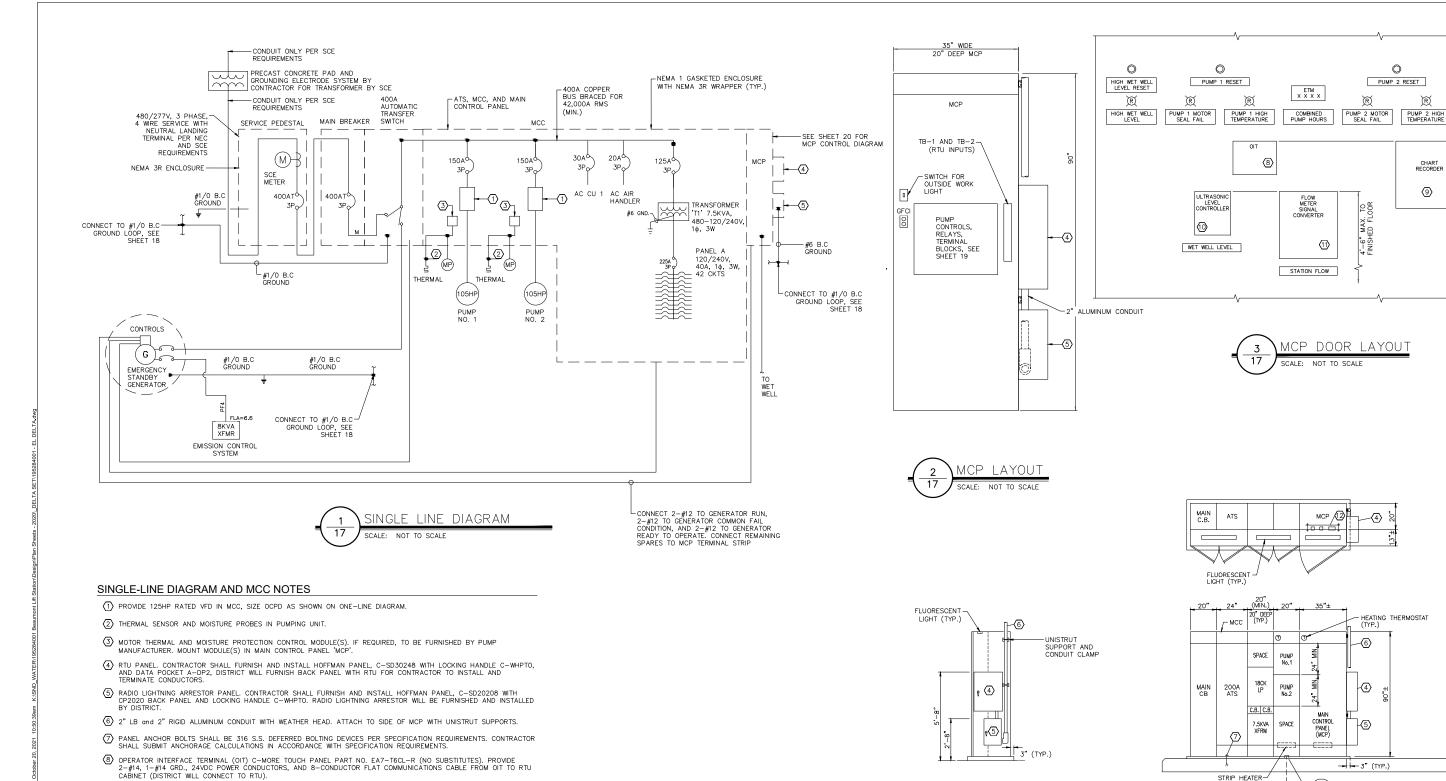

MCC PLAN AND SECTION VIEW



BENCHMARK:

MATOMIA GEORETIC SUPER'S BENCHMARK NO. "0.1311

1.4 MEIS WEST OF BEAUMONT ON INTERSTATE 10 TO SAN

MINICATIO CANNON NARE PROVINCE ROAD ON SOUTHWEST)
SIDE OF INTERSTATE 10, 0.1 MILES SOUTHEAST ALONG

FRONTAGE ROAD, SOUTH ACROSS THE ROAD FROM A GLY

POLL 29. FEET SOUTH OF THE CENTERINE OF PROVINCE

ROAD, 10. BT WEST OF PREMIED AND 15-EET EAST

SCREW PUIG 1 INCH ABOVE GROUND (SELVATION =

1248.07). ALSO SOUND ON "HIGHWAY 60 / POTERO BLYD.

INTERCHANGE STATIC OPS PROJECT CONTROL DIAGRAM

AND IDENTIFED THEEON AS 3008 ON X3474 WHEEN

THE PUBLISHED ELEVATION = 2488.07) IS CORRECTED WITH


A MEASURED LEETATION = 2488.07 IS CORRECTED WITH

ELEV. 2468.01. (INVD '88), (STAMPED Q 1311 1978)

10 FLUSH MOUNT ULTRASONIC CONTROLLER ON MCP DOOR.

PAPERLESS CHART RECORDER. EZTREND QXE, AS MANUFACTURED BY HONEYWELL MODEL TVEZQX-60-000-22 (NO SUBSTITUTES) CHART RECORDER SHALL BE FLUSH MOUNTED TO FACE OF MCP DOOR. CHART RECORDER SHALL ACCEPT A MINIMUM OF FOUR 4-20MA INPUTS AND OPERATE ON 120VAC POWER. CHART RECORDER SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURER'S PRINTED INSTRUCTIONS. SUPPLIER OR CONTACT TRENDVIEW RECORDERS

PLEXIGLASS SHIELD TO COVER BACK OF DOOR MOUNTED DEVICES (LIGHTS, SWITCHES, OIT, ETC.). 1/8" THICK PLEXIGLASS SHIELD WITH 1/4" DIA. S.S. BOLTS AT EACH CORNER OF SHIELD AND SPACERS BETWEEN MCP DOOR AND PLEXIGLASS SHIELD.





8/23/2021





Reviewed By:Staff Engineer	_ Date:	
Recommended for Approval By:Administrative Engineer	_ Date:	BE
Approved By:City Engineer/Director of Public Works	_ Date:	
CITY OF BEAUMONT, PUBLIC WORKS DEPARTMENT ENGINEERING DIVISION	NT 550E. 6th St Beaumont, CA 92223 769-8520 FAX: (951) 769-8526	ELE

CITY OF BEAUMONT, CALIFORNIA SHEE IMPROVEMENT PLANS FOR: EAUMONT CROSSROADS of  $\underline{38}$  sheets LIFT STATION 3387 PARTMENT 550E, 6th 51 TEL: (951) 769-8520 FAX: (951) 769-8520 FAX: (951) 769-8520 ELECTRICAL SINGLE LINE AND SCHEDULES

TYP. ALL SPARE C.O.

 $\bigcirc$ 


HIGH HIGH WET WELL LEVEL RESET


R


HIGH HIGH WET WELL LEVEL

-0" MAX. NISHED FL

R

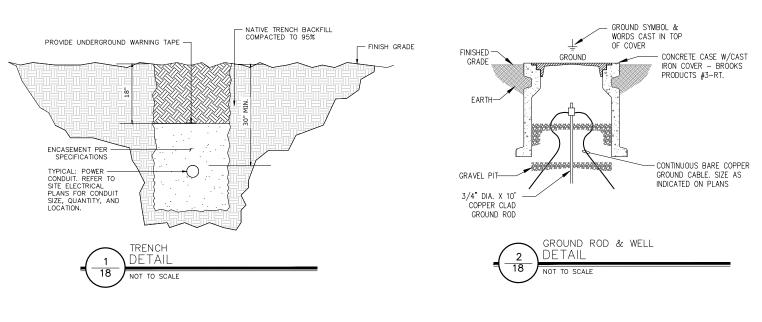


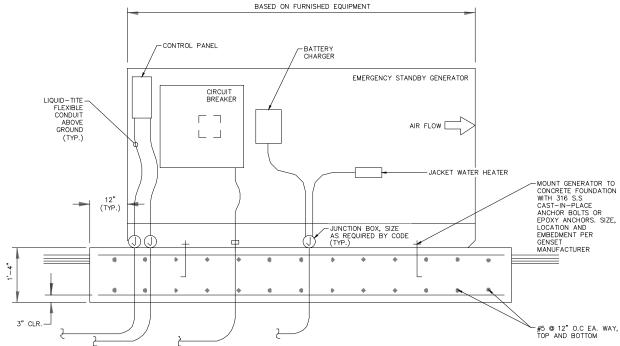



1. COVER SHALL BE RATED FOR H20 LOADING AND SHALL BE MARKED "DANGER - HIGH VOLTAGE - KEEP OUT". LETTERS SHALL BE BLOCK TYPE AND AT LEAST 1/2" IN HEIGHT. COVER SHALL HAVE BOLT DOWN PROVISIONS. BOLT DOWN HARDWARE SHALL BE STAINLESS STEEL.

ELECTRICAL HANDHOLE

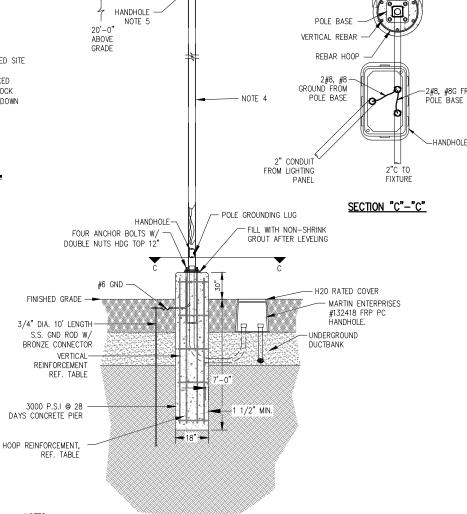

- LITHONIA "PIRH" BI-LEVEL MOTION/AMBIENT SENSOR ON EACH POLE.
- MOTION/AMBIENT SENSOR SHALL UTILIZE 100% DIGITAL PASSIVE INFRARED TECHNOLOGY THAT IS TUNED FOR WALKING-SIZED MOTION WHILE PREVENTING FALSE TRIPPING FROM THE **ENVIRONMENT**
- MOTION/AMBIENT SENSOR SHALL BE PROGRAMMED TO BE FULL-ON AT DUSK AND SHALL RAMP DOWN TO 30% AT 10:00 PM. IF MOTION IS DETECTED, SENSOR SHALL RAMP UP TO FULL POWER IN 3 SECONDS. AFTER MOTION IS NO LONGER DETECTED A 5 MINUTE TIME DELAY BEGINS. WHEN TIME DELAY EXPIRES, LIGHTS RAMP DOWN TO 30% POWER AND WILL REMAIN AT LOW LEVEL SETTING UNTIL NEW MOTION IS DETECTED, AT WHICH POINT THE LUMINARIE RAMPS BACK UP TO 100% POWER. THIS CYCLE REPEATS ONCE THERE IS NO MOTION IN THE SPACE AGAIN. TEST % VERIFY OPERATION AFTER INSTALLATION.
- POLE SHALL BE 4" SQUARE STRAIGHT STEEL RATED @ 100 MPH + 30% GUST FACTOR. POLE AND FIXTURE INSTALLATION SHALL UTILIZE THE SPECIFIED PRODUCTS. SHOULD A CONTRACTOR DESIRE TO SUBSTITUTE AN ALTERNATE LIGHT FIXTURE AND/OR POLE FOR THAT SPECIFIED, PRE-APPROVAL MUST BE GRANTED BY THE CITY AND THE ENGINEER AND A POINT-TO-POINT LIGHTING CALCULATION SHALL BE SUBMITTED FOR REVIEW. THIS DECISION TO ALLOW AN ALTERNATE WILL BE DETERMINED AFTER THE CONTRACT IS AWARDED.

  5. PROVIDE HANDHOLE NEAR TOP OF POLE. MOUNT FUSE BLOCK NEAR UPPER HANDHOLE.



EMERGENCY STANDBY GENERATOR

DESCRIPTION APPR. DATE REVISIONS




401 B Street, Suite 600, San Diego, CA 9210 Phone: (619) 234-9411 WWW.KIMLEY-HORN.COM

ne ce


MICHAEL A. COLOMBO R.C.E. 19280








CITY OF BEAUMONT, CALIFORNIA SHEET IMPROVEMENT PLANS FOR: BEAUMONT CROSSROADS of  $\underline{38}$  sheets LIFT STATION 3387 ELECTRICAL DETAILS 1

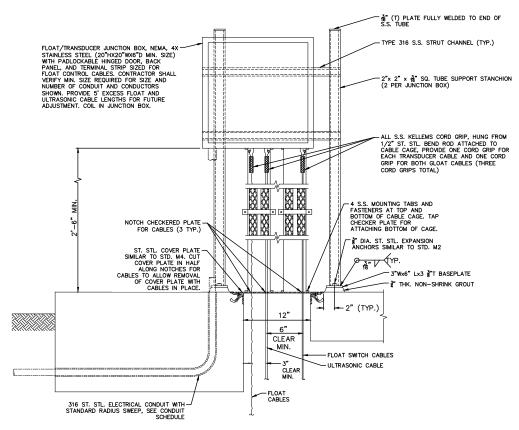

- NOTES:
  1. JUNCTION BOX SUPPORT STANCHIONS SHALL BE CONSTRUCTED OF 316 STAINLESS STEEL.
- CONTRACTOR SHALL SUBMIT SHOP DRAWINGS FOR CABLE CAGE TO THE CITY FOR APPROVAL PRIOR TO FABRICATION.
- 3. WET WELL SHAFT NOT SHOWN FOR CLARITY.
- 4. LEVEL TRANSDUCER CABLE CONTINUOUS TO LEVEL CONTROLLER IN MCP.
- 5. ELECTRICAL PULL BOX NOT SHOWN FOR CLARITY.



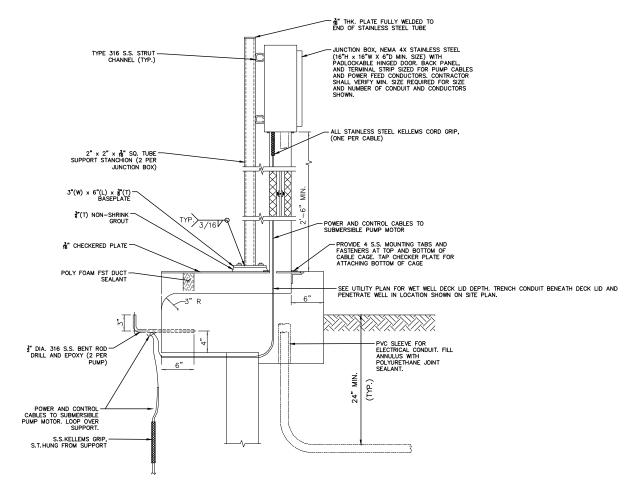


- 1. JUNCTION BOX SUPPORT STANCHIONS SHALL BE CONSTRUCTED OF 316 STAINLESS STEEL
- 2. CONTRACTOR SHALL SUBMIT SHOP DRAWINGS FOR PUMP CABLE CAGE TO THE CITY FOR APPROVAL PRIOR TO FABRICATION.





BENCHMARK:










Reviewed By:Staff Engineer	Date:	(
Recommended for Approval By:Administrative Engineer	Date:	BE
Approved By:City Engineer/Director of Public Works	Date:	
CITY OF BEAUMONT, PUBLIC WORKS DEPARTMEN ENGINEERING DIVISION TEL: (951)	T 550E. 6th St Beaumont, CA 92223 769-8520 FAX: (951) 769-8526	

CITY OF BEAUMONT, CALIFORNIA SHEET IMPROVEMENT PLANS FOR: EAUMONT CROSSROADS of 38 sheets LIFT STATION FILE NO: 3387 ELECTRICAL DETAILS 2

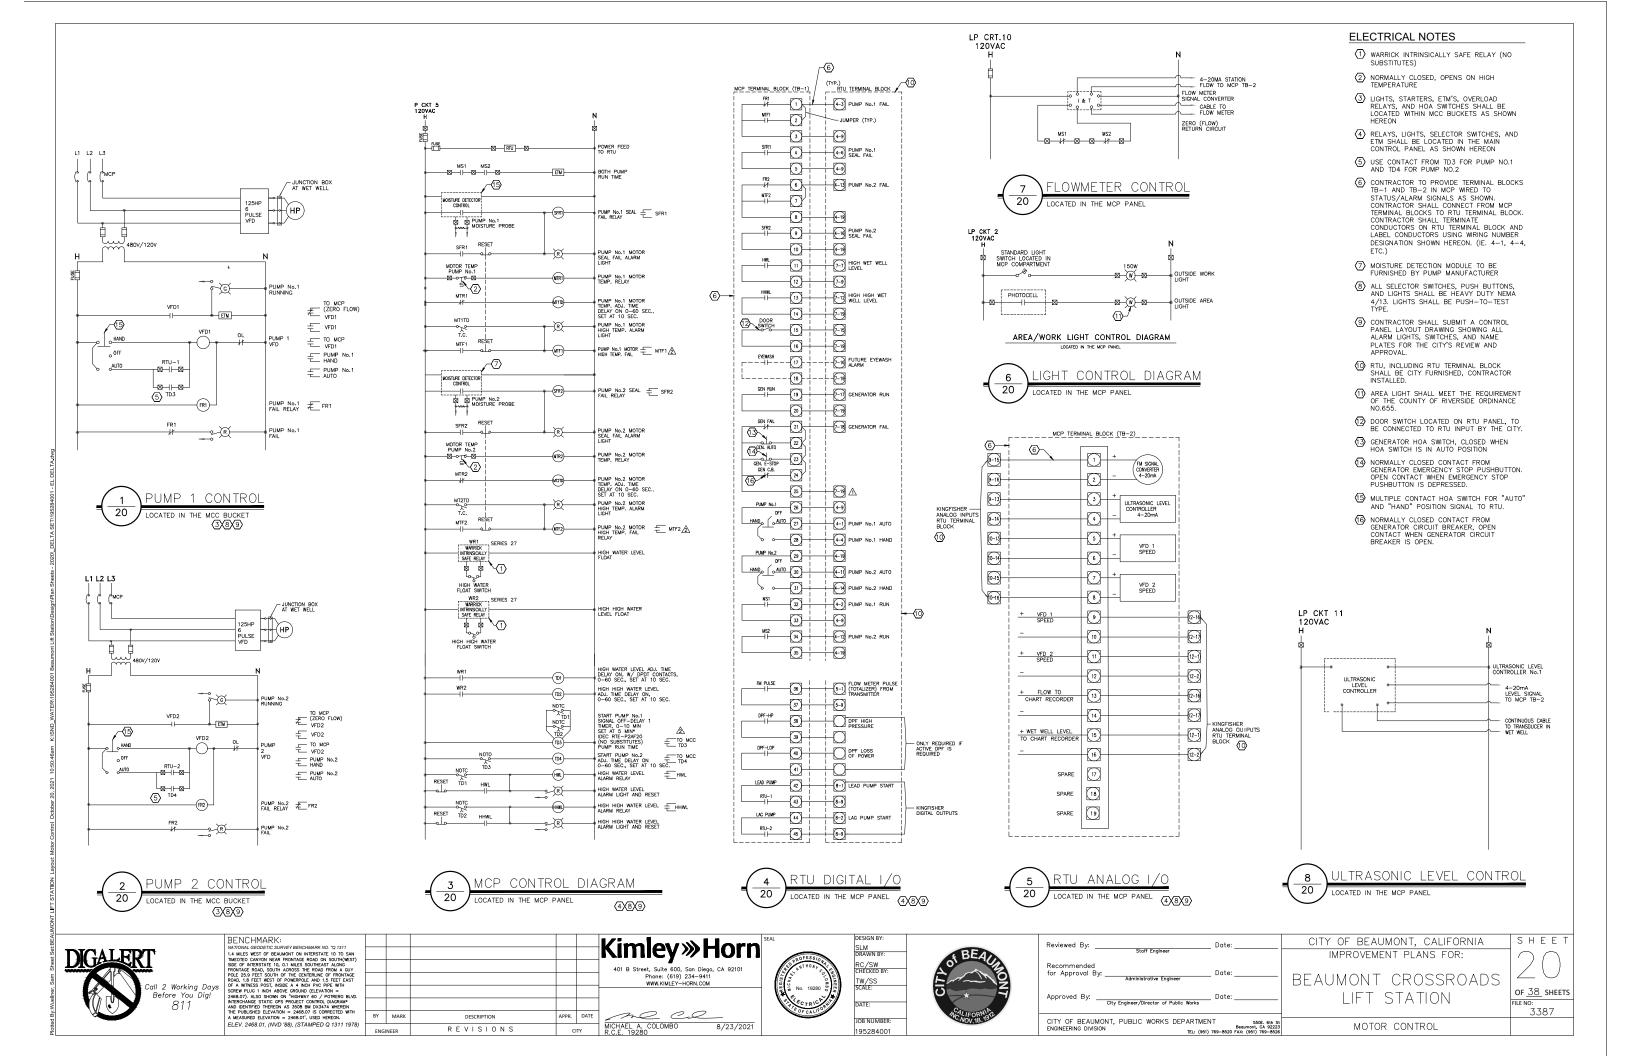

CONDUIT SCHEDULE							
CONDUIT		WIRE		5001	то	DENANDI/G	
NO.	SIZE	TYPE	POWER	GROUND	FROM	10	REMARKS
E-UTIL-1	3"	SCHED 40 PVC UG			UTILITY METER	UTILITY TRANSFORMER	CONTRACTOR TO COORDINATE UTILITY TRANSFORMER LOCATION
E-UTIL-2	3"	SCHED 40 PVC UG			UTILITY METER	UTILITY TRANSFORMER	CONTRACTOR TO COORDINATE UTILITY TRANSFORMER LOCATION
E-01A	2"	SCHED 40 PVC UG	4-#3/0 AWG	1-#4 GND	UTILITY METER	MCC MAIN BREKAER	PARALLEL SET TO ATS
E-01B	2"	SCHED 40 PVC UG	4-#3/0 AWG	1-#4 GND	UTILITY METER	MCC MAIN BREKAER	PARALLEL SET TO ATS
E-02A	2"	SCHED 40 PVC UG	4-#3/0 AWG	1-#4 GND	GENERATOR	ATS	PARALLEL SET TO ATS
E-02B	2"	SCHED 40 PVC UG	4-#3/0 AWG	1-#4 GND	GENERATOR	ATS	PARALLEL SET TO ATS
E-03A		RUN IN WIREWAY	4-#3/0 AWG	1-#4 GND	MCC MAIN BREKAER	ATS	RUN IN WIREWAY
E-03B		RUN IN WIREWAY	4-#3/0 AWG	1-#4 GND	MCC MAIN BREKAER	ATS	RUN IN WIREWAY
E-04	2.5"	SCHED 40 PVC UG	4-#3/0 AWG	1-#6 GND	MCC DISTRIBUTION BOARD	SITE ELECTRICAL PULL BOX	PUMP #1 POWER
E-05	2.5"	SCHED 40 PVC UG	4-#3/0 AWG	1-#6 GND	MCC DISTRIBUTION BOARD	SITE ELECTRICAL PULL BOX	PUMP #2 POWER
E-06	2.5"	SCHED 40 PVC UG	4-#3/0 AWG	1-#6 GND	SITE ELECTRICAL PULL BOX	PUMP #1 200A DISCONNECT	
E-07	2.5"	SCHED 40 PVC UG	4-#3/0 AWG	1-#6 GND	SITE ELECTRICAL PULL BOX	PUMP #2 200A DISCONNECT	
E-08	-	-	-	-	-	-	NOT USED
E-09	-	-	-	-	-	-	NOT USED
E-10	1"	SCHED 40 PVC UG	2-#12 AWG	1-#12 GND	SITE ELECTRICAL PULL BOX	FLOW METER	FLOW METER POWER
E-11	1"	SCHED 40 PVC UG	2-#12 AWG	1-#12 GND	SITE ELECTRICAL PULL BOX	SITE LIGHT	SITE LIGHTING
E-12	1"	RGS AG/SCHED 40 PVC UG	2-#10 AWG	1-#10 GND	PANEL A	SITE ELECTRICAL PULL BOX	FLOW METER POWER
		,	2-#10 AWG				SITE LIGHTING
E-13	1"	RGS AG/SCHED 40 PVC UG	2-#10 AWG	1-#10 GND	PANEL A	GENERATOR	GENERATOR BATTERY CHARGER
		,	2-#10 AWG	2 1120 0110			GENERATOR BLOCK HEATER
E-14	2"	RGS AG/SCHED 40 PVC UG	-	-	MCC DISTRIBUTION BOARD	FUTURE LIFT STATION PULL BOX	SPARE FOR FUTURE USE
E-15	3"	PVC COATED RGS	MFR CABLE		NEMA 4X POWER JB	PUMP #1	PENETRATE WET WELL PER DETAIL 2, SHEET 16.
E-16	3"	PVC COATED RGS	MFR CABLE		NEMA 4X POWER JB	PUMP #2	PENETRATE WET WELL PER DETAIL 2, SHEET 16.
E-17	1"	SCHED 40 PVC UG	2-#12 AWG	1-#12 GND	PANEL A	ODOR CONTROL PAD GFI RECEPTACLE	
C-00	1"	SCHED 40 PVC UG	4-PR #16 AWG		MCP	SITE COMMUNICATIONS PULL BOX	PUMP #1, PUMP #2 LEAK/OVERTEMP
C-01	1"	SCHED 40 PVC UG	4-PR #16 AWG		SITE COMMUNICATIONS PULL BOX	NEMA 4X FLOAT SWITCH JB	PUMP #1, PUMP #2 LEAK/OVERTEMP
C-02	1"	PVC COATED RGS	4-PR #16 AWG		NEMA 4X FLOAT SWITCH JB	NEMA 4X POWER JB	SPLICE MFTR PUMP POWER CABLE
C-03	1"	RGS AG/SCHED 40 PVC UG	MFR CABLE		MCP	SITE COMMUNICATIONS PULL BOX	FLOW METER 4-20Ma INSTANTANEOUS FLOW, TOTAL FLOW PULSE
C-04	1"	SCHED 40 PVC UG/ PVC COATED RGS	MFR CABLE		SITE COMMUNICATIONS PULL BOX	FLOW METER FM-100	FLOW METER 4-20Ma INSTANTANEOUS FLOW, TOTAL FLOW PULSE
C-05	1"	SCHED 40 PVC UG	MFR CABLE		MCP	SITE COMMUNICATIONS PULL BOX	US LEVEL SENSOR LE-100
C-06	1"	SCHED 40 PVC UG	MFR CABLE		SITE COMMUNICATIONS PULL BOX	NEMA 4X US SENSOR JB	US LEVEL SENSOR LE-100
C-07	1"	SCHED 40 PVC UG	8-PR #16 AWG		MCP	SITE COMMUNICATIONS PULL BOX	FLOAT SWITCHES LSLL, LSL, LSH, LSHH
C-08	1"	SCHED 40 PVC UG	8-PR #16 AWG		SITE COMMUNICATIONS PULL BOX	NEMA 4X FLOAT JB	FLOAT SWITCHES LSLL, LSL, LSH, LSHH
C-09	1"	SCHED 40 PVC UG	2-PR #16 AWG		ATS	GENERATOR	2-WIRE GENERATOR START/STOP SIGNAL
C-10	1"	SCHED 40 PVC UG	4-PR #16 AWG		MCP	GENERATOR	GENERATOR RUN, FAIL ALARMS, SPARES

CONDUIT SCHEDULE

PANEL: PANEL A VOLTAGE: 120/240 PHASE, WIRES: 1ø, 3W SCCR (AMPS): 10,000 SOURCE: T-1 PANEL BUS: 40 AMPS MAIN: 40A BREAKER 
 VA
 CB
 CKT
 A
 B
 CKT
 CB
 VA

 240
 20/1
 1
 3.0
 2
 2 20/1
 120

 180
 20/1
 3
 13.2
 4
 20/1
 1400

 180
 20/1
 5
 3.5
 6
 20/1
 240

 240
 20/1
 7
 7.0
 8
 20/1
 600

 720
 20/1
 9
 6.0
 10
 10
 10

 720
 20/1
 13
 6.0
 14
 14
 14

 600
 20/1
 15
 5.0
 16
 14
 16

 600
 20/1
 17
 0.0
 18
 18
 19
 0.0
 20
 18

 19
 0.0
 20
 22
 2
 23
 0.0
 24
 24

 TOTALS
 18.5
 31.2
 AMPS
 31.2
 AMPS
 DESCRIPTION DESCRIPTION BUILDING INTERIOR LIGHTING
BUILDING EXTERIOR LIGHTING
BUILDING EXTERIOR LIGHTING
LIGHTING CONTROL CABINET
SITE LIGHTING
BUILDING RECEPTACLES
BUILDING RECEPTACLES
SITE RECEPTACLES
BIOXIDE/GOOR CONTROL PUMP
SPARE DESCRIPTION
FLOW METER
RTU CABINET
GENERATOR BATTERY CHARGER
GENERATOR BLOCK HEATER
SPACE SUBTOTAL (VA): 5960 +25% PER NEC (VA): 1490 TOTAL (VA): 7450 @ 240V, 1Ø = 31.1 AMPS LOAD CALCULATIONS:



MANUFACTURER: SCHNEIDER		VOLTS/PHASE/WIRE 480V/3 PHASE/4W							
EQUIPMENT LOCATION: ELECTRICAL ROOM			AL ROOM	MAIN BUS RATING: 400A					
	FED FROM: UTILITY			MAIN BREAKER (AMPS): 400A					
				AIC RATING (AMPS)	45,000				
SECTION NO.	BREAKER SIZE	STARTER SIZE	FEEDER CABLE SIZE	EQUIPMENT NAME	KVA	HP	FLA	BREAKER TRIP RATING	
1	150A	VFD		PUMP 1		105	125.0		
2	150A	VFD		PUMP 2		105	125.0		
3				7.5KVA TRANSFORMER	6		7.2		
4				AC CU 1	15		18.0		
5				AC AIR HANDLER	2		2.4		
					1				
FLA FOR N	ON-MOTOR L	OAD (AMPS	5):				27.6		
	OTOR LOAD						250.0		
	OF LARGEST						31.3		
TOTAL AMI	PS						308.9		
SERVICE S	IZE						400.0		
% LOADED	% LOADED (NO LARGER THAN 80% OF SELECTED LO			AD SERVICE SIZE):			77%		





BENCHMARK:

MATIONAL GEODETIC SURVEY BENCHMARK NO. 10 1311

1.4 MaLES WEST OF BEAMONT ON INTERSTATE 10 10 SAN

1.4 MALES WEST OF BEAMONT ON INTERSTATE 10 10 SAN

1.4 MALES WEST OF BEAMONT ON INTERSTATE 10 OF SAN

1.5 MEDIA SOLID FROM A GUY

FRONTAGE ROAD, SOUTH ACROSS THE ROAD FROM A GUY

FRONTAGE ROAD, SOLID HACROSS THE ROAD FROM A GUY

FRONTAGE ROAD, SOLID HACROSS THE ROAD FROM A GUY

FRONTAGE ROAD FROM THE SOLID FROM THE SOLID FROM THE SOLID SOLID FROM THE SOLID FROM THE SOLID FROM THE SOLID SOLI

BY MARK DESCRIPTION REVISIONS









Reviewed By: Date:	CITY OF BEAUMONT, CALIFORNIA	SHEET
Staff Engineer	IMPROVEMENT PLANS FOR:	$1 \cap 1$
Recommended for Approval By: Date:	BEAUMONT CROSSROADS	
Approved By: Date: Date:	LIFT STATION	OF 38 SHEETS FILE NO: 3387
CITY OF BEAUMONT, PUBLIC WORKS DEPARTMENT Some ENGINEERING DIVISION TEL: (951) 769-6520 FAX: (951) 769	2223  FLECTRICAL SCHEDULES	

# STRUCTURAL GENERAL NOTES

### 1.00 DESIGN LOADS

- 1.01 2019 CALIFORNIA BUILDING CODE (CBC), ASCE 7-16, ACI 318-14, AISC 360-16, TMS 402-16)
- 1.02 BUILDING RISK CATEGORY = II
- 1.03 DEFLECTION CRITERIA: SEE CBC TABLE 1604.3 AND PROJECT SPECIFICATIONS FOR VERTICAL DEFLECTION AND LATERAL DIRFT REQUIREMENTS.

4	LOAD	ING INFOR	MATION		
	A.	DEAD:	SELF WEIGHT + 10 PSF (INCLUDING ROOFING ELEMENTS	+	MECHANICAL)
	В.	LIVE:	ROOF	=	20 PSF
			SIDEWALKS	=	250 PSF
	C.	SNOW:	IMPORTANCE FACTOR, I <sub>S</sub>	=	1.0
			GROUND SNOW LOAD, PG	=	5 PSF
	D.	WIND:	IMPORTANCE FACTOR, $I_{\boldsymbol{W}}$	=	1.0
			WIND SPEED, V (SITE SPECIFIC):	=	97 MPH
			EXPOSURE CATEGORY	=	С
			INTERNAL PRESSURE COEFFICIENT, GCPI	=	±0.18
			COMPONENTS AND CLADDING:		
			ROOF	=	17.5 PSF, -32 PSF (UPLIFT)
	E.	SEISMIC:	IMPORTANCE FACTOR, $I_E$ :	=	1.0
			MAPPED SHORT PERIOD SPECTRAL ACCELERATION, $S_{S}$	=	1.688 G
			MAPPED 1-S PERIOD SPECTRAL ACCELERATION, $S_1$	=	0.659 G
			SITE CLASS	=	D
			SITE COEFFICIENT, FA	=	1.0
			SITE COEFFICIENT, F <sub>V</sub>	=	1.7
			SHORT PERIOD DESIGN SPECTRAL RESPONSE ACCELERATION, $S_{DS}$	=	1.351 G
			1—S PERIOD DESIGN SPECTRAL RESPONSE ACCELERATION, $S_{D1}$	=	0.747 G

### CMU MCC BUILDING:

SEISMIC DESIGN CATEGORY

MAIN SEISMIC FORCE RESISTING SYSTEM

SPECIAL REINFORCED MASONRY SHEAR WALLS — EQUIVALENT LATERAL FORCE PROCEDURE

BASE SHEAR IN N-S DIRECTION, $V_{\text{NS}}$	= 7.32 KIPS
BASE SHEAR IN E-W DIRECTION, $V_{\text{EW}}$	= 7.08 KIPS
SEISMIC RESPONSE COEFFICIENT, Cs	= 0.27
RESPONSE MODIFICATION FACTOR, R	= 5
OVERSTRENGTH FACTOR, $\Omega_0$	= 2.5
DEFLECTION AMPLIFICATION FACTOR, $C_{D}$	= 3.5
REDUNDANCY FACTOR P	= 1.3

FOUNDATIONS, RETAINING AND BASEMENT WALLS, FOUNDATION DRAINAGE, SLABS ON GRADE AND OTHER ITEMS RELATED TO THE SOILS ARE DESIGNED AND SHALL BE IN ACCORDANCE TO WITH THE RECOMMENDATIONS OF THE GEOTECHNICAL REPORT "FINAL GEOTECHNICAL REPORT ON THE OBSERVATION AND TESTING OF REMEDIAL AND ROUGH GRADING, HIDDEN CANYON INDUSTRIAL PARK, BEAUMONT, CALIFORNIA.",
PREPARED BY KLING CONSULTING GROUP, INC, DATED OCTOBER 1, 2019
AND THE CITY OF BEAUMONT DESIGN CRITERIA, BASED ON THE 2019 CBC

### ALLOWABLE SOIL DESIGN PARAMETERS:

BEARING PRESSURE:	=	2000 PSF
SOIL LATERAL BEARING CAPACITY;	=	100 PCF
SOIL SLIDING COEFFICIENT:	=	0.25

# 2.00 DOCUMENTS AND LIMITATIONS

- 2.01 THESE STRUCTURAL DOCUMENTS, TOGETHER WITH THE CONCEPTS AND DESIGNS PRESENTED HEREIN, AS AN INSTRUMENT OF SERVICE, ARE INTENDED ONLY FOR THE SPECIFIC PURPOSE AND CLIENT FOR WHICH IT WAS PREPARED. REUSE OF, AND IMPROPER RELIANCE ON THIS DOCUMENT WITHOUT WRITTEN AUTHORIZATION AND ADAPTATION BY KIMLEY-HORN AND ASSOCIATES, INC. SHALL BE WITHOUT LIABILITY TO KIMLEY-HORN AND
- 2.02 IT IS UNDERSTOOD THAT THE STRUCTURAL ENGINEER OF RECORD MAKES NO WARRANTY, EITHER EXPRESSED OR IMPLIED, AS TO FINDINGS, DESIGNS, RECOMMENDATIONS, SPECIFICATIONS, OPINION, OR PROFESSIONAL ADVICE, EXCEPT THAT THESE INSTRUMENTS OF SERVICE HAVE BEEN PREPARED IN ACCORDANCE WITH CURRENT, GENERALLY ACCEPTED PROFESSIONAL ENGINEER PRACTICES.

2.03 ALL NON-STRUCTURAL ELEMENTS INDICATED ON THE STRUCTURAL DRAWINGS HAVE BEEN SHOWN IN GENERAL TO THEIR RELATIONSHIPS TO STRUCTURAL ELEMENTS. THEY SHALL NOT BE ASSUMED TO BE ACCURATE AND REFERENCE MUST BE MADE TO THE APPROPRIATE CONSULTANT(S) AND SPECIFICATIONS.

### 3.00 CONSTRUCTION SAFETY

- 3.01 IT IS UNDERSTOOD THAT THE CONTRACTOR IS SOLELY RESPONSIBLE FOR INITIATING, MAINTAINING, AND SUPERVISING ALL SAFETY PRECAUTIONS AND PROGRAMS IN CONNECTION WITH THE WORK ON THE PROJECT. THE CONTRACTOR SHALL TAKE ALL NECESSARY PRECAUTIONS FOR THE SAFETY OF ALL PERSONS AND PROTECT THEM FROM INJURY. LIKEWISE, THE CONTRACTOR SHALL PROTECT ALL PROPERTY AGAINST DAMAGE
- 3.02 THE CONTRACTOR SHALL COMPLY WITH ALL APPLICABLE LAWS. ORDINANCES, RULES, REGULATIONS, AND ORDERS OF ANY PUBLIC BODY HAVING JURISDICTION FOR THE SAFETY OF PERSONS OR PROPERTY.
- 3.03 THE CONTRACTOR'S DUTIES AND RESPONSIBILITIES FOR THE SAFETY AND PROTECTION OF THE WORK SHALL CONTINUE UNTIL SUCH TIME AS THE WORK IS SATISFACTORILY COMPLETED, AND THE ENGINEER HAS ISSUED A NOTICE TO THAT EFFECT TO THE OWNER AND THE CONTRACTOR.

- 4.00 FORMWORK AND SHORING
  4.01 THE CONTRACTOR SHALL EMPLOY AT HIS EXPENSE, A FORMWORK/SHORING ENGINEER REGISTERED IN CALIFORNIA TO CONTROL ALL OPERATIONS RELATING TO DESIGN, INSTALLATION AND REMOVAL OF ALL FORMWORK AND SHORING
- 4.02 CONTRACTOR SHALL SUBMIT SHOP DRAWINGS FOR FABRICATION, ERECTION, SUPPORT, AND BRACING OF FORMWORK AND SHORING PROCEDURES FOR THE ENGINEER'S RECORDS.
- 4.03 PRIOR TO THE PLACEMENT OF CONCRETE, THE FORMWORK/SHORING ENGINEER NEEDS TO INSPECT THE SHORING AFTER THE FIRST POUR (AND AGAIN IF THERE IS ANY CHANGE IN THE METHOD OF SHORING), TO VERIFY THAT THE SHORING INSTALLATION IS IN CONFORMANCE WITH THE SHORING SHOP DRAWINGS. A WRITTEN STATEMENT OF COMPLIANCE SIGNED BY THE SHORING ENGINEER SHALL BE SUBMITTED TO THE OWNER.

- 5.01 BEFORE STARTING WORK, THE CONTRACTOR SHALL VERIFY ALL DIMENSIONS ON THE SITE, AND REPORT ANY DISCREPANCIES IMMEDIATELY TO THE ENGINEER.
- 5.02 THE CONTRACTOR, BEFORE STARTING ANY WORK, SHALL CHECK ALL DIMENSIONS GIVEN ON THE STRUCTURAL DRAWINGS, RELATING TO GRID LINES, COLUMN AND WALL LOCATIONS, STRUCTURAL AND FINISHED FLOOR ELEVATIONS, MEMBER SIZES, ETC., WITH THE ARCHITECTURAL, MECHANICAL, ELECTRICAL, PLUMBING, AND CIVIL DRAWINGS. IF ANY DISCREPANCY IS NOTICED, IT SHALL BE IMMEDIATELY BROUGHT TO THE ATTENTION OF THE ENGINEER, AND WORK SHALL NOT COMMENCE UNTIL INSTRUCTIONS ARE RECEIVED FROM THE ENGINEER.
- 5.03 THE CONTRACTOR SHALL REFER TO THE ENGINEER FOR HIS INSTRUCTIONS FOR ANY DIMENSION NOT GIVEN ON OR OBTAINABLE FROM THE DRAWINGS. THE CONTRACTOR SHALL NOT USE SCALE TO OBTAIN OR VERIFY ANY DIMENSION SHOWN ON THESE

### 6.00 SHOP DRAWINGS

- 6.01 REVIEW OF SHOP DRAWINGS BY THE ENGINEER IS LIMITED TO COMPLIANCE OF THE COMPLETED STRUCTURE WITH THE DESIGN CONCEPT AND INFORMATION GIVEN IN THE CONTRACT DOCUMENTS. THE CONTRACTOR IS SOLELY RESPONSIBLE FOR DIMENSIONS, QUANTITIES, PERFORMANCE, SAFETY, COORDINATION WITH OTHER WORKS, AND ALL OTHER REQUIREMENTS OF THE CONTRACT DOCUMENTS. REVIEW DOES NOT AUTHORIZE CHANGES
- 6.02 THE CONTRACTOR SHALL SUBMIT SHOP DRAWINGS TO THE ENGINEER FOR HIS REVIEW IN ACCORDANCE WITH A SCHEDULE OF SUBMITTALS ACCEPTABLE TO THE ENGINEER. THESE SHOP DRAWINGS SHALL HAVE BEEN CHECKED BY, AND STAMPED WITH THE APPROVAL OF, THE CONTRACTOR AND IDENTIFIED AS THE ENGINEER MAY REQUIRE. THE DATA SHOWN ON THE SHOP DRAWINGS SHALL BE COMPLETE WITH RESPECT TO DIMENSIONS, DESIGN CRITERIA, AND DULY SIGNED AND SEALED BY A PROFESSIONAL ENGINEER (WHERE APPLICABLE).

### 7.00 MASONRY

- 7.01 THE CONTRACTOR SHALL REFER TO FINISHES AND DOORS & ROOF DRAWINGS FOR ADDITIONAL DETAILS RELATING TO MASONRY WORK. CONTRACTOR SHALL FURTHER CHECK ANY DETAILS SHOWN ON STRUCTURAL DRAWINGS WITH THE FINISHES AND DOORS & ROOF DRAWINGS AND NOTIFY ENGINEER AND ARCHITECT OF ANY NOTED DISCREPANCIES.
- 7.02 CONCRETE MASONRY UNITS (CMU) SHALL BE ERECTED AS LOAD BEARING CONCRETE MASONRY. COMPLY WITH ACI 530.1 "SPECIFICATION FOR MASONRY STRUCTURES" FOR MATERIALS, METHODS, AND WORKMANSHIP AND ERECTION TOLERANCES.
- 7.03 PROVIDE CONCRETE MASONRY UNIT ASSEMBLIES (CMUS) AS INDICATED ON THE DRAWINGS
  - CMUS SHALL CONFORM TO ASTM C90 WITH A MINIMUM AVERAGE NET-AREA COMPRESSIVE STRENGTH OF 1900 PSI.
  - WEIGHT CLASSIFICATION: MEDIUM WEIGHT, UNLESS OTHERWISE NOTED
- C. SIZE: MANUFACTURED TO DIMENSIONS 3/8" LESS THAN NOMINAL DIMENSIONS
- 7.04 PROVIDE MORTAR AND GROUT MATERIALS AS INDICATED ON THE DRAWINGS AND CONFORMING TO THE REQUIREMENTS LISTED BELOW. ALL CELLS CONTAINING REINFORCEMENT, CELLS BELOW GRADE, AND ANY LOCATIONS NOTED ON THE DRAWINGS SHALL BE GROUTED SOLID. DO NOT USE ADMINITURES, INCLUDING AIR—ENTRAINING AGENTS, ACCELERATORS, RETARDERS, WATER—REPELLENT AGENT, ANTIFREEZE COMPOUNDS, OR OTHER ADMIXTURES UNLESS OTHERWISE NOTED. DO NOT USE CALCIUM CHLORIDE IN MORTAR OR GROUT.
  - A. MORTAR FOR MASONRY ASSEMBLIES SHALL BE TYPE S, PCL MORTAR, CONFORMING TO ASTM C270.
  - GROUT FOR UNIT MASONRY SHALL BE FINE GROUT CONFORMING TO ASTM C476 AND HAVE A MINIMUM 28 DAY COMPRESSIVE STRENGTH (FM ) OF 2000 PSI. GROUT SHALL HAVE A SLUMP OF 8 TO 11 INCHES AS MEASURED ACCORDING TO ASTM C143. COMPLY WITH TABLE 1.15.1 IN ACI 530.1 FOR DIMENSIONS OF GROUT SPACES AND POUR HEIGHT.
- 7.05 LAY HOLLOW CONCRETE MASONRY UNITS IN A BOND PATTERN COMPLYING WITH THE ARCHITECTURAL DRAWINGS AND AS FOLLOWS:

- WITH FACE SHELLS FULLY BEDDED IN MORTAR AND WITH HEAD JOINTS OF DEPTH EQUAL TO BED JOINTS.
- B. WITH WEBS FULLY BEDDED IN MORTAR IN ALL COURSES OF PIERS, COLUMNS, AND
- C. WITH WEBS FULLY BEDDED IN MORTAR IN GROUTED MASONRY, INCLUDING STARTING COURSE ON FOOTINGS
- WITH ENTIRE UNITS, INCLUDING AREAS UNDER CELLS, FULLY BEDDED IN MORTAR AT STARTING COURSE ON FOOTINGS WHERE CELLS ARE NOT GROUTED.
- 7.06 PROVIDE VERTICAL REINFORCING AS NOTED PER THE CMU WALL REINFORCING SCHEDULE AND PER THE REQUIREMENTS BELOW, PROVIDE MATCHING DOWELS INTO THE FOOTING OR FOUNDATION CONSTRUCTION. PROVIDE TWO ADDITIONAL BARS AND DOWELS UNDER POINT LOADS, LINTELS AND BEAMS WHICH HAVE A REACTION EXCEEDING 10 KIPS, WHETHER OR NOT NOTED ON THE FRAMING PLANS.
  - A. ALL REBAR SHALL BE UNCOATED STEEL REINFORCING BARS: ASTM ASTM A615,
  - B. REINFORCING STEEL SHALL BE PLACED IN COMPLIANCE WITH ACI 530.1.
  - C. GROUT ALL CELLS CONTAINING REINFORCEMENT AND DO NOT PLACE GROUT UNTIL THE ENTIRE HEIGHT OF MASONRY TO BE GROUTED HAS ATTAINED ENOUGH STRENGTH TO RESIST GROUT PRESSURE. LIMIT HEIGHT OF VERTICAL GROUT POURS TO NOT MORE THAN 60°.
  - PROVIDE AN OPEN BOTTOM BOND BEAM REINFORCED WITH (1) NO. 5 CONTINUOUS BARS AT THE FOLLOWING LOCATIONS AND AS NOTED ON THE DRAWINGS.
    - i. AT THE TOP OF ALL WALL ELEVATIONS
    - ii. AT ALL JOIST AND FRAMING BEARING ELEVATIONS
    - iii. EQUALLY SPACED BETWEEN LATERAL SUPPORTS OR AT 10'-0" O.C. MAXIMUM VERTICALLY, IF THE DISTANCE BETWEEN LATERAL SUPPORTS EXCEEDS 10'-0"
- CONTINUOUS REINFORCEMENT, AND NOT MORE THAN 8" ABOVE AND BELOW OPENINGS IN MASONRY WALLS AND EXTENDING 12" BEYOND SAID OPENING. INTERRUPT JOINT MASJONET WALES AND EXTROLING IS BETOND SAID DEFINION. INTERROPT JOINT REINFORCEMENT AT CONTROL AND EXPANSION JOINTS, UNLESS OTHERWISE INDICATED. CUT AND BEND REINFORCING UNITS AS DIRECTED BY MANUFACTURER FOR CONTINUITY AT CORNERS, RETURNS, OFFSETS, COLUMN FIREPROFING, PIPE ENCLOSURES, AND OTHER SPECIAL CONDITIONS. JOINT REINFORCING SHALL CONSIST OF HOT-DIPPED GALVANIZED, CARBON STEEL CONFORMING TO ASTM A951 AND PER THE REQUIREMENTS BELOW:
- A. JOINT REINFORCEMENT FOR SINGLE WYTHE WALLS SHALL CONSIST OF EITHER LADDER OR TRUSS TYPE WITH A SINGLE PAIR OF SIDE RODS. SIDE AND CROSS RODS SHALL BE W1.7" DIAMETER.
- 7.08 PROVIDE MASONRY LINTELS AS NOTED ON THE PLANS.
- 7.09 DURING CONSTRUCTION COVER TOPS OF WALLS PROJECTIONS AND SILLS WITH WATERPROOF SHEETING AT END OF EACH DAY'S WORK. COVER PARTIALLY COMPLETED MASONRY WHEN CONSTRUCTION IS NOT IN PROGRESS.
- 7.10 DO NOT APPLY UNIFORM FLOOR OR ROOF LOADS FOR AT LEAST 12 HOURS AND CONCENTRATED LOADS FOR AT LEAST 3 DAYS AFTER BUILDING MASONRY WALLS OR
- 7.11 DO NOT USE FROZEN MATERIALS OR MATERIALS MIXED OR COATED WITH ICE OR FROST. DO NOT BUILD ON FROZEN SUBSTRATES. REMOVE AND REPLACE UNIT MASONRY DAMAGED BY FROST OR BY FREEZING CONDITIONS. COMPLY WITH COLD—WEATHER
- 7.12 COMPLY WITH HOT-WEATHER CONSTRUCTION REQUIREMENTS CONTAINED IN ACI 530.1
- 7.13 ALL REINFORCEMENT SHALL BE DETAILED PER TMS 402

## 8.00 STRUCTURAL STEEL

- 8.01 DESIGN, FABRICATION, AND ERECTION SHALL BE IN ACCORDANCE WITH AISC 360 "SPECIFICATIONS FOR STRUCTURAL STEEL BUILDINGS".
- 8.02 WIDE FLANGE MEMBERS SHALL CONFORM TO ASTM A992, GRADE 50
- 8.03 ALL C CHANNELS, L ANGLES, STRUCTURAL PLATES AND BARS SHALL CONFORM TO ASTM
- 8.04 ANCHOR BOLTS SHALL CONFORM TO ASTM F1554 GRADE 55. THE UPPER 1'-0"AND LOWER 6"SHALL BE THREADED. THE ENTIRE LENGTH OF BOLT SHALL BE GALVANIZED IN ACCORDANCE WITH THE REQUIREMENTS OF ASTM A153.
- 8.05 ALL WELDING SHALL BE PERFORMED BY CERTIFIED WELDERS AND SHALL BE IN ACCORDANCE WITH AMERICAN WELDING SOCIETY (AWS) D1.1 STRUCTURAL WELDING CODE RETURN ALL WELDS AT CORNERS A MINIMUM OF TWICE THE NORMAL SIZE OF THE WELD.
- 8.06 WELDING ELECTRODES SHALL BE E70XX UNLESS OTHERWISE NOTED
- 8.07 NUTS SHALL BE HEAVY HEX NUTS CONFORMING TO ASTM A563
- 8.08 WASHERS SHALL CONFORM TO ASTM F436.

DESIGN BY

- 8.09 ALL STEEL AND HARDWARE SHALL BE HOT-DIP GALVANIZED UNLESS OTHERWISE NOTED
- 8.10 ALL CONNECTIONS NOT DETAILED ON THE DRAWINGS SHALL BE DESIGNED BY A PROFESSIONAL ENGINEER REGISTERED IN THE STATE OF CALIFORNIA AND SHOP DRAWINGS SUBMITTED FOR REVIEW.
- 8.11 THE CONTRACTOR SHALL SUBMIT SHOP DRAWINGS FOR ALL STRUCTURAL STEEL WORK, SHOWN IN CONTRACT DRAWINGS, TO THE ENGINEER FOR THEIR REVIEW.
- 8.12 OMIT PAINT ON CONTACT SURFACES WHERE BOLTS AND WELDS ARE USED TOGETHER IN A CONNECTION. BOLTS TO BE BEARING TYPE.
- 8.13 BOLTED CONNECTIONS SHALL BE MADE WITH 3/4" DIA A-325 BOLTS WITH THREADS INCLUDED IN THE SHEAR PLANE, UON. INSTALL BOLTS IN PROPERLY ALIGNED HOLES AND TIGHTEN USING ONE OF THE FOLLOWING METHODS: SNUG-TIGHT CONDITION, TURN-OF-THE-NUT METHOD, A DIRECT TENSION INDICATOR, OR CALIBRATED WRENCH AS DEFINED BY THE AISC "SPECIFICATION FOR STRUCTURAL JOINTS USING ASTM A-325 OR A490 BOLTS, 2014 FDITION"

- 8.14 THE BOLT SUPPLIER SHALL USE PAINT TO COLOR AND IDENTIFY UNIQUE BOLT SIZES AND GRADES. A MATCHING PAINT STRIPE SHALL BE MADE NEAR THE END OF EACH MEMBER THAT IS TO ACCEPT A UNIQUE BOLT SIZE OR GRADE.
- 8.15 HEADED-STUD TYPE CONNECTORS SHALL BE ASTM A-108, GRADES 1010 THRU 1020, COLD FINISHED CARBON STEEL: AWS D1.1. TYPE B.
- 8.16 ALL COPES, BLOCKS AND CUTS IN STRUCTURAL MEMBERS SHALL BE MADE FREE OF NOTCHES, OR OTHER AREAS THAT COULD CREATE STRESS CONCENTRATIONS. THE MINIMUM RADIUS AT CORNERS SHALL BE 1/2".
- 8.17 ALL FIELD SPLICES OF CONTINUOUS BEAMS AND COLUMNS SHALL BE COMPLETE JOINT PENETRATION WELDS, NO BOTTLED FIELD SPLICES WILL BE PERMITTED
- 8.18 FABRICATOR SHALL PROVIDE A FIELD-WELD SCHEDULE SUMMARIZING MINIMUM PREHEAT, THE WELD FILLER MATERIAL, THE PROPER WELD DEPOSITION RATE AND WELDING MACHINE SETTINGS FOR EACH WELD THAT WILL BE UTILIZED IN THE FIELD.

### 9.00 POST-INSTALLED ANCHORS

9.01 UNLESS NOTED OTHERWISE INDICATED ON PLANS, POST-INSTALLED ANCHORS SHALL CONSIST OF THE FOLLOWING ANCHOR TYPES, OR APPROVED EQUAL:

ADHESIVE ANCHOR	MECHANICAL ANCHOR			
SOLID CONCE	RETE			
HILTI RE 500 SD	HILTI KWIK HUS EZ			
HILTI HY 200 SAFE SET SYSTEM	HILTI KWIK BOLT TZ			
GROUTED MASONRY				
HILTI HY 270	HILTI KWIK BOLT 3			

- 9.02 SUBSTITUTION REQUESTS FOR ALTERNATE PRODUCTS MUST BE APPROVED IN WRITING BY THE ENGINEER OF RECORD PRIOR TO USE. CONTRACTOR SHALL PROVIDE CALCULATIONS DEMONSTRATING THAT THE SUBSTITUTED PRODUCT IS CAPABLE OF ACHIEVING THE PERFORMANCE VALUES OF THE SPECIFIED PRODUCT. SUBSTITUTIONS WILL BE EVALUATED BY THEIR HAVING AN ICC ESR SHOWING COMPLIANCE WITH THE RELEVANT BUILDING
- 9.03 INSTALL ANCHORS PER THE MANUFACTURER INSTRUCTIONS, AS INCLUDED IN THE ANCHOR PACKAGING.
- 9.04 THE CONTRACTOR SHALL ARRANGE AN ANCHOR MANUFACTURER'S REPRESENTATIVE TO PROVIDE ONSITE INSTALLATION TRAINING FOR ALL OF THEIR ANCHORING PRODUCTS SPECIFIED. THE ENGINEER OF RECORD MUST RECEIVE DOCUMENTED CONFIRMATION THAT ALL OF THE CONTRACTOR'S PERSONNEL WHO INSTALL ANCHORS ARE TRAINED PRIOR TO THE COMMENCEMENT OF INSTALLING ANCHORS.
- 9.05 ANCHOR CAPACITY IS DEPENDANT UPON SPACING BETWEEN ADJACENT ANCHORS AND PROXIMITY OF ANCHORS TO EDGE OF CONCRETE. INSTALL ANCHORS IN ACCORDANCE WITH SPACING AND EDGE CLEARANCES INDICATED ON THE DRAWINGS.
- 9.06 EXISTING REINFORCING BARS IN THE CONCRETE STRUCTURE MAY CONFLICT WITH SPECIFIC ANCHOR LOCATIONS. UNLESS NOTED ON THE DRAWINGS THAT THE BARS CAN BE CUT, THE CONTRACTOR SHALL REVIEW THE EXISTING STRUCTURAL DRAWINGS AND SHALL UNDERTAKE TO LOCATE THE POSITION OF THE REINFORCING BARS AT THE LOCATIONS OF

2 Working Days

BENCHMARK:

MATONIA GEORGIT SURVEY BENCHMARK NO. '0 1311

1.4 MES WEST OF BEAUMONT ON INTERSTREE 10 TO SAN

INDECTED CANNON NAME PROMINES CROUD ON SOUTHWESTS)

1.4 MESS WEST OF BEAUMONT ON INTERSTREE 10 TO SAN

HELDER CONTINUES OF THE PROPERTY OF THE PRO

DESCRIPTION APPR. DATE REVISIONS

**Kimley Horn** 401 B Street, Suite 600, San Diego, CA 92101 Phone: (619) 234-9411 WWW.KIMI.FY-HORN.COM Mue

8/23/2021







Reviewed By: Staff Engineer for Approval By: Administrative Engineer Approved By: City Engineer/Director of Public Works CITY OF BEAUMONT, PUBLIC WORKS DEPARTMENT

CITY OF BEAUMONT, CALIFORNIA IMPROVEMENT PLANS FOR: BEAUMONT CROSSROADS LIFT STATION

GENERAL STRUCTURAL NOTES I

SHEE

of 38 sheets

3387

# STRUCTURAL GENERAL NOTES

### 10.00 REINFORCED CONCRETE (CAST-IN-PLACE)

- 10.01 THE GENERAL CONTRACTOR SHALL ASSIST AND COOPERATE WITH AN INDEPENDENT TESTING LABORATORY (TO BE RETAINED BY THE OWNER) WHICH SHALL CONDUCT ALL OF THE SPECIFIED TESTS REQUIRED FOR THE CONCRETE WORK AND REPORT THE RESULTS OF THESE TESTS DIRECTLY AND PROMPTLY TO THE ENGINEER FOR HIS REVIEW.
- 10.02 DETAILING OF REBAR SHALL BE IN ACCORDANCE WITH THE LATEST REVISION OF THE ACI DETAILING MANUAL, AND CONCRETE REINFORCING INSTITUTE'S LATEST EDITION OF "MANUAL OF STANDARD PRACTICE". ALL SHOP DRAWINGS PERTAINING TO REBAR DETAILS SHALL BE SUBMITTED TO THE ENGINEER FOR HIS REVIEW.
- 10.03 CONCRETE MIX DESIGN FOR ALL CONCRETE WORK IS REQUIRED TO BE SUBMITTED TO THE ENGINEER FOR HIS REVIEW. IT IS TO BE NOTED THAT THE CONCRETE SUPPLIER SHALL HAVE A QUALITY CONTROL PROCEDURE FOR THE PRODUCTION OF ALL CONCRETE, WHICH MUST BE ACCEPTABLE TO THE ENGINEER AND MEETS CURRENT ACI STANDARDS.
- 10.04 CONSTRUCTION JOINTS SHALL BE AS APPROVED BY THE ENGINEER. ENGINEER SHALL BE INFORMED AT LEAST 48 HOURS PRIOR TO THE COMMENCEMENT OF ANY CONCRETE
- 10.05 COPY OF ACI 301 "SPECIFICATIONS FOR STRUCTURAL CONCRETE FOR BUILDINGS" AND ACI SP 15 "FIELD REFERENCE MANUAL" SHALL BE KEPT IN THE PROJECT FIELD OFFICE
- 10.06 CONCRETE COMPRESSIVE DESIGN STRENGTH IN 28 DAYS: CONCRETE EXPOSURE CLASS F1 FOR SPREAD FOOTINGS, WALL FOOTINGS, AND SLAB-ON-GRADE, SEE ACI 318-14 TABLE 19.3.1.1 AND TABLE 19.3.2.1.

SPREAD FOOTINGS. 4,000 FSI MAX	W/C RATIO.	0.43
WALL FOOTINGS: 4,000 PSI		0.45
SLAB-ON-GRADE: 4,000 PSI		0.45

W/C DATIO: 0.45

- 10.07 CLEAR DISTANCE FROM FACE OF CONCRETE TO MAIN STEEL SHALL BE AS SHOWN ON THE STRUCTURAL DRAWINGS. WHERE CLEAR DISTANCE IS NOT SHOWN, ACI 301 SHALL
- 10.08 PROVIDE 3/4 INCH CHAMFERS AT ALL EXPOSED EDGES UNO.

CDDEAD ECOTINGS, 4 000 DSI MAY

- 10.09 EMBEDDED ITEMS THAT WILL SUPPORT STRUCTURAL STEEL CONSTRUCTION SHALL BE PLACED WITHIN THE TOLERANCES PRESCRIBED IN THE LATEST EDITION OF THE AISC "CODE OF STANDARD PRACTICE". GENERAL CONTRACTOR SHALL FIELD VERIFY LOCATION OF EMBEDDED ITEMS PRIOR TO FABRICATION AND DELIVERY OF STRUCTURAL STEEL TO THE PROJECT SITE.
- 10.10 BAR SUPPORTS, DESIGN, DETAILING, FABRICATION, AND PLACING OF REINFORCING BARS SHALL BE IN ACCORDANCE WITH ACI 318-14 (BUILDING CODE REQUIREMENTS FOR STRUCTURAL CONCRETE) AND THE LATEST EDITION OF THE ACI DETAILING MANUAL.
- 10.11 WHERE SHOWN OR SPECIFIED ON PLANS, PROVIDE STANDARD ACI 90-DEGREE OR 180-DEGREE HOOK, AS APPLICABLE.
- 10.12 REINFORCING: ASTM A615, GRADE 60, FOR SLABS, RETAINING / STAIR WALLS, AND FOUNDATIONS IS ACCEPTABLE. ALL REINFORCING TO BE A706 GRADE WHERE WELDING IS REQUIRED.
- 10.13 BAR DETAILS AND SUPPORTS: ACI DETAILING MANUAL AND BUILDING CODE. LAP ALL SPLICES AS SHOWN ON THE STRUCTURAL DRAWINGS
- 10.14 CLEAR DISTANCE FROM FACE OF CONCRETE TO REINFORCING STEEL SHALL BE AS SHOWN ON THE STRUCTURAL DRAWINGS. WHERE CLEAR DISTANCE IS NOT ILLUSTRATED, ACI 301 REQUIREMENTS SHALL CONTROL.
- 10.15 ALL REINFORCEMENT SHOWN IS INTENDED TO BE CONTINUOUS UNLESS NOTED OTHERWISE. LAP SPLICES SHALL BE 40 BAR DIAMETERS FOR #5 AND SMALLER, 48 BAR DIAMETERS FOR #6 AND LARGER.
- 10.16 CORE DRILLING SHALL NOT BE ALLOWED THROUGH IN-PLACE CONCRETE ELEMENTS UNLESS SPECIFICALLY APPROVED BY THE ENGINEER. PENETRATIONS THROUGH CONCRETE ELEMENTS SHALL BE ILLUSTRATED ON SHOP DRAWNOS AND SHALL UTILIZE SCHEDULE 40 STEEL PIPE. CLEARANCE REQUIRED WITHIN PIPE SLEEVE SHALL BE CONFIRMED BY SUBCONTRACTOR RESPONSIBLE FOR THE MATERIAL PASSING THROUGH REINFORCEMENT CLEAR COVER SHALL BE MAINTAINED AROUND THE
- 10.17 FOLLOWING FOUNDATION PLACEMENT AND PRIOR TO STEEL ERECTION, THE CONCRETE CONTRACTOR SHALL PROVIDE THE STEEL ERECTOR WITH WRITTEN DOCUMENTATION STATING THAT COLLUMN FOUNDATION ELEMENTS HAVE REACHED A MINIMUM OF 75% OF DESIGN COMPRESSIVE STRENGTH AND THAT ALL ANCHOR BOLT PLACEMENT IS IN CONFORMANCE WITH CONTRACT DOCUMENTS OR THAT REPAIRS WERE COMPLETED PER EOR DIRECTION. REFER TO 1926 OSHA REGULATIONS SUBPART R FOR ADDITIONAL DETAILS

### 11.00 ELEVATED METAL DECK

- 11.01 ALL NOTES APPLY TO NONCOMPOSITE AND COMPOSITE METAL FLOOR DECKING WITH CONCRETE TOPPING AND UNTOPPED ROOF DECKING, UNLESS NOTED OTHERWISE.
- 11.02 REFER TO CONTRACT DRAWINGS FOR CONNECTION DETAILS AND DEFINITION OF PERIMETER AND CORNER AREAS.
- 11.03 METAL DECK SHALL BE PROVIDED IN LONGEST LENGTHS POSSIBLE, PROVIDED A MINIMUM OF 3-SPAN CONDITIONS IN ALL LOCATIONS.
- 11.04 STEEL DECK SHALL CONFORM TO ASTM A653 AND SDI DESIGN MANUAL FOR COMPOSITE DECKS FORM DECKS AND ROOF DECKS. STEEL DECK SHALL BE RECOGNIZED UNDER THE LATEST VERSION OF ICC-ES AC43 ACCEPTANCE CRITERIA FOR STEEL DECK, ROOF
- 11.05 SHOP DRAWINGS INDICATING STEEL DECK LAYOUT, FASTENING METHOD AND PATTERN SHALL BE SUBMITTED TO THE ENGINEER OF RECORD PRIOR TO STEEL DECK
- 11.06 CONTRACTOR SHALL TAKE ALL NECESSARY PRECAUTIONS TO ENSURE STEEL DECK IS NOT DAMAGED PRIOR TO INSTALLATION DURING STORAGE, HANDLING AND ERECTION. DAMAGED STEEL DECK SHALL BE REPLACED.
- 11.07 STEEL DECK SHALL BE STORED OFF THE GROUND WITH ONE END ELEVATED TO PROVIDE DRAINAGE AND SHOULD BE PROTECTED FROM THE ELEMENTS WITH A WATERPROOF COVERING VENTILATED TO PREVENT CONDENSATION.

- 11.08 STEEL DECK PANELS SHALL BE PLACED STRAIGHT AND TRUE WITH A MAXIMUM 1/4-INCH HORIZONTAL MISALIGNMENT IN 100 FEET LENGTH. STEEL DECK SHALL BE MARKED OVER JOIST CHORDS PRIOR TO FASTENING TO PREVENT WELD BURN THROUGH OR MECHANICAL FASTENER PUNCH THROUGH.
- 11.09 ENDLAPS OF STEEL DECK SHALL OVERLAP ADJACENT SHEETS A MINIMUM OF 2 INCHES UNLESS NOTED OTHERWISE.
- 11.10 FRAMING AROUND TYPICAL OPENINGS SHALL BE IN ACCORDANCE WITH STANDARD PRACTICE DETAILS PROVIDED IN SDI "MANUAL OF CONSTRUCTION WITH STEEL DECK."
- 11.11 NO MECHANICAL, ELECTRICAL, PLUMBING, ARCHITECTURAL OR MISCELLANEOUS ELEMENTS SHALL BE SUPPORTED FROM THE UNDERSIDE OF THE METAL DECK.
- 11.12 REFER TO ARCHITECTURAL AND MECHANICAL DRAWINGS FOR SIZE AND LOCATION OF ALL ROOF OPENINGS, ROOF DRAIN DETAILS, SKYLIGHT AND ROOF HATCH DETAILS.
- A. INSTALL POWDER-ACTUATED FASTENERS ACCORDING TO THE MANUFACTURER'S
- POWDER-ACTUATED FASTENERS SHALL BE MANUFACTURED FROM AISI 1070 MODIFIED STEEL, AUSTEMPERED TO A ROCKWELL C HARDNESS OF 52-58. FASTENERS SHALL HAVE MINIMUM TENSILE AND SHEAR STRENGTHS OF 285 KSI AND
- POWDER-ACTUATED FASTENERS SHALL HAVE BALLISTIC POINTS AND KNURLED SHANKS AND MINIMUM 12-MILLIMETER DIAMETER STEEL WASHERS.

### ABBREVIATIONS AND DEFINITIONS:

ADDITE	ABBREVIATIONS AND BET INTIONS.						
A ACI	AREA AMERICAN CONCRETE INSTITUTE						
AISC	AMERICAN INSTITUTE OF STEEL CONSTRUCTION						
AISI	AMERICAN IRON AND STEEL INSTITUTE						
ASTM	AMERICAN SOCIETY FOR TESTING AND MATERIALS						
AWS	AMERICAN WELDING SOCIETY						
BW	BOTTOM OF WALL						
C/L	CENTERLINE						
CBC	CALIFORNIA BUILDING CODE						
CHP	CHAPTER						
CIP	CAST-IN-PLACE						
CL	CENTERLINE						
CLR	CLEAR						
CONC	CONCRETE						
CONT	CONTINUOUS						
	0.10.0						

DIAMETER DETAIL EACH FACE EXISTING GROUND EL, ELEV ELEVATION EACH WAY EXISTING FINISHED GROUND FEET, FOOT HEIGHT, HIGH INCHES

KH, KHA KIMLEY-HORN AND ASSOCIATES, INC.

KIPS PER SQUARE INCH LENGTH, LONG LINEAR FEET MAXIMUM MINIMUM NUMBER NOT TO SCALE

ON CENTER OCCUPATIONAL SAFETY AND HEALTH ADMINISTRATION PORTLAND CEMENT CONCRETE OSHA PCC

PE PL PROP PROPOSED POUNDS PER SQUARE FOOT REINFORCEMENT

PROFESSIONAL ENGINEER

SDI SE SEC SF STEEL DECK INSTITUTE STRUCTURAL ENGINEER SECTION

SQUARE FEET SPECIAL INSPECTION/INSPECTOR

SQUARE, SQUARED STANDARD TOP OF WALL TYPICAL TOP AND BOTTOM UNLESS OTHERWISE NOTED

WATER TO CEMENT DIAMETER INCHES

STEEL SPECIAL	INSPECT	ION TA	3LE	
TYPE	CONTINUOUS SPECIAL INSPECTION	PERIODIC SPECIAL INSPECTION	REFERENCE	QUALIF.
1. REVIEW SHOP FABRICATION AND QUALITY CONTROL PROCEDURES.	x	-	IBC 1704.2.5.1	AWS/AISC -SSI ICC-SWSI
PRE-WELI	D INSPECTION			
2. VERIFY WELDER QUALIFICATION RECORDS, WELDER CONTINUITY RECORDS, AND MATERIAL IDENTIFICATION (TYPE/GRADE).	-	x	AISC 360: N3.2, N5.2 & N5.4	AWS/AISC -SSI ICC-SWSI
3. VERIFY AVAILABILITY OF WELDING PROCEDURE SPECIFICATION & MATERIAL CERTIFICATIONS OF WELDING CONSUMABLES.	x	-	AISC 360: N3.2, N5.2 & N5.4	AWS/AISC -SSI ICC-SWSI
4. INSPECT FIT-UP GROOVE WELDS, CJP GROOVE WELDS OF HSS T-, Y-, AND K-JOINTS WITHOUT BACKING, AND FILLET WELDS. INSPECT CONFIGURATION OF AND FINISH OF ACCESS HOLES.	-	×	AISC 360: N3.2, N5.2 & N5.4	AWS/AISC -SSI ICC-SWSI
DURING WELI	DING INSPECTI	ON		
5. INSPECT PRE—HEAT, POST—HEAT, SURFACE PREPARATION. VERIFY PROPER ELECTRODE USE, CHARPY V—NOTCH TEST WELDS WHERE REQUIRED.	-	х	AISC 360: N3.2, N5.2 & N5.4	AWS/AISC -SSI ICC-SWSI
6. VERIFY WELDING PROCEDURE SPECIFICATIONS (WPS) ARE FOLLOWED AND VERIFY REQUIRED TECHNIQUES.	-	х	AISC 360: N3.2, N5.2 & N5.4	AWS/AISC -SSI ICC-SWSI
POST WELD	ING INSPECTIO	N		
7. TEST 10% OF ALL COMPLETE AND PARTIAL PENETRATION WELDS 5/16" OR GREATER	-	х	-	AWS/AISC -SSI ICC-SWSI
BOLTING	INSPECTION			
8. INSPECT INSTALLATION AND TIGHTENING OF HIGH-STRENGTH BOLTS. VERIFY THAT SPLINES HAVE SEPARATED FROM TENSION CONTROL BOLTS. VERIFY PROPER TIGHTENING SEQUENCE.	-	×	AISC 360: N5.6	AWS/AISC -SSI ICC-SWSI
9. INSTALLATION OF BOLTS IN SLIP-CRITICAL CONNECTIONS SHALL BE MONITORED CONTINUOUSLY EXCEPT AS ALLOWED PER AISC 360:N5.6	х	-	AISC 360: N5.6	AWS/AISC -SSI ICC-SWSI
MISC. STEE	L INSPECTION:	S		
10. VISUALLY INSPECT SIZE, NUMBER, POSITIONING AND WELDING OF SHEAR CONNECTORS, SOUND TEST ALL SHEAR CONNECTORS AND BEND TEST ALL QUESTIONABLE CONNECTORS. BEND TEST 15% OF SHEAR CONNECTORS TO 15 DEGREES FROM ORIGINAL AXIS.	-	х	AWS D1.1 SECTIONS 7.7 & 7.8	AWS-CWI ASNT
11. INSPECT STEEL FRAME FOR COMPLIANCE WITH STRUCTURAL DRAWINGS, INCLUDING BRACING, MEMBER CONFIGURATION & CONNECTION DETAILS.	-	х	-	PE/SE
12. VERIFY WELDING CERTIFICATIONS. INSPECT WELDING AND SIDE—LAP FASTENING OF METAL ROOF AND FLOOR DECK.	_	x	IBC 1705.2.2, SDI-QA/QC	AWS-CWI

STEEL SPECIAL INSPECTION TARLE

SOIL SPECIAL INSPECTION	TABLE	
TYPE	CONTINUOUS SPECIAL INSPECTION	PERIODIC SPECIAL INSPECTION
1. VERIFY MATERIALS BELOW SHALLOW FOUNDATIONS ARE ADEQUATE TO ACHIEVE THE DESIGN BEARING CAPACITY.	-	x
2. VERIFY EXCAVATIONS ARE EXTENDED TO PROPER DEPTH AND HAVE REACHED PROPER MATERIAL.	_	x
3. PERFORM CLASSIFICATION AND TESTING OF COMPACTED FILL MATERIALS.	x	x
4. VERIFY USE OF PROPER MATERIALS, DENSITIES AND LIFT THICKNESSES DURING PLACEMENT AND COMPACTION OF COMPACTED FILL.	-	х
5. PRIOR TO PLACEMENT OF COMPACTED FILL, INSPECT SUBGRADE AND VERIFY THAT SITE HAS BEEN PREPARED PROPERLY.	-	x

CONCRETE SPECIAL INSPECTION TABLE						
TYPE	CONTINUOUS SPECIAL INSPECTION	PERIODIC SPECIAL INSPECTION	REFERENCED STANDARD	CBC REFERENCE		
1. INSPECT REINFORCEMENT AND VERIFY PLACEMENT.	-	Х	ACI 318: CH. 20, 25.2, 25.3, 26.6.1 – 26.6.3	1908.4		
2. INSPECT ANCHORS CAST IN CONCRETE	-	×	ACI 318: 17.8.2	-		
3. INSPECT AND TEST ANCHOR POST INSTALLED IN HARDENED CONCRETE MEMBERS. A. ADHESIVE ANCHORS INSTALLED IN HORIZONTALLY OR UPWARDLY INCLINED ORIENTATIONS TO RESIST SUSTAINED TENSION LOADS. B. MECHANICAL ANCHORS AND ADHESIVE ANCHORS NOT DEFINED IN 4.A	x	x	ACI 318: 17.8.2.4 ACI 318: 17.8.2	-		
4. VERIFY USE OF REQUIRED DESIGN MIX.	-	×	ACI 318: CH. 19, 26.4.3, 26.4.4	1904.1, 1904.2, 1908.2, 1908.3		
5. VERIFY MAINTENANCE OF SPECIFIED CURING TEMPERATURE AND TECHNIQUES.	_	×	ACI 318: 26.5.3 -26.5.5	1908.9		
6. VERIFY IN—SITU CONCRETE STRENGTH, PRIOR TO REMOVAL OF FORMS FROM STRUCTURAL SLABS.	_	x	ACI 318: 26.11.2	_		
7. INSPECT FORMWORK FOR SHAPE, LOCATION AND DIMENSIONS OF THE CONCRETE MEMBER BEING FORMED.	_	x	ACI 318: 26.11.1.2(B)	_		

MASONRY SPECIA	L INSPEC	CTION T	ABLE	
TYPE	CONTINUOUS SPECIAL INSPECTION	PERIODIC SPECIAL INSPECTION	TMS 402/ ACI530/ ASCE 5	TMS 602, ACI 530.1 ASCE 6
1. VERIFY COMPLIANCE WITH THE APPROVED SUBMITTAL.	-	×	-	ART. 1.5
BEFORE MASO	NRY CONSTRUC	CTION		•
2. CONSTRUCTION MORTAR JOINTS		×	-	ART. 3.3
3. LOCATION OF REINFORCEMENT AND EMBEDS	_	x	1	ART. 3.4 3.6 A
PRIOR -	TO GROUTING			
4. GROUT SPACE	-	х	-	ART. 3.2 D, 3.2 F
5. GRADE, TYPE, AND SIZE OF REINFORCEMENT	-	х	SECTION 6.1	ART. 2.4 3.4
6. PLACEMENT OF REINFORCEMENT AND EMBEDS	_	×	SECTIONS 6.1, 6.2.1, 6.2.6, 6.2.7	ART. 3.2 E, 3.4, 3 A
7. PROPORTIONS OF SITE-PREPARED GROUT	-	×	-	ART. 2.6 B, 2.4 G.1.B
8. CONSTRUCTION OF MORTAR JOINTS	-	x	-	ART. 3.3
VERIFY DURI	NG CONSTRUCT	ION		
9. SIZE AND LOCATION OF STRUCTURAL ELEMENTS	-	х	-	ART. 3.3
10. PREPARATION, CONSTRUCTION, AND PROTECTION OF MASONRY DURING COLD WEATHER (TEMPERATURE BELOW 40°F) OR HOT WEATHER (TEMPERATURE ABOVE 90°F).	-	×	-	ART. 1.80 1.8D
11. PLACEMENT OF GROUT	×	-	-	ART. 3.5 3.6 C
12. OBSERVE PREPARATION OF GROUT SPECIMENS, MORTAR SPECIMENS, AND/OR PRISMS.	-	x	-	ART. 1.4 B2.A.3, 1. B.2.B.3, 1.4 B.2.C.3, 1.4 B.3, 1.4 B.4



BENCHMARK:

MATIONAL GEODETIC SURVEY BENCHMARK NO. 10 1311

1.4 MESE WEST OF BEAUMONT ON INTERSTATE 10 TO SAN

MIGOTIC CANNON NEAR FRONTAGE ROAD ON SOUTHMESTS

SOE OF INTERSTATE 10, 0.1 MILES SOUTHEAST ALONG

FRONTAGE ROAD, SOUTH AGROSS THE ROAD FROM GUY

POLE 259 FEET SOUTH OF THE CENTERLINE OF FRONTAGE

ROAD, 1.8 FEET WEST OF POMEROL AND 1.5 FEET EAST

SCREW PILLO 1 INCH ABOVE GROUND (ELEVATION 
2486.07). ALSO SHOWN ON "HERWAYS OF / POTRERO BLVD.

INTERCHANCE STATIC OPS FROMECT CONTROL DIAGRAMA

AND IDENTIFIED THEREON AS 3006 BM DX3474 WHEREIN

THE PUBLISHED ELEVATION = 2488.07 IS CORRECTED WITH

A MEASURED LEVATION = 2488.07 IS CORRECTED WITH

A MEASURED LEVATI

**Kimley Morn** 401 B Street, Suite 600, San Diego, CA 92101 Phone: (619) 234-9411 Mue DESCRIPTION APPR. DATE REVISIONS



WWW.KIMLEY-HORN.COM

8/23/2021


SLM PRAWN BY





eviewed By:	Date:	CITY OF BEAUMONT, CALIFORNIA
Staff Engineer		IMPROVEMENT PLANS FOR:
ecommended or Approval By:	Date:	BEAUMONT CROSSROAD
pproved By:City Engineer/Director of Public Works	Date:	LIFT STATION
ITY OF BEAUMONT, PUBLIC WORKS DEPARTMEN NGINEERING DIVISION TEL: (951)	T 550E. 6th St Beaumont, CA 92223 769-8520 FAX: (951) 769-8526	GENERAL STRUCTURAL NOTES II

JMONT, CALIFORNIA SHEE IENT PLANS FOR: CROSSROADS OF 38 SHEETS STATION 3387

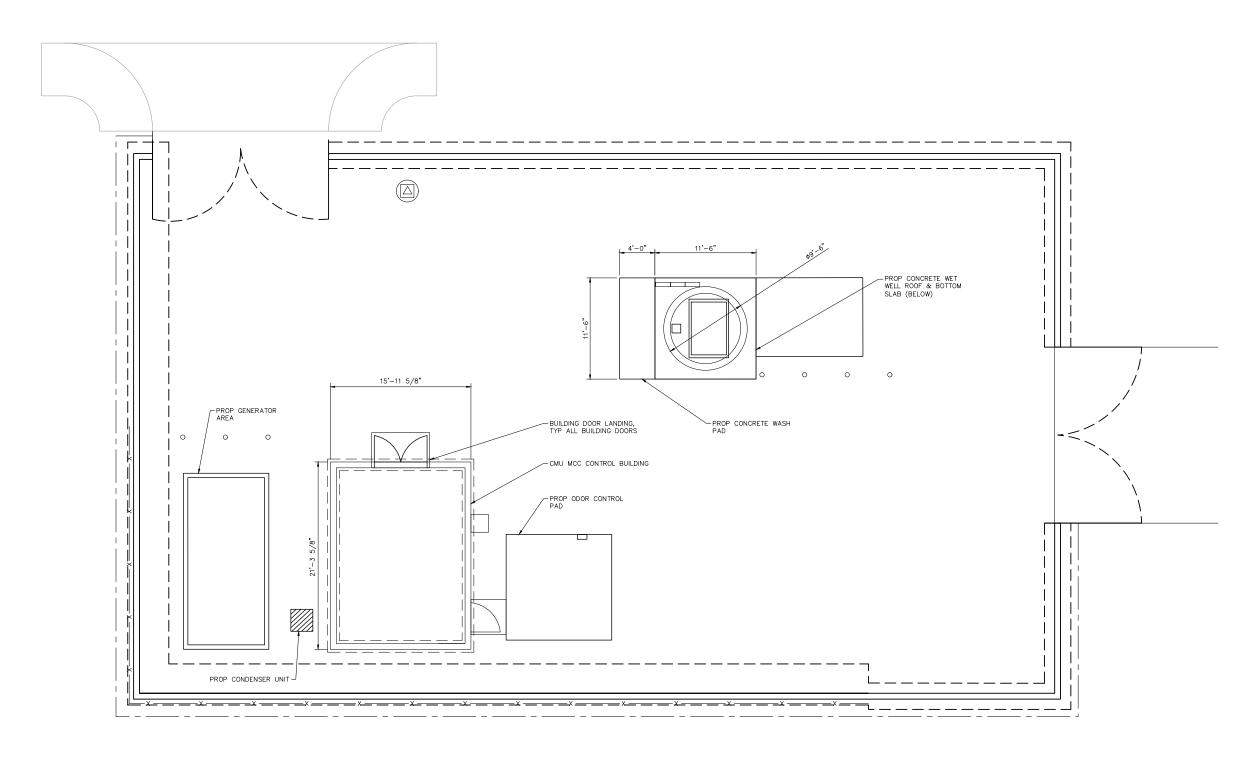





DIGALERT


Call 2 Working Days
Before You Dig!

811

BENCHMARK: NATIONAL GEODETIC SURVEY BENCHMARK NO. *Q 1311				_
1.4 MILES WEST OF BEAUMONT ON INTERSTATE 10 TO SAN				
TIMEOTEO CANYON NEAR FRONTAGE ROAD ON SOUTH(WEST) SIDE OF INTERSTATE 10, 0.1 MILES SOUTHEAST ALONG FRONTAGE ROAD, SOUTH ACROSS THE ROAD FROM A GUY				_
POLE 25.9 FEET SOUTH OF THE CENTERLINE OF FRONTAGE ROAD, 1.8 FEET WEST OF POWERPOLE AND 1.5 FEET EAST OF A WITNESS POST, INSIDE A 4 INCH PVC PIPE WITH				
SCREW D7), ALSO SHOWN ON "HIGHWAY 60 / POTRERO BLVD.				
INTERCHANGE STATIC GPS PROJECT CONTROL DIAGRAM® AND IDENTIFIED THEREON AS 3508 BM DX3474 WHEREIN				
THE PUBLISHED ELEVATION = 2468.07 IS CORRECTED WITH A MEASURED ELEVATION = 2468.01', USED HEREON.	BY	MARK		
ELEV. 2468.01, (NVD '88), (STAMPED Q 1311 1978)	FNC	INICED	R F	=

						<b>Kimley</b> » Horn	SEAL
AN EST)			1				
IJΥ			<u> </u>			401 B Street, Suite 600, San Diego, CA 92101	
NGE ST			1			Phone: (619) 234-9411 WWW.KIMLEY-HORN.COM	
LVD.							1
LVD.						Mue	
NTH .	BY	MARK	DESCRIPTION	APPR.	DATE	I frace	
978)	ENG	NEED	REVISIONS		ITV	USTIN L. BRUE 8/23/2021	





Reviewed By:Staff Engineer	Date:	
Recommended for Approval By:Administrative Engineer	Date:	В
Approved By:City Engineer/Director of Public Works	_ Date:	
CITY OF BEAUMONT, PUBLIC WORKS DEPARTMEN ENGINEERING DIVISION TEL: (951)	T 550E. 6th St Beaumont, CA 92223 769-8520 FAX: (951) 769-8526	


CITY OF BEAUMONT, CALIFORNIA


IMPROVEMENT PLANS FOR:


BEAUMONT CROSSROADS

LIFT STATION

of 38 sheets
file NO:
3387

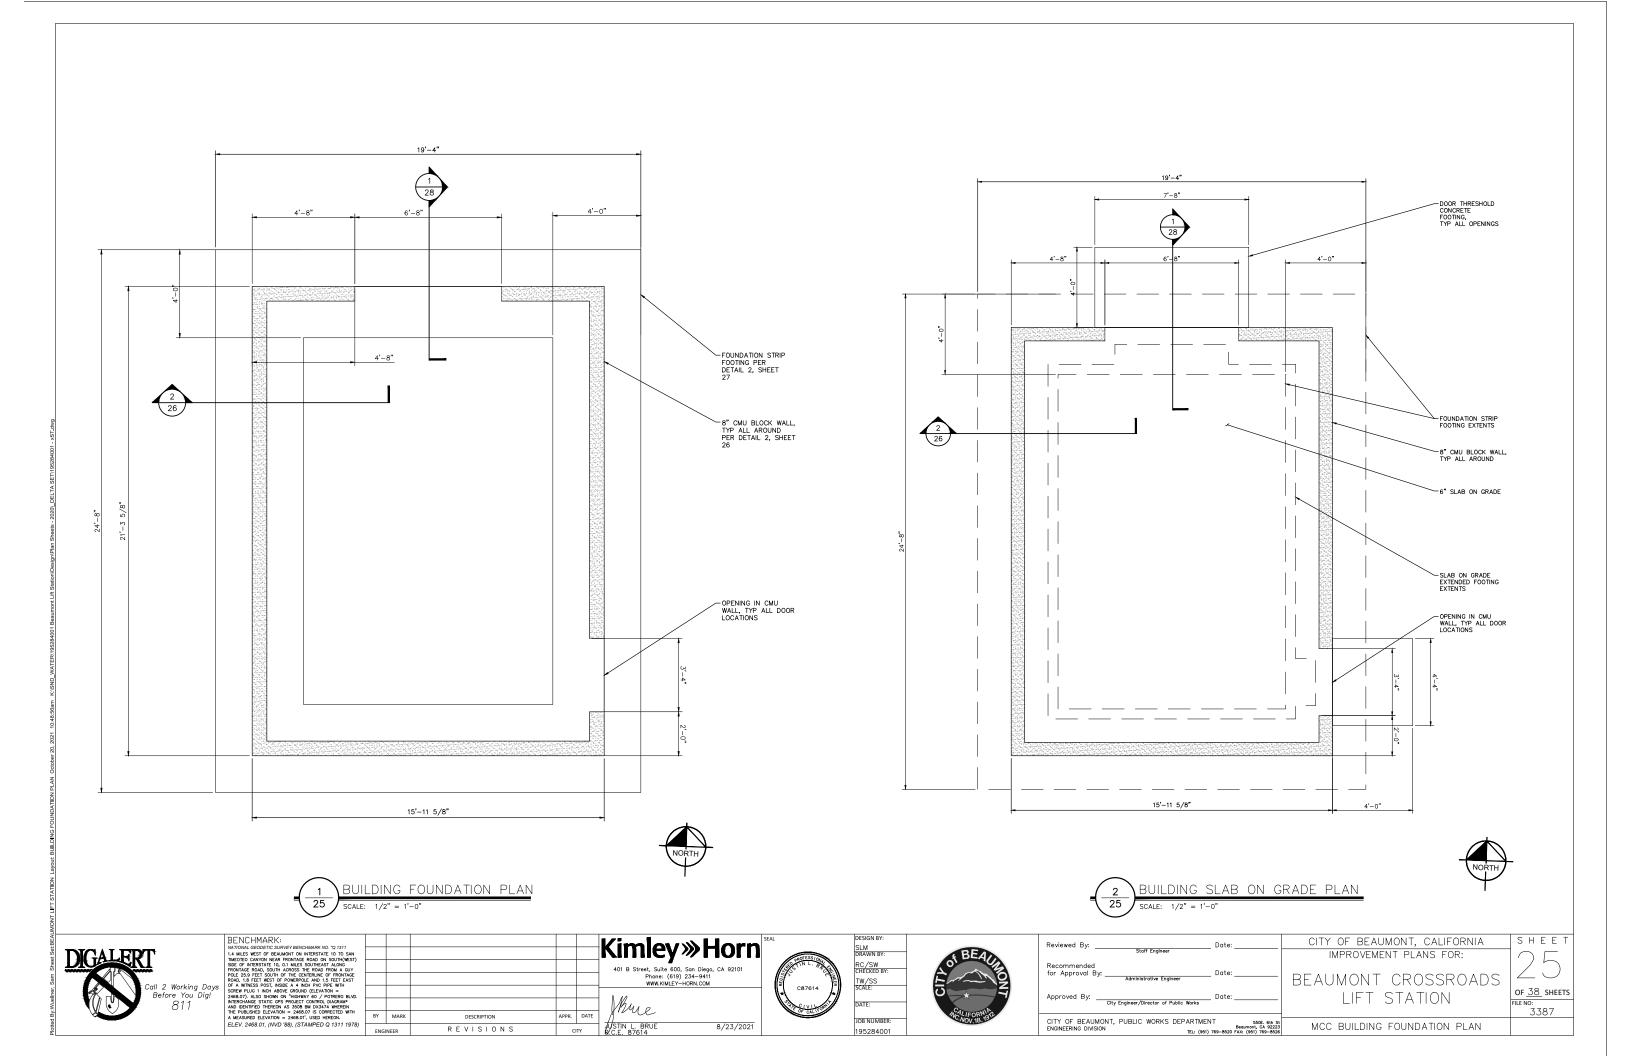

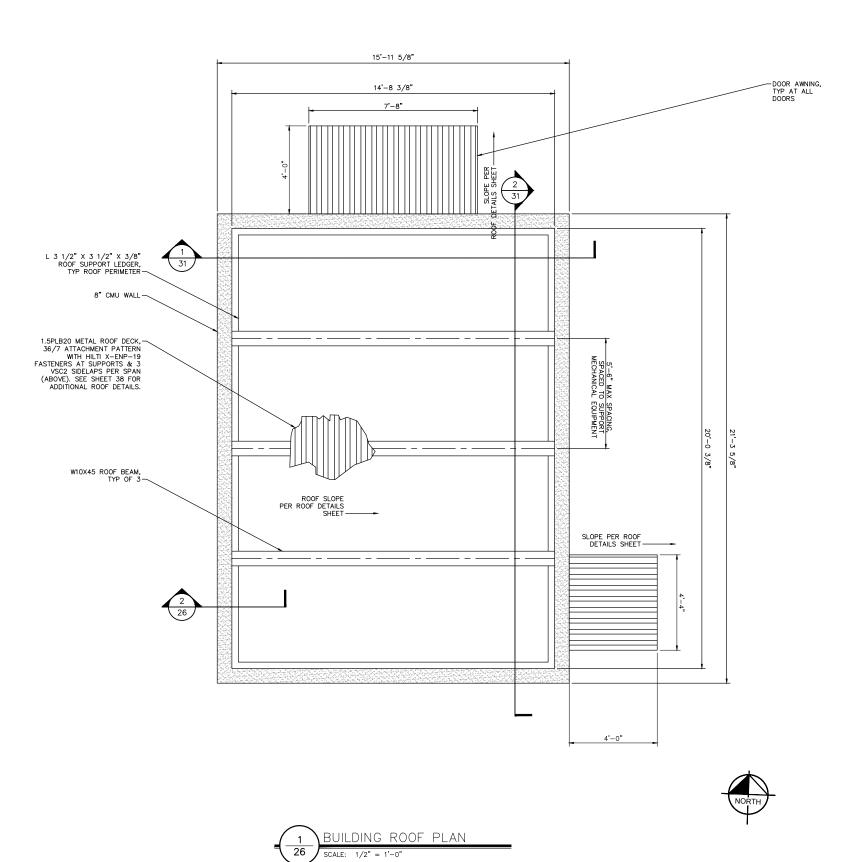

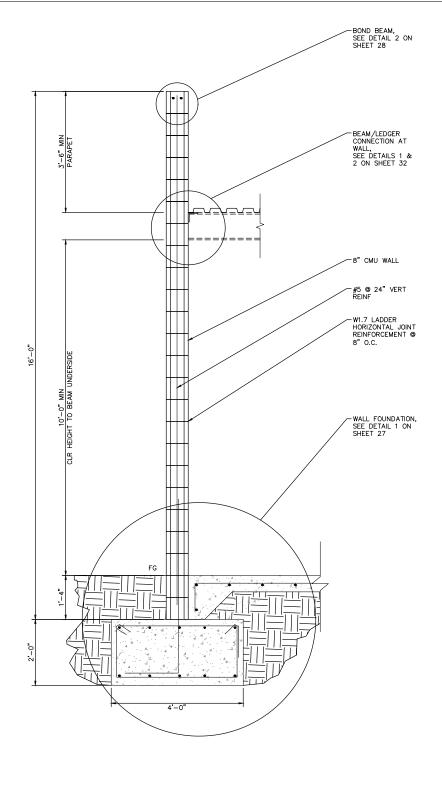




TYPICAL BUILDING WALL SECTION \_<u>-</u> 26



,						Kimlow W Hori
SAN MEST)						Kimley»Hori
GUY FAGE AST						401 B Street, Suite 600, San Diego, CA 92101 Phone: (619) 234-9411 WWW.KIMLEY-HORN.COM
BLVD.  * IN						Mula
WITH	BY	MARK	DESCRIPTION	APPR.	DATE	1200
1978)	ENG	INEER	REVISIONS	С	ITY	JUSTIN L. BRUE 8/23/202 R.C.E. 87614









Reviewed By: Date:	CITY OF BEAUMONT, CALIFORNIA
Staff Engineer	IMPROVEMENT PLANS FOR:
Recommended for Approval By:Administrative Engineer Date:	BEAUMONT CROSSROADS
Approved By: Date:	LIFT STATION
CITY OF BEAUMONT, PUBLIC WORKS DEPARTMENT 550E. 6th 5t ENGINEERING DIVISION TEL: (951) 769-8520 FAX: (951)	MCC BUILDING ROOF PLAN


SHEET

OF 38 SHEETS
FILE NO:
3387

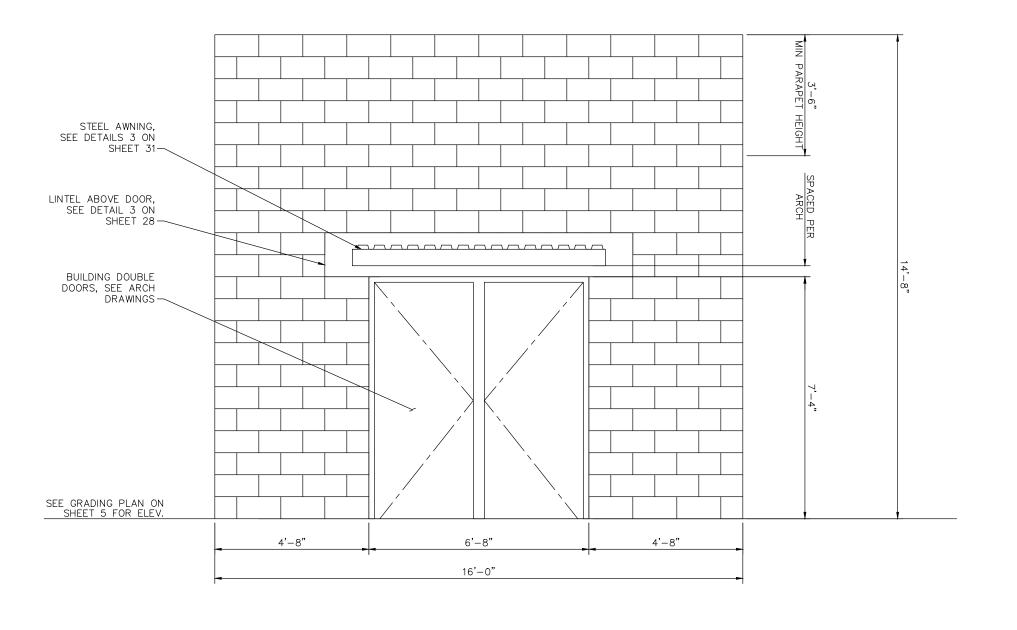

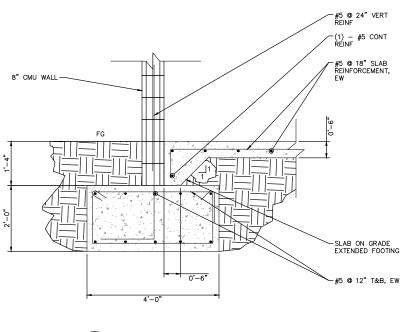



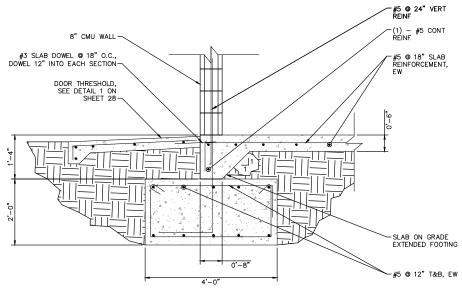



BENCHMARK:

ARTONAL GEODETIC SURVEY BENCHMARK NO. 1931


1.4 MILES WEST OF BEAUNONT ON INTERTATE 10 TO SAN
THEOTEC CANNON NARE FRONTAGE ROAD ON SOUTHWESTS
SDE OF INTERSTATE 10, 0.1 MILES SOUTHEAST ALONG
FRONTAGE ROAD, SOUTH ACROSS THE ROAD FROM A GUY
POLE 259 FEET SOUTH OF THE CENTERLINE OF FRONTAGE
FOR THE SOUTH OF THE CENTERLINE OF FRONTAGE
OF A WINESS POST, INSIDE A HOLP DUP FOR THE
SORREY PLUG 1 INCH ABOVE GROUND (ELEVATION —
2488.07). ALSO SHOWN ON "HIGHWAY 60 / POTRERO BLVD.
INTERCHANCE STATIC OFF FROLECT CONTROL DIAGRAM\*
AND IDENTIFIED THEREON AS 3006 BM DOX374 WHEREIN
THE PUBLISHED LELVATION — 2488.07 IS COMPECTED WITH
A MEASURED ELEVATION — 2488.07 IS COMPEC

DESCRIPTION APPR. DATE REVISIONS

NORTH ELEVATION

Mue


SCALE: 3/4" = 1'-0"







Reviewed By:Staff Engineer	Date:	CITY OF BE
Recommended		IMPROVE
for Approval By:	Date:	BEAUMON
Approved By:City Engineer/Director of Public Works	Date:	LIF
CITY OF BEAUMONT, PUBLIC WORKS DEPARTMEN ENGINEERING DIVISION TEL: (951)	T 550E. 6th St Beaumont, CA 92223 769-8520 FAX: (951) 769-8526	I MCC BU

BEAUMONT, CALIFORNIA SHEET VEMENT PLANS FOR: NT CROSSROADS OF <u>38</u> SHEETS T STATION FILE NO: 3387 MCC BUILDING ELEVATION I

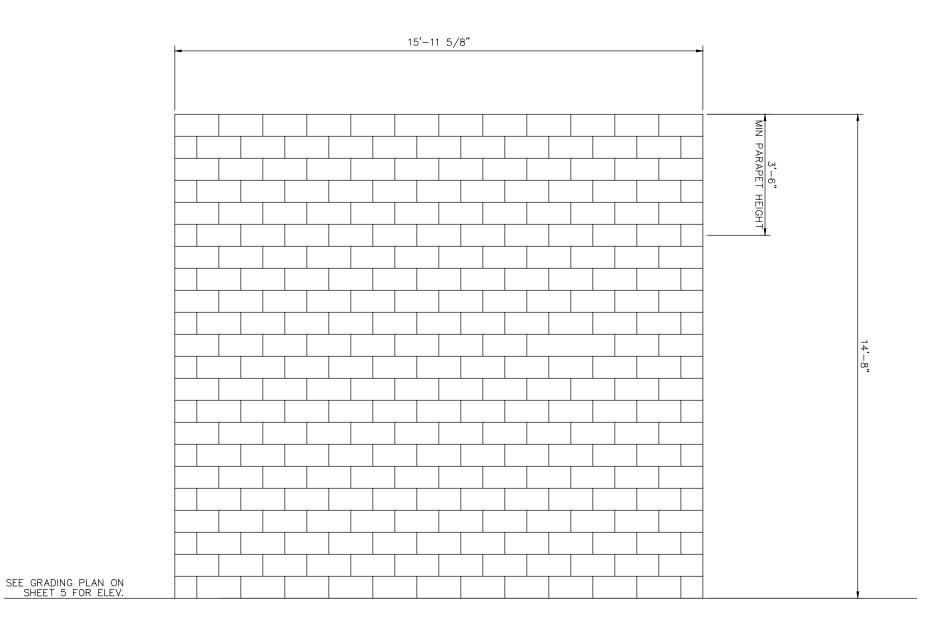


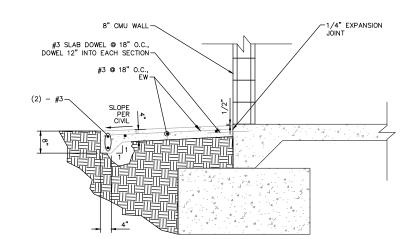





NOTES:
1. PROVIDE BOND BEAM AT THE TOP OF ALL WALLS.



16 IN NOMINAL DEPTH LINTEL

CMU MASONRY LINTEL SCHEDULE (EXTERIOR WALLS)					
CLEAR OPENING WIDTH, W	BOND BEAM / LINTEL DEPTH	REINFORCING	MIN BEARING		
W ≥6'-0"	16"	2 - #5	16"		
W ≤ 6'-0"	16"	1 - #5	16"		

- NOTES:

  1. EXTEND REINFORCING TO END OF BEARING AT EACH SIDE OF OPENING.

  2. FILL ALL CELLS UNDER BEARING WITH GROUT AND (1) #5 VERT BARS CONT TO FOUNDATION, LOCATED DIRECTLY BELOW BEARING AT EACH SIDE OF LINTEL.

  3. LINTELS SHALL BE SHORED UNTIL GROUT REACHES DESIGN COMPRESSIVE STRENGTH.

  4. LINTEL SPANS BEYOND THE MAXIMUM INDICATED IN THE SCHEDULE REQUIRES SPECIAL DESIGN.



BENCHMARK:


ARTONAL GEODETIC SURVEY BENCHMARK NO. 1931

1.4 MILES WEST OF BEAUNONT ON INTERTATE 10 TO SAN
THEOTEC CANNON NARE FRONTAGE ROAD ON SOUTHWESTS
SDE OF INTERSTATE 10, 0.1 MILES SOUTHEAST ALONG
FRONTAGE ROAD, SOUTH ACROSS THE ROAD FROM A GUY
POLE 259 FEET SOUTH OF THE CENTERLINE OF FRONTAGE
FOR THE SOUTH OF THE CENTERLINE OF FRONTAGE
OF A WINESS POST, INSIDE A HOLP DUP FOR THE
SORREY PLUG 1 INCH ABOVE GROUND (ELEVATION —
2488.07). ALSO SHOWN ON "HIGHWAY 60 / POTRERO BLVD.
INTERCHANCE STATIC OFF FROLECT CONTROL DIAGRAM\*
AND IDENTIFIED THEREON AS 3006 BM DOX374 WHEREIN
THE PUBLISHED LELVATION — 2488.07 IS COMPECTED WITH
A MEASURED ELEVATION — 2488.07 IS COMPEC

DESCRIPTION APPR. DATE REVISIONS

SOUTH ELEVATION

SCALE: 3/4" = 1'-0"



401 B Street, Suite 600, San Diego, CA 92101 Phone: (619) 234-9411 WWW.KIMLEY-HORN.COM


Mue





Reviewed By: Date: Date:		
Dd-d	-	
for Approval By: Date:	-	Е
Approved By: Date: Date:	-	
CITY OF BEAUMONT, PUBLIC WORKS DEPARTMENT 550E. 61 ENGINEERING DIVISION TEL: (951) 769-8520 FAX: (951) 769-	23	


CITY OF BEAUMONT, CALIFORNIA SHEET IMPROVEMENT PLANS FOR: BEAUMONT CROSSROADS OF <u>38</u> SHEETS
FILE NO:
3387 LIFT STATION MCC BUILDING ELEVATION II

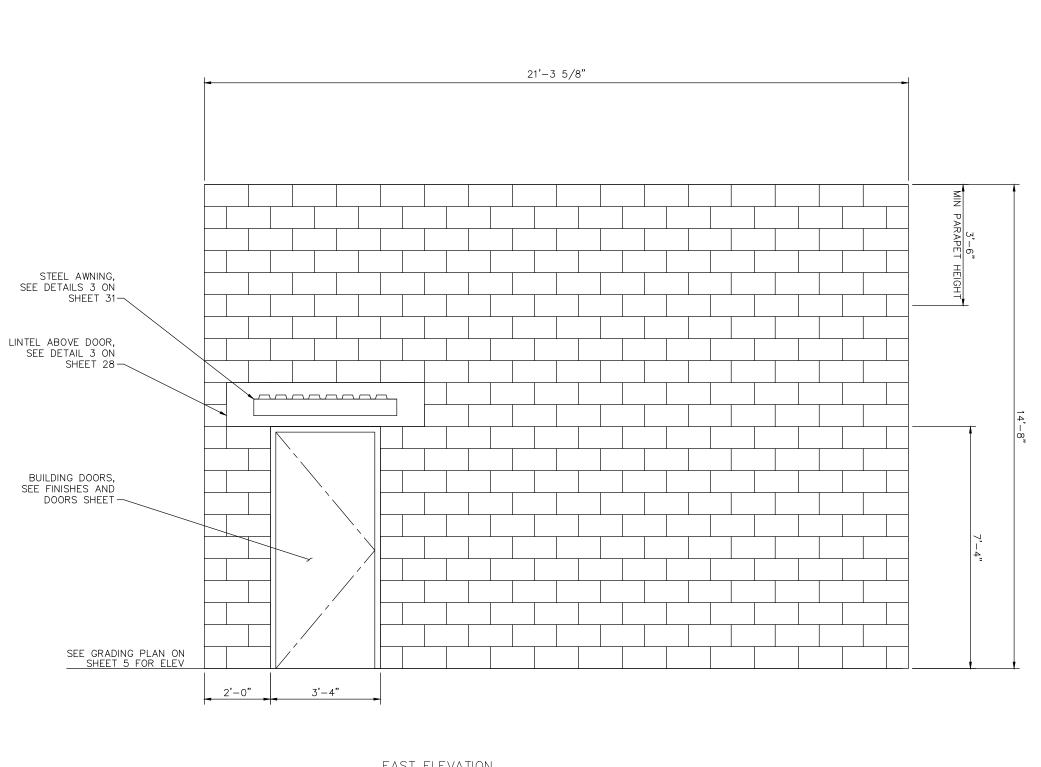

EAST ELEVATION SCALE: 3/4" = 1'-0"

REVISIONS


APPR. DATE



Kimley»Horn <sup>55</sup> 401 B Street, Suite 600, San Diego, CA 92101 Phone: (619) 234-9411 WWW.KIMLEY-HORN.COM








Reviewed By:Staff Engineer	Date:	
Recommended for Approval By:Administrative Engineer		{
Approved By:City Engineer/Director of Public Works	Date:	
CITY OF BEAUMONT, PUBLIC WORKS DEPARTMEN ENGINEERING DIVISION TEL: (951)	T 550E. 6th St Beaumont, CA 92223 769-8520 FAX: (951) 769-8526	_

CITY OF BEAUMONT, CALIFORNIA IMPROVEMENT PLANS FOR: BEAUMONT CROSSROADS OF <u>38</u> SHEETS
FILE NO:
3387 LIFT STATION MCC BUILDING ELEVATION III

SHEET

21'-3 5/8"



- 1 BAR, TYP

  NOTES:

  1. UNLESS NOTED OTHERWISE ON THE DRAWINGS, REINFORCE ALL CMU WALL WITH (1) #5 BAR © 24" O.C.

  2. PROVIDE VERT REINF AND GROUT PER NOTE 1 IN THE ADJACENT 2 CELLS ON BOTH SIDES OF ALL OPENINGS & ENDINGS.


  3. VERTICAL BARS ARE TO EXTEND A MIN OF 6" INTO THE BOND BEAM AT THE TOP OF WALL. BOND BEAMS SHALL BE REINFORCED WITH CONTINUOUS BARS ALONG BEAM PER TYPICAL DETAIL.

  4. ALL CMU SHALL BE FULLY GROUTED.

  5. PROVIDE AN OPEN BOTTOM BOND BEAM REINF WITH (1) #5 CONT BARS AT THE FOLLOWING LOCATIONS:


  o) AT THE TOP OF ALL WALL ELEVATIONS.



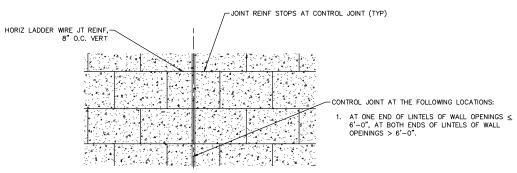

NOTES:
1. CONTROL JOINTS MAY BE OFFSET A MAXIMUM DISTANCE OF 8" CROSS WIRES WITHIN THIS OFFSET SHALL BE CUT.

# ELEVATION

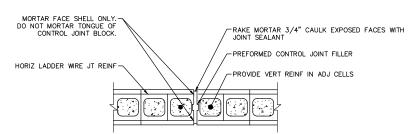

NOTES: 1. WIDE FLANGED PREFORMED CONTROL JOINT FILLER MAY BE USED IN LIEU OF DETAIL SHOWN.

CMU WALL CONTROL JOINT

WEST ELEVATION

SCALE: 3/4" = 1'-0"




SEE GRADING PLAN ON SHEET 5 FOR ELEV






401 B Street, Suite 600, San Diego, CA 92101 Phone: (619) 234-9411 WWW.KIMLEY-HORN.COM






	Reviewed By:Staff Engineer	Date:	
	Recommended for Approval By:Administrative Engineer	Date:	Е
	Approved By:City Engineer/Director of Public Works		
	CITY OF BEAUMONT, PUBLIC WORKS DEPARTMEN ENGINEERING DIVISION	T 550E. 6th St Beaumont, CA 92223 769-8520 FAX: (951) 769-8526	
_	166 (801)	.00 0020 (801) 708-0020	


CITY OF BEAUMONT, CALIFORNIA SHEET IMPROVEMENT PLANS FOR: BEAUMONT CROSSROADS OF <u>38</u> SHEETS LIFT STATION FILE NO: 3387 MCC BUILDING ELEVATION IV

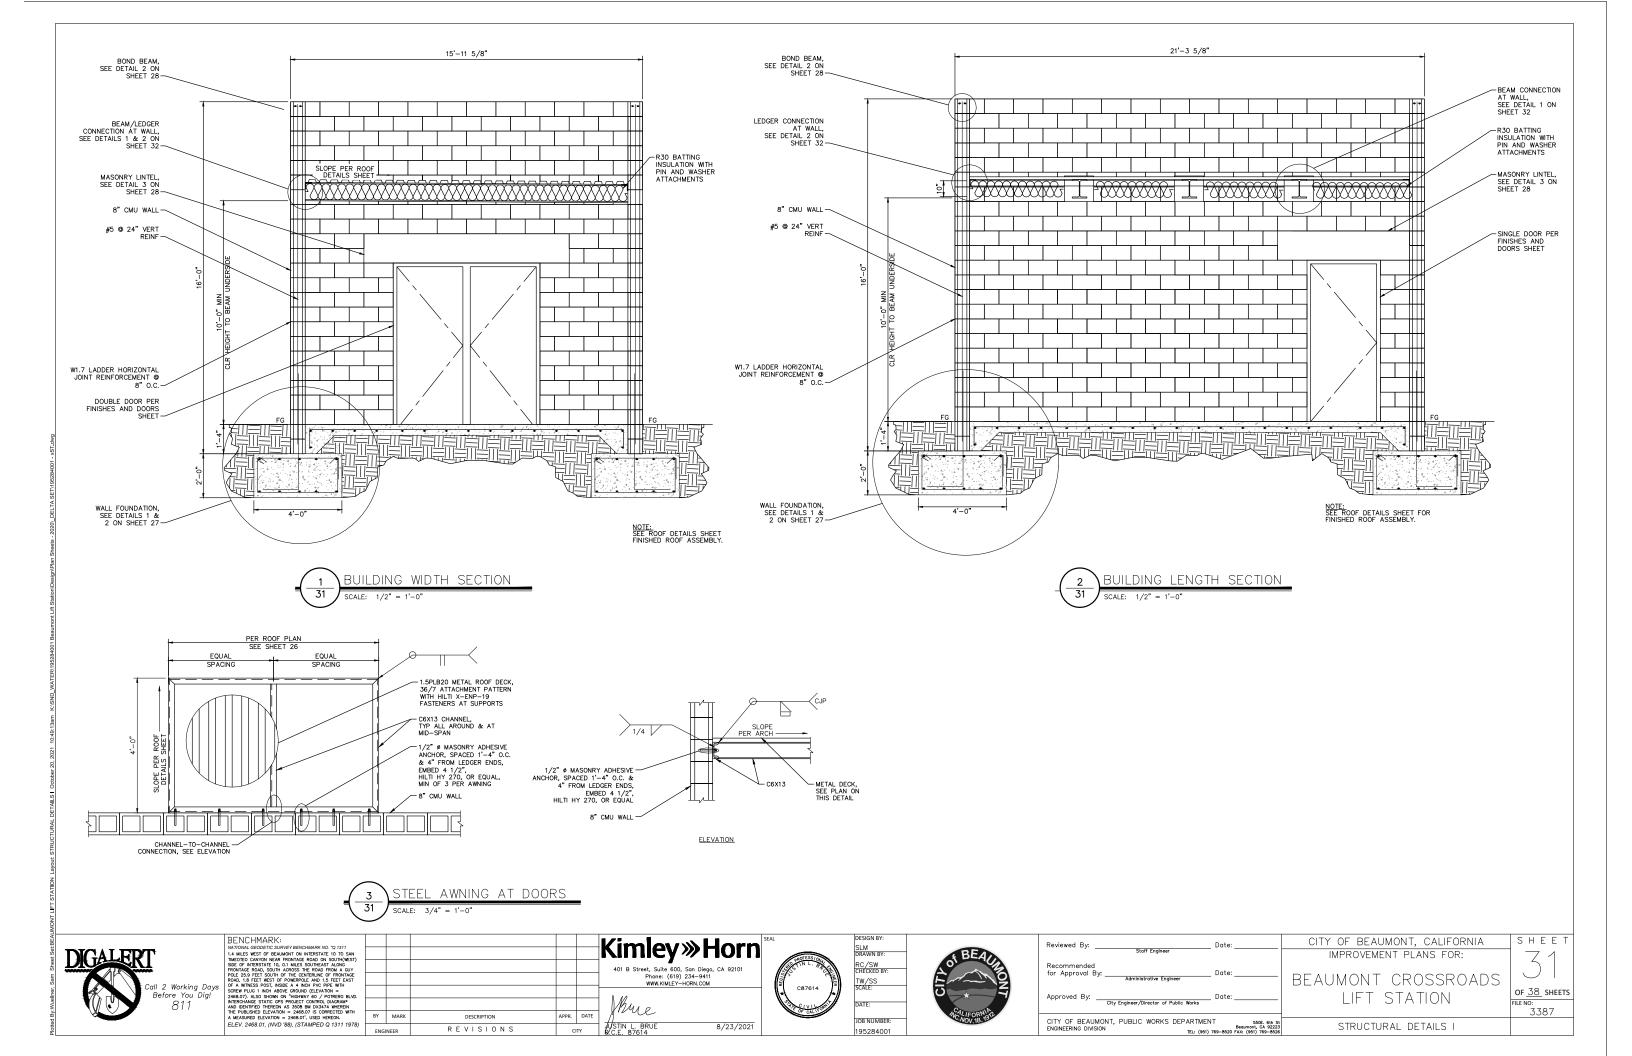

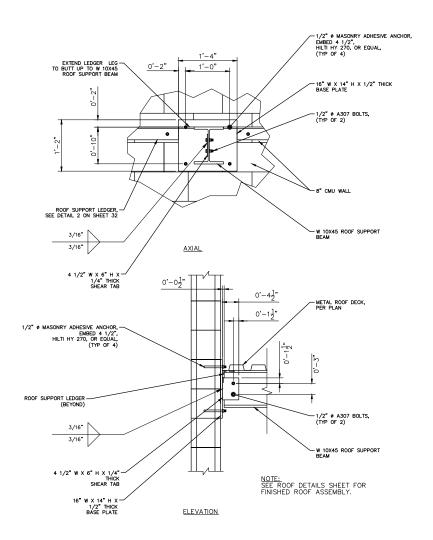

BEAM CONNECTION DETAIL

SCALE: 3/4" = 1'-0"

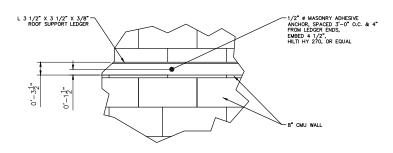

NOTE:
SEE ROOF DETAILS SHEET FOR
FINISHED ROOF ASSEMBLY.

METAL ROOF DECK,
PER PLAN

W 10X45 ROOF DECK,
PER PLAN

METAL ROOF DECK

AXIAL

LEDGER CONNECTION DETAIL

SCALE: 3/4" = 1'-0"

DIGALERT  Call 2 Working Days Before You Dig!	
Before You Dig! 811	

MATIONAL GEOGRES GENERAL SENSITIATION OF 2511


AT MALES SEST DE BAUNDOT ON INTERSTATE 10 TO SAN THACOTO CANYON NEAR PROFITAGE ROAD ON SOUTHWEST)

BOG OF INTERSTATE 10, OI MILES SOUTHEAST ALONG PROFILES ROAD, SOUTH ARRONDERS ROAD FROM A GUY PROFILE OF PROVINGE ROAD, SOUTH OF THE CENTERNE OF PROVINGE ROAD, 13 FEET MEST OF POMEPOLE, AND 1.5 FEET EAST SOUTH OF THE CHARLES AND 1.5 FEET EAST SOUTH OF SPECIAL CONTINGUING MARKAWARD ENTIFIED THEREON AS 3506 BIN DOSL'AT WEEREN THE PUBLISHED ELEVATION = 2466.07, 1950 HEREON HAVE ALEXED ELEVATION = 2466.07,

BY MARK DESCRIPTION APPR. DATE
ENGINEER REVISIONS

| Columbia | Co





	Re
UE	Re fo
4	Αp
SIZ.	CI

Reviewed By: Date:	CITY
Recommended for Approval By: Date:	BEAL
Approved By:City Engineer/Director of Public Works Date:	
CITY OF BEAUMONT, PUBLIC WORKS DEPARTMENT SSOE. 6th st ENGINEERING DIVISION TEL: (951) 769-8520 FAX: (951)	


CITY OF BEAUMONT, CALIFORNIA

IMPROVEMENT PLANS FOR:


EAUMONT CROSSROADS

LIFT STATION

STRUCTURAL DETAILS II

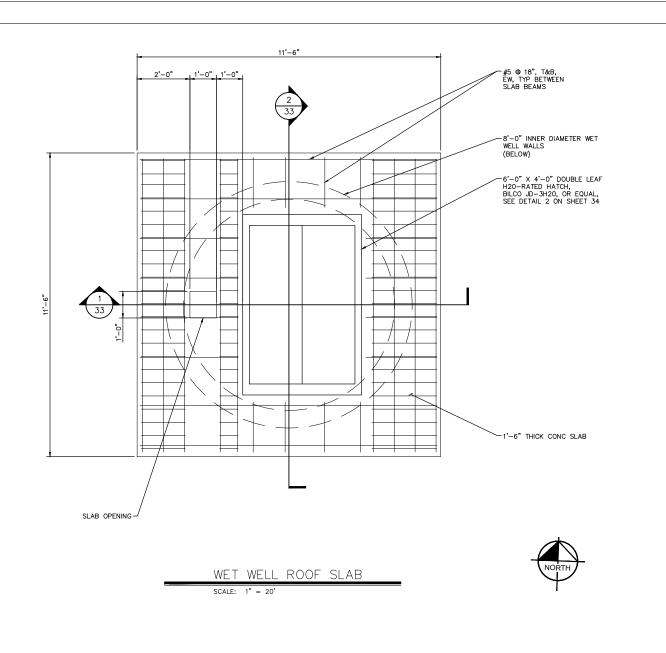

#4 TIES @ 6",-11'-6" -6'-0" X 4'-0" DOUBLE LEAF H20-RATED HATCH, BILCO JD-3H20, OR EQUAL, SEE DETAIL 2 ON SHEET 34 #7 @ 12", T&B,-WET WELL WALLS (2) - #7, T&B

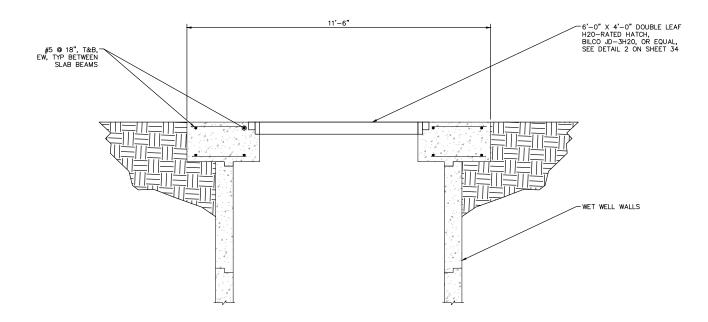


WET WELL ROOF SLAB SECTION

WET WELL ROOF SLAB SECTION



APPR. DATE REVISIONS




Mue





Reviewed By:Staff Engineer	Date:	
Recommended for Approval By:	Date:	l BE
Approved By:City Engineer/Director of Public Works	Date:	
CITY OF BEAUMONT, PUBLIC WORKS DEPARTMEN ENGINEERING DIVISION TEL: (951)	T 550E. 6th St Beaumont, CA 92223 769-8520 FAX: (951) 769-8526	

CITY OF BEAUMONT, CALIFORNIA SHEET IMPROVEMENT PLANS FOR: EAUMONT CROSSROADS OF <u>38</u> SHEETS LIFT STATION FILE NO: 3387 WET WELL SLAB

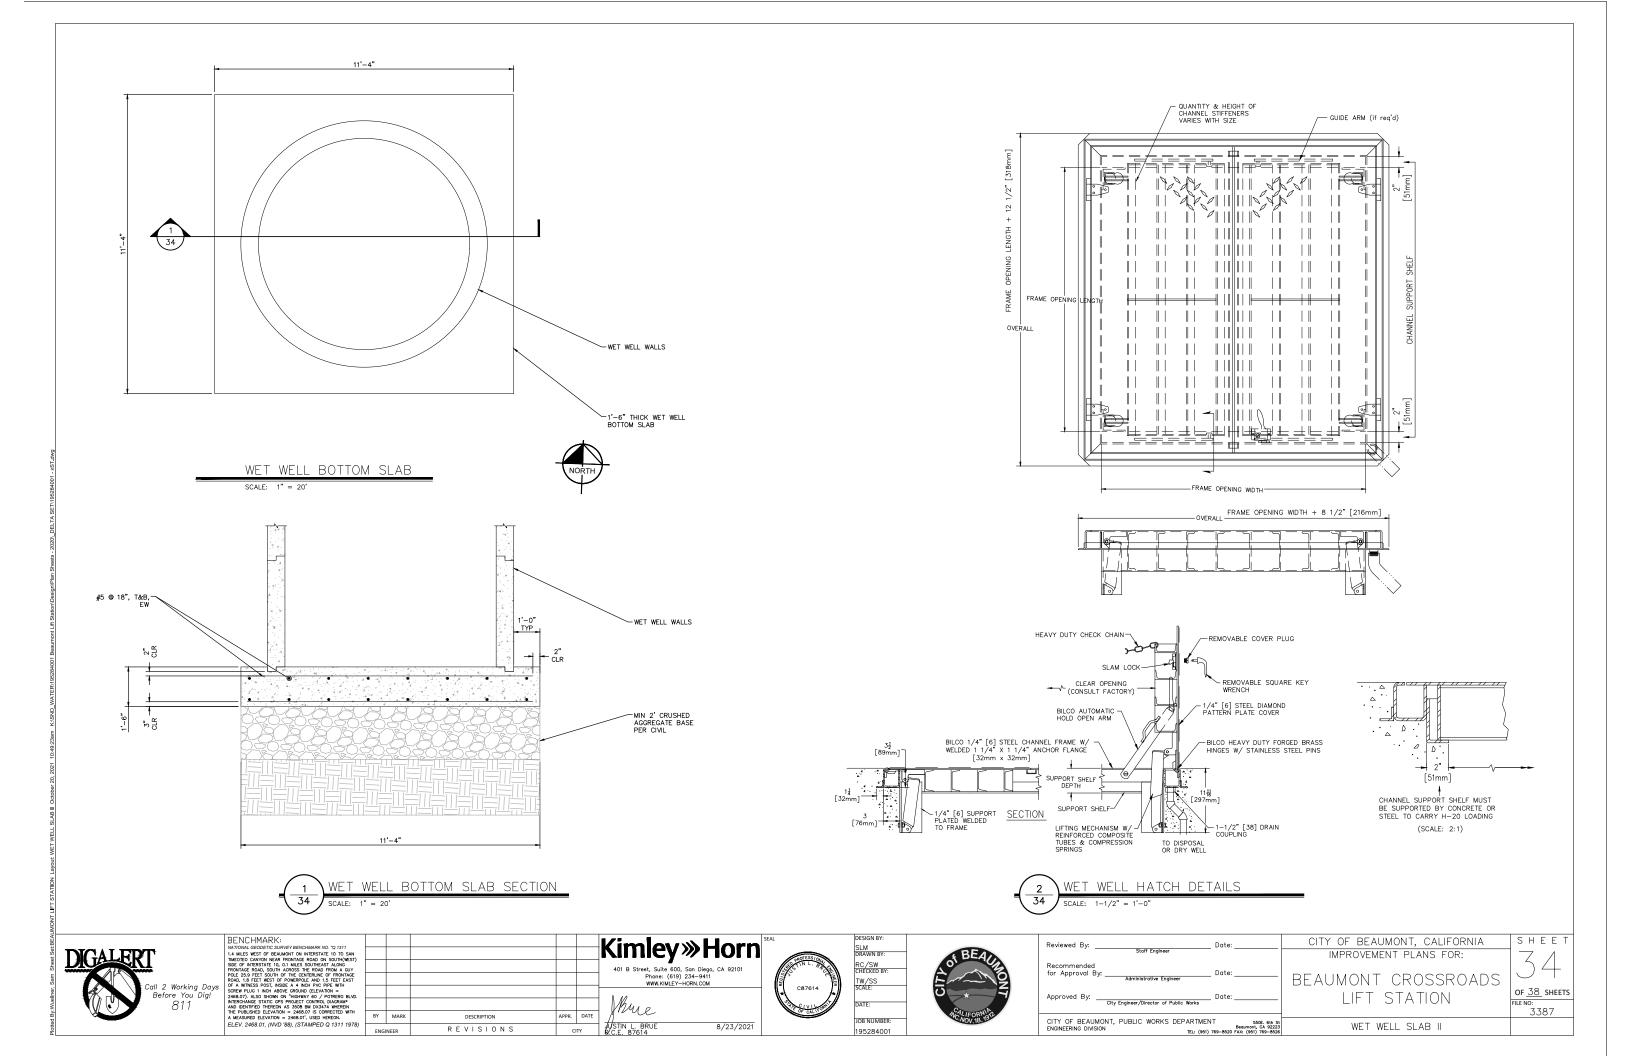

### A. GENERAL

- THE INFORMATION INDICATED ON THESE DRAWINGS AS EXISTING IS BASED UPON INFORMATION TAKEN FROM AS-BUILT DRAWINGS, AND FIFLD INVESTIGATION, THE PLANS DO NOT GUARANTEE ACCURACY BUT ARE ONLY AN INDICATION OF EXISTING CONDITIONS. IT IS THE CONTRACTOR'S RESPONSIBILITY TO FIELD VERIFY EXACT CONDITIONS SUCH AS EQUIPMENT PLACEMENT, DUCTWORK (SIZE, ROUTING, AND ELEVATION), PIPING (SIZE ROUTING, AND ELEVATION), ETC. THE DRAWINGS ARE INTENDED TO PROVIDE THE CONTRACTOR AN INDICATION OF THE SYSTEM INSTALLED IN THE FACILITY TO DATE. IT WILL BE THE CONTRACTOR'S RESPONSIBILITY TO MAKE ADJUSTMENTS TO THE DRAWING INFORMATION AS REQUIRED TO MATCH EXISTING FIELD CONDITIONS.
- 2. THE CONTRACTOR SHALL INSTALL THE NEW EQUIPMENT, ROOF CURB, AND PIPING AROUND ALL EXISTING OBSTACLES INCLUDING: ELECTRICAL CONDUIT, DOMESTIC WATER PIPING. WASTE AND VENT PIPING, ACID WASTE AND VENT PIPING, AND FIRE SPRINKLER PIPING. PROVIDE OFFSETS TO AVOID RELOCATION OF OTHER UTILITIES. RELOCATE UTILITIES IF THEY ARE IN CONFLICT WITH THE MECHANICAL SYSTEM INSTALLATION, CAUSE DEVIATIONS IN THE DESIGN INTENT, UNSATISFACTORY OPERATION, NOISY CONDITIONS, OR INTERFERE WITH MAINTENANCE. IT IS THE MECHANICAL CONTRACTOR'S RESPONSIBILITY TO COORDINATE ANY UTILITY RELOCATION WITH THE APPROPRIATE SUBCONTRACTOR.
- 3. PROVIDE ALL NECESSARY LABOR, MATERIALS, EQUIPMENT, SERVICES AND INSURANCES TO COMPLETE THE HEATING AND AIR CONDITIONING WORK WITHIN THE FULL INTENT OF THE DRAWINGS AND SPECIFICATIONS CONTAINED HEREON AND TO THE ENTIRE SATISFACTION
- 4. PROVIDE ALL PERMITS AND FEES AS REQUIRED FOR THE MECHANICAL WORK.
- 5. CONTRACTOR SHALL VISIT THE SITE AND BECOME FAMILIAR WITH THE PROJECT BEFORE
- ALL WORK SHALL BE IN ACCORDANCE WITH THE 2018 INTERNATIONAL BUILDING CODE (IBC), 2018 INTERNATIONAL ENERGY CONSERVATION CODE (IECC), 2018 INTERNATIONAL FIRE CODE (IFC), 2018 UNIFORM MECHANICAL CODE (UMC), 2018 UNIFORM PLUMBING CODE (UPC), 2017 NATIONAL ELECTRICAL CODE (NEC), NATIONAL FIRE PROTECTION ASSOCIATION (NFPA) STANDARDS, AND ALL OTHER APPLICABLE CODES, RULES, AND LOCAL REQUIREMENTS
- 7. GUARANTEE ALL WORK AND MATERIALS FOR A PERIOD OF ONE YEAR
- ALL DIMENSIONS AND MEASUREMENTS SHALL BE VERIFIED AT THE JOBSITE BEFORE FABRICATION AND/OR INSTALLATION OF THE EQUIPMENT.
- PROVIDE AND INSTALL ALL EQUIPMENT, PIPING, AND CONTROLS AS SHOWN ON THE

# B. SUBMITTALS

- 1. ELECTRONIC SUBMITTALS IN A PDF FORMAT, IN LIEU OF PAPER COPIES, WILL BE ACCEPTABLE.
- SUBSTITUTED ITEMS SHALL BE SUBMITTED WITH MANUFACTURER'S DESCRIPTIVE DATA AND MUST SHOW FOUALITY TO FOUIPMENT SPECIFIED. INFORMATION ON SUBSTITUTED ITEMS MUST. BE COMPLETE, INCLUDING, BUT NOT LIMITED TO: DESIGN, CONSTRUCTION MATERIALS, CONSTRUCTION QUALITY, AND SOUND LEVELS. ENGINEER WILL NOT RESEARCH INFORMATION REQUIRED TO COMPARE EQUIPMENT. ENGINEER RESERVES THE RIGHT TO REQUIRE SPECIFIED
- SUBMIT MANUFACTURER'S DESCRIPTIVE DATA WITHIN TEN (10) WORKING DAYS AFTER AWARD OF THE CONTRACT. MATERIALS AND EQUIPMENT SHALL NOT BE ORDERED PRIOR TO SUBMITTAL APPROVAL. ALLOW TEN (10) WORKING DAYS AFTER RECEIPT OF SUBMITTALS IN THE ENGINEER'S OFFICE BEFORE REVIEWED SUBMITTALS WILL BE RETURNED.
- UPON COMPLETION OF THE PROJECT, AND PRIOR TO FINAL ACCEPTANCE PAYMENT, SUBMIT AS-BUILT DRAWINGS AND OPERATING AND MAINTENANCE INSTRUCTIONS.

## C. WORKMANSHIP

- ALL WORK TO BE PERFORMED BY QUALIFIED PERSONNEL NORMALLY ENGAGED IN THE RESPECTIVE LINE OF WORK.
- 2. PERFORM ALL WORK IN A MANNER NOT TO DISTURB THE NORMAL OPERATION OF THE
- 3. COORDINATE ALL WORK WITH THE OWNER'S REPRESENTATIVE.
- 4. COORDINATE ALL WORK WITH THE OTHER TRADES.
- THE MECHANICAL CONTRACTOR IS RESPONSIBLE FOR PERFORMING ALL WORK ACCEPTABLE TO THE OWNER'S REPRESENTATIVE.

1. DEMOLITION WORK SHALL NOT CREATE ANY DUST PROBLEMS IN THE WORKING SPACES.

# E. CUTTING, PATCHING, AND PAINTING

- 1. ALL CUTTING AND PATCHING TO BE PERFORMED BY THE GENERAL CONTRACTOR.
- 2. CUTTING OF ALL OPENINGS SHALL BE COORDINATED WITH THE OWNER'S ENGINEERING REPRESENTATIVE
- 3. WALL SURFACES SHALL BE PRIMED AND PAINTED. PAINT TYPE AND COLOR SHALL BE AS SPECIFIED BY THE OWNER'S REPRESENTATIVE.

### F. PRODUCT HANDLING

- USE ALL MEANS NECESSARY TO PROTECT ALL MATERIALS AND EQUIPMENT BEFORE, DURING, AND AFTER INSTALLATION AND TO PROTECT THE MATERIALS AND WORK OF THE OTHER
- IN THE EVENT OF DAMAGE, IMMEDIATELY MAKE ALL REPAIRS AND REPLACEMENTS NECESSARY TO THE APPROVAL OF THE ENGINEER AND AT NO ADDITIONAL COST TO THE OWNER

### G. SEISMIC RESTRAINTS

- ALL EQUIPMENT, PIPING, AND CONDUIT SHALL BE SEISMICALLY RESTRAINED PER THE 2018
- REFERENCES: INTERNATIONAL BUILDING CODE (IBC) SECTION 1613.1, AMERICAN SOCIETY OF CIVIL ENGINEERS (ASCE 7) SECTION 13.6, SHEET METAL AND AIR CONDITIONING CONTRACTOR'S NATIONAL ASSOCIATION (SMACNA) SEISMIC RESTRAINT MANUAL, AND AMERICAN SOCIETY OF PLUMBING ENGINEERS (ASPE) PLUMBING ENGINEERING DESIGN

### H. EQUIPMENT

- EQUIPMENT SHALL BE AS SPECIFIED IN THE EQUIPMENT SCHEDULE OR AN APPROVED EQUAL
- INSTALL EQUIPMENT PER MANUFACTURER'S INSTRUCTIONS.
- CONTRACTOR SHALL PROVIDE ALL PENETRATION OPENINGS IN ROOF FOR ALL PIPING AND CONDUIT REQUIREMENTS.
- 4. ALL UNITS ON ROOF SHALL BE SET ON LEVEL CURBS OR SUPPORTS AT ROOF.
- SECURELY FASTEN ALL EQUIPMENT TO PREVENT MOVEMENT DUE TO WIND OR SEISMIC

## N. PIPING

FOLIPMENT DRAIN PIPING TO BE TYPE 'M' HARD DRAWN COPPER WITH WROT COPPER FITTINGS. USE 95/5 SOLDER. SLOPE PIPING 1/8" PER FOOT TOWARDS DRAIN.

### T. REFRIGERANT PIPING

- REFRIGERANT PIPING SHALL BE ACR COPPER. LINESET INSULATION TO BE INCLUDED BY
- ALL JOINTS SHALL BE BRAZED WITH SIL-FOS OR EQUAL UNDER A NITROGEN PURGE.
- CHARGING OF SYSTEM: TEST ALL REFRIGERANT PIPING WITH 150 PSI CHARGE OF NITROGEN AFTER FIRST ISOLATING ANY CONTROLS, ETC., THAT ARE NOT RATED FOR 150 PSI. TEST ALL JOINTS WITH A SOAP SOLUTION. EVACUATE SYSTEM AND CHARGE SYSTEM WITH REFRIGERANT. RETEST SYSTEM WITH AN ELECTRONIC GAS DETECTOR. MAKE ALL FINAL ADJUSTMENTS TO REFRIGERANT SYSTEM AS REQUIRED.
- 4 AFTER SYSTEM HAS BEEN LEAK TESTED AND CHARGED INSULATE ALL SLICTION PIPING WITH RUBATEX R-180 FS OR EQUAL 1/2" THICK CLOSED CELL FOAM INSULATION MEETING ALL NFPA REQUIREMENTS FOR SMOKE DENSITY AND FLAME SPREAD.
- ALL OUTDOOR SECTIONS SHALL BE COATED WITH AN ULTRAVIOLET AND WEATHER RESISTIVE COATING.

## U. OTHER MATERIAL

ALL OTHER MATERIAL, NOT SPECIFICALLY DESCRIBED BUT REQUIRED FOR A COMPLETE JOB, SHALL BE NEW AND FIRST QUALITY, FURNISHED AND INSTALLED BY THE MECHANICAL

## W. IDENTIFICATION

PLASTIC NAMEPLATES: LAMINATED THREE LAYER WITH ENGRAVED BLACK LETTERS ON A LIGHT CONTRASTING BACKGROUND COLOR, INSTALL PLASTIC NAMEPLATES WITH CORROSION RESISTANT MECHANICAL FASTENERS OR ADHESIVE

### Y. RELATED WORK

ELECTRICAL CONTRACTOR TO PROVIDE AND INSTALL ALL POWER WIRING AND EQUIPMENT DISCONNECTS, UNLESS INCLUDED WITH EQUIPMENT, TO MAKE SYSTEM OPERATIONAL.

### 7 CONTROLS

1. THERMOSTATS TO BE FURNISHED AND INSTALLED BY HVAC CONTRACTOR.

# MECHANICAL SYMBOL LIST

(NOTE: ALL OF THE SYMBOLS INDICATED BELOW MAY NOT APPEAR ON THIS PROJECT

.01 // (1110/				
- RL	RL	REFRIGERANT LIQUID PIPING	CLG	CEILING
RS ——	RS	REFRIGERANT SUCTION PIPING	DB	DRY BULB TEMPERATURE
<b></b>	U	UNION	DDC	DIRECT DIGITAL CONTROL
÷	P.D.	PIPING TEE DOWN	DL	DOOR LOUVER
<del>-</del>	P.U.	PIPING TEE UP	DN	DOWN
	P.U.	PIPING ELBOW UP	(E)	EXISTING
	P.D.	PIPING ELBOW DOWN	EAT	ENTERING AIR TEMPERATURE
		BRANCH - TOP CONNECTION	EDB	ENTERING DRY BULB
<u> </u>		BRANCH - BOTTOM CONNECTION	°F	DEGREES FARENHEIT
OR		ARROW INDICATES DIRECTION OF FLOW	F.A.	FROM ABOVE
	P.O.C.	POINT OF CONNECTION - NEW ITEMS TO EXISTING ITEMS	F.B.	FROM BELOW
	S.A.	SUPPLY AIR DUCT DOWN	FT.	FEET
	S.A.	SUPPLY AIR DUCT UP	LAT	LEAVING AIR TEMPERATURE
	R.A.	RETURN AIR DUCT DOWN	HVAC	HEATING, VENTILATION, AND AIR CONDITIONING
	R.A.	RETURN AIR DUCT UP	MAX	MAXIMUM
	E.A.	EXHAUST AIR DUCT DOWN	MBH	BRITISH THERMAL UNITS PER HOUR (THOUSANDS)
	E.A.	EXHAUST AIR DUCT UP	MIN	MINIMUM
<b>}</b> ₩	S.A.D.	SUPPLY AIR DIFFUSER WITH FLEX CONNECTION	(N)	NEW
]	R.A.G.	RETURN AIR GRILLE OPEN TO CEILING SPACE	NFPA	NATIONAL FIRE PROTECTION ASSOCIATION
<u>₹Q</u>		MECHANICAL EQUIPMENT INDICATED (SEE SCHEDULE)	RL/RS	REFRIGERANT LIQUID LINE / REFRIGERANT SUCTION LIN
 T)	T.	THERMOSTAT	S.E.E.R.	SEASONAL ENERGY EFFICIENCY RATIO
R	R.	ROOM TEMPERATURE SENSOR	SP	STATIC PRESSURE
	ACR	AIR CONDITIONING AND REFRIGERATION	STD	STANDARD
	AFF	ABOVE FINISHED FLOOR	Т	TEMPERATURE
	AFG	ABOVE FINISHED GRADE	T.A.	TO ABOVE
	BDD	BACKDRAFT DAMPER	T.B.	TO BELOW
	BTUH	BRITISH THERMAL UNITS PER HOUR	TYP	TYPICAL
	CFM	CUBIC FEET PER MINUTE	WB	WET BULB TEMPERATURE

ELECTRICAL		
VOLTS/Ø/Hz MCA MC	MOCP	
208/1/60 8 1:	15	
-	VOLTS/Ø/Hz MCA	

SENERAL NOTES

- ALL CAPACITIES LISTED ARE AT 0 FEET ELEVATION
- PROVIDE AND INSTALL MANUFACTURER'S REFRIGERANT LINESET
- SET FAN SPEED TO MEDIUM

### STANDARD FEATURES:

- REFRIGERANT SHALL BE R-410A

PROVIDE AND INSTALL MANUFACTURER'S PROGRAMMABLE T-STAT

INVERTER VARIABLE SPEED COMPRESSOR MINIMUM LINE LENGTH OF 9.8 FEET, MAX LINE LENGTH OF 49.2 FEET WITH NO

CITY OF BEAUMONT, CALIFORNIA IMPROVEMENT PLANS FOR:

BEAUMONT CROSSROADS LIFT STATION

3387

SHEE

OF 38 SHEETS

REVISIONS

**Kimley Morn** B Street, Suite 600, San Diego, CA 9210 Phone: (619) 234-9411 APPR. DAT 8/23/2021









CITY OF BEAUMONT, PUBLIC WORKS DEPARTMENT

MECHANICAL NOTES AND SCHEDULES

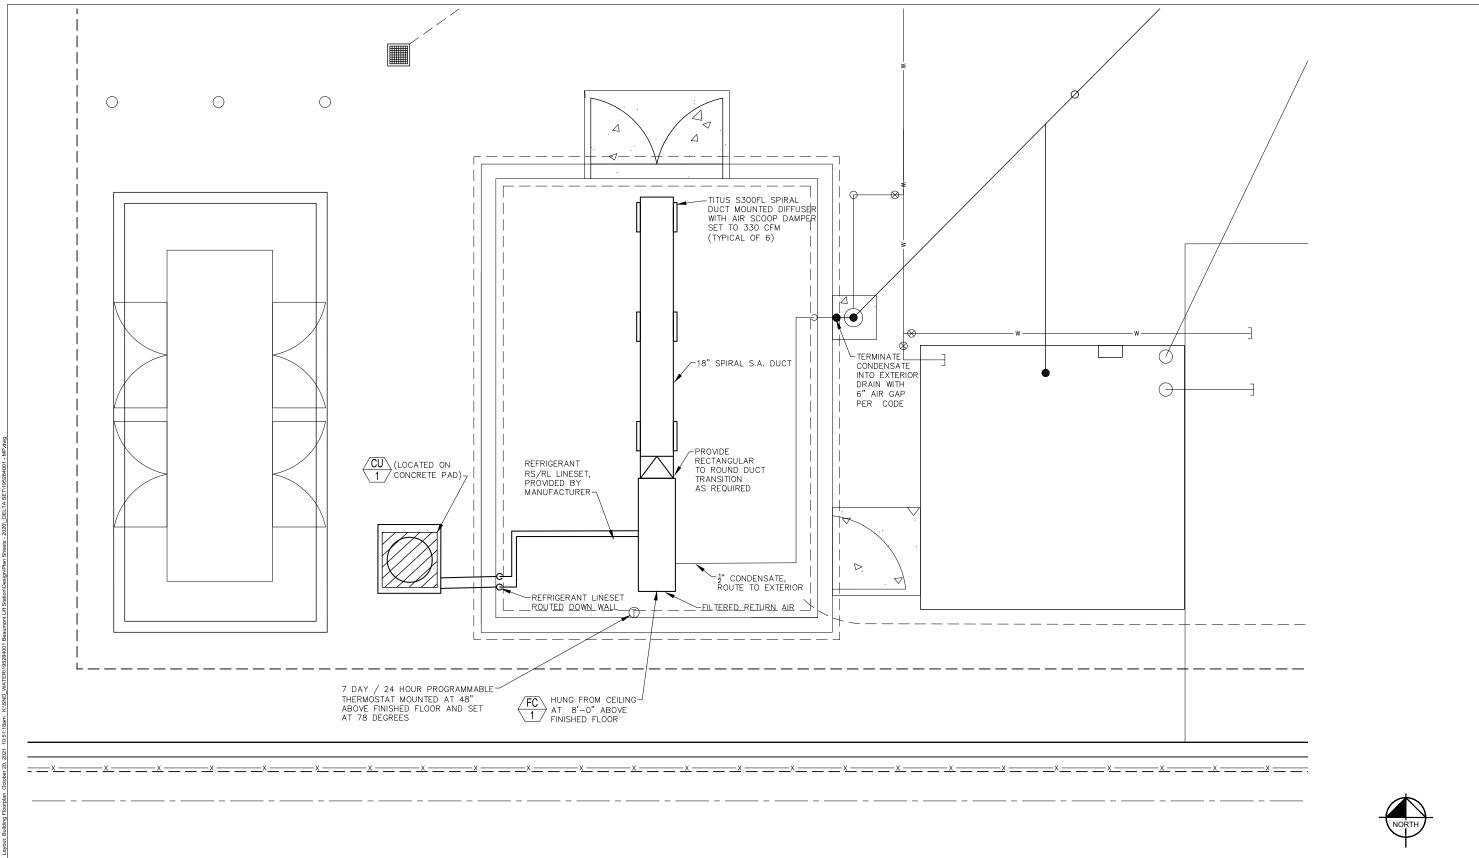



MCC BUILDING - MECHANICAL FLOOR PLAN



AMPED Q 1311 1978)		
07 IS CORRECTED WITH ', USED HEREON.	BY	MA
CONTROL DIAGRAM* BM DX3474 WHEREIN		
D (ELEVATION = AY 60 / POTRERO BLVD.		
NTERLINE OF FRONTAGE LE AND 1.5 FEET EAST CH PVC PIPE WITH		
SOUTHEAST ALONG HE ROAD FROM A GUY		
HMARK NO. "Q 1311 INTERSTATE 10 TO SAN ROAD ON SOUTH(WEST)		
		l

,						Kimley»Horn
SAN MEST)						
GUY FAGE FAST						401 B Street, Suite 600, San Diego, CA 92101 Phone: (619) 234-9411 WWW.KIMLEY-HORN.COM
BLVD.  *						MI M -
WITH	BY	MARK	DESCRIPTION	APPR.	DATE	1 +112-647
1978)	ENGI	NEER	REVISIONS	CI	TY	MATTHEW¹C. MYRES 8/23/2021 R.C.E. 33152



LM	
RAWN BY:	& BEA
C/SW HECKED BY:	0
W/SS CALE:	
CALE:	0
ATE:	Complete
	ACALIFORNIA CNOW 18 19
OB NUMBER:	WOV.10.


Reviewed By:
Recommended for Approval By:
Approved By:
CITY OF BEAUMONT

Reviewed By: Date:	CITY OF BEAUMONT, CALIFORNIA
Staff Engineer	IMPROVEMENT PLANS FOR:
Recommended for Approval By:Administrative Engineer Date:	BEAUMONT CROSSROAD
Approved By: Date:	LIFT STATION
CITY OF BEAUMONT, PUBLIC WORKS DEPARTMENT 550E 6th St	MECHANICAL ELOOPDIANI

IMPROVEMENT PLANS FOR: BEAUMONT CROSSROADS LIFT STATION

MECHANICAL FLOORPLAN


SHEET OF 38 SHEETS
FILE NO:
3387



(01B) 2'-0" TYPE A HM PAIR WITH 1/2" CLEAR TYPE B HM PAIR WITH 1/2" CLEAR INSULATED LITE INSULATED LITE

DOOR HARDWARE SET 1 - EXTERIOR PAIR

1 SADDLE THRESHOLD

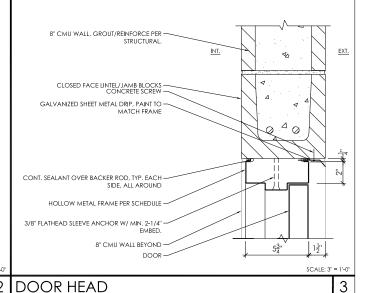

NORTH ELEVATION

PAINT

**LEGEND** 

SHERWIN WILLIAMS

EXTERIOR FINISH ELEVATIONS

	COLOR/MATERIAL LEGEND											
-												
CODE	MATERIAL NAME	MANUFACTURER	PRODUCT	COLOR	SIZE	NOTES						
CMU-1	SPLIT FACE CMU	ANGELUS BLOCK CO, INC.	-	SANDSTONE	8X8X16	PROVIDE ANTI-GRAFFITI COATING						
CMU-2	PRECISION CMU	ANGELUS BLOCK CO, INC.	=	SANDSTONE	8X8X16	PROVIDE ANTI-GRAFFITI COATING						
CMU-3	SPLIT RIBBED CMU - 4 RIB	ANGELUS BLOCK CO, INC.	_	SANDSTONE	8X8X16	PROVIDE ANTI-GRAFFITI COATING						

SOUTH ELEVATION

SW 7548 PORTICO

DOOR SCHEDULE																
DOOR							FRAME									
MARK	TYPE	SIZE (FT-IN)			MAT. FIN.		-IN) MAT. FIN.		MAT.	FIN.		DETAIL			HARDWRE	COMMENTS
W/ d dic		WIDTH	HEIGHT	THICKNESS	1017 (1.		1017 (1.	1 114.	HEAD	JAMB	SILL	RATING LABEL	SET#	SOMMENTS		
01A	1	6'-0"PR	7'-0''	1-3/4"	НМ	PT-1	НМ	PT-1	3/THIS SHEET	5/THIS SHEET	4/THIS SHEET		1			
01B	2	3'-0"	7'-0''	1-3/4"	НМ	PT-1	НМ	PT-1	3/THIS SHEET	5/THIS SHEET	4/THIS SHEET		2			

- Provide hardware for all openings, whether specified or not, in compliance with NFPA Standard No. 80, proper operation and local building code requirements. Where required, provide only hardware which has been tested and listed by UL or FM for types and sizes of doors required and complies with requirements of door and door frame labels. Label hardware, as required, for compliance with pressure testing criteria as dictated in
- Provide hardware which meets or exceeds handicap accessibility per local building code requirements. Conform to the Americans with Disabilities Act (ADA) of 1990 as amended by the D.O.J. September 15, 2010, as adopted by the Authority Having Jurisdiction (AHJ).
- Base Metals: Produce hardware units of basic metal and forming method indicated, using manufacturer's standard metal alloy, composition, temper and hardness, but in no case of lesser (commercially recognized) quality than specified for applicable hardware units by applicable ANSI A 156 series standard for each type hardware item and with ANSI A 156.18 for finish designations indicated. Do not furnish "optional" materials or
- forming methods for those indicated, except as otherwise specified.

  Fasteners: Provide hardware manufactured to conform to published templates, generally prepared for machine screw installation. Do not provide hardware which has been prepared for self tapping sheet metal screws, except as specifically indicated.
- Screws: Furnish screws for installation, with each hardware item. Provide Phillips flat head screws except as otherwise indicated. Finish exposed (exposed under any condition) screws to match hardware finish or, if exposed in surfaces of other work, to match finishes of such other work as closely as possible, including "prepared for paint" in surfaces to receive painted finish.
- Concealed Fasteners: Provide concealed fasteners for hardware units which are exposed when door is closed, except to extent no standard units of type specified are available with concealed fasteners. Do not use thru-bolts for installation where bolt head or nut on opposite face is exposed in other work, except where it is not feasible to adequately reinforce the work. In such cases, provide sleeves for each thru-bolt or use sex screw fasteners.
- 5. Hinges: Manufacturer Stanley; Substitutions Hager, McKinney. Provide only template produced units. Furnish Phillips flat head or machine screws for installation of units, Finish screw heads to match surface of hinges.
- Lock cylinders: Manufacturer Best Cormax Patented; Approved Substitutions Match existing system coordinate with the City of Beaumont.All lock cylinders shall be equipped with 7-pin tumbler small format interchangeable core lock cylinders. The interchangeable core shall be removable by a special control key. The control key shall have no cuts in common with grandmaster keys which operate with a shear line completely independent from the shear line of the grandmaster, master, and operating keys. All cores shall have a special limited keyway and shall be removable without removing the cylinder, knob, or core housing of any type lock or lockset. The removable core shall be instantly interchangeable without modification for use in any lock throughout the system. Provide brass construction cores for the construction period. Plastic construction cores are not acceptable. Construction cores shall remain the property of the hardware supplier and will be returned upon inexpolation of the permanent key system. Cylinders shall utilize the manufacturer's patented Cormax keyway. Construct lock cylinder parts from bross larghize/stainless/ steel, or nickel silver
- Keys, keying, and key control: Provide keys of nickel silver only. Deliver keys to the Owner's representative: Send masterkeys to owner views. registered mail direct from hardware supplier. Comply with Owner's written instructions for masterkeying and, except as otherwise indicated, provide individual change keys for each lock which is not designated to be keyed alike with a group of related locks. Grandmaster key all cylinder items to coordinate with the Owner's new patented masterkey system. Permanently inscribe each key with the notation "DO NOT DUPLICATE". Provide cylinder units with concealed key control and keys with visual key control.

MANUFACTURER'S ABBREVIATIONS

BE BEST ACCESS SYSTEMSLOCKS, CYLINDERS NATIONAL GUARD GASKETS, THRESHOLDS

SCALE: 1/4" = 1'-

DOOR TYPES

HINGES FLUSH BOLTS, FLAT GOODS TR TRIMCO

FINISH LIST

SATIN CHROME SATIN STAINLESS STEEL 626/652 PAINTED ALUMINUM

DOORS, FRAMES, FLASHING, OVERHANG FRAME

BEVELED FOUR EDGES - KICK PLATES (TRIMCO) COUNTER SINKING - KICK PLATES (TRIMCO) SSMS/EA STAINLESS MACHINE SCREWS/EXPANSION

SMS-TEKSSELF-DRILLING MACHINE SCREWS (NGP)


6 HINGES 2 FLUSH BOLTS FBB199 4 1/2 X 4 1/2 NRP 3917-12 45H-7D15H PATD 1 LOCKSET 626 2 CLOSER/STOP HD7016 SDS K0050 10" X 2" LDW B4E CS 16 A FHW SMS-TEKS 2 KICK PLATE 1 GASKETING 700 NA SMS-TEKS 1 ASTRAGAL GASKET
2 DOOR SWEEP 200 NA SMS-TEKS
1 SADDLE THRESHOLD 5040 B 426 SSMS/EA DO NOT CUT WEATHERSTRIP - TEMPLATE HARDWARE ACCORDINGLY, ASTRAGA ON INACTIVE LEAF BY DOOR MANUFACTURER. VERIFY THRESHOLD APPLICATION DOOR HARDWARE SET 2 - EXTERIOR SINGLE 3 HINGES FBB199 4 1/2 X 4 1/2 NRF 626 689 630 1 LOCKSET 45H-7D15H PATD HD7016 SDS K0050 10" X 2" LDW B4E CS 1 KICK PLATE DRIP CAP 16 A FHW SMS-TEKS 1 GASKETING 1 DOOR SWEEP 700 NA SMS-TEKS 200 NA SMS-TEKS


SCALE: 3/8" = 1

426 SSMS/EA

DO NOT CUT WEATHERSTRIP - TEMPLATE HARDWARE ACCORDINGLY, VERIFY THRESHOLD APPLICATION. Locksets, latchsets, and privacy sets: Manufacturer - Best 45H; Substitutions - Dorma M9000. Provide manufacturer's standard wrought box strike for each latch or lock bolt. Provide dust-proof strikes for foot bolts, except where not available. At these locations, provide manufacturer's standard recessed strike. Provide roller type strikes where recommended by lock, latch or bolt manufacturer. Provide 3/4" minimum throw of mortise type


- latches and deadbolts used. Cylindrical latches will be 1/2" minimum. Comply with UL requirements for throw of bolts and latch bolts on rated fire openings. Locks and latches shall be warranted for a period of five years. Closers: Manufacturer - Best HD7016; Substitutions - Stanley QDC100. Except as otherwise specifically indicated, comply with the manufacturer's recommendations for size of door control unit, depending on the size of the door, exposure to weather and anticipated frequency of use. Provide manufacturer's standard through bolt attachment at all applications. Provide parallel arms for all overhead closers, except as otherwise indicated. Provide drop plates as needed to prevent glazing interference. Mount all closers to the maximum allowable degree of opening by the closer manufacturer's template. Where closer arms incorporate dead stop features, mount closers to the maximum degree of opening available before conflict with adjacent structures. If not apparent on the contract documents, verify the use of open space with the Architect or Owner's Representative to determine the maximum allowable degree of opening. Door closers and related hardware shall be warranted for a period of twenty-five years
- 10. Protection plates: Manufacturers Trimco; Substitutions Hager, Tice. Provide manufacturer's standard exposed and countersunk Phillips head fasteners for door trim units; either machine screws or self tapping sheet metal type screws per manufacturer's recommendations for application to the specified door construction. Fabricate protection plates (armor, kick or mop) not more than 2" less than door width on stop side and not more than 1" less than door width on pull side, by the height indicated. Stainless Steel, 18 gauge (0.050) thick. Satin finish, US32D (630), beveled four edge
- Gaskets and sweeps: Manufacturer National Guard; Substitutions Pemko, Reese. Except as otherwise indicated, provide continuous weatherstripping at each edge of every exterior door leaf. Provide non-corrosive fasteners as recommended by the manufacturer for applications indicated. Replaceable seal strips: Provide only those units where resilient or flexible seal strip is easily replaceable and readily available from stocks maintained by the manufacturer. Perimeter weatherstripping: Flexible, hollow neoprene bulb or loop insert, conforming to MIL R 6055, Class II, Grade 40. Where two types of perimeter gaskets are specified, apply them not to conflict and per gasket manufacturer's recommendations. Weatherstripping at Door Bottoms: Provide door bottoms consisting of contact type resilient insert and metal housing of design and size indicated. Gaskets and sweeps shall be warranted for a period of three years.
- Thresholds: Manufacturer National Guard: Substitutions- Pemko, Reese, Except as otherwise indicated provide standard metal threshold unit of type, size and profile as detailed or scheduled. All thresholds will be supplied with the SIA abrasive finish unless noted otherwise. Where there is conflict between scheduled thresholds and details, details shall have precedence. Revise details only if necessary to comply with handicap accessibility requirements. Notify the Architect of such required modifications. Verify threshold details or conditions at all openings to ensure that the openings receive proper application. For a period of three years, abrasive coatings shall be warranted for a period of three years, abrasive coatings shall be warranted for a period of ten years.

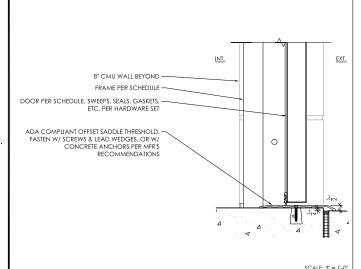

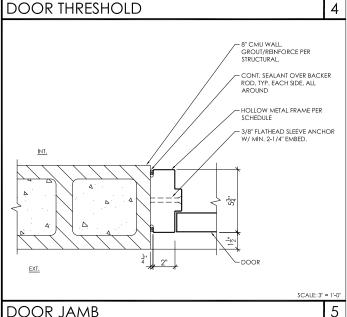




**BENCHMARK** 











CITY OF BEAUMONT, CALIFORNIA SHEE IMPROVEMENT PLANS FOR 3387 BEAUMONT CROSSROADS of <u>38</u> sheets LIFT STATION FINISHES AND DOORS

