


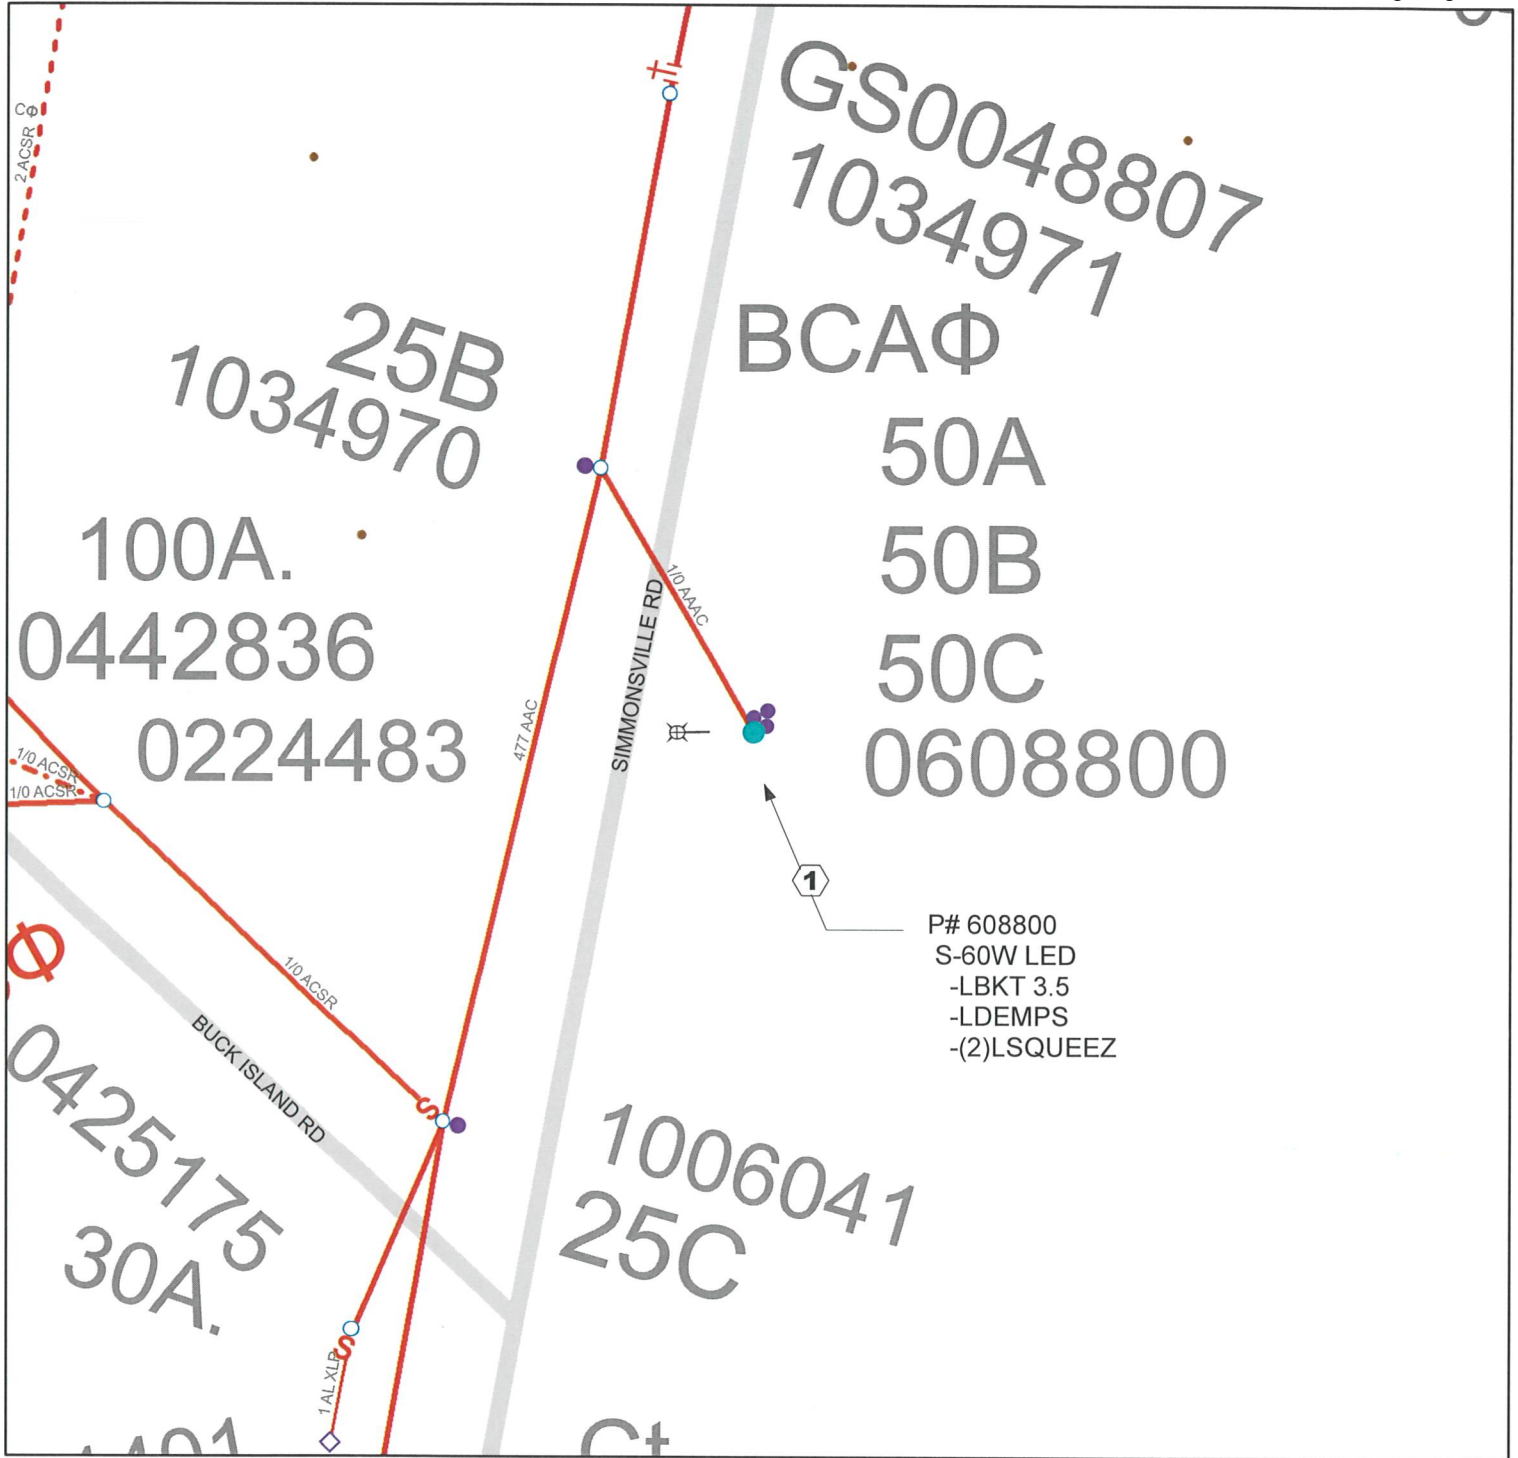

Designer: step847

Design Date: 7/25/2023


TRANSFORMER INSTALLED


Company #	Serial #	KVA	Spec	Type	Ph	Con	RFA

TRANSFORMER REMOVED

Company #	Serial #	KVA	Spec	Type	Ph	Con	RFA

SUB: <u>00486</u>	TRUCK ACCESS? Y / N	R-SWITCH REQUIRED? Y / N	WHITE-X CUST. AFFECTED? Y / N
CKT: <u>60902</u>	PUPS #: _____	CUSTOMER: _____	
SECT: _____	DATE: _____	ADDRESS: <u>SIMMONSVILLE RD</u>	
TAP: _____	TIME: _____	<u>BLUFFTON</u>	
PHASE: _____	Sketch Corrected	NAME: _____	POINT ID: <u>608800</u>
SEC. VOLT: _____	to Agree with	CREW ID: _____	
	Construction	DATE: _____	
			WORK REQ.#: _____

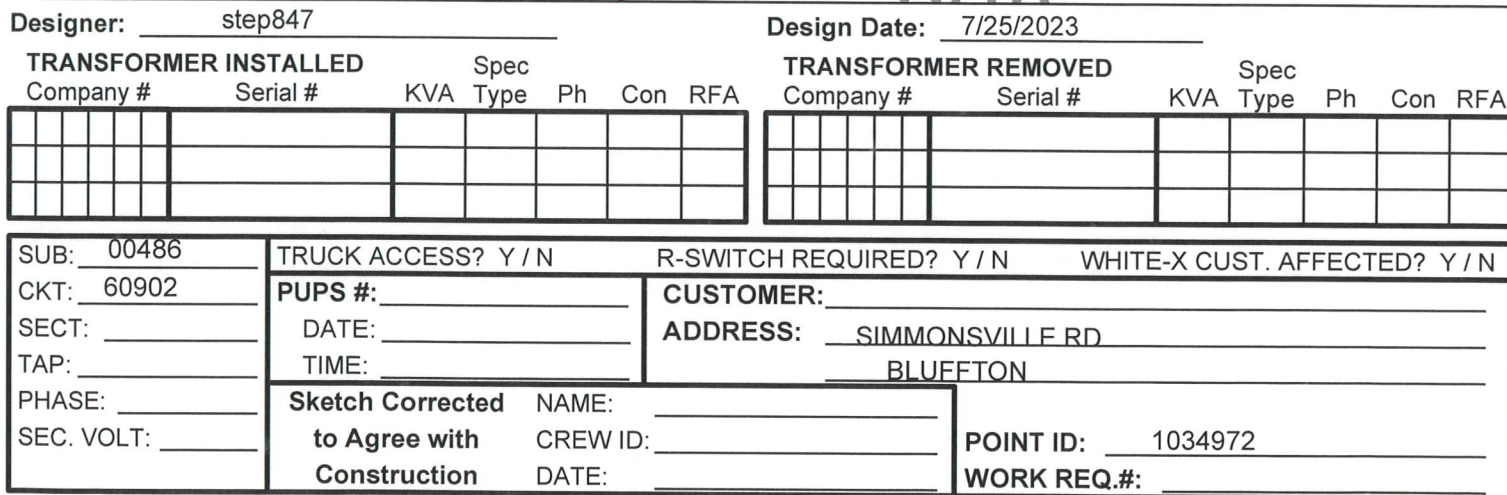

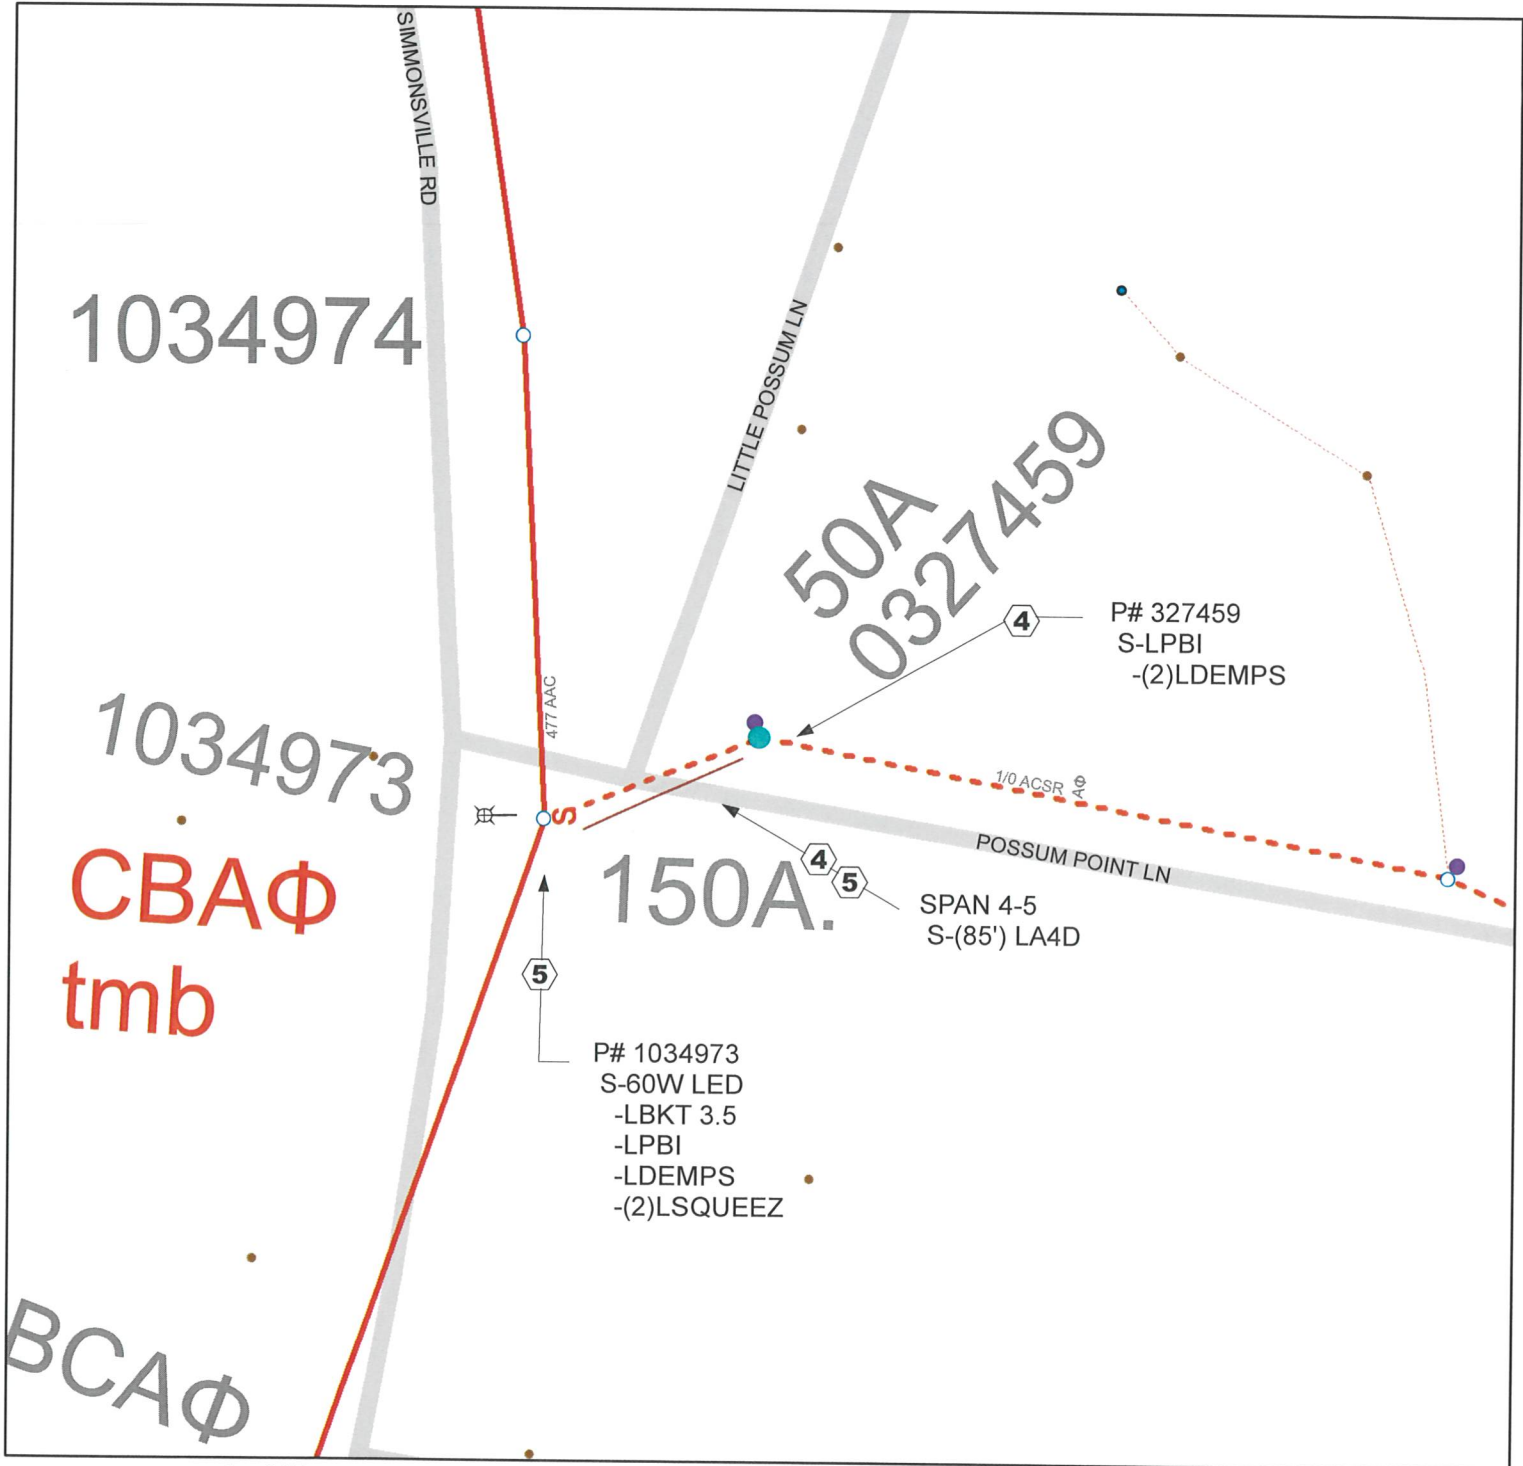

Designer: step847

Design Date: 7/25/2023


TRANSFORMER INSTALLED


Company #	Serial #	KVA	Spec Type	Ph	Con	RFA

TRANSFORMER REMOVED

Company #	Serial #	KVA	Spec Type	Ph	Con	RFA

SUB: <u>00486</u>	TRUCK ACCESS? Y / N	R-SWITCH REQUIRED? Y / N	WHITE-X CUST. AFFECTED? Y / N
CKT: <u>60902</u>	PUPS #: _____	CUSTOMER: _____	
SECT: _____	DATE: _____	ADDRESS: <u>SIMMONSVILLE RD</u>	
TAP: _____	TIME: _____	<u>BLUFFTON</u>	
PHASE: _____	Sketch Corrected	NAME: _____	POINT ID: <u>327459</u>
SEC. VOLT: _____	to Agree with	CREW ID: _____	
	Construction	DATE: _____	
			WORK REQ.#: _____

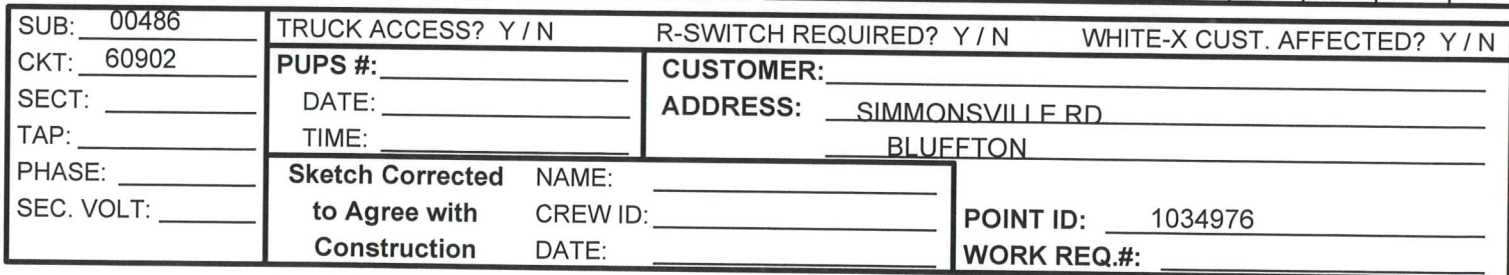

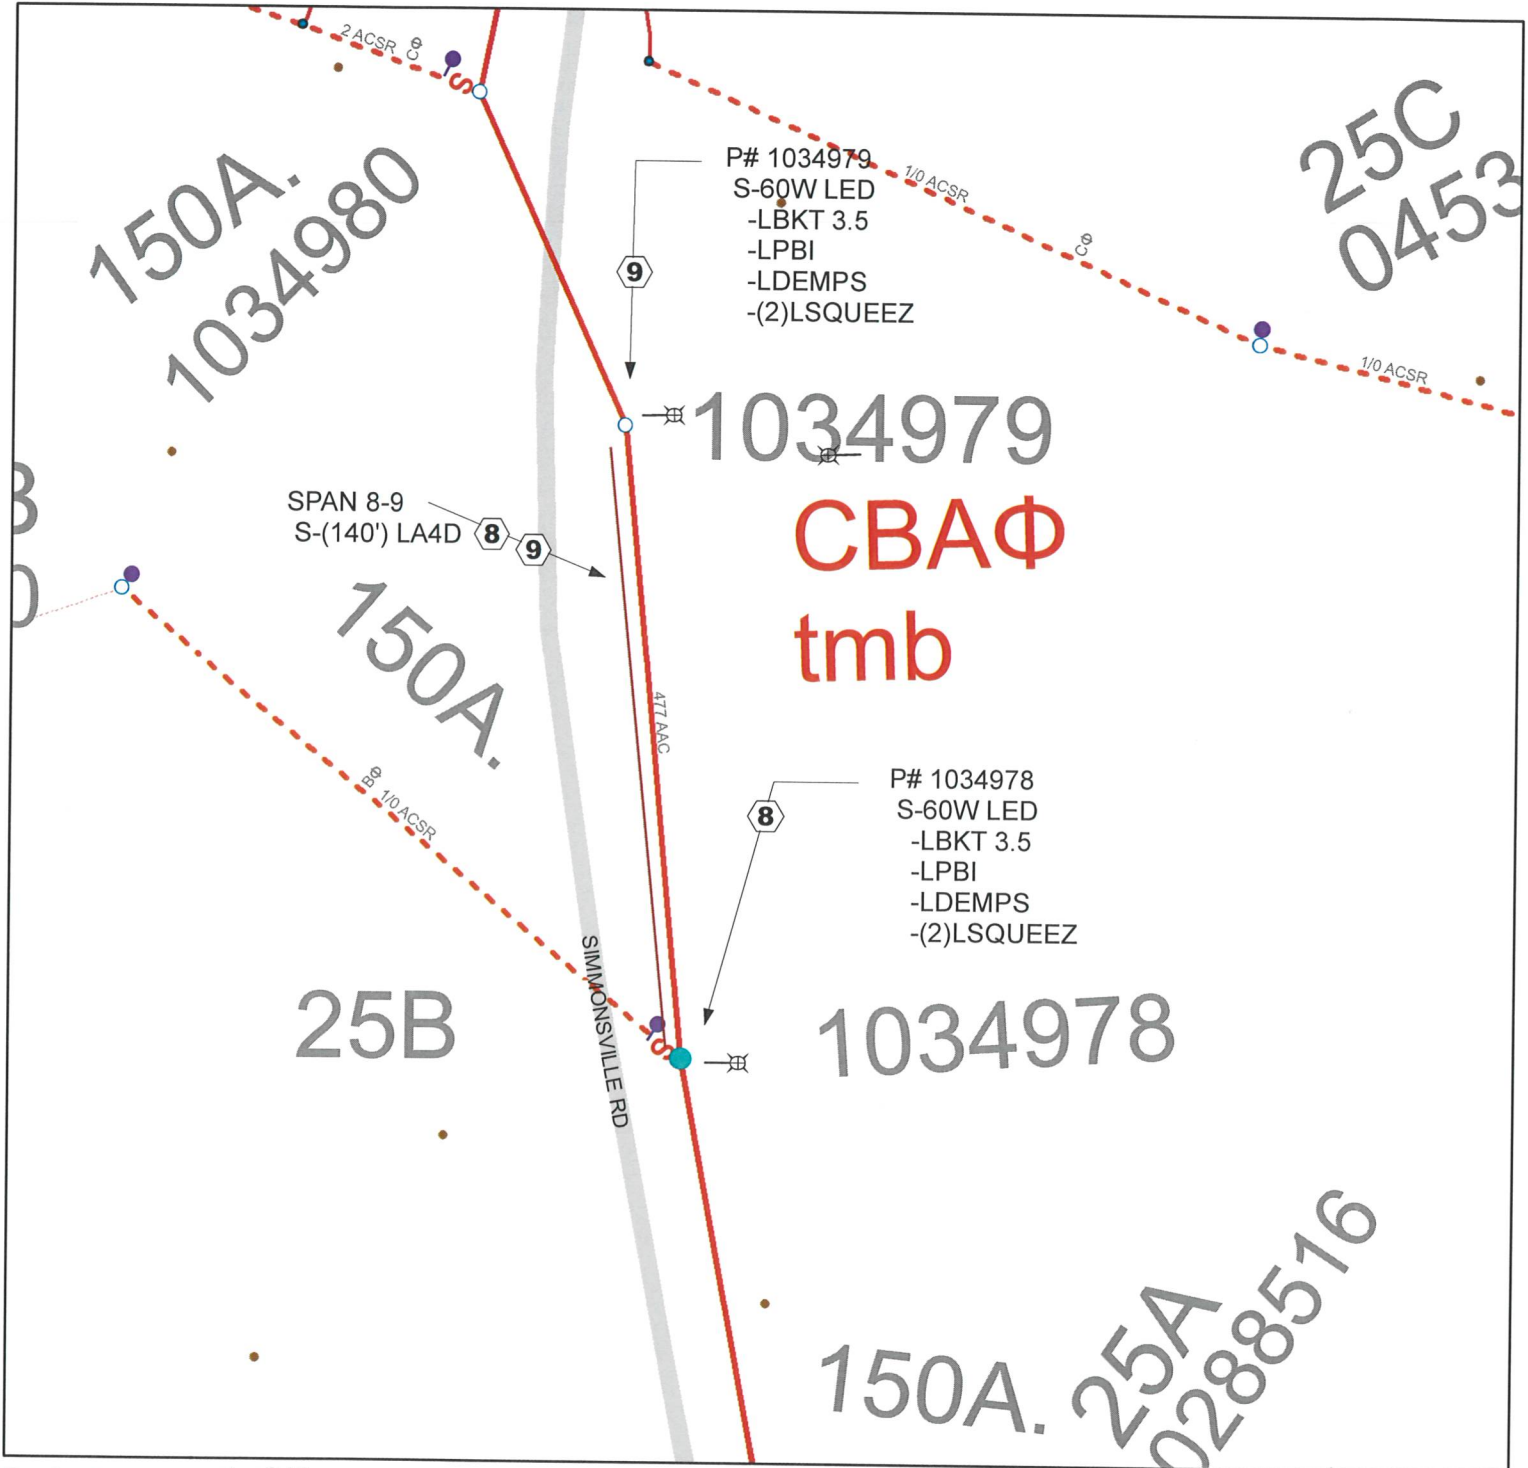

Designer: step847

Design Date: 7/25/2023

TRANSFORMER INSTALLED

Company #	Serial #	KVA	Spec Type	Ph	Con	RFA

TRANSFORMER REMOVED

Company #	Serial #	KVA	Spec Type	Ph	Con	RFA

SUB: 00486

CKT: 60902

SECT:

TAP:

PHASE:

SEC. VOLT:

TRUCK ACCESS? Y / N

R-SWITCH REQUIRED? Y / N

WHITE-X CUST. AFFECTED? Y / N

PUPS #:

CUSTOMER:

DATE:

ADDRESS: SIMMONSVILLE RD

TIME:

BLUFFTON

Sketch Corrected

NAME:

to Agree with


CREW ID:

Construction

DATE:

POINT ID: 1034978

WORK REQ.#:

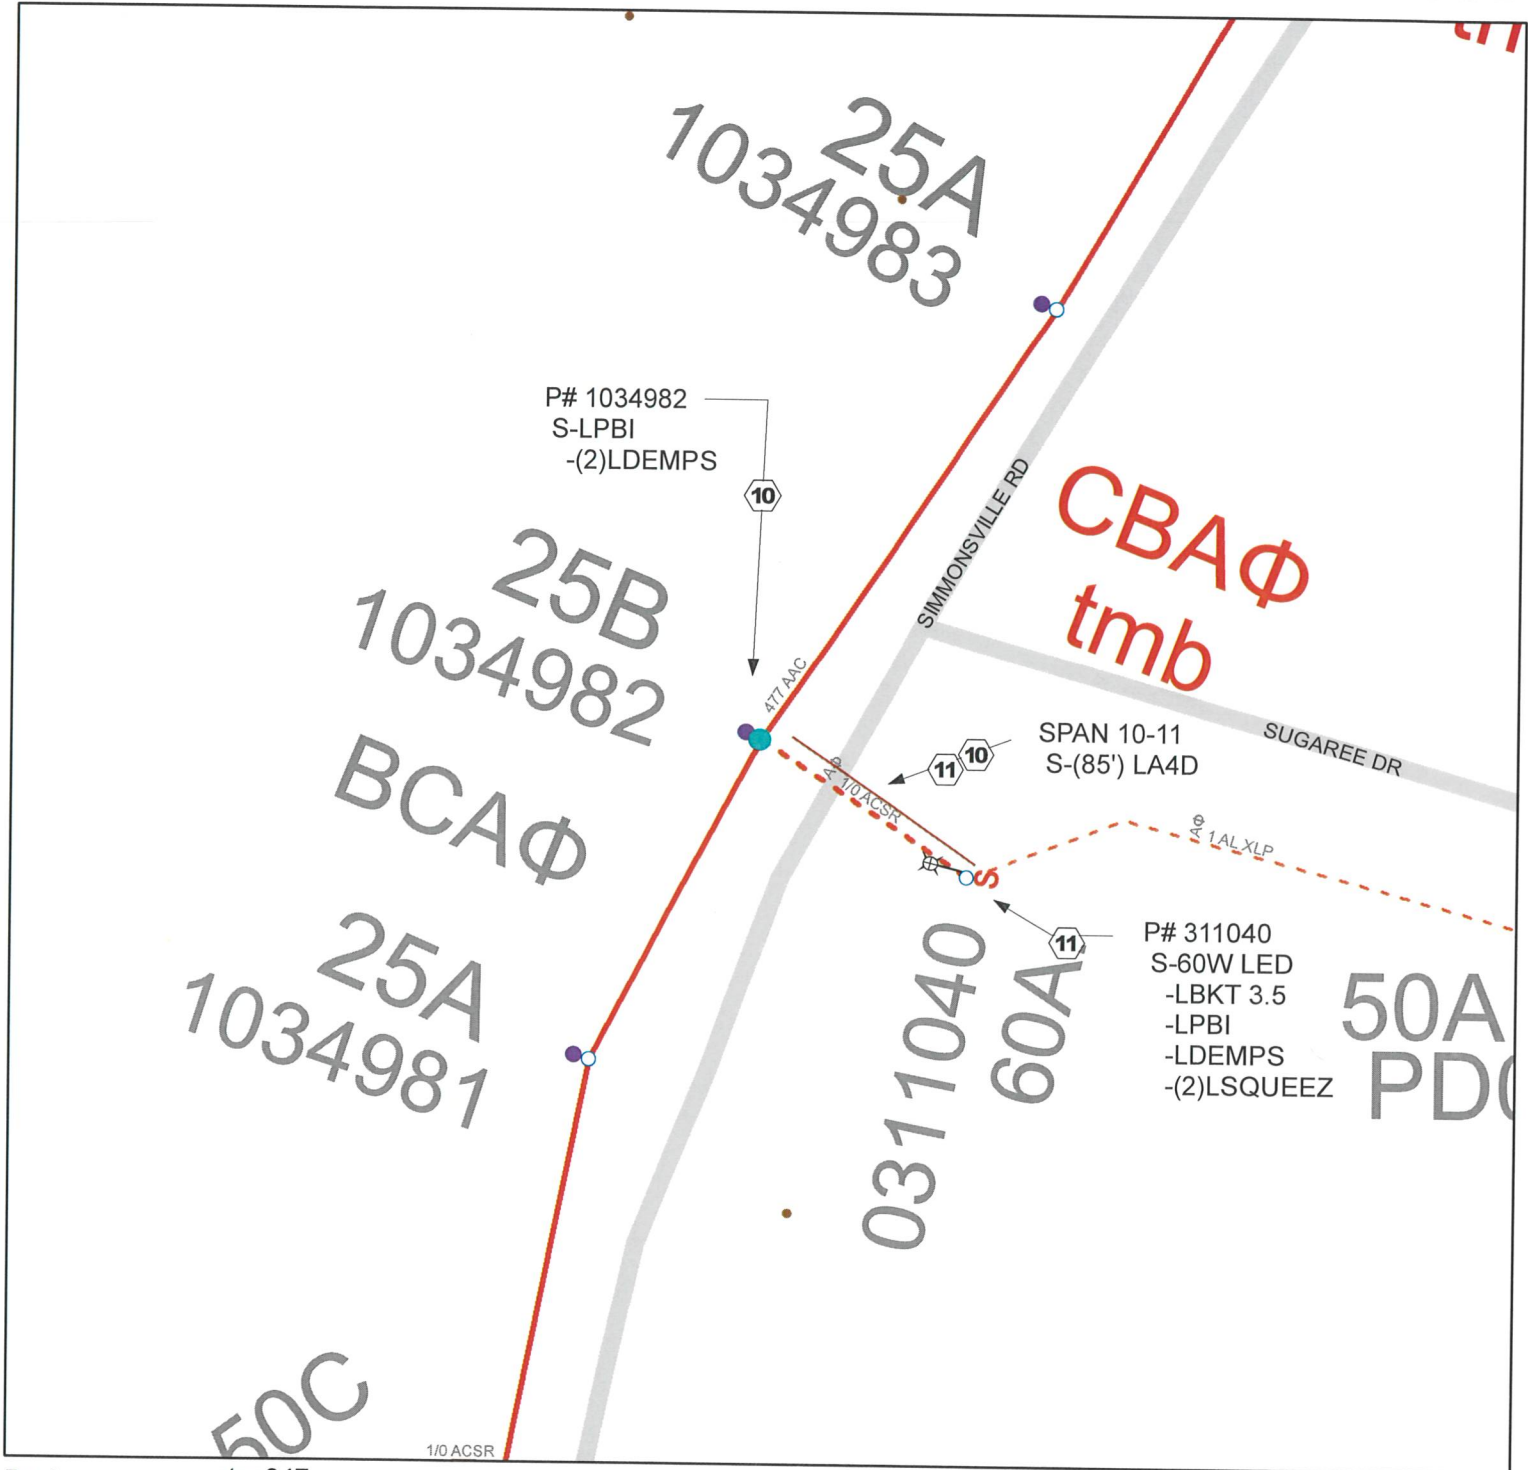

Designer: step847

Design Date: 7/25/2023


TRANSFORMER INSTALLED

Company # Serial # Spec KVA Type Ph Con RFA

TRANSFORMER REMOVED

Company # Serial # Spec KVA Type Ph Con RFA

SUB: <u>00486</u>	TRUCK ACCESS? Y / N	R-SWITCH REQUIRED? Y / N	WHITE-X CUST. AFFECTED? Y / N
CKT: <u>60902</u>	PUPS #: _____	CUSTOMER: _____	
SECT: _____	DATE: _____	ADDRESS: <u>SIMMONSVILLE RD</u>	
TAP: _____	TIME: _____	<u>BLUFFTON</u>	
PHASE: _____	Sketch Corrected	NAME: _____	POINT ID: <u>1034982</u>
SEC. VOLT: _____	to Agree with	CREW ID: _____	WORK REQ.#: _____
	Construction	DATE: _____	

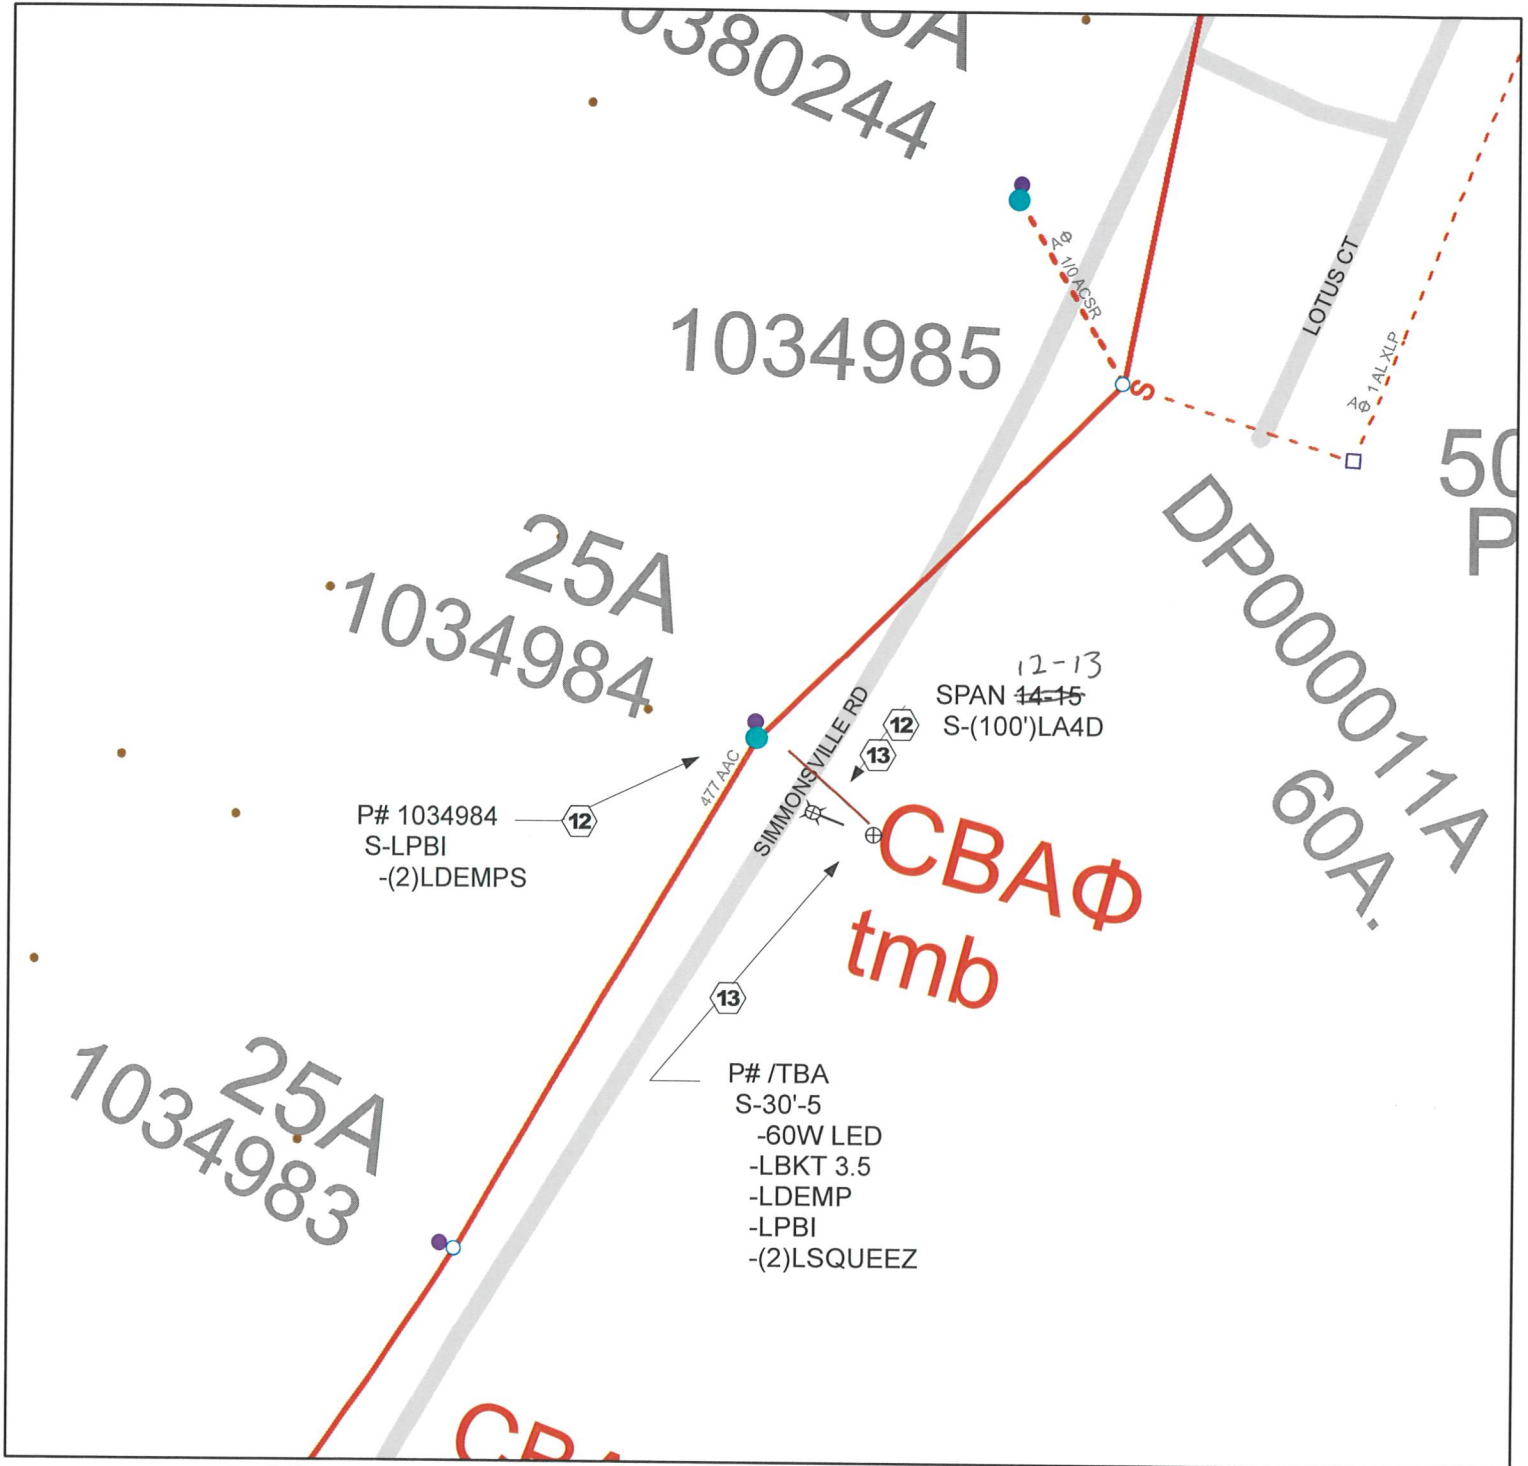
 Designer: step847

 Design Date: 7/24/2023
TRANSFORMER INSTALLED

Company #	Serial #	KVA	Spec Type	Ph	Con	RFA

TRANSFORMER REMOVED

Company #	Serial #	KVA	Spec Type	Ph	Con	RFA

 SUB: 00486

 CKT: 60902

 SECT:

 TAP:

 PHASE:

 SEC. VOLT:

 TRUCK ACCESS? Y / N

 PUPS #:

 DATE:

 TIME:

 R-SWITCH REQUIRED? Y / N

 WHITE-X CUST. AFFECTED? Y / N

 CUSTOMER:

 ADDRESS: Text
BLUFFTON

Sketch Corrected

to Agree with

Construction


 NAME:

 CREW ID:

 DATE:

 POINT ID: 1034984

 WORK REQ.#:

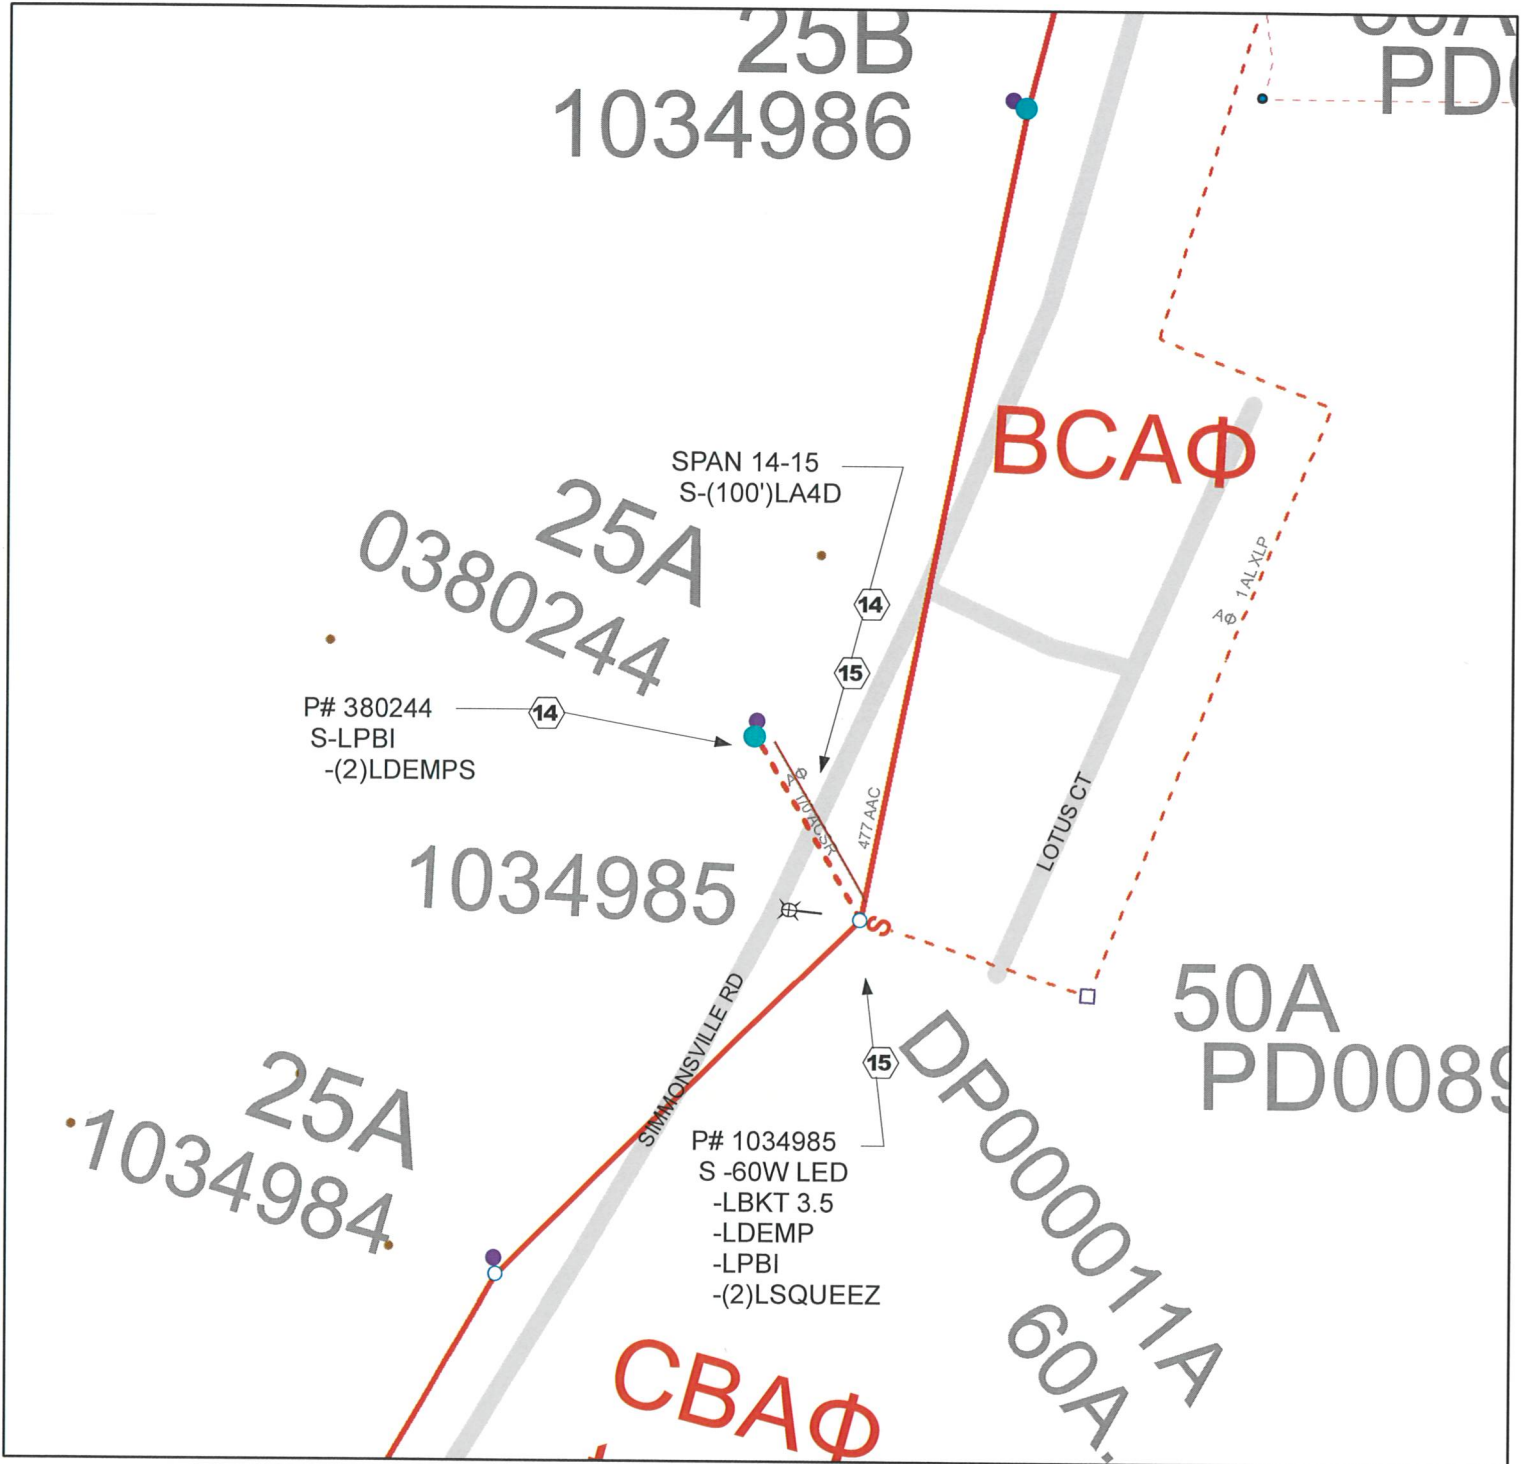

Designer: step847

Design Date: 7/24/2023

TRANSFORMER INSTALLED

Company # Serial # KVA Spec Type Ph Con RFA

TRANSFORMER REMOVED

Company # Serial # KVA Spec Type Ph Con RFA

SUB: 00486

CKT: 60902

SECT: _____

TAP: _____

PHASE: _____

SEC. VOLT: _____

TRUCK ACCESS? Y / N

R-SWITCH REQUIRED? Y / N

WHITE-X CUST. AFFECTED? Y / N

PUPS #: _____

CUSTOMER: _____

DATE: _____

ADDRESS: Text

TIME: _____

BLUFFTON

Sketch Corrected

NAME: _____

to Agree with

CREW ID: _____

Construction

DATE: _____

POINT ID: 380244

WORK REQ.#: _____

1034987

25B
1034986

50A
PD00829

P# 1034986
S-LPBI
-(2)LDMP

P# #TBA
S-30'-5
-60W LED
-LBKT 3.5
-LDMP
-LPBI
-(2)LSQUEEZ

BCAΦ

25A
0380244

Designer: step847

Design Date: 7/24/2023

TRANSFORMER INSTALLED

Company # Serial # KVA Type Ph Con RFA

TRANSFORMER REMOVED

Company # Serial # KVA Type Ph Con RFA

SUB: 00486
CKT: 60902
SECT:
TAP:
PHASE:
SEC. VOLT:

TRUCK ACCESS? Y / N

R-SWITCH REQUIRED? Y / N

WHITE-X CUST. AFFECTED? Y / N


PUPS #:
DATE:
TIME:

CUSTOMER:
ADDRESS: Text
BLUFFTON

Sketch Corrected
to Agree with
Construction

NAME:
CREW ID:
DATE:

POINT ID: 1034986
WORK REQ.#:

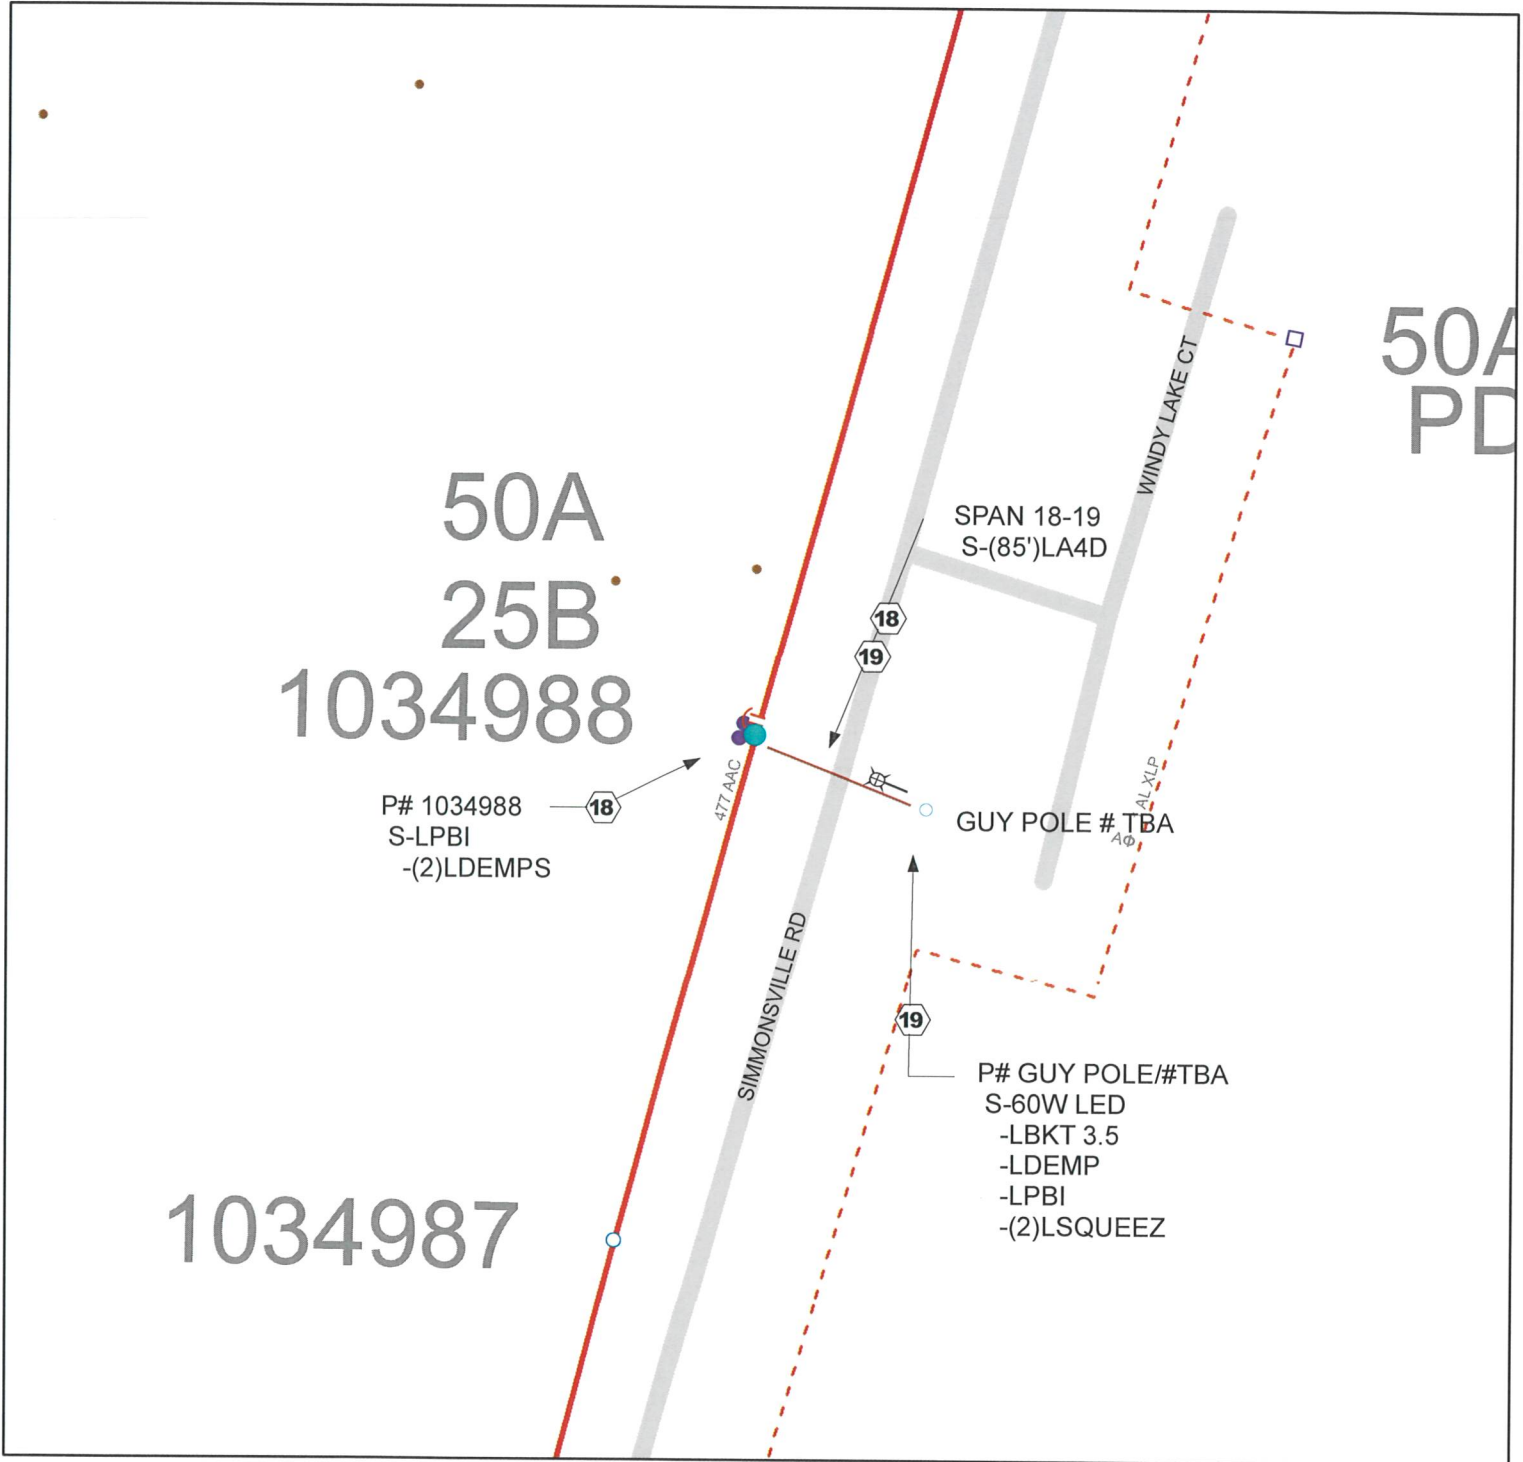

Designer: step847

Design Date: 7/24/2023

TRANSFORMER INSTALLED

Company #	Serial #	KVA	Spec Type	Ph	Con	RFA

TRANSFORMER REMOVED

Company #	Serial #	KVA	Spec Type	Ph	Con	RFA

SUB: 00486

CKT: 60902

SECT:

TAP:

PHASE:

SEC. VOLT:

TRUCK ACCESS? Y / N

R-SWITCH REQUIRED? Y / N

WHITE-X CUST. AFFECTED? Y / N

PUPS #:

CUSTOMER:

DATE:

ADDRESS: Text

TIME:

BLUFFTON

Sketch Corrected

NAME:

to Agree with

CREW ID:

Construction

DATE:

POINT ID: 1034988

WORK REQ.#: