


Proposed Gooding Avenue Hotel


Storm Chamber SC - 740 is being discontinued - Recommend Use SC-800 (ADS)




Different Profile

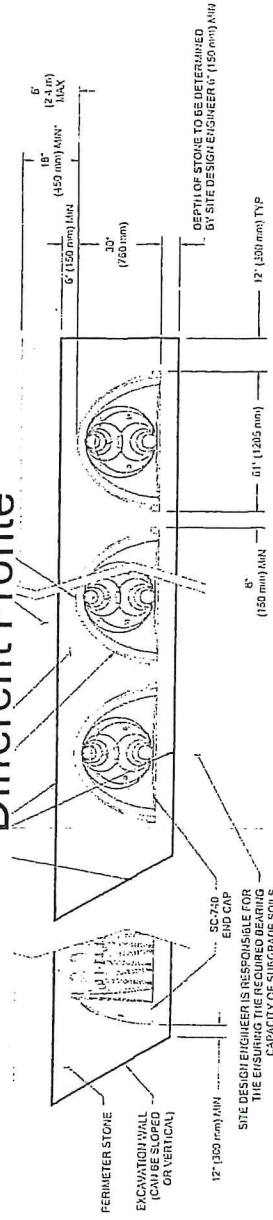

SC - 740

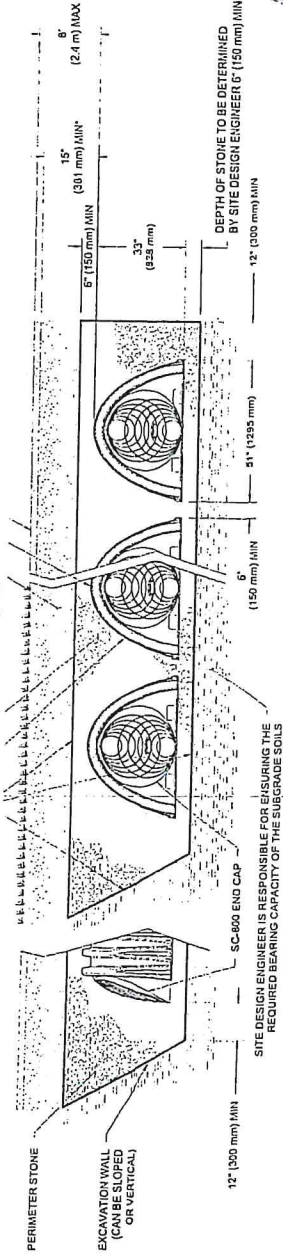

SC - 800

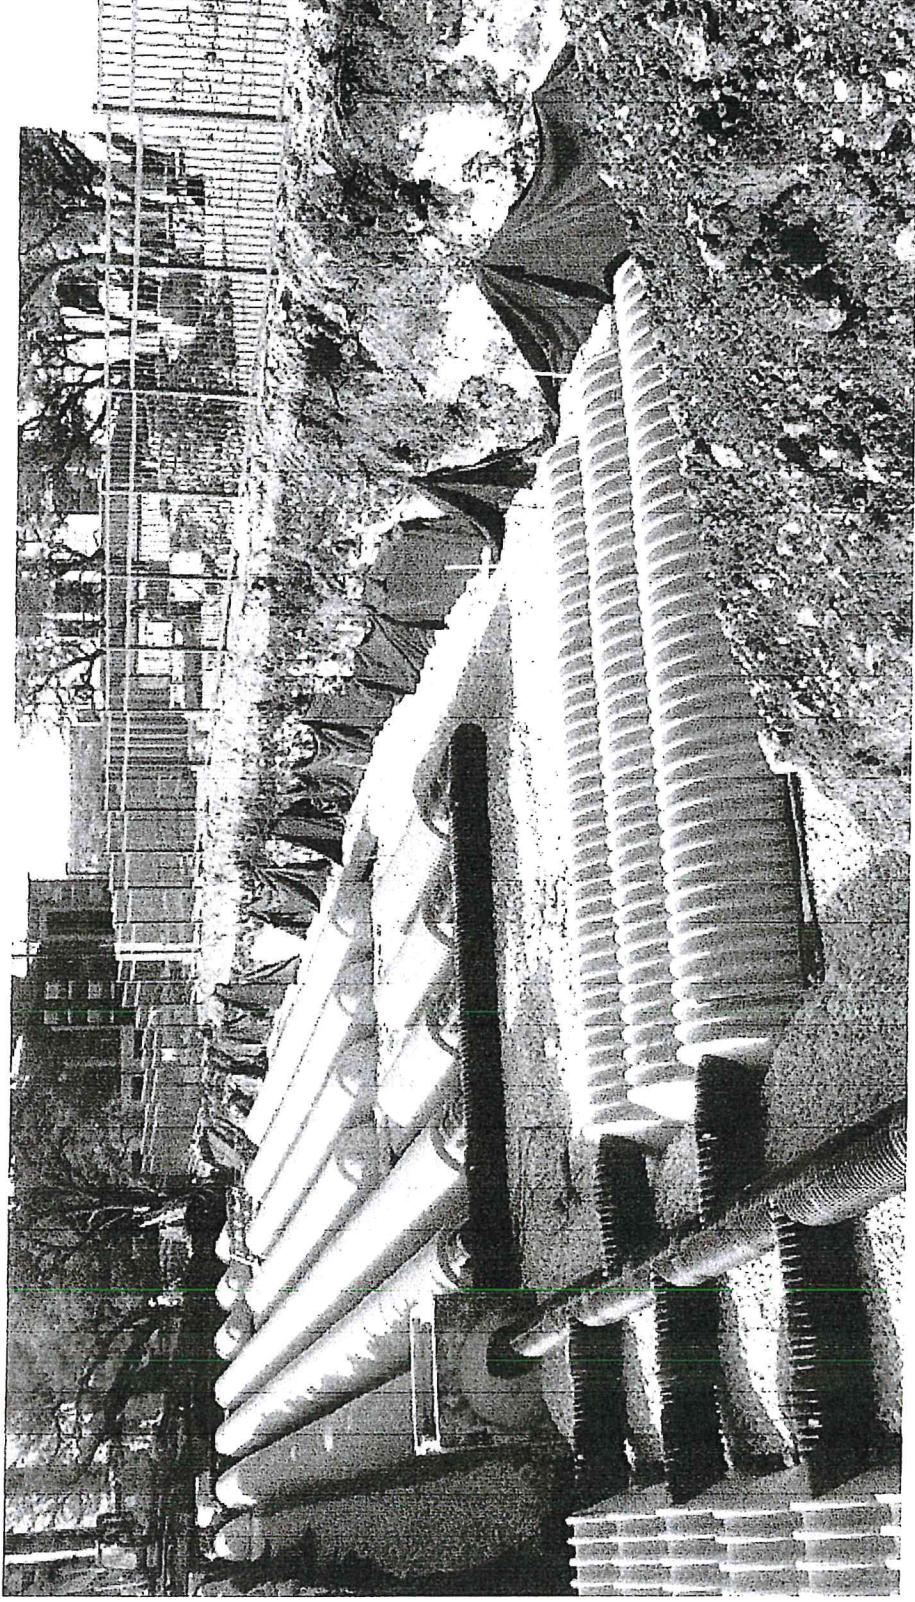

The SC-740 is in limited stock and will eventually be discontinued. Refer to the SC-800 for all of your design needs.

Learn More

Get new product info and more in advance.

Proposed Gooding Avenue Hotel

Conclusion



In my opinion, the project does not comply with the following:

Town of Bristol Subdivision and Development Review Regulations
(Amended March 14, 2024)
Appendix F: Design and Construction Standards; I Drainage

- (e) To the maximum extent practicable as agreed upon by the Planning Board Engineer and the applicant's engineer, any increase in storm runoff volume, up to and including the 10-year storm event, shall be retained and recharged on site as close as feasible to its place of origin by means of detention ponds or basins, seepage areas, subsurface drains, porous paving, or similar low impact design techniques. This shall be required within the Tanyard Brook and Silver Creek watersheds and encouraged to the extent practicable in other areas of Bristol.
- (g) Proposals for disposal of surface run-off, downstream from the subdivision without damage to land and improvements or to the receiving water body. The drainage report shall specifically address the downstream impacts resulting from the proposed drainage system

Therefore, does not comply with:
Article 8.6 Required Findings