



2 D2 Fixture Specification - TMS Lighting 2W





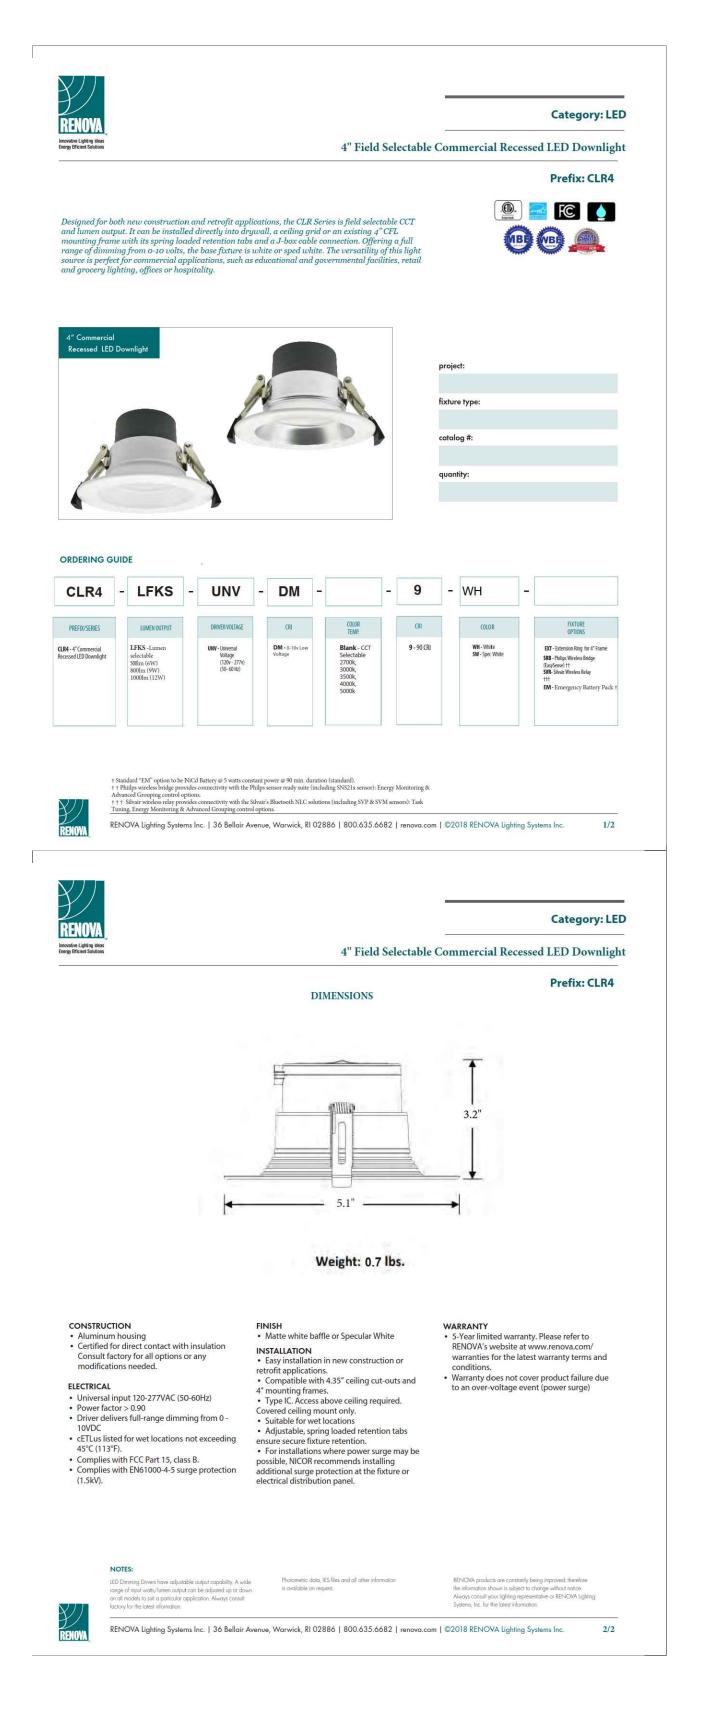

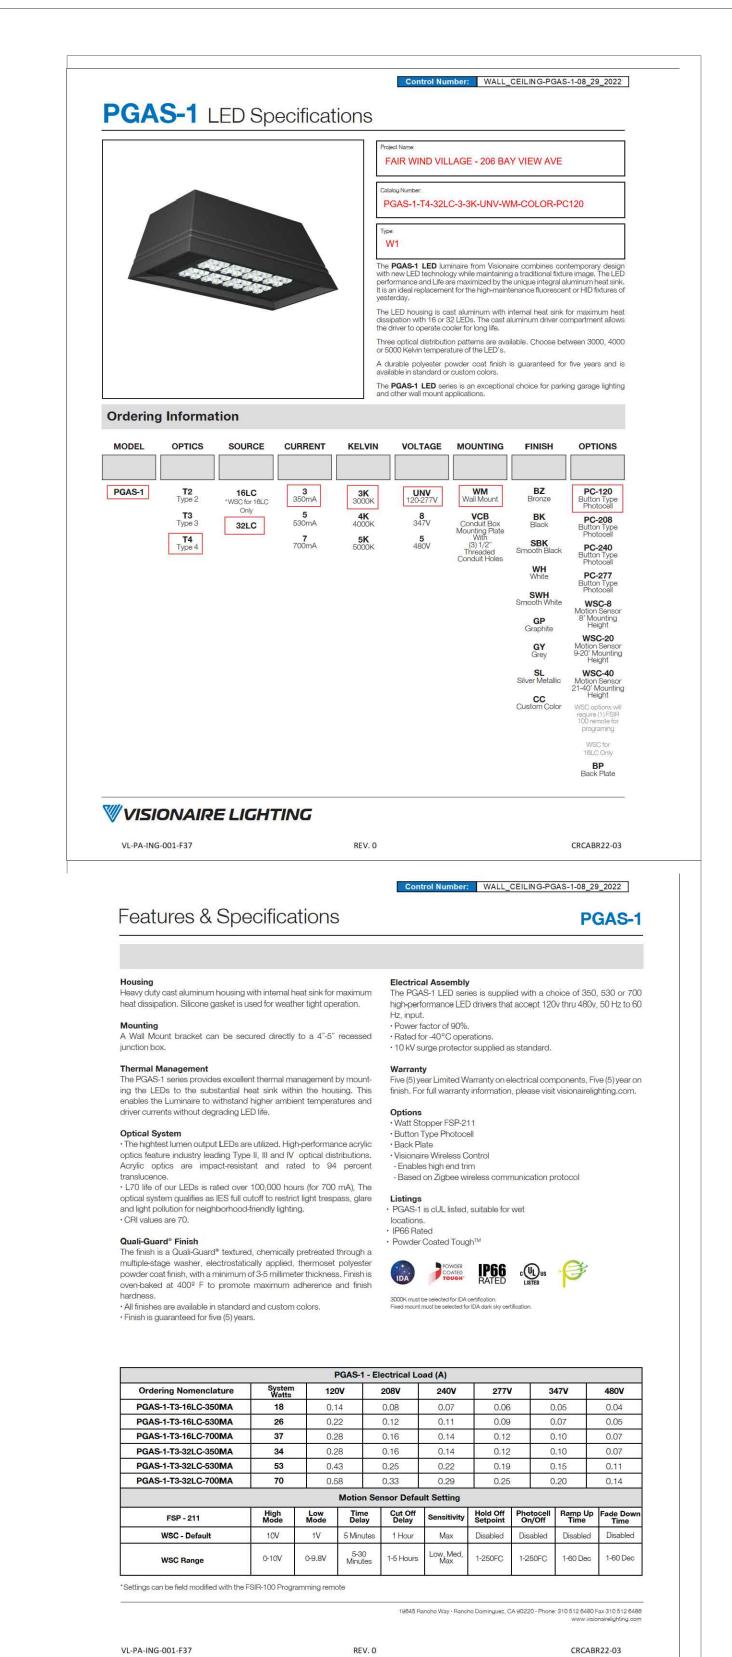

NOTES

- A. A LIGHT LOSS FACTOR OF 0.950 HAS BEEN APPLIED TO FIXTURES UNLESS OTHERWISE NOTED. REFER TO LUMINAIRE SCHEDULE FOR LIGHT LOSS FACTOR AND LUMEN INFORMATION.
- B. MOUNTING HEIGHT (MH) ABOVE FINISHED GRADE INDICATED ON PLAN ADJACENT TO FIXTURE SYMBOL, UNDER FIXTURE IDENTIFICATION LABEL.
- C. ALL CALCULATION POINTS ARE TAKEN AT GRADE.
- D. CALCULATION RESULTS ARE BASED ON IES STANDARDS UNLESS OTHERWISE REQUESTED.



Fair Wind Village - 206 Bay View Ave

REVISIONS DESCRIPTION