

# Water Availability Request



Applicant Information

Date: 08/18/2025  
 Property Owner Signature: *Halsey C. Herreshoff*  
 Owner (please print): Halsey C. Herreshoff, Trustee  
 Corporate Title (if not an individual): \_\_\_\_\_  
 Address: 18 Burnside Street - 1 Resolute Lane, Bristol, RI 02809  
 Phone: c/o 401 253-2500 Email: al@rego-law.com  
 Contractor: Marshall Properties Email: jjmarshall@marshallproeprtlesinc.com

Location

Preliminary request is hereby made for a confirmation that public water is available from BCWA to service this property:  
 Town: Bristol Location: 18 Burnside Street  
1 Resolute Lane  
 Address/Plat and Lot: Plat 39 and 48

<input type="checkbox"/> Residential* adaptive re-use condominium conversion 7 - residential units	<input checked="" type="checkbox"/> Commercial* Building Footprint 18 Burnside 3,639 sq ft 5 units 2 baths each Building Footprint 1 Resolute 4,638 sq ft 2 units 2 baths each Total Occupancy: 7 residential condo units Total Estimated water use: 9,000 to 12,000 gallons per week... *Site Plan Must Be Attached to All Applications
---	---

For BCWA Office Use Only

Action by the Bristol County Water Authority



Water Available       Water Not Available  
 Approximate Static Pressure: 70 psi


Conditions: 18 Burnside has frontage on a street with a water main, however, more information on domestic and fire protection demands are required in order to ensure sufficient supply for property.  
 If connection to BCWA is desired, you must:

Submit Application for Main Extension Form and Engineering Plans for Review  
 Submit Application for New Water Service Installation and Fee

Date of Review: 8/28/2025 BCWA Engineer: Colin O'Hara



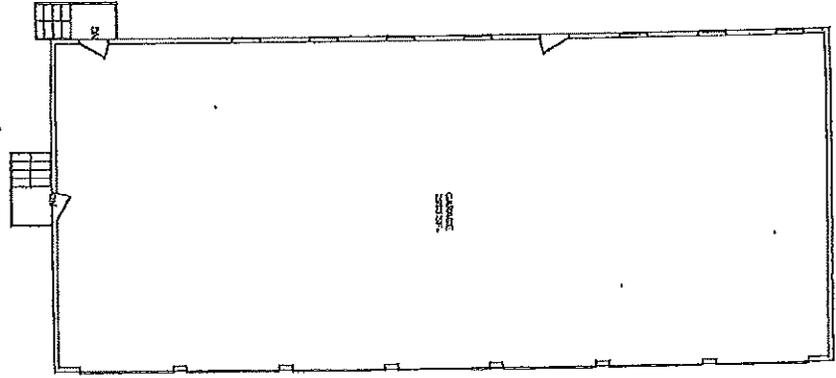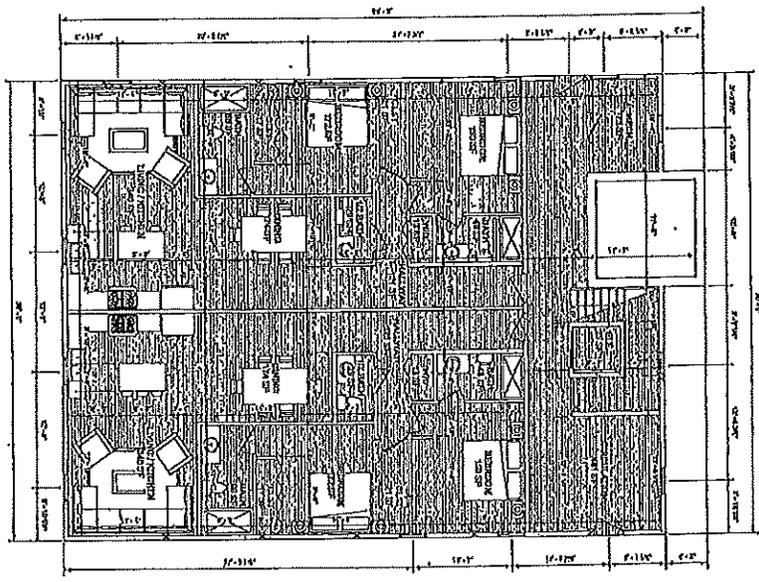

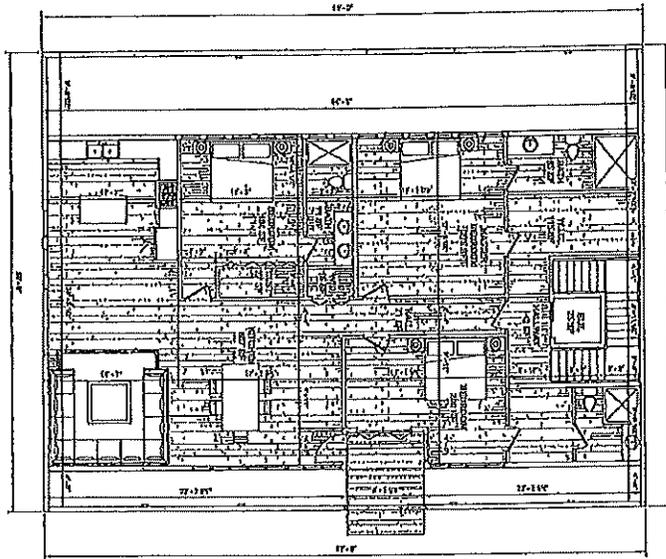


①  
SECTION

SECOND LEVEL PLAN



Architectural drawing header information, including project name and date.

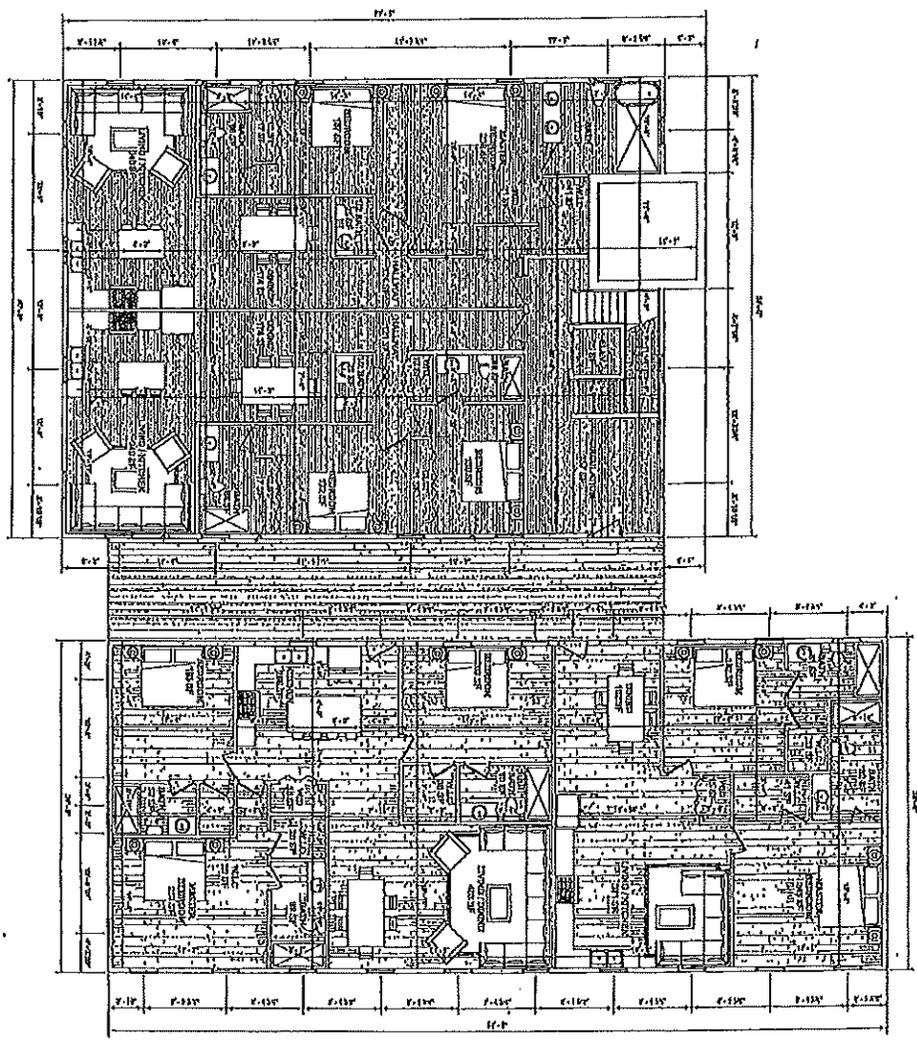

Vertical text label, possibly indicating a section or orientation.