






**BLACK CHAINLINK FENCE WITH
OPTIONAL BLACK PRIVACY SLATS
(EXTERIOR)**

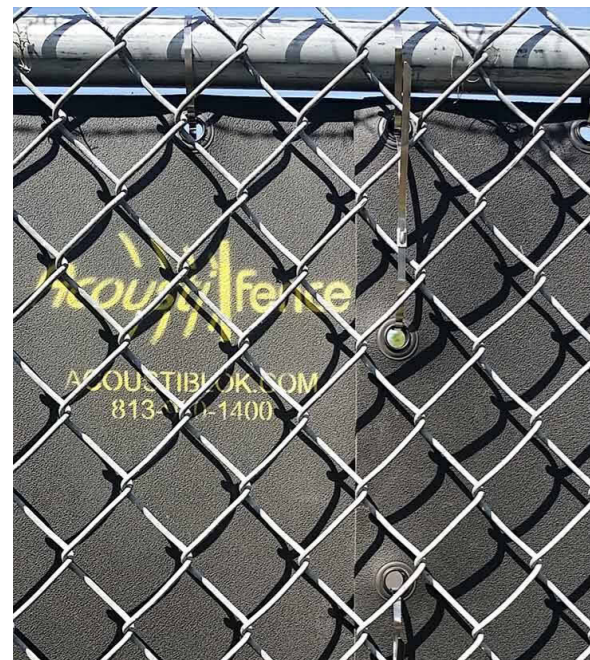

**ACOUSTIBLOK SOUND DAMPENING
PANELS (INTERIOR)**

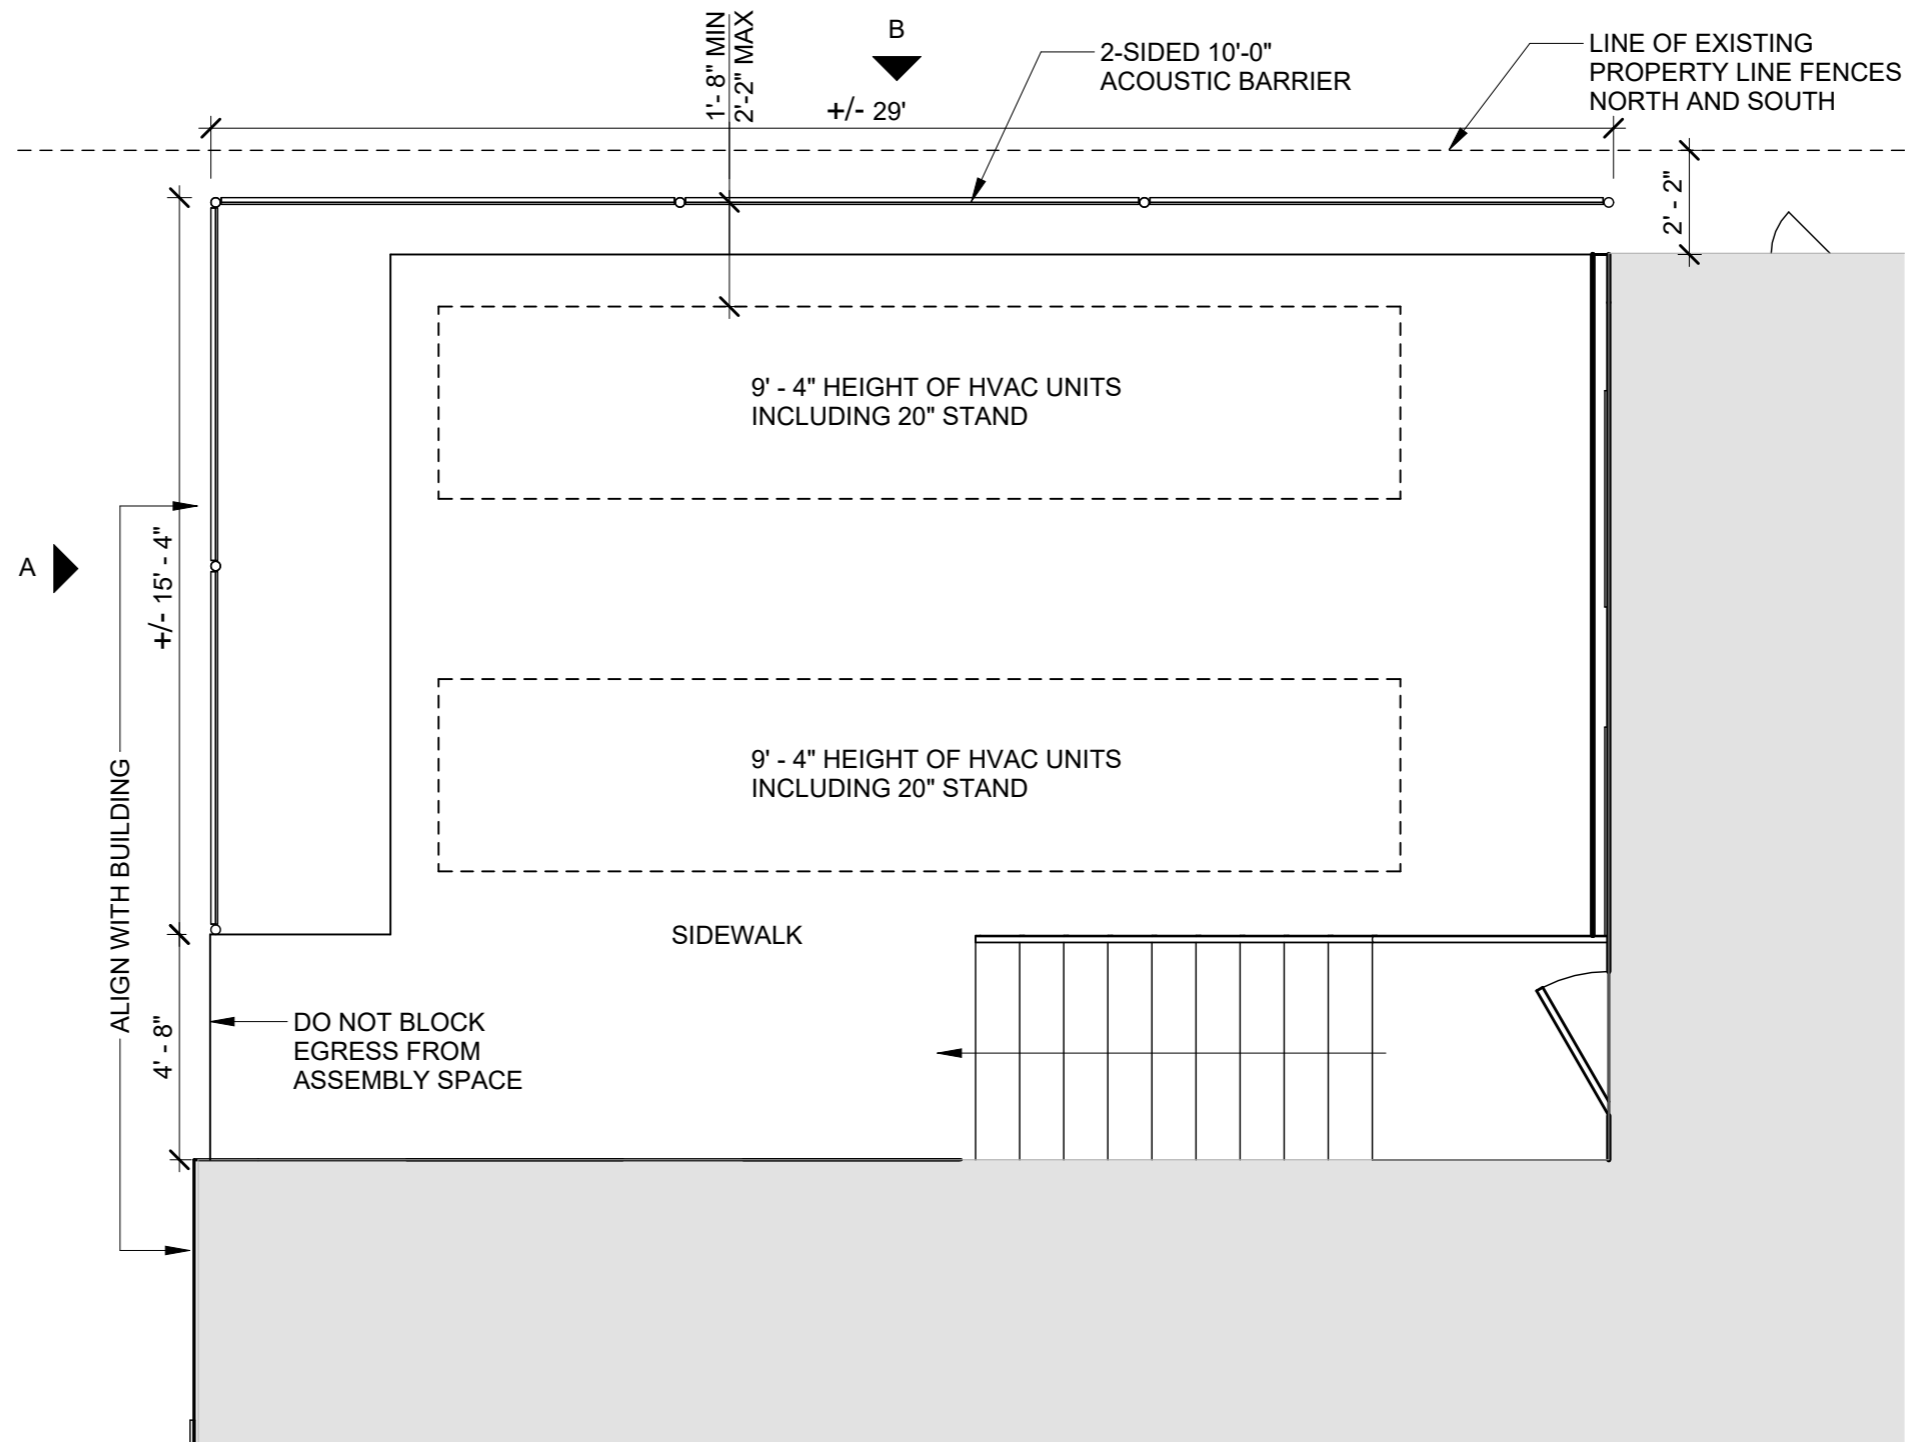


NOTE: FENCE MUST BE LOCATED A MINIMUM OF 12" + THE DISTANCE ABOVE THE TOP OF THE UNIT AWAY FROM THE UNITS FOR PROPER EXHAUST

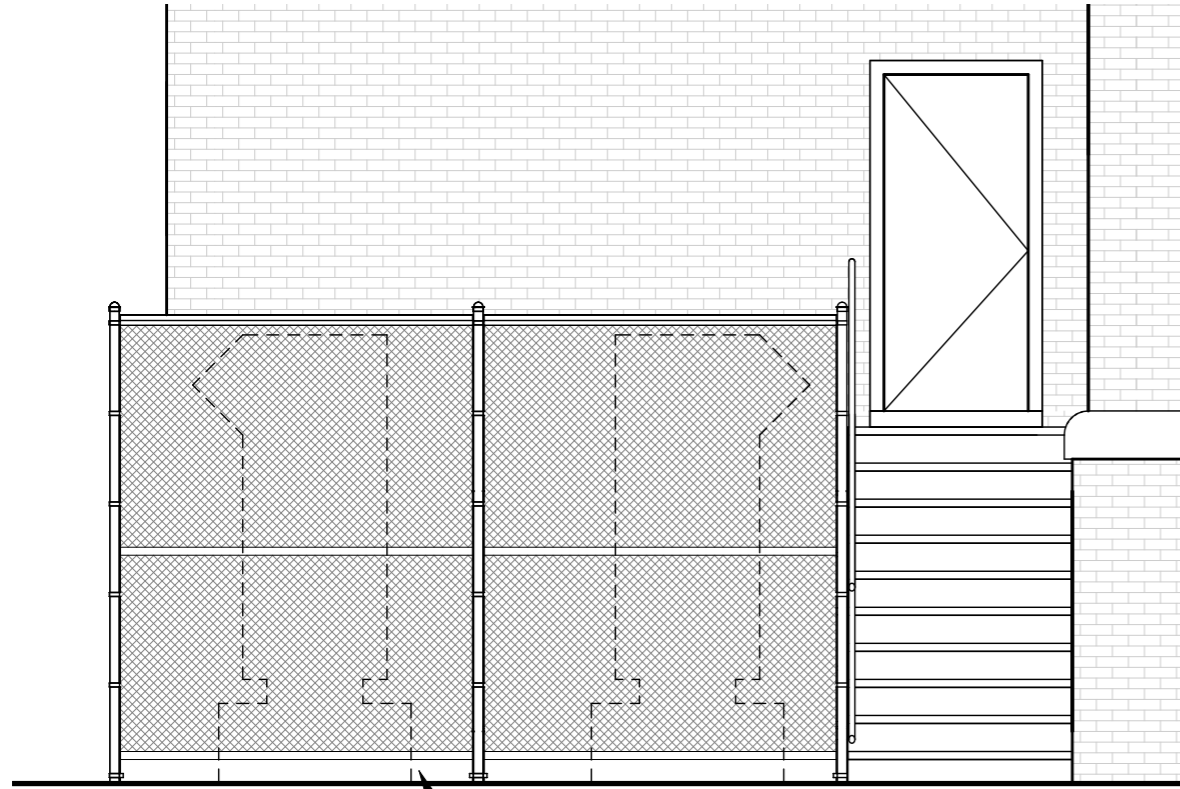

PROVIDE A 6" AIR GAP
UNDER FENCE PER
UTILITY VENTILATION
REQUIREMENTS

A - SOUTH ELEVATION

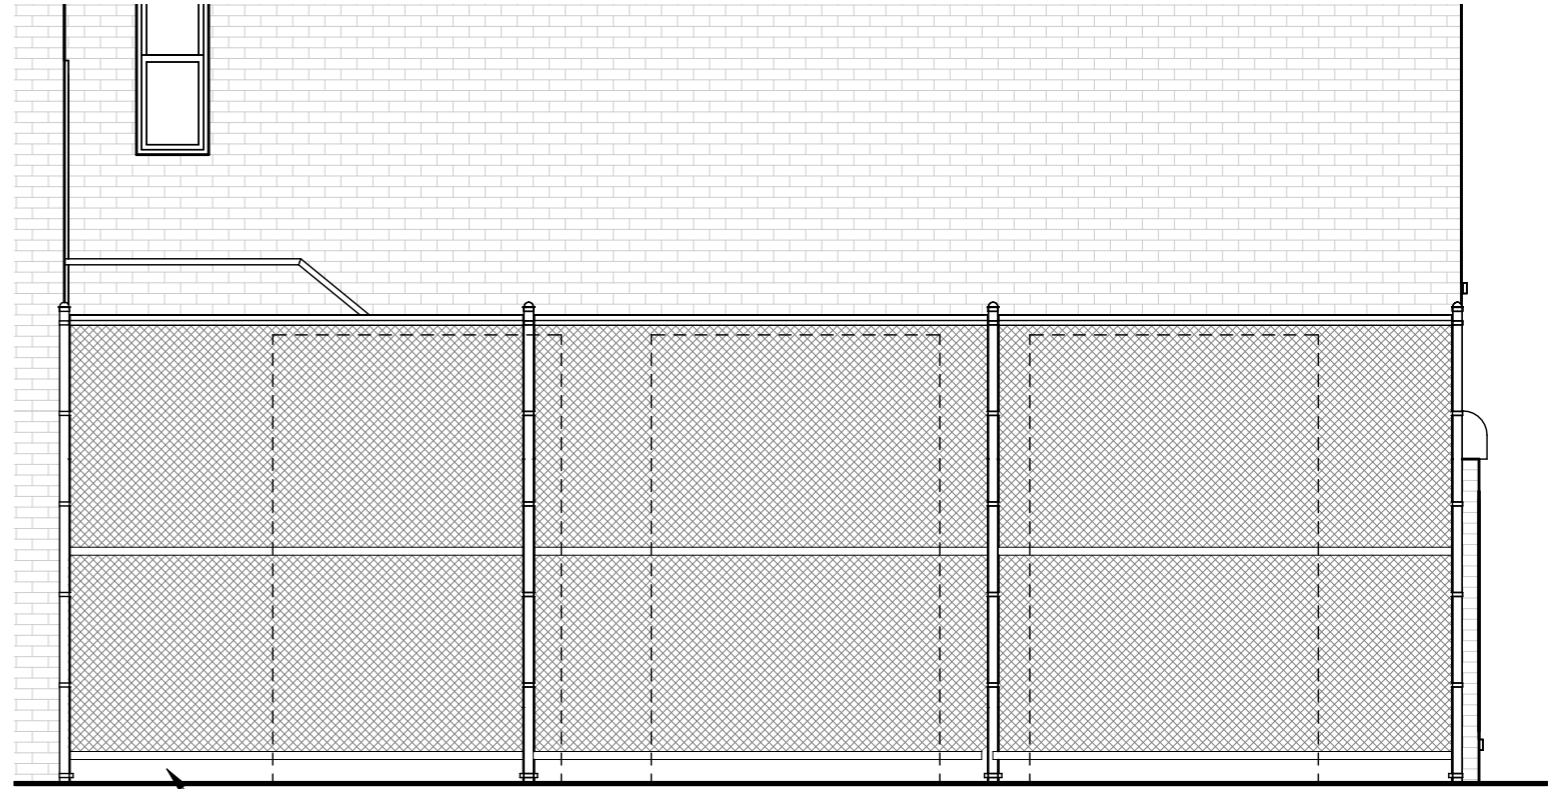

PROVIDE A 6" AIR GAP
UNDER FENCE PER
UTILITY VENTILATION
REQUIREMENTS

B - WEST ELEVATION