



City Council
Regular Meeting

April 22, 2025

Pump Bid Award

Discuss and consider action: Resolution No. R2025-28

A RESOLUTION OF THE CITY COUNCIL OF THE CITY OF BURNET, TEXAS, SELECTING A PROPOSAL UNDER REQUEST FOR PROPOSAL 2025-003; AWARDING A CONTRACT TO SAID PROPOSER AND AUTHORIZING THE CITY MANAGER TO EXECUTE THE CONTRACT ON BEHALF OF THE CITY: E. Belaj





TIMELINE

Background



Oct 2024 Funding Approved



Oct 2024: Surveyed Main St. Well



Dec 2024: Replaced Inks Raw 2 Pump



March 2025: Replaced Cheatham 1



April 2025: Main St Pump 1



May 2025: Inks Raw 1
Likely June 2025





BUDGETED
\$250,000

Previous Work

1	Main St Well Camera	\$ 9,500.00
2	Pump Repair: Inks High Svc	\$ 11,227.00
3	Inks Raw Pump 2	\$ 47,515.00
4	Cheatham Well Caliper	\$ 5,925.00
5	Chemical Pump at Main St	\$ 3,583.00
6	Cheatham Lab Work	\$ 1,416.00
7	Cheatham Engineering	\$ 3,246.75
9	Cheatham Electrical	\$ 7,664.00
11	Cheatham 1 Pump Install	\$ 65,400.00
8	Misc Materials	\$ 39.98
12	Main Street Pump (not yet installed) \$26,800	\$ 26,800.00
14	Pump 1 Repl WWTP Pond B (not Paid)	\$ 26,815.00
15	Pump 1 Rehab WWTP Pond B (not Installed)	\$ -
16	WTP Re-Fencing (Not yet installed)	\$ 34,323.00
TOTAL SPENT or ALLOCATED		\$ 243,454.73





INFORMATION

Project Info.

- Replace Inks Raw Pump 1 at Water Plant
- Store for reuse old pump and motor
- Bid option to perform maintenance on pump: short shelf life.





Funding

- **FY 24/25 Budget Allocation:** \$250,000 for pump and motor repairs/replacements (Water & Wastewater Systems)
- **Recommended Contractor:** Jurgensen Pumps
 - Base Bid: \$47,922.00
 - Alternate 1 (Rehab Existing Equipment): \$15,560
 - Estimated Miscellaneous Work: \$15K
- **Additional Funding for This Project:** \$74,613.23
 - Transfer SCADA from Street Funds to this line item. Addl. Cost \$18,236.5
 - Fencing at WTP: \$34,323. (This serves as an alternative to using the Water/Wastewater operations budget, which is currently under strain.)

ESTIMATE #		DATE	
9048		04/02/2025	
DESCRIPTION	QTY	RATE	AMOUNT
Quote 2			
Raw Water Intake Pump			
Inks Lake			
75HP / 3Ph / 460V / 1800RPM			
2000 GPM at 106' TDH			
Simflo SM14LL - 2 Stage Pump	1	16,261.00	16,261.00
- 2000GPM at 106' TDH			
Pleuger MI10-490-4, 10", 75HP, 3PH, 460V, 1750RPM Submersible Motor	1	28,061.00	28,061.00
Shop Labor to Disassemble Existing Unit, Modify Motor Shroud, Assemble with New Pump and Motor, Repair Discharge Head	1	1,400.00	1,400.00
Field Service for Crew with Crane Truck to Install Equipment with New Wiring, New SST Bolts, and SST Bands and Buckles. Complete Start-up After Installation	1	2,200.00	2,200.00
SUBTOTAL			47,922.00
TAX			0.00
TOTAL			\$47,922.00

BIDS






TIMELINE

Post Award

- **Contract Execution:** Within 2 weeks
- **New Pump Lead Time:** 1–2 months
- **Remove Existing Pump:** 1 day
- **Misc. Elec. & Site Work:** 1 week
- **New Pump Install:** 1 day
- **Pump Start-Up:** 1 day
- **Capacity Testing :** Up to 2 Days

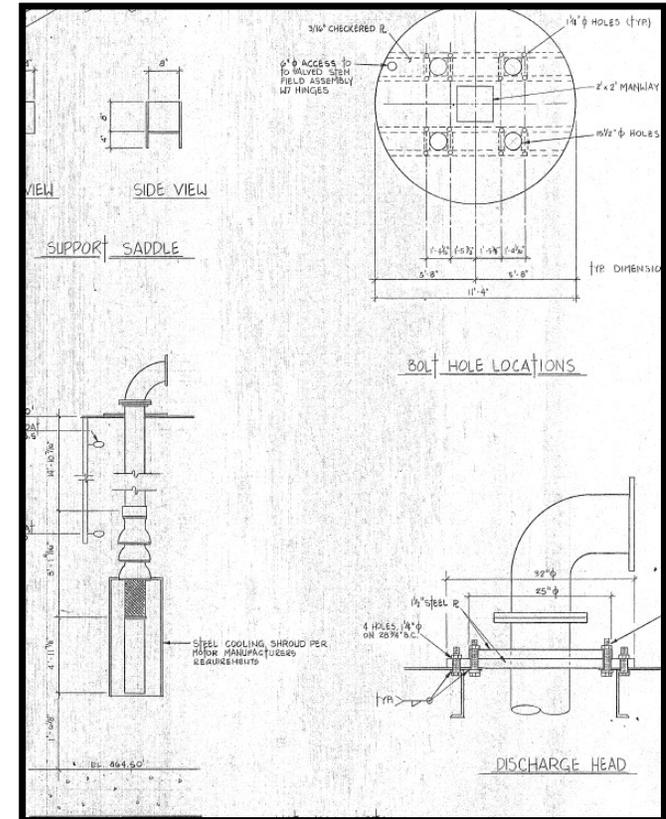



AWARD

Questions?

Recommendation

- Staff recommends approval of Resolution No. 2025-28 as presented to award the contract to the recommended contractor in the amount to exclude added bid alternate.
- Resolution includes allocating additional \$74,613.23 to pumps and motors budget. Budget amendment will be presented later this year.

