

Xref: \A1-B.dwg

Luminaire Schedule						
Symbol	Qty	Label	LLF	Description	Wattage	Lumens per Fixture
☐	41	IAHP1C1xxxFD850xxT3	0.935	ISON LED Area Light High Performance Gen 1, 143W, 23000 Lumens, 80CRI, 5000K, Ty	138.9	22360
☐	20	IAHP1C1xxxFD850xxT3-WM	0.935	ISON LED Area Light High Performance Gen 1, 143W, 23000 Lumens, 80CRI, 5000K, Ty	138.9	22360
☐	12	IAHP1C1xxxFD850xxT3-B2B	0.935	ISON LED Area Light High Performance Gen 1, 143W, 23000 Lumens, 80CRI, 5000K, Ty	138.9	22360

Calculation Summary									
Label	CalcType	Units	Avg	Max	Min	Avg/Min	Max/Min	FC Req	AFF
Building A Lot	Illuminance	Fc	1.43	10.8	0.1	14.30	108.00	1 FC	0"
Building B Lot	Illuminance	Fc	1.70	10.8	0.0	N.A.	N.A.	1 FC	0"
Building C Lot	Illuminance	Fc	1.89	10.7	0.1	18.90	107.00	1 FC	0"

**IMPORTANT**  
 1.) Presentation plans only. Not for construction use.  
 2.) Calculations performed on representative aisles only and are inclusive of all contributing light.

# AREA LAYOUT


(1) GENERAL NOTES  
 CONFIDENTIAL INFORMATION Please Note: This data is based upon certain specific assumed reflectances and characteristics of the proposed environment. Any deviation from these reflectances or assumed characteristics may affect the actual performance of the luminaries. Based on the factors, Orion Energy Systems, Inc. can not guarantee these results.

2) NO OBJECTS CONSIDERED IN CALCULATIONS UNLESS OTHERWISE NOTED ON THE PRINT.

3) STANDARD REFLECTION VALUES  
 CEILING: .8  
 WALLS: .5  
 FLOOR: .2  
 RACKING: .5



Lifepoint Twin County Regional Healthcare			
P1291284 Galax, VA			
DRAWING	DATE	DRAWN BY	REVIEWED BY
Rev 0	04/11/22	LL	

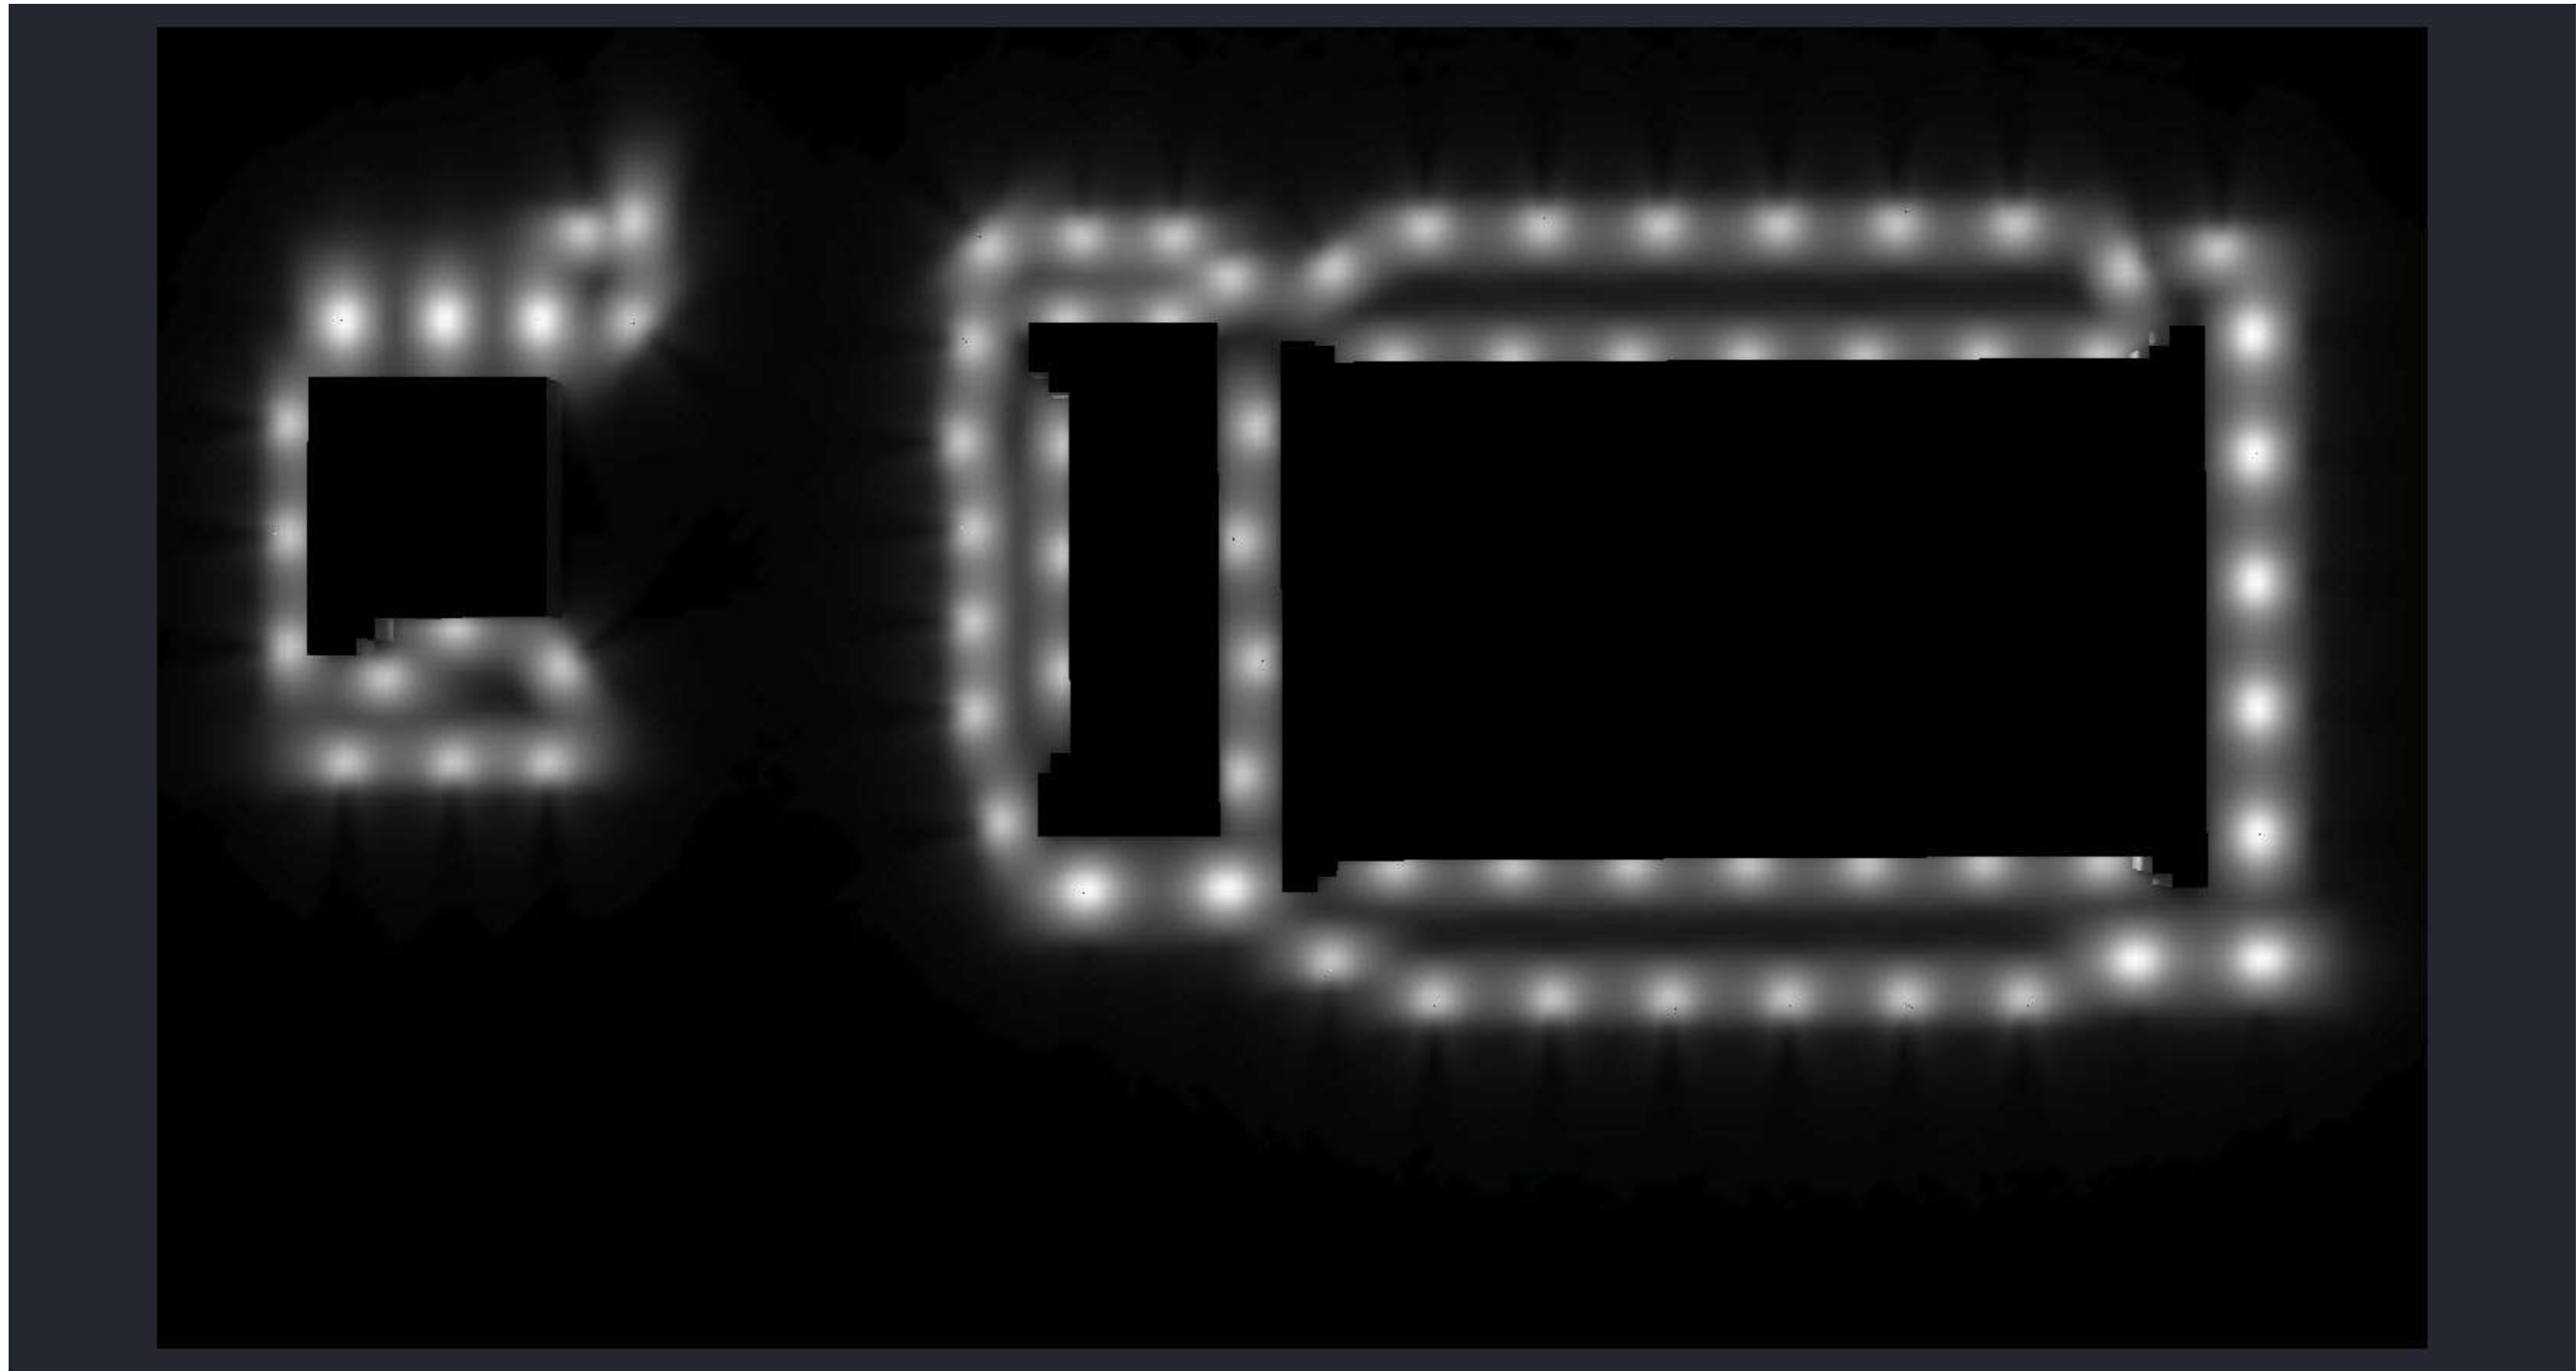

**IMPORTANT**  
 1.) Presentation plans only. Not for construction use.  
 2.) Calculations performed on representative aisles only and are inclusive of all contributing light.

# RENDERING

(1) GENERAL NOTES  
 CONFIDENTIAL INFORMATION Please Note: This data is based upon certain specific assumed reflectances and characteristics of the proposed environment. Any deviation from these reflectances of assumed characteristics may affect the actual performance of the luminaries. Based on the factors, Orion Energy Systems, Inc. can not guarantee these results.

2) NO OBJECTS CONSIDERED IN CALCULATIONS UNLESS OTHERWISE NOTED ON THE PRINT.

3) STANDARD REFLECTION VALUES  
 CEILING: .8  
 WALLS: .5  
 FLOOR: .2  
 RACKING: .5



Confidential & Proprietary - Copyright © 2015 Orion Energy Systems, Inc.

Lifepoint Twin County Regional Healthcare			
P1291284			
Galax, VA			
DRAWING	DATE	DRAWN BY	REVIEWED BY
Rev 0	04/11/22	LL	

