


SPECIAL FEATURES: NONE

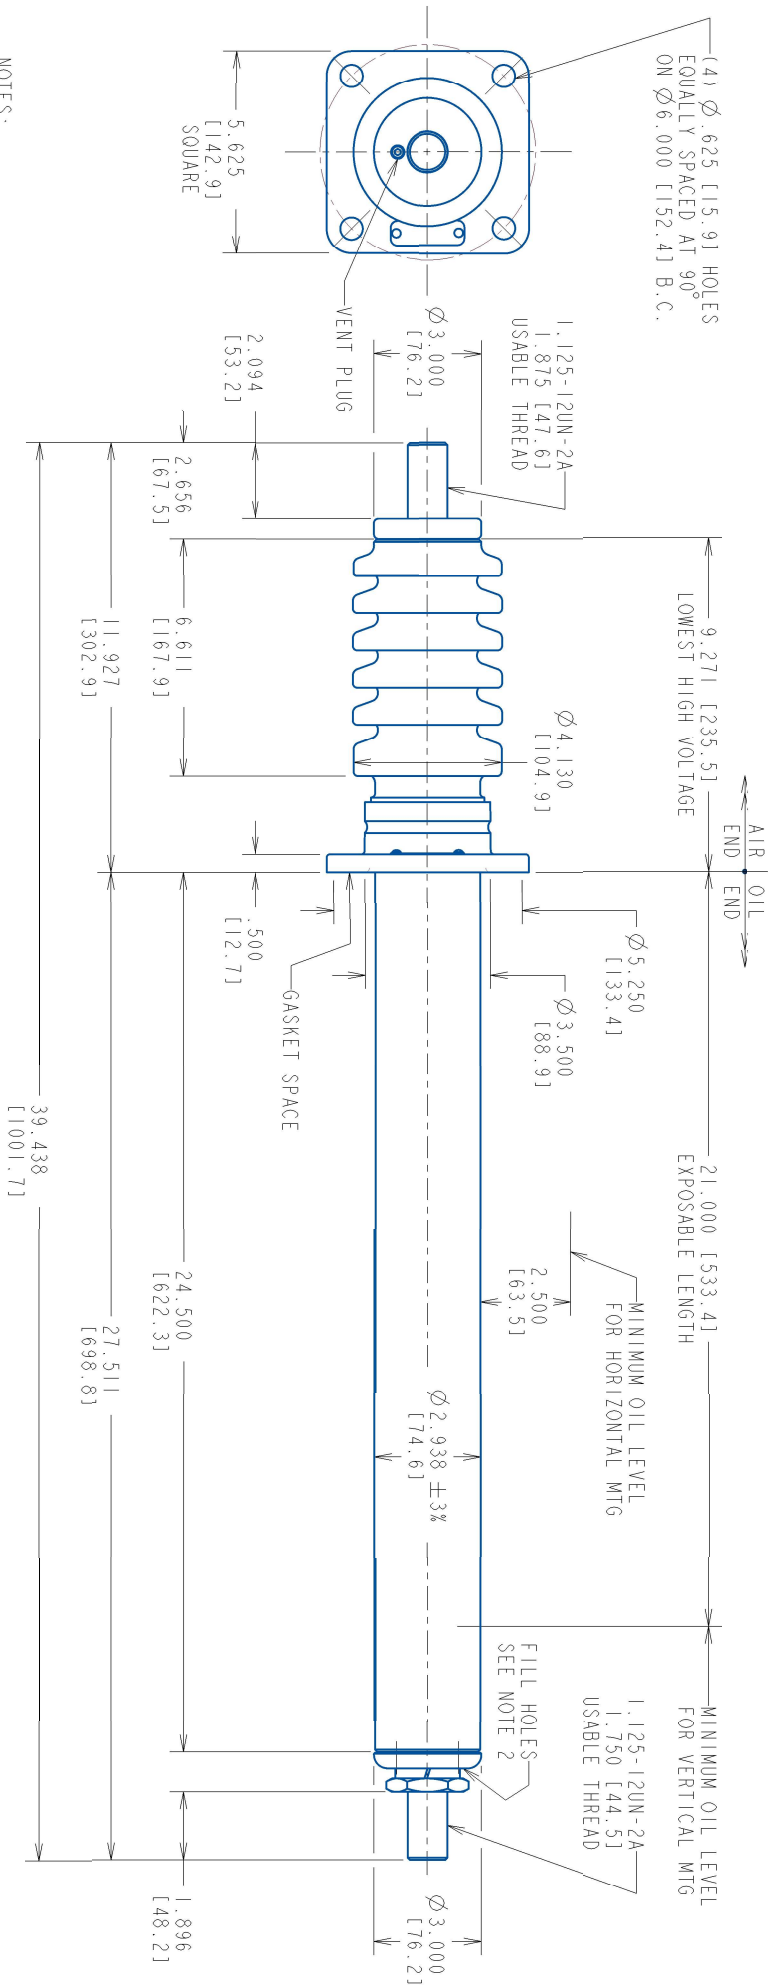

- NOTES:
1. THE GAP BETWEEN THE PORCELAIN AND THE CONDUCTOR MUST BE FLOODED WITH OIL. IN ORDER TO FLOOD THIS GAP WITH OIL, IT IS NECESSARY THAT THE BUSHING BE MOUNTED ON APPARATUS AND THEN EVACUATED AT 5mm VACUUM WHILE THE EQUIPMENT IS BEING FILLED WITH OIL. IF VACUUM IS NOT USED WHEN FILLING THE EQUIPMENT, THE VENT PLUG MAY BE USED TO BLEED AIR FROM THE BUSHING.
 2. THEY ARE ON THE VERTICAL AXIS FOR HORIZONTAL APPLICATIONS.

NO. & LOC.		REVISIONS																	
2	CSR- 1013130 REDRAWN IN PRO/E, CHG'D TO SELF FILLING. C. DILLER 12/08/10 H. DINH 12/10/10	3	"FOR OPTIMUM CORONA PERFORMANCE" REMOVED FROM NOTES:1 PRABHU 05/21/12 W.A.SHINER 7-23-12	A	DRAWING CLEANUP, MOUNTING ANGLE UPDATED. D.STEDMAN 1/2/24 D.STACY 1/8/24		OUTER INSULATING ENVELOPE COLOR		INSULATION CLASS kV	BASIC IMPULSE LEVEL kV	MAX. LINE TO GROUND VOLTAGE kV	CONNECTION METHOD AND CONTINUOUS CURRENT A @ 60Hz			MINIMUM CREEP DISTANCE in. / [mm]	MINIMUM ARCING DISTANCE in. / [mm]	MAXIMUM ALTITUDE ft / [m]	MOUNTING ANGLE FROM VERTICAL deg	APPROX. WEIGHT lb / [kg]
	DRAW- LEAD		TRANS.				O.C.B.												
015B0120AQ	N/A	GRAY	15	110	10		N/A	1200	N/A	11.660 [296]	6.606 [168]	10000 [3048]	0 TO 90	31 [14.1]					
015D0120AQ	N/A	BROWN																	
ABB Inc. ALAMO, TN U.S.A.																			
TITLE: TYPE ICRJ™, JEFF, BULK RUSHING																			
RESP. DEPT.: BUSHINGS																			
DTR: C. DILLER 08-Dec-10 UNITS = in./[mm] DRAWING NO: T015B0120AQ																			
CHKD: SCALE = NTS																			
APPD: LANG. = ENGLISH REV.: A SHEET 1 OF 1																			

WE RESERVE ALL RIGHTS IN THIS DOCUMENT AND IN THE INFORMATION CONTAINED HEREIN. REPRODUCTION, USE OR DISCLOSURE TO THIRD PARTIES WITHOUT EXPRESS AUTHORITY IS STRICTLY FORBIDDEN. © ABB.