



Public Works Department Monthly Report

August 2026

Listed below is a summary of the activities of the Public Works Department for August

STREETS, PROPERTIES, AND STORM SEWER

- Trimmed trees at Welsh Park
- Trimmed brush in alley behind Town Hall
- Trimmed bushes at Suppeland Park
- Installed mulch around trees at Well 2 and Well 2 detention area.
- Repaired storm drain inlet on Dove St.
- Repaired storm drain inlet on E Meadow Dr.
- Mowed all Town owned parks and properties.
- Mowed/trimmed all ditches
- Dragged ball fields in CCP and Suppeland Parks
- Repaired pickleball nets
- Completed pothole patching
- Setup for Town festival – No Parking signs, generator, lights and parking area
- Changed light bulbs in Town Hall
- Cleaned up material area and moved millings and gravel to new material area
- Cleaned catch basins
- Ground various sidewalk areas correcting sidewalk displacement
- Moved speed signs for the Police

TRAINING

- Attended PWX – The Public Works Conference

EQUIPMENT/VEHICLE MAINTENANCE AND REPAIRS

- Squad 25 – Oil Change/Repair Arm Rest
 - WW3 – Oil Change
- Cleaned Air Filters on Street Sweeper

WATER AND WASTEWATER

GENERAL


- Completed work orders for:

Shut-Off Service:	0
Turn On Service:	0
Final Read:	9
Courtesy Read:	1
Julie Locate Requests:	71
New Meters Installed:	7
Existing Meters Replaced with New Meters:	15
Other:	4
Final Inspections:	4
Total Work Orders:	41


WASTEWATER

- Total raw wastewater flow into the plant (Influent) 7,793,000
- Total treated wastewater from the plant: (Effluent) 17,142,000
- Completed normal sewer main jetting
- Sampled process equipment for monthly compliance
- Worked in lagoons on airlines
- Completed maintenance on the blowers
- Cleaned wastewater manholes at STP
- Dismantled and cleaned disc filters
- Built and installed new aerators

INFLUENT

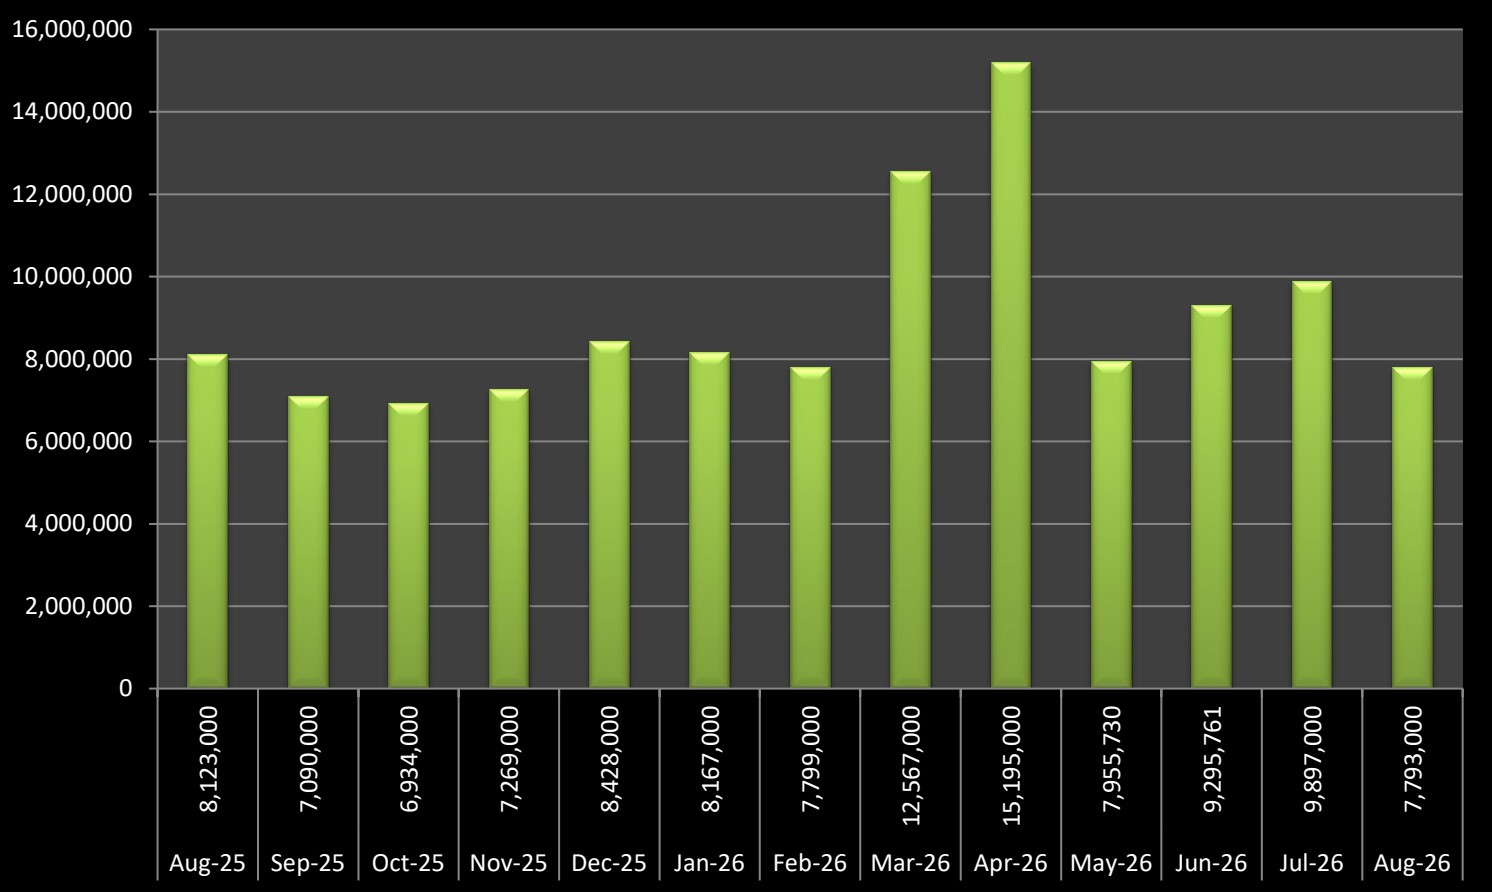


EFFLUENT

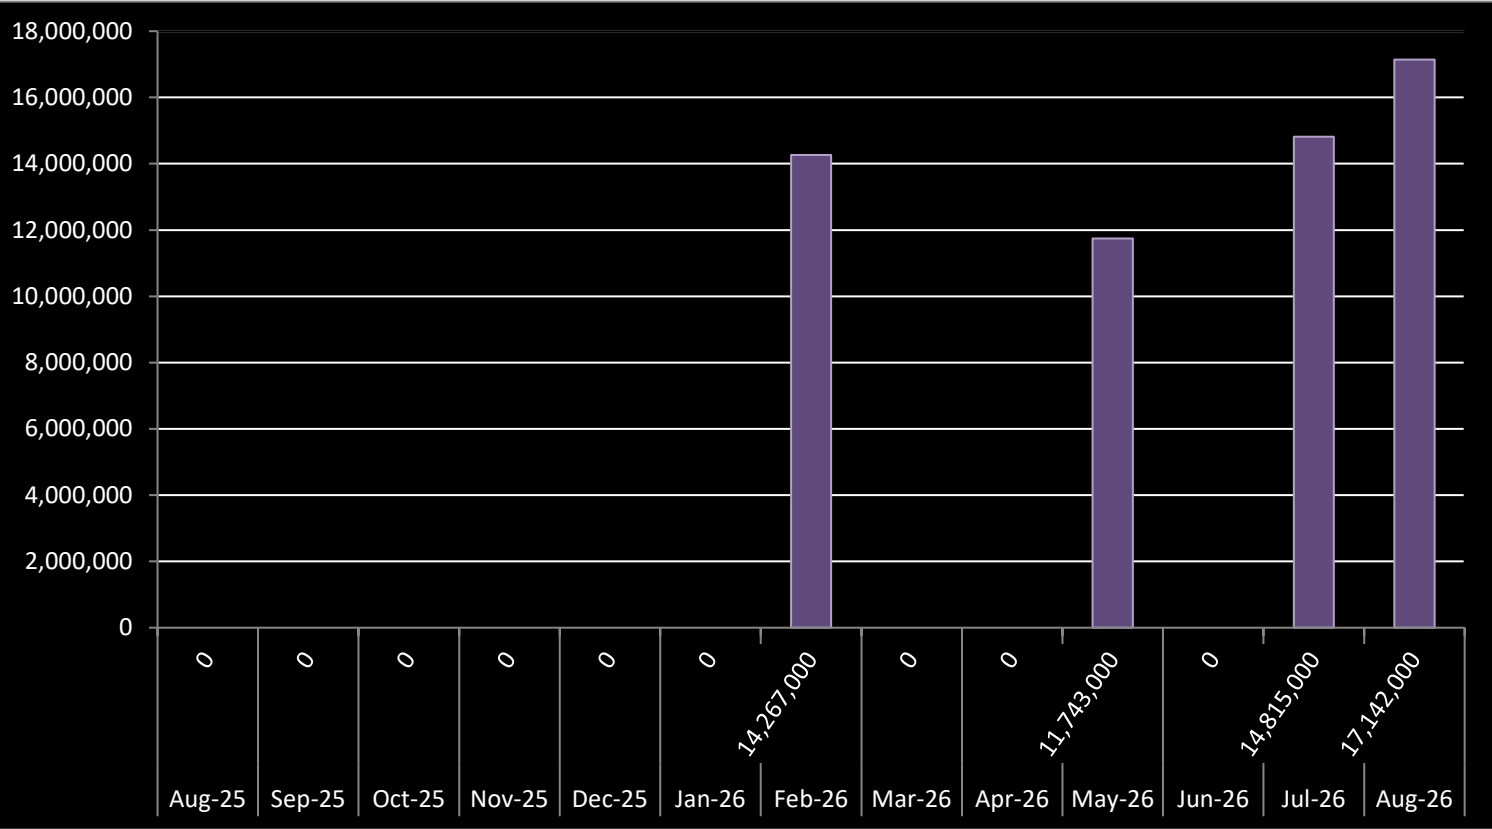

WATER

- Completed daily lab samples related to water quality. (pH, Fluoride, Chlorine, Hardness)
- Monthly chemical injection reports were completed and mailed to the IEPA.
- Distributed tags for water meter replacement
- Continued painting fire hydrants

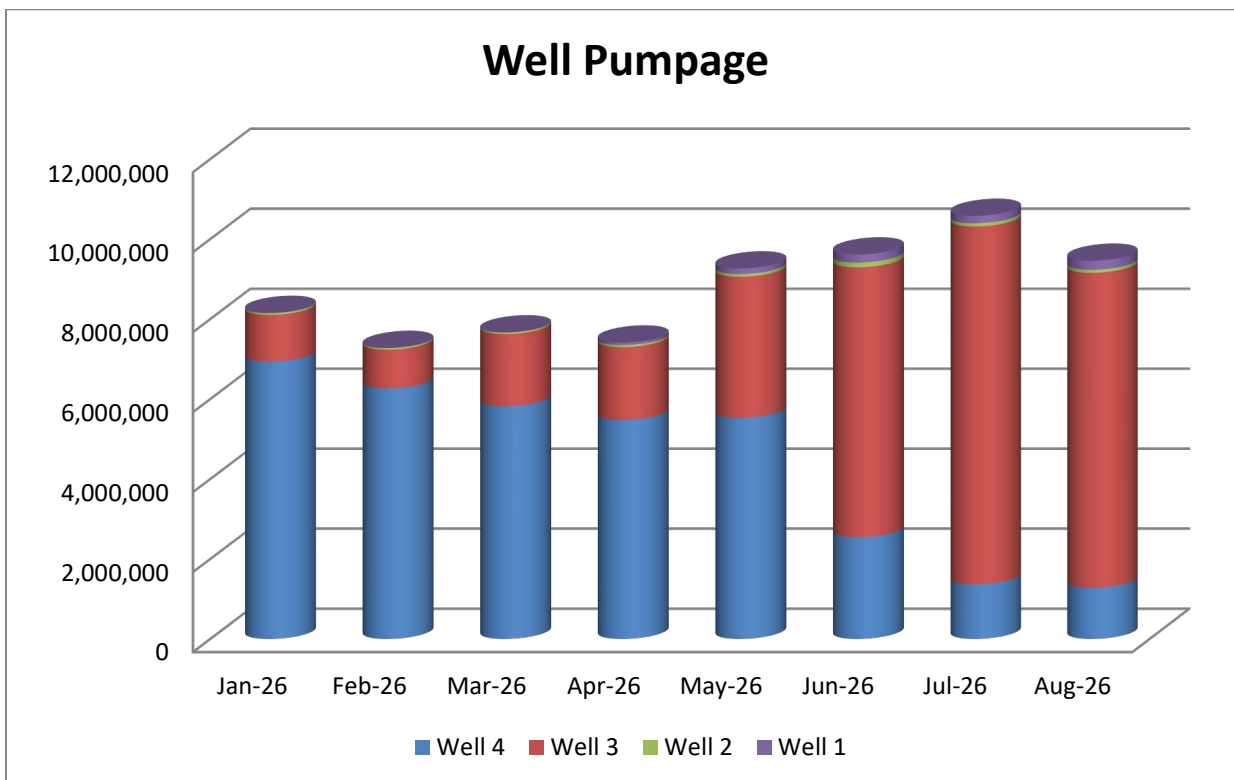

Well 1	227,100
Well 2	74,400
Well 3	7,878,000
Well 4	1,279,000

Total pumpage of treated water from wells for August: 9,458,500