



## **Public Works Department Monthly Report February 2025**

Listed below is a summary of the activities of the Public Works Department for February

### **STREETS, PROPERTIES, AND STORM SEWER**

- Completed pothole patching.
- Grinded various sidewalk joints for trip hazards.
- Repaired crushed storm sewer at Pampas and Chestnut.
- Repaired/replaced/installed various street and regulatory sign throughout Town.
- Repaired 2 streetlights.
- Repaired many "Lighted Emergency Exit" signs in various Town buildings.
- Installed required fire extinguisher signage in various Town buildings.

### **SNOWPLOWING AND ICE CONTROL**

- 1140 miles were driven during snow/ice removal operations in February.
- 112 tons of salt were used in February.

### **TRAINING**

- Entry Level Driver Training continued for the two employees that do not have CDL's. Classroom work is projected to be completed by April 1<sup>st</sup>.
- Joel S. and Jeff L. attended a webinar on 2025 Federal Regulatory and Legislative Update.
- Joel S. and Jeff L. attended a webinar for Quarterly Water and Wastewater Sector Threat Briefing.
- Travys L. completed online training for the JULIE locate ticket computer entry system.

## **EQUIPMENT/VEHICLE MAINTENANCE AND REPAIRS**

- Squad 20 – Oil Change
- Squad 20 – Oil Change
- Squad 17 – Remove bent rim and take tire to Belle Tire. Reinstalled tire and new rim on car.
- Squad 19 – Air up tire

## **WATER AND WASTEWATER**

### **GENERAL**


- Completed work orders for:

Shut-Off Service:	0
Turn On Service:	0
Final Read:	1
Courtesy Read:	1
Julie Locate Requests:	90
New Meters Installed:	0
Existing Meters Replaced with New Meters:	23
Other:	0
Final Inspections:	0
Total Work Orders:	26


### **WASTEWATER**

- Total raw wastewater flow into the plant (Influent) 9,160,000
- Total treated wastewater from the plant: (Effluent) 12,572,000
- Completed monthly wastewater sampling.
- Completed normal sewer main jetting.
- Completed compressor maintenance.
- Repaired a tear in the liner of cell 3 at the STP.

INFLUENT

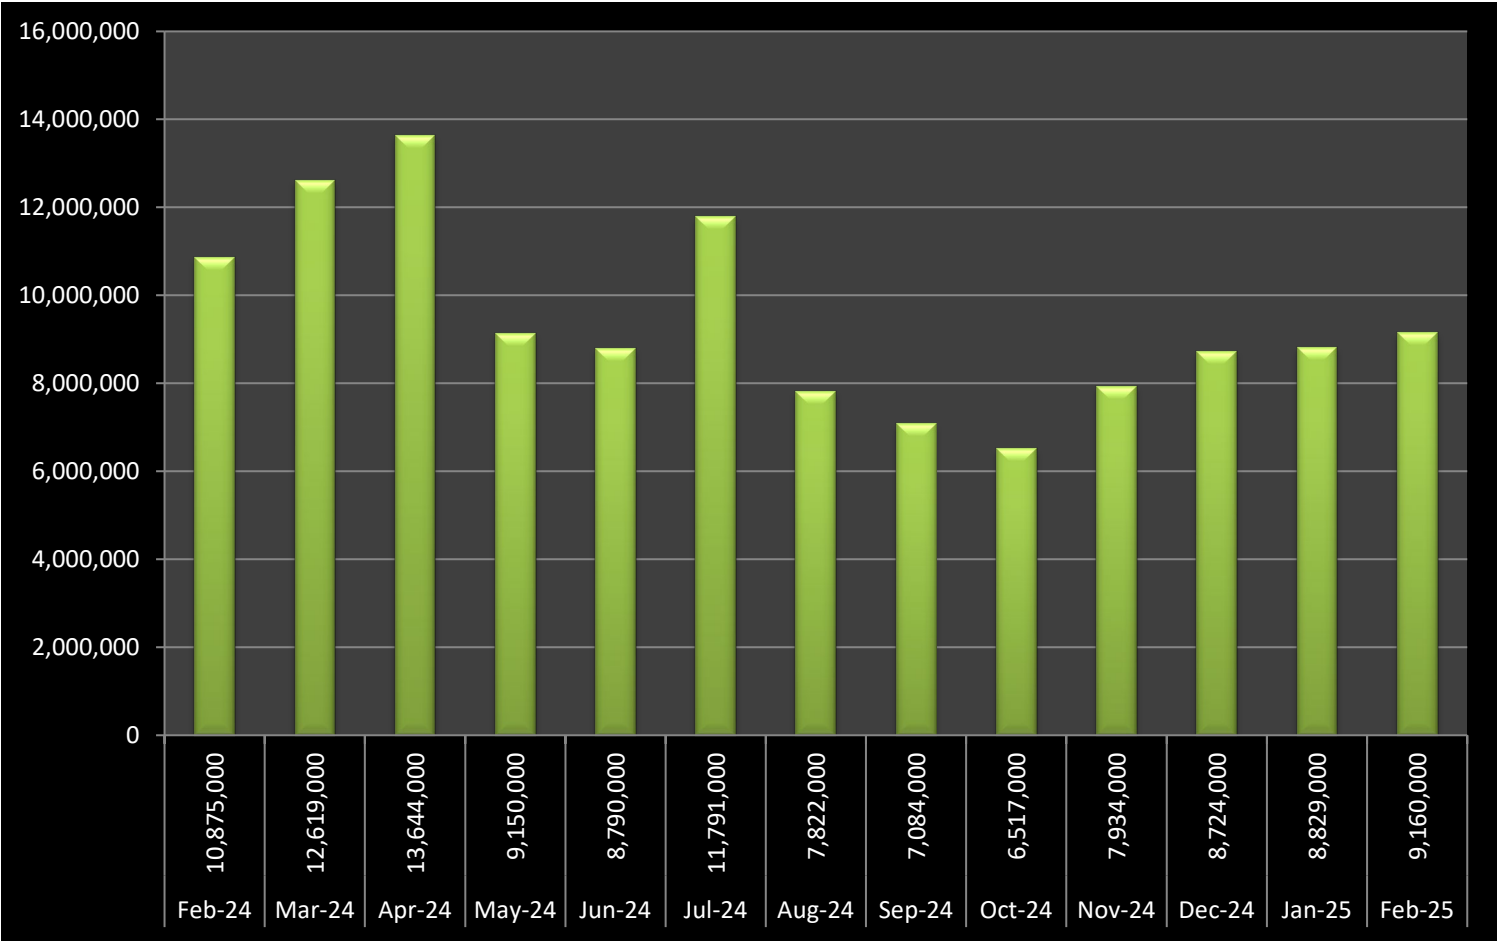


EFFLUENT

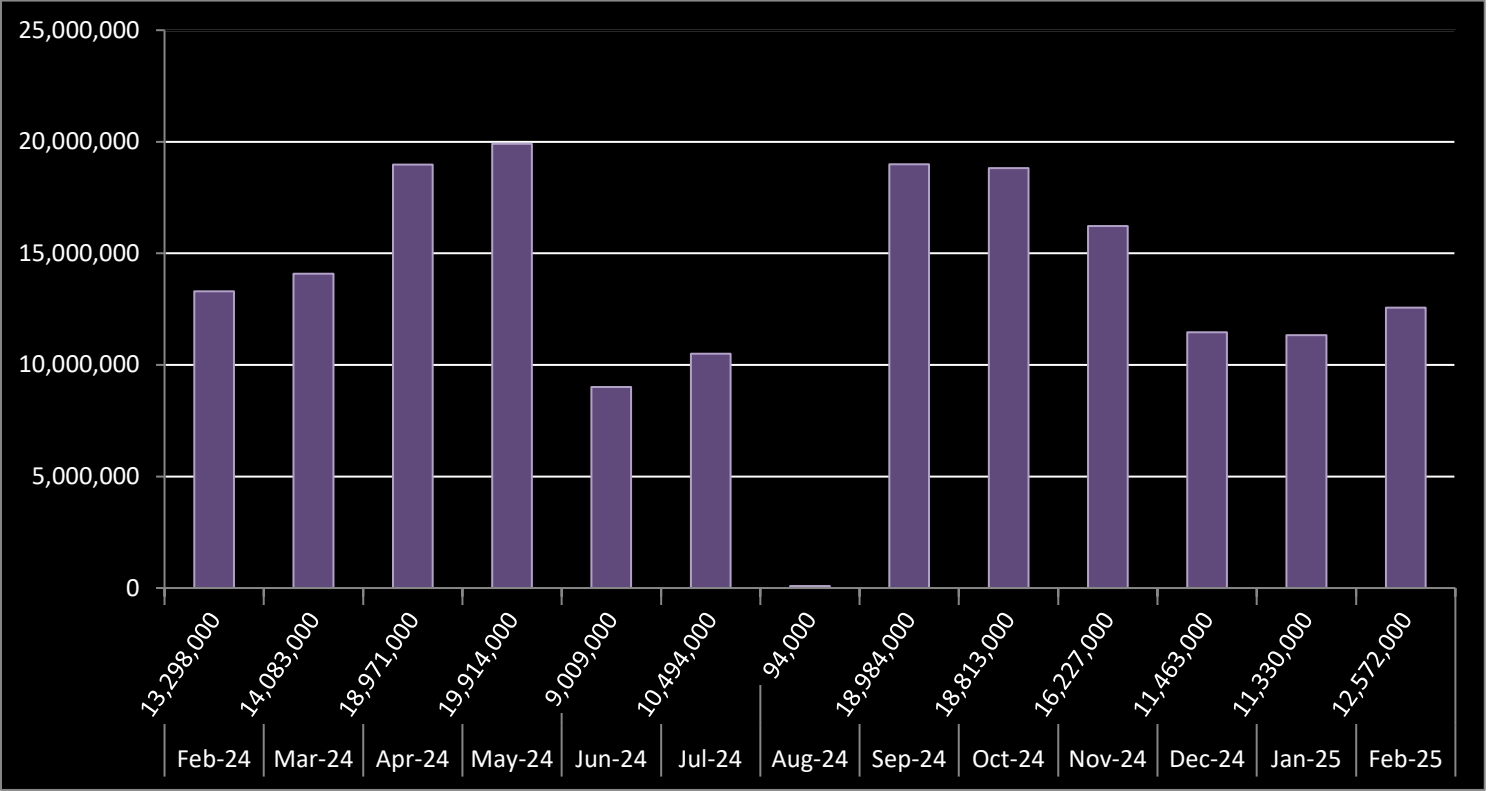

## WATER

- Completed daily lab samples related to water quality. (pH, Fluoride, Chlorine, Hardness)
- Monthly chemical injection reports were complete and mailed to the IEPA.
- Completed monthly sampling.
- Replaced over 20 water meters for updating to the current reading system.
- Replaced the light fixture in the chemical room at Well 3.

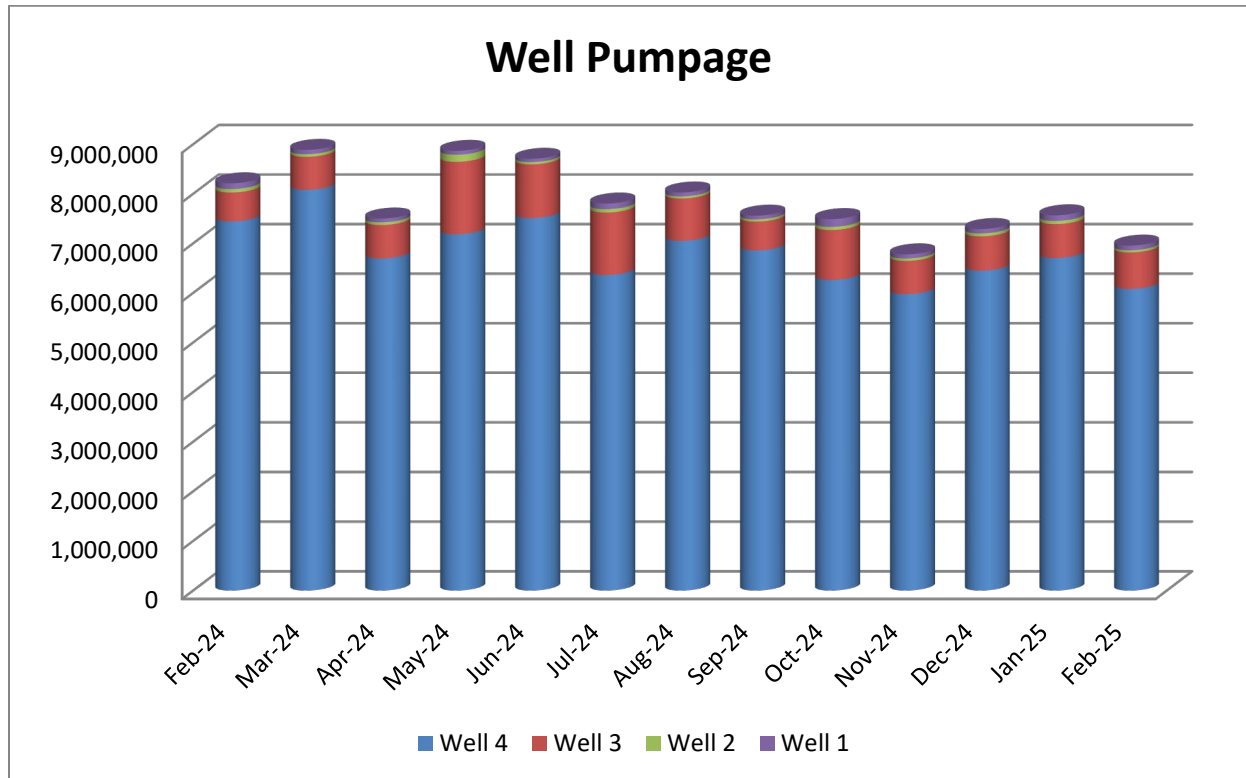

Well 1	93,900
Well 2	44,147
Well 3	738,000
Well 4	6,079,800

Total pumpage of treated water from wells for Febuaury: 6,955,847