



Public Works Department Monthly Report February 2026

Listed below is a summary of the activities of the Public Works Department for February

STREETS, PROPERTIES, AND STORM SEWER

- Install America 250 Banners
- Grind sidewalk hazards in multiple locations
- Cleaned up plowing divots
- Picked up garbage in ditches and parks
- Installed a new culvert/field entrance on Loves Road
- Picked up branches in parks
- Patched potholes

TRAINING

- Staff attended annual JULIE training

EQUIPMENT/VEHICLE MAINTENANCE AND REPAIRS

- Bucket Truck – Replaced front brake calipers and pads
 - Vactor Truck – ECM wiring was replaced

WATER AND WASTEWATER

GENERAL


- Completed work orders for:

Shut-Off Service:	0
Turn On Service:	0
Final Read:	3
Courtesy Read:	1
Julie Locate Requests:	66
New Meters Installed:	8
Existing Meters Replaced with New Meters:	4
Other:	0
Final Inspections:	3
Total Work Orders:	11


WASTEWATER

- Total raw wastewater flow into the plant (Influent) 7,799,000
- Total treated wastewater from the plant: (Effluent) 14,267,000
- Completed normal sewer main jetting
- Sampled process equipment for monthly compliance
- Worked in lagoons on airlines
- Responded to a lift station emergency at Pine St Lift Station. A breaker and a pump shorted out due to the electric conduit rotting away and breaking the main electric line from the wet well to the lift station building.

INFLUENT

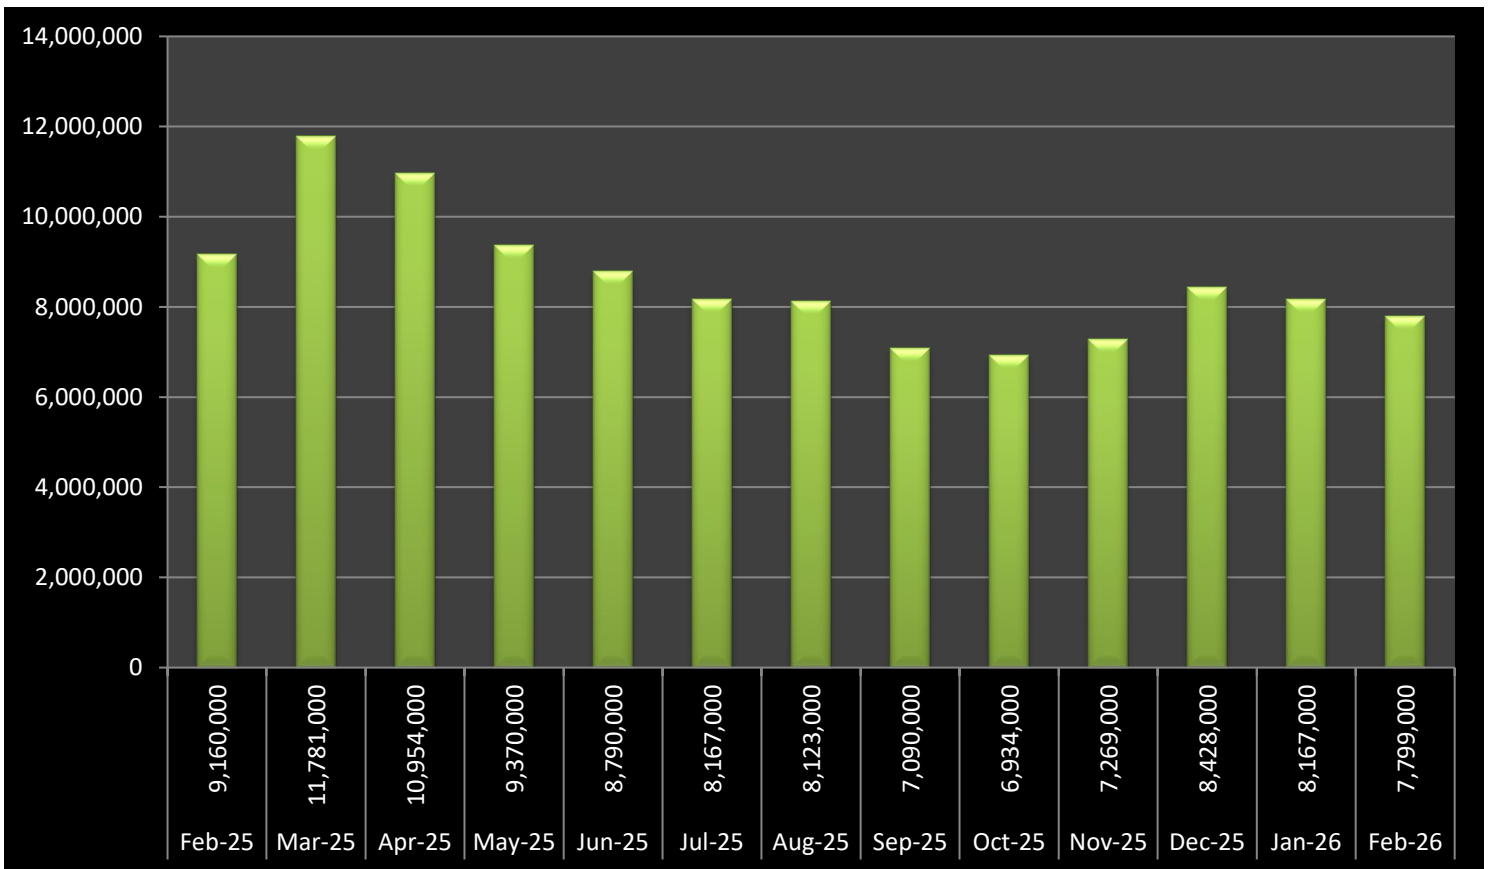


EFFLUENT

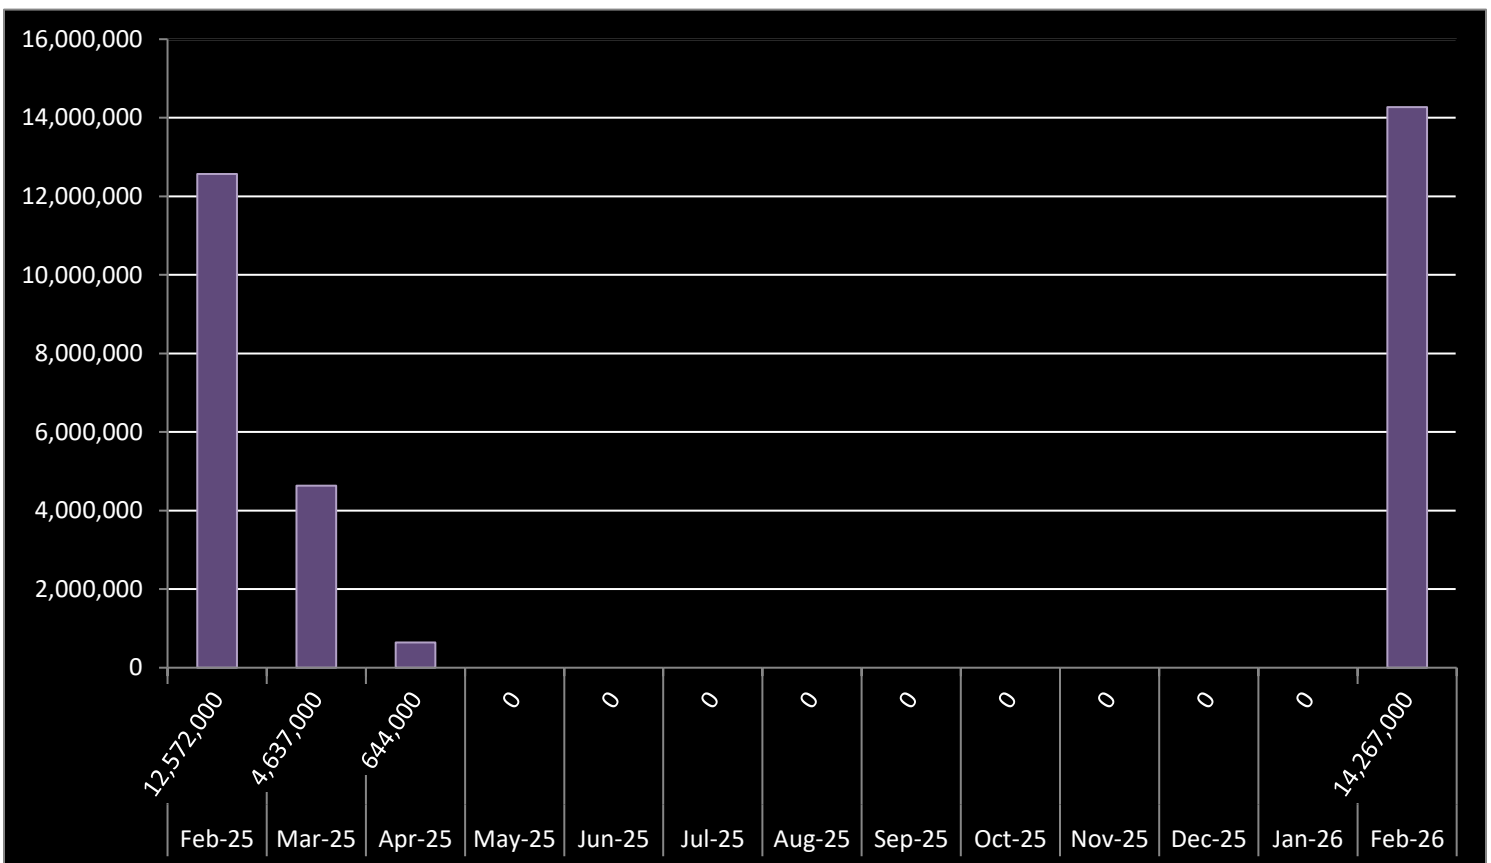

WATER

- Completed daily lab samples related to water quality. (pH, Fluoride, Chlorine, Hardness)
- Monthly chemical injection reports were completed and mailed to the IEPA.
- Painted all process pipes at Well 2
- Responded to a water main break on Cortland Center Rd
- Well 1 motor and pump has been pulled and awaiting replacement

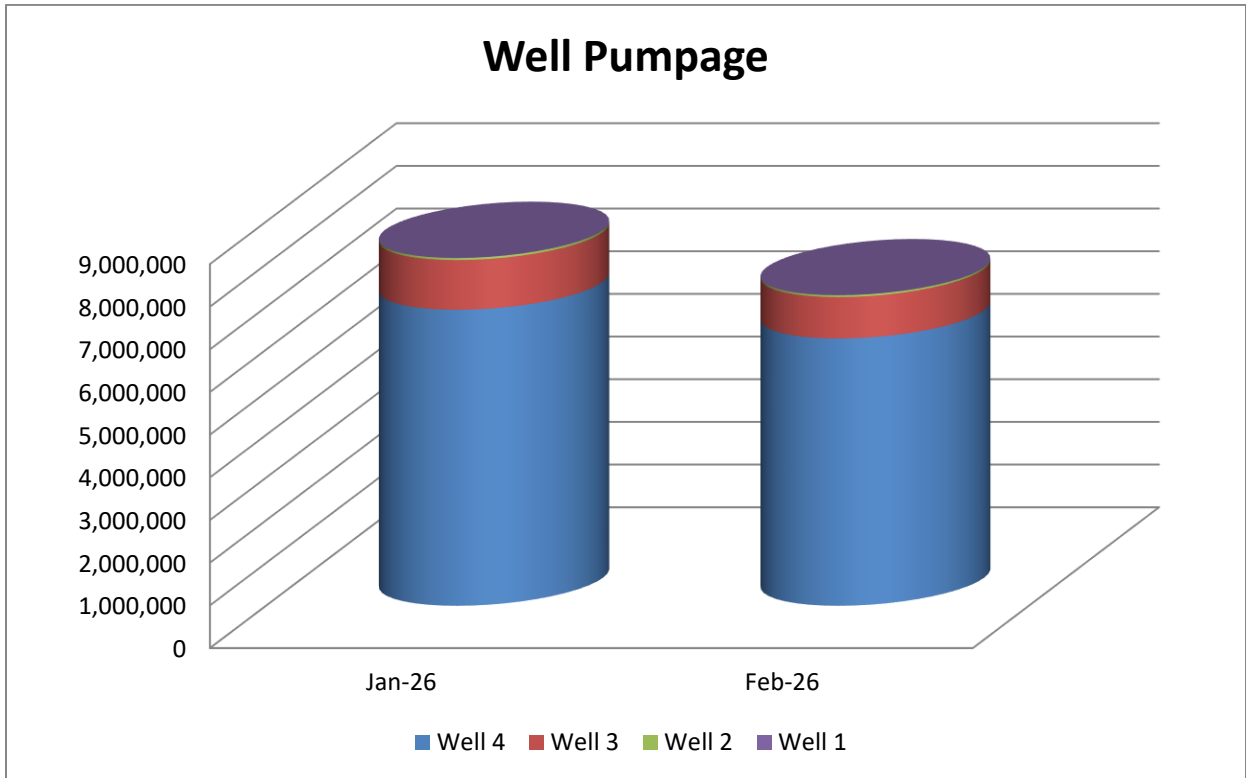

Well 1	0
Well 2	42,700
Well 3	970,000
Well 4	6,265,100

Total pumpage of treated water from wells for Febuaury: 7,277,800