



Public Works Department Monthly Report March 2024

Listed below is a summary of the activities of the Public Works Department for March

STREETS, PROPERTIES, AND STORM SEWER

- Patched potholes as needed.
- Removed snow fence from various areas of Town.
- Replace/repaired all damaged mailboxes from snow plowing operations.
- Mulched around trees in parks.
- Repaired previous excavation areas around Town.
- Replaced light bulb in stained glass window at Town Hall.
- Removed various dead trees throughout Town.
- Replace the sump pump in the old school.
- Continued to clean old school.
- Removed and repoured 90 feet of damaged sidewalk in front of McPhilips Park.
- Removed and washed all salting and plowing equipment from trucks.
- Resurfaced various sidewalk trip hazards.

SNOWPLOWING AND SALTING

- Minimal salting was completed this month.

EQUIPMENT/VEHICLE MAINTENANCE AND REPAIRS

- Squad 20 – Completed Oil Change
- Squad 19 – Completed Oil Change and Installed new front and rear brakes.
- Vector – Installed new LED lights on the vehicle.

TRAINING

CDL training continued for Thomas Boubin

WATER AND WASTEWATER

GENERAL


- Completed work orders for:

Shut-Off Service:	0
Turn On Service:	1
Final Read:	11
Courtesy Read:	0
Julie Locate Requests:	62
New Meters Installed:	3
Existing Meters Replaced with New Meters:	23
Other:	
Final Inspections:	3
Total Work Orders:	19


WASTEWATER

- Approx. 12,619,000 gallons flowed into the treatment plant.
- Approx. 14,083,000 gallons were discharged.
- The Discharge Monitoring Report (DMR) was completed and filed with the IEPA.
- Completed monthly wastewater sampling.
- Completed normal sewer main jetting.
- Installed a new cutout valve on the disc filter compressor.
- Repaired 15 aerators in cell 1.
- Inovair completed start up on the newly installed blower.

INFLUENT

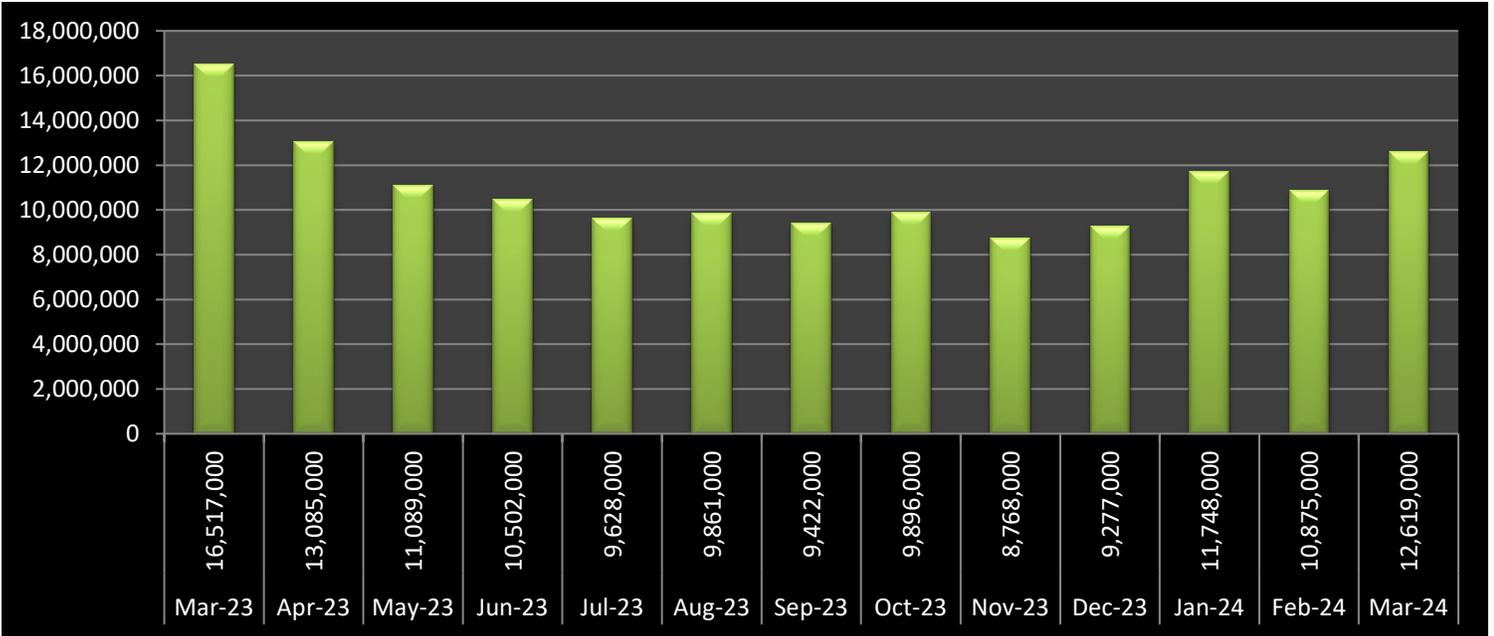


EFFLUENT

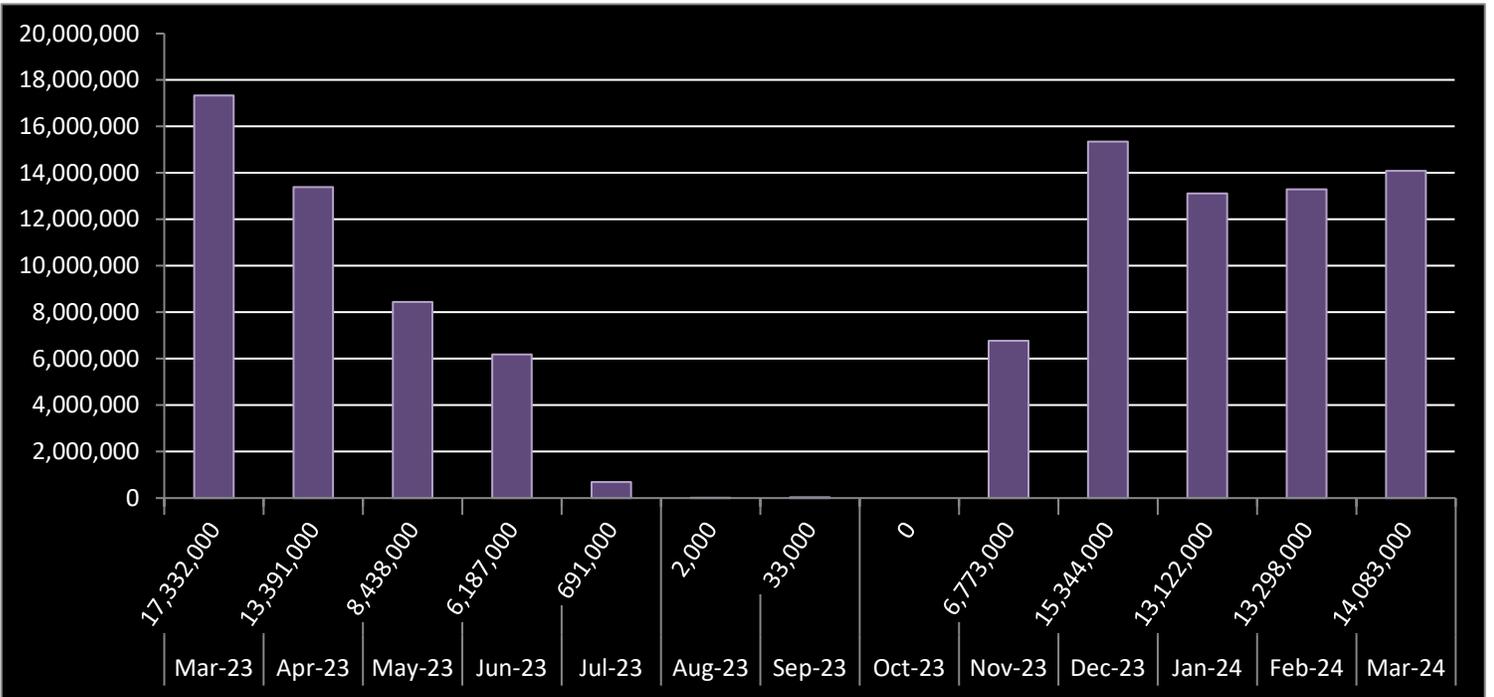

WATER

- Completed daily lab samples related to water quality. (pH, Fluoride, Chlorine, Hardness)
- Monthly chemical injection reports were complete and mailed to the IEPA.
- Completed monthly sampling.
- Cleaned well houses for IEPA inspection.
- Completed Water Service Line Inventory Report.
- Called in ATS to investigate possible water leak at McMillian Ct.
- Updated emergency procedures manual and other water related paperwork for IEPA inspection.

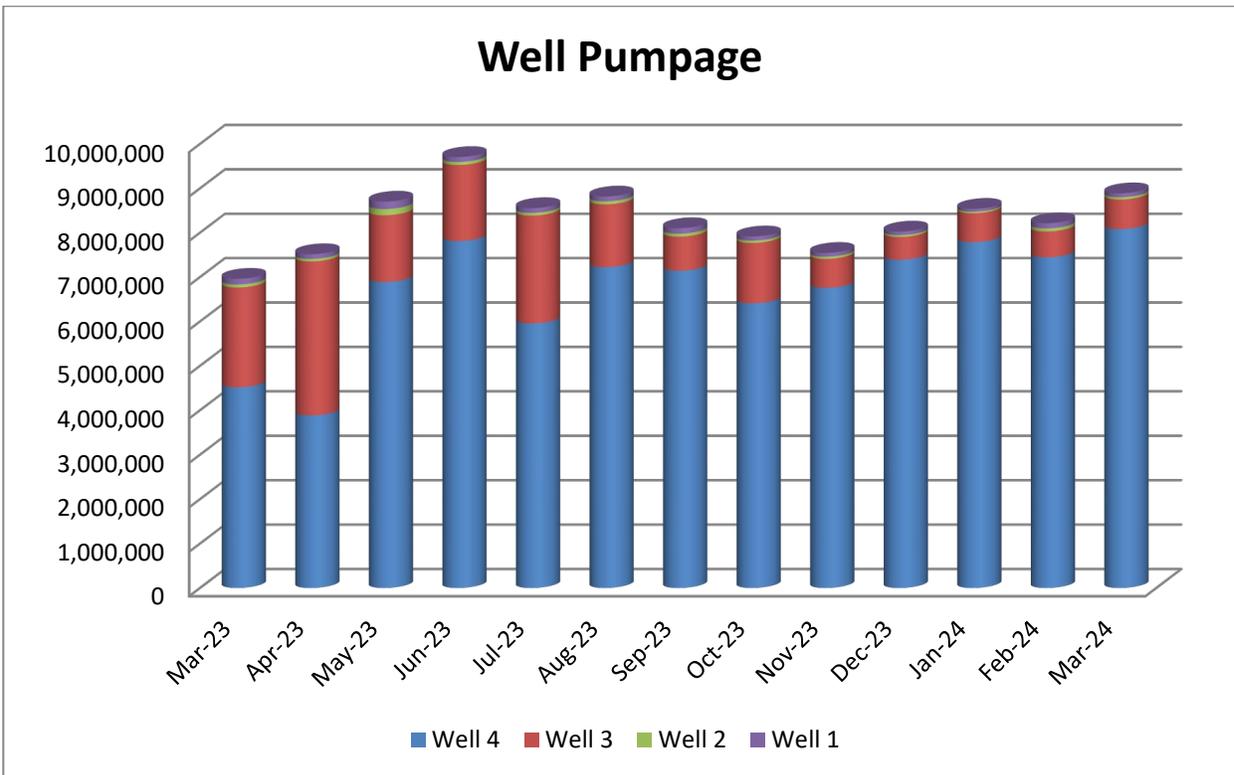

Well 1 87,100
Well 2 53,100
Well 3 666,000
Well 4 8,081,300

Total pumpage of treated water from wells for March 2024: 8,887,500