



Public Works Department Monthly Report September 2024

Listed below is a summary of the activities of the Public Works Department for September

STREETS, PROPERTIES, AND STORM SEWER

- Patched potholes as needed.
- Continued mowing operations on all town properties.
- Swept streets.
- Refreshed painted traffic control lines on Cortland Center Road
- Refreshed paint on various stop bars as needed.
- Repaired sidewalk in front of PW building
- Installed BAGS game in Hetchler Park and Suppeland Park
- Installed bike rack in Cortland Community Park



- Installed PING PONG game in Cortland Community Park



- Removed damaged tree in Cortland Community Park



- Removed dead parkway tree.



EQUIPMENT/VEHICLE MAINTENANCE AND REPAIRS

- Squad 20 – Oil Change

TRAINING

WATER AND WASTEWATER

GENERAL

- Completed work orders for:


Shut-Off Service:	0
Turn On Service:	1
Final Read:	11
Courtesy Read:	1
Julie Locate Requests:	63
New Meters Installed:	4
Existing Meters Replaced with New Meters:	0
Other:	1
Final Inspections:	0
Total Work Orders:	18

WASTEWATER


- Total raw wastewater flow into the plant (Influent) 7,084,000
- Total treated wastewater from the plant: (Effluent) 18,984,000
- Completed monthly wastewater sampling.
- Completed normal sewer main jetting.
- Installed Wet Well Wizard in lift stations at North Ave and Neucort Lakes



INFLUENT

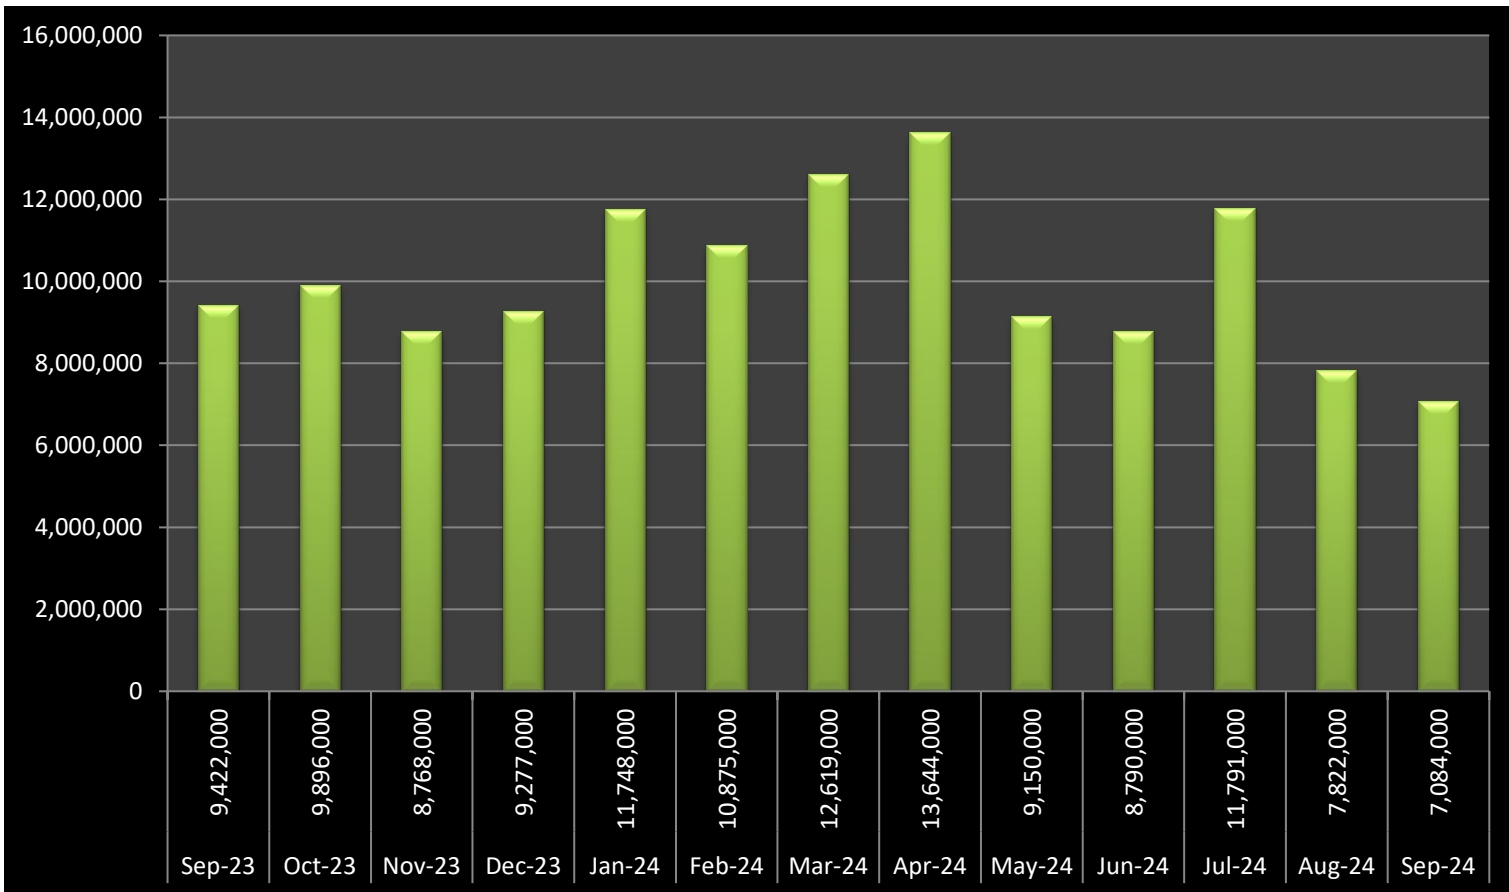


EFFLUENT

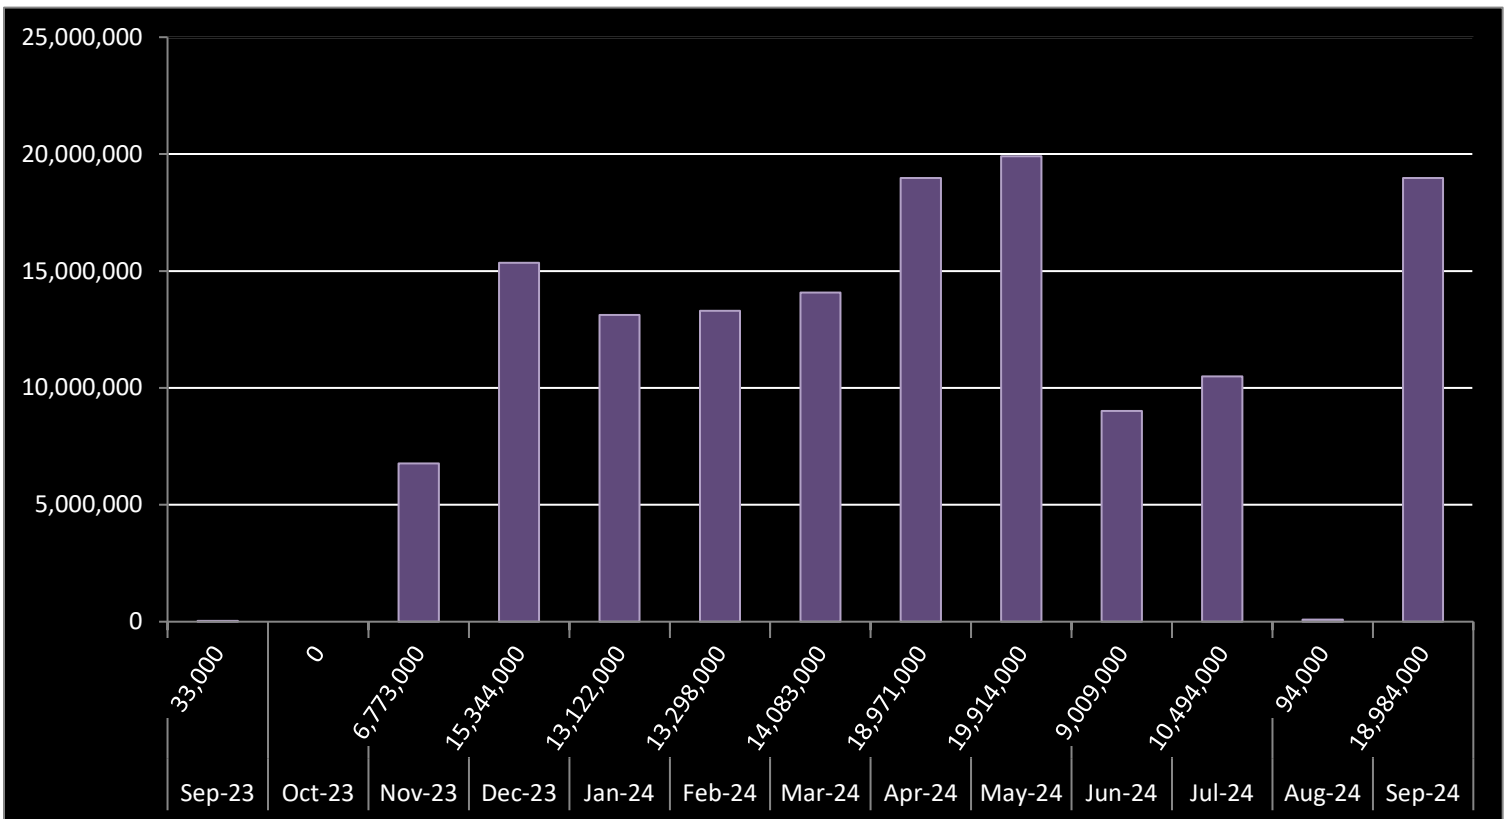

WATER

- Completed daily lab samples related to water quality. (pH, Fluoride, Chlorine, Hardness)
- Monthly chemical injection reports were complete and mailed to the IEPA.
- Completed monthly sampling.
- Lowered 2 b-boxes.
- Rebuilt 1 chlorine pump.
- Replaced chlorine injector at Well 1

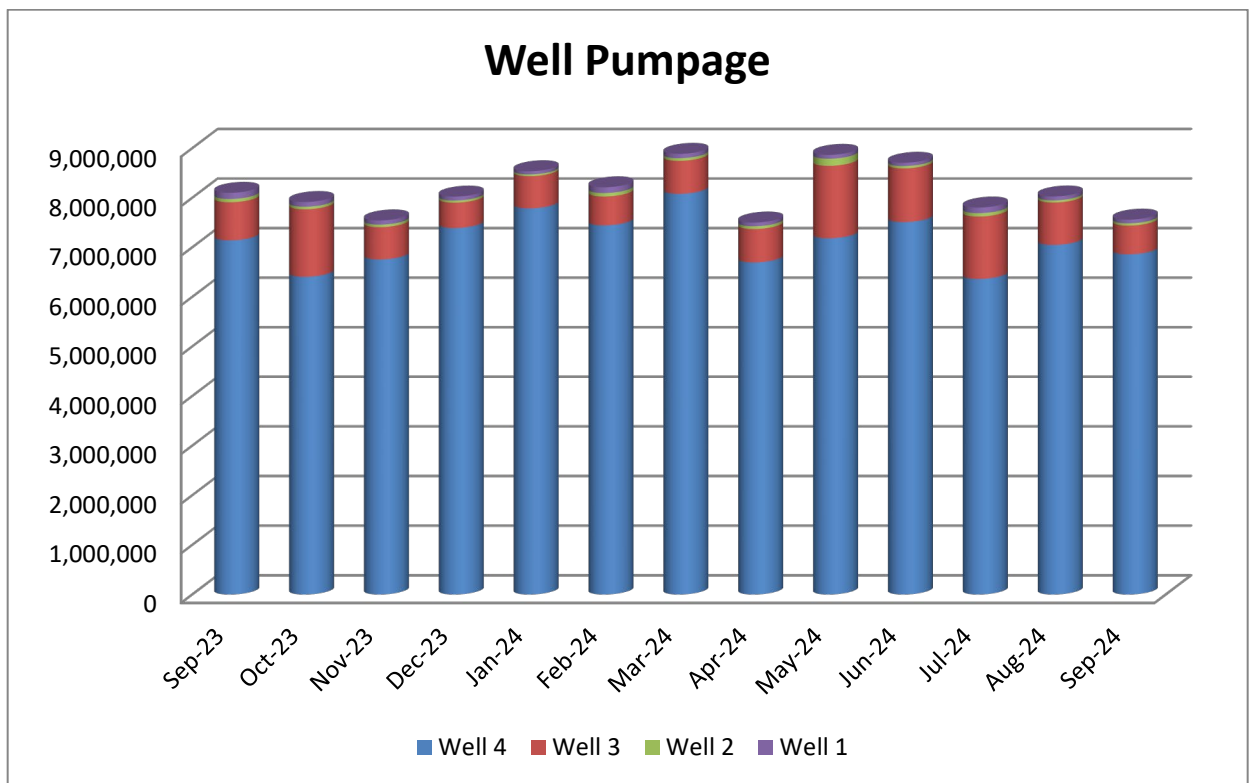

Well 1 73,900
Well 2 46,400
Well 3 580,000
Well 4 6,860,000

Total pumpage of treated water from wells for September: 7,560,300