



Public Works Department Monthly Report December 2023

Listed below is a summary of the activities of the Public Works Department for December 2023

STREETS, PROPERTIES, AND STORM SEWER

- Patched potholes as needed.
- Curbside leaf pick up.
- Installed signage for Ped path extension.
- Cleaned and winterized the leaf vac.
- Replaced torn flags at all Town locations.
- Installed snow fence at usual locations in Town.
- Installed new lighting and painted the wash bay.
- Installed the new power washer in the wash bay.

SNOWPLOWING AND SALTING

- 46 miles were driven during events in December.
- 18 Tons of salt were used in events in December.

EQUIPMENT/VEHICLE MAINTENANCE AND REPAIRS

- Squad 20 Replace Headlight Bulb
- Squad 21 Replace Printer Battery
- Engineer 15 Replace Headlight Assemblies

TRAINING

- CDL training continued for Thomas Boubin

WATER AND WASTEWATER

GENERAL

- Completed work orders for:


| | |
|---|----|
| Shut-Off Service: | 1 |
| Turn On Service: | 0 |
| Final Read: | 8 |
| Courtesy Read: | 0 |
| Julie Locate Requests: | 50 |
| New Meters Installed: | 2 |
| Existing Meters Replaced with New Meters: | 6 |
| Other: | |
| Final Inspections: | 3 |
| Total Work Orders: | 21 |

WASTEWATER


- Approx. 9,277,000 gallons flowed into the treatment plant.
- Approx. 15,344,000 gallons were discharged.
- The Discharge Monitoring Report (DMR) was completed and filed with the IEPA.
- Completed monthly wastewater sampling.
- Completed normal sewer main jetting.
- Completed IEPA wastewater facility inspection.
- Completed aerator work in the lagoons.



INFLUENT

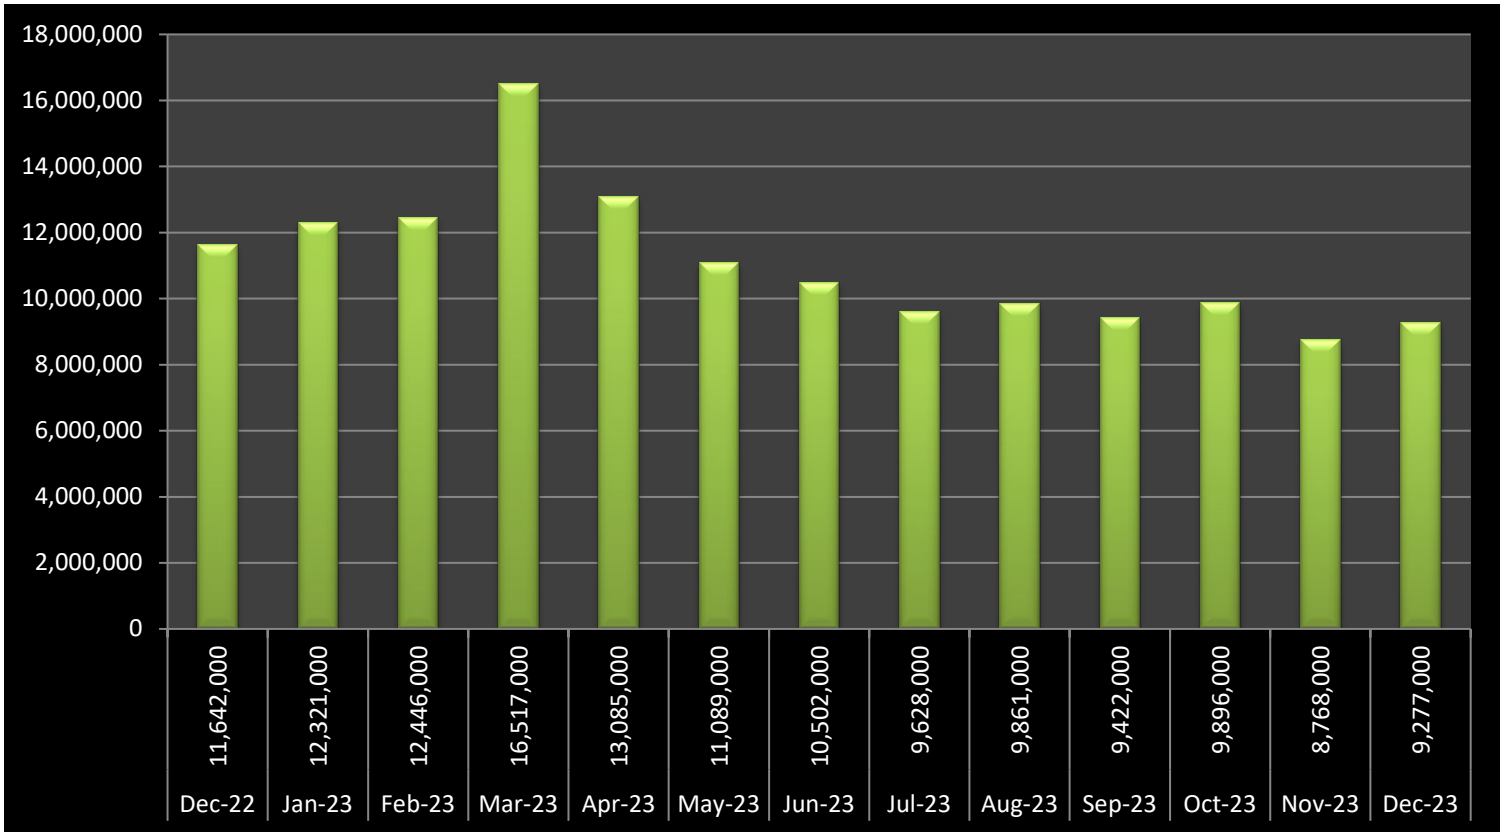


EFFLUENT

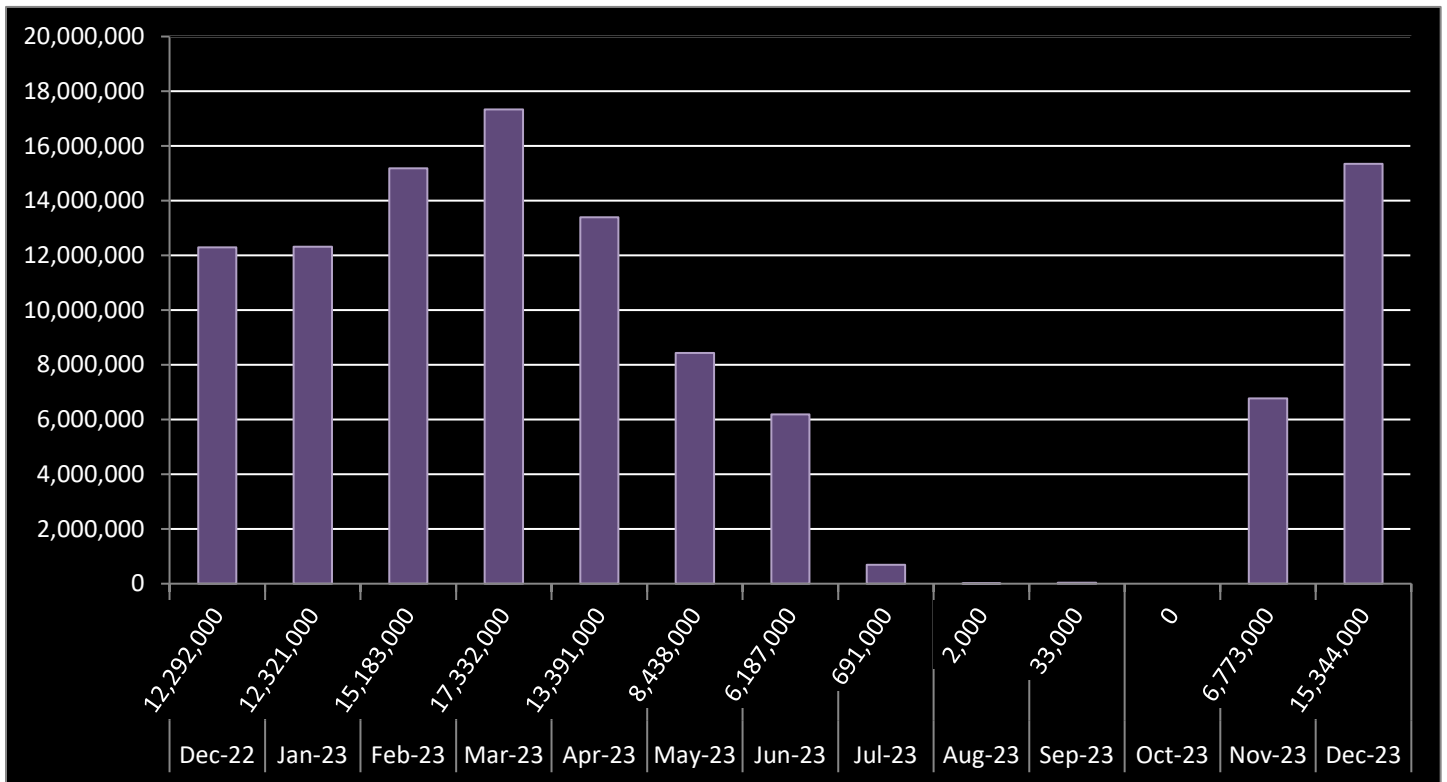

WATER

- Completed daily lab samples related to water quality. (pH, Fluoride, Chlorine, Hardness)
- Monthly chemical injection reports were complete and mailed to the IEPA.
- Completed monthly sampling.
- Repaired a service break in the middle of Walnut St.

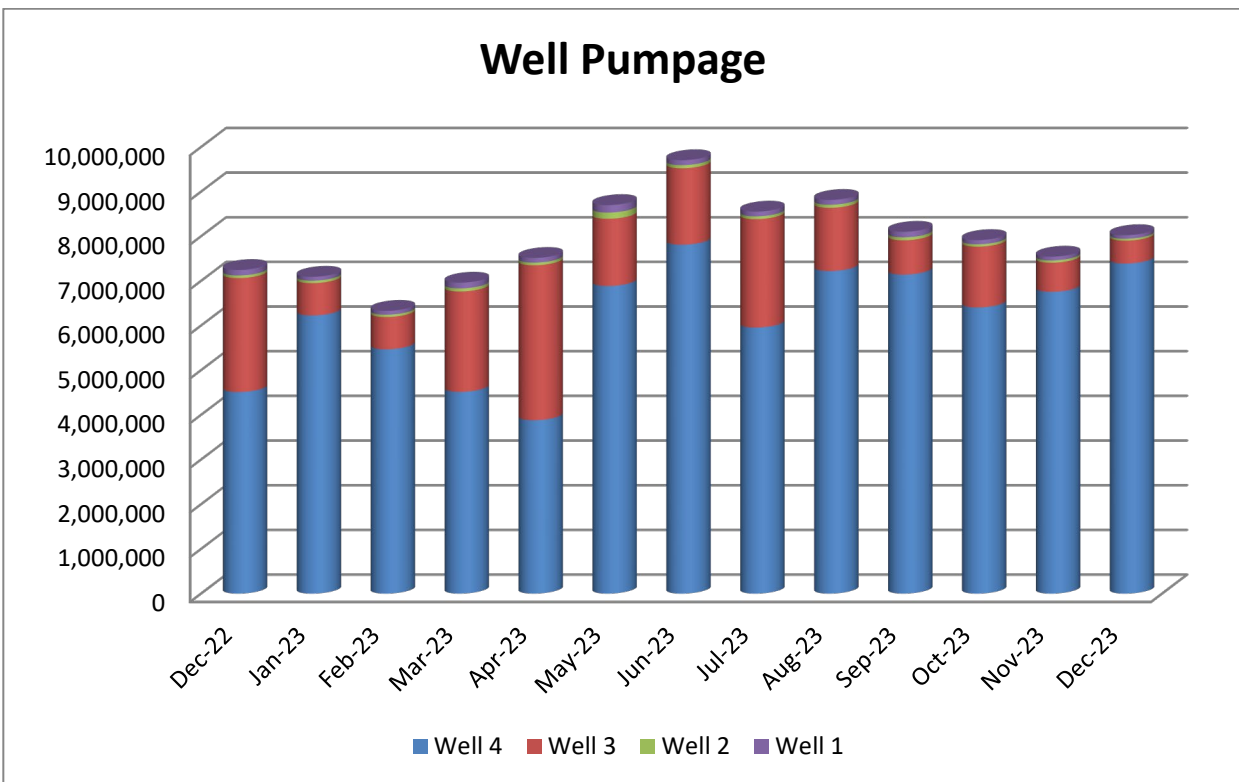

| | |
|--------|-----------|
| Well 1 | 79,500 |
| Well 2 | 42,800 |
| Well 3 | 513,000 |
| Well 4 | 7,390,200 |

Total pumpage of treated water from wells for December 2023: 8,025,500