



Public Works Department Monthly Report October 2025

Listed below is a summary of the activities of the Public Works Department for October

STREETS, PROPERTIES, AND STORM SEWER

- Mowed all Town property and parks.
- Mowed ditches
- Excavated, framed, stoned, and poured concrete for path connections
- Installed new street signs in Chestnut Grove, Fire Station Ahead Warning on Somonauk, and various street name signs
- Built and distributed four new picnic tables
- Dredge triangle pond
- Completed branch/limb chipping for citizens
- Completed street sweeping
- Installed and picked up signage and barricades for Town parade
- Excavated, stoned, and compacted area for parking lot extension at PW
- Planted seasonal plants in Townhall planters
- Removed speed signs by request of the PD
- Repaired RR crossing delineators on Loves Rd and Somonauk Rd
- Started leaf pick up
- Installed new metal roof on PW/PD building



TRAINING

- Trained staff on leaf vac operations

EQUIPMENT/VEHICLE MAINTENANCE AND REPAIRS

- Squad 19 – Oil Change
- W/WW 3 – Oil Change
- Streets 2 – Oil Change
- Leaf Vac – Oil Change
- Toro Mowers – Winterized
 - Truck 10 – Test Lane
 - Truck 12 – Test Lane
 - Truck 16 – Test Lane
- Truck 01- To Superior For ABS Issue
- Truck 16 – To Superior For Regen/DEF issue

WATER AND WASTEWATER

GENERAL


- Completed work orders for:

Shut-Off Service:	0
Turn On Service:	0
Final Read:	5
Courtesy Read:	0
Julie Locate Requests:	105
New Meters Installed:	0
Existing Meters Replaced with New Meters:	0
Other:	1
Final Inspections:	4
Total Work Orders:	10


WASTEWATER

- Total raw wastewater flow into the plant (Influent) 6.934,000
- Total treated wastewater from the plant: (Effluent) 0
- Completed normal sewer main jetting.
- Continued to build/repair aerators at the STP.
- Re-attached aerators in cell 1 and 2
-

INFLUENT

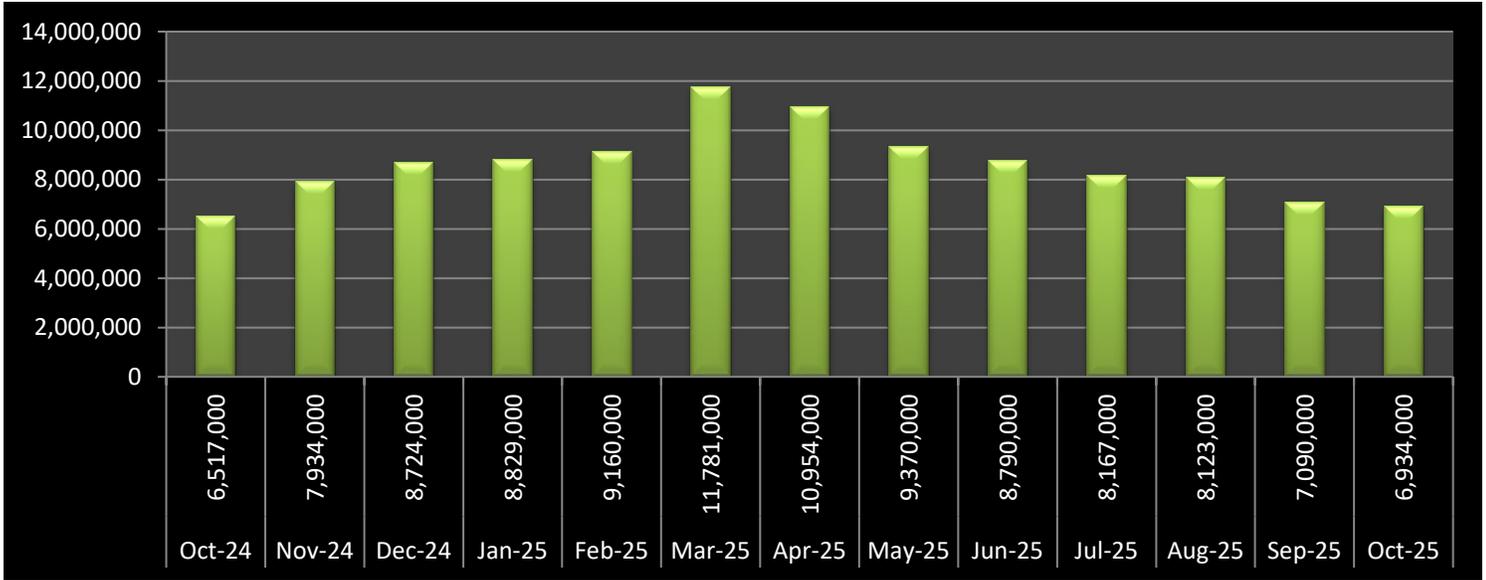


EFFLUENT

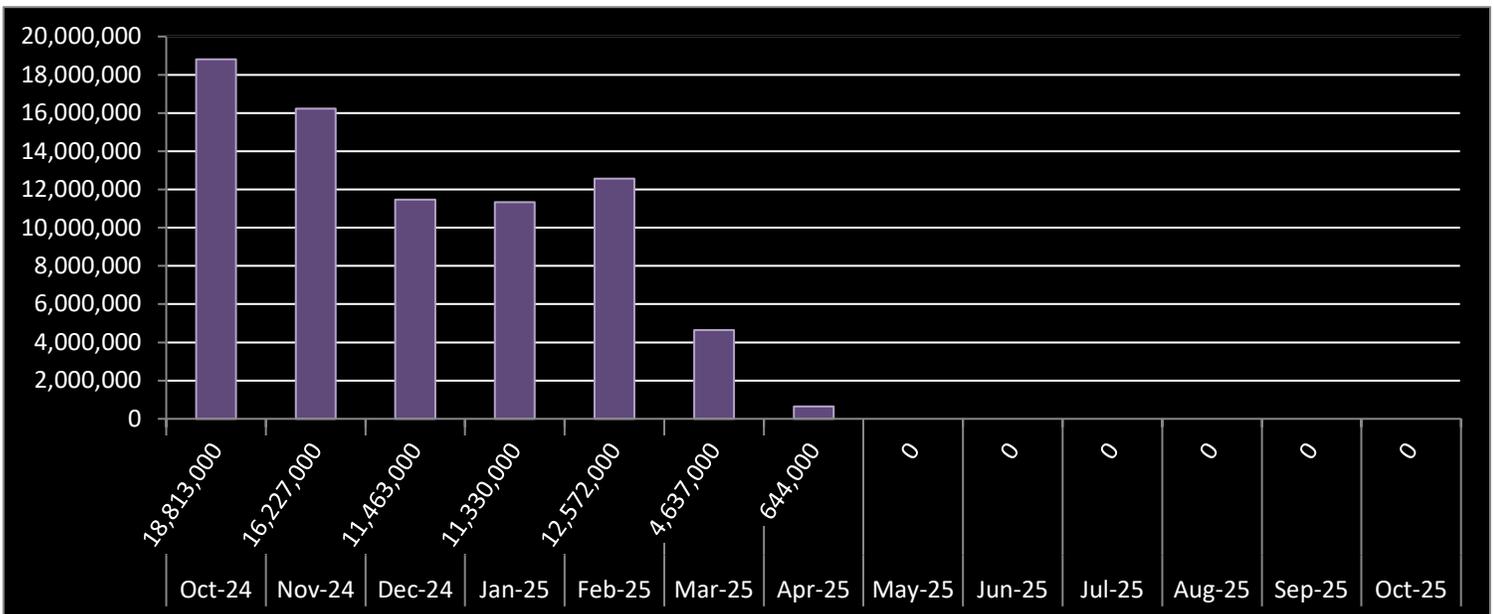

WATER

- Completed daily lab samples related to water quality. (pH, Fluoride, Chlorine, Hardness)
- Monthly chemical injection reports were completed and mailed to the IEPA.
- Repaired main/service break on Hahn St
- Read meters for utility billing
- Assisted with the Town shred event.

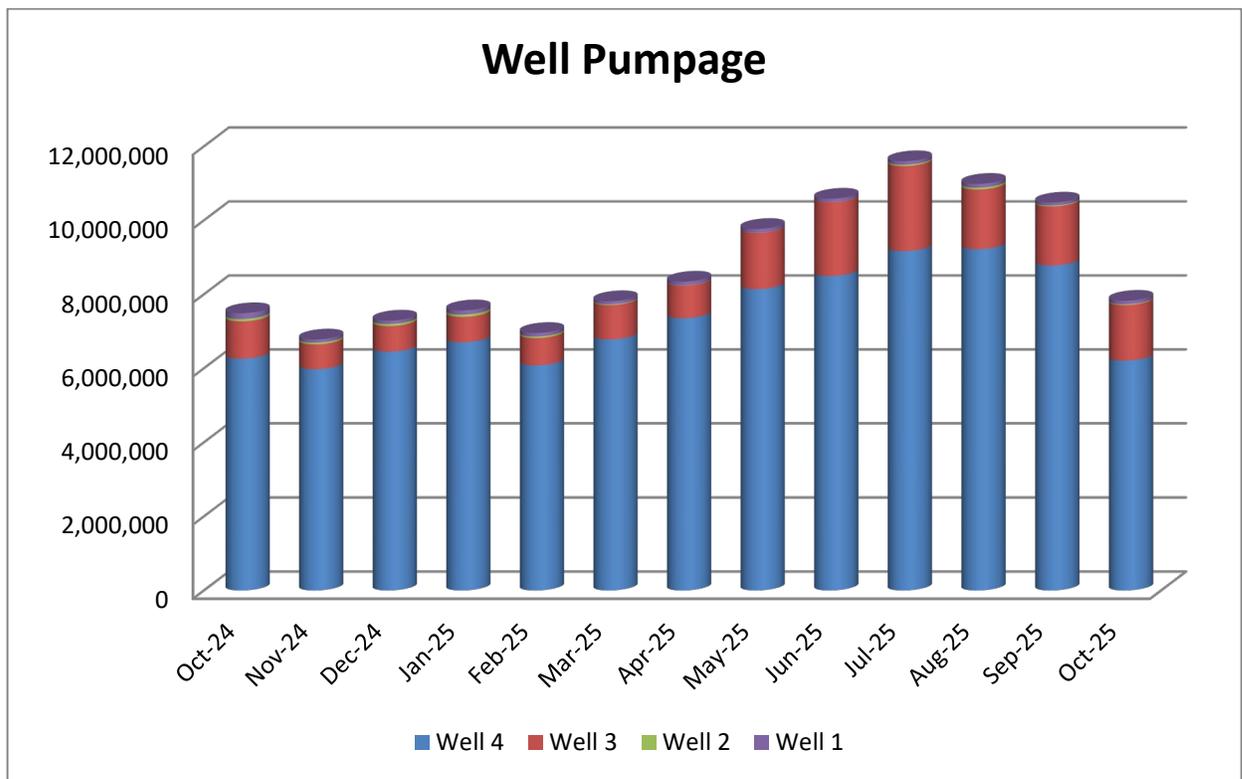

Well 1	94,100
Well 2	22,988
Well 3	1,503,000
Well 4	6,207,600

Total pumpage of treated water from wells for October: 7,827,688