



Public Works Department Monthly Report

July 2025

Listed below is a summary of the activities of the Public Works Department for July

STREETS, PROPERTIES, AND STORM SEWER

- Mowed all Town property and parks.
- Mowed ditches
- Mowed ponds
- Completed police work orders for mowing private property.
- Installed soccer goals at Suppeland Park.
- Ground 12 tree stumps in parkways.
- Mulched Town owned areas.
- Added 14 tons of AG-Lime to CCP ballfield.
- Swept streets.
- Cold patched potholes.
- Repaired storm sewer at 177 Clover Ave.

TRAINING

- 2 employees completed CDL training and testing and have obtained their Class B with air brake endorsement CDL'S.

EQUIPMENT/VEHICLE MAINTENANCE AND REPAIRS

- Squad 20 – Oil Change
 - EZ 15 – Oil Change
 - Squad 21 – Oil Change
- Toro Mower – New Deck Belt and Idler Pulley
 - Truck #16 – Repair Rear Light Plate

WATER AND WASTEWATER

GENERAL


- Completed work orders for:

Shut-Off Service:	0
Turn On Service:	0
Final Read:	14
Courtesy Read:	1
Julie Locate Requests:	118
New Meters Installed:	7
Existing Meters Replaced with New Meters:	8
Other:	1
Final Inspections:	3
Total Work Orders:	33


WASTEWATER

- Total raw wastewater flow into the plant (Influent) 8,167,000
- Total treated wastewater from the plant: (Effluent) 0
- Completed normal sewer main jetting.
- Continued to build/repair aerators at the STP.
- Continued to explore phosphate mitigation treatments.
- Took the electric motor from turbo blower #1 to a shop for repairs.
- Re-attached 18 aerators in the lagoons at the STP.
- Completed the permit application for treated wastewater discharge.

INFLUENT

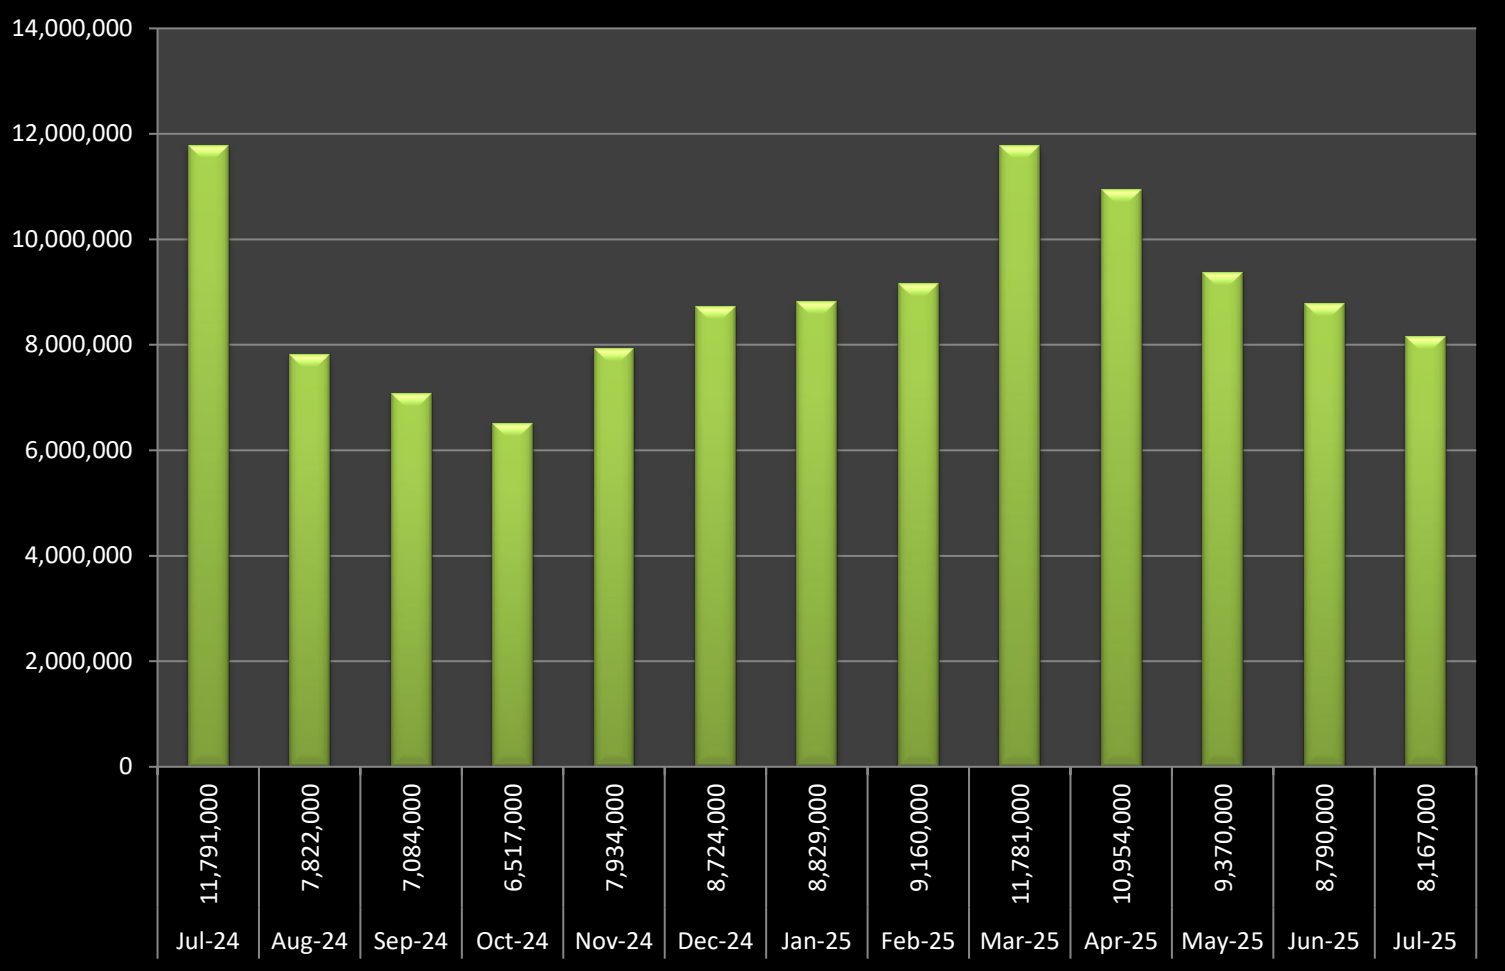


EFFLUENT

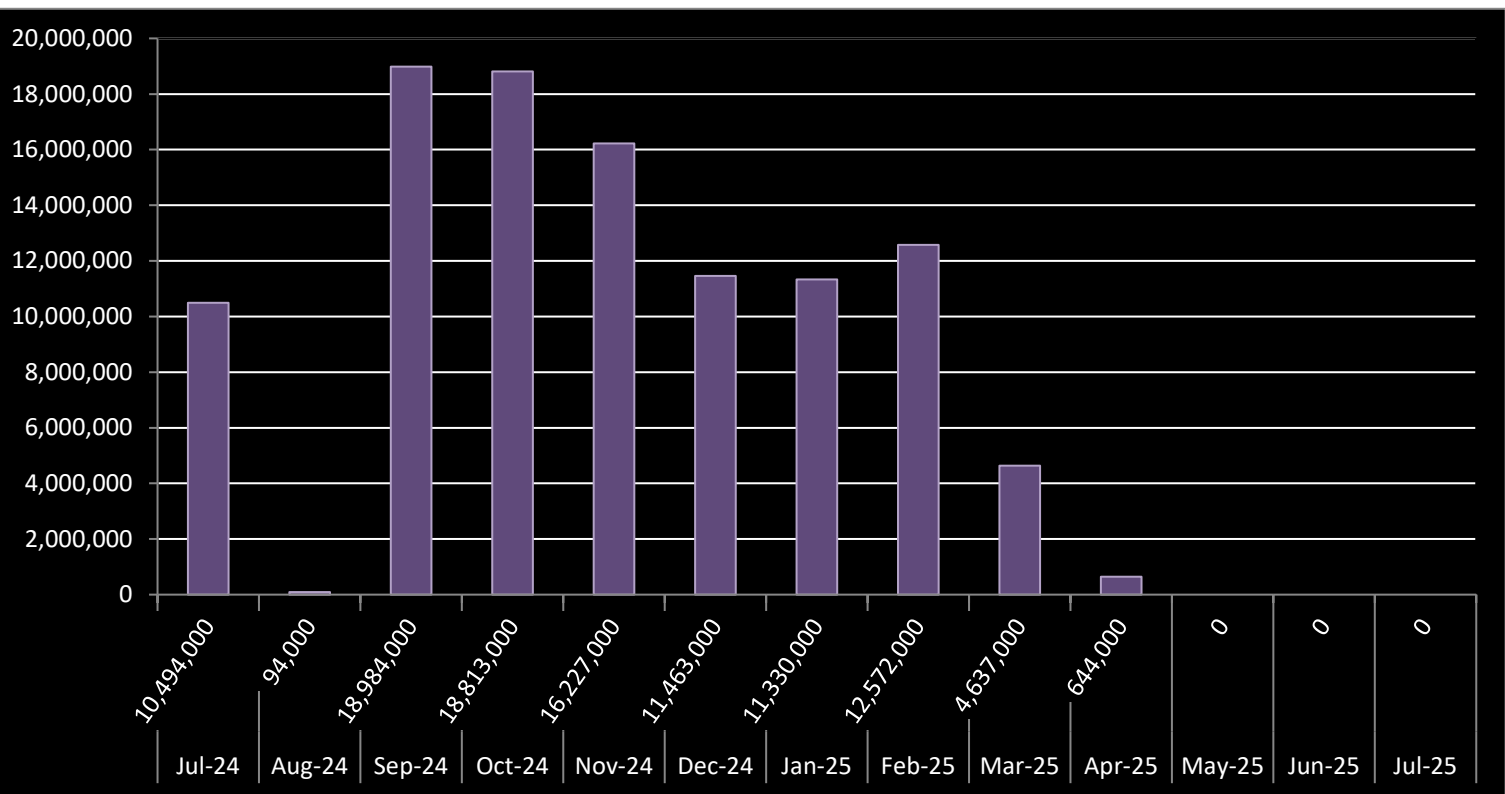

WATER

- Completed daily lab samples related to water quality. (pH, Fluoride, Chlorine, Hardness)
- Monthly chemical injection reports were completed and mailed to the IEPA.
- Read meters for utility billing.
- Replaced CL2 injector at Well 4
- Replaced CL2 injector at Well 3
- Repaired B-box on Hickory St.

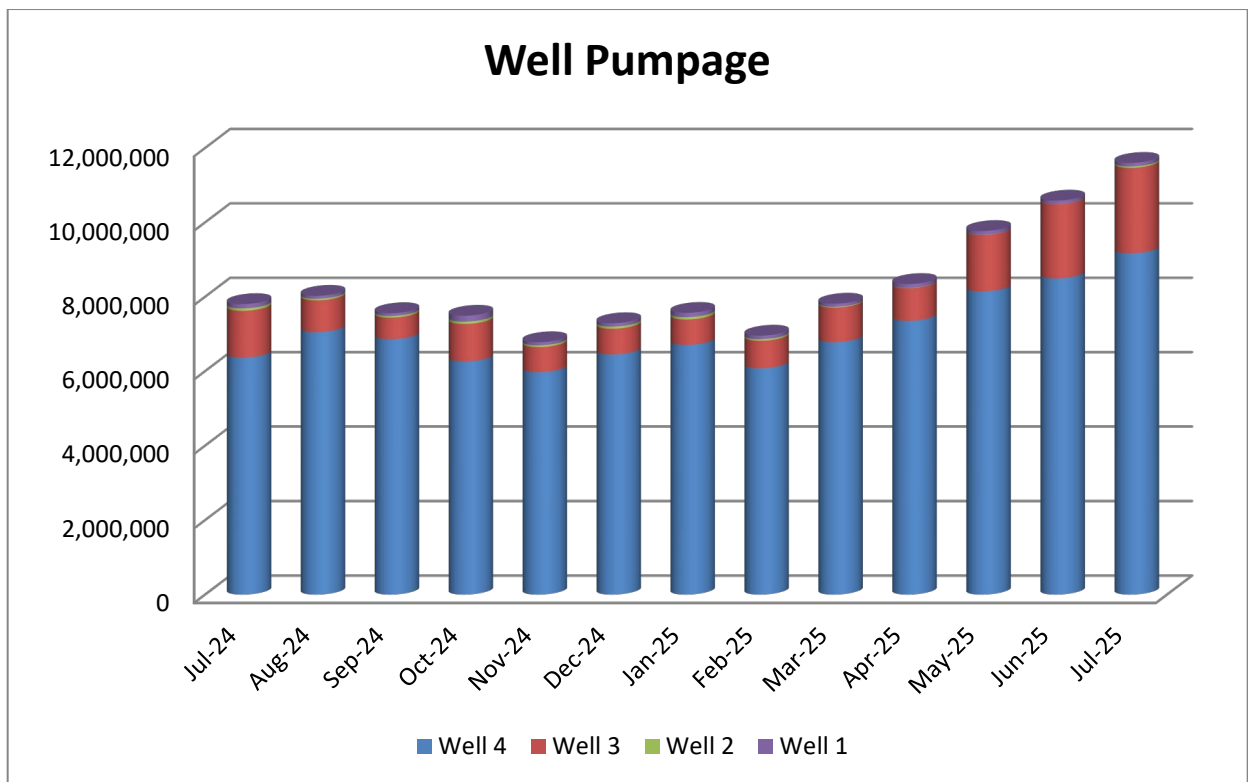

Well 1	94,500
Well 2	38,480
Well 3	2,298,000
Well 4	9,169,900

Total pumpage of treated water from wells for July: 11,600,880