



Public Works Department Monthly Report June 2025

Listed below is a summary of the activities of the Public Works Department for June

STREETS, PROPERTIES, AND STORM SEWER

- Mowed all Town property and parks.
- Mowed ditches
- Mowed ponds
- Cleaned water way ditches in McPhillips Park
- Installed vehicle lift in shop.
- Completed police work orders for mowing private property.
- Drag ball fields.
- Moved the radar signs to other areas as requested by the police.
- Repaired a swing at Suppeland Park
- Sprayed weeds in Town owned areas.

TRAINING

- Completed cyber security training for all PW employees.
- Continued CDL training.

EQUIPMENT/VEHICLE MAINTENANCE AND REPAIRS

- Squad 20 – Oil Change
- W/WW 03 – Oil Change
- Squad 19 – Oil Change

WATER AND WASTEWATER

GENERAL


- Completed work orders for:

Shut-Off Service:	0
Turn On Service:	0
Final Read:	9
Courtesy Read:	1
Julie Locate Requests:	186
New Meters Installed:	1
Existing Meters Replaced with New Meters:	3
Other:	0
Final Inspections:	2
Total Work Orders:	18


WASTEWATER

- Total raw wastewater flow into the plant (Influent) 8,790,000
- Total treated wastewater from the plant: (Effluent) 0
- Completed normal sewer main jetting.
- Continued to build/repair aerators at the STP.
- Continued to explore phosphate mitigation treatments.

INFLUENT

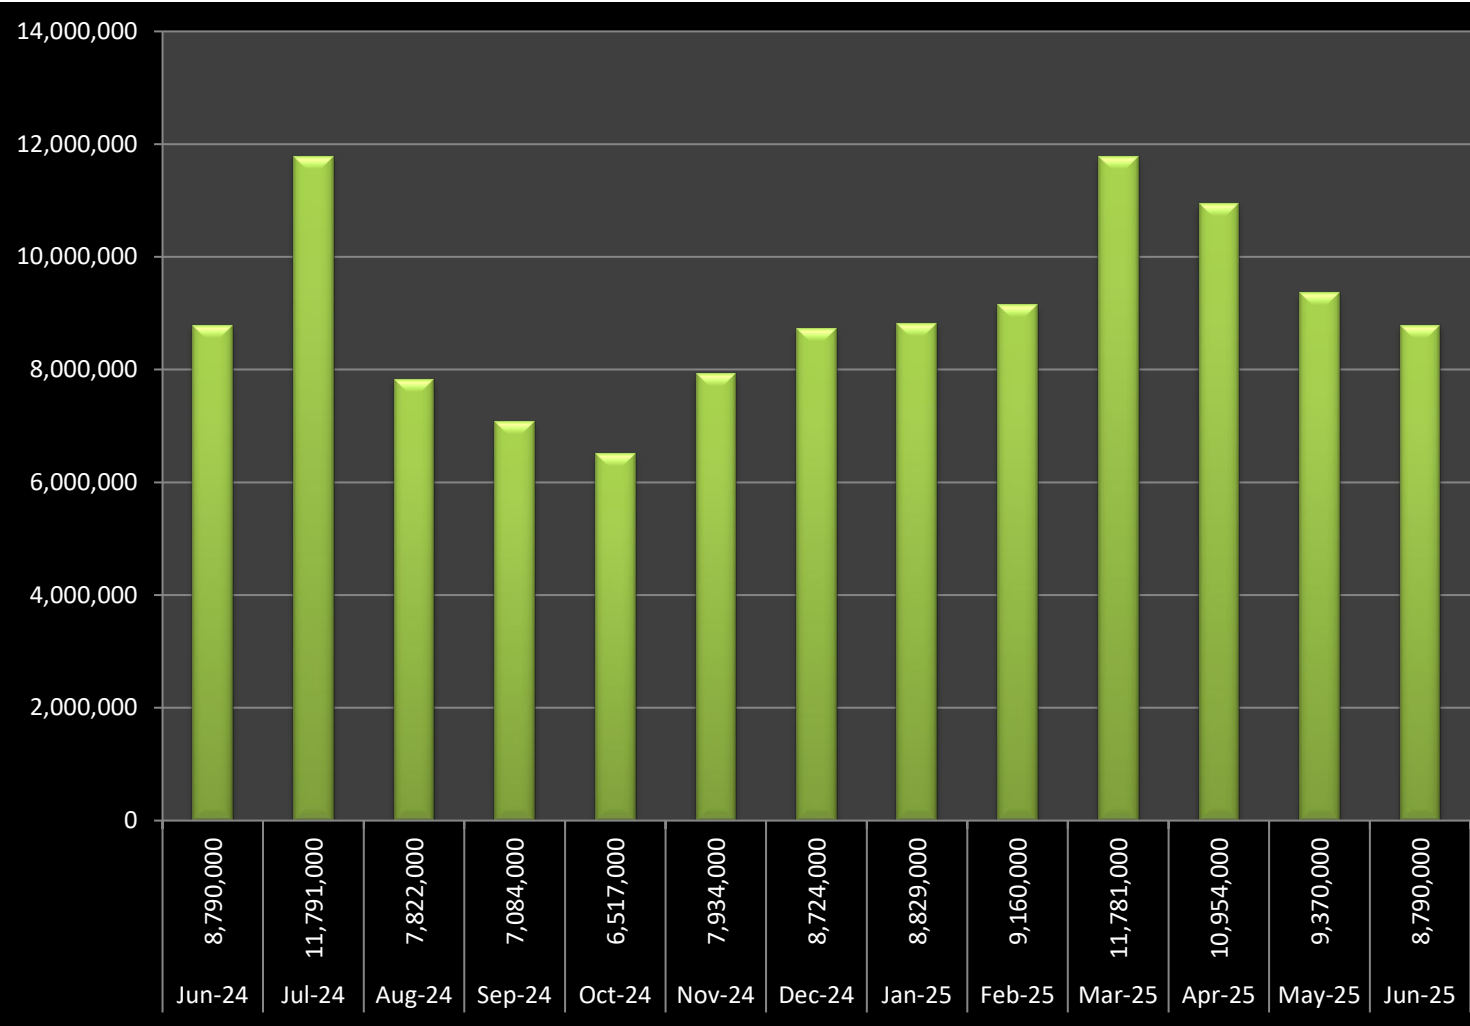


EFFLUENT

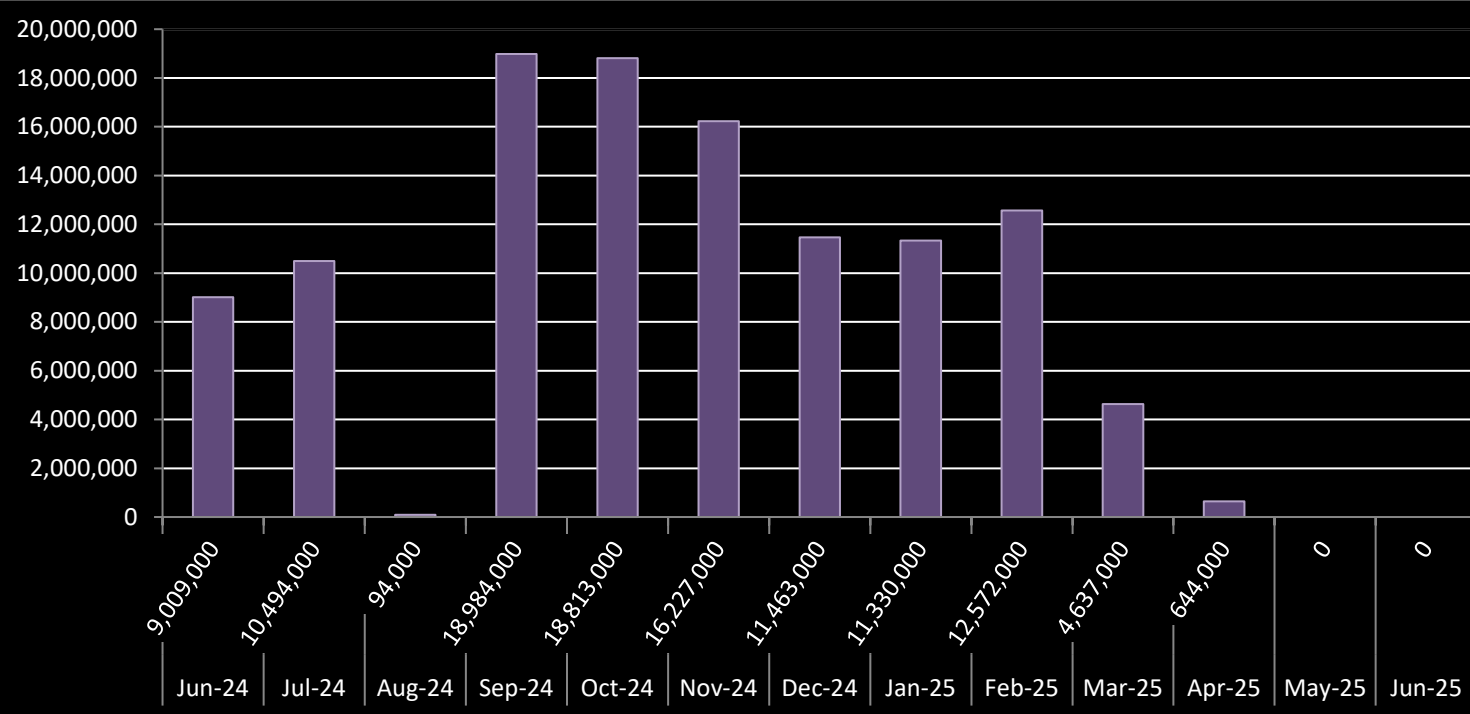

WATER

- Completed daily lab samples related to water quality. (pH, Fluoride, Chlorine, Hardness)
- Monthly chemical injection reports were completed and mailed to the IEPA.
- Distributed tags for possible nonpayment disconnection.
- Observed tie ins and pressure testing at Owens Corning
- Conducted hydrant flow testing for new construction on Llanos.

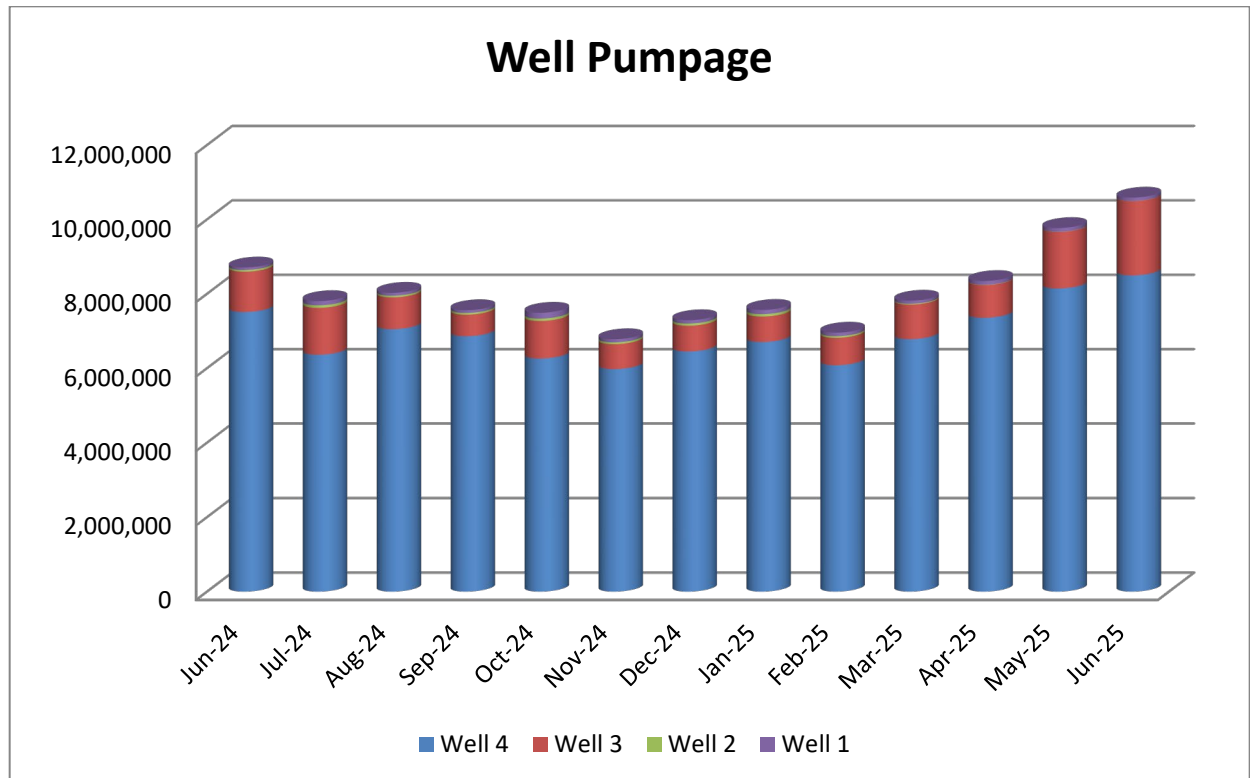

Well 1	90,000
Well 2	3,552
Well 3	1,998,000
Well 4	8,495,300

Total pumpage of treated water from wells for June: 10,586,852