



Public Works Department Monthly Report May 2025

Listed below is a summary of the activities of the Public Works Department for May

STREETS, PROPERTIES, AND STORM SEWER

- Mowed all Town property and parks.
- Mowed ditches
- Mowed ponds
- Planted small trees from the Arbor Day Foundation/ComEd in various parks.
- Swept streets.
- Removed and repoured concrete sidewalk sections in Neucort Lakes.
- Removed 2 parkway trees that were damaged in storms.
- Chipped branches from residents who had storm damage.

TRAINING

- On road CDL training continued for 2 PW employees

EQUIPMENT/VEHICLE MAINTENANCE AND REPAIRS

- Squad 25 – Oil Change

WATER AND WASTEWATER

GENERAL


- Completed work orders for:

Shut-Off Service:	0
Turn On Service:	0
Final Read:	9
Courtesy Read:	1
Julie Locate Requests:	168
New Meters Installed:	1
Existing Meters Replaced with New Meters:	3
Other:	0
Final Inspections:	2
Total Work Orders:	18


WASTEWATER

- Total raw wastewater flow into the plant (Influent) 9,370,000
- Total treated wastewater from the plant: (Effluent) 0
- Completed monthly wastewater sampling.
- Completed normal sewer main jetting.
- Continued to build/repair aerators at the STP.
- Continued to explore phosphate mitigation treatments.

INFLUENT

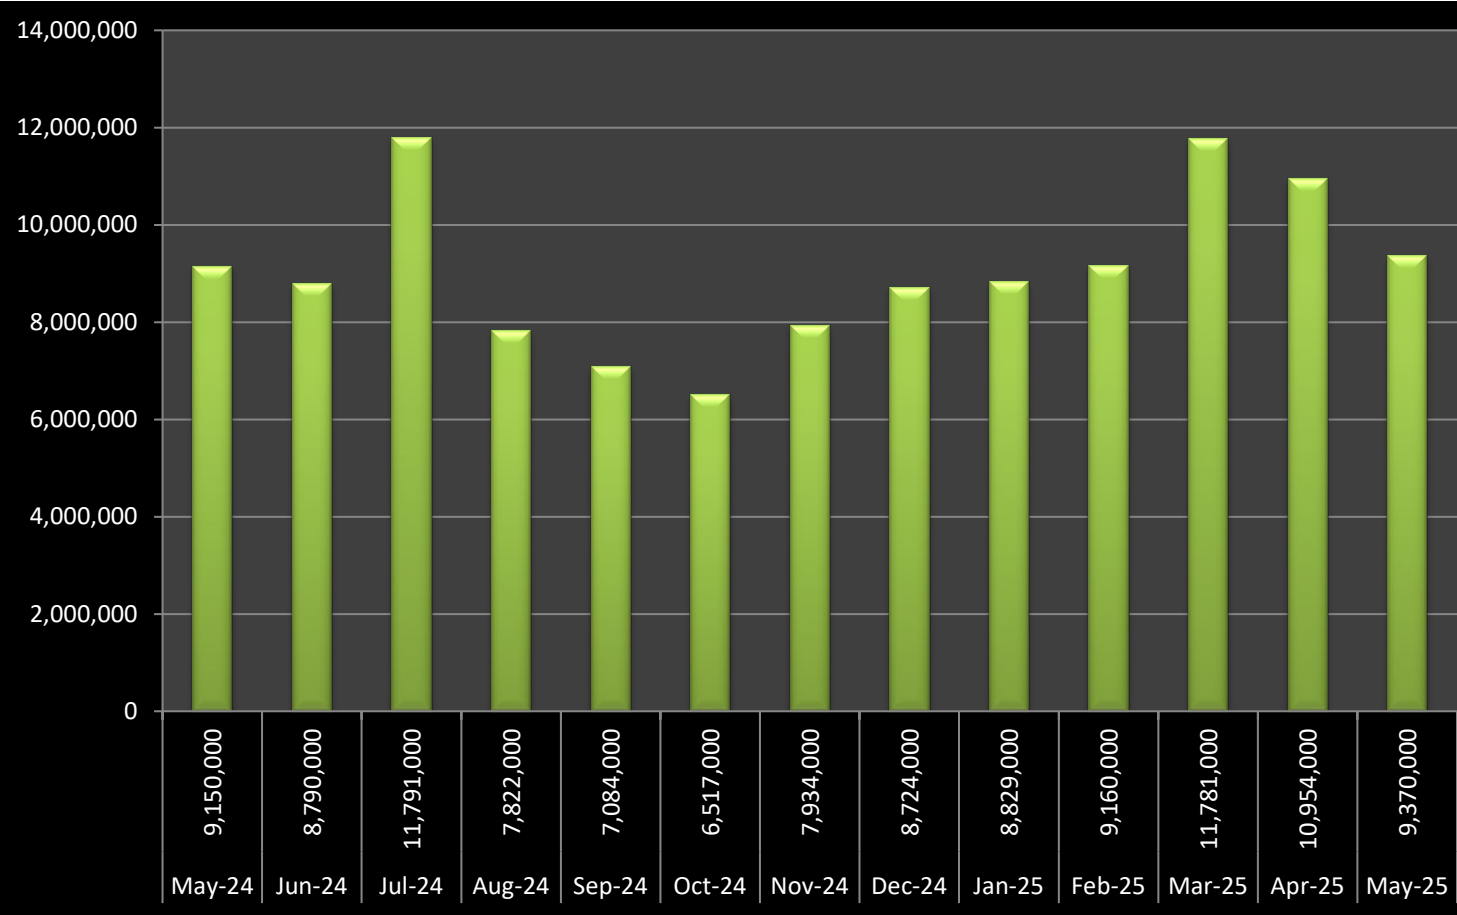


EFFLUENT

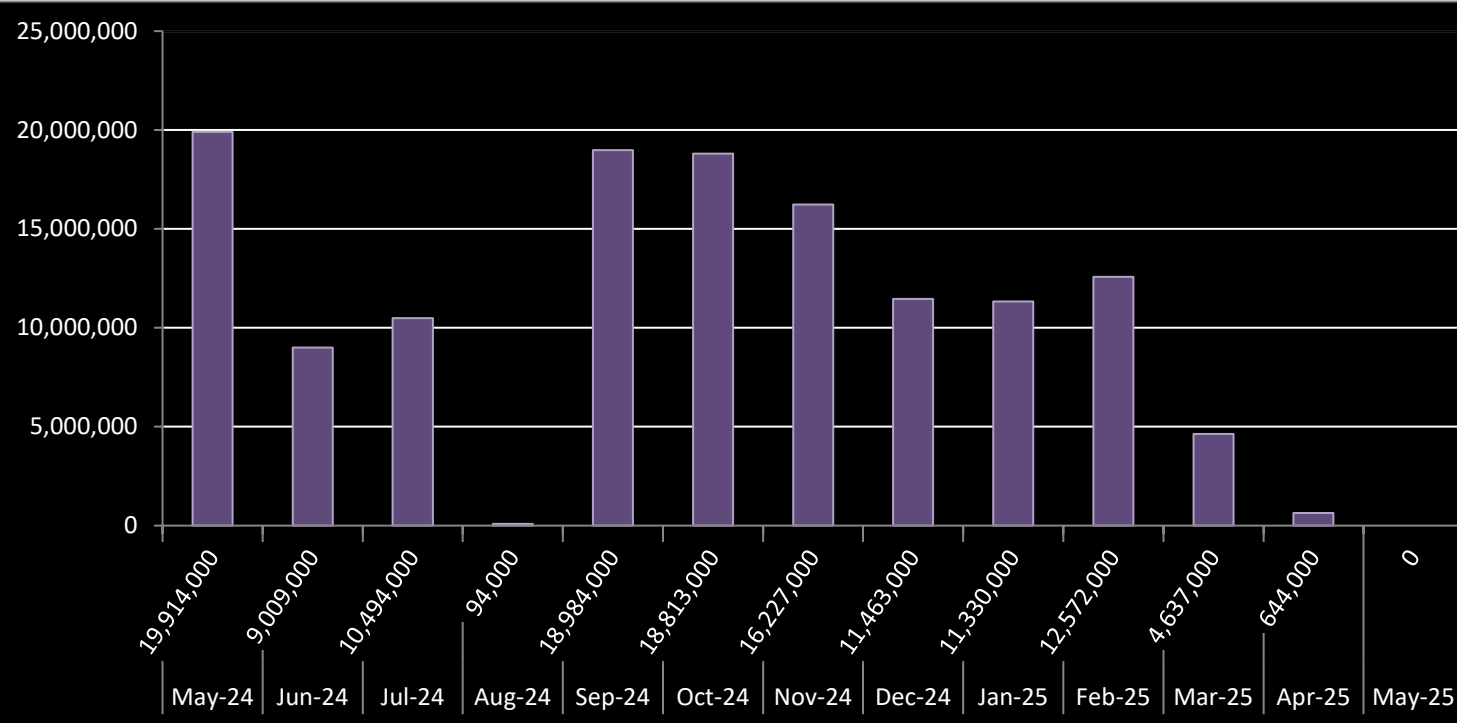

WATER

- Completed daily lab samples related to water quality. (pH, Fluoride, Chlorine, Hardness)
- Monthly chemical injection reports were complete and mailed to the IEPA.
- Completed monthly sampling.
- Repaired 2 b-boxes.
- Cleaned the CL2 injector at Well 3.

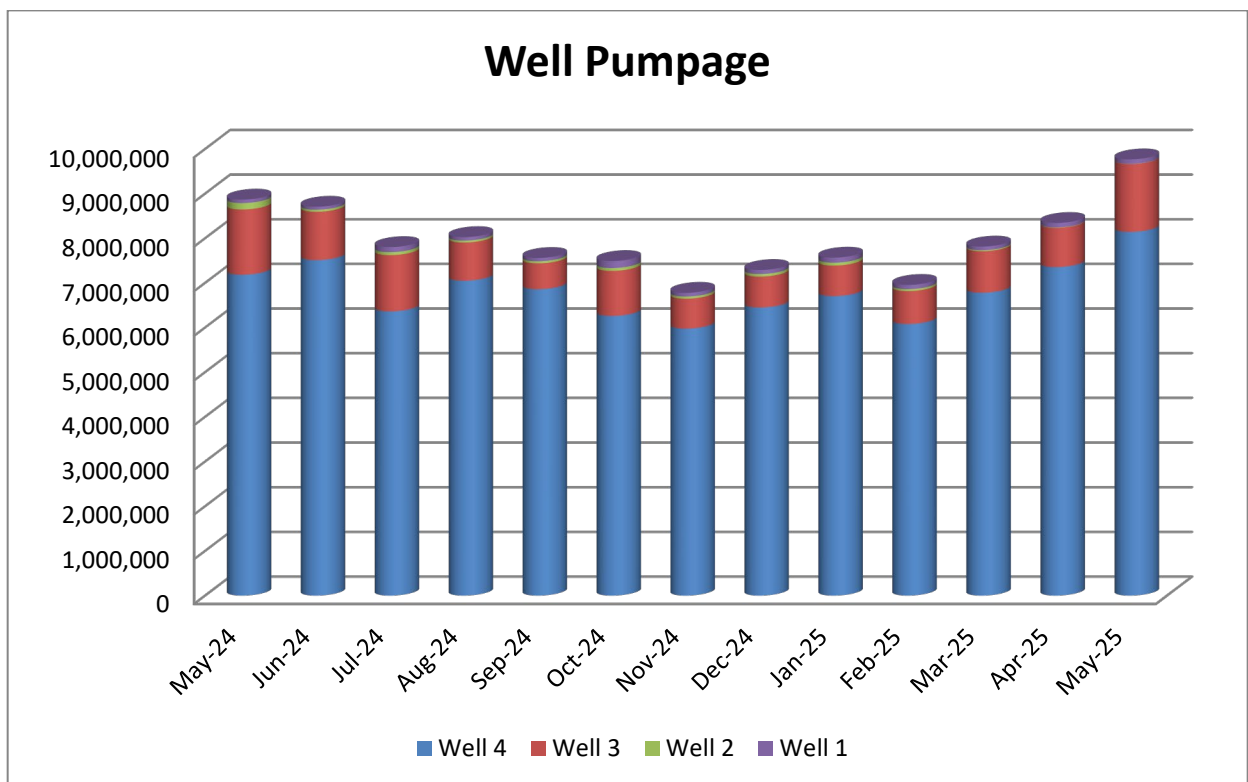

Well 1	99,900
Well 2	4,604
Well 3	1,521,000
Well 4	8,143,600

Total pumpage of treated water from wells for May: 9,769,104