



Public Works Department Monthly Report September 2022

Listed below is a summary of the activities the Public Works Department for September 2022

STREETS, PROPERTIES, AND STORM SEWER

- Patched potholes as needed.
- Completed mowing on all town properties.
- Continued sweeping streets.
- Saw cut and removed sidewalk sections for replacement.
- Removed excess dirt from West St storm sewer project.
- Clean up silt from flooding at the end of Tallgrass Pkwy.
- Added ag lime to the pedestrian path.
- Cored out/framed/prepped and poured 100' of sidewalk for connectivity of Walnut St.
- Repaired vandalized dugout bleacher in Suppeland Park.
- Distributed barricades for a block party.
- Patched the cul-de-sac on Ellwalk.
- Marked one plot for burial at the cemetery.
- Cut down plants and bushes for the winter.



. EQUIPMENT/VEHICLE MAINTENANCE AND REPAIRS

- Squad 20 Replaced both batteries
- Squad 21 Remount gun rack
- Squad 21 Remove arm rest
- Squad 17 Oil Change
- Squad 17 Replace coil packs and spark plugs
- W/WW F250 Repair shift linkage
- The bucket truck controls were safety inspected and hydraulic lines were replaced
- Repaired shorted wiring on the Leaf Vac
- Serviced both zero turn mowers

TRAINING

Started Entry Level CDL driver training for new employees and employees upgrading to a Class A from a Class B CDL

WATER AND WASTEWATER

GENERAL

- Completed work orders for:


Shut-Off Service:	0
Turn On Service:	0
Final Read:	16
Courtesy Read:	2
Julie Locate Requests:	183
New Meters Installed:	5
Existing Meters Replaced with New Meters:	10
Other:	
Final Inspections:	1
Total Work Orders:	36

Public works employees have started to use the new Town ID's and keyless entry system.


WASTEWATER

- Approx. 11,783,000 gallons flowed into the treatment plant.
- Approx. 9,345,000 gallons were discharged
- The Discharge Monitoring Report (DMR) was completed and filed with the IEPA.
- Completed monthly wastewater sampling
- Completed normal sewer main jetting.

INFLUENT

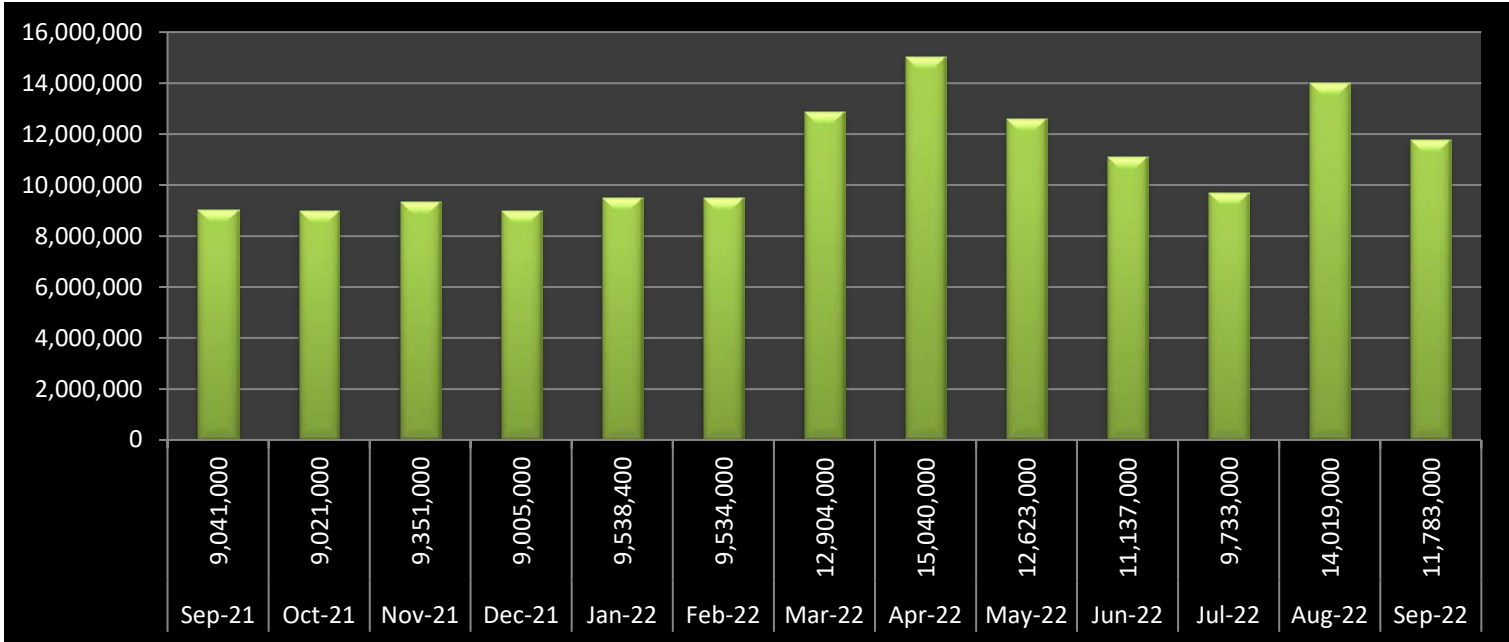


EFFLUENT

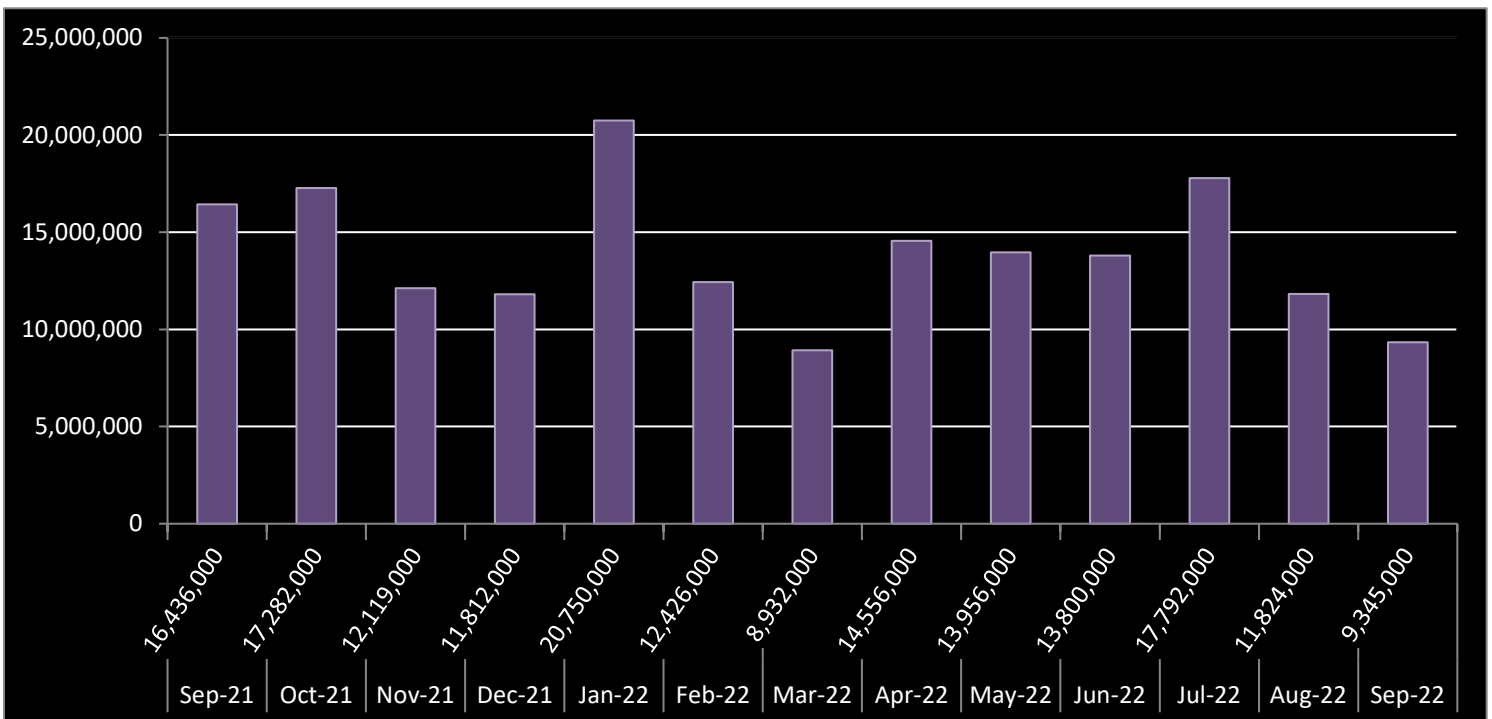

WATER

- Completed daily lab samples related to water quality. (pH, Fluoride, Chlorine, Hardness)
- Monthly chemical injection reports were complete and mailed to the IEPA.
- Completed monthly sampling.

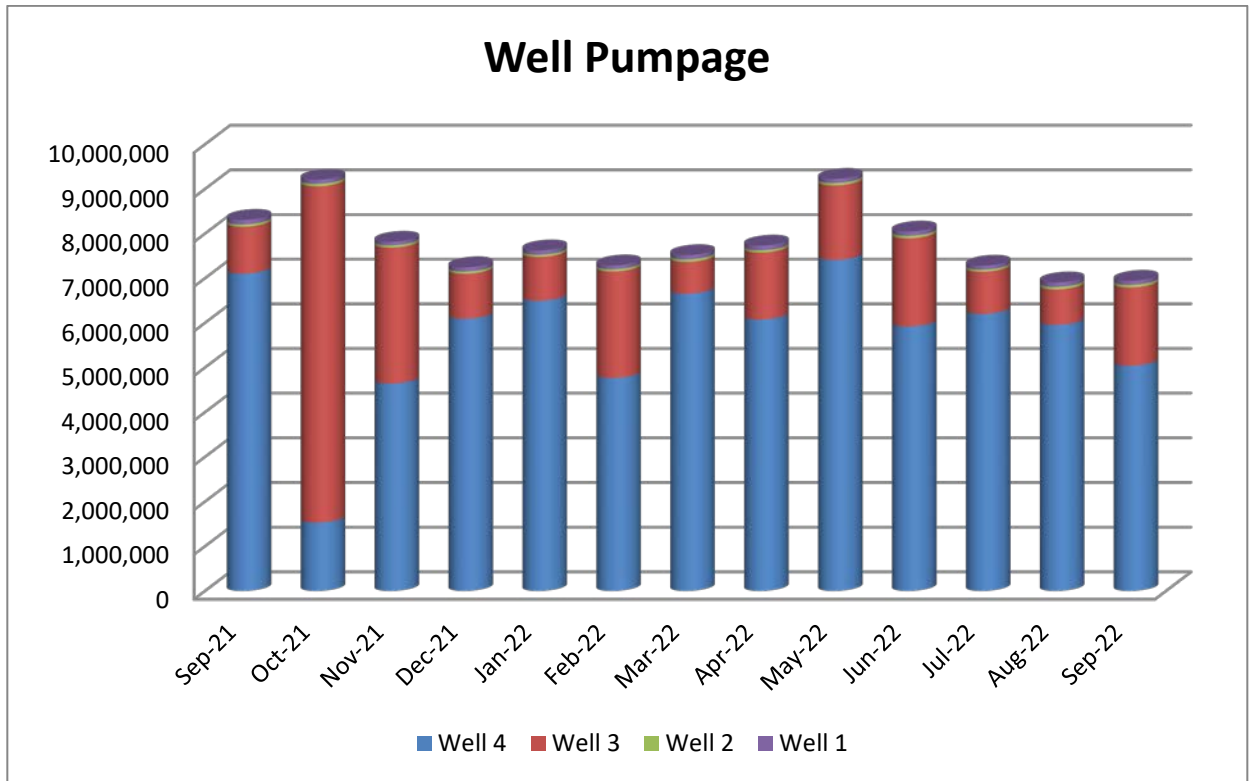

Well 1 91,700
Well 2 58,400
Well 3 1,751,000
Well 4 6,942,700

Total pumpage of treated water from wells for September: 6,942,700