



Public Works Department Monthly Report April 2024

Listed below is a summary of the activities of the Public Works Department for April

STREETS, PROPERTIES, AND STORM SEWER

- Patched potholes as needed.
- Removed dead pine tree from CCP.
- Started mowing operations on all town properties.
- Repaired storm sewer inlet on Spruce St
- Dirt and seeded excavation areas
- Completed sidewalk grinding in various areas in town.
- Assembled new chairs for board table.
- Installed radar speed signs in various areas as requested by the PD.

EQUIPMENT/VEHICLE MAINTENANCE AND REPAIRS

- Squad 17 – Change battery on ticket printer.
- Engineer 15 – Oil Change
- Water Truck 1- Oil Change
- Street 06 – Installed new strobe lights.
- Street 04 – Installed new strobe lights.
- Replaced broken boards on trailer.

TRAINING

Travys L. and Mike R. attended mosquito larvicide training.

Jeff L. and Tom P. attended Watercon.

Joel S attended training for the new utility billing portal.

Travys L., Mike R., Tom P., and Tom B. attended flagger training.

All staff completed annual sexual harassment prevention training.

All staff completed skid steer safety training.

WATER AND WASTEWATER

GENERAL


- Completed work orders for:

Shut-Off Service:	0
Turn On Service:	1
Final Read:	18
Courtesy Read:	0
Julie Locate Requests:	89
New Meters Installed:	1
Existing Meters Replaced with New Meters:	11
Other:	
Final Inspections:	
Total Work Orders:	31


WASTEWATER

- Approx. 13,644,000 gallons flowed into the treatment plant.
- Approx. 18,971,000 gallons were discharged.
- The Discharge Monitoring Report (DMR) was completed and filed with the IEPA.
- Completed monthly wastewater sampling.
- Completed normal sewer main jetting.
- Sprayed the fence line at the STP.
- Repaired 12 aerators in cell 1.

INFLUENT

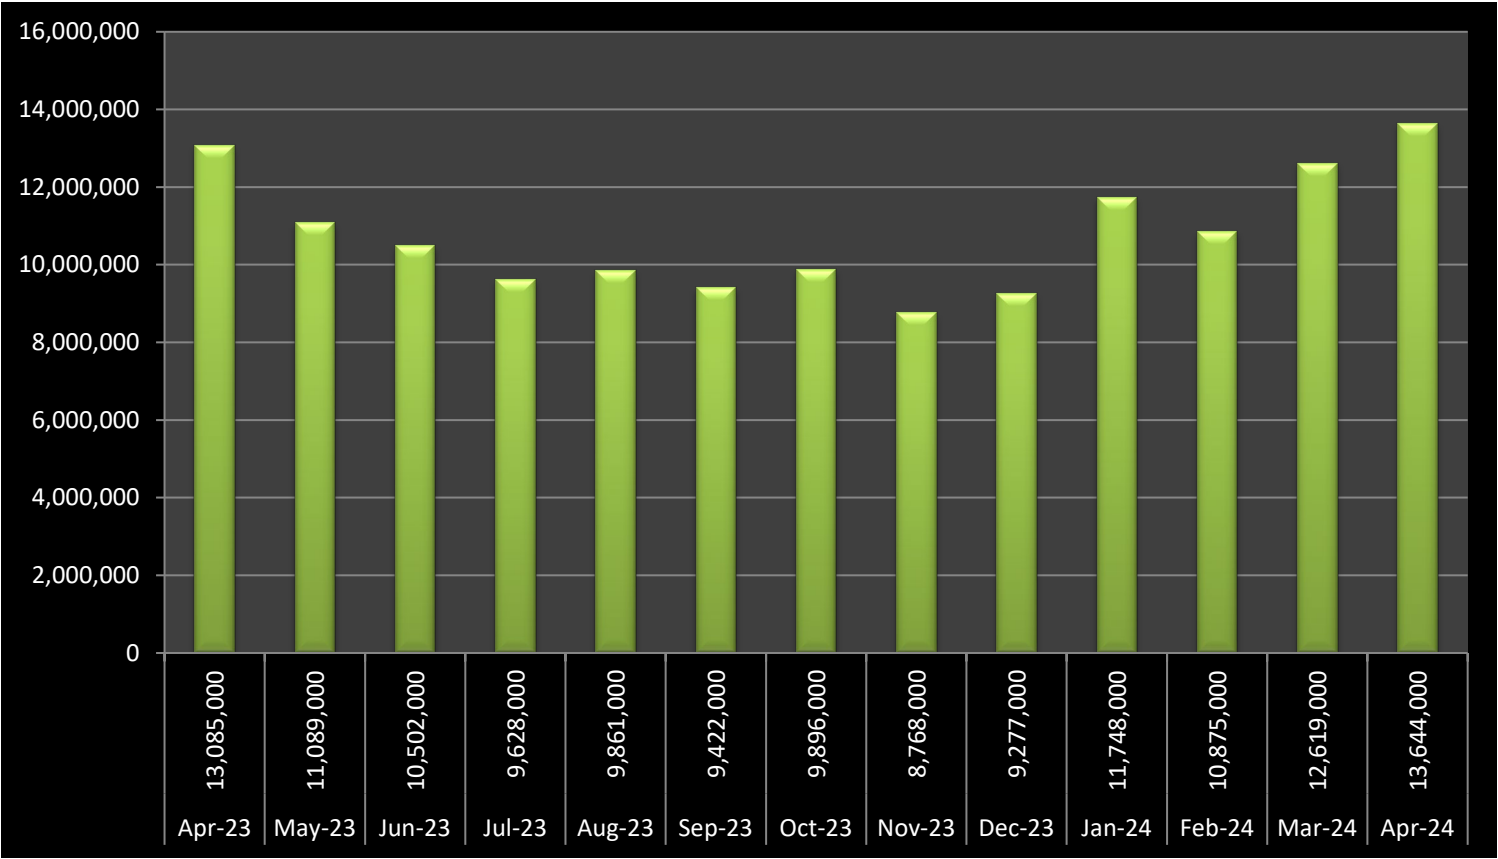


EFFLUENT

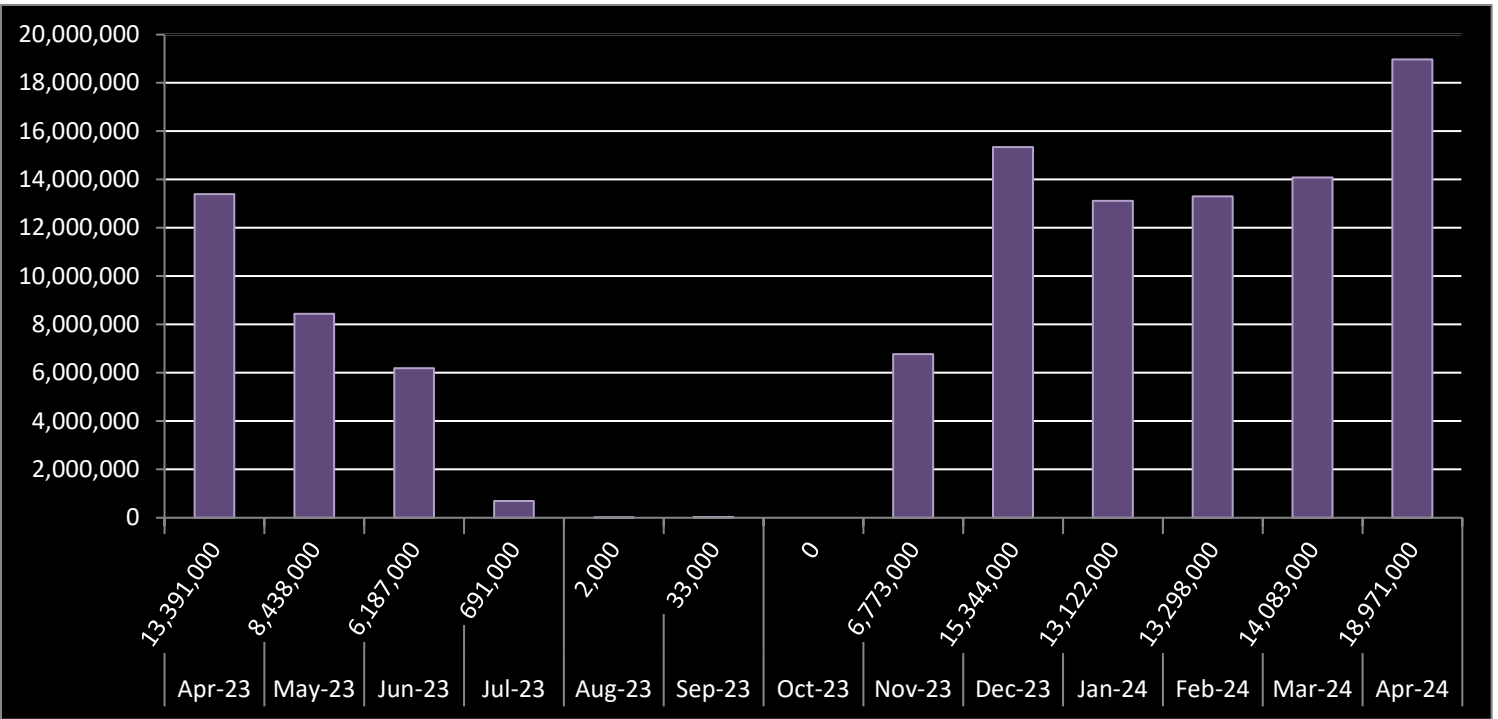

WATER

- Completed daily lab samples related to water quality. (pH, Fluoride, Chlorine, Hardness)
- Monthly chemical injection reports were complete and mailed to the IEPA.
- Completed monthly sampling.
- Met with the IEPA for the sanitary survey.
- Completed meter reading for utility billing.
- Completed the annual Consumer Confidence Report
- Repaired a water service leak on Llanos St.

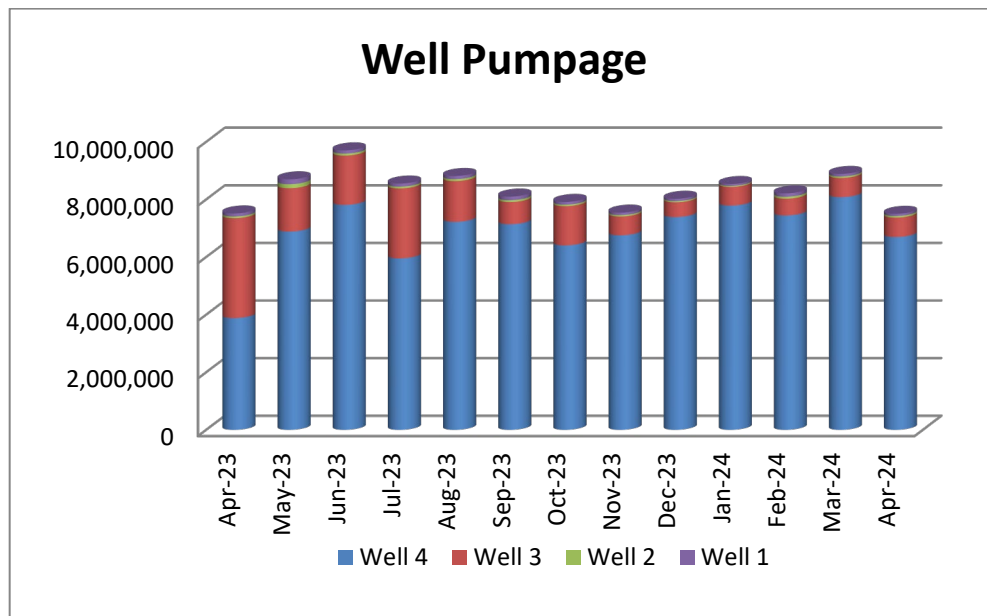

Well 1	75,000
Well 2	55,800
Well 3	675,000
Well 4	6,696,200

Total pumpage of treated water from wells for April 2024: 7,502,000