

# Detailed Selected Statistics and Management Activity

By Incident Type

Report Period: 09/01/22 - 09/30/22 23:59:59


| CODE | DESCRIPTOR                                    | FREQUENCY | FREQ. PERCENT | EXPs | AVG # SUPPR. PERS | AVG # EMS PERS | AVG # OTHER PERS | AVG # SUPPR. APPR. | AVG # EMS APPR. | AVG # OTHER APPR. | AVERAGE # MAN HOURS | TOTAL MAN HOURS | AVERAGE RESPONSE TIME (min) |
|------|---|-----------|---------------|------|-------------------|----------------|------------------|--------------------|-----------------|-------------------|---------------------|-----------------|-----------------------------|
| 111  | Building fire                                 | 2         | 0.63%         | 0    | 15.5              | 0              | 1.5              | 5                  | 0.00            | 1                 | 55.53               | 84.183332       | 4.50                        |
| 113  | Cooking fire, confined to container           | 1         | 0.32%         | 0    | 15                | 0              | 1                | 5                  | 0.00            | 1                 | 7.47                | 4.316666        | 3.18                        |
| 123  | Fire in portable building, fixed location     | 1         | 0.32%         | 1    | 39                | 0              | 5                | 13                 | 0.00            | 4                 | 3,130.60            | 101.200000      | 7.97                        |
| 130  | Mobile property (vehicle) fire, other         | 1         | 0.32%         | 0    | 3                 | 0              | 0                | 1                  | 0.00            | 0                 | 1.35                | 1.250000        | 5.95                        |
| 131  | Passenger vehicle fire                        | 1         | 0.32%         | 0    | 3                 | 0              | 0                | 1                  | 0.00            | 0                 | 1.80                | 1.800000        | 4.37                        |
| 160  | Special outside fire, other                   | 1         | 0.32%         | 0    | 3                 | 0              | 0                | 1                  | 0.00            | 0                 | 0.85                | .850000         | 5.60                        |
| 251  | Excessive heat, scorch burns with no ignition | 1         | 0.32%         | 0    | 12                | 0              | 1                | 4                  | 0.00            | 1                 | 3.90                | 3.200000        | 3.48                        |
| 311  | Medical assist, assist EMS crew               | 196       | 62.22%        | 0    | 0                 | 3.17           | 0.03             | 0                  | 1.01            | 0.02              | 1.01                | 195.949990      | 4.96                        |
| 322  | Motor vehicle accident with injuries          | 11        | 3.49%         | 0    | 0.55              | 5.73           | 0.27             | 0.18               | 1.82            | 0.27              | 3.55                | 33.466663       | 4.27                        |
| 323  | Motor vehicle/pedestrian accident (MV Ped)    | 2         | 0.63%         | 0    | 0                 | 4              | 0.5              | 0                  | 1.50            | 0.5               | 3.26                | 4.549999        | 4.70                        |
| 324  | Motor vehicle accident with no injuries.      | 7         | 2.22%         | 0    | 0.86              | 4.43           | 0.43             | 0.29               | 1.57            | 0.29              | 2.38                | 14.916665       | 4.57                        |
| 353  | Removal of victim(s) from stalled elevator    | 1         | 0.32%         | 0    | 6                 | 0              | 0                | 2                  | 0.00            | 0                 | 1.90                | 1.850000        | 6.63                        |
| 411  | Gasoline or other flammable liquid spill      | 1         | 0.32%         | 0    | 5                 | 0              | 1                | 2                  | 0.00            | 1                 | 19.20               | 13.133333       | 6.72                        |
| 412  | Gas leak (natural gas or LPG)                 | 1         | 0.32%         | 0    | 15                | 0              | 1                | 5                  | 0.00            | 1                 | 9.60                | 7.300000        | 5.28                        |
| 444  | Power line down                               | 4         | 1.27%         | 0    | 4                 | 0              | 0.25             | 1.25               | 0.00            | 0.25              | 5.84                | 21.216666       | 5.15                        |
| 445  | Arcing, shorted electrical equipment          | 4         | 1.27%         | 0    | 10.5              | 0              | 0.75             | 3.5                | 0.00            | 0.75              | 9.61                | 20.999997       | 5.25                        |

| CODE                              | DESCRIPTOR   | FREQUENCY  | FREQ. PERCENT | EXPS     | AVG # SUPPR. PERS | AVG # EMS PERS | AVG # OTHER PERS | AVG # SUPPR. APPR. | AVG # EMS APPR. | AVG # OTHER APPR. | AVERAGE # MAN HOURS | TOTAL MAN HOURS | AVERAGE RESPONSE TIME (min) |
|-----------------------------------|--|------------|---------------|----------|-------------------|----------------|------------------|--------------------|-----------------|-------------------|---------------------|-----------------|-----------------------------|
| 500                               | Service Call, other                                | 1          | 0.32%         | 0        | 0                 | 3              | 0                | 0                  | 1.00            | 0                 | 0.75                | .750000         | 3.33                        |
| 550                               | Public service assistance, other                   | 1          | 0.32%         | 0        | 3                 | 0              | 0                | 1                  | 0.00            | 0                 | 2.05                | 2.050000        | 3.85                        |
| 553                               | Public service                                     | 3          | 0.95%         | 0        | 2                 | 1              | 0                | 0.67               | 0.33            | 0                 | 0.63                | 1.900000        | 4.39                        |
| 600                               | Good intent call, other                            | 1          | 0.32%         | 0        | 6                 | 0              | 1                | 2                  | 0.00            | 1                 | 3.62                | 3.333333        | 7.62                        |
| 611                               | Dispatched & canceled en route                     | 16         | 5.08%         | 0        | 2                 | 2.94           | 0.13             | 0.63               | 0.88            | 0.13              | 0.60                | 4.249997        | 0.52                        |
| 622                               | No incident found on arrival at dispatch address   | 7          | 2.22%         | 0        | 3.57              | 3.14           | 0.14             | 1.14               | 1.00            | 0.14              | 0.93                | 6.233332        | 4.36                        |
| 651                               | Smoke scare, odor of smoke                         | 3          | 0.95%         | 0        | 7.67              | 0              | 0.33             | 2.33               | 0.00            | 0.33              | 2.18                | 6.466665        | 4.46                        |
| 711                               | Municipal alarm system, malicious false alarm      | 1          | 0.32%         | 0        | 12                | 0              | 1                | 4                  | 0.00            | 1                 | 2.60                | 1.700000        | 4.10                        |
| 731                               | Sprinkler activation due to malfunction            | 1          | 0.32%         | 0        | 16                | 0              | 1                | 5                  | 0.00            | 1                 | 10.20               | 3.200000        | 6.45                        |
| 733                               | Smoke detector activation due to malfunction       | 8          | 2.54%         | 0        | 9.88              | 0              | 1.13             | 3                  | 0.00            | 0.88              | 5.55                | 23.983329       | 4.04                        |
| 735                               | Alarm system sounded due to malfunction            | 6          | 1.90%         | 0        | 12.67             | 0              | 1.17             | 4                  | 0.00            | 1                 | 6.19                | 31.083331       | 4.34                        |
| 740                               | Unintentional transmission of alarm, other         | 3          | 0.95%         | 0        | 7                 | 0              | 0.33             | 2.33               | 0.00            | 0.33              | 1.26                | 2.166666        | 3.80                        |
| 741                               | Sprinkler activation, no fire - unintentional      | 2          | 0.63%         | 0        | 12.5              | 0              | 1.5              | 4                  | 0.00            | 1                 | 5.02                | 8.216665        | 4.04                        |
| 743                               | Smoke detector activation, no fire - unintentional | 13         | 4.13%         | 0        | 11.85             | 0              | 1.08             | 3.77               | 0.00            | 1                 | 3.20                | 26.733324       | 4.34                        |
| 744                               | Detector activation, no fire - unintentional       | 1          | 0.32%         | 0        | 13                | 0              | 1                | 4                  | 0.00            | 1                 | 1.17                | 1.099999        | 3.37                        |
| 745                               | Alarm system activation, no fire - unintentional   | 13         | 4.13%         | 0        | 11.92             | 0              | 0.85             | 3.85               | 0.00            | 0.77              | 2.52                | 24.399997       | 4.26                        |
| <b>Totals</b>                     |  | <b>315</b> | <b>100%</b>   | <b>1</b> | <b>2.69</b>       | <b>2.53</b>    | <b>0.26</b>      | <b>0.86</b>        | <b>0.81</b>     | <b>0.23</b>       | <b>12.14</b>        | <b>657.75</b>   | <b>4.58</b>                 |
| <b>Mutual Aid Given Incidents</b> |  | <b>13</b>  |               |          |                   |                |                  |                    |                 |                   |                     |                 |                             |

- Station 1
- Station 2
- Station 3
- Station 4
- Station 5

# Incidents by Stations

09/01/2022-09/30/2022

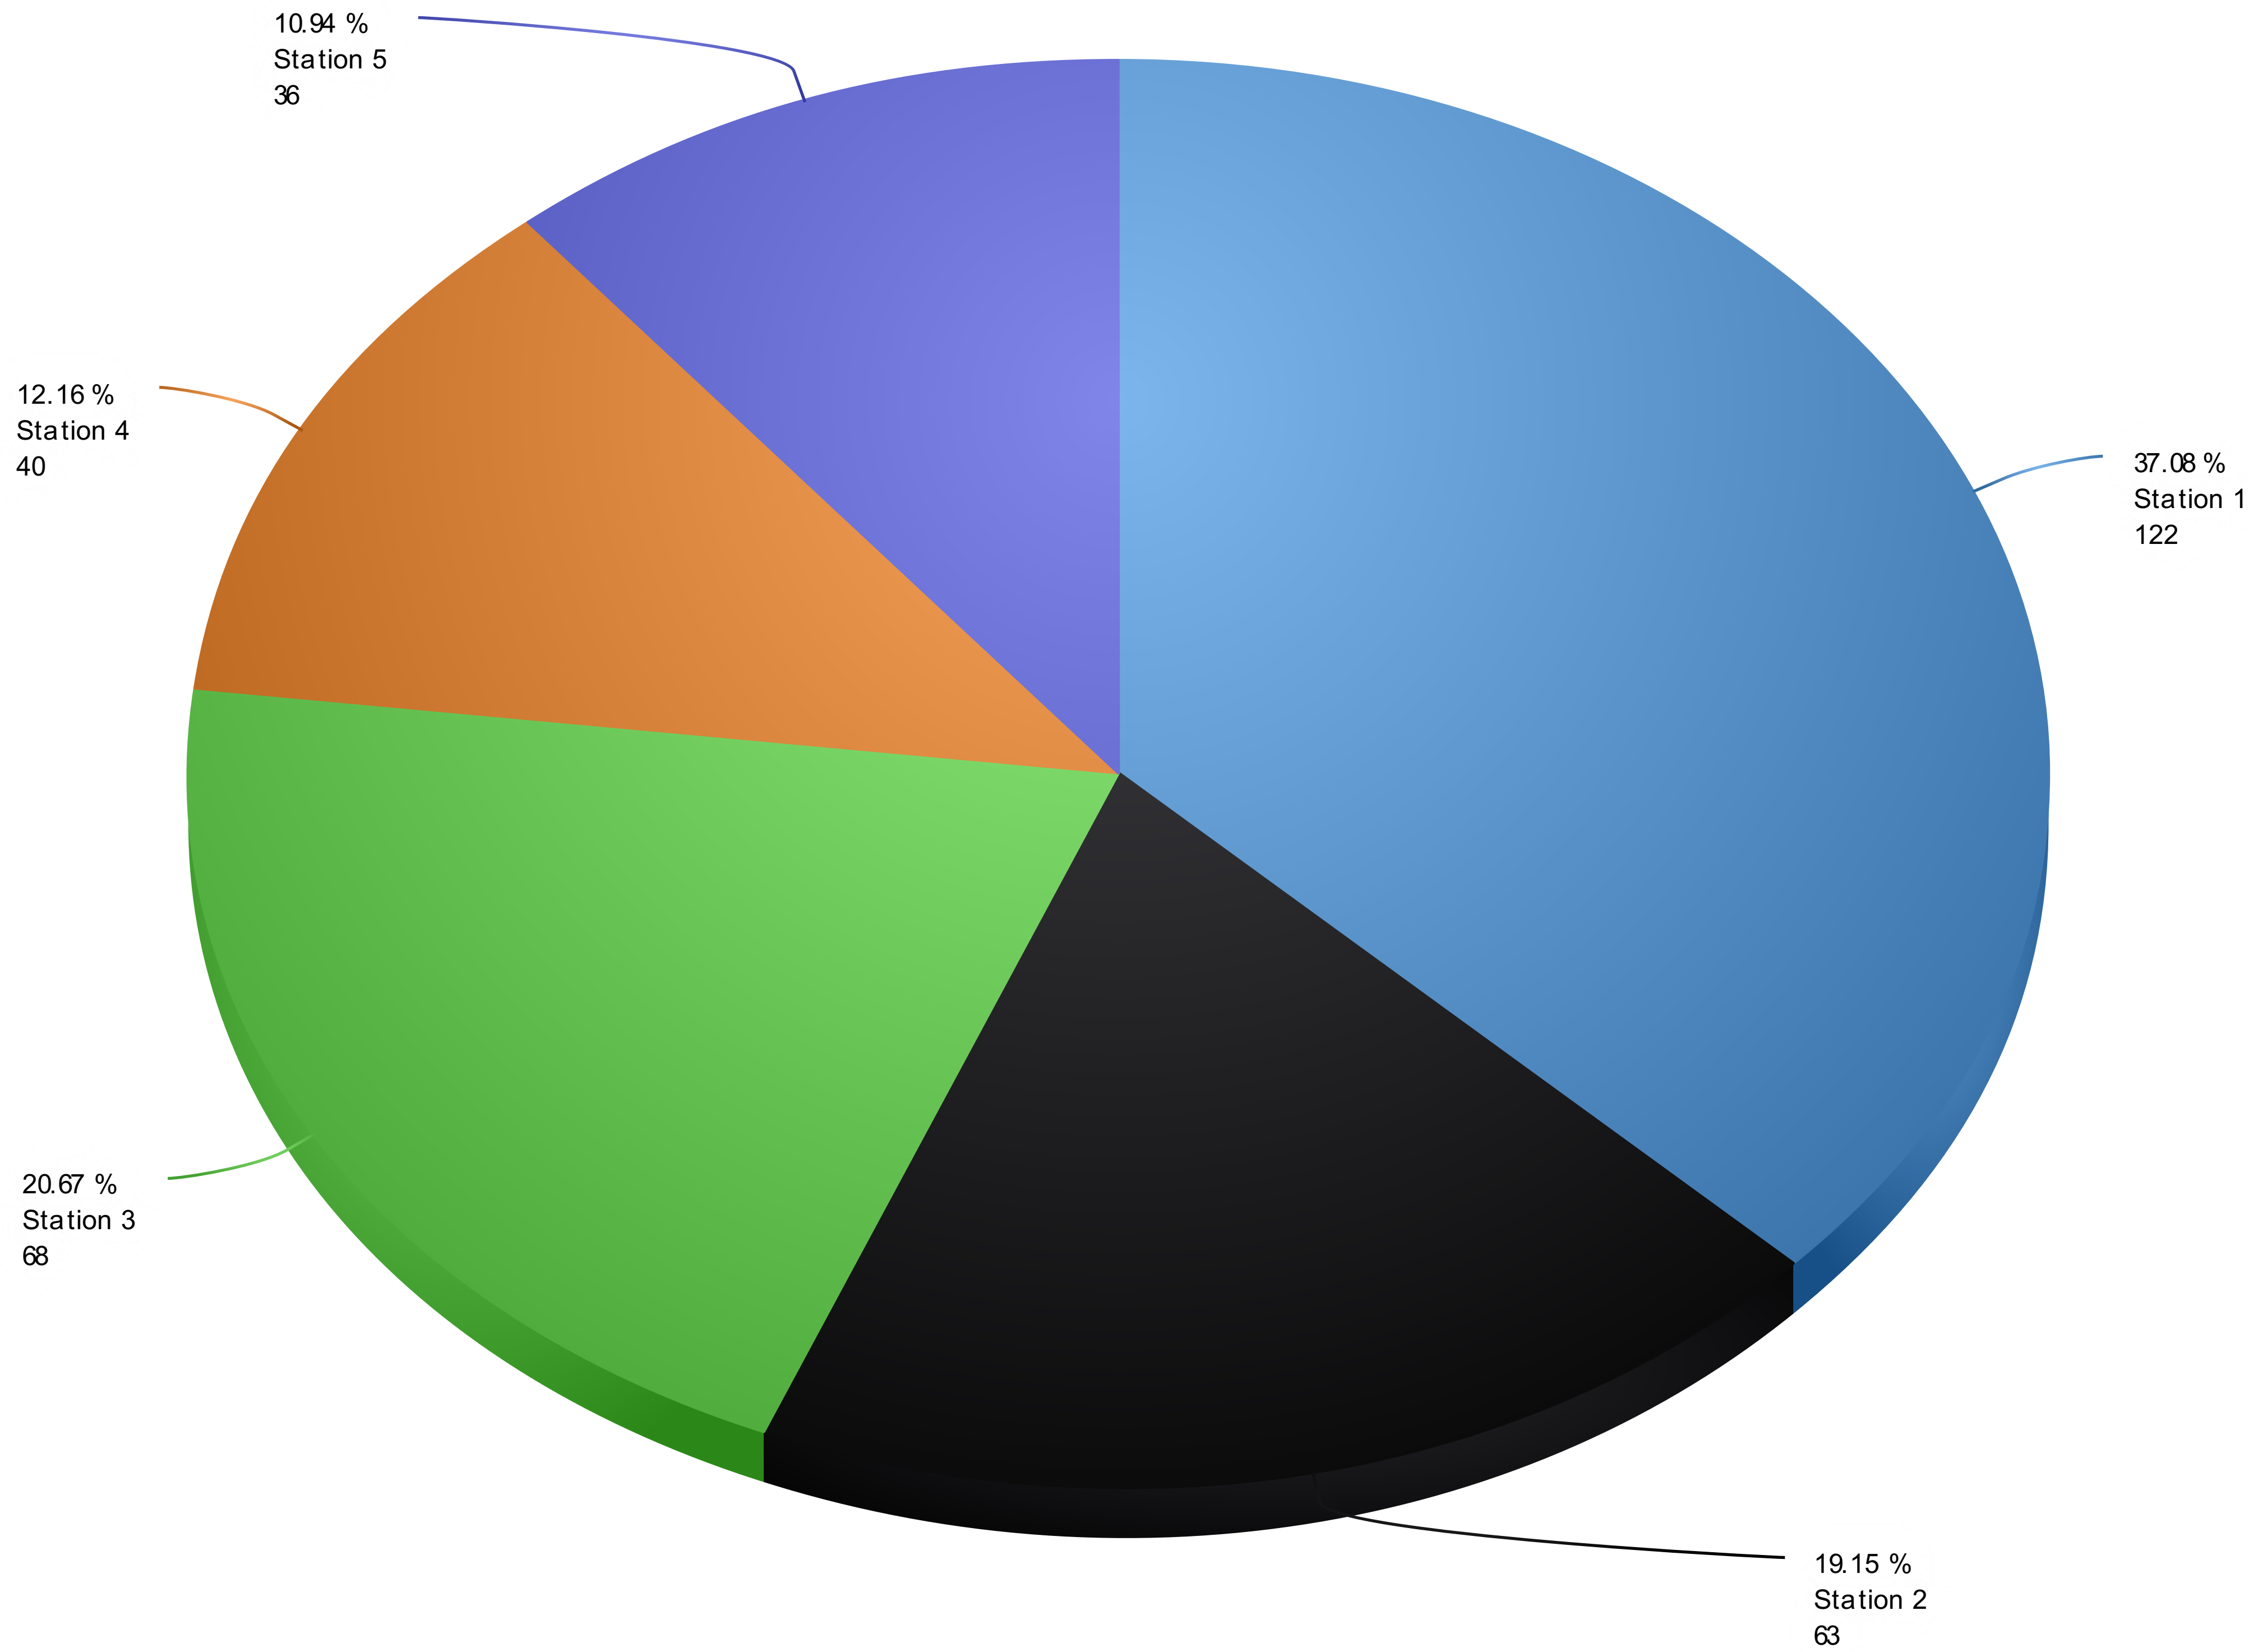


Total of Station: 329

## Response Summary by Station

Report Period: 09/01/22 - 09/30/22 23:59:59


| Station | Responses | % Fire | % EMS | Other | Per Day |
|---------|-----------|--------|-------|-------|---------|
| 1       | 122       | 3.28   | 68.85 | 27.87 | 4.21    |
| 2       | 63        | 1.59   | 71.43 | 26.98 | 2.17    |
| 3       | 68        | 1.47   | 64.71 | 33.82 | 2.34    |
| 4       | 40        | 2.5    | 67.5  | 30    | 1.38    |
| 5       | 36        | 2.78   | 58.33 | 38.89 | 1.24    |

**Total 329**

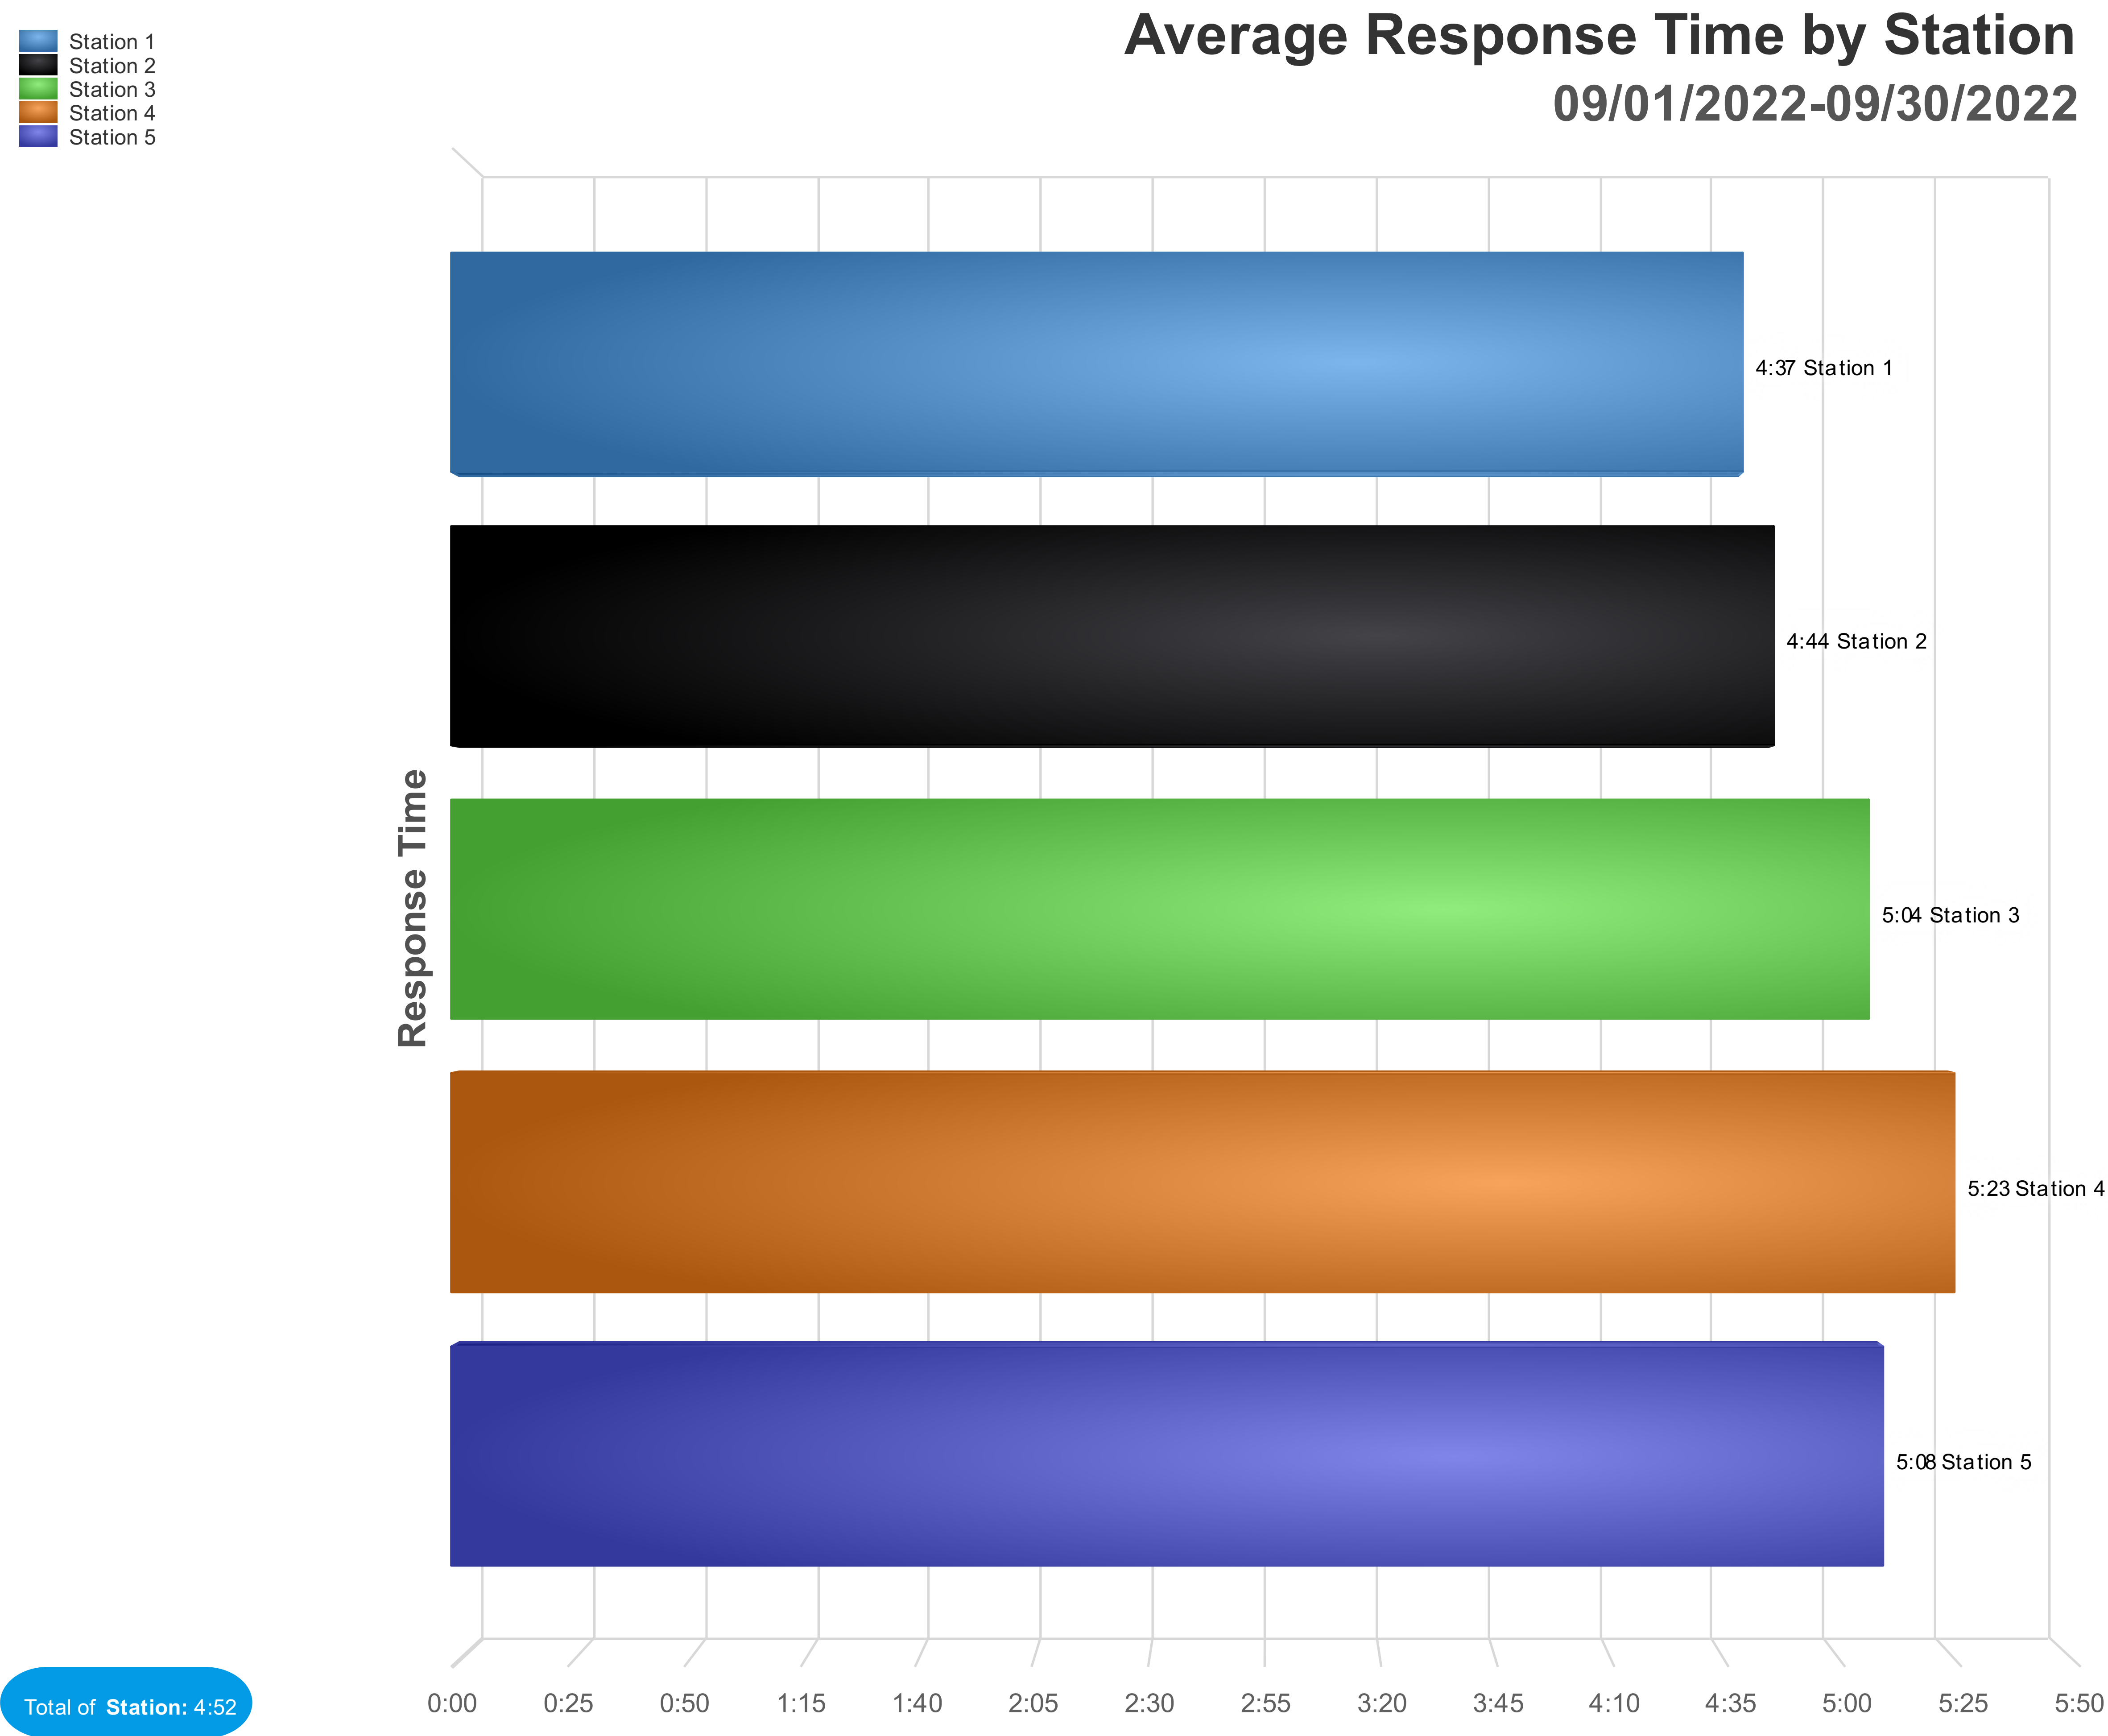


# Department Average Turnout Time (Alarm-> First En Route)

09/01/22-09/30/22

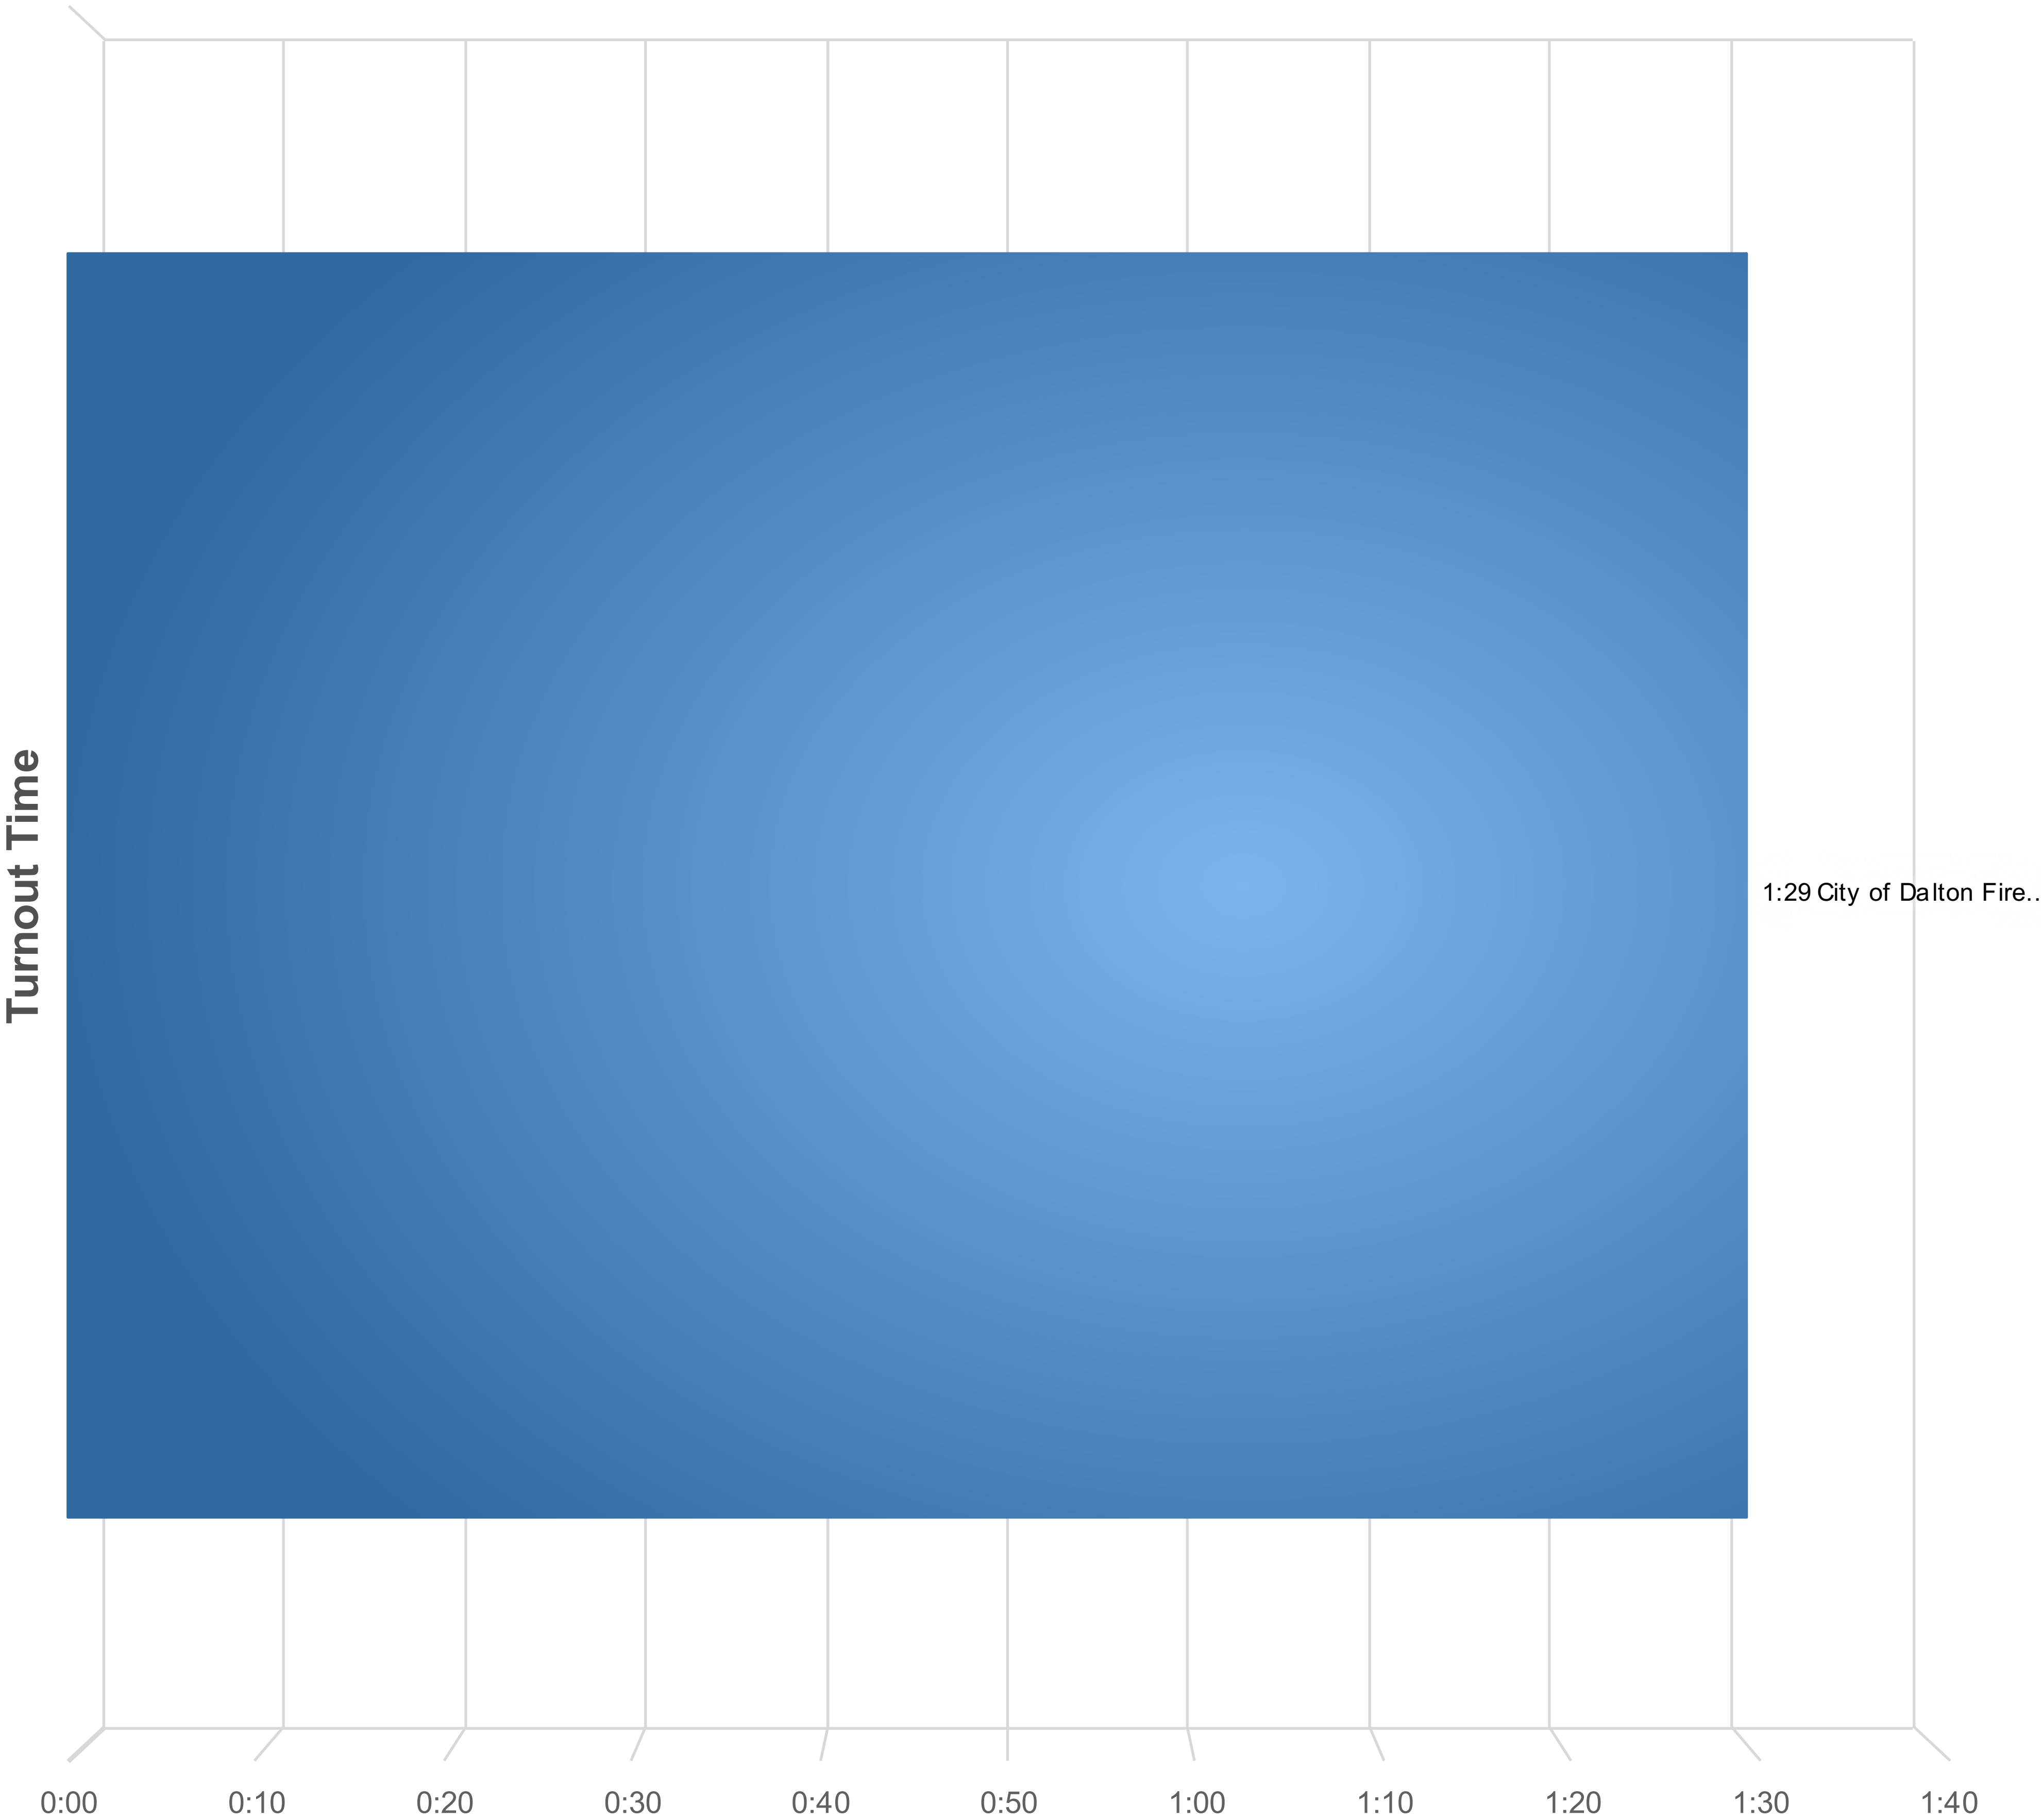

# Department Average Travel Time (First En Route -> First Unit Arrival)

09/01/22-09/30/22

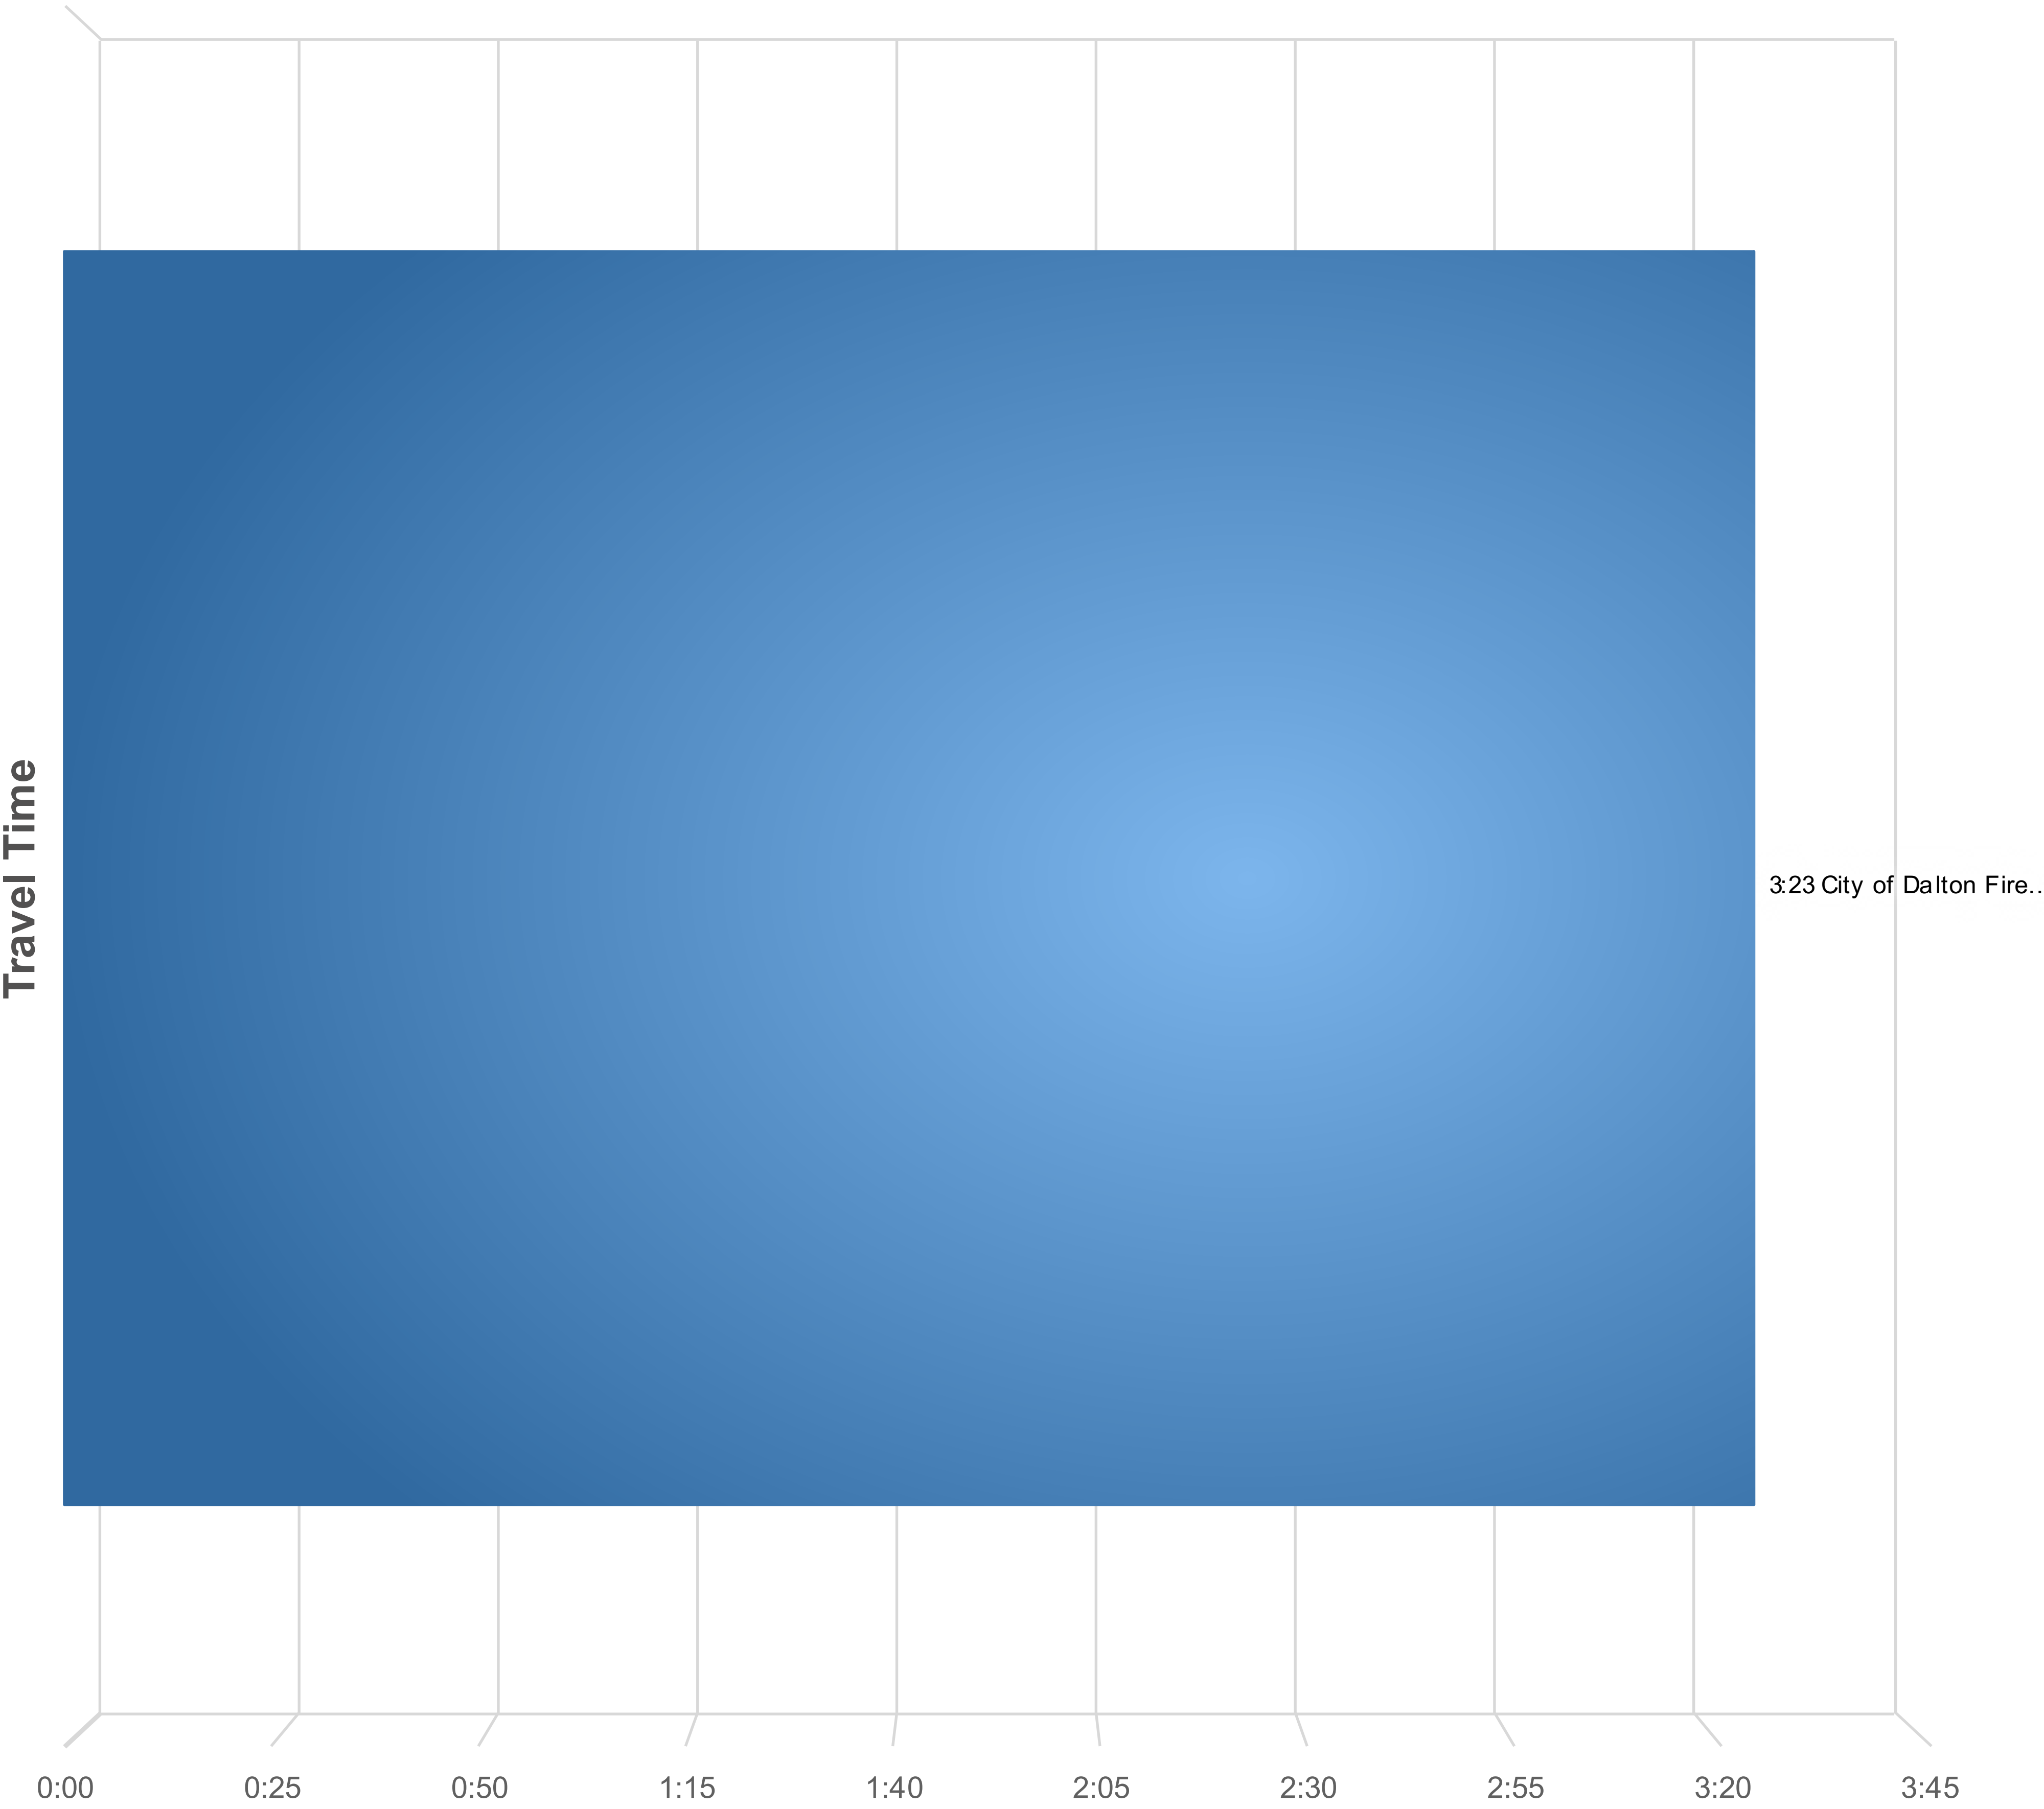

## Breakdown by Incident Type

Report Period: 09/01/22 - 09/30/22 23:59:59

| Incident Type  | Incidents | Exposures |
|--|-----------|-----------|
| 311 Medical assist, assist EMS crew                    | 198       | 0         |
| 611 Dispatched & canceled en route                     | 23        | 0         |
| 743 Smoke detector activation, no fire - unintentional | 14        | 0         |
| 745 Alarm system activation, no fire - unintentional   | 14        | 0         |
| 322 Motor vehicle accident with injuries               | 12        | 0         |
| 733 Smoke detector activation due to malfunction       | 8         | 0         |
| 324 Motor vehicle accident with no injuries.           | 8         | 0         |
| 622 No incident found on arrival at dispatch address   | 7         | 0         |
| 735 Alarm system sounded due to malfunction            | 6         | 0         |
| 444 Power line down                                    | 4         | 0         |
| 445 Arcing, shorted electrical equipment               | 4         | 0         |
| 740 Unintentional transmission of alarm, other         | 3         | 0         |
| 651 Smoke scare, odor of smoke                         | 3         | 0         |
| 553 Public service                                     | 3         | 0         |
| 323 Motor vehicle/pedestrian accident (MV Ped)         | 2         | 0         |
| 741 Sprinkler activation, no fire - unintentional      | 2         | 0         |
| 111 Building fire                                      | 2         | 0         |
| 113 Cooking fire, confined to container                | 1         | 0         |
| 123 Fire in portable building, fixed location          | 1         | 1         |
| 130 Mobile property (vehicle) fire, other              | 1         | 0         |
| 131 Passenger vehicle fire                             | 1         | 0         |
| 132 Road freight or transport vehicle fire             | 1         | 0         |
| 160 Special outside fire, other                        | 1         | 0         |
| 251 Excessive heat, scorch burns with no ignition      | 1         | 0         |
| 500 Service Call, other                                | 1         | 0         |
| 550 Public service assistance, other                   | 1         | 0         |
| 353 Removal of victim(s) from stalled elevator         | 1         | 0         |
| 411 Gasoline or other flammable liquid spill           | 1         | 0         |



| Incident Type                                     | Incidents | Exposures |
|---|-----------|-----------|
| 412 Gas leak (natural gas or LPG)                 | 1         | 0         |
| 744 Detector activation, no fire - unintentional  | 1         | 0         |
| 600 Good intent call, other                       | 1         | 0         |
| 711 Municipal alarm system, malicious false alarm | 1         | 0         |
| 731 Sprinkler activation due to malfunction       | 1         | 0         |

|              | Incidents  | Exposures |
|--------------|------------|-----------|
| <b>Total</b> | <b>329</b> | <b>1</b>  |

## Staff Hours by Incident Type

Report Period: 09/01/22 - 09/30/22 23:59:59

| Incident Type  | Hours  |
|--|--------|
| 311 Medical assist, assist EMS crew                    | 198.88 |
| 123 Fire in portable building, fixed location          | 101.20 |
| 111 Building fire                                      | 84.19  |
| 322 Motor vehicle accident with injuries               | 34.57  |
| 735 Alarm system sounded due to malfunction            | 31.09  |
| 743 Smoke detector activation, no fire - unintentional | 27.38  |
| 745 Alarm system activation, no fire - unintentional   | 24.75  |
| 733 Smoke detector activation due to malfunction       | 23.98  |
| 444 Power line down                                    | 21.21  |
| 445 Arcing, shorted electrical equipment               | 21.00  |
| 324 Motor vehicle accident with no injuries.           | 19.39  |
| 411 Gasoline or other flammable liquid spill           | 13.13  |
| 741 Sprinkler activation, no fire - unintentional      | 8.21   |
| 611 Dispatched & canceled en route                     | 7.68   |
| 412 Gas leak (natural gas or LPG)                      | 7.30   |
| 651 Smoke scare, odor of smoke                         | 6.46   |
| 622 No incident found on arrival at dispatch address   | 6.23   |
| 323 Motor vehicle/pedestrian accident (MV Ped)         | 4.55   |
| 113 Cooking fire, confined to container                | 4.32   |
| 600 Good intent call, other                            | 3.33   |
| 251 Excessive heat, scorch burns with no ignition      | 3.20   |
| 731 Sprinkler activation due to malfunction            | 3.20   |
| 740 Unintentional transmission of alarm, other         | 2.17   |
| 550 Public service assistance, other                   | 2.05   |
| 553 Public service                                     | 1.90   |
| 353 Removal of victim(s) from stalled elevator         | 1.85   |
| 131 Passenger vehicle fire                             | 1.80   |
| 711 Municipal alarm system, malicious false alarm      | 1.70   |


| <b>Incident Type</b>                             | <b>Hours</b> |
|--|--------------|
| 132 Road freight or transport vehicle fire       | 1.47         |
| 130 Mobile property (vehicle) fire, other        | 1.25         |
| 744 Detector activation, no fire - unintentional | 1.10         |
| 160 Special outside fire, other                  | 0.85         |
| 500 Service Call, other                          | 0.75         |

|              |               |
|--------------|---------------|
| <b>Total</b> | <b>672.14</b> |
|--------------|---------------|

# Incidents by Months

09/01/2021-09/30/2022

- 2021-09
- 2021-10
- 2021-11
- 2021-12
- 2022-01
- 2022-02
- 2022-03
- 2022-04
- 2022-05
- 2022-06
- 2022-07
- 2022-08
- 2022-09

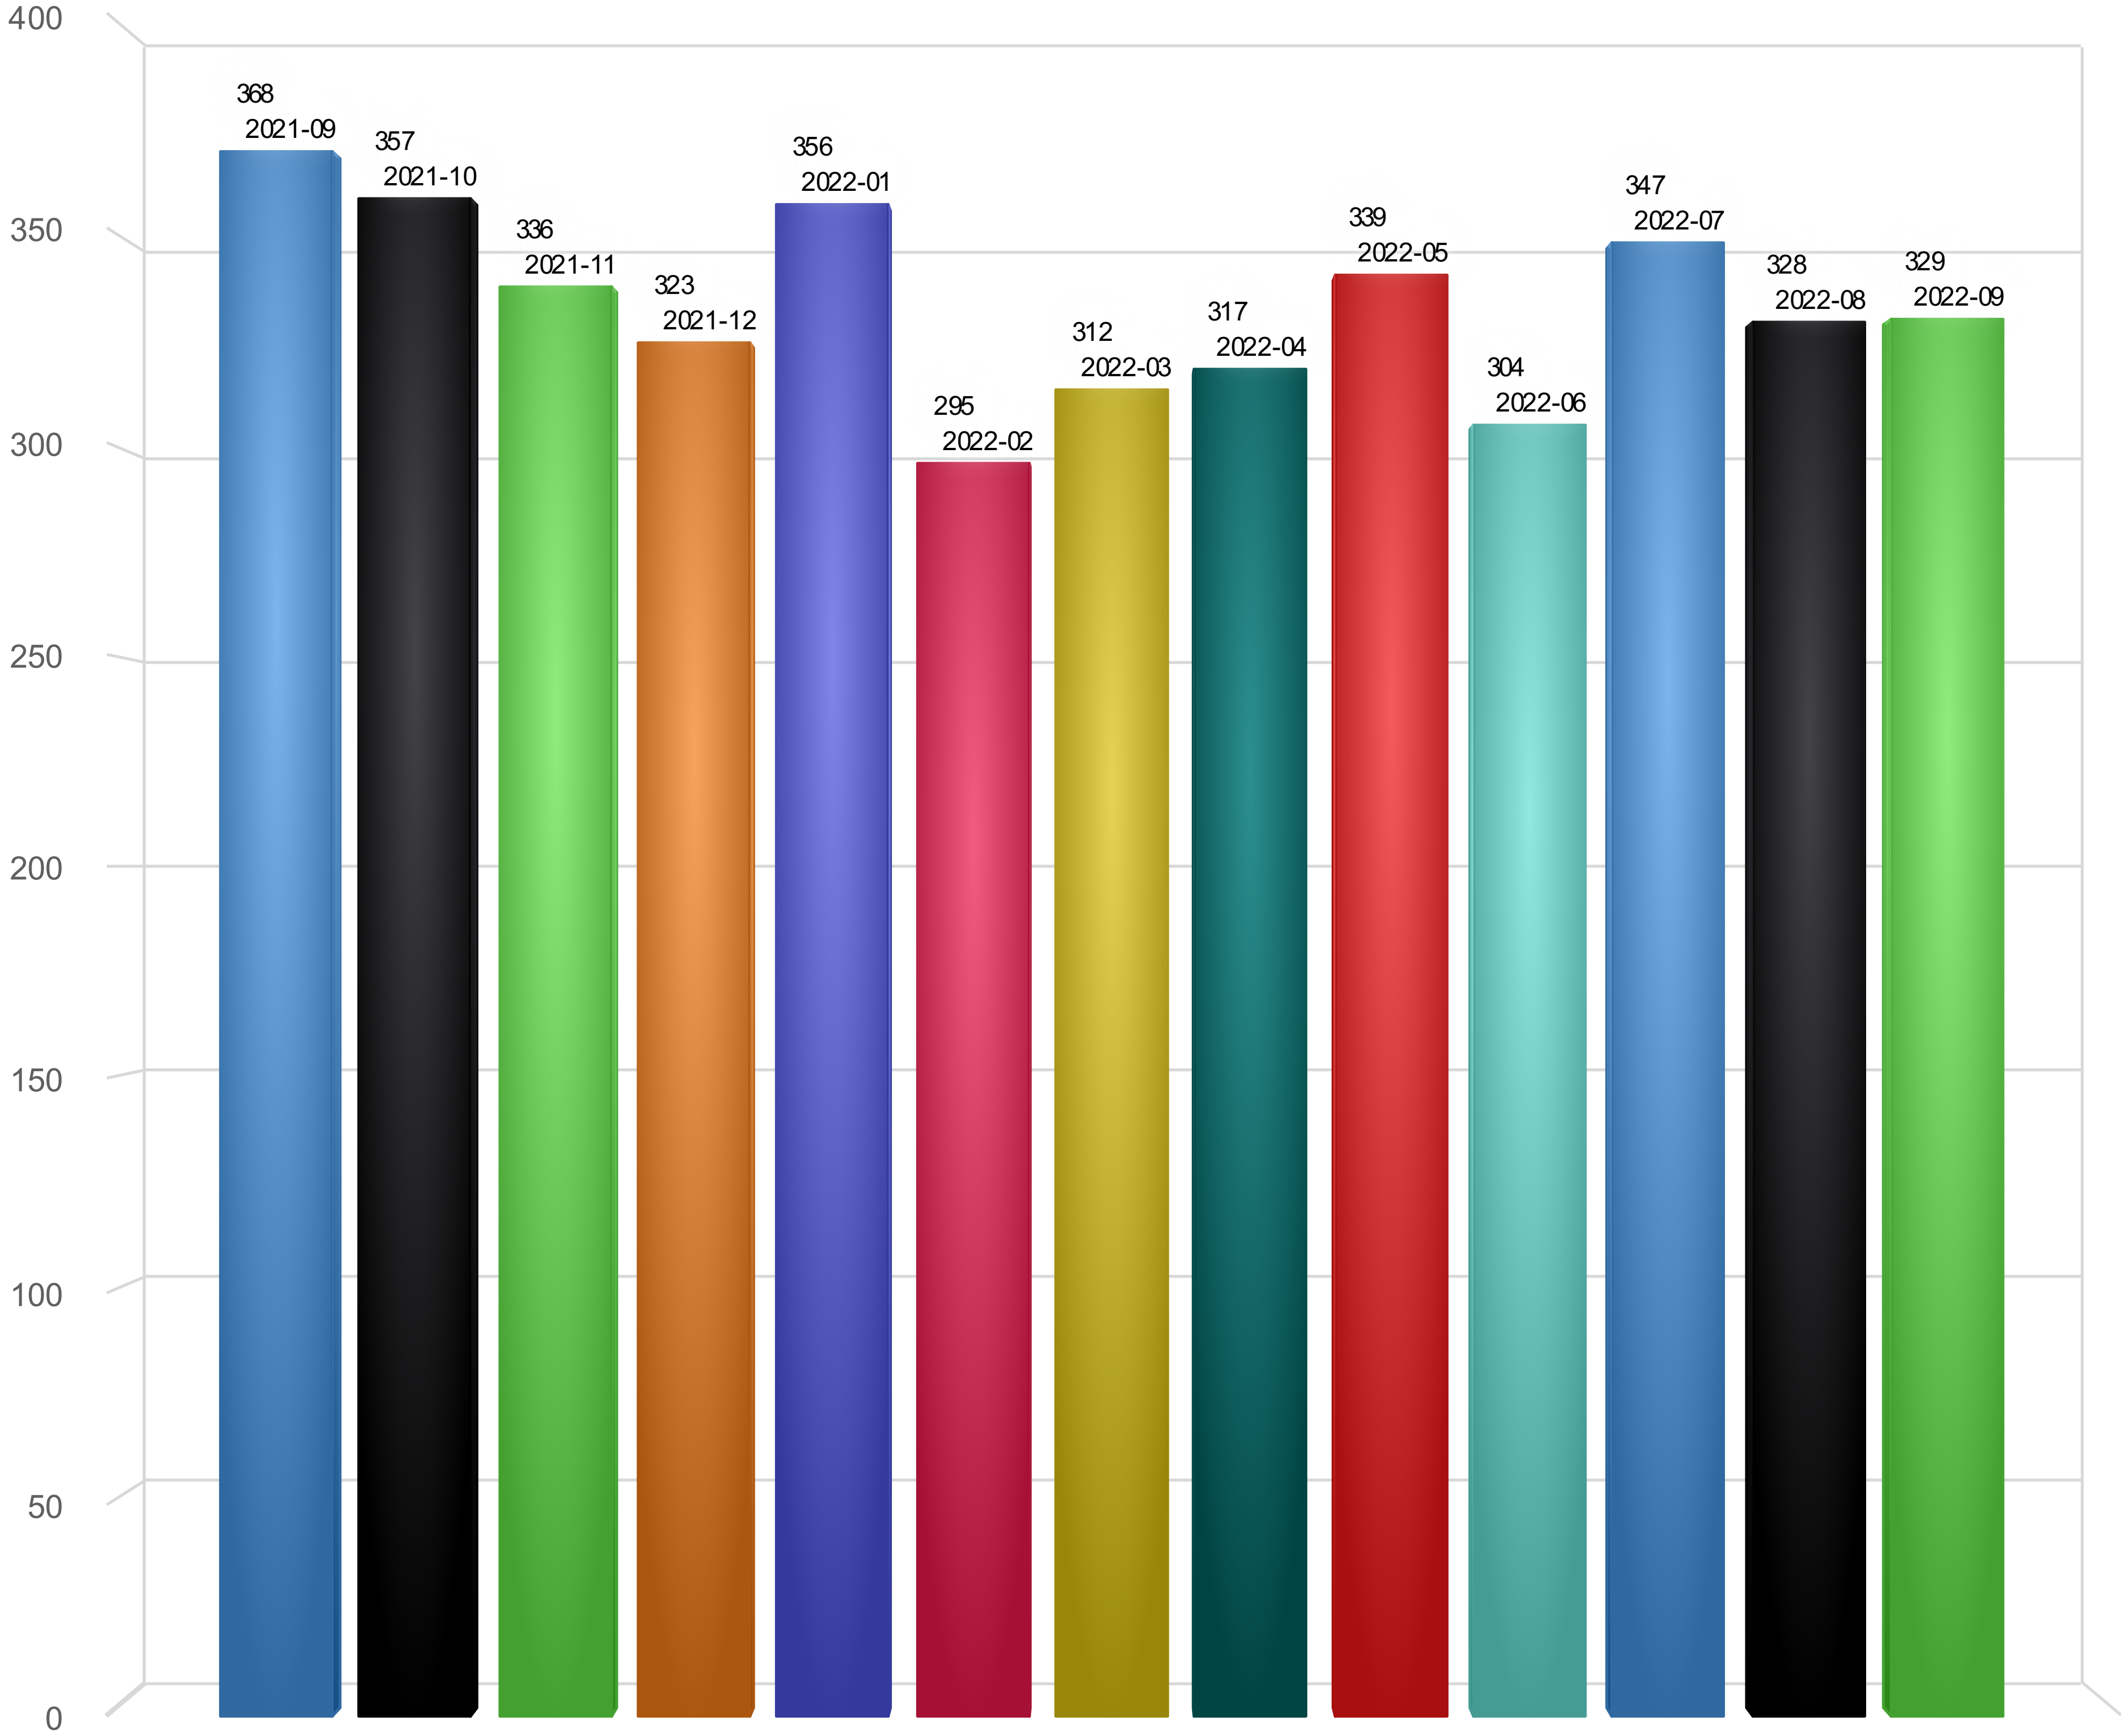

Incident Count

Total of Month: 4,311

# BREAKDOWN OF STRUCTURE FIRES AND OTHER FIRES AND INCIDENTS

(Dates: 09/01/22 - 09/30/22 23:59:59)

| FIRES IN STRUCTURES BY<br>FIXED PROPERTY USE (OCCUPANCY)<br>(Incident Type 110–129) |   | Number<br>of Fires | Number of Civilian<br>Fire Casualties |          | Est. Property<br>Damage and<br>Contents from Fire |
|---|---|--------------------|---------------------------------------|----------|---|
|   |   |                    | Deaths                                | Injuries |   |
| 1   | Private Dwellings (1 or 2 family), including mobile homes (FPU 419)   | 1                  | 0                                     | 0        | 110,000   |
| 2   | Apartments (3 or more families) (FPU 429)   | 2                  | 0                                     | 0        | 80,000  |
| 3   | Hotels and Motels (FPU 449)   | 0                  | 0                                     | 0        | 0   |
| 4   | All Other Residential (dormitories, boarding houses, tents, etc.) (FPU 400, 439, 459–499)   | 0                  | 0                                     | 0        | 0   |
| 5   | <b>TOTAL RESIDENTIAL FIRES (Sum of lines 1 through 4)</b>   | <b>3</b>           | <b>0</b>                              | <b>0</b> | <b>190,000</b>                                    |
| 6   | Public Assembly (church, restaurant, clubs, etc.) (FPU 100–199)   | 0                  | 0                                     | 0        | 0   |
| 7   | Schools and Colleges (FPU 200–299)  | 0                  | 0                                     | 0        | 0   |
| 8   | Health Care and Penal Institutions (hospitals, nursing homes, prisons, etc.) (FPU 300–399)  | 0                  | 0                                     | 0        | 0   |
| 9   | Stores and Offices (FPU 500–599)  | 0                  | 0                                     | 0        | 0   |
| 10  | Industry, Utility, Defense, Laboratories, Manufacturing (FPU 600–799)   | 0                  | 0                                     | 0        | 0   |
| 11  | Storage in Structures (barns, vehicle storage garages, general storage, etc.) (FPU 800–899)   | 1                  | 0                                     | 0        | 40,000  |
| 12  | Other Structures (outbuildings, bridges, etc.) (FPU 900–999)  | 0                  | 0                                     | 0        | 0   |
| 13  | <b>TOTALS FOR STRUCTURE FIRES (Sum of lines 5 through 12)</b>   | <b>4</b>           | <b>0</b>                              | <b>0</b> | <b>230,000</b>                                    |
| 14a   | Fires in Highway Vehicles (autos, trucks, buses, etc.) (IT 131–132, 136–137)  | 1                  | 0                                     | 0        | 12,500  |
| 14b   | Fires in Other Vehicles (planes, trains, ships, construction or farm vehicles, etc.) (IT 130, 133–135, 138)                                   | 1                  | 0                                     | 0        | 5,000   |
| 15  | Fires outside of Structures with Value Involved, but Not Vehicles (outside storage, crops, timber, etc.) (IT 140, 141, 161–162, 164, 170–173) | 0                  | 0                                     | 0        | 0   |
| 16  | Fires in Brush, Grass, Wildland (excluding crops and timber), with no value involved. (IT 142–143)  | 0                  | 0                                     |          |   |
| 17  | Fires in Rubbish, Including Dumpsters (outside of structures), with no value involved. (IT 150–155)   | 0                  | 0                                     |          |   |
| 18  | All Other Fires. (IT 100, 160, 163)   | 1                  | 0                                     | 0        | 300   |
| 19  | <b>TOTALS FOR FIRES (Sum of lines 13 through 18)</b>  | <b>7</b>           | <b>0</b>                              | <b>0</b> | <b>247,800</b>                                    |
| 20  | Rescue, Emergency Medical Responses (ambulance, EMS, rescue) (IT 300–381)   | 217                |                                       |          |   |
| 21  | False Alarm Responses (malicious or unintentional false calls, malfunctions, bomb scares) (IT 700–746)  | 48                 |                                       |          |   |
| 22  | Mutual Aid Responses Given  | 14                 |                                       |          |   |
| 23a   | Hazardous Materials Responses (spills, leaks, etc.) (IT 410–431)  | 2                  |                                       |          |   |
| 23b   | Other Hazardous Responses (arcing wires, bomb removal, power line down, etc.) (IT 440–482, 400)   | 8                  |                                       |          |   |
| 24  | All Other Responses (smoke scares, lock-outs, animal rescues, etc.) (IT 200–251, 500–699, 800–911)  | 33                 |                                       |          |   |
| 25  | <b>TOTAL FOR ALL INCIDENTS (Sum of lines 19 through 24)</b>   | <b>329</b>         |                                       |          |   |

# Confined Fires

(Dates: 09/01/22 - 09/30/22 23:59:59; Incident Types: 110-129)

|    |                   | Number of Confined Fires | Number of Nonconfined Fires |
|----|-------------------|--------------------------|-----------------------------|
| 5  | Residential Fires | 1                        | 2                           |
| 13 | Structure Fires   | 1                        | 3                           |

# Breakdown of False Alarm Responses

(Dates: 09/01/22 - 09/30/22 23:59:59; Incident Types: 700-799)

| Type of False Alarm |   | Number of Incidents |
|---------------------|---|---------------------|
| 1                   | Malicious, Mischievous False Call (IT 710-715)                              | 1                   |
| 2                   | System Malfunction (IT 730-739)   | 15                  |
| 3                   | Unintentional (tripping on interior device accidentally, etc.) (IT 740-749) | 32                  |
| 4                   | Other False Alarms (bomb scares, etc.) (IT 721, 751, 700)                   | 0                   |

# Intentionally Set Fires in Structures and Vehicles

(Dates: 09/01/22 - 09/30/22 23:59:59; Incident Types: 110-139; Cause of Ignition: 1)

|   |  | Number of Fires | Number of Civilian Fire Casualties |          | Estimated Property Damage and Contents from Fire |
|---|--|-----------------|------------------------------------|----------|--|
|   |  |                 | Deaths                             | Injuries |  |
| 1 | Structure Fires Intentionally set (IT=110-129) | 0               | 0                                  | 0        | 0  |
| 2 | Vehicle Fires Intentionally set (IT=130-139)   | 0               | 0                                  | 0        | 0  |

# **Training Division Monthly Report**

## **September 2022**

### **Overview**

A unit on mental health in the fire service was presented to all DFD personnel by Dr. Meghan Lacks. Biennial recertification training for licensed EMTs and Paramedics began in September with a session on airway and breathing. Monthly training included territory familiarization, pre-fire training, core competency check-offs, special operations training, and company level drills chosen by company officers. Training hours during the month of September totaled 2,525.

### **Outside Schools**

3 firefighters attended the National Fire Academy direct delivery offering of Decision Making for Initial Company Operations at Gordon County Fire Rescue.


2 company officers attended Fire Department Executive at GPSTC and subsequently received NPQ Fire Officer 4 certifications.

The department's 3 certified asbestos inspectors attended annual refresher training at The Environmental Institute in Marietta.

# Inspection Visit History by Inspection Type

09/01/2022-09/30/2022

- Alcohol
- Annual
- Annual \ Periodic
- Annual Apartment
- Complaint
- Fireworks Display
- Kitchen Hood Installation
- Knox Box
- New Fire Alarm
- OTC
- Plan Review
- Site Visit

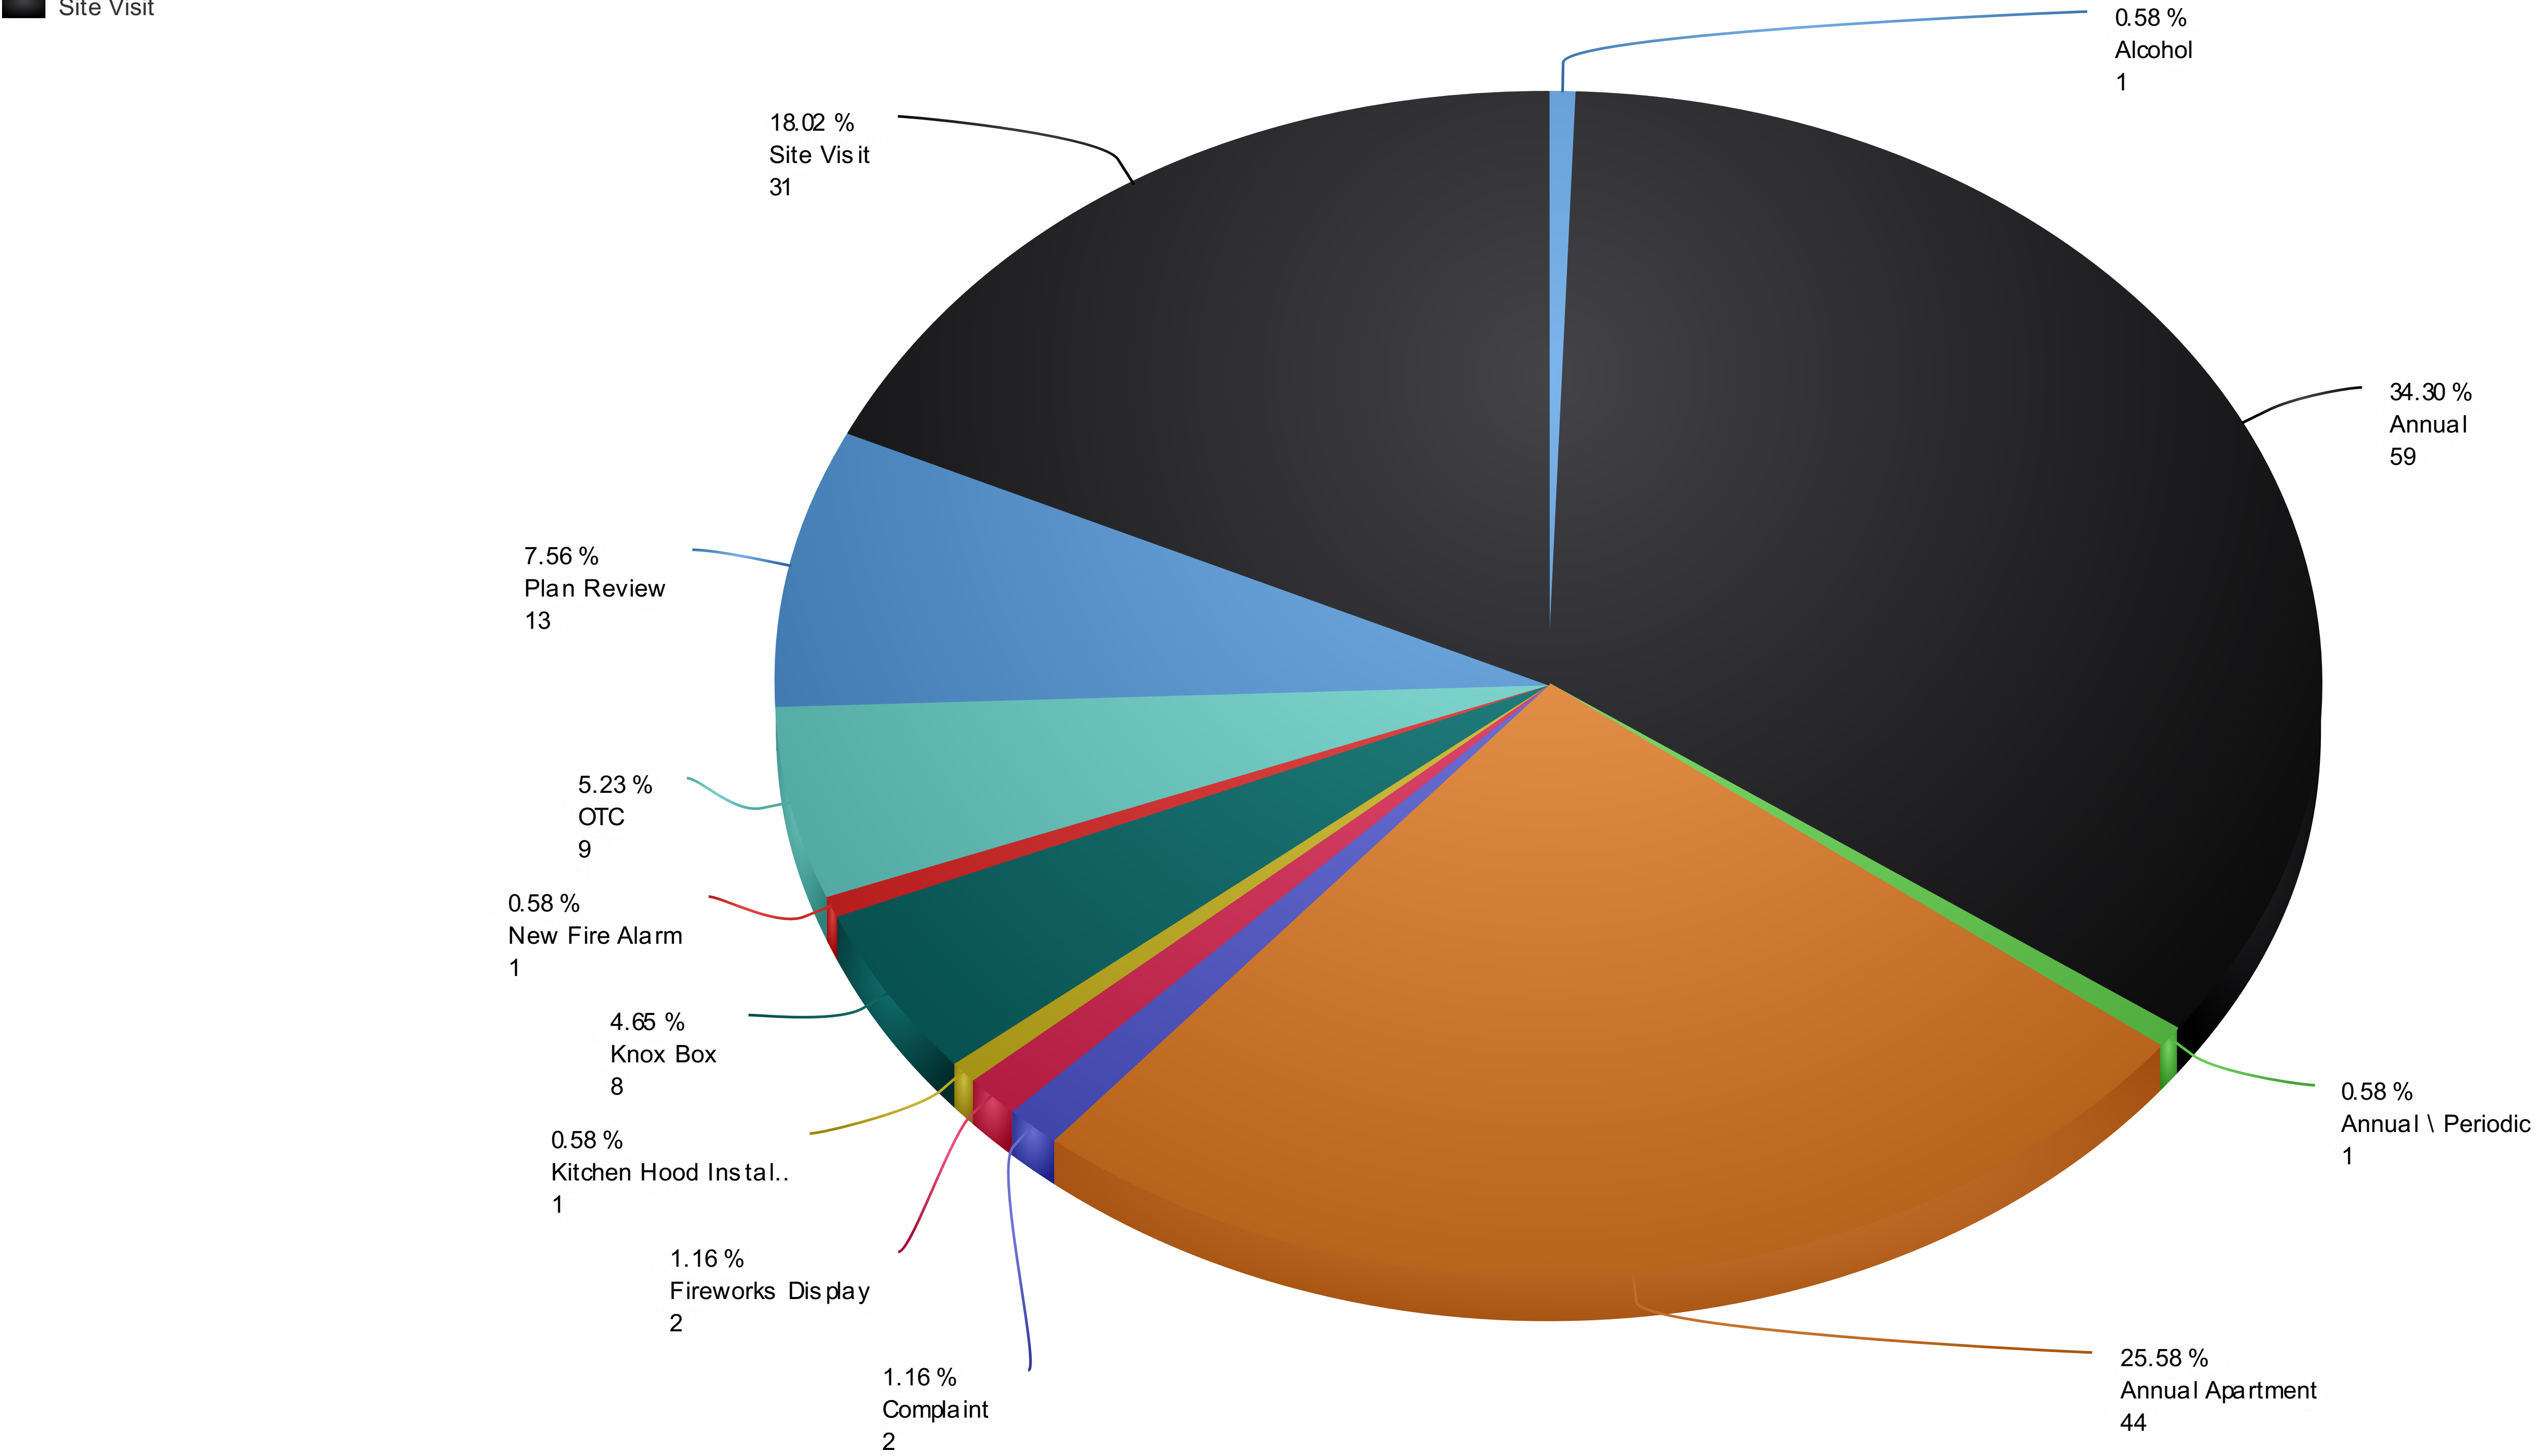

Total of Inspection Type: 172