




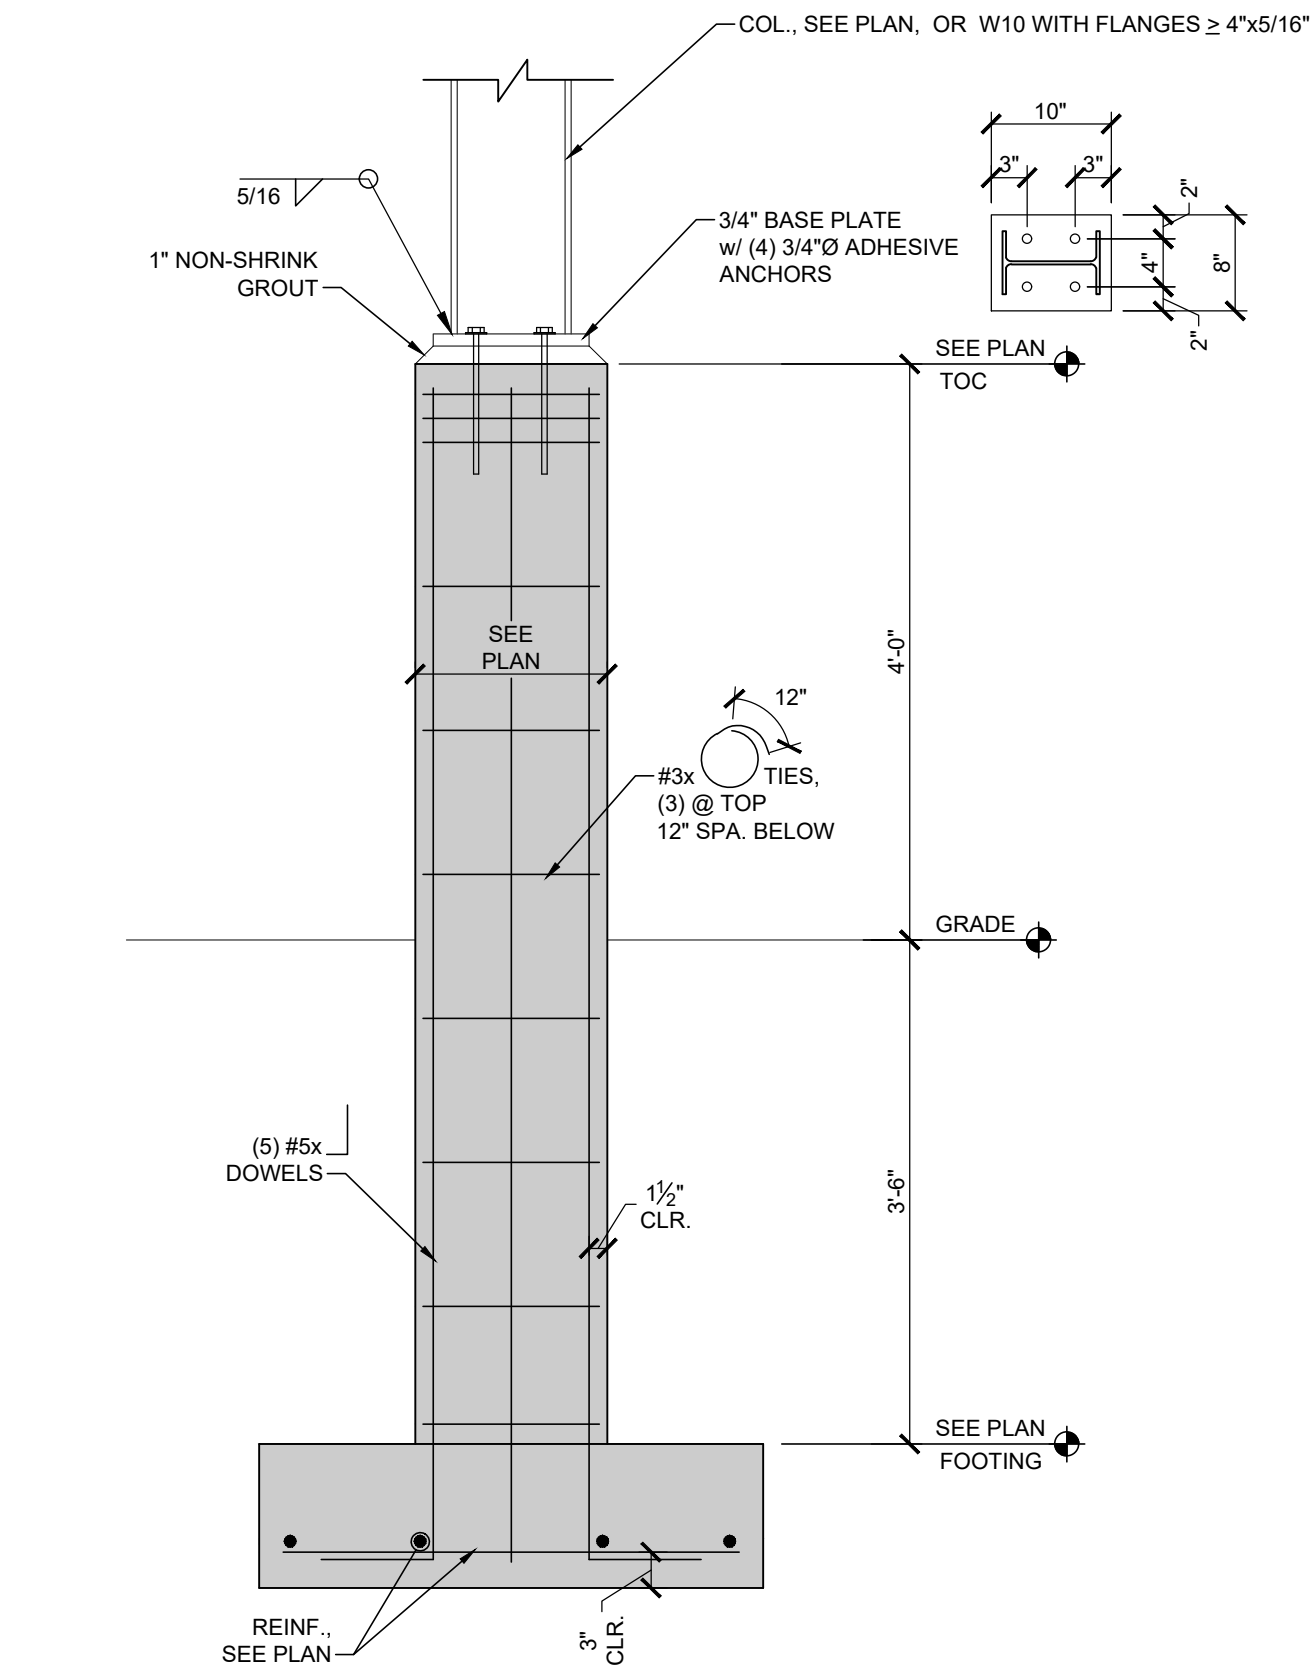


1
S201
SCALE = 3/4"=1'-0"

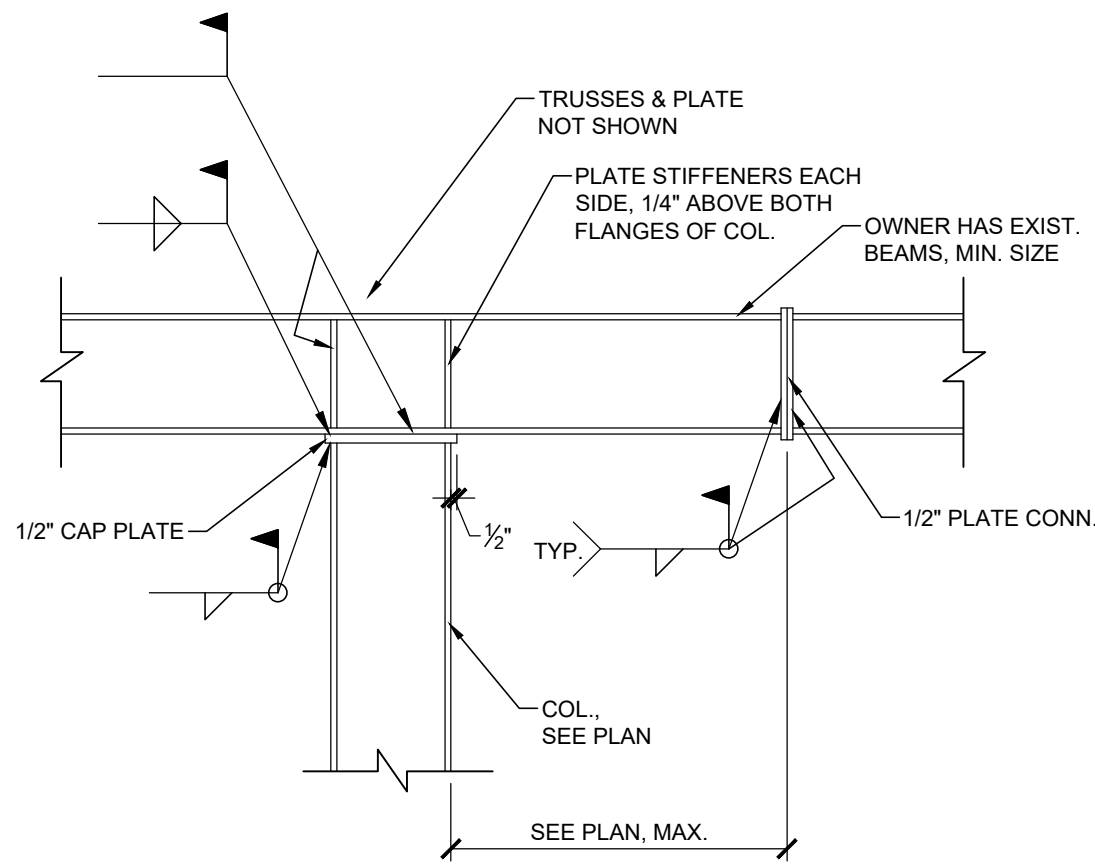


2
S201
SCALE = 3/4"=1'-0"

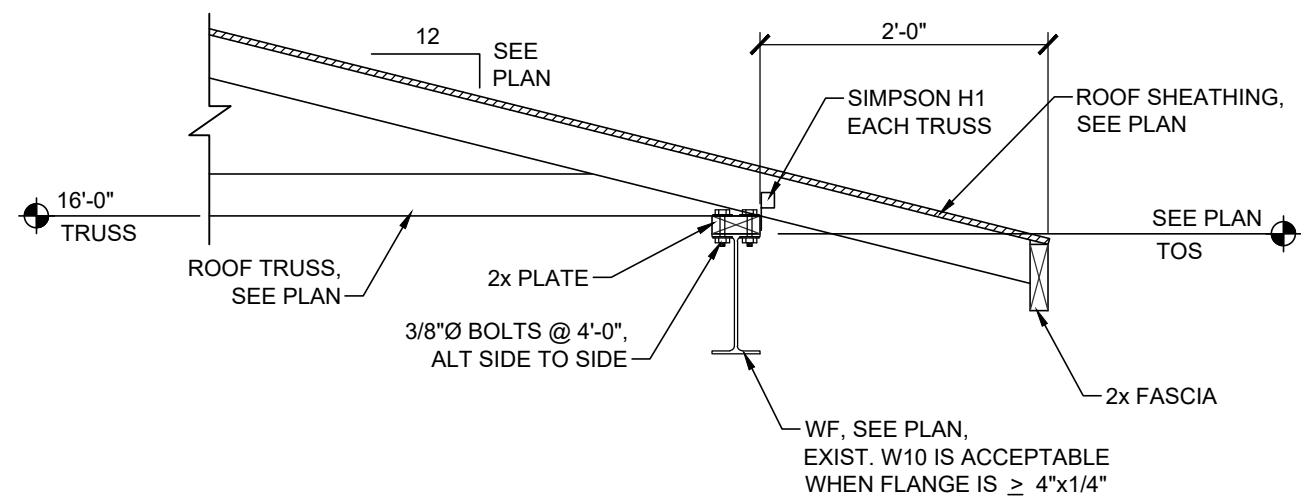

3
S201
SCALE = 3/4"=1'-0"

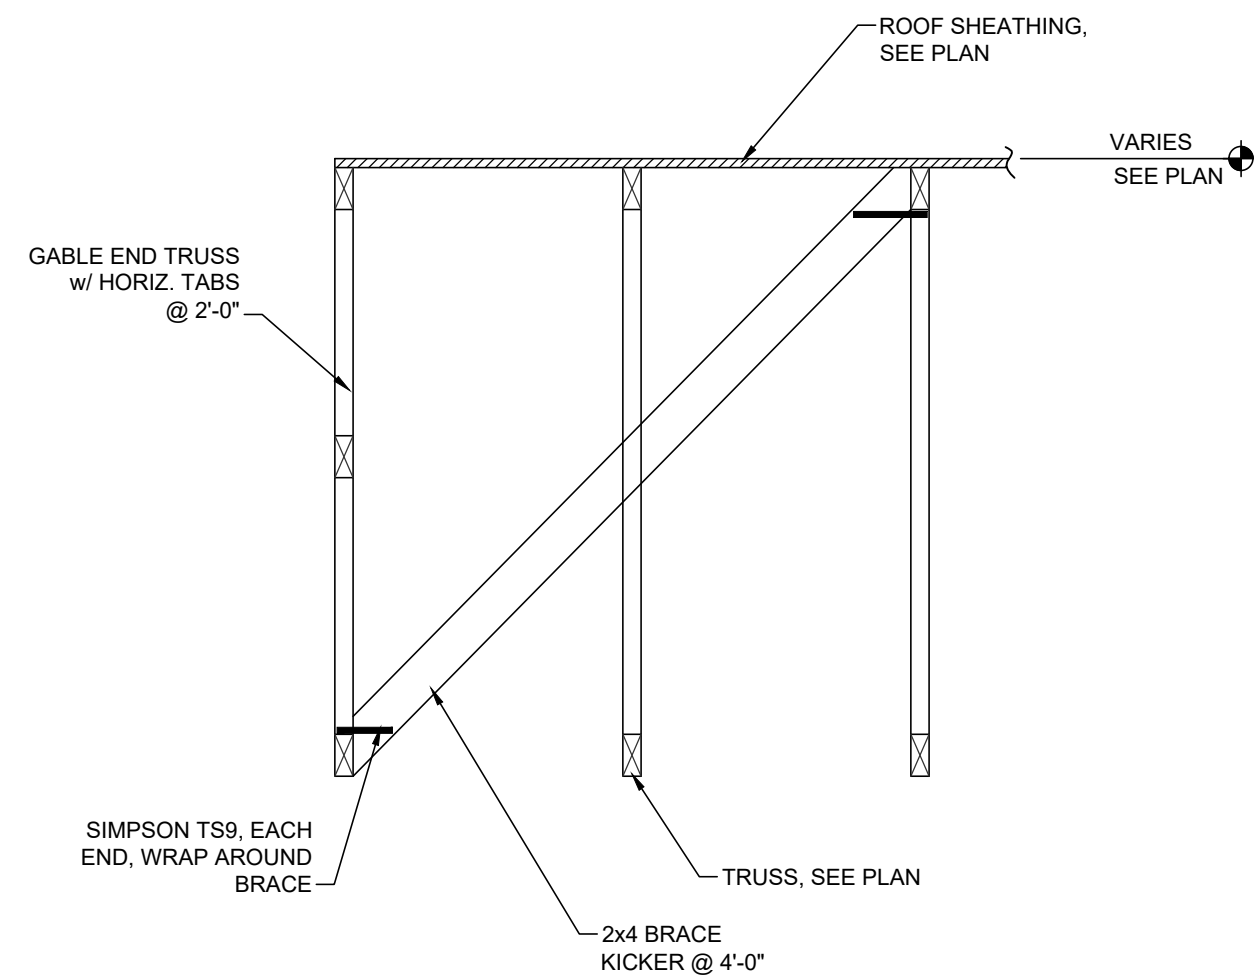

4
S201
SCALE = 3/4"=1'-0"

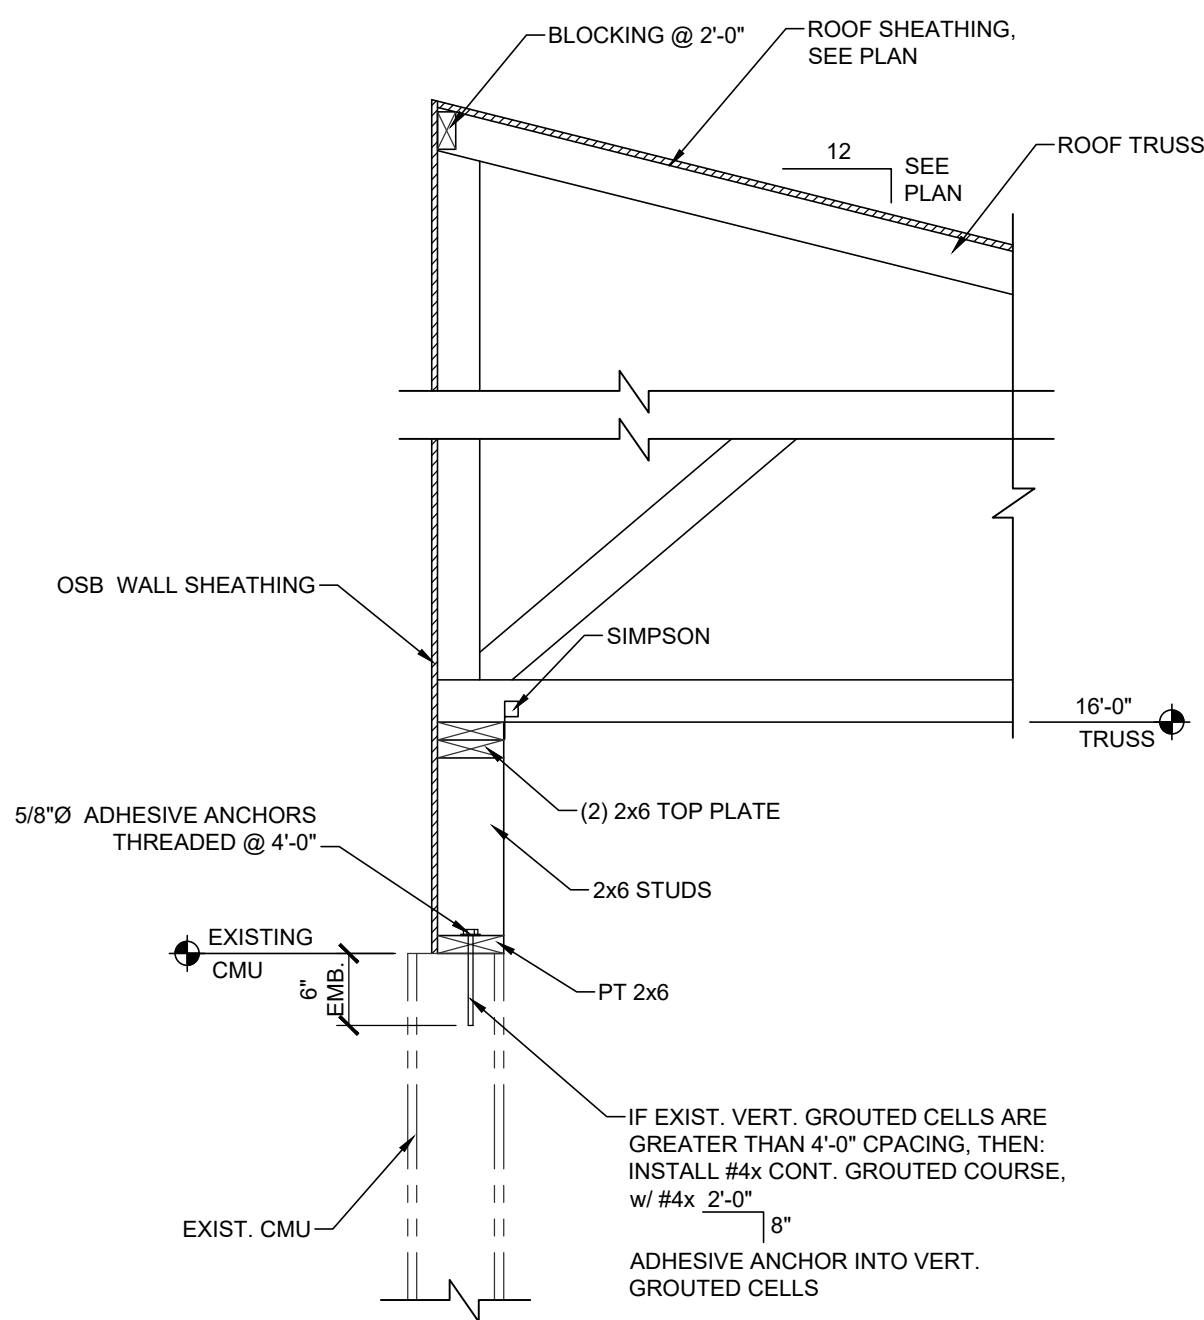


5
S201
SCALE = 3/4"=1'-0"

ANCHOR ROD SCHEDULE			
TYPE "A" ANCHOR ROD DETAIL			
DIAMETER	EMBEDMENT	REMARKS	
3/4"	1'-0"		
1/2"	1'-0"		
1/4"	1'-0"		
1/8"	1'-0"		
TYPE "B" ANCHOR ROD DETAIL			
DIAMETER	EMBEDMENT	REMARKS	
3/4"	1'-0"		
1/2"	1'-0"		
1/4"	1'-0"		
1/8"	1'-0"		
TYPE "C" ANCHOR ROD DETAIL			
DIAMETER	EMBEDMENT	REMARKS	
3/4"	1'-0"		
1/2"	1'-0"		
1/4"	1'-0"		
1/8"	1'-0"		

REBAR SIZE	LAP LENGTH 60 KSI REBAR		MASONRY
	VERT & HORZ	TOP BAR	
#3	1'-2"	1'-6"	ALL
#4	2'-0"	2'-6"	2'-0"
#5	2'-6"	3'-4"	2'-6"
#6	3'-2"	4'-2"	3'-0"
#7	3'-6"	4'-6"	3'-6"
#8	4'-0"	5'-2"	4'-2"
#9	5'-0"	6'-4"	
#10	6'-2"	8'-2"	
#11	8'-2"	9'-6"	


- REINFORCING NOTES:
- 1) CONCRETE LAP LENGTHS ARE CLASS 'B' BASED ON FC=4000 PSI WITH COVER REQUIREMENTS INDICATED AND BAR SPACING AT LEAST THREE BAR DIAMETERS.
 - 2) TOP BAR LAPS ARE HORIZONTAL LAPS WHERE MORE THAN 12" OF FRESH CONCRETE IS PLACED BELOW THE BARS.
 - 3) TOP BAR LAP LENGTHS MAY BE USED AT ALL LOCATIONS IN CONCRETE AT THE CONTRACTOR'S DISCRETION.
 - 4) MASONRY LAP LENGTHS ARE BASED ON FM=1500 PSI WITH COVER REQUIREMENTS AND SPACING INDICATED.

REVISIONS

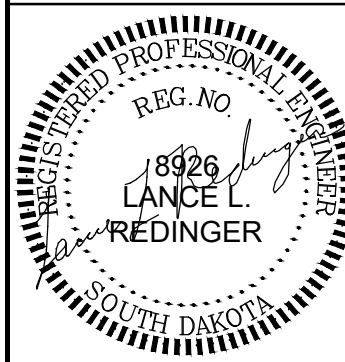

FIRST GOLD HOTEL

DEADWOOD, SOUTH DAKOTA

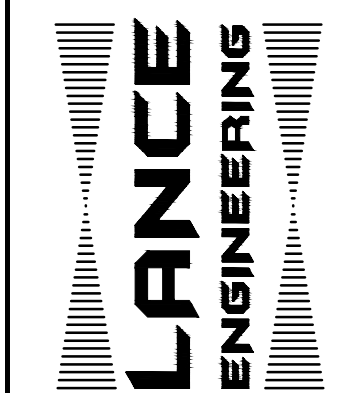

PRECISION DESIGN

LANCE ENGINEERING
605-642-3680
19751 ST. ONGE RD
ST. ONGE, SD 57779

THESE DOCUMENTS ARE THE PROPERTY OF LANCE ENGINEERING AND SHALL NOT BE USED FOR ANY OTHER PROJECT.

Drawn By RJT

Checked By LLR

Date 4/16/21

LE # 20253

Cad File S201.DWG

SHEET TITLE: DETAILS

SHEET#
S201