

Dripping Springs Wastewater Plant Report

Month of June 2026

Regional	Combined Flow	Plant TLAP	Caliterra	210 Reuse	Cl2 residual	NTU	BOD	TSS	E-coli
Total	11148.5	3737	5967.15	1560.65	>1	<3	<5	<5	<20
Daily Average	372	125	199	52	4.86	2.77	5.25	2.6	0.689

Arrowhead	Flow	Cl2 residual	BOD	TSS	E-coli
Total	1850	>1	<10	<15	<126
Daily Average	61.7	4.15	1.5	2.6	0.1


Flow x1000

Big Sky	Flow	Cl2 residual	BOD	TSS	E-coli
Total	1065	>1	<20	<20	<126
Daily Average	35.5	5.49	1.77	8.02	0.1

210 Reuse	Fill Station	Sports Park	Founders Park	Village Grove Construction
Total	116	1084	360	N/A
Daily Average	6.12	36.15	12	N/A

Flow is in 1000's gallons

REGIONAL FLOW DISTRIBUTION

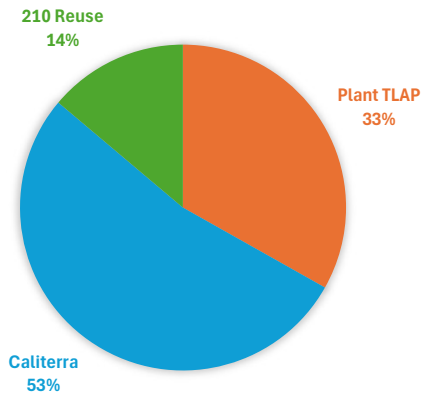

210 Flow Distribution

