

Dripping Springs Wastewater Plant Report

Month of February 2026

Regional	Combined Flow	Plant TLAP	Caliterra	210 Reuse	Cl2 residual	NTU	BOD	TSS	E-coli
Total	9111.4	2447	4842.19	1822.21	>1	<3	<5	<5	<20
Daily Average	325.00	87.00	173	65	6	16	4.4	1.3	0.26

Arrowhead	Flow	Cl2 residual	BOD	TSS	E-coli
Total	168.2	>1	<10	<15	<126
Daily Average	60.07	6.43	3	5.66	0.1


Flow x1000

Big Sky	Flow	Cl2 residual	BOD	TSS	E-coli
Total	966	>1	<20	<20	<126
Daily Average	34.5	6.675	8.66	25.666	N/A

210 Reuse	Fill Station	Sports Park	Founders Park	Village Grove Construction
Total	71.7	1227	315	209
Daily Average	2.56	43.81	11.23	7.47

Flow is in 1000's gallons

REGIONAL FLOW DISTRIBUTION

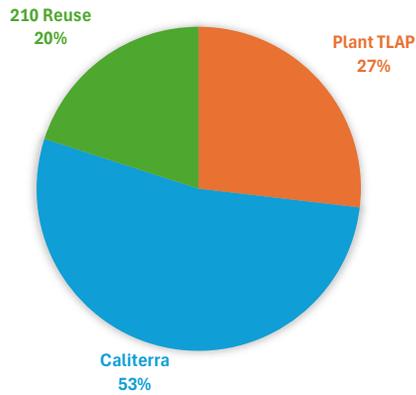

210 Flow Distribution

