

Dripping Springs Wastewater Plant Report

Month of July 2025

Regional	Combined Flow	Plant TLAP	Caliterra	210 Reuse	Cl2 residual	NTU	BOD	TSS	E-coli
Total	8566.4	3065	3680.7	1929	>1	<3	<5	<5	<20
Daily Average	286.00	102.00	123	62.24	5.38	2.14	1.625	1	2.706

Arrowhead	Flow	Cl2 residual	BOD	TSS	E-coli
Total	1816	>1	<10	<15	<126
Daily Average	58.5	6.22	1.2	4.4	2


Big Sky	Flow	Cl2 residual	BOD	TSS	E-coli
Total	1816	>1	<20	<20	<126
Daily Average	58.5	6.3	1.8	0.8	7.5

210 Reuse	Fill Station	Sports Park	Founders Park	Village Grove Construction
Total	117	1017	472	324
Daily Average	3.76	32.8	15.24	10.44

Flow is in 1000's gallons

Incomplete Data

REGIONAL FLOW DISTRIBUTION

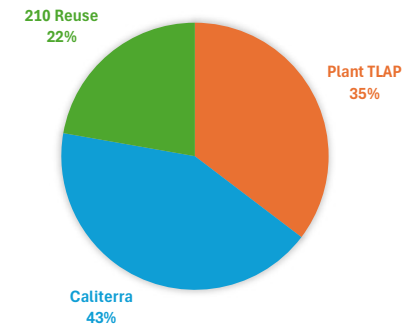

210 REUSE DISTRIBUTION

