

Dripping Springs Wastewater Plant Report

Month of January 2026

Regional	Combined Flow	Plant TLAP	Caliterra	210 Reuse	Cl2 residual	NTU	BOD	TSS	E-coli
Total	10128.0	1986	3128.4	2013.6	>1	<3	<5	<5	<20
Daily Average	335.00	66.00	203	65	8	2	2.2	0.75	0.516

Arrowhead	Flow	Cl2 residual	BOD	TSS	E-coli
Total	200	>1	<10	<15	<126
Daily Average	0.065	6.18	3	7.5	0.01


Flow x1000

Big Sky	Flow	Cl2 residual	BOD	TSS	E-coli
Total	1221	>1	<20	<20	<126
Daily Average	39.39	7.7	1.67	1.5	0.1

210 Reuse	Fill Station	Sports Park	Founders Park	Village Grove Construction
Total	212	1034	388	394
Daily Average	6.8	33.37	12.52	12.72

Flow is in 1000's gallons

REGIONAL FLOW DISTRIBUTION

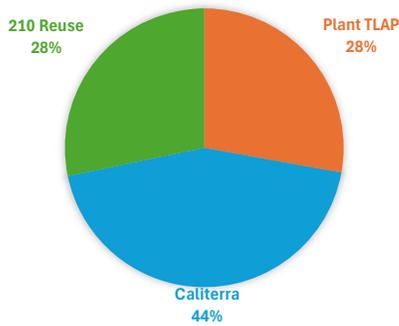

210 Flow Distribution

