

Dripping Springs Wastewater Plant Report

Month of July 2026

Regional	Combined Flow	Plant TLAP	Caliterra	210 Reuse	Cl2 residual	NTU	BOD	TSS	E-coli
Total	10741.0	4256	4490	1994	>1	<3	<5	<5	<20
Daily Average	346	137	145	64	8.24	3.3	3.5	3.3	0.32

Arrowhead	Flow	Cl2 residual	BOD	TSS	E-coli
Total	1820	>1	<10	<15	<126
Daily Average	58.7	6.1	1.7	1.7	0.1


Flow x1000

Big Sky	Flow	Cl2 residual	BOD	TSS	E-coli
Total	1136	>1	<20	<20	<126
Daily Average	36.7	6.1	0.4	0.7	0.1

210 Reuse	Fill Station	Sports Park	Founders Park
Total	226	1331	437
Daily Average	7.3	42.9	14.1

Flow is in 1000's gallons

REGIONAL FLOW DISTRIBUTION

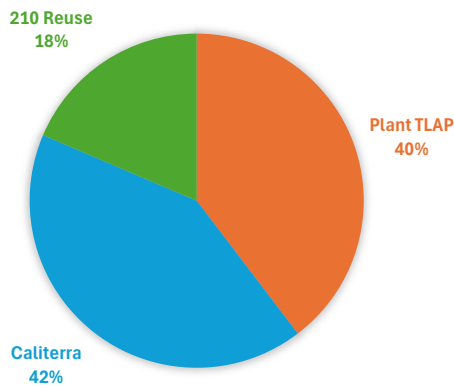

210 Flow Distribution

