



500 SE Fourth Street • Grand Rapids, Minnesota 55744

WATER MONTHLY ANALYSIS REPORT December 2024


Water Operations


The water plant pumped an average of 0.87 million gallons of water per day (MGD) with a peak of 1.17 million gallons during last month which is normal for this time of the year.

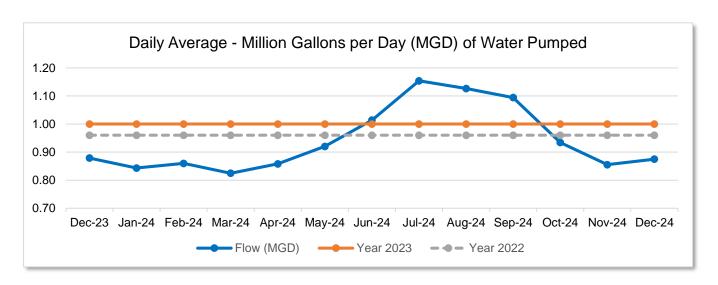


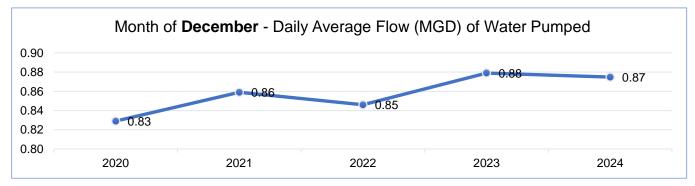

All water quality analysis was normal for the month as seen in the graphs below.

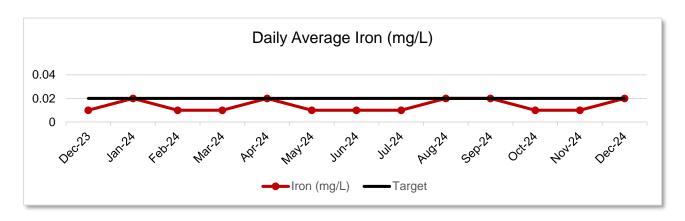

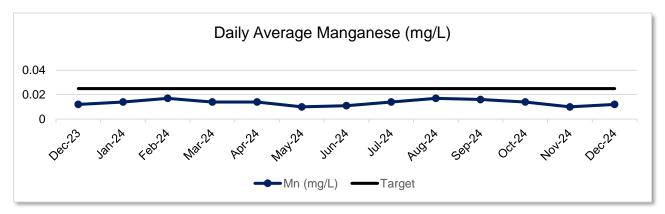

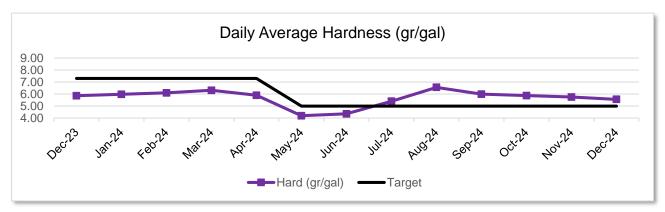

Due to the disinfection, water softening was increased to enhance corrosion protection measures.

