



500 SE Fourth Street • Grand Rapids, Minnesota 55744

## WATER MONTHLY ANALYSIS REPORT January 2025


## **Water Operations**


The water plant pumped an average of 0.87 million gallons of water per day (MGD) with a peak of 1.02 million gallons during last month which is normal for this time of the year.

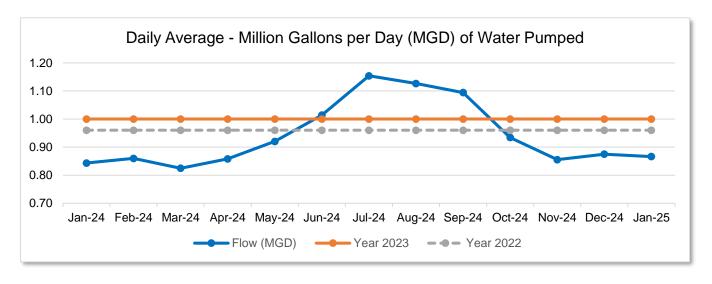


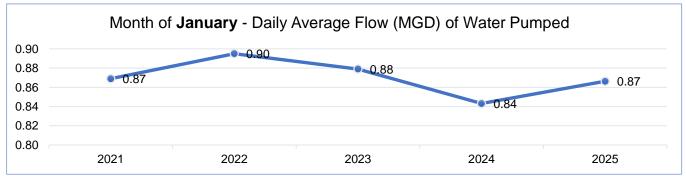

Most water quality analysis was normal for the month as seen in the graphs below. Iron and Manganese was higher than normal due to filter valve repairs on filter number 1.

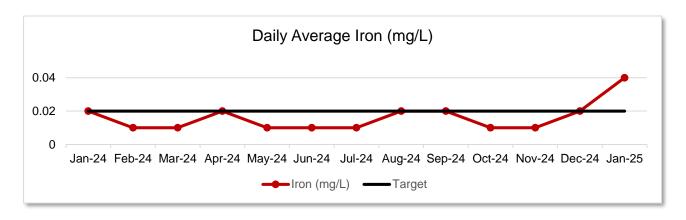

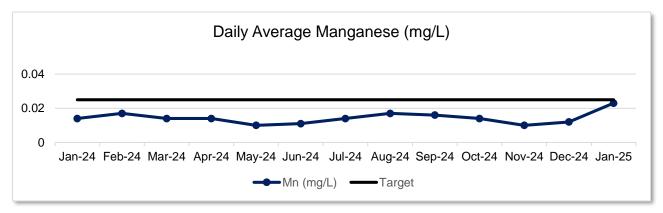

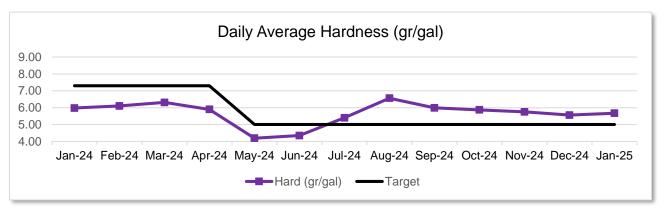

Due to the disinfection, water softening was increased to enhance corrosion protection measures.

