


Service is Our Nature

500 SE Fourth Street • Grand Rapids, Minnesota 55744


WASTEWATER MONTHLY ANALYSIS REPORT September 2025

Wastewater Operations


The Wastewater Treatment Plant (WWTP) met all National Pollutant Discharge Elimination System (NPDES) permit requirements last month while treating 174 million gallons of water removing 99.9% of the Total Suspended Solids (TSS) and 99.6% Biochemical Oxygen Demand (cBOD).

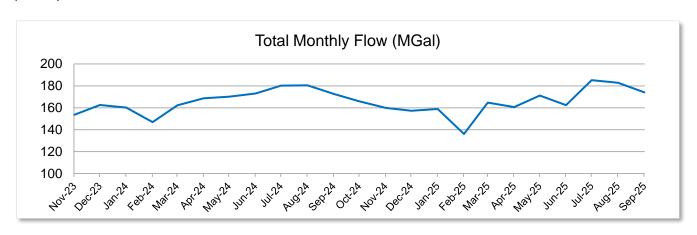


	Design Limits (monthly AVG)	Actual Results
Primary Plant		
Flow (MGD)	13.25	4.3
TSS (Tons/day)	162	33.1
TSS Peak (Tons/Dav)	284	118.8

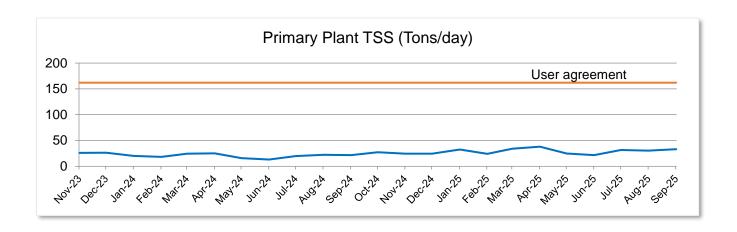



	Design Limits (monthly AVG)	Actual Results
Secondary Plant		
Flow (MGD)	15.25	5.8
cBOD (lbs/Day)	41,300	28,849
Peak cBOD (lbs/Day)	57,350	42,675
Zinc-weekly (ug/L)	418	160
% GRPUC		30.0%

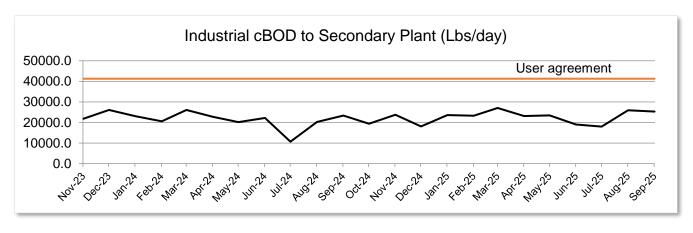

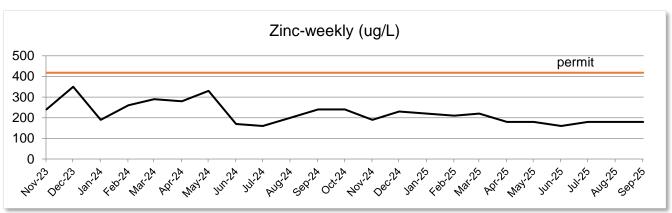

	Permit Limits (monthly AVG)	Actual Results
<u>Effluent</u>		
TSS (mg/L) – monthly average	30	1.1
cBOD (mg/L) - monthly average	25	2.6
Dissolved Oxygen (mg/L)	>1.0	6.7

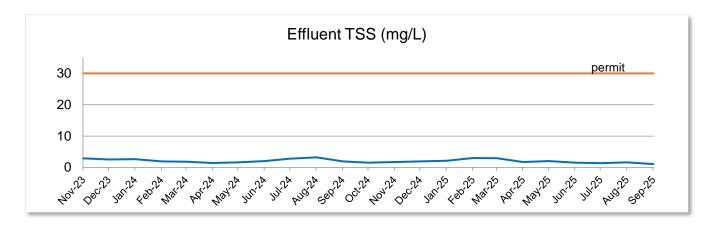

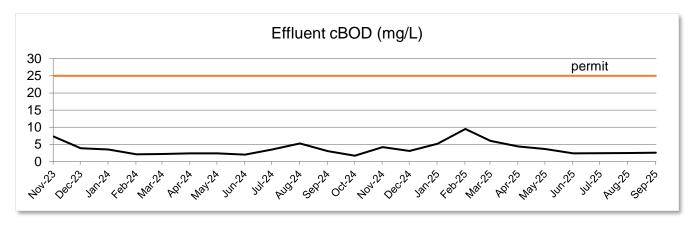

Sludge Landfill Operations

- 0.32 million gallons of leachate were hauled last month
- 4092 cubic yards of sludge solids were hauled to the landfill

