
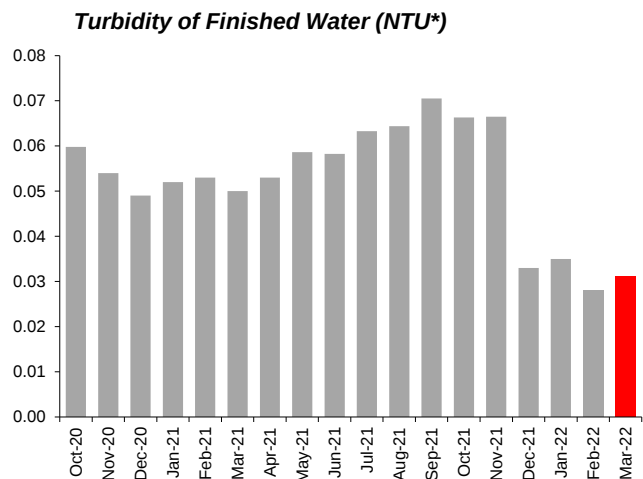
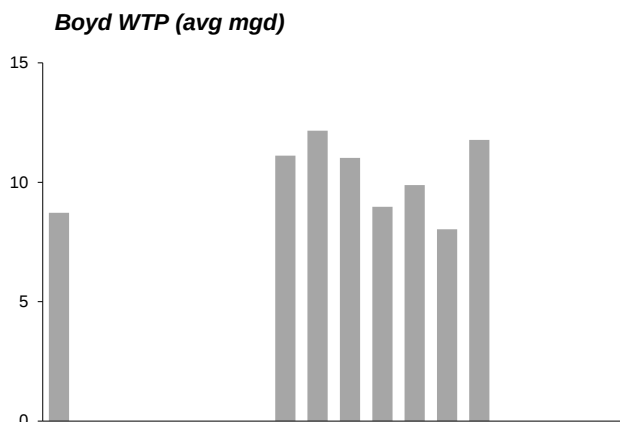
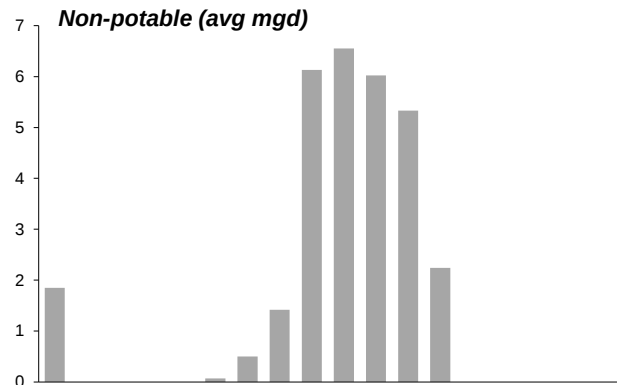


Water Treatment

Bellvue Water Treatment Plant operates year-round with a transmission capacity of 29.1 million gallons per day (mgd) (plant capacity is 32 to 35 mgd). Water sources include Poudre River direct flows, Colorado-Big Thompson (C-BT), Windy Gap, High Mountain Reservoirs, Laramie-Poudre Tunnel, and Water Supply and Storage. Average volume is 19,000 acre-feet a year (2000-2011). The plant was built in 1907, with its last treatment upgrade in 2009. Solar panels were added in 2014.

Boyd Water Treatment Plant operates normally from April to October with a plant capacity of 38 mgd (transmission capacity is 40 mgd). Water sources include Greeley-Loveland Irrigation Company, C-BT, and Windy Gap. Average Volume is 8,200 acre-feet (2000-2011). The current plant was built in 1974, with its last treatment upgrade in 1999. Solar panels were added at Boyd in 2014. In 2016, tube settlers and plate settlers were replaced in the sedimentation basins. In 2018, all old existing chemical lines were replaced with new lines and the piping was up-sized to carry more chemical. A PLC upgrade was done on the SCADA system. Sludge pumps were replaced and hooked into the Trac Vac system that pulls sludge out of the sedimentation basins.

Combined, Bellvue and Boyd can treat a maximum of 70-73 million gallons per day.

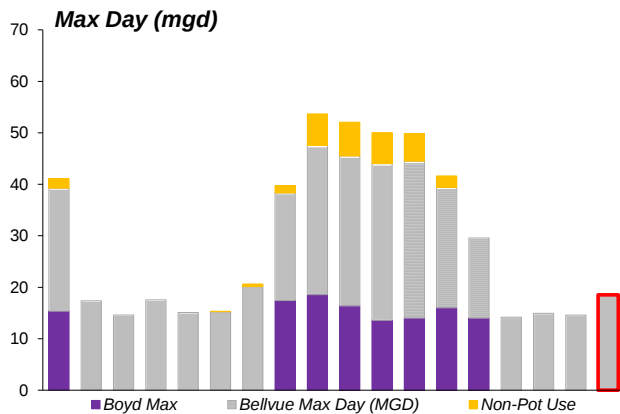

Starting May 2016 Bellvue turbidity measurements will use a new method resulting in more accurate readings.

*Turbidity limit: 95% of samples must be below 0.3 NTU.

Turbidity is the measure of relative clarity of a liquid. Clarity is important when producing drinking water for human consumption and in many manufacturing uses. Turbidity is measured in Nephelometric Turbidity Units (NTU).








Wastewater Treatment

The Water Pollution Control Facility (WPCF) staff are dedicated environmental professionals who provide quality, safe and cost-effective wastewater treatment services for the citizens of Greeley. The WPCF treats wastewater to meet or exceed Environmental Protection Agency (EPA) and Colorado Department of Public Health & Environment requirements.

In 2011, the WPCF received an Xcel Energy Custom Efficiency Achievement Award for saving 2.78 million kWh and reducing CO2 emissions by 1,584 tons. In 2012, the WPCF received the Rocky Mountain Water Environment Association's (RMWEA) Sustainability Award for Colorado demonstrating excellence in programs that enhanced the principles of sustainability. A Certificate of Achievement from the Colorado Industrial Energy Challenge program managed through the Colorado Energy Office was received in the same year. In 2013, the plant received the City of Greeley's Environmental Stewardship Award for outstanding efforts to reduce energy (watts), conserve energy and water, reduce air and water pollution, and educate and encourage others to be environmental stewards. Also, in 2013, the plant was the recipient of a Bronze Award from the Colorado Environmental Leadership Program. In 2015, after having 5 years without a plant violation, the plant received the 2015 National Association of Clean Water Agencies (NACWA) Platinum Peak Performance award for the City of Greeley Water and Sewer Department.

Note: the red column indicates the current month.

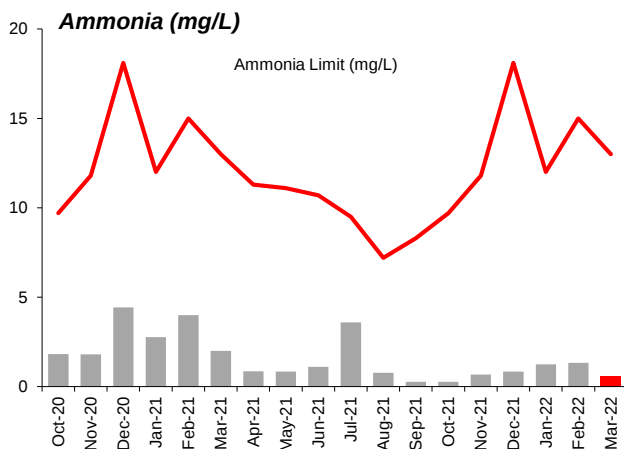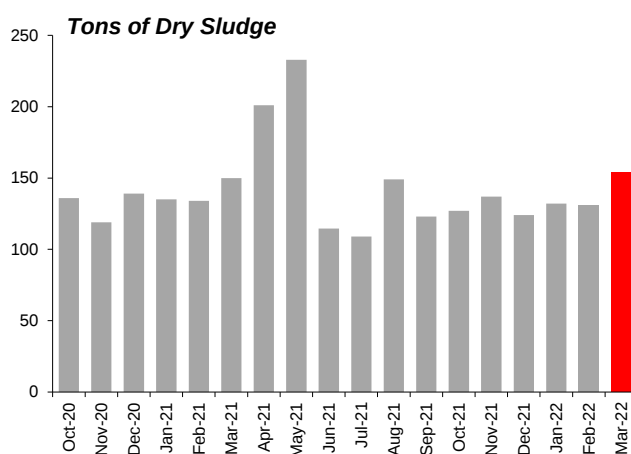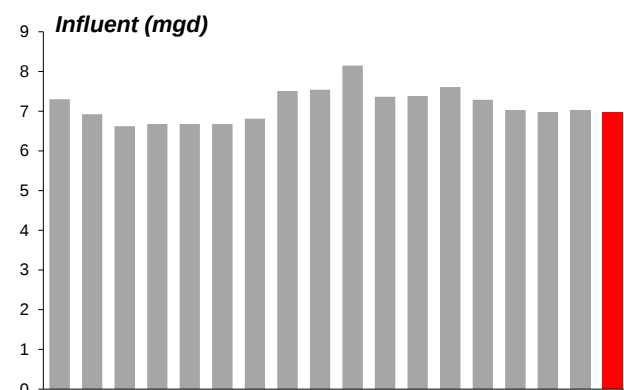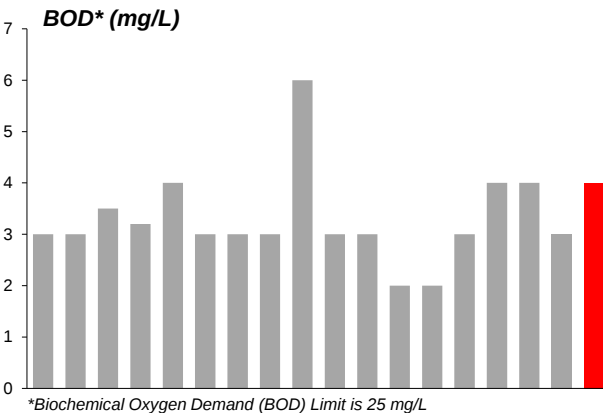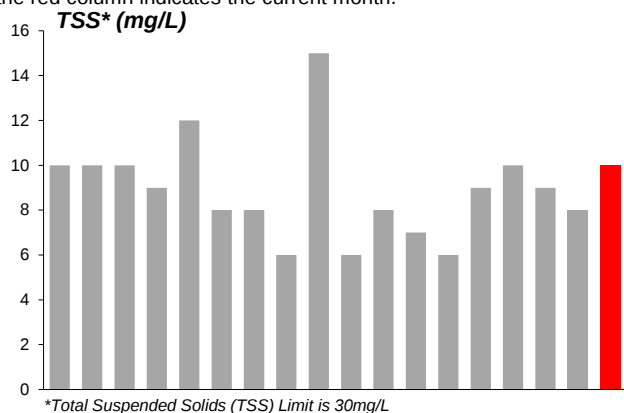






Water Distribution

The Greeley water distribution system consists of various sizes of pipes that generally follow the streets within the City. The distribution system serves residences and businesses in Greeley, Evans and Garden City, and the system is divided into four pressure zones.

There are 69.75 million gallons of potable water storage in Greeley. The water is stored within three covered reservoirs and one elevated tank; 23rd Avenue - 37.5 million gallons, Mosier Hill - 15 million gallons, and Gold Hill - 15 million gallons. The system also has 476 miles of pipeline, 24,233 water meters and 3,378 fire hydrants.

The water pipes in the distribution system vary in size from 4" to 36". Pipe material is steel, ductile iron, cast iron, or polyvinyl chloride. The age of the pipes varies from the 1890's to new installations.

Note: the red column indicates the current month.

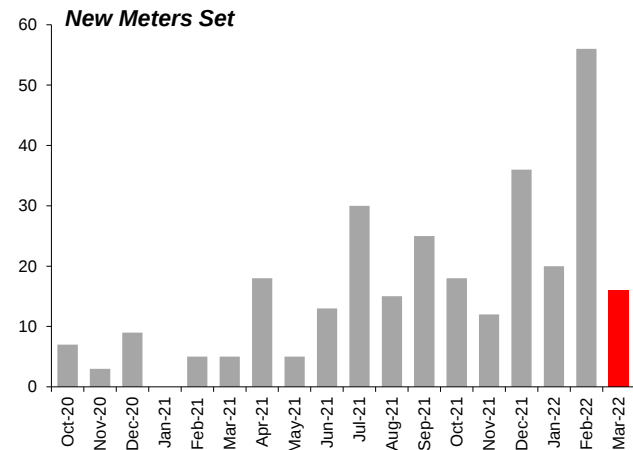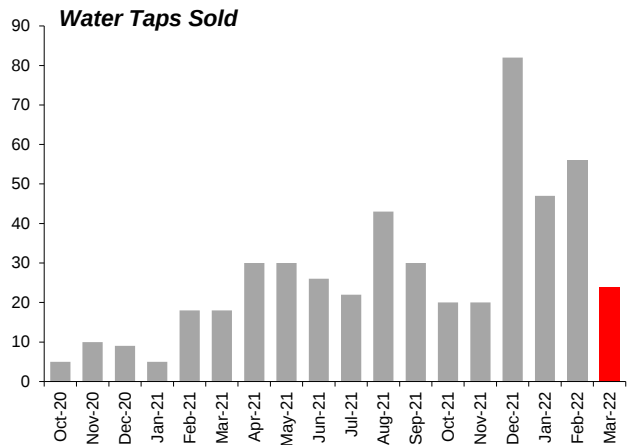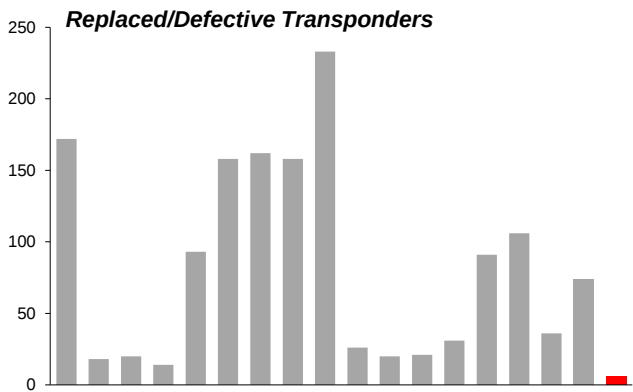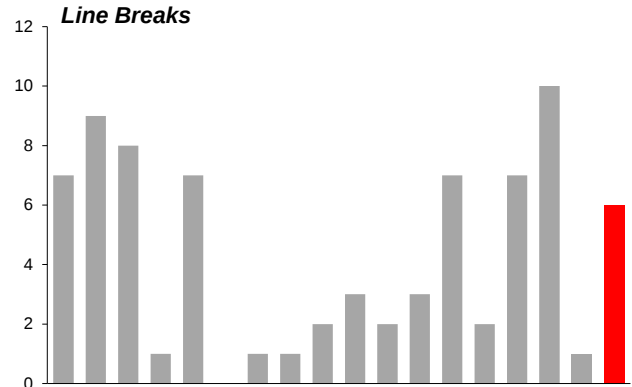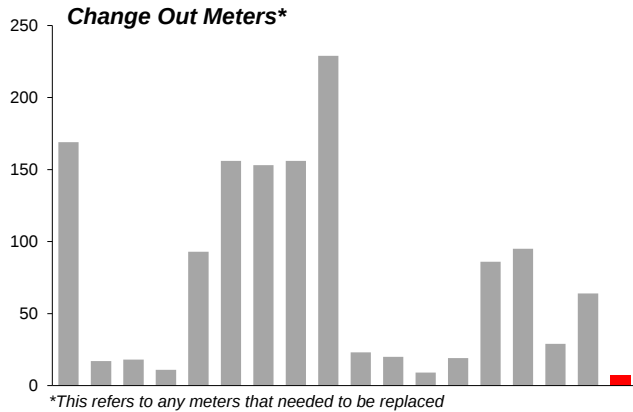

Wastewater Collection


The mission of the Wastewater Collection Division of the Water and Sewer Department is to protect community health by transporting wastewater away from homes and businesses. This includes respecting property values and public safety by reducing the frequency of blockages in the sanitary sewer lines.

A wide variety of work is performed including routine cleaning of sewer lines, inspection of sewer lines, maintenance of the sewage pumping stations, rehabilitation of the system and responding to emergencies.


The wastewater collection system dates back to 1889. At the end of 2017, the system had a total of 364.8 miles of line and 10 sewage pumping stations. The sewer service area is approximately 51 square miles. Over the last 10 years, the system has grown by 17 miles.

Note: the red column indicates the current month.


No. Calls*

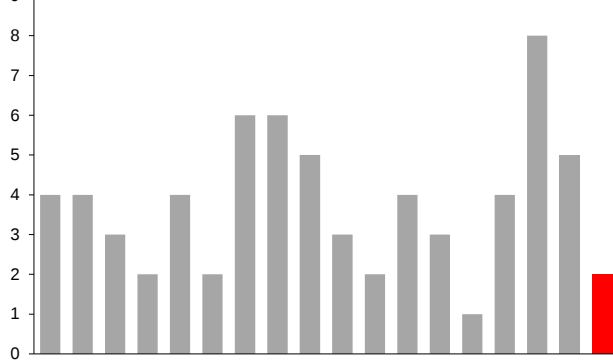


Sewer Taps Sold

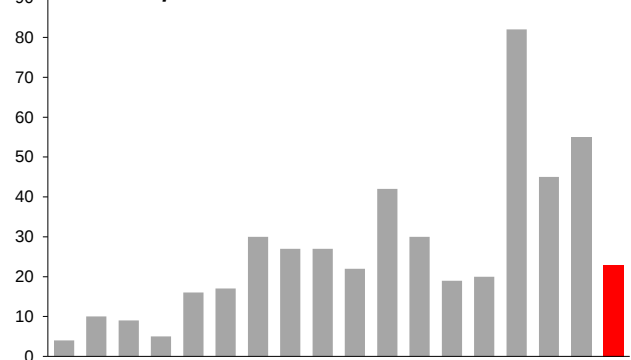

Feet of Televised Sewer Pipe

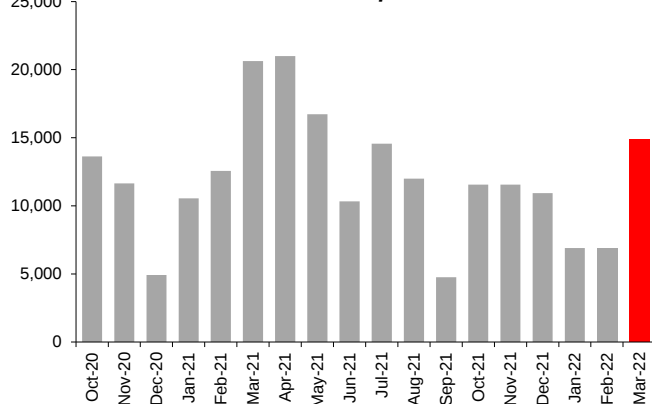

Feet of Cleaned Sewer Pipe





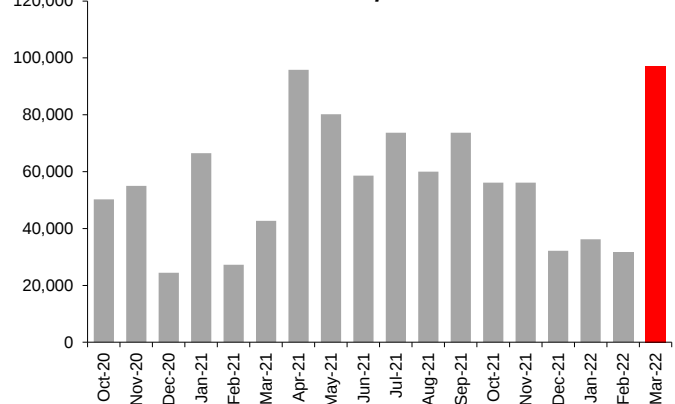


Water Resources


Greeley has numerous water rights in four river basins; the Upper Colorado River, Cache La Poudre, Big Thompson and Laramie River. The Water Resource staff must account for all of this water and comply with the rules of the Colorado Water Court and the State Engineer's Office which is in charge of allocating all of Colorado's water resources. Approximately one-third of the City's water supply comes from agricultural water rights. These water rights must be formally changed to municipal use by a special legal process through the Water Court. In this court, Water Resource staff and attorneys also defend the City's water rights against adverse claims from other parties.

Greeley's goal is to have enough water in carry-over storage to sustain Greeley through a 50-year critical drought. Water in excess of this carry-over drought supply can be leased to agriculture, both for revenue and to support our local agricultural community. Modeling has shown that, given existing population and demand factors, Greeley will have sufficient water for citizens, if at the beginning of the 6-year long, 50-year critical drought, there is 20,000 acre-feet in storage on April 1st of the following year.

Note: the red column indicates the current month.

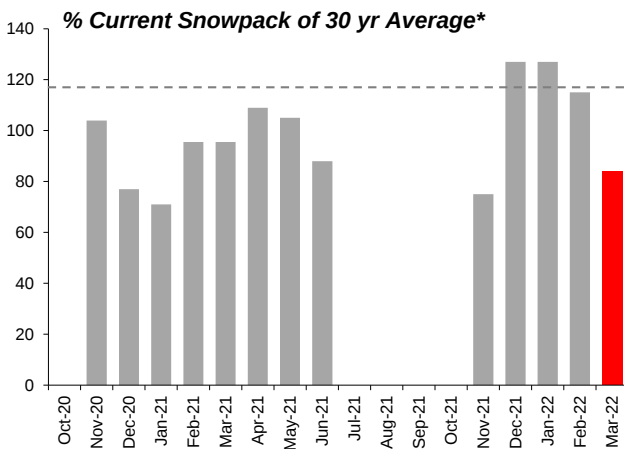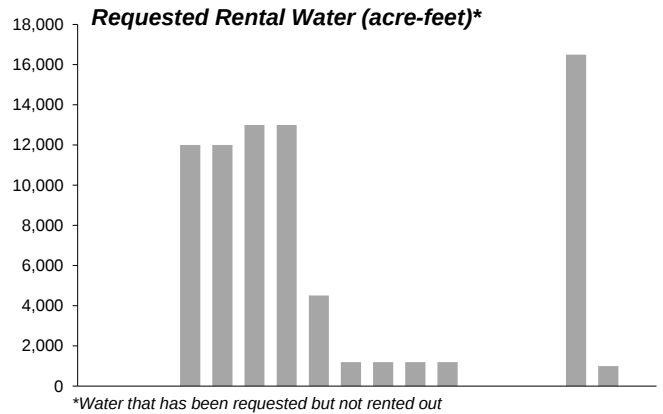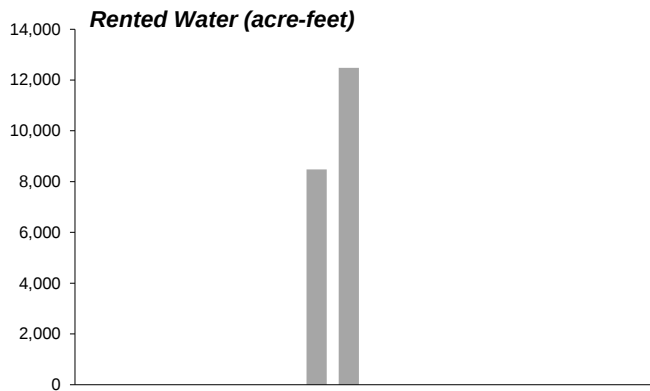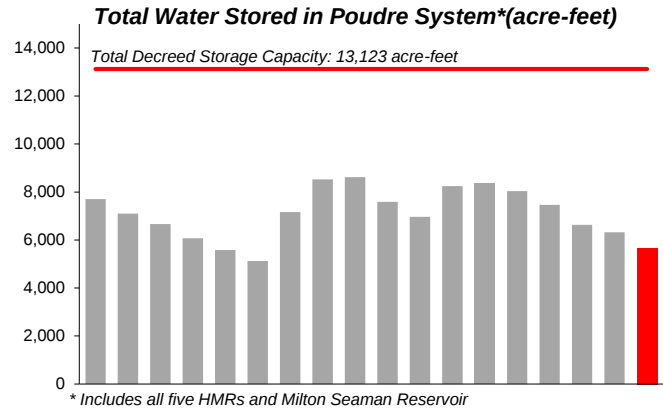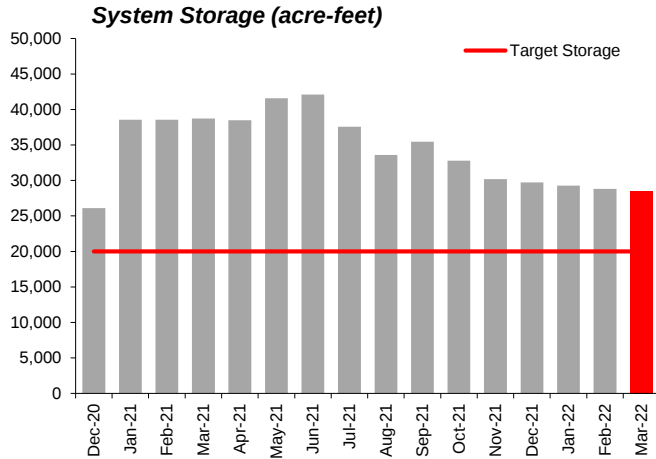

*Data is from the 1st of the month
 **Average of Deadman Hill and Joe Wright






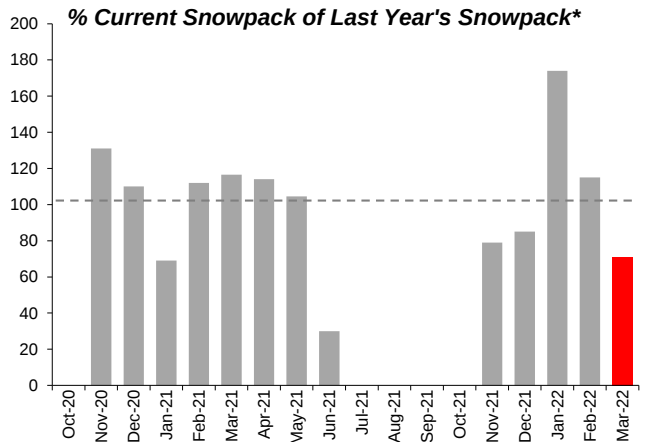


*Data is from the 1st of the month
 **Average of Deadman Hill and Joe Wright

Treated Water and Weather Data

January 2022 average temperature was 24.38°F, approximately 2.8°F cooler than average. February also brought colder temperatures averaging 25.23°F. In March the average temperature was 38.94°F, slightly cooler than the historical average.

Greeley precipitation was 0.79 inches in January, which is slightly above average (0.43 inches). February had high precipitation at 0.93 inches. March brought 1.07 inches of precipitation, setting Greeley 1.23 inches over the historical cumulative precipitation for March.

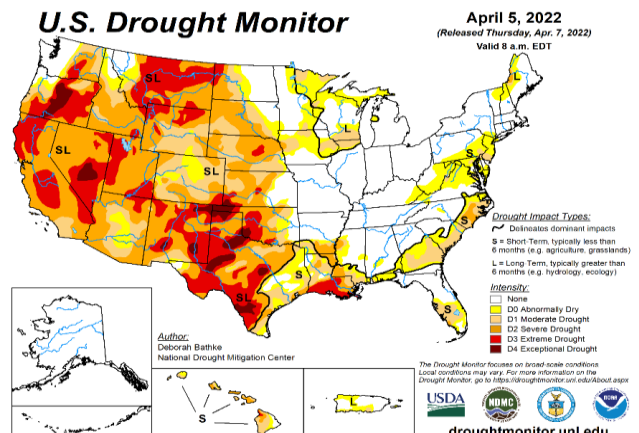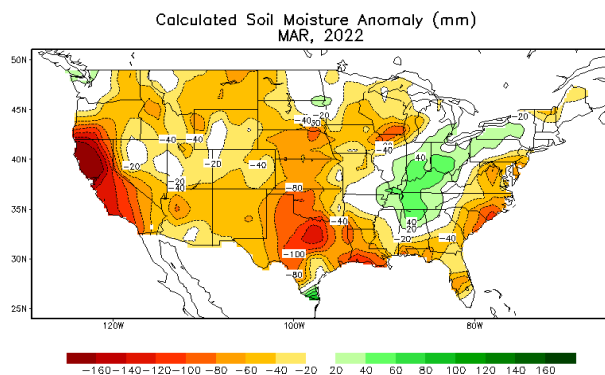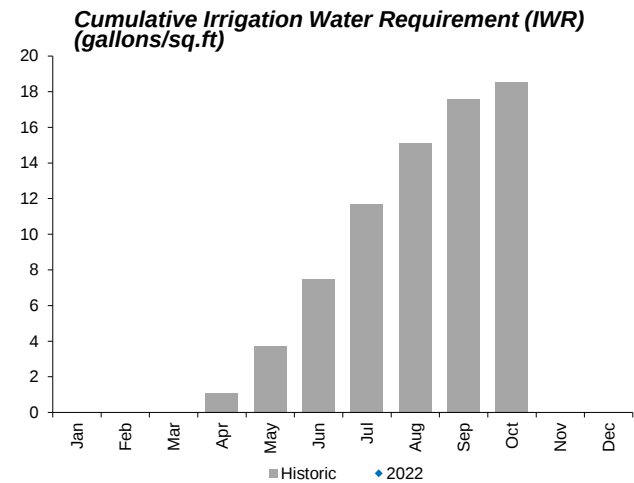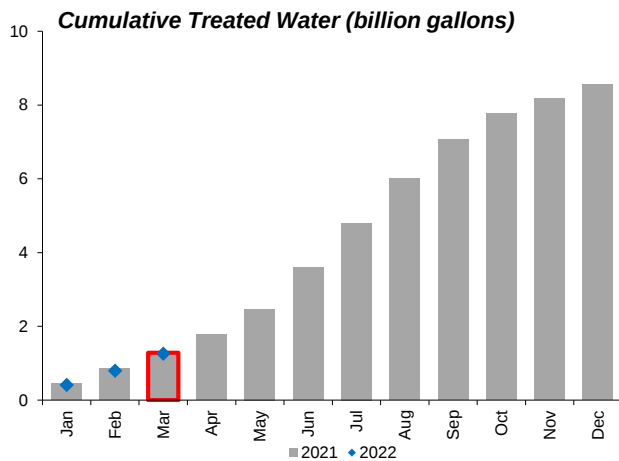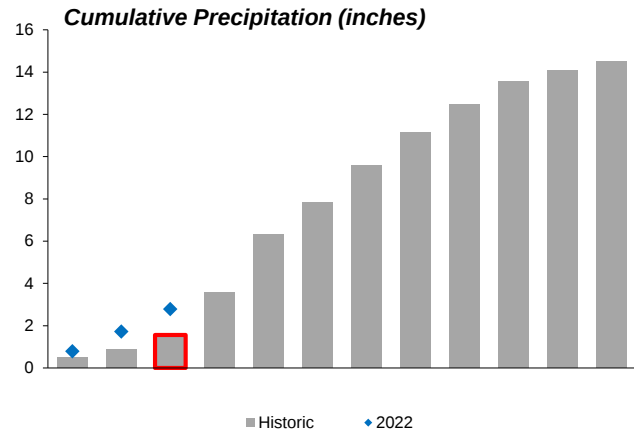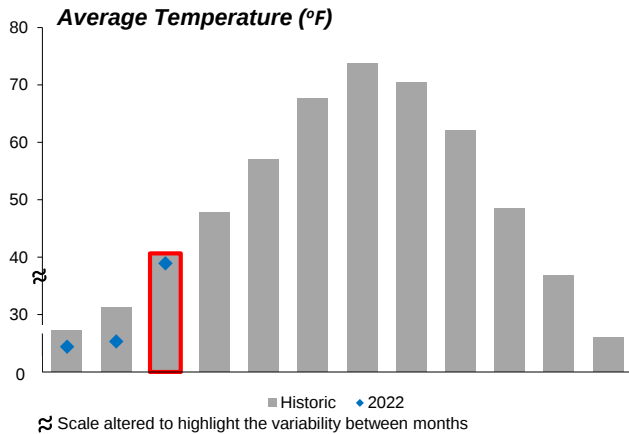

2015 Conservation Program Summary

Month	Residential Audit Requests (indoor/outdoor)	Residential Completed Outdoor Audits	Commercial & Residential Indoor Audits	Commercial Completed Outdoor Audits	Commercial Rebates (indoor/outdoor)	Residential Outdoor Rebates	Residential Toilet Rebates	Residential Washer Rebates	Variances	Violations	Rebate \$ Spent per month
January	45	0	20	0	0	1	12	20	8	0	\$2,618.00
February	33	0	24	0	33	1	11	12	8	0	\$4,498.00
March	63	0	29	0	9	3	30	20	10	0	\$4,185.50
April	58	19	20	1	0	7	25	22	23	14	\$3,975.00
May	32	32	2	4	1	7	11	12	34	25	\$3,354.00
June	47	38	7	6	1	9	24	14	42	51	\$3,625.00
July	30	69	14	14	5	18	20	4	32	145	\$4,151.15
August	29	28	0	6	3	3	13	5	34	71	\$6,521.84
September	16	36	5	8	1	25	18	4	37	19	\$3,079.59
October	19	14	30	2	2	12	17	1	31	7	\$4,604.68
November	8	0	5	0	4	8	20	2	25	0	\$3,339.61
December	2	0	8	0	0	3	21	6	23	0	\$2,432.80
TOTAL	382	236	164	41	59	97	222	122	307	332	\$46,385.17

2014 Conservation Program Summary

Month	Residential Audit Requests (indoor/outdoor)	Residential Completed Outdoor Audits	Commercial & Residential Indoor Audits	Commercial Completed Outdoor Audits	Commercial Rebates (indoor/outdoor)	Residential Outdoor Rebates	Residential Toilet Rebates	Residential Washer Rebates	Variances	Violations	Rebate \$ Spent per month
January	34	0	1	0	1	6	21	33	8	0	\$6,209.86
February	40	0	4	0	1	2	6	33	8	0	\$4,350.00
March	176	0	19	0	1	11	18	28	8	0	\$5,067.78
April	176	37	13	2	33	1	14	21	19	15	\$14,940.00
May	16	62	0	2	6	3	14	38	42	29	\$5,409.25
June	11	38	1	6	2	8	16	27	49	33	\$4,358.97
July	6	39	1	6	46	11	12	21	39	30	\$6,038.32
August	6	54	0	2	12	8	15	26	29	34	\$7,602.82
September	9	11	2	5	3	9	13	28	27	16	\$9,679.98
October	16	5	7	3	1	1	6	15	20	2	\$2,136.50
November	30	0	12	0	0	0	9	13	15	0	\$1,975.00
December	12	0	13	0	2	1	28	31	14	0	\$6,115.00
TOTAL	532	246	73	26	108	61	172	314	278	159	\$73,883.48

2013 Conservation Program Summary

Month	Residential Audit Requests (indoor/outdoor)	Residential Completed Outdoor Audits	Commercial & Residential Indoor Audits	Commercial Completed Outdoor Audits	Commercial Rebates (indoor/outdoor)	Residential Outdoor Rebates	Residential Toilet Rebates	Residential Washer Rebates	Variances	Violations	Rebate \$ Spent per month
January	5		2				24	25	8		\$4,675.00
February	33		7		1		22	22	8		\$3,575.00
March	22	2	4				21	18	10		\$3,025.00
April	19	9	4	2	1		25	36	23	6	\$5,025.00
May	65	45	5	1		19	20	32	59	21	\$4,486.59
June	11	27	3	14	0	5	7	15	89	61	\$2,217.20
July	40	42	0	3	0	13	24	53	80	59	\$8,413.75
August	23	34	0	10	4	15	15	33	60	40	\$8,336.26
September	13	28	1	7	7	6	19	49	55	21	\$13,523.16
October	39	12	19	3	11	6	22	39	44	5	\$7,344.95
November	4	0	12	0	0	9	19	30	28	0	\$4,966.14
December	0	0	4	0	3	1	29	46	27	0	\$7,639.49
TOTAL	274	199	61	40	27	74	247	398	491	213	\$73,227.54

2012 Conservation Program Summary

Month	Residential Audit Requests (indoor/outdoor)	Residential Completed Outdoor Audits	Commercial & Residential Indoor Audits	Commercial Completed Outdoor Audits	Commercial Rebates (indoor/outdoor)	Residential Outdoor Rebates	Residential Toilet Rebates	Residential Washer Rebates	Variances	Violations	Rebate \$ Spent per month
January	2		26		3		30	24	7		\$7,834.98
February	3		15				20	16	7		\$3,100.00
March	2		2		1		27	23	10	1	\$4,225.00
April	33	4		4		48	19	14	67	17	\$3,175.75
May	38	39	2	5	5	1	23	35	113	46	\$19,492.77
June	27	27	1	4	28	26	37	22	113	51	\$34,368.61
July	32	23	1	8	1	48	26	27	84	67	\$5,414.00
August	12	25	6	4	9	21	39	30	73	38	\$13,749.95
September	18	41	5	1		1	48	21	87	12	\$5,634.21
October	7	8	2	2		3	40	18	67	3	\$4,858.25
November	15		9		3		39	26	41	1	\$7,106.00
December	4		4		2	1	43	44	36		\$9,829.11
TOTAL	193	167	73	28	52	149	391	300	705	236	\$118,788.63

Date	X-charge (F or Larger) Meters Changed	Amount Previous Month Meters	Radio Transmitter Replacement (Exclusive of Meters Set)	New Construction Meters Set	Small (10-15 Meters) Change Meters	Large (16-25 Meters) Change Meters	Number of Line Breaks	Water Taps Set	Total change net meters
Jun-09	0	0	238	13	42	1	23	2	22
Jul-09	0	0	186	8	37	1	37	1	13
Aug-09	13	1	142	10	68	2	23	1	13
Sep-09	0	1	124	7	60	0	23	1	13
Oct-09	0	0	99	2	35	1	4	1	13
Nov-09	2	0	144	13	53	1	11	1	13
Dec-09	0	1	71	0	34	3	9	1	13
Jan-10	0	0	123	5	53	1	11	1	13
Feb-10	0	0	87	14	51	0	11	1	13
Mar-10	0	0	83	1	35	0	11	1	13
Apr-10	0	1	85	13	21	3	11	1	13
May-10	1	1	112	1	9	74	5	11	13
Jun-10	0	0	144	13	53	1	11	1	13
Aug-10	0	0	124	10	63	0	11	1	13
Sep-10	0	0	123	5	79	0	11	1	13
Oct-10	0	0	87	4	36	0	11	1	13
Nov-10	0	0	123	5	79	0	11	1	13
Dec-10	2	2	127	5	29	3	9	1	13
Jan-11	1	0	121	1	37	0	11	1	13
Feb-11	3	0	124	0	69	0	11	1	13
Mar-11	0	0	124	4	69	0	11	1	13
Apr-11	0	7	124	0	50	1	11	1	13
May-11	0	0	124	4	77	1	11	1	13
Jun-11	0	5	163	7	63	1	11	1	13
Jul-11	0	1	140	1	6	0	11	1	13
Aug-11	0	1	128	0	79	4	11	1	13
Sep-11	0	0	177	1	9	1	11	1	13
Oct-11	0	0	84	0	12	0	11	1	13
Nov-11	0	0	84	0	12	0	11	1	13
Dec-11	0	0	84	1	28	0	11	1	13
Jan-12	0	0	84	1	35	0	11	1	13
Feb-12	4	1	124	4	45	0	11	1	13
Mar-12	0	0	124	4	45	0	11	1	13
Apr-12	0	2	124	5	68	0	11	1	13
May-12	0	5	127	8	104	1	11	1	13
Jun-12	0	0	127	8	64	1	11	1	13
Jul-12	1	1	127	11	80	2	11	1	13
Aug-12	0	2	127	10	70	1	11	1	13
Sep-12	0	2	127	3	46	3	11	1	13
Oct-12	0	2	99	4	36	3	11	1	13
Nov-12	0	2	99	3	46	3	11	1	13
Dec-12	4	0	88	3	20	4	11	1	13
Jan-13	0	2	121	6	4	89	11	1	13
Feb-13	0	1	121	7	27	1	11	1	13
Mar-13	0	0	121	4	34	0	11	1	13
Apr-13	0	1	127	0	46	0	11	1	13
May-13	0	0	124	46	77	1	11	1	13
Jun-13	0	0	103	16	31	0	11	1	13
Jul-13	0	0	109	23	36	0	11	1	13
Aug-13	2	2	109	22	56	3	11	1	13
Sep-13	0	0	121	8	60	0	11	1	13
Oct-13	0	1	111	15	44	1	11	1	13
Nov-13	0	0	87	7	73	0	11	1	13
Dec-13	9	1	121	17	22	0	11	1	13
Jan-14	0	0	121	20	55	0	11	1	13
Feb-14	0	0	121	25	50	0	11	1	13
Mar-14	0	0	121	25	50	0	11	1	13
Apr-14	0	3	177	12	40	8	11	1	13
May-14	1	1	141	17	46	38	0	11	13
Jun-14	0	0	141	46	38	0	11	1	13
Jul-14	0	0	141	46	38	0	11	1	13
Aug-14	0	0	141	46	38	0	11	1	13
Sep-14	3	0	141	46	38	0	11	1	13
Oct-14	0	0	141	46	38	0	11	1	13
Nov-14	0	0	141	46	38	0	11	1	13
Dec-14	2	2	127	40	26	1	11	1	13
Jan-15	0	2	127	17	33	0	11	1	13
Feb-15	0	2	124	47	36	0	11	1	13
Mar-15	0	2	124	47	36	0	11	1	13
Apr-15	0	1	124	52	39	0	11	1	13
May-15	0	2	124	52	39	0	11	1	13
Jun-15	0	2	124	52	39	0	11	1	13
Jul-15	0	0	124	52	39	0	11	1	13
Aug-15	0	0	124	52	39	0	11	1	13
Sep-15	0	0	124	52	39	0	11	1	13
Oct-15	0	0	124	52	39	0	11	1	13
Nov-15	0	0	124	52	39	0	11	1	13
Dec-15	0	0	124	52	39	0	11	1	13
Jan-16	0	0	124	52	39	0	11	1	13
Feb-16	0	0	124	52	39	0	11	1	13
Mar-16	0	0	124	52	39	0	11	1	13
Apr-16	0	0	124	52	39	0	11	1	13
May-16	0	1	124	52	39	0	11	1	13
Jun-16	0	1	124	52	39	0	11	1	13
Jul-16	0	1	124	52	39	0	11	1	13
Aug-16	0	1	124	52	39	0	11	1	13
Sep-16	3	0	124	52	39	0	11	1	13
Oct-16	0	0	124	52	39	0	11	1	13
Nov-16	0	0	124	52	39	0	11	1	13
Dec-16	0	1	124	52	39	0	11	1	13
Jan-17	0	0	124	52	39	0	11	1	13
Feb-17	0	0	124	52	39	0	11	1	13
Mar-17	0	1	124	52	39	0	11	1	13
Apr-17	0	0	124	52	39	0	11	1	13
May-17	0	0	124	52	39	0	11	1	13
Jun-17	0	0	124	52	39	0	11	1	13
Jul-17	0	0	124	52	39	0	11	1	13
Aug-17	0	0	124	52	39	0	11	1	13
Sep-17	0	0	124	52	39	0	11	1	13
Oct-17	2	2	124	52	39	0	11	1	13
Nov-17	0	0	124	52	39	0	11	1	13
Dec-17	0	0	124	52	39	0	11	1	13
Jan-18	0	0	124	52	39	0	11	1	13
Feb-18	0	0	124	52	39	0	11	1	13
Mar-18	0	0	124	52	39	0	11	1	13
Apr-18	0	0	124	52	39	0	11	1	13
May-18	2	0	124	52	39	0	11	1	13
Jun-18	0	0	124	52	39	0	11	1	13
Jul-18	0	0	124	52	39	0	11	1	13
Aug-18	0	0	124	52	39	0	11	1	13
Sep-18	0	1	124	52	39	0	11	1	13
Oct-18	0	0	124	52	39	0	11	1	13
Nov-18	0	0	124	52	39	0	11	1	13
Dec-18	3	0	124	52	39	0	11	1	13
Jan-19	0	0	124	52	39	0	11	1	13
Feb-19	0	0	124	52	39	0	11	1	13
Mar-19	0	0	124	52	39	0	11	1	13
Apr-19	0	5	124	52	39	0	11	1	13
May-19	0	3	124	52	39	0	11	1	13
Jun-19	0	0	124	52	39	0	11	1	13
Jul-19	0	0	124	52	39	0	11	1	13
Aug-19	0	2	141	0	62	1	11	1	13
Sep-19	0	0	124	52	39	0	11	1	13
Oct-19	0	0	124	52	39	0	11	1	13
Nov-19	0	0	124	52	39	0	11	1	13
Dec-19	0	0	124	52	39	0	11	1	13
Jan-20	0	0	124	52	39	0	11	1	13
Feb-20	0	0	124	52	39	0	11	1	13
Mar-20	0	0	124	52	39	0	11	1	13
Apr-20	0	0	124	52	39	0	11	1	13
May-20	0	0	124	52	39	0	11	1	13
Jun-20	0	0	124	52	39	0	11	1	13
Jul-20	0	0	124	52	39	0	11	1	13
Aug-20	0	0	124	52	39	0	11	1	13
Sep-20	0	0	124	52	39	0	11	1	13
Oct-20	0	0	124	52	39	0	11	1	13
Nov-20	0	0	124	52	39	0	11	1	13
Dec-20	0	0	124	52	39	0	11	1	13
Jan-21	0	0	124	52	39	0	11	1	13
Feb-21	0	0	124	52	39	0	11	1	13
Mar-21	0	0	124	52	39	0	11	1	13
Apr-21	0	0	124	52	39	0	11	1	13
May-21	0	0	124	52	39	0	11	1	13
Jun-21	0	0	124	52	39	0	11	1	13
Jul-21	0	0	124	52	39	0	11	1	13
Aug-21	0	0	124	52	39	0	11	1	13
Sep-21	0	0	124	52	39	0	11	1	13
Oct-21	0	0	124	52	39	0	11	1	13
Nov-21	0	0	124	52	39	0	11	1	13
Dec-21	0	0	124	52	39	0	11	1	13
Jan-22	0	0	124	52	39	0	11	1	13
Feb-22	0	0	124	52	39	0	11	1	13
Mar-22	0	0	124	52	39	0	11	1	13
Apr-22	0	0	124	52	39	0	11	1	13

[illegible]

Date	Boyd Max Day (MGD)	Bellvue Max Day (MGD)	Non-potable Use (MGD)	Boyd Avg Day (MGD)	Bellvue Avg Day (MGD)	Boyd Turbidity
Jan-94						
Feb-94						
Mar-94						
Apr-94						
May-94						
Jun-94						
Jul-94						
Aug-94						
Sep-94						
Oct-94						
Nov-94						
Dec-94						
Jan-95		14.34			13.466	
Feb-95		14.42			13.774	
Mar-95		16.79			14.982	
Apr-95	8.95	18.91		5.27	15.85	0.20
May-95	7.69	19.09		4.69	15.57	0.17
Jun-95	16.42	18.68		10.58	16.97	0.21
Jul-95	25.80	18.71		18.19	18.09	0.25
Aug-95	24.93	19.06		21.43	18.81	0.20
Sep-95	21.44	18.93		14.88	17.98	0.21
Oct-95	7.85	18.02		5.33	16.80	0.17
Nov-95		14.30			13.94	
Dec-95		14.31			13.66	
Jan-96		14.78			13.65	
Feb-96		15.24			14.32	
Mar-96		15.86			14.69	
Apr-96	15.04	18.22		7.40	17.49	0.23
May-96	23.30	18.93		14.94	18.48	0.22
Jun-96	19.33	19.09		13.79	19.14	0.10
Jul-96	24.31	19.34		14.61	18.97	0.14
Aug-96	22.21	19.22		16.89	19.24	0.20
Sep-96	17.37	19.17		10.34	17.79	0.20
Oct-96	11.26	17.70		8.37	16.56	0.21
Nov-96	4.18	13.89		3.51	13.77	0.27
Dec-96		13.87			13.41	
Jan-97	2.15	14.03		1.78	13.93	0.19
Feb-97	2.06	14.02		1.72	13.63	0.16
Mar-97	6.44	13.82		1.21	13.97	0.13
Apr-97	13.78	13.87		3.72	13.29	0.23
May-97	20.71	18.79		11.89	16.64	0.15
Jun-97	20.53	18.60		10.69	18.23	0.18
Jul-97	27.58	18.77		21.75	18.72	0.21
Aug-97	19.30	19.09		11.37	17.64	0.18
Sep-97	18.63	18.92		10.77	18.56	0.16
Oct-97	12.89	18.90		6.04	16.91	0.14
Nov-97	4.35	12.57		1.89	12.27	0.15
Dec-97	2.805	12.44		1.13	12.371	0.15
Jan-98	2.96	14.97		1.06	12.573	0.15
Feb-98		16.975			14.245	
Mar-98		16.825			14.179	

Apr-98	11.169	19.335		2.623	17.27	0.15
May-98	23.399	19.53		11.905	18.229	0.13
Jun-98	27.656	19.65		16.175	18.783	0.13
Jul-98	28.074	19.68		22.912	19.43	0.13
Aug-98	22.37	19.69		17.549	19.69	0.13
Sep-98	22.607	19.69		15	19.724	0.13
Oct-98	11.661	19.73		6.529	16.986	0.13
Nov-98		15.46			14.633	
Dec-98		15.488			13.572	
Jan-99		17.623			15.529	
Feb-99		14.637			14.428	
Mar-99		19.909			16.63	
Apr-99	9.323	19.72		6.388	17.794	14
May-99	17.507	19.267		8.925	17.358	15
Jun-99	25.779	19.784		16.33	19.329	0.13
Jul-99	26.837	19.784		20.924	19.62	0.15
Aug-99	21.564	19.645		13.971	19.551	0.13
Sep-99	14.824	16.431		10.666	17.016	0.14
Oct-99	9.087	18.07		6.046	16.52	0.14
Nov-99	0	19.501		0	16.785	0
Dec-99	0	16.751		0	14.789	0
Jan-00	0	17.046		0	14.819	0
Feb-00	0	17.229		0	15.469	0
Mar-00	0	18.941		0	15.94	0
Apr-00	13.575	19.852		8.131	19.249	0.1
May-00	21	20.338		13.509	20.415	0.11
Jun-00	25.6	20.606		19.012	20.03	0.11
Jul-00	28.5	21.048		24.636	20.962	0.11
Aug-00	27.5	21.009		19.94	21.057	0.12
Sep-00	21.59	20.45		14.537	19.642	0.12
Oct-00	8.212	19.249		7.457	17.211	0.13
Nov-00	2.549	17.222		2.549	15.115	0.13
Dec-00	0	15.918		0	14.723	0
Jan-01	0	17.289		0	15.077	0
Feb-01	0	16.988		0	15.226	0
Mar-01	0	16.612		0	14.794	0
Apr-01	7.527	18.315		5.828	17.416	0.1
May-01	21.828	19.569		12.637	17.989	0.13
Jun-01	29.68	20.203		19.746	18.337	0.12
Jul-01	26.504	20.321		18.571	20.645	0.11
Aug-01	23.507	21.067		19.564	21.064	0.12
Sep-01	21.65	21.04		14.726	18.619	0.11
Oct-01	16.528	16.966		7.506	17.24	0.1
Nov-01	6.807	17.13		3.931	10.884	0.09
Dec-01	0	16.503		0	14.812	0
Jan-02	0	15.915		0	15.128	0
Feb-02	0	16.106		0	15.263	0
Mar-02	0	17.761		0	13.61	0
Apr-02	18.789	20.099		10.076	17.764	0.12
May-02	19.722	20.45		13.126	19.332	0.07
Jun-02	23.429	20.352		18.534	19.115	0.06
Jul-02	23.485	20.161		17.685	21.422	0.07
Aug-02	21.349	20.63		15.841	20.792	0.06
Sep-02	18.951	20.841		11.709	20.184	0.06
Oct-02	7.964	20.052		5.804	18.265	0.07

Nov-02	0	16.132		0	14.3	0
Dec-02	0	14.906		0	14.117	0
Jan-03	0	14.945		0	13.57	0
Feb-03	0	13.845		0	13.523	0
Mar-03	0	16.312		0	13.982	0
Apr-03	0	17.004		0	15.862	0
May-03	16.115	20.96		7.205	17.739	0.09
Jun-03	17.903	19.575		10.342	18.745	0.07
Jul-03	26.234	20.005		20.079	20.009	0.1
Aug-03	24.605	20.101		18.22	19.818	0.12
Sep-03	16.53	18.314		11.114	17.294	0.1
Oct-03	13.097	17.255		9.225	17.281	0.08
Nov-03	0	16.038		0	14.044	0
Dec-03	0	14.71		0	13.76	0
Jan-04	0	17.606		0	15.278	0
Feb-04	0	13.475		0	13.335	0
Mar-04	0	18.121	0.25	0	15.686	0
Apr-04	11.668	18.718	0.79	5.321	16.759	0.09
May-04	22.873	20.104	1.74	10.757	18.954	0.07
Jun-04	23.094	20.764	2.56	15.192	18.279	0.07
Jul-04	26.048	20.992	3.50	17.016	19.477	0.1
Aug-04	24.976	19.746	2.84	16.168	18.452	0.08
Sep-04	18.342	18.585	2.31	11.99	18.118	0.07
Oct-04	6.46	16.472	0.95	4.084	16.36	0.08
Nov-04	0	15.761	0.08	0	14.228	0
Dec-04	0	15.825	0.00	0	13.988	0
Jan-05	0	15.036	0.00	0	13.673	0
Feb-05	0	14.279	0.00	0	13.854	0
Mar-05	0	16.093	0.15	0	14.399	0
Apr-05	9.305	20.018	1.04	6.689	17.992	0.09
May-05	26.423	17.759	2.03	15.825	16.465	0.07
Jun-05	31.265	16.375	3.57	19.271	16.224	0.07
Jul-05	32.332	21.431	4.90	27.932	19.687	0.09
Aug-05	29.14	21.388	3.29	20.526	19.102	0.07
Sep-05	26.33	18.031	4.20	18.734	17.994	0.09
Oct-05	18.239	18.174	1.16	9.619	16.352	0.08
Nov-05	0	14.134	0.04	0	13.199	0
Dec-05	0	13.538	0.00	0	12.763	0
Jan-06	0	13.755	0.00	0	13.027	0
Feb-06	0	15.102	0.00	0	13.366	0
Mar-06	0	16.536	0.05	0	14.2	0
Apr-06	14.918	20.862	2.19	9.518	19.581	0.08
May-06	23.056	22.303	4.35	15.372	21.788	0.05
Jun-06	30.967	22.129	6.63	23.521	22.212	0.06
Jul-06	25.026	21.94	5.46	19.51	21.132	0.05
Aug-06	23.187	20.586	4.73	16.835	20.641	0.05
Sep-06	16.918	20.364	3.05	10.493	20.317	0.05
Oct-06	13.269	20.596	1.12	10.882	16.98	0.05
Nov-06	0	14.019	0.00	0	13.202	0
Dec-06	0	14.052	0.00	0	13.183	0
Jan-07	0	15.628	0.00	0	13.842	0
Feb-07	0	15.804	0.00	0	14.607	0
Mar-07	0	16.063	0.06	0	14.721	0
Apr-07	7.8	19.658	0.81	5.983	17.81	0.07
May-07	18.33	20.818	3.34	10.653	20.821	0.06

Jun-07	27.274	22.929	4.98	19.058	21.593	0.11
Jul-07	28.737	22.954	5.81	22.585	22.752	0.12
Aug-07	29.294	22.863	4.05	16.681	21.363	0.08
Sep-07	21.439	20.731	3.36	13.861	21.078	0.08
Oct-07	12.306	21.127	1.19	7.031	14.731	0.09
Nov-07	5.285	15.979	-0.01	3.892	14.233	0.1
Dec-07	0	15.253	0.00	0	13.865	0
Jan-08	0	15.491	0.00	0	14.483	0
Feb-08	0	15.191	0.00	0	14.267	0
Mar-08	0	15.976	0.10	0	14.681	0
Apr-08	15.017	19.559	1.32	7.268	16.206	0.12
May-08	20.487	20.889	3.39	12.483	19.861	0.09
Jun-08	23.705	23.012	4.67	17.876	20.917	0.06
Jul-08	25.723	23.391	3.98	20.23	22.919	0.07
Aug-08	23.649	23.305	3.28	15.099	22.35	0.07
Sep-08	11.532	22.523	2.34	8.457	21.906	0.06
Oct-08	10.157	22.012	0.65	8.259	19.069	0.06
Nov-08	0	17.098	0	0	14.352	0
Dec-08	0	15.03	0	0	13.446	0
Jan-09	0	14.258	0	0	13.38	0
Feb-09	0	15.469	0	0	14.057	0
Mar-09	0	17.754	0.21	0	14.986	0
Apr-09	9.422	20.594	0.71	5.509	15.432	0.08
May-09	18.145	23.691	2.72	9.752	20.01	0.06
Jun-09	18.305	23.229	2.85	9.229	20.383	0.05
Jul-09	21.309	23.229	4.12	12.263	20.383	0.05
Aug-09	18.494	21.004	3.89	13.357	19.756	0.05
Sep-09	21.786	20.005	3	12.896	17.464	0.05
Oct-09	9.86	19.001	0.66	7.267	15.545	0.06
Nov-09	0	15.061	0	0	13.163	0
Dec-09	0	14.999	0	0	13.717	0
Jan-10	0	14.478	0	0	13.146	0
Feb-10	0	13.993	0	0	13.193	0
Mar-10	0	14.043	0	0	13.377	0
Apr-10	2.344	20.211	0.76	2.05	16.999	0.07
May-10	12.825	20.967		6.228	19.521	0.06
Jun-10	21.564	21.05	4.35	14.329	20.281	0.05
Jul-10	21.895	22.038	4.92	16.172	21.213	0.06
Aug-10	20.370	22.358	4.86	14.914	22.224	0.06
Sep-10	17.374	22.323	3.96	13.516	22.257	0.06
Oct-10	11.879	22.295	2.02	8.204	19.024	0.06
Nov-10	0	15.036	0	0	13.483	0
Dec-10	0	14.02	0	0	13.464	0
Jan-11	0	16.963	0	0	13.839	0
Feb-11	0	15.1	0	0	13.529	0
Mar-11	0	16.463	0	0	14.22	0
Apr-11	0	20.849	1.21	0	18.391	0
May-11	15.128	22.666	2.07	7.161	19.551	0.07
Jun-11	24.901	22.792	4.7	16.583	20.469	0.06
Jul-11	22.711	22.773	4.99	17.021	20.902	0.07
Aug-11	21.549	22.566	5.62	17.254	22.176	0.08
Sep-11	15.723	22.801	3.56	10.201	22.538	0.08
Oct-11	11.884	22.78	1.52	7.767	19.035	0.07
Nov-11	0	15.292	0	0	13.578	0
Dec-11	0	15.985	0	0	13.554	0

Jan-12	0	14.022	0	0	13.121	0
Feb-12	0	16.073	0	0	13.955	0
Mar-12	0	22.647	0	0	16.553	0
Apr-12	12.599	23.978	2.55	7.126	23.101	0.06
May-12	19.265	23.766	3.76	10.995	22.646	0.06
Jun-12	27.635	23.393	6.13	20.499	21.11	0.05
Jul-12	30.033	23.606	6.16	22.203	19.425	0.04
Aug-12	27.901	17.86	5.75	23.22	16.439	0.07
Sep-12	23.52	21.471	3.49	13.909	18.923	0.06
Oct-12	10.03	18.05	0.44	7.301	15.94	0.06
Nov-12	0	14.6	0	0	13.321	0
Dec-12	0	15.018	0	0	13.301	0
Jan-13	0	13.515	0	0	12.465	0
Feb-13	0	14.576	0	0	12.998	0
Mar-13	0	14.198	0	0	12.879	0
Apr-13	0	17.375	0.25	0	13.893	0
May-13	16.462	23.018	1.79	10.474	19.088	0.08
Jun-13	22.6	23.491	6.02	17.78	23.152	0.06
Jul-13	23.278	23.522	5.46	16.963	22.298	0.05
Aug-13	18.198	23.278	4.36	13.317	22.351	0.05
Sep-13	17.616	23.542	1.76	9.235	16.966	0.05
Oct-13	10.261	16.245	0.38	5.384	14.884	0.07
Nov-13	0	15.567	0	0	14.519	0
Dec-13	0	15.316	0	0	14.269	0
Jan-14	0	15.268	0	0	14.227	0
Feb-14	0	15.275	0	0	14.499	0
Mar-14	0	15.272	0	0	14.009	0
Apr-14	6.16	22.435	1.01	4.087	18.18	0.013
May-14	11.165	23.24	2.08	7.65	20.813	0.07
Jun-14	14.856	23.337	3.58	8.652	23.112	0.06
Jul-14	17.76	23.297	4.24	12.596	23.095	0.05
Aug-14	13.958	23.178	3.7	10.033	22.755	0.07
Sep-14	10.113	23.115	2.91	7.258	22.451	0.07
Oct-14	5.442	23.075	0.72	4.788	17.851	0.08
Nov-14	0	15.06	0	0	13.568	0
Dec-14	0	14.543	0	0	13.175	0
Jan-15	0	14.981	0	0	13.293	0
Feb-15	0	14.1	0	0	13.085	0
Mar-15	0	18.07	0	0	14.493	0
Apr-15	3.419	22.724	0.97	3.045	18.503	0.08
May-15	3.534	20.009	0.78	2.97	16.989	0.05
Jun-15	23.453	19.082	2.62	12.168	16.171	0.04
Jul-15	27.448	16.079	5.42	22.321	16.044	0.04
Aug-15	27.931	16.35	5.37	23.125	16.077	0.05
Sep-15	24.013	19.95	4.52	18.59	16.834	0.05
Oct-15	12.885	18.189	1.06	5.662	15.704	0.05

Nov-15	9.995	13.624	0	5.025	13.417	0.05
Dec-15	0	14.093	0	0	13.564	0
Jan-16	0	15.548	0	0	14.148	0
Feb-16	0	14.937	0	0	13.766	0
Mar-16	0	15.237	0	0	14.215	0
Apr-16	5.387	17.045	0.32	3.635	15.844	0.06
May-16	7.995	17.791	1.13	4.423	19.399	0.05
Jun-16	22.913	21.517	5.14	16.43	20.938	0.05
Jul-16	28.285	21.694	5.65	21.076	21.39	0.05
Aug-16	23.916	21.832	4.36	16.557	20.88	0.06
Sep-16	15.387	20.745	3.62	11.091	20.663	0.05
Oct-16	11.279	21.11	1.2	6.402	19.554	0.06
Nov-16	0	16.476	0	0	14.998	0
Dec-16	0	15.493	0	0	13.973	0
Jan-17	0	18.743	0	0	13.981	0
Feb-17	0	14.486	0	0	13.613	0
Mar-17	0	17.828	0.04	0	14.718	0
Apr-17	12.366	16.574	1.49	8.13	14.773	0.05
May-17	14.532	15.048	1.78	7.766	14.71	0.05
Jun-17	30.34	14.901	5.7	22.824	14.764	0.05
Jul-17	30.868	15.301	5.77	25.978	15.117	0.05
Aug-17	27.455	15.34	3.48	18.351	15.319	0.05
Sep-17	26.548	15.346	3.38	17.801	15.212	0.05
Oct-17	9.683	15.424	0.33	4.119	15.237	0.07
Nov-17	0	15.723	0	0	15.165	0
Dec-17	0	15.65	0	0	14.074	0
Jan-18	0	15.012	0	0	14.071	0
Feb-18	0	15.033	0	0	14.283	0
Mar-18	0	17.312	0.09	0	14.898	0
Apr-18	0	26.317	1.09	0.0	18.511	0
May-18	11.08	28.226	2.70	5.5	23.554	0.06
Jun-18	21.48	27.456	5.97	14.4	26.337	0.04
Jul-18	20.55	27.51	5.79	11.0	26.259	0.05
Aug-18	18.68	27.314	5.03	12.5	23.46	0.051
Sep-18	17.46	21.243	4.8	13.0	21.007	0.057
Oct-18	14.91	22.544	0.8	7.1	16.898	0.056
Nov-18	9.90	14.347	0	5.3	13.632	0.056
Dec-18	0.00	17.98	0	0.0	14.311	0
Jan-19	0.00	15.899	0	0.0	14.192	0
Feb-19	0.00	16.059	0	0.0	13.927	0
Mar-19	0.00	15.915	0.01	0.0	14.295	0
Apr-19	0.00	24.315	1.1	0.0	17.913	0
May-19	6.50	25.684	2.13	4.3	21.443	0.12
Jun-19	16.41	22.854	3.85	9.6	21.261	0.055
Jul-19	21.39	24.076	6.33	13.8	23.128	0.05
Aug-19	18.06	24.642	6.41	14.6	24.02	0.053
Sep-19	17.14	24.76	4.27	11.1	22.795	0.053
Oct-19	16.24	22.014	1.12	10.4	9.672	0.053
Nov-19	0.00	14.937	0	0.0	12.336	0
Dec-19	0.00	14.464	0	0.0	13.653	0
Jan-20	0.00	15.780	0	0.0	13.878	0
Feb-20	0.00	15.413	0	0.0	14.01	0
Mar-20	0.00	15.157	0	0.0	13.54	0
Apr-20	0.00	25.304	1.2	0.0	15.609	0
May-20	14.01	28.464	3.44	7.8	25.823	0.075

Jun-20	24.49	28.388	6.17	16.0	24.338	0.054
Jul-20	28.055	28.312	7.3	20.557	23.337	0.055
Aug-20	17.795	28.834	6.67	13.349	27.543	0.061
Sep-20	16.528	27.666	4.1	11.582	22.494	0.078
Oct-20	15.345	23.892	1.85	8.724	18.135	0.074
Nov-20	0	17.358	0	0	14.521	0
Dec-20	0	14.6	0	0	13.876	0
Jan-21	0	17.548	0	0	14.623	0
Feb-21	0	15.086	0	0	14.33	0
Mar-21	0	15.256	0.07	0	13.884	0
Apr-21	0	20.123	0.5	0	16.345	0
May-21	17.42	20.895	1.42	11.111	15.229	0.065
Jun-21	18.561	28.989	6.13	12.16	25.446	0.063
Jul-21	16.37	29.137	6.55	11.025	27.65	0.074
Aug-21	13.568	30.447	6.02	8.968	28.271	0.072
Sep-21	14	30.488	5.33	9.886	25.764	0.077
Oct-21	15.999	23.383	2.24	8.037	16.547	0.069
Nov-21	13.999	15.565	0	11.771	13.401	0.067
Dec-21	0	14.172	0	0	13.581	0
Jan-22	0	14.929	0	0	13.585	0
Feb-22	0	14.584	0	0	14.281	0
Mar-22	0	18.521	0	0	15.217	0
Apr-22						
May-22						

Bellvue Turbidity	NTU = Turbidity of Finished Water	Treatment Capacity	MGD - Influent	Biosolids Hauled (Dry Tons)	TSS Effluent	BOD Effluent	Ammonia- Effluent
		70	7.80	91.7	19	9	
		70	7.72	65.3	17	8	
		70	7.97	99.3	20	9	
		70	8.36	55.1	22	11	
		70	8.18	103.1	17	11	
		70	8.96	91.5	10	6	
		70	8.74	112.2	8	4	
		70	9.24	106.6	12	7	
		70	9.26	86.7	18	11	
		70	9.29	67.6	24	13	
		70	8.89	79.4	18	10	
		70	8.34	85.3	14	8	
0.1	0.10	70	8.43	97.2	18	8	
0.07	0.07	70	8.06	60.5	16	8	
0.08	0.08	70	7.66	93.3	20	11	
0.07	0.10	70	8.37	66.0	13	10	
0.07	0.09	70	8.99	45.0	13	9	
0.10	0.14	70	12.18	112.9	19	10	
0.08	0.17	70	9.94	84.6	26	13	
0.09	0.15	70	9.34	98.0	10	7	
0.08	0.14	70	9.98	66.3	21	11	
0.07	0.09	70	9.74	81.4	24	13	
0.07	0.07	70	9.14	85.2	18	10	
0.08	0.08	70	8.45	76.4	25	15	
0.07	0.07	70	8.16	82.3	22	12	
0.06	0.06	70	8.00	73.0	16	11	
0.06	0.06	70	8.05	114.8	12	10	
0.08	0.12	70	8.53	76.8	17	11	
0.09	0.15	70	9.08	55.0	25	13	
0.06	0.08	70	9.65	97.2	11	14	
0.06	0.09	70	9.74	89.9	12	8	
0.05	0.12	70	9.57	93.6	10	9	
0.06	0.11	70	9.76	68.0	9	5	
0.05	0.10	70	9.84	99.3	17	8	
0.06	0.10	70	10.26	82.3	9	4	
0.07	0.07	70	10.13	96.1	13	5	
0.07	0.08	70	10.51	82.4	16	7	
0.10	0.11	70	8.66	76.4	11	7	
0.05	0.06	70	7.85	76.2	10	7	
0.05	0.09	70	7.85	108.4	11	7	
0.06	0.10	70	7.22	59.0	9	6	
0.04	0.09	70	9.11	105.5	12	8	
0.04	0.13	70	8.08	97.7	12	6	
0.06	0.11	70	8.84	310.9	7	5	
0.05	0.09	70	9.07	217.6	8	5	
0.08	0.10	70	9.32	55.7	15	8	
0.13	0.13	70	9.58	90.2	14	10	
0.10	0.10	70	8.65	125.6	8	5	
0.08	0.09	70	8.51	99.2	11	6	
0.09	0.09	70	8.24	86.6	12	6	
0.09	0.09	70	8.08	97	11	6	

0.11	0.12	70	7.85	94.4	10	5	
0.06	0.09	70	7.88	107	16	7	
0.05	0.09	70	8.16	140.9	15	7	
0.05	0.09	70	8.45	136.08	9	5	
0.05	0.09	70	8.56	103.93	9	4	
0.05	0.08	70	8.91	81.83	6	4	
0.05	0.07	70	8.7	106.15	12	6	
0.07	0.07	70	8.63	75.36	18	8	
0.07	0.07	70	8.51	116.8	29	10	
0.07	0.07	70	8.4	105.51	18	8	
0.06	0.06	70	8.05	55.39	18	9	
0.07	0.07	70	7.58	110.41	9	6	
0.06	3.74	70	7.93	103.43	11	6	
0.07	5.14	70	10.98	144.54	10	5	
0.05	0.09	70	10.04	140.35	10	4	
0.07	0.11	70	8.7	121.29	11	5	
0.07	0.10	70	8.85	80.27	10	5	
0.06	0.09	70	9.34	100.34	19	8	
0.05	0.07	70	8.82	88.48	9	5	
0.09	0.09	70	8.68	94.96	14	7	
0.07	0.07	70	8.24	115.17	15	8	
0.07	0.07	70	8.15	96.65	8	5	7.51
0.06	0.06	70	8.05	79.55	7	5	8.61
0.06	0.06	70	7.76	105.92	9	5	8.59
0.08	0.09	70	7.85	89.73	6	4.5	7.36
0.11	0.11	70	7.73	73.68	7	4	7.58
0.04	0.07	70	7.96	107.78	6	4	7.44
0.03	0.07	70	8.01	103.8	4	3	3.23
0.03	0.07	70	8.4	113.99	5	3	4.52
0.03	0.07	70	8.39	114.95	5	3	4.45
0.03	0.06	70	8.51	87.36	6	3	2.97
0.06	0.07	70	8.28	112.47	6	3	3.16
0.07	0.07	70	7.8	103.5	6	3	3.58
0.05	0.05	70	8.18	109.6	6	3	4.92
0.05	0.05	70	8.03	119.45	4	3	6.57
0.03	0.03	70	7.63	86.15	6	3.0	2.53
0.04	0.06	70	7.75	112.79	7	4.0	5.45
0.05	0.08	70	8.49	126.87	7	3.0	4.83
0.03	0.08	70	8.39	113.13	9	3.0	3.4
0.03	0.07	70	8.95	113.53	5	3.0	2.74
0.02	0.07	70	8.71	158.17	6	4.0	10.11
0.03	0.07	70	8.58	93.77	7	5.0	8.91
0.02	0.04	70	8.88	114.69	6	3.0	4.5
0.02	0.04	70	8.63	84.94	8	4.0	2.01
0.09	0.09	70	8.57	118.34	10	3.0	3.77
0.09	0.09	70	7.99	161.86	8	3.3	4.84
0.09	0.09	70	8.51	130.48	9.5	3.6	4.71
0.08	0.08	70	8.06	52.2	12	5.2	3.12
0.07	0.09	70	8.35	171.13	14.1	4.0	6.81
0.07	0.07	70	8.11	136.98	9.4	5.1	7.48
0.06	0.06	70	8.23	128.56	7	4.1	9.41
0.07	0.07	70	8.47	123.7	4.6	2.7	8.34
0.038	0.05	70	8.45	129.93	5.8	3	5.88
0.05	0.05	70	8.64	131.27	3.9	2.6	7.41
0.053	0.06	70	8.47	130.7	4	2.6	6.78

0.05	0.05	70	8.41	100.17	5.9	3.2	6.39
0.054	0.05	70	8.34	115.36	6.5	3.6	5.13
0.056	0.06	70	8.03	127.56	5	3	6.88
0.053	0.05	70	8.13	92.71	5.3	2.5	3.76
0.05	0.05	70	7.87	100.72	3.8	2.2	3.19
0.062	0.06	70	8.07	147.91	4.6	3.4	3.85
0.09	0.09	70	7.64	159.37	8.4	4.6	5.13
0.071	0.07	70	7.67	108.04	7.8	4.2	4.65
0.06	0.08	70	7.72	133.17	5.2	3	3.94
0.056	0.09	70	8.39	110.99	5.4	3.1	5.1
0.054	0.07	70	8.63	113.32	7	4.4	5.92
0.052	0.06	70	7.73	90.94	3.5	2.9	3.03
0.06	0.06	70	7.61	101.29	8.1	4.9	6.48
0.06	0.06	70	7.59	147.87	5.6	4.2	5.15
0.097	0.10	70	7.66	90.92	12.4	7.1	5.83
0.059	0.06	70	7.7	113.52	5.7	5.2	6.83
0.05	0.05	70	7.67	99.18	4.1	4.3	3.2
0.052	0.06	70	7.54	108.84	4	4	4.47
0.054	0.06	70	7.22	131.43	4.8	3.5	3.61
0.08	0.08	70	7.32	137.55	4.8	3.6	5.1
0.057	0.08	70	7.28	117.17	4.2	3	3.81
0.065	0.07	70	7.88	189.76	5.6	4	4.59
0.056	0.06	70	7.85	136.02	5.4	3.4	2.62
0.055	0.06	70	8.18	101.52	6	3.7	3.39
0.058	0.06	70	7.69	102.42	5.7	3	3.07
0.056	0.06	70	7.37	113.41	6.5	3.9	3.76
0.061	0.06	70	7.39	100.81	5.6	3.2	7.49
0.063	0.06	70	7.31	111.67	4.6	3	5.28
0.062	0.06	70	7.2	120.61	4.9	3	4.13
0.066	0.07	70	7.74	97.61	9.7	4.3	6.25
0.063	0.07	70	8.3	125.45	7.2	3.8	4.86
0.064	0.07	70	9.29	125.14	8	4	4.28
0.066	0.08	70	8.84	116.62	6.5	4	4.86
0.065	0.07	70	8.93	176.75	4.6	2.5	2.96
0.064	0.08	70	8.97	80.08	7.4	4.5	4.52
0.064	0.07	70	8.37	116.9	6.6	3.3	3.29
0.58	0.58	70	7.85	66.54	6.1	3.3	2.36
0.067	0.07	70	7.52	87.64	7.05	5.2	5.3
0.066	0.07	70	7.21	86.85	6	3.3	4.67
0.063	0.06	70	7.15	109.43	4.2	2.7	4.76
0.07	0.07	70	7.13	119.74	4.7	2.3	4.35
0.06	0.07	70	7.5	112.15	6.8	3.5	4.24
0.064	0.06	70	7.25	120.74	7.8	3.1	5.22
0.08	0.07	70	7.39	97.05	6.2	3.6	6.17
0.068	0.06	70	7.5	104.44	5.7	3.7	4.02
0.07	0.06	70	7.46	115.87	6.5	3.3	4.91
0.073	0.07	70	7.44	79.11	6.9	3	4.67
0.068	0.06	70	7.54	69.37	5.7	2.9	4.66
0.066	0.07	70	7.31	113.87	7.3	3.1	6.29
0.067	0.07	70	7.28	100.41	9.5	4.7	8.68
0.065	0.07	70	7.23	122.7	8.3	4.5	11.11
0.069	0.07	70	8.16	99.28	6	3.6	9
0.07	0.07	70	7.93	120.19	4.8	3	4.42
0.063	0.06	70	7.83	131.01	8.2	4.9	4.36
0.068	0.07	70	7.66	138.94	5.6	3.3	8.24

0.068	0.09	70	7.53	124.23	8.8	4.9	8.26
0.067	0.09	70	7.67	108.314	4.9	3.4	4.72
0.062	0.07	70	8.14	112.74	5.1	2.5	4.23
0.061	0.07	70	8.06	99.61	8.6	3.2	5.36
0.061	0.07	70	7.89	114.24	6.3	3.2	6.54
0.068	0.07	70	7.26	110.28	6.1	3.4	6.75
0.062	0.06	70	7.29	100.35	11.9	5	7.42
0.062	0.06	70	7.48	117.27	15.1	5.7	8.72
0.062	0.06	70	7.32	87.07	15.1	4.6	5.32
0.106	0.11	70	7.32	97.64	11.1	3.6	5.46
0.105	0.11	70	7.36	117.25	11.2	4	3.25
0.067	0.08	70	7.33	108.31	9	4	5.46
0.064	0.06	70	7.59	98.7	6.7	2.9	3.51
0.062	0.07	70	7.72	102.85	6	2.7	2.05
0.06	0.06	70	8.69	118.36	6.8	2.5	4.71
0.062	0.06	70	8.24	88.62	4.2	2	1.95
0.063	0.06	70	7.77	94.55	5.7	3.3	4.02
0.066	0.07	70	7.63	124.13	6.9	3.1	6.03
0.067	0.07	70	7.26	120.75	6.7	3.7	5.52
0.062	0.06	70	7.25	118.52	6.1	3	6.87
0.062	0.06	70	7.22	112.62	4.9	2.2	7.05
0.063	0.06	70	7.1	109.34	5.4	2.5	6.95
0.08	0.08	70	7.44	106.36	7.1	2.9	6.59
0.067	0.06	70	7.51	100.87	11.6	3.4	7.55
0.068	0.06	70	8.38	120.28	6.9	2.2	3.53
0.068	0.06	70	7.9	111.53	5.5	2.3	1.97
0.076	0.07	70	8.16	115.5	5.6	2	1.25
0.065	0.06	70	7.89	85.84	5.7	1.5	4.32
0.062	0.06	70	7.57	91	11.1	3.2	8.1
0.066	0.07	70	7.41	92.63	12	3.4	6.31
0.066	0.07	70	7.21	95.4	11.5	4.3	9.9
0.051	0.05	70	7.2	76.56	11	5	11.25
0.056	0.06	70	7.06	60.6	11.1	4.2	6.3
0.060	0.06	70	7.13	131.96	8.6	2.8	5.54
0.056	0.06	70	7.48	98.12	13	4.5	8.62
0.055	0.06	70	8.45	124.11	11.1	3.8	13.97
0.055	0.05	70	10.42	120.75	7.1	2.3	0.8
0.062	0.06	70	8.55	131.13	6.5	2.2	0.27
0.059	0.06	70	8.27	154.63	8.6	2.6	2.68
0.053	0.06	70	7.84	89.12	18.1	4.5	11.61
0.059	0.06	70	7.69	87.35	16	5.8	12.68
0.061	0.06	70	7.36	60.77	17.2	6	10.5
0.069	0.07	70	6.97	81.51	24.9	9.1	5.62
0.062	0.06	70	7.08	122.11	14	6	3.45
0.053	0.05	70	7.12	128.65	11.1	4.4	5.8
0.056	0.06	70	7.04	144.07	11.3	4.8	5.41
0.059	0.06	64.6	7.32	96.8	10.6	4.3	6.19
0.059	0.06	64.6	7.93	103.63	6.2	2.4	2.81
0.06	0.06	64.6	9.67	98.62	6.5	2	2.94
0.067	0.07	64.6	9.05	102.76	4.9	1.8	1.26
0.065	0.07	64.6	8.55	112.12	7.2	2.6	1.1
0.061	0.07	64.6	8.28	117.52	9.3	2.7	1.51
0.062	0.06	64.6	8.19	91.87	7.9	2.5	0.92
0.063	0.06	64.6	7.96	95.93	6.3	2	0.87
0.079	0.08	64.6	7.31	122.81	8.3	3.1	0.35

0.063	0.06	64.6	7.15	141.72	8.8	4.1	6.25
0.063	0.06	64.6	7.32	113.91	9.2	3.1	4.08
0.063	0.06	64.6	7.19	158.7	7.6	2.5	7.67
0.065	0.06	64.6	7.34	112.44	6.9	2.8	5.79
0.062	0.06	64.6	7.32	117.95	8.3	3.3	5.77
0.064	0.06	64.6	7.36	117.95	6.6	2.3	4.41
0.078	0.06	64.6	7.65	91.85	4	2.2	2.11
0.084	0.08	64.6	7.62	109.87	4	1.7	4.81
0.075	0.07	64.6	7.74	121.71	6	2.6	3.16
0.069	0.07	64.6	7.66	111.49	7.1	2.9	4.71
0.068	0.07	64.6	7.29	96.29	7.9	3	9.36
0.076	0.08	64.6	7.31	102.19	9.6	3.2	8.42
0.075	0.08	64.6	7.34	111.98	9.1	3.2	9.67
0.076	0.08	64.6	7.34	71.91	9	3	10.58
0.075	0.08	64.6	7.39	112.12	7	3	9.67
0.076	0.08	64.6	7.48	127.9	8	2	8.85
0.069	0.07	64.6	7.71	117.5	5	3	5.1
0.072	0.07	64.6	7.58	157.72	6	2	4.8
0.074	0.06	64.6	7.77	134.71	5.7	2	3
0.074	0.07	64.6	7.96	125.61	5.3	2.3	3.4
0.076	0.07	64.6	9.18	114	4.8	2.2	5.1
0.072	0.07	64.6	7.93	134	5.2	2.9	3.1
0.069	0.07	64.6	7.87	130	6.6	3	7
0.069	0.07	64.6	7.83	149	8.3	2.9	8.4
0.06	0.06	64.6	7.09	89	4.9	3	10.4
0.061	0.06	64.6	7.19	115	8.1	3.9	6
0.079	0.08	64.6	7.29	184	10.7	3.8	3.4
0.063	0.05	64.6	7.3	194	8.2	3.9	1.7
0.066	0.07	64.6	8.2	128	4.8	2.4	2.1
0.07	0.07	64.6	10.9	112	6.8	3.9	2.6
0.067	0.06	64.6	8.3	121	5.4	2	0.8
0.067	0.07	64.6	8	38	4	2	0.8
0.066	0.07	64.6	7.9	133	4.4	1.7	2.1
0.065	0.07	64.6	7.1	124	5.4	2.2	2.2
0.068	0.07	64.6	7.4	102	10	3	3
0.064	0.06	64.6	7.1	185	15	5	6.5
0.063	0.06	64.6	7.4	127	14	5	3.7
0.062	0.06	64.6	7.4	181	16	6	6.1
0.061	0.06	64.6	7.1	199	24	8	10.3
0.069	0.07	64.6	7.3	167	16	6	5.3
0.075	0.07	64.6	9.2	134	6.5	2.9	3.9
0.100	0.07	64.6	10.4	155	11.3	4	7.3
0.088	0.06	64.6	8.0	140	5.3	2	1.7
0.081	0.06	64.6	7.7	85	5.3	4	5.6
0.079	0.06	64.6	7.7	133	4	1.6	1.7
0.069	0.06	64.6	7.6	145	5	1.9	2.8

0.065	0.06	64.6	8.0	130	13	4	5.87
0.062	0.06	64.6	8.0	193	13	5	5.8
0.060	0.06	64.6	7.4	171	11	5.1	7.1
0.059	0.06	64.6	7.4	137	8	4	4.8
0.061	0.06	64.6	7.2	155	12	5	3.5
0.075	0.07	64.6	7.4	169	7	3	3
0.038	0.04	64.6	8.3	144	6	2	3
0.073	0.06	64.6	8.5	152	10	3	4
0.067	0.06	64.6	7.8	99	6	3	0.5
0.067	0.06	64.6	7.9	163	10	5	1.5
0.065	0.06	64.6	7.7	127	9	4	1.8
0.062	0.06	64.6	7.5	105	8	4	2.4
0.059	0.06	64.6	7.4	137	8.4	4	1.6
0.051	0.05	64.6	7.7	153	13.4	5.5	5.7
0.047	0.05	64.6	7.4	134	13	5.7	6.3
0.037	0.04	64.6	7.3	148	14	4.3	5.1
0.04	0.04	64.6	7.1	164	17	5.8	3.8
0.047	0.05	64.6	7.2	139	16	4.8	2.6
0.052	0.05	64.6	8	139	12	5	2.7
0.051	0.05	64.6	8	158	7	3.1	0.9
0.067	0.06	64.6	7.9	90	10	3.8	0.6
0.059	0.05	64.6	8.5	61	12	3.9	0.9
0.065	0.06	64.6	8.4	136	6	2.4	1.5
0.052	0.06	64.6	8.5	174	12	4	2.5
0.044	0.04	64.6	8.1	145	10	4	3
0.043	0.04	64.6	7.6	142	10	4.8	2.2
0.044	0.04	64.6	7.7	130	12	4.3	0.7
0.041	0.04	64.6	7.7	121	14	4.8	0.9
0.0425	0.04	64.6	7.1	150	25	11.3	2.4
0.042	0.04	64.6	7.9	149	9	3.5	2
0.046	0.05	64.6	7.9	189	9	4.8	0.6
0.049	0.05	64.6	7.4	144	7	2.9	0.97
0.055	0.05	64.6	7.4	125	6	2.3	2.3
0.054	0.05	64.6	7.5	77	12	3.8	1.4
0.05	0.05	64.6	7.5	127	6	2.4	1.2
0.063	0.06	64.6	6.9	137	9	3.3	1.3
0.051	0.05	64.6	7.2	118	10	3.6	3.3
0.046	0.05	64.6	6.9	125	7	3.6	4
0.045	0.05	64.6	7.0	156	9	3.9	2.1
0.046	0.05	64.6	7.0	131	9	4.3	5.9
0.049	0.05	64.6	6.95	124	12	4.8	7.7
0.055	0.06	64.6	7.1	167	8	3.4	0.6
0.054	0.06	64.6	7.2	183	12	4.7	1.7
0.055	0.06	64.6	7.51	133	5	2.3	1.1
0.055	0.05	64.6	7.56	155	8	2.8	1.1
0.055	0.05	64.6	7.77	159	9	3.7	3.8
0.051	0.05	64.6	7.7	158	9	3.3	1.8
0.053	0.05	64.6	7.4	171	9	3.2	3.8
0.055	0.06	64.6	7.4	150	14	3.2	5.8
0.055	0.06	64.6	7.2	143	14	5.6	8.2
0.049	0.05	64.6	7.1	157	9	3.9	5.1
0.051	0.05	64.6	7.2	141	12	4.8	4.7
0.051	0.05	64.6	7.1	135	11	4.6	3
0.052	0.05	64.6	6.9	135	12	4.2	3.3
0.049	0.06	64.6	7.1	116	9	2.8	1

0.052	0.05	64.6	7.3	106	9	3	0.8
0.055	0.06	64.6	7.4	123	7	2.4	0.6
0.059	0.06	64.6	7.5	134	11	5	2.84
0.059	0.07	64.6	7.44	131	10	3	1.1
0.053	0.06	64.6	7.3	136	10	3	1.81
0.054	0.05	64.6	6.92	119	10	3	1.8
0.049	0.05	64.6	6.62	139	10	3.5	4.43
0.052	0.05	64.6	6.68	135	9	3.2	2.77
0.053	0.05	64.6	6.68	134	12	4	4
0.05	0.05	64.6	6.68	150	8	3	2
0.053	0.05	64.6	6.81	201	8	3	0.85
0.054	0.06	64.6	7.51	233	6	3	0.84
0.056	0.06	64.6	7.54	115	15	6	1.108
0.059	0.06	64.6	8.15	109	6	3	3.59
0.062	0.06	64.6	7.36	149	8	3	0.776
0.068	0.07	64.6	7.38	123	7	2	0.26
0.065	0.07	64.6	7.61	127	6	2	0.265
0.066	0.07	64.6	7.29	137	9	3	0.677
0.033	0.03	64.6	7.03	124	10	4	0.834
0.035	0.04	64.6	6.98	132	9	4	1.241
0.028	0.03	64.6	7.01	131	8	3	1.326
0.031	0.03	64.6	6.96	154	10	4	0.569

[illegible]

30	25	
30	25	
30	25	
30	25	
30	25	
30	25	
30	25	
30	25	
30	25	
30	25	
30	25	
30	25	
30	25	
30	25	
30	25	
30	25	
30	25	
30	25	
30	25	
30	25	
30	25	
30	25	
30	25	
30	25	29
30	25	21.8
30	25	11.5
30	25	9.9
30	25	14.5
30	25	15.4
30	25	12.5
30	25	15
30	25	14
30	25	15
30	25	20
30	25	20
30	25	11
30	25	12
30	25	5
30	25	12
30	25	20
30	25	14
30	25	14
30	25	15
30	25	14
30	25	15
30	25	20
30	25	20
30	25	11
30	25	12
30	25	5
30	25	12
30	25	20
30	25	14
30	25	14
30	25	15
30	25	14
30	25	15

30	25		20
30	25		20
30	25		11
30	25		12
30	25		5
30	25		12
30	25		20
30	25		14
30	25		14
30	25		15
30	25		14
30	25		15
30	25		20
30	25		20
30	25		11
30	25		12
30	25		5
30	25		12
30	25		20
30	25		14
30	25		14
30	25		15
30	25		14
30	25		15
30	25		20
30	25		20
30	25		11
30	25		12
30	25		5
30	25		12
30	25		20
30	25		14
30	25		14
30	25		15
30	25		14
30	25		14
30	25		20
30	25		20
30	25		12
30	25		15
30	25		13
30	25		14
30	25		16
30	25		17
30	25		22
30	25		18
30	25		19
30	25		19
30	25		28
30	25		30
30	25		32
30	25		21
30	25		13
30	25		14
30	25		15

30	25	17
30	25	22
30	25	19
30	25	19
30	25	19
30	25	29
30	25	28
30	25	32
30	25	21
30	25	13
30	25	14
30	25	15
30	25	17
30	25	22
30	25	19
30	25	19
30	25	19
30	25	29
30	25	28
30	25	32
30	25	21
30	25	13
30	25	14
30	25	15
30	25	17
30	25	22
30	25	19
30	25	19
30	25	19
30	25	29
30	25	28
30	25	32
30	25	21
30	25	13
30	25	14
30	25	15
30	25	16
30	25	22
30	25	19
30	25	29
30	25	28
30	25	29
30	25	28
30	25	32
30	25	21
30	25	13
30	25	14
30	25	15
30	25	17
30	25	22
30	25	19
30	25	19
30	25	19
30	25	29
30	25	28

30	25	32
30	25	21
30	25	13
30	25	26
30	25	25
30	25	17
30	25	22
30	25	19
30	25	19
30	25	19
30	25	29
30	25	29
30	25	12
30	25	15
30	25	13
30	25	11.3
30	25	11.1
30	25	10.7
30	25	9.5
30	25	7.2
30	25	8.3
30	25	9.7
30	25	11.8
30	25	18.1
30	25	12
30	25	15
30	25	13
30	25	11.3
30	25	11.1
30	25	9.7
30	25	9.5
30	25	7.2
30	25	8.3
30	25	9.7
30	25	11.8
30	25	18.1
30	25	12
30	25	15
30	25	13
30	25	11.3
30	25	11.1
30	25	9.7
30	25	9.5
30	25	7.2
30	25	8.3
30	25	9.7

30	25	11.8
30	25	18.1
30	25	12
30	25	15
30	25	13
30	25	11.3
30	25	11.1
30	25	10.7
30	25	9.5
30	25	7.2
30	25	8.3
30	25	9.7
30	25	11.8
30	25	18.1
30	25	12
30	25	15
30	25	13
30	25	11.3
30	25	11.1
30	25	10.7
30	25	9.5
30	25	7.2
30	25	8.3
30	25	9.7
30	25	11.8
30	25	11.8
30	25	12
30	25	15
30	25	13
30	25	13
30	25	11
30	25	10.7
30	25	9.5
30	25	7.2
30	25	8.3
30	25	9.7
30	25	11.8
30	25	18.1
30	25	12
30	25	15
30	25	13
30	25	11.3
30	25	11.1
30	25	10.7
30	25	9.5
30	25	7.2
30	25	8.3
30	25	9.7
30	25	11.8
30	25	18.1
30	25	12
30	25	15
30	25	13
30	25	11.3
30	25	11.1

30	25	10.7
30	25	9.5
30	25	7.2
30	25	8.3
30	25	9.7
30	25	11.8
30	25	18.1
30	25	12
30	25	15
30	25	13
30	25	11.3
30	25	11.1
30	25	10.7
30	25	9.5
30	25	7.2
30	25	8.3
30	25	9.7
30	25	11.8
30	25	18.1
30	25	12
30	25	15
30	25	13

Date	Feet of Sewer Cleaned	Feet of Sewer Televised (inspected)	Calls	Repairs (calls corrected)	Sewer Taps Sold
Jan-94	61,710	12,128	16	2	54
Feb-94	25,695	8,991	10	3	55
Mar-94	127,210	12,680	14	1	60
Apr-94	117,455	8,648	17	6	69
May-94	97,550	15,550	14	1	48
Jun-94	142,495	16,971	11	3	75
Jul-94	161,635	0	10	0	61
Aug-94	132,140	0	14	1	55
Sep-94	82,075	21,897	12	2	42
Oct-94	138,665	11,440	17	3	60
Nov-94	93,990	19,557	14	5	49
Dec-94	62,580	11,132	9	2	43
Jan-95	41,791	15,591	12	1	20
Feb-95	48,468	0	18	2	26
Mar-95	98,455	0	13	4	28
Apr-95	62,280	3,375	4	4	47
May-95	138,680	0	11	1	0
Jun-95	108,470	0	8	4	0
Jul-95	114,590	0	6	2	0
Aug-95	165,373	0	12	3	0
Sep-95	105,415	16,867	12	1	0
Oct-95	147,960	23,679	8	2	0
Nov-95	77,984	19,381	7	2	0
Dec-95	113,765	13,454	8	0	0
Jan-96	84,347	9,693	19	4	0
Feb-96	92,320	18,357	15	3	0
Mar-96	60,295	15,858	11	3	0
Apr-96	112,853	10,655	14	4	0
May-96	100,860	5,444	5	0	0
Jun-96	107,541	6,790	6	1	0
Jul-96	120,645	1,129	6	1	0
Aug-96	88,430	16,257	9	0	0
Sep-96	112,850	0	12	3	0
Oct-96	86,871	6,996	12	2	0
Nov-96	60,730	12,677	19	5	0
Dec-96	68,730	15,774	13	4	0
Jan-97	57,050	15,594	17	2	0
Feb-97	72,140	12,939	13	2	0
Mar-97	100,171	15,163	11	4	0
Apr-97	169,601	27,518	14	2	0

May-97	141,760	2,155	11	2	0
Jun-97	106,035	11,802	23	1	0
Jul-97	138,938	25,726	11	1	0
Aug-97	83,695	6,172	14	2	0
Sep-97	78,760	12,046	12	2	0
Oct-97	79,170	12,908	15	1	0
Nov-97	77,160	397	16	5	0
Dec-97	84,040	9,870	18	4	0
Jan-98	101,591	15,976	12	0	0
Feb-98	105,000	3,673	11	2	0
Mar-98	142,817	20,069	7	1	0
Apr-98	120,180	25,775	14	2	0
May-98	77,205	15,414	7	1	0
Jun-98	138,360	8,993	13	3	0
Jul-98	118,130	8,970	10	0	0
Aug-98	129,395	5,341	10	1	0
Sep-98	106,130	15,266	13	2	0
Oct-98	127,585	10,002	14	4	0
Nov-98	129,625	16,033	12	1	0
Dec-98	127,120	8,431	14	2	0
Jan-99	109,710	6,636	13	2	0
Feb-99	111,300	5,424	5	1	0
Mar-99	177,255	9,217	8	2	0
Apr-99	197,150	12,744	8	2	0
May-99	182,915	9,038	7	1	0
Jun-99	212,237	25,946	6	2	0
Jul-99	153,620	19,545	3	0	0
Aug-99	208,175	7,233	8	1	0
Sep-99	164,078	8,462	9	0	0
Oct-99	115,970	10,657	14	2	0
Nov-99	104,325	9,083	9	1	0
Dec-99	117,819	4,958	13	1	0
Jan-00	128,980	11,287	10	2	0
Feb-00	111,275	1,372	2	1	0
Mar-00	114,360	18,444	11	3	0
Apr-00	135,850	21,719	13	2	0
May-00	236,465	9,344	12	0	0
Jun-00	140,995	16,226	7	2	0
Jul-00	198,995	23,047	5	0	0
Aug-00	135,985	31,772	8	0	0
Sep-00	76,454	23,567	8	0	0
Oct-00	123,200	15,417	12	2	0
Nov-00	115,875	9,525	13	1	0

Dec-00	75,735	2,398	13	3	0
Jan-01	91,422	7,001	6	1	0
Feb-01	65,975	10,762	14	2	0
Mar-01	194,650	13,821	14	0	0
Apr-01	157,155	15,013	9	0	0
May-01	185,042	14,492	10	1	0
Jun-01	136,638	20,216	7	0	0
Jul-01	143,563	13,837	5	0	0
Aug-01	232,128	23,881	6	1	0
Sep-01	137,177	5,619	6	1	0
Oct-01	144,347	18,999	7	0	0
Nov-01	122,616	17,367	7	2	0
Dec-01	130,862	18,628	6	0	0
Jan-02	108,893	6,774	7	0	0
Feb-02	123,990	12,717	4	1	0
Mar-02	64,338	8,742	4	0	0
Apr-02	173,389	20,652	7	2	0
May-02	227,983	23,416	7	0	0
Jun-02	192,762	11,030	7	0	0
Jul-02	211,099	10,119	5	0	0
Aug-02	226,892	22,263	7	1	0
Sep-02	194,821	31,202	7	0	0
Oct-02	208,878	31,202	5	1	0
Nov-02	108,281	17,930	10	2	0
Dec-02	163,705	22,623	14	2	0
Jan-03	119,232	20,216	9	0	0
Feb-03	115,958	17,700	6	1	0
Mar-03	235,419	3,339	4	0	0
Apr-03	168,467	13,230	2	0	0
May-03	157,878	18,743	5	1	0
Jun-03	122,718	24,170	2	0	0
Jul-03	175,479	16,034	5	1	0
Aug-03	136,513	26,987	0	0	0
Sep-03	181,960	26,579	5	1	0
Oct-03	196,762	14,645	4	0	0
Nov-03	173,712	16,244	8	1	0
Dec-03	181,311	11,818	9	0	0
Jan-04	131,015	8,345	2	1	0
Feb-04	103,869	11,753	6	1	0
Mar-04	160,034	17,586	6	1	0
Apr-04	147,209	15,576	8	0	0
May-04	112,216	23,561	4	1	0
Jun-04	145,735	23,388	7	1	0

Jul-04	127,740	23,488	4	0	0
Aug-04	192,810	22,893	5	2	0
Sep-04	176,090	21,494	9	1	0
Oct-04	137,599	24,181	1	0	0
Nov-04	93,516	15,462	6	0	51
Dec-04	119,069	14,564	6	2	54
Jan-05	113,548	14,255	8	0	55
Feb-05	127,944	15,636	2	1	60
Mar-05	238,341	24,753	7	1	69
Apr-05	186,024	19,851	3	0	48
May-05	142,874	22,353	9	1	75
Jun-05	157,658	28,621	2	0	61
Jul-05	153,572	24,613	4	0	55
Aug-05	144,347	24,354	7	0	42
Sep-05	178,690	18,096	3	0	60
Oct-05	144,319	23,436	3	0	49
Nov-05	121,390	13,060	11	0	43
Dec-05	111,822	9,195	3	0	20
Jan-06	145,681	23,078	6	0	26
Feb-06	113,343	18,422	6	1	28
Mar-06	138,323	25,632	3	0	47
Apr-06	217,213	22,516	3	0	36
May-06	205,272	20,488	7	2	57
Jun-06	151,320	24,930	5	0	29
Jul-06	161,179	20,158	3	0	27
Aug-06	155,743	26,390	1	0	16
Sep-06	156,886	20,193	8	0	13
Oct-06	123,184	23,019	3	0	34
Nov-06	153,123	21,437	2	0	24
Dec-06	82,064	9,748	9	1	5
Jan-07	13,217	0	9	0	17
Feb-07	44,577	0	9	3	15
Mar-07	163,234	20,023	4	1	23
Apr-07	158,723	23,126	7	2	17
May-07	135,730	24,785	2	0	19
Jun-07	159,227	14,560	2	0	45
Jul-07	220,231	27,192	4	0	40
Aug-07	189,537	27,755	1	0	40
Sep-07	181,693	9,405	3	0	35
Oct-07	174,360	26,511	0	0	24
Nov-07	104,410	21,407	6	1	20
Dec-07	59,981	9,216	5	0	20
Jan-08	59,451	14,699	3	0	18

Feb-08	85,720	21,966	4	0	10
Mar-08	151,693	19,479	3	0	13
Apr-08	145,921	20,612	5	2	17
May-08	98,290	14,556	3	0	7
Jun-08	122,072	19,631	1	0	34
Jul-08	111,620	19,007	0	0	7
Aug-08	137,413	23,400	2	1	13
Sep-08	103,896	19,161	2	0	7
Oct-08	150,569	18,676	1	0	15
Nov-08	98,420	21,335	3	0	4
Dec-08	70,731	6,503	1	0	7
Jan-09	154,708	13,067	1	0	3
Feb-09	131,002	20,052	0	0	2
Mar-09	128,808	15,197	3	0	5
Apr-09	178,101	22,750	1	0	10
May-09	129,614	25,262	4	0	14
Jun-09	175,099	23,999	2	1	12
Jul-09	203,089	12,875	0	1	22
Aug-09	173,261	22,734	2	0	2
Sep-09	154,726	14,369	3	0	3
Oct-09	163,059	24,823	1	2	8
Nov-09	136,756	19,817	3	0	4
Dec-09	48,534	6,563	4	0	5
Jan-10	95	16,151	5	1	24
Feb-10	131,913	15,648	2	0	0
Mar-10	239,948	20,206	4	0	38
Apr-10	172,711	17,538	3	0	30
May-10	154,844	20,550	2	0	13
Jun-10	214,879	11,736	6	0	8
Jul-10	148,801	20,178	2	0	12
Aug-10	187,267	1,424	2	0	14
Sep-10	193,706	3,177	3	0	15
Oct-10	173,542	8,626	4	0	4
Nov-10	158,088	12,468	3	0	4
Dec-10	135,229	4,466	2	0	1
Jan-11	133,697	0	3	0	0
Feb-11	66,878	3,356	3	0	0
Mar-11	210,536	11,826	3	0	15
Apr-11	132,183	18,026	2	0	3
May-11	112,914	12,191	1	0	8
Jun-11	204,372	11,671	2	0	2
Jul-11	194,320	14,820	1	0	0
Aug-11	177,427	23,150	3	0	1

Sep-11	230,501	16,590	1	0	5
Oct-11	153,598	26,651	1	0	3
Nov-11	103,546	2,548	4	0	1
Dec-11	98,417	8,749	3	0	4
Jan-12	140,661	20,667	2	0	1
Feb-12	145,832	16,725	0	0	2
Mar-12	192,877	17,427	1	0	7
Apr-12	210,423	15,097	5	0	7
May-12	227,747	21,871	3	0	5
Jun-12	179,372	24,637	4	0	2
Jul-12	197,531	15,018	7	0	9
Aug-12	225,580	8,858	3	0	11
Sep-12	181,861	9,130	1	0	6
Oct-12	158,145	17,844	3	0	5
Nov-12	121,742	17,246	2	0	3
Dec-12	82,665	5,821	4	0	4
Jan-13	93,776	9,678	2	0	11
Feb-13	89,149	10,582	2	0	10
Mar-13	101,509	11,518	2	0	5
Apr-13	117,484	791	5	0	16
May-13	148,560	741	5	0	20
Jun-13	190,071	0	2	0	11
Jul-13	217,332	4,188	2	0	17
Aug-13	187,968	15,569	4	0	21
Sep-13	136,562	4,414	1	1	17
Oct-13	187,024	2,241	1	0	12
Nov-13	131,594	0	3	0	29
Dec-13	92,470	7,964	3	0	23
Jan-14	104,608	12,675	2	0	29

Date	Requested Rented Water	DWR Snow Course % of Average	DWR Snow Course % of Last Year Average	100%	Milton- Seaman(Randy)	Chambers (Randy)	Comanche(Randy)	Hourglass (Randy)	Barnes (Randy)	Peterson (Randy)	Twin Lakes	From Alex, Rented Water by month (not cumulative)	Decreed Storage
Jan-09	0	114	123	100	1962	840.6		0	1370	0	0	0	13123
Feb-09	800	100	94	100	1962	1021.1		0	1170	0	0	0	13123
Mar-09	330	94	95	100	1962	509.4		0	999	0	0	0	13123
Apr-09	835	113	98	100	4461	331		54	1370	224	28	6600	13123
May-09	0	0	0	100	5008	1343		243	2040	518	80	0	13123
Jun-09	1,500	0	0	100	5008	2629		1400	2349	1118	184	200	13123
Jul-09	0	0	0	100	5008	2540		1385	2328	1151	0	0	13123
Aug-09	0	0	0	100	5008	1775		1192	2296	1183	0	0	13123
Sep-09	0	0	0	100	5008	982		623	2349	1172	0	0	13123
Oct-09	0	0	0	100	5008	255		0	2345	627	0	0	13123
Nov-09	0	0	0	100	5008	1881		0	2328	0	0	0	13123
Dec-09	0	0	0	100	5008	1728.1		0	2136	0	0	0	13123
Jan-10	9,095	82	71	100	5008	1508.1		0	1959	0	0	0	13123
Feb-10	0	79	78	100	5008	1093		0	1818	0	0	4000	13123
Mar-10	36	81	86	100	5008	769.7		0	1598	0	0	0	13123
Apr-10	1,300	93	82	100	5008	613.2		0	1686	0	0	1200	13123
May-10	700	0	0	100	5008	1070		185	2274	513	68	0	13123
Jun-10	200	0	0	100	5008	2629		1490	0	1183	252	200	13123
Jul-10	0	0	0	100	4407	2629		1585	2338	1183	271	0	13123
Aug-10	0	0	0	100	3417	2547		687	2306	1178	79	0	13123
Sep-10	40	0	0	100	3081	2000		0	2263	617	0	40	13123
Oct-10	65	0	0	100	4056	2000		0	2263	0	0	65	13123
Nov-10	0	0	0	100	5008	1500		0	2094	0	0	0	13123
Dec-10	0	0	0	100	5008	1152.4		0	1887	0	0	0	13123
Jan-11	5,400	140	173	100	5008	771.6		0	1682	0	0	0	13123
Feb-11	3,300	143	185	100	5008	452.8		0	1508	0	0	0	13123
Mar-11	1,150	143	178	100	5008	0		0	1360	0	0	0	13123
Apr-11	0	191	202	100	1962	0		0	1161	0	0	4200	13123
May-11	50	0	0	100	4572	0		0	1877	0	0	50	13123
Jun-11	0	0	0	100	5008	1118		1179	2349	1134	201	50	13123
Jul-11	0	0	0	100	5008	2000		1366	2349	1183	269	50	13123
Aug-11	50	0	0	100	1958	2020		1362	2317	1183	247	50	13123
Sep-11	0	0	0	100	615	2000		780	2285	1183	0	0	13123
Oct-11	0	0	0	100	611	2108		125	2279	1183	0	0	13123
Nov-11	0	0	0	100	615	1715		0	2015	1183	0	0	13123
Dec-11	0	0	0	100	611	1352.1		0	1867	521	0	0	13123
Jan-12	5,454	98	70	100	611	899.5		0	1877	0	0	0	13123
Feb-12	9,454	102	71	100	611	497.6		0	1887	0	0	0	13123
Mar-12	10,454	61	42	100	611	88		0	1913	0	0	0	13123
Apr-12	7,300	23	12	100	2760	0		0	2094	77	0	0	13123
May-12	8,003	0	0	100	3186	2000		0	2349	562	0	3823	13123
Jun-12	7,853	0	0	100	3354	2000		0	2349	583	0	4515	13123
Jul-12	0	0	0	100	3593	2000		0	2317	493	0	700	13123

	1995			1996			1997			1998			1995		1996		1997		1998		19
	Flow	Cum Flow	Cum Flow/ 1000	Flow	Cum Flow	Cum Flow/ 1000	Flow	Cum Flow	Cum Flow/ 1000	Flow	Cum Flow	Cum Flow/ 1000	Precip .	CUM	Precip.	CUM	Precip.	CUM	Precip.	CUM	Precip.
Jan	417.44	417.44	0.42	423.23	423.23	0.42	444.36	444.36	0.44	422.66	422.66	0.42	0.06	0.06	0.76	0.76	0.82	0.82	0.3	0.3	0.38
Feb	385.68	803.12	0.80	415.27	838.50	0.84	391.90	836.26	0.84	398.86	821.52	0.82	0.88	0.94	0.08	0.84	0.48	1.30	0.25	0.55	0.11
Mar		803.12	0.80	455.22	1293.72	1.29	470.61	1306.87	1.31	439.54	1261.06	1.26	0.44	1.38	0.94	1.78	0.46	1.76	1.1	1.65	0.41
Apr	512.41	1315.53	1.32	650.44	1944.16	1.94	532.28	1839.15	1.84	596.78	1857.84	1.86	2.85	4.23	0.67	2.45	1.49	3.25	1.5	3.15	7.41
May	524.97	1840.50	1.84	961.36	2905.52	2.91	884.24	2723.39	2.72	922.21	2780.05	2.78	4.14	8.37	2.49	4.94	1.61	4.86	2.34	5.49	1.61
Jun	699.60	2540.10	2.54	977.23	3882.75	3.88	867.56	3590.95	3.59	1048.73	3828.77	3.83	4.00	12.37	1.65	6.59	2.33	7.19	0.63	6.12	1.03
Jul	1124.80	3664.89	3.66	1026.38	4909.13	4.91	1254.55	4845.50	4.85	1312.60	5141.37	5.14	0.57	12.94	2.55	9.14	2.30	9.49	1.45	7.57	2.29
Aug	1247.40	4912.29	4.91	1119.96	6029.09	6.03	899.44	5744.95	5.74	1154.40	6295.77	6.30	0.23	13.17	0.65	9.79	2.98	12.47	0.47	8.04	1.87
Sep	851.63	5763.92	5.76	771.60	6800.69	6.80	879.85	6624.79	6.62	1026.71	7322.48	7.32	2.86	16.03	1.75	11.54	0.83	13.30	0.56	8.6	2.46
Oct	590.24	6354.16	6.35	672.32	7473.01	7.47	711.18	7335.97	7.34	624.51	7946.99	7.95	0.48	16.51	0.45	11.99	2.07	15.37	1.98	10.58	0.3
Nov	418.14	6772.29	6.77	434.09	7907.09	7.91	424.92	7760.89	7.76	439.00	8385.99	8.39	0.46	16.97	0.41	12.40	0.45	15.82	0.29	10.87	0.28
Dec	423.35	7195.64	7.20	415.71	8322.80	8.32	417.42	8178.31	8.18	420.72	8806.71	8.81	0.10	17.07	0.00	12.40	0.32	16.14	0.65	11.52	0.1
	7195.639	42382.991		8322.803	52729.701								17.07	120.04	12.4	84.62	16.14	101.77	11.52	74.44	18.25

February
March
April
May
June
July
August
September
October
November
December

99	2000			2001		2002		2003		2004			2005			35 YEAR	2006			Historical Precipitation	Annual	Annual	2007			2008		
CUM	Precip	CUM	Precip	CUM	PRECIP	CUM	PRECIP	CUM	UNC	West	Cum	UNC	West	Cum	UNC		West	Cum	Avg. Monthly		Avg. Monthly	UNC	West	Precip	UNC	West	Precip	
0.38	0.14	0.14	0.58	0.58	0.85	0.85	0.06	0.06	0.50	0.11	0.11	0.81	0.18	0.18	0.36	0.03	0.01	0.01	0.50	0.50	0.50	0.77	0.34	0.34	0.14	0.05	0.14	
0.49	0.13	0.27	0.43	1.01	0.29	1.14	0.61	0.67	0.27	0.50	0.61	0.32	0.20	0.38	0.32	0.51	0.08	0.09	0.37	0.37	0.87	0.15	0.08	0.42	0.10	0.16	0.24	
0.9	1.26	1.53	0.73	1.74	0.51	1.65	1.78	2.45	0.01	0.07	0.68	0.43	0.65	1.03	1.02	0.68	0.68	0.77	1.08	1.08	1.95	1.33	1.17	1.59	0.51	0.61	0.75	
8.31	0.34	1.87	2.77	4.51	0	1.65	2.11	4.56	1.46	1.57	2.25	1.99	1.5	2.53	1.58	0.26	0.33	1.1	1.79	1.79	3.74	2.73	1.63	3.22	0.83	0.52	1.58	
9.92	2.44	4.31	3.45	7.96	1.88	3.53	2.53	7.09	1.62	1.41	3.66	1.3	1.48	4.01	2.67	1.78	0.43	1.53	2.45	2.45	6.19	2.47	1.08	4.30	1.93	1.22	3.51	
10.95	0.84	5.15	1.14	9.1	2.37	5.9	1.67	8.76	2.15	2.30	5.96		3.63	7.64	2.1	0.37	0.24	1.77	1.90	1.90	8.09	2.30	0.61	4.91	1.91	1.94	5.42	
13.24	0.02	5.17	6.12	15.22	0.83	6.73	0.69	9.45	0.94	0.76	6.72	0.56	0.45	8.09	1.8	2.12	2.15	3.92	1.48	1.48	9.57	2.33	0.94	5.85	0.63	1.72	6.05	
15.11	0.63	5.8	0.44	15.66	0.91	7.64	2.82	12.27	1.40	2.90	9.62	0.75	0.71	8.80	1.39	0.53	0.96	4.88	1.15	1.15	10.72	2.69	2.54	8.39	7.02	6.30	13.07	
17.57	1.41	7.21	1.00	16.66	0.59	8.23	0.16	12.43	3.77	1.64	11.26	0.17	0.22	9.02	1.27	0.39	0.53	5.41	1.11	1.11	11.83	1.30	1.24	9.63	1.83	1.90	14.90	
17.87	0.71	7.92	0.23	16.89	1.06	9.29	0.12	12.55	1.33	1.04	12.3	3.76	3.45	12.47	0.93	1.22	1.43	6.84	0.96	0.96	12.79	0.55	0.57	10.20	0.88	0.57	15.78	
18.15	0.64	8.56	0.96	17.85	0.36	9.65	0.3	12.85	0.88	0.11	12.41	0.42	0.31	12.78	0.6		0.17	7.01	0.79	0.79	13.58	0.24	0.18	10.38	0.24	0.18	16.02	
18.25	0.45	9.01	0.05	17.9	0.01	9.66	0.37	13.22	0.13	0.10	12.51	0.00	0.08	12.86	0.39	2.80	0.20	7.21	0.41	0.41	13.99	0.25	0.22	10.60	0.22	0.22	16.24	
131.14	9.01	56.94	17.9	125.08	9.66	65.92	13.22	96.36	14.46	12.51	12.51		12.86	12.86	14.43		7.21		13.99	13.99	93.82						93.7	

	2007
Janua	0.77
March	1.33
April	2.73
May	2.47
June	2.30
July	2.33
August	2.69
Septe	1.30
Octob	0.55
Novem	0.24
Decem	0.25

2009			2010			2011		2012		Long-term (1967-2011?)		2011	
UNC	West	Precip	UNC	West	Precip	UNC (Doris)	Cum Precip	UNC	Cum Precip	Average Precip	Cum Avg Annual Precip	Flow	2011 Cum. Treated Water (MG)
0.43	0.04	0.43	0.14	0.05	0.14	0.58	0.58	0.1	0.10	0.48	0.48	422.837	422.837
0.10	0.05	0.53	0.62	0.32	0.76	0.48	1.06	0.54	0.64	0.37	0.85	381.547	804.384
1.19	0.24	1.72	1.07	0.46	1.83	0.12	1.18	0.01	0.65	1.07	1.92	445.193	1249.577
2.84	3.16	4.56	3.54	3.88	5.37	1.26	2.44	0.98	1.63	1.79	3.71	550.236	1799.813
2.42	2.19	6.98	1.78	2.12	7.15	3.58	6.02	1.31	2.94	2.45	6.16	773.875	2573.688
3.08	3.17	10.06	4.09	2.24	11.24	0.59	6.61	0.30	3.24	1.90	8.06	1095.21	3668.894
2.78	3.64	12.84	1.24	1.86	12.48	1.25	7.86	1.63	4.87	1.48	9.54	1177.69	4846.584
2.71	1.32	15.55	1.50	1.15	13.98	1.13	8.99	0.04	4.91	1.15	10.69	1105.31	5951.892
0.87	0.87	16.42	0.03	0.07	14.01	0.75	9.74	1.32	6.23	1.11	11.80	959.001	6910.893
2.02	0.69	18.44	0.56	0.38	14.57	2.46	12.20	1.35	7.58	1.03	12.83	675.575	7586.468
0.78	0.26	19.22	0.73	0.82	15.30	0.95	13.15	0.52	8.10	0.78	13.61	410.781	7997.249
0.98	0.08	20.20	0.41	0.00	15.71	0.82	13.97	0.34	8.44	0.41	14.02	417.66	8414.909

127

30yr Avg Based on Smoothed Data
www.wrcc.dri.edu/

2008	2009	2010
0.14	0.43	0.14
0.51	1.19	1.07
0.83	2.84	3.54
1.93	2.42	1.78
1.91	3.08	4.09
0.63	2.78	1.24
7.02	2.71	1.50
1.83	0.87	0.03
0.88	2.02	0.56
0.24	0.78	0.73
0.22	0.98	0.41

SEND #'s to Frank

*where does the

Day	Historic Avg Temp	2022 Temps	Month	Day	*Need to refresh
1-Jan	16.69	2.96	1	1	
2-Jan	19.60	6.14	1	2	
3-Jan	23.49	18.55	1	3	
4-Jan	22.53	35.23	1	4	Row Labels
5-Jan	24.80	11.54	1	5	1
6-Jan	24.11	4.10	1	6	2
7-Jan	24.39	16.60	1	7	3
8-Jan	27.88	31.25	1	8	4
9-Jan	26.95	22.73	1	9	5
10-Jan	24.49	23.79	1	10	6
11-Jan	25.48	26.69	1	11	7
12-Jan	23.05	30.54	1	12	8
13-Jan	26.06	33.98	1	13	9
14-Jan	27.68	34.49	1	14	10
15-Jan	26.61	27.47	1	15	11
16-Jan	27.09	32.32	1	16	12
17-Jan	28.86	30.67	1	17	(blank)
18-Jan	32.17	34.16	1	18	Grand Total
19-Jan	31.44	21.39	1	19	
20-Jan	30.92	20.58	1	20	
21-Jan	29.23	30.03	1	21	
22-Jan	27.69	30.15	1	22	
23-Jan	29.02	31.88	1	23	
24-Jan	29.32	33.30	1	24	
25-Jan	30.12	26.32	1	25	
26-Jan	30.42	17.67	1	26	
27-Jan	30.67	23.19	1	27	
28-Jan	31.02	18.39	1	28	
29-Jan	31.62	24.66	1	29	
30-Jan	30.55	26.31	1	30	
31-Jan	28.32	28.73	1	31	
1-Feb	25.48	24.05	2	1	
2-Feb	25.87	8.13	2	2	
3-Feb	28.73	-1.93	2	3	
4-Feb	28.65	12.15	2	4	
5-Feb	31.35	29.17	2	5	
6-Feb	30.78	30.22	2	6	
7-Feb	30.13	27.99	2	7	
8-Feb	28.67	39.24	2	8	
9-Feb	29.30	35.72	2	9	
10-Feb	30.03	39.43	2	10	
11-Feb	29.06	33.85	2	11	
12-Feb	30.61	25.92	2	12	
13-Feb	34.54	33.44	2	13	
14-Feb	32.27	34.42	2	14	
15-Feb	30.55	38.29	2	15	
16-Feb	32.03	27.59	2	16	
17-Feb	33.08	20.28	2	17	
18-Feb	32.96	28.02	2	18	
19-Feb	34.58	34.88	2	19	
20-Feb	32.61	42.18	2	20	
21-Feb	32.96	23.77	2	21	
22-Feb	34.29	2.61	2	22	
23-Feb	32.76	3.42	2	23	

24-Feb	32.88	9.91	2	24
25-Feb	30.77	13.33	2	25
26-Feb	31.82	19.65	2	26
27-Feb	32.68	30.60	2	27
28-Feb	33.44	42.55	2	28
1-Mar	34.84	47.50	3	1
2-Mar	33.26	47.86	3	2
3-Mar	36.23	48.96	3	3
4-Mar	35.87	45.05	3	4
5-Mar	35.80	30.73	3	5
6-Mar	39.06	21.60	3	6
7-Mar	35.82	22.57	3	7
8-Mar	36.27	27.05	3	8
9-Mar	37.28	12.91	3	9
10-Mar	37.76	7.49	3	10
11-Mar	38.82	16.77	3	11
12-Mar	41.62	35.25	3	12
13-Mar	42.28	43.62	3	13
14-Mar	42.03	44.42	3	14
15-Mar	42.96	45.94	3	15
16-Mar	43.58	43.81	3	16
17-Mar	42.70	35.53	3	17
18-Mar	40.57	38.38	3	18
19-Mar	40.91	44.47	3	19
20-Mar	41.62	48.44	3	20
21-Mar	42.56	38.63	3	21
22-Mar	45.62	36.48	3	22
23-Mar	44.22	44.50	3	23
24-Mar	41.76	50.28	3	24
25-Mar	42.15	45.35	3	25
26-Mar	43.81	52.30	3	26
27-Mar	44.24	45.37	3	27
28-Mar	44.87	54.88	3	28
29-Mar	43.65	46.55	3	29
30-Mar	43.24	37.23	3	30
31-Mar	45.15	47.13	3	31
1-Apr	46.69		4	1
2-Apr	44.08		4	2
3-Apr	42.53		4	3
4-Apr	44.85		4	4
5-Apr	48.90		4	5
6-Apr	46.48		4	6
7-Apr	45.83		4	7
8-Apr	47.03		4	8
9-Apr	46.37		4	9
10-Apr	44.97		4	10
11-Apr	47.24		4	11
12-Apr	49.34		4	12
13-Apr	50.92		4	13
14-Apr	50.60		4	14
15-Apr	47.37		4	15
16-Apr	44.79		4	16
17-Apr	47.29		4	17
18-Apr	48.66		4	18
19-Apr	49.24		4	19

20-Apr	47.89	4	20
21-Apr	49.56	4	21
22-Apr	49.19	4	22
23-Apr	49.62	4	23
24-Apr	48.60	4	24
25-Apr	48.24	4	25
26-Apr	49.16	4	26
27-Apr	49.88	4	27
28-Apr	51.39	4	28
29-Apr	49.76	4	29
30-Apr	49.41	4	30
1-May	47.89	5	1
2-May	48.52	5	2
3-May	52.57	5	3
4-May	54.54	5	4
5-May	55.20	5	5
6-May	56.55	5	6
7-May	54.92	5	7
8-May	54.42	5	8
9-May	54.57	5	9
10-May	53.97	5	10
11-May	51.16	5	11
12-May	52.78	5	12
13-May	55.88	5	13
14-May	55.88	5	14
15-May	56.69	5	15
16-May	57.87	5	16
17-May	57.91	5	17
18-May	58.44	5	18
19-May	58.00	5	19
20-May	58.52	5	20
21-May	61.22	5	21
22-May	60.40	5	22
23-May	58.87	5	23
24-May	57.81	5	24
25-May	58.61	5	25
26-May	60.23	5	26
27-May	62.31	5	27
28-May	64.40	5	28
29-May	62.45	5	29
30-May	61.39	5	30
31-May	62.19	5	31
1-Jun	64.06	6	1
2-Jun	65.52	6	2
3-Jun	62.77	6	3
4-Jun	61.37	6	4
5-Jun	62.63	6	5
6-Jun	66.30	6	6
7-Jun	66.48	6	7
8-Jun	65.45	6	8
9-Jun	65.77	6	9
10-Jun	66.39	6	10
11-Jun	65.97	6	11
12-Jun	65.30	6	12
13-Jun	64.52	6	13

14-Jun	65.90	6	14
15-Jun	66.84	6	15
16-Jun	65.90	6	16
17-Jun	66.80	6	17
18-Jun	68.35	6	18
19-Jun	69.36	6	19
20-Jun	68.50	6	20
21-Jun	70.15	6	21
22-Jun	69.75	6	22
23-Jun	71.06	6	23
24-Jun	71.75	6	24
25-Jun	71.86	6	25
26-Jun	71.45	6	26
27-Jun	71.00	6	27
28-Jun	71.77	6	28
29-Jun	73.00	6	29
30-Jun	71.96	6	30
1-Jul	72.81	7	1
2-Jul	73.51	7	2
3-Jul	72.84	7	3
4-Jul	73.56	7	4
5-Jul	73.37	7	5
6-Jul	72.14	7	6
7-Jul	72.02	7	7
8-Jul	72.30	7	8
9-Jul	72.40	7	9
10-Jul	73.02	7	10
11-Jul	73.85	7	11
12-Jul	73.45	7	12
13-Jul	75.20	7	13
14-Jul	75.32	7	14
15-Jul	74.64	7	15
16-Jul	74.34	7	16
17-Jul	75.22	7	17
18-Jul	75.81	7	18
19-Jul	76.13	7	19
20-Jul	75.91	7	20
21-Jul	74.98	7	21
22-Jul	74.47	7	22
23-Jul	74.76	7	23
24-Jul	73.93	7	24
25-Jul	72.73	7	25
26-Jul	72.18	7	26
27-Jul	72.85	7	27
28-Jul	72.69	7	28
29-Jul	72.18	7	29
30-Jul	72.59	7	30
31-Jul	73.70	7	31
1-Aug	72.53	8	1
2-Aug	72.76	8	2
3-Aug	71.89	8	3
4-Aug	70.45	8	4
5-Aug	71.27	8	5
6-Aug	71.79	8	6
7-Aug	71.75	8	7

8-Aug	72.55	8	8
9-Aug	70.94	8	9
10-Aug	70.37	8	10
11-Aug	71.55	8	11
12-Aug	70.65	8	12
13-Aug	69.80	8	13
14-Aug	70.36	8	14
15-Aug	69.64	8	15
16-Aug	69.12	8	16
17-Aug	68.92	8	17
18-Aug	69.03	8	18
19-Aug	67.66	8	19
20-Aug	69.81	8	20
21-Aug	71.09	8	21
22-Aug	70.76	8	22
23-Aug	70.71	8	23
24-Aug	70.84	8	24
25-Aug	70.05	8	25
26-Aug	71.34	8	26
27-Aug	70.25	8	27
28-Aug	69.65	8	28
29-Aug	69.64	8	29
30-Aug	70.25	8	30
31-Aug	68.34	8	31
1-Sep	68.32	9	1
2-Sep	68.03	9	2
3-Sep	67.72	9	3
4-Sep	67.46	9	4
5-Sep	67.56	9	5
6-Sep	67.08	9	6
7-Sep	64.33	9	7
8-Sep	64.09	9	8
9-Sep	64.79	9	9
10-Sep	64.50	9	10
11-Sep	64.39	9	11
12-Sep	63.59	9	12
13-Sep	61.24	9	13
14-Sep	60.71	9	14
15-Sep	61.18	9	15
16-Sep	62.62	9	16
17-Sep	61.92	9	17
18-Sep	61.56	9	18
19-Sep	60.91	9	19
20-Sep	60.14	9	20
21-Sep	58.56	9	21
22-Sep	56.62	9	22
23-Sep	57.58	9	23
24-Sep	57.34	9	24
25-Sep	58.42	9	25
26-Sep	59.53	9	26
27-Sep	58.53	9	27
28-Sep	57.69	9	28
29-Sep	58.06	9	29
30-Sep	57.84	9	30
1-Oct	56.97	10	1

2-Oct	55.17	10	2
3-Oct	54.10	10	3
4-Oct	51.30	10	4
5-Oct	51.55	10	5
6-Oct	50.81	10	6
7-Oct	52.06	10	7
8-Oct	51.57	10	8
9-Oct	49.47	10	9
10-Oct	49.00	10	10
11-Oct	51.24	10	11
12-Oct	48.64	10	12
13-Oct	49.58	10	13
14-Oct	49.99	10	14
15-Oct	49.80	10	15
16-Oct	48.51	10	16
17-Oct	48.07	10	17
18-Oct	47.90	10	18
19-Oct	47.98	10	19
20-Oct	48.42	10	20
21-Oct	46.71	10	21
22-Oct	46.11	10	22
23-Oct	47.79	10	23
24-Oct	47.18	10	24
25-Oct	46.58	10	25
26-Oct	42.96	10	26
27-Oct	42.03	10	27
28-Oct	43.86	10	28
29-Oct	45.95	10	29
30-Oct	41.54	10	30
31-Oct	41.38	10	31
1-Nov	42.16	11	1
2-Nov	39.05	11	2
3-Nov	40.22	11	3
4-Nov	39.96	11	4
5-Nov	39.82	11	5
6-Nov	40.92	11	6
7-Nov	40.95	11	7
8-Nov	41.62	11	8
9-Nov	38.98	11	9
10-Nov	38.50	11	10
11-Nov	36.65	11	11
12-Nov	36.94	11	12
13-Nov	38.66	11	13
14-Nov	38.80	11	14
15-Nov	37.75	11	15
16-Nov	37.42	11	16
17-Nov	38.10	11	17
18-Nov	39.60	11	18
19-Nov	36.56	11	19
20-Nov	34.81	11	20
21-Nov	34.58	11	21
22-Nov	35.88	11	22
23-Nov	33.66	11	23
24-Nov	33.14	11	24
25-Nov	33.10	11	25

26-Nov	32.68	11	26
27-Nov	32.23	11	27
28-Nov	32.09	11	28
29-Nov	30.75	11	29
30-Nov	30.60	11	30
1-Dec	30.83	12	1
2-Dec	31.47	12	2
3-Dec	29.47	12	3
4-Dec	26.42	12	4
5-Dec	25.78	12	5
6-Dec	24.87	12	6
7-Dec	25.24	12	7
8-Dec	25.32	12	8
9-Dec	25.19	12	9
10-Dec	25.32	12	10
11-Dec	26.48	12	11
12-Dec	25.97	12	12
13-Dec	27.64	12	13
14-Dec	28.11	12	14
15-Dec	25.68	12	15
16-Dec	25.53	12	16
17-Dec	25.37	12	17
18-Dec	24.79	12	18
19-Dec	24.83	12	19
20-Dec	25.72	12	20
21-Dec	23.41	12	21
22-Dec	21.34	12	22
23-Dec	21.46	12	23
24-Dec	21.68	12	24
25-Dec	22.99	12	25
26-Dec	23.85	12	26
27-Dec	26.11	12	27
28-Dec	28.86	12	28
29-Dec	29.04	12	29
30-Dec	29.44	12	30
31-Dec	26.04	12	31

pivot table after entering data

Average of Historic Avg Temp	Average of 2022 Temps
27.17	24.38
31.17	25.32
40.66	38.94
47.86	
56.97	
67.60	
73.71	
70.51	
62.08	
48.52	
36.87	
25.94	
49.19	29.69

11/28/12: wrong year highlighted in system storage chart