


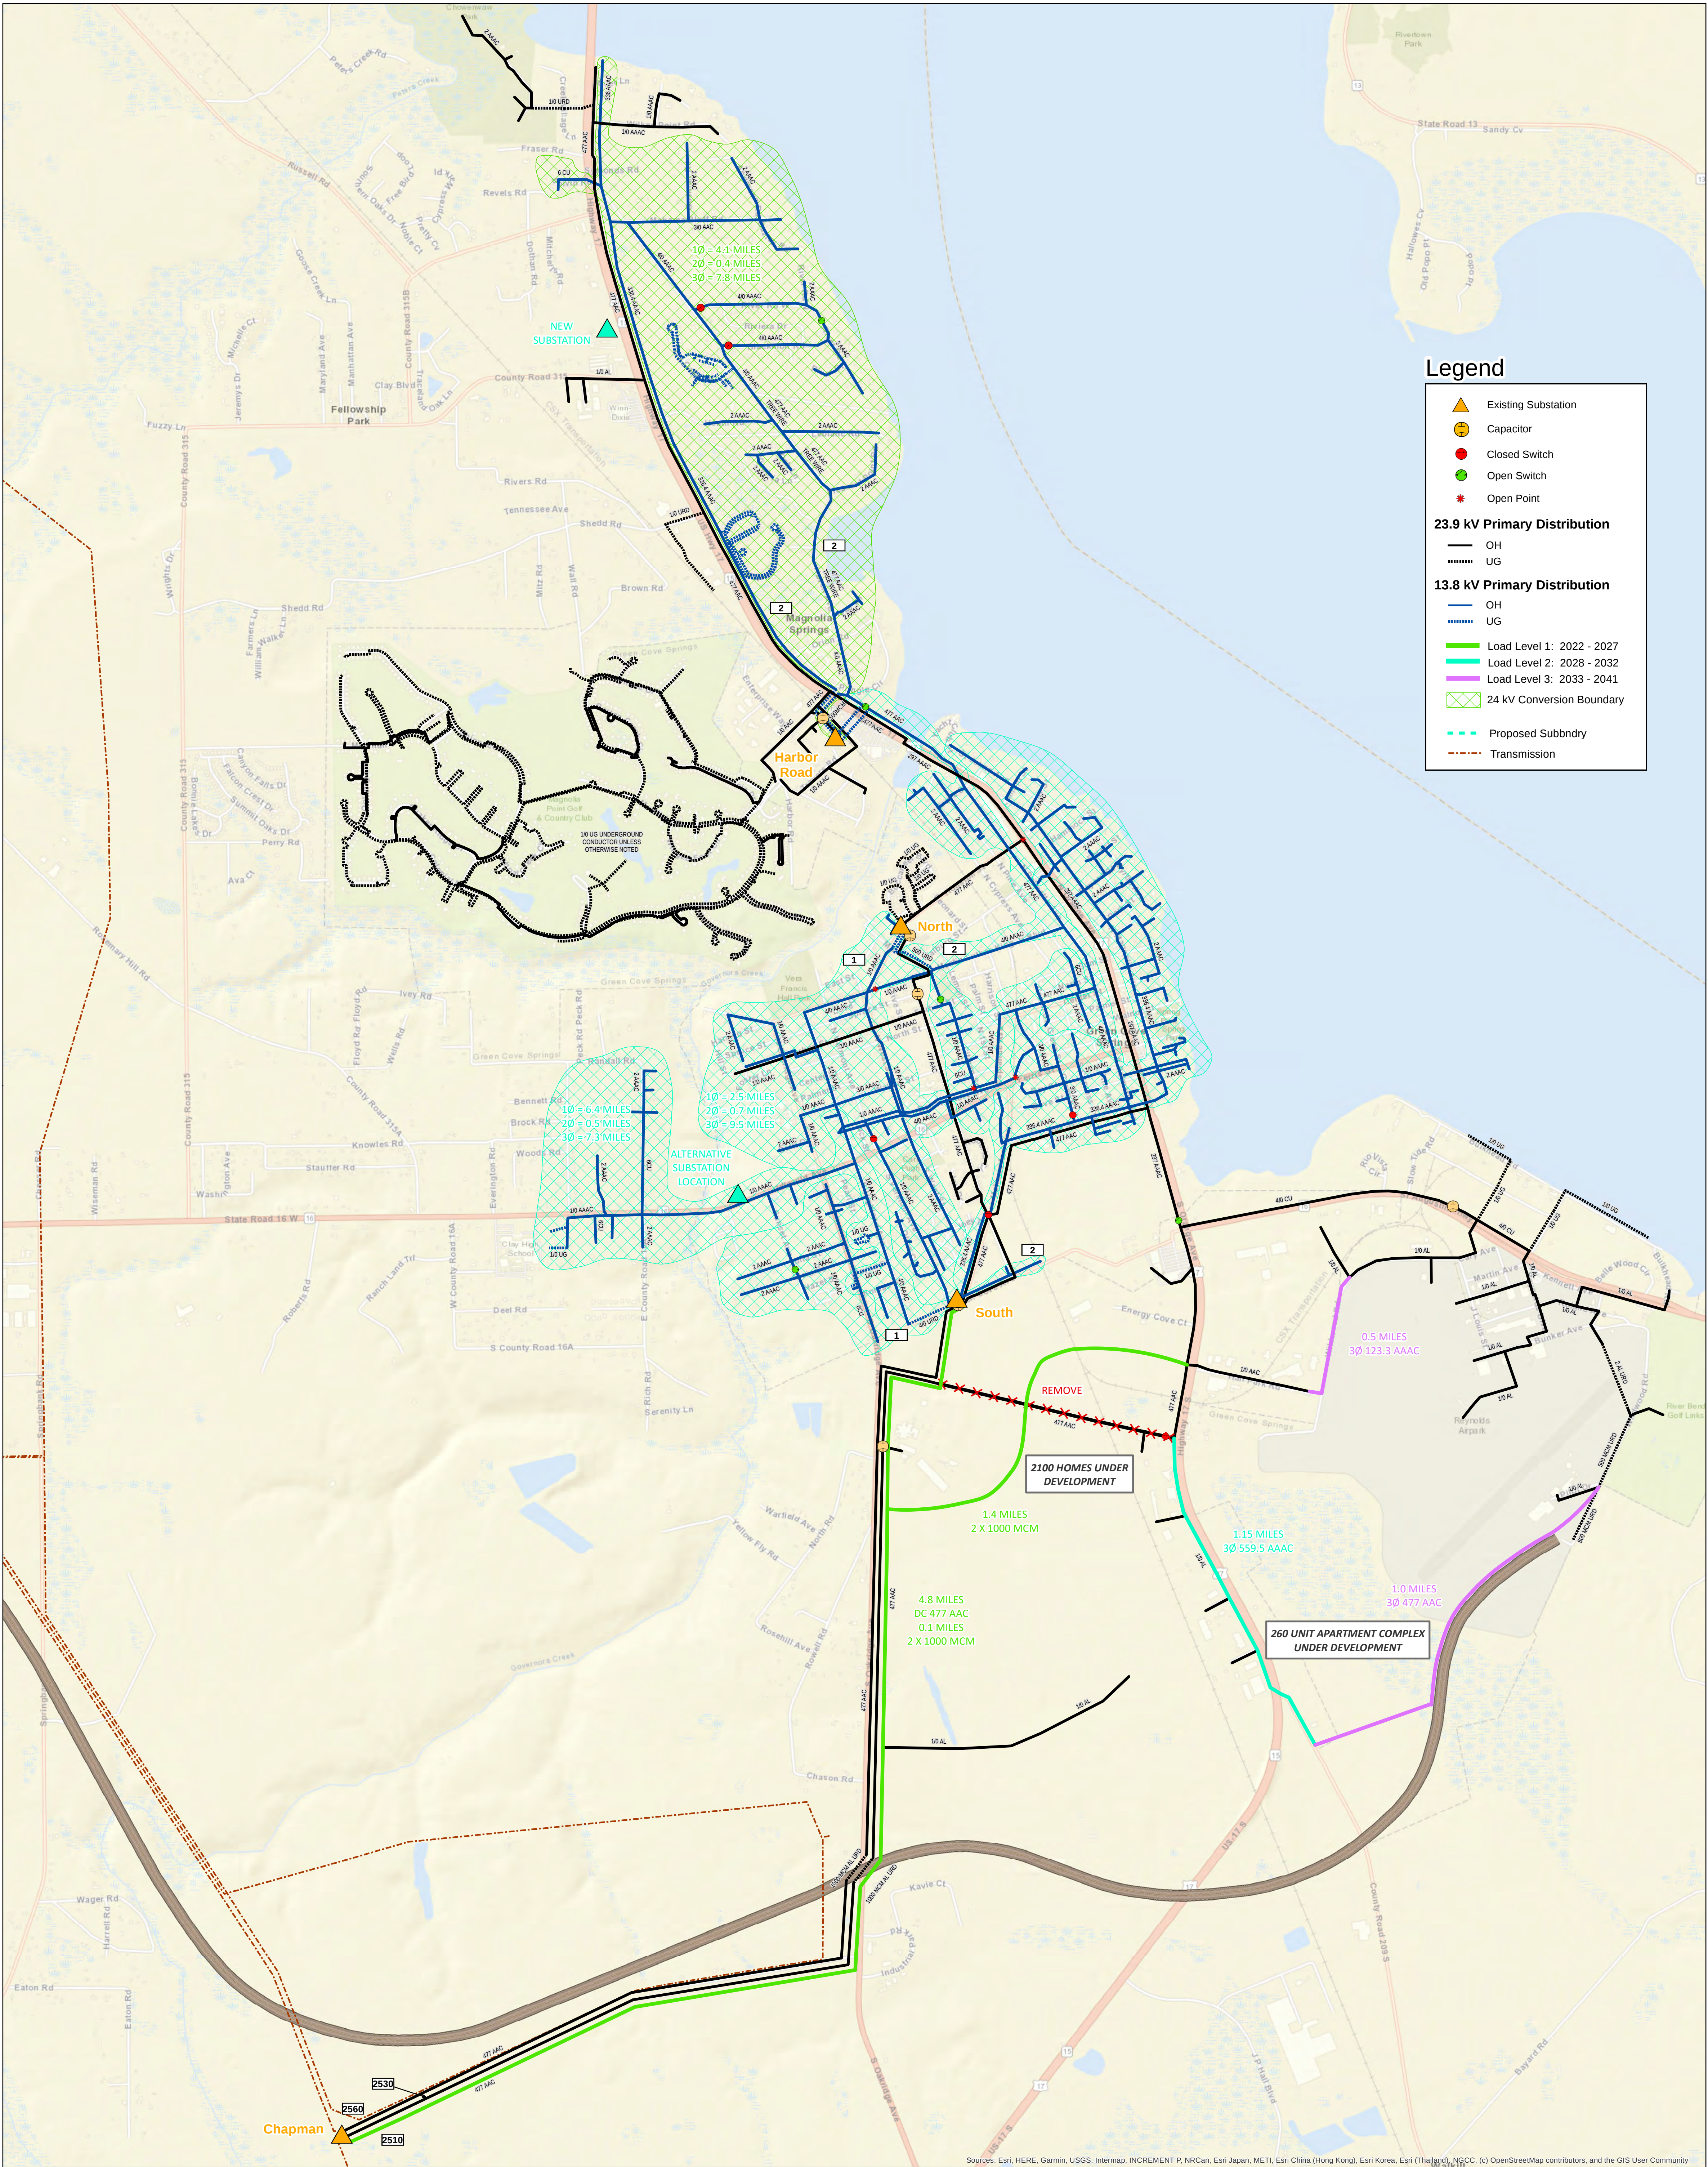

Legend

▲

Existing Substation

⊕

Capacitor

●

Closed Switch

●

Open Switch

*

Open Point

23.9 kV Primary Distribution

—

OH

UG

13.8 kV Primary Distribution

—

OH

UG

Load Level 1: 2022 - 2027

Load Level 2: 2028 - 2032

Load Level 3: 2033 - 2041


24 kV Conversion Boundary

Proposed Subbdry

Transmission



850 Center Way | Norcross, GA 30071
O: 770-453-1410 | F: 770-453-1411
www.pdengineers.com

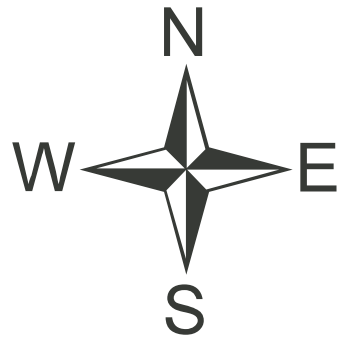

2022 LONG RANGE PLAN

GREEN COVE SPRINGS GREEN COVE SPRINGS, FLORIDA			LRP
DWN BY: LJ	ENGRS FILE: GREEN.COVE.SPRINGS.2022.LRP	DATE: 8/26/2022	