



January 21, 2026

CHAD PELISHEK
W5298 State Road 114
Menasha, WI 54952

THIS LETTER IS YOUR INVOICE FOR ELECTRIC SERVICE

W5662 Manitowoc Rd , Menasha, WI 54952

Dear CHAD PELISHEK,

With your returned service application, you are on your way to having electric service installed at your location.

Please confirm that the following electric service details are correct. If not, please call me right away.

Type:	New Service	Subdivision:	n/a
Class:	Underground	Lot #:	0
Size:	800 amps	Work Request #:	5151845 (for internal use only)
Voltage:	208Y/120V-4W		

Your next steps are to:

1. *Send in payment for electric service installation.*

- **The cost for electric service installation is: \$10,779.80**
- This includes \$660.00 for installation from December 1 through March 31.
- We must receive your payment and electrical inspection before we can schedule your installation. Please include the service address with your payment, and send it to us in the enclosed envelope.
- In the event we encounter unusual conditions during the installation of your service, there may be additional charges.
- This amount is valid for 90 days from the date of this letter.
- If an additional cost estimate is needed within 12 months, there will be a charge for preparing the new estimate.

2. *Sign and return one of the enclosed sketches:*

- Review, sign and return an enclosed sketch in the envelope provided.
- Draw and label any private underground facilities on the sketch.
- We must receive your approved and signed sketch before step #3 below.

3. *Send or fax the Ready for Service card when the site is ready for electric service installation:*

- Your construction site is ready for service when requirements 1-4 on the *Ready for Service* card are met.
- When we receive your card, we will call you to discuss the installation.

4. Mark private underground facilities.

- Locate and mark (with stakes, spray paint or flags) or expose any customer-owned underground obstructions or facilities.
- If you are not sure what this includes, please call for more information.
- We Energies and/or its agents will not be held responsible for damage to unmarked, private facilities.

Contact me for all of your electric installation needs.

I'm here to make sure your questions are answered and any concerns you have are addressed. On behalf of We Energies, I appreciate the opportunity to serve you and look forward to providing you with safe, reliable and reasonably-priced electricity.

Sincerely,

Alexis Kringel
Energy Services Consultant
Phone 920-380-3372; Fax 920-380-3506



ELEC WR **WI 5151845**

GAS WR **####**

CITY / TOWN / VILLAGE: V/HARRISON

CUST/PROJ NAME: VILLAGE OF HARRISON

PROJECT LOCATION: W5662 MANITOWOC RD

WORK DESCRIPTION: EXTEND UNDERGROUND 3PH PRIMARY FOR 800A SERVICE.

PREPARED BY: JOSEPH SALM

E-MAIL: JOSEPH.SALM@WE-ENERGIES.COM

OFFICE #: 920-380-3466 CELL #: 715-281-0022

PAGER #: _____ IO #: 5469

PROJECT ID: WI5151845 CGS #: _____

DATE PREPARED: 12/11/2025 DATE REVISED: _____

RAILROAD PERMITTING/FLAGGING REQUIRED YES NO RR NAME _____

CORROSION CONTACT: _____ PHONE #: _____

COMMON INFORMATION

STAKING REQUIREMENTS:

- SURVEYOR STAKED
- DESIGNER NOT NEEDED

MAIN / SERVICE IN EASEMENT:

- YES NO

RESTORE PRIVATE PROPERTY: WE ENERGIES CUSTOMER

WORK IS APPROX 225 FT, DIRECTION N OF CL OF MANITOWOC RD NEAREST CROSS STREET (ALSO FOR GAS SERVICE TEE)

ELECTRIC INFORMATION

OPER MAP #: _____ FEEDER/LINE #: FDBY64
CATV JOINT USE #: _____ TEL JOINT USE #: _____

PROPOSED GAS SERVICE INFORMATION

MTR SIZE: _____ MTR TYPE: _____ PRES: _____ EFV
 SERV PIPE SIZE: _____ MATERIAL: _____ RELIGHT
 MTR LOC: _____ FT. _____ OF _____ CORNER CURB VLV
 CONSTRUCTION TYPE: _____ TIE IN PIPING

CRITICAL SAFETY RULES - EO:

1. Enclosed space procedures
2. Excavation and shoring
3. Rubber gloves and sleeves
4. Fall protection
5. Lock out - Tag out
6. Seat belts
7. Securing parked vehicles

**CREW TO CONTACT
LARRY PELLATT TO HAVE
PRIVATE FACILITIES
LOCATED.
209-640-8366**



JOB INFO:

SECTION / TOWN / RANGE: NW1/4 SEC 11, T20N, R18E
SITE VISIT COMPLETED BY: JOSEPH SALM
JOB OWNER: ALEXIS HENSCHER, 920-380-3372

MAIN CONTACTS:

- CONTRACTOR/BUILDER: WENDEL COMPANIES, ROBERT BARTECK, 715-832-4848 EXT 2352
- PLUMBER/HVAC: JOHNSON & JONET MECHANICAL CONTRACTOR, JEFF LEMAHIEU, 920-378-1232
- ELECTRICIAN: VOE POWER @ SYSTEMS LLC, ROB VAN OFFEREN, 920-428-4160
- CUSTOMER: VILLAGE OF HARRISON, CHAD PELISHEK, 920-989-1062

CONTINGENCIES & COMMENTS:

DIGGERS HOTLINE / MISS DIG REQUIRED

WE ENERGIES WILL COMPLETE LAWN / PAVEMENT REPAIR ON:

- ROAD ROW NEIGHBORING PROPERTY
- NONE CUSTOMER PROPERTY

WE ENERGIES WILL HAUL SPOIL FROM:

- ROAD ROW NEIGHBORING PROPERTY
- NONE CUSTOMER PROPERTY

CUSTOMER IS REQUIRED TO LOCATE ALL PRIVATE UNDERGROUND FACILITIES PRIOR TO INSTALLATION
WE ENERGIES IS NOT RESPONSIBLE FOR ROOT DAMAGE


CONSTRUCTION REMARKS

*
*

CUSTOMER'S SIGNATURE OF APPROVAL _____ DATE _____

**RELATED GAS WR: 5146672
PRIMARY ALONG HOMESTEAD LN
TO BE INSTALLED BY WR 5146977.**

**BUILDER OK WITH TRENCHING &
BACKFILLING THROUGH FUTURE
HARD SURFACE AREAS.**

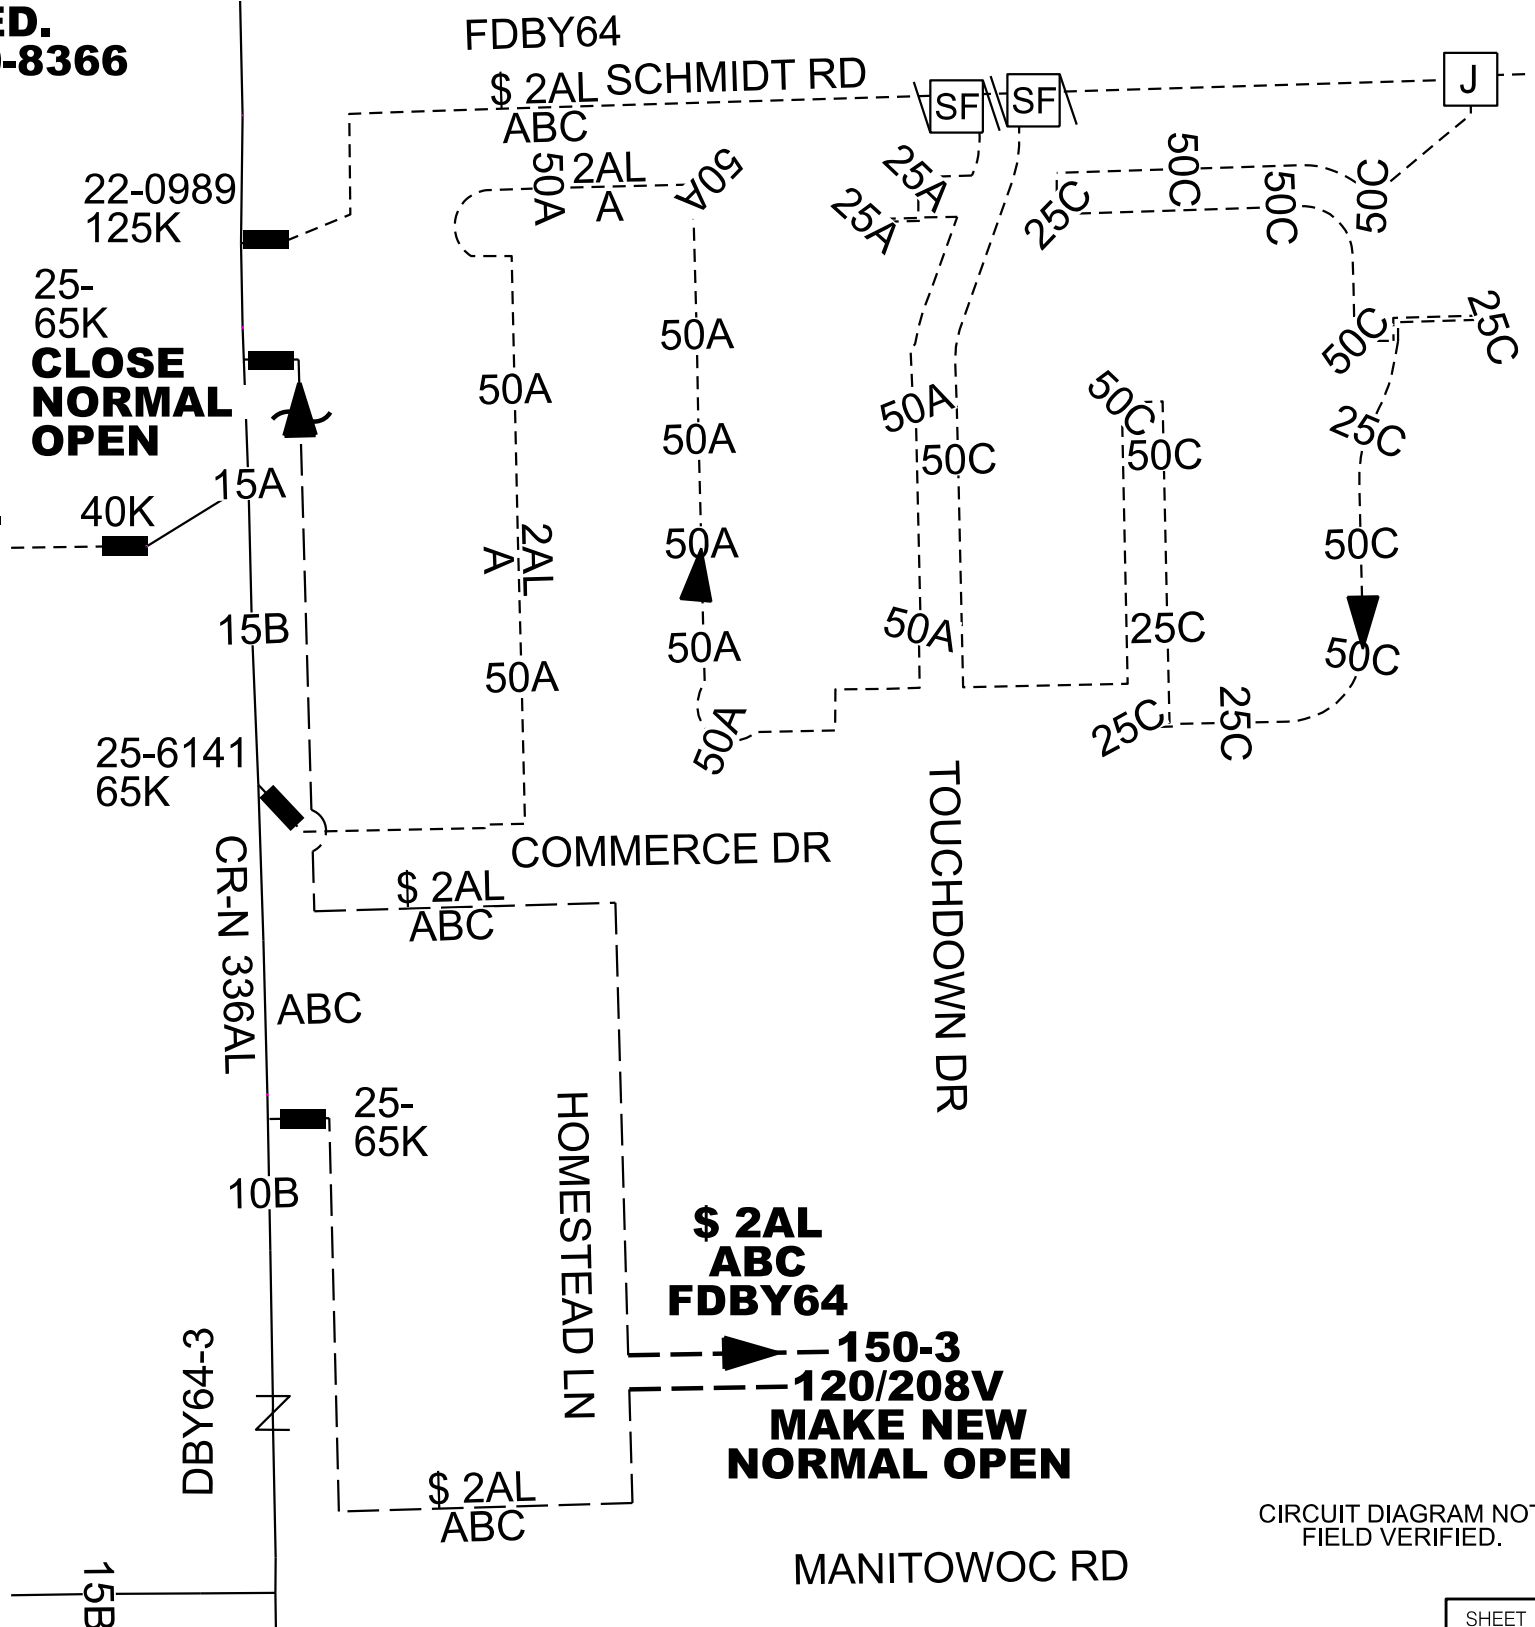


CIRCUIT DIAGRAM NOT FIELD VERIFIED.



**RELATED GAS WR:
5146672**
**PRIMARY ALONG
HOMESTEAD LN TO BE
INSTALLED BY WR
5146977.**

MANUFACTURER:	_____
KVA:	150
VOLTAGE:	120/208
LOCATION ID:	110
PHASE:	ABC
FLUID TYPE:	_____ DESIGN IZ: _____
SERIAL:	_____
MATERIAL #:	T2275022
ASSET ID #:	_____
3 PHASE TRANSFORMER LOAD BREAK SWITCHES?	<input type="checkbox"/> Y <input type="checkbox"/> N
<small>FOR USE ONLY</small> WE ENERGIES EQUIPMENT ENERGIZED	<input type="checkbox"/> Y <input type="checkbox"/> N
<small>FOR USE ONLY</small> Customer EQUIPMENT ENERGIZED	<input type="checkbox"/> Y <input type="checkbox"/> N EDC: _____
<small>FOR USE ONLY</small> SWITCHED BY:	_____ DATE/TIME: _____

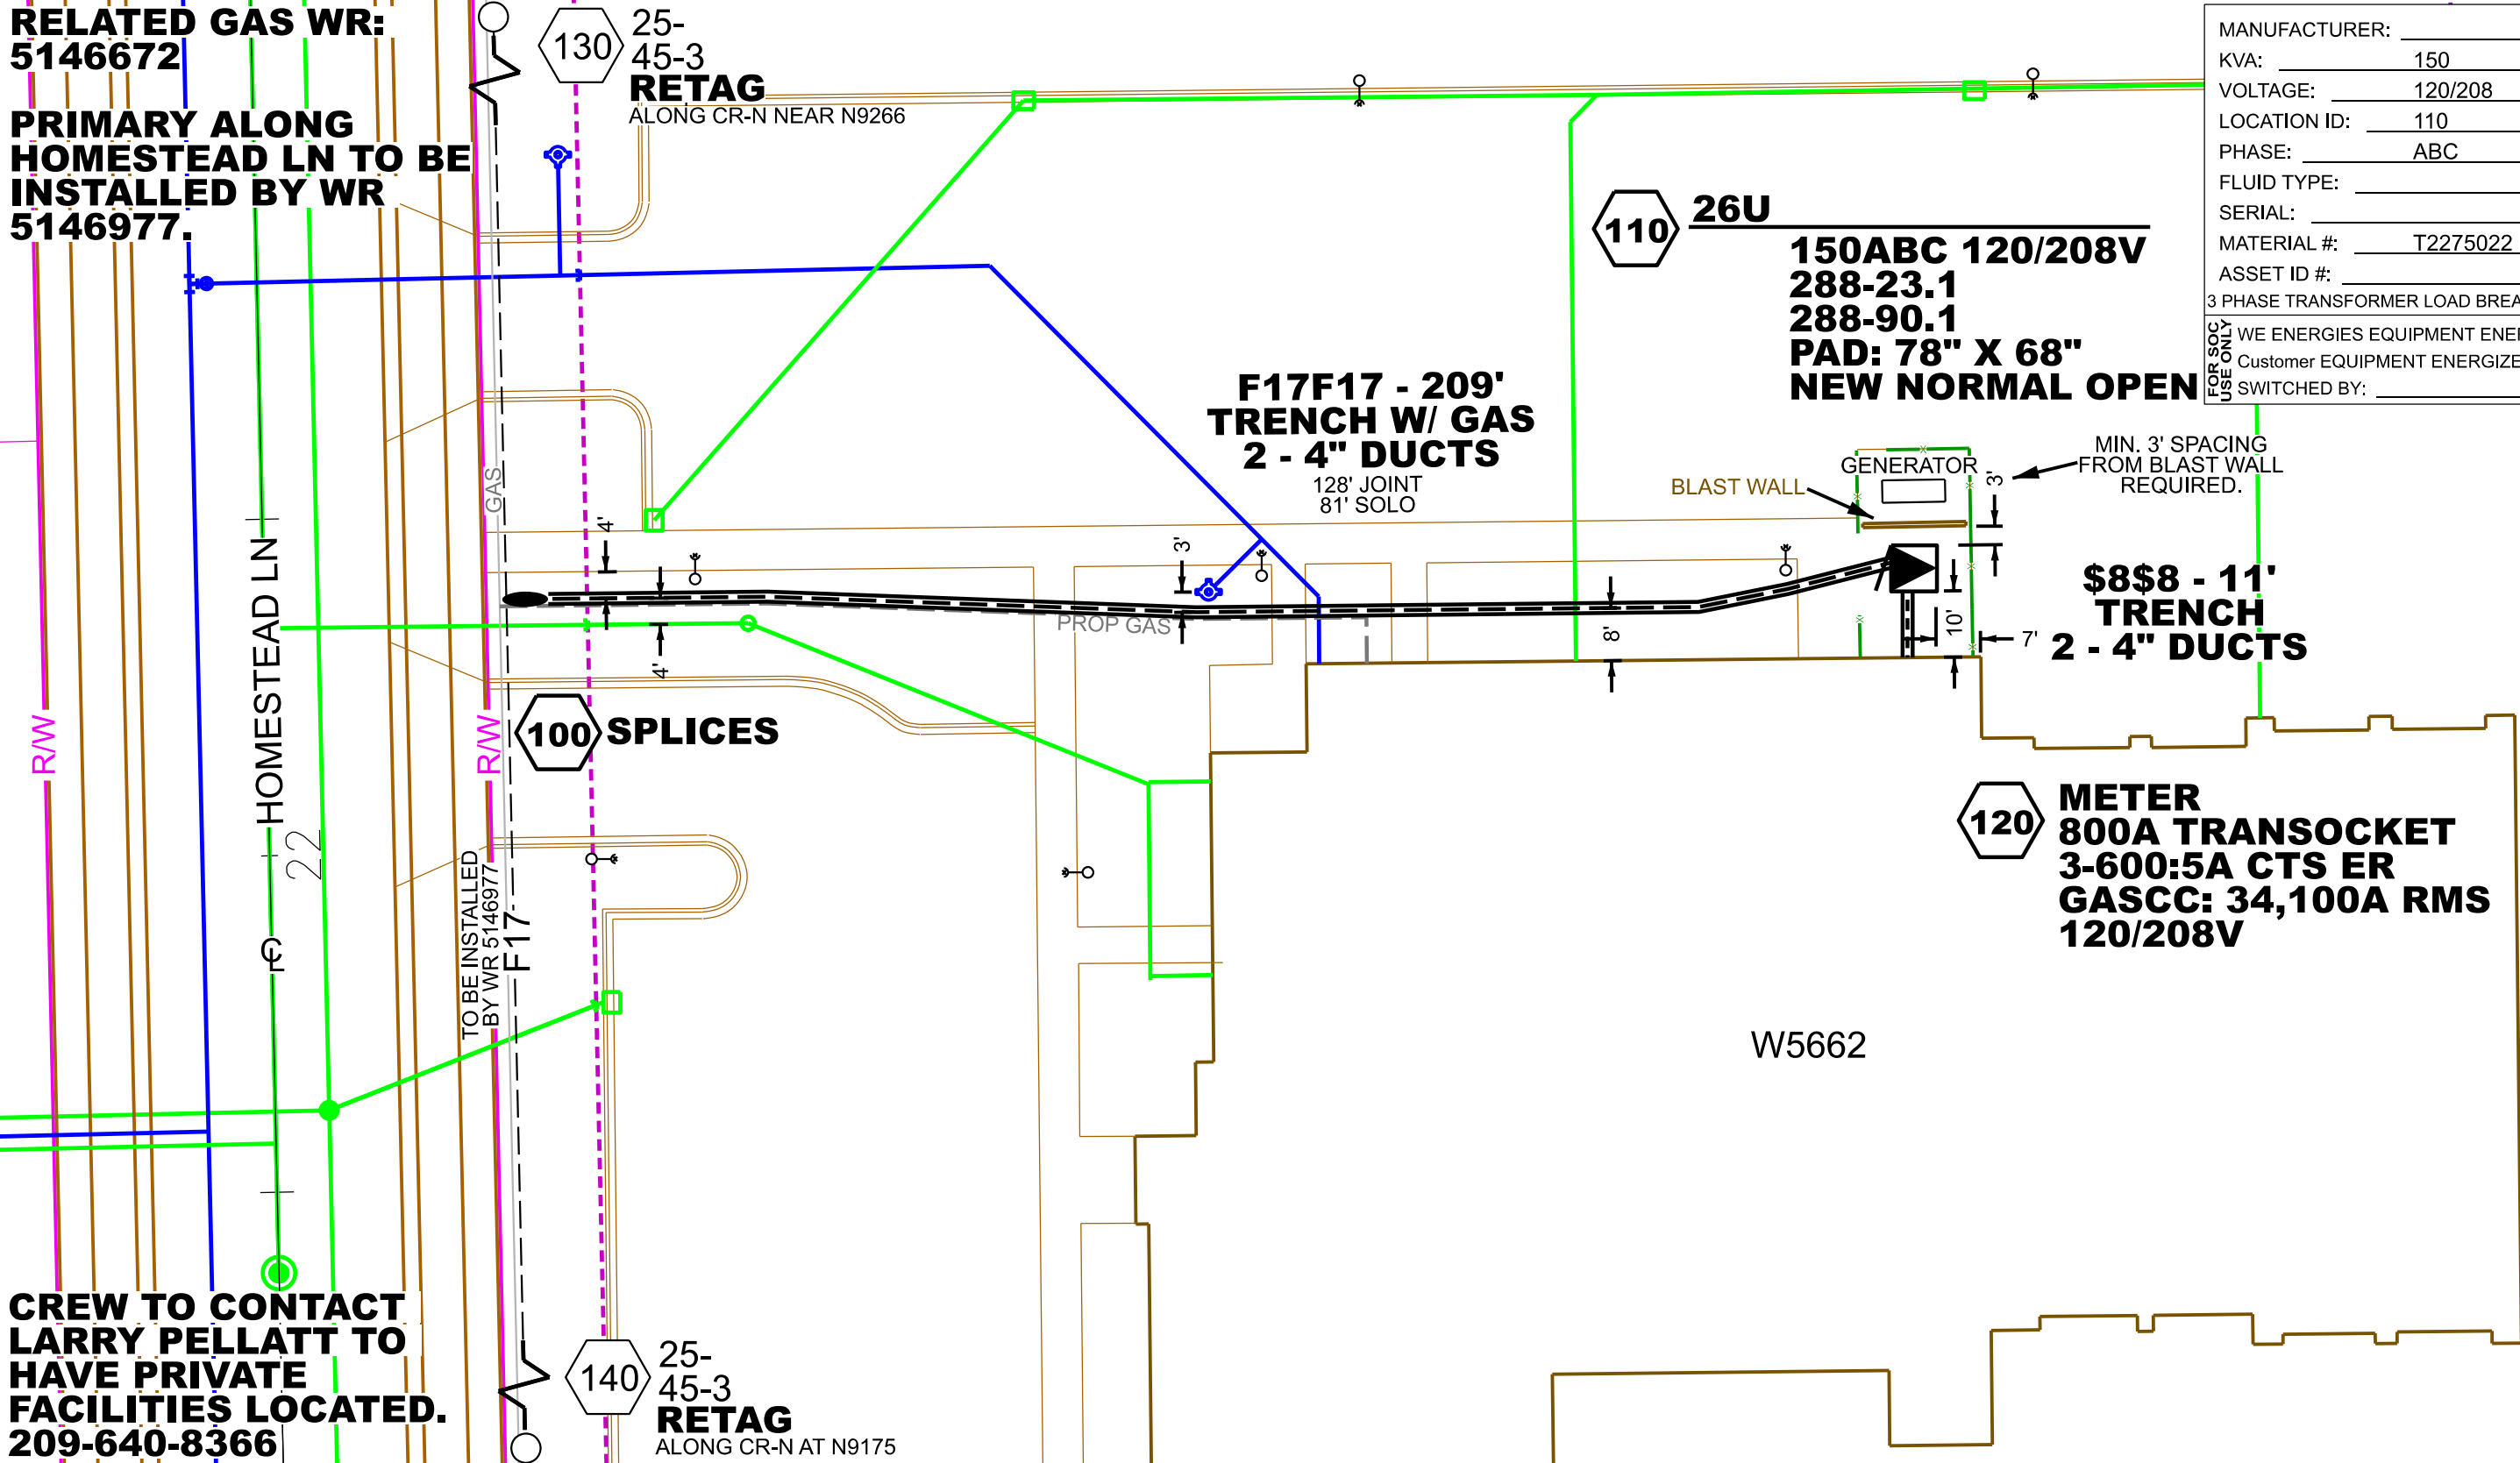

**CREW TO CONTACT
LARRY PELLATT TO
HAVE PRIVATE
FACILITIES LOCATED.
209-640-8366**

WE ENERGIES - ELECTRIC OPERATIONS

CLEARANCE NOTES:

- LOCATION OF OBSTRUCTIONS ARE FROM RECORDS AND MUST BE VERIFIED IN THE FIELD.
- MAINTAIN 2' MIN. CLEARANCE BETWEEN OUTSIDE FACE OF MANHOLE & BELL OF PIPE.
- THIS APPLIES TO GAS AND WATER MAINS.
- MAINTAIN 2' MIN. VERTICAL CLEARANCE AT CROSSINGS OF SEWER OR WATER MAINS.
- MAINTAIN 5' MIN. HORIZONTAL DIST. BETWEEN CONDUIT AND SEWER.
- MAINTAIN 3' MIN. HORIZONTAL DIST. BETWEEN CONDUIT AND WATER MAINS.
- NOTE - CLEARANCES SHOWN ARE MINIMUM DISTANCES - REFERENCE PERMITS FOR SPECIFIC CLEARANCE REQUIREMENTS. ADDITIONAL UNDERGROUND INFORMATION ON EXCAVATION, BACKFILLING AND CLEARANCES CAN BE FOUND IN STD. 281-02.

OVERHEAD PRIMARY
E, F, H, Q, R, W, X or Z

- Z 1 #2 ACSR
- Z1 1 #1/0 ACSR
- Z2 1 #3/0 ACSR
- Z3 3 #2 ACSR
- Z4 3 #1/0 ACSR
- Z5 3 #3/0 ACSR
- Z7 3 #336 ACSR
- Z9 SPECIAL LIST ON SKETCH
- Z10 1 WIRE REMOVAL
- Z11 2 WIRE REMOVAL
- Z12 3WIRE REMOVAL

STANDARD WIRE KEY

DIRECT BURY PRIMARY - E, F, H, Q, R, W, X or Z

- Z13 1 #1 AL 25KV
- Z14 3 #1 AL 25KV
- Z15 3 #500 AL 28KV
- X16 1 #2 AL 15KV
- X17 3 #2 AL 15KV
- X18 3 #500 AL 15KV
- R19 3 #1/0 AL 35KV
- R20 3 #750 AL 35KV
- Z21 3 #750 AL 28KV
- X22 1 #2 Cu 15kV
- X23 3 #2 Cu 15kV
- Z24 1 #2 Cu 25kV
- Z25 3 #2 Cu 25kV
- X26 3 #500 Cu 15kV
- Z27 3 #500 Cu 28kV
- Z28 3 #750 Cu 28kV
- Z29 SPECIAL - LIST ON SKETCH

NEUTRAL

- N 1-#2 ACSR
- N1 1-#1/0 ACSR
- N2 1-#3/0 ACSR
- N3 1-#4/0 AL
- N4 1-#336 ACSR
- N5 REMOVAL

GUYING

- G 1/4" ARM GUY
- G1 5/16" ARM GUY
- G2 3/8" ARM GUY
- G3 5/16" POLE GUY
- G4 3/8" POLE GUY
- G5 7/16" POLE GUY

SECONDARY - 1PHASE

- S 6DX
- S1 4 TX
- S2 2 TX
- S3 1/0 TXR
- S4 3/0 TXR
- S5 350 TXR
- S6 750 TXR
- S7 1/0 TXF
- S8 4/0 TXF
- S9 336 TXR
- S10 750 TXF
- S11 3 WIRE REMOVAL
- S12 3 WIRE MAIN
- S14 6DX CIC
- S15 1/0TX CIC

SECONDARY - 3PHASE

- \$ 1/0 TXF
- \$1 4/0 TXF
- \$2 336 TXF
- \$3 3/0 TX
- \$4 350 TX
- \$5 750 TX
- \$6 1/0 QXF
- \$7 3/0 QXF
- \$8 350 QXR
- \$9 750 QXR
- \$10 3 WIRE REMOVAL
- \$11 3/0 QXR
- \$12 4 WIRE REMOVAL

EROSION CONTROL LEGEND

	APPROXIMATE LOCATION FOR UNDERGROUND FACILITY EXCAVATION
	INLET PROTECTION, TYPE
	12" WATTLE or 12"/20" SEDIMENT LOG or 9.5"/20" EROSION EEL
	STONE DITCH CHECK
	ROCK BAG
	MULCH
	SOIL STABILIZER, TYPE B
	EROSION MAT CLASS I, TYPE A
	EROSION MAT CLASS I, TYPE B
	EROSION MAT CLASS I, TYPE A URBAN
	EROSION MAT CLASS I, TYPE B URBAN
	EROSION MAT CLASS II
	EROSION MAT CLASS III
	VEGETATIVE BUFFER
	TRACKING PAD
	TIMBER MAT
	SILT FENCE
	APPROXIMATE DEWATERING BASIN LOCATION
	SURFACE WATER FLOW

WE ENERGIES WORK REQUEST ENVIRONMENTAL NOTES (Notes 1 through 7 apply to ALL work requests)

General

1. If WDNR and/or USACE permits were obtained for the project, all permit conditions shall be met during construction of the project.

Erosion Control

2. If soil disturbance occurs on slopes or channels/ditches leading to wetlands or waterways, or within wetlands, the disturbed areas shall be stabilized and appropriate erosion control Best Management Practices (BMP's) shall be implemented.
3. Erosion Control BMR's shall meet or exceed the approved WDNR Storm Watter Management Technical Standards (http://dnr.wi.gov/topic/stormwater/standards/const_standards.html). Refer to We Energies Construction Site Sediment and Erosion Control Standards.
4. Inspect installed erosion control BMP's at least one time per week and after 1/2" rain events: repair as necessary.
5. When temporary stabilization is required (e.g. for winter or short-term construction) prior to final restoration, soil stabilizer shall be installed wherever possible. Erosion mat shall be used temporarily only where appropriate, in accordance with state standards, and when approved by the Operations Supervisor.

Contaminated Soils

6. Whenever soil exhibiting obvious signs of contamination (e.g., discoloration, petroleum or solvent odor, free liquids other than water, buried containers or tanks, or other obvious signs of environmental impacts) is encountered during excavation or installation, cease work immediately, take appropriate immediate precautions to ensure worker health and safety, and contact the Operations Supervisor or Inspector.

Spills

7. If an oil spill occurs during construction, call the Environmental Incident Response Team (EIRT) at 414-430-3478:
 - a. Any quantity of oil is spilled into surface water;
 - b. Any oil spill greater than 50 ppm PCB into a sewer, vegetable garden, or grazing land;
 - c. Any oil spill containing greater than 500 ppm PCB;
 - d. Five gallons or more of oil spilled to the ground;
 - e. Any oil spill involving a police department, fire department, DNR, or concerned property owner.

Notes 8 through 27 apply as noted at specific points within each work request:

Dewatering

8. Dewatering of pits or trenches shall be done in accordance with state standards. Use an approved sediment bag, a straw bale dewatering basin, a combination of both, or equivalent.

Wetlands

9. As much as practicable, the majority of the work shall be staged from the public roadways and road shoulders, keeping equipment out of adjacent wetlands.
10. All work shall be conducted to minimize soil disturbance. No rutting will be allowed within the wetlands.
11. If soils are not frozen or stable to a point that avoids rutting, timber mats, mud tracks, or equivalent shall be utilized to access pole locations.
12. Excavated soils cannot be stockpiled in wetlands.

13. All excess spoils shall be removed from wetlands and placed in a suitable upland location.
14. Trenching and pit excavations within wetlands shall include soil segregation to facilitate restoration of pre-construction soil stratification, and restoration to pre-construction elevations.
15. Poles scheduled to be removed, and that occur within wetland, shall be cut at the ground surface.

Waterways

16. No work can be performed within the banks or below the ordinary high watermark of any navigable waterways/streams.
17. No crossing of navigable waterways with equipment can occur. Foot traffic is allowed.
18. Any disturbed soil within 75-feet of the ordinary high water mark of any navigable waterways/streams shall be stabilized within 24 hours of construction completion.

Threatened and Endangered Species

19. Threatened or endangered species are known to occur in the work area. It is illegal to harass, harm, or kill a protected species under state and federal regulations. Proper precautions shall be taken to ensure harm to individuals is avoided.
20. In order to protect the threatened or endangered species, work must be conducted between November 5 and March 15.
21. Exclusion fencing must be installed at the work area prior to March 15.
22. A qualified biologist must be present when conducting work at this location.

Invasive Species

23. State regulated invasive species are known to occur in the work area. Reasonable precautions are legally required to prevent the spread of these species. The Wisconsin Council on Forestry Transportation and Utility Rights-of-Way Best Management Practices should be followed: (<http://council.wisconsinforestry.org/invasives/transportation/>).

Cultural and Historical Resources, cont.

24. The project is within or adjacent to an area that is identified by the State of Wisconsin as potentially having Native American artifacts, burial mounds or burial sites, which could be encountered during construction.
25. If human bone or any artifacts are discovered during construction, work must cease immediately. Contact the Environmental Department who will contact the State Burial Sites Preservation Office and determine the next steps that must be taken in order to comply with state law. Work at that site MAY NOT PROCEED until the Environmental Department authorizes it.
26. A "qualified archaeologist," as specified under Wis. Stats 157.70 (1) (i) and Wis. Admin. Code HS 2.04 (6), must be present to monitor all ground disturbing activities.

Frac-out Contingency Plan

27. A frac-out contingency plan shall be on-site and implemented accordingly. The contingency plan shall incorporate the following components.
 - a. Continuously inspect the bore paths for frac-outs in order to respond quickly and appropriately.
 - b. Containment materials (e.g. silt fence, straw bales, sand bags, etc.) shall be on site and available should a frac-out occur.
 - c. A vac truck shall be accessible on short notice in order to respond quickly to a frac-out.



Are you ready for electric service?




Important!

The electric ready for service card must be completed, signed and returned to us before we can begin your new service installation.

If the site is not ready when we arrive to install service, your timeline may be significantly delayed.

To be considered ready for service, check the boxes to confirm that you have completed the following:

- Confirmed all well, drain tiles, septic/mound system, underground yard lighting and/or sprinkler systems are marked clearly with stakes, spray paint or flags.



We Energies and/or its agents will not be held responsible for damage to customer-owned underground facilities that are not properly located and marked before electric service installation. If you are unable to properly locate and mark those buried facilities, you can hire a contractor to do it for you.

- Cleared a minimum 10-foot wide path along the service route from the property line to the marked meter location on the building. Dirt piles and construction materials are out of the way.



We Energies WILL NOT remove any obstacles from construction site.

- Installed We Energies-approved meter socket, pedestal or CT cabinet at the agreed-upon location marked on site sketch.



This applies to both underground and overhead services.

- Prepared ground around building and along the service route to within 4 inches of final grade (applies to underground service only).



The owner of the property, or responsible party, will pay for any relocation or repair costs incurred by We Energies due to grade changes in excess of 4 inches.

- Sent **signed site sketch and payment** (if applicable) and informed We Energies of any future plans for deck, patio or pool.



Once service is installed, costs for moving electric facilities to accommodate new structures will be your responsibility. Building over the top of electric facilities (including the meter) may cause serious safety or code violations.

- I understand that my service will not be energized until We Energies receives my municipal inspection.**

Electric ready for service card | Please complete, sign and return this card when all of the items above have been completed.

If the site is not ready when we arrive to install service, your timeline may be significantly delayed.

Name: VILLAGE OF HARRISON
(please print)

Installation address: W5662 MANITOWOC RD (FIRE DEPT)
(please print)

City: MENASHA

State: WI ZIP code: 54952

Daytime phone: _____

- I certify that I am the owner or authorized representative of the owner.

Signature: _____

Date: 01/21/2026

- Please hold my ready for service card and schedule installation after March 31.

(For We Energies office use only) Order number: 5151845

Additional charges for electric service installation apply from Dec. 1 through March 31.

For new service questions, go to www.we-energies.com/newservice or call 262-574-6400 or 866-423-0364 (toll free).