















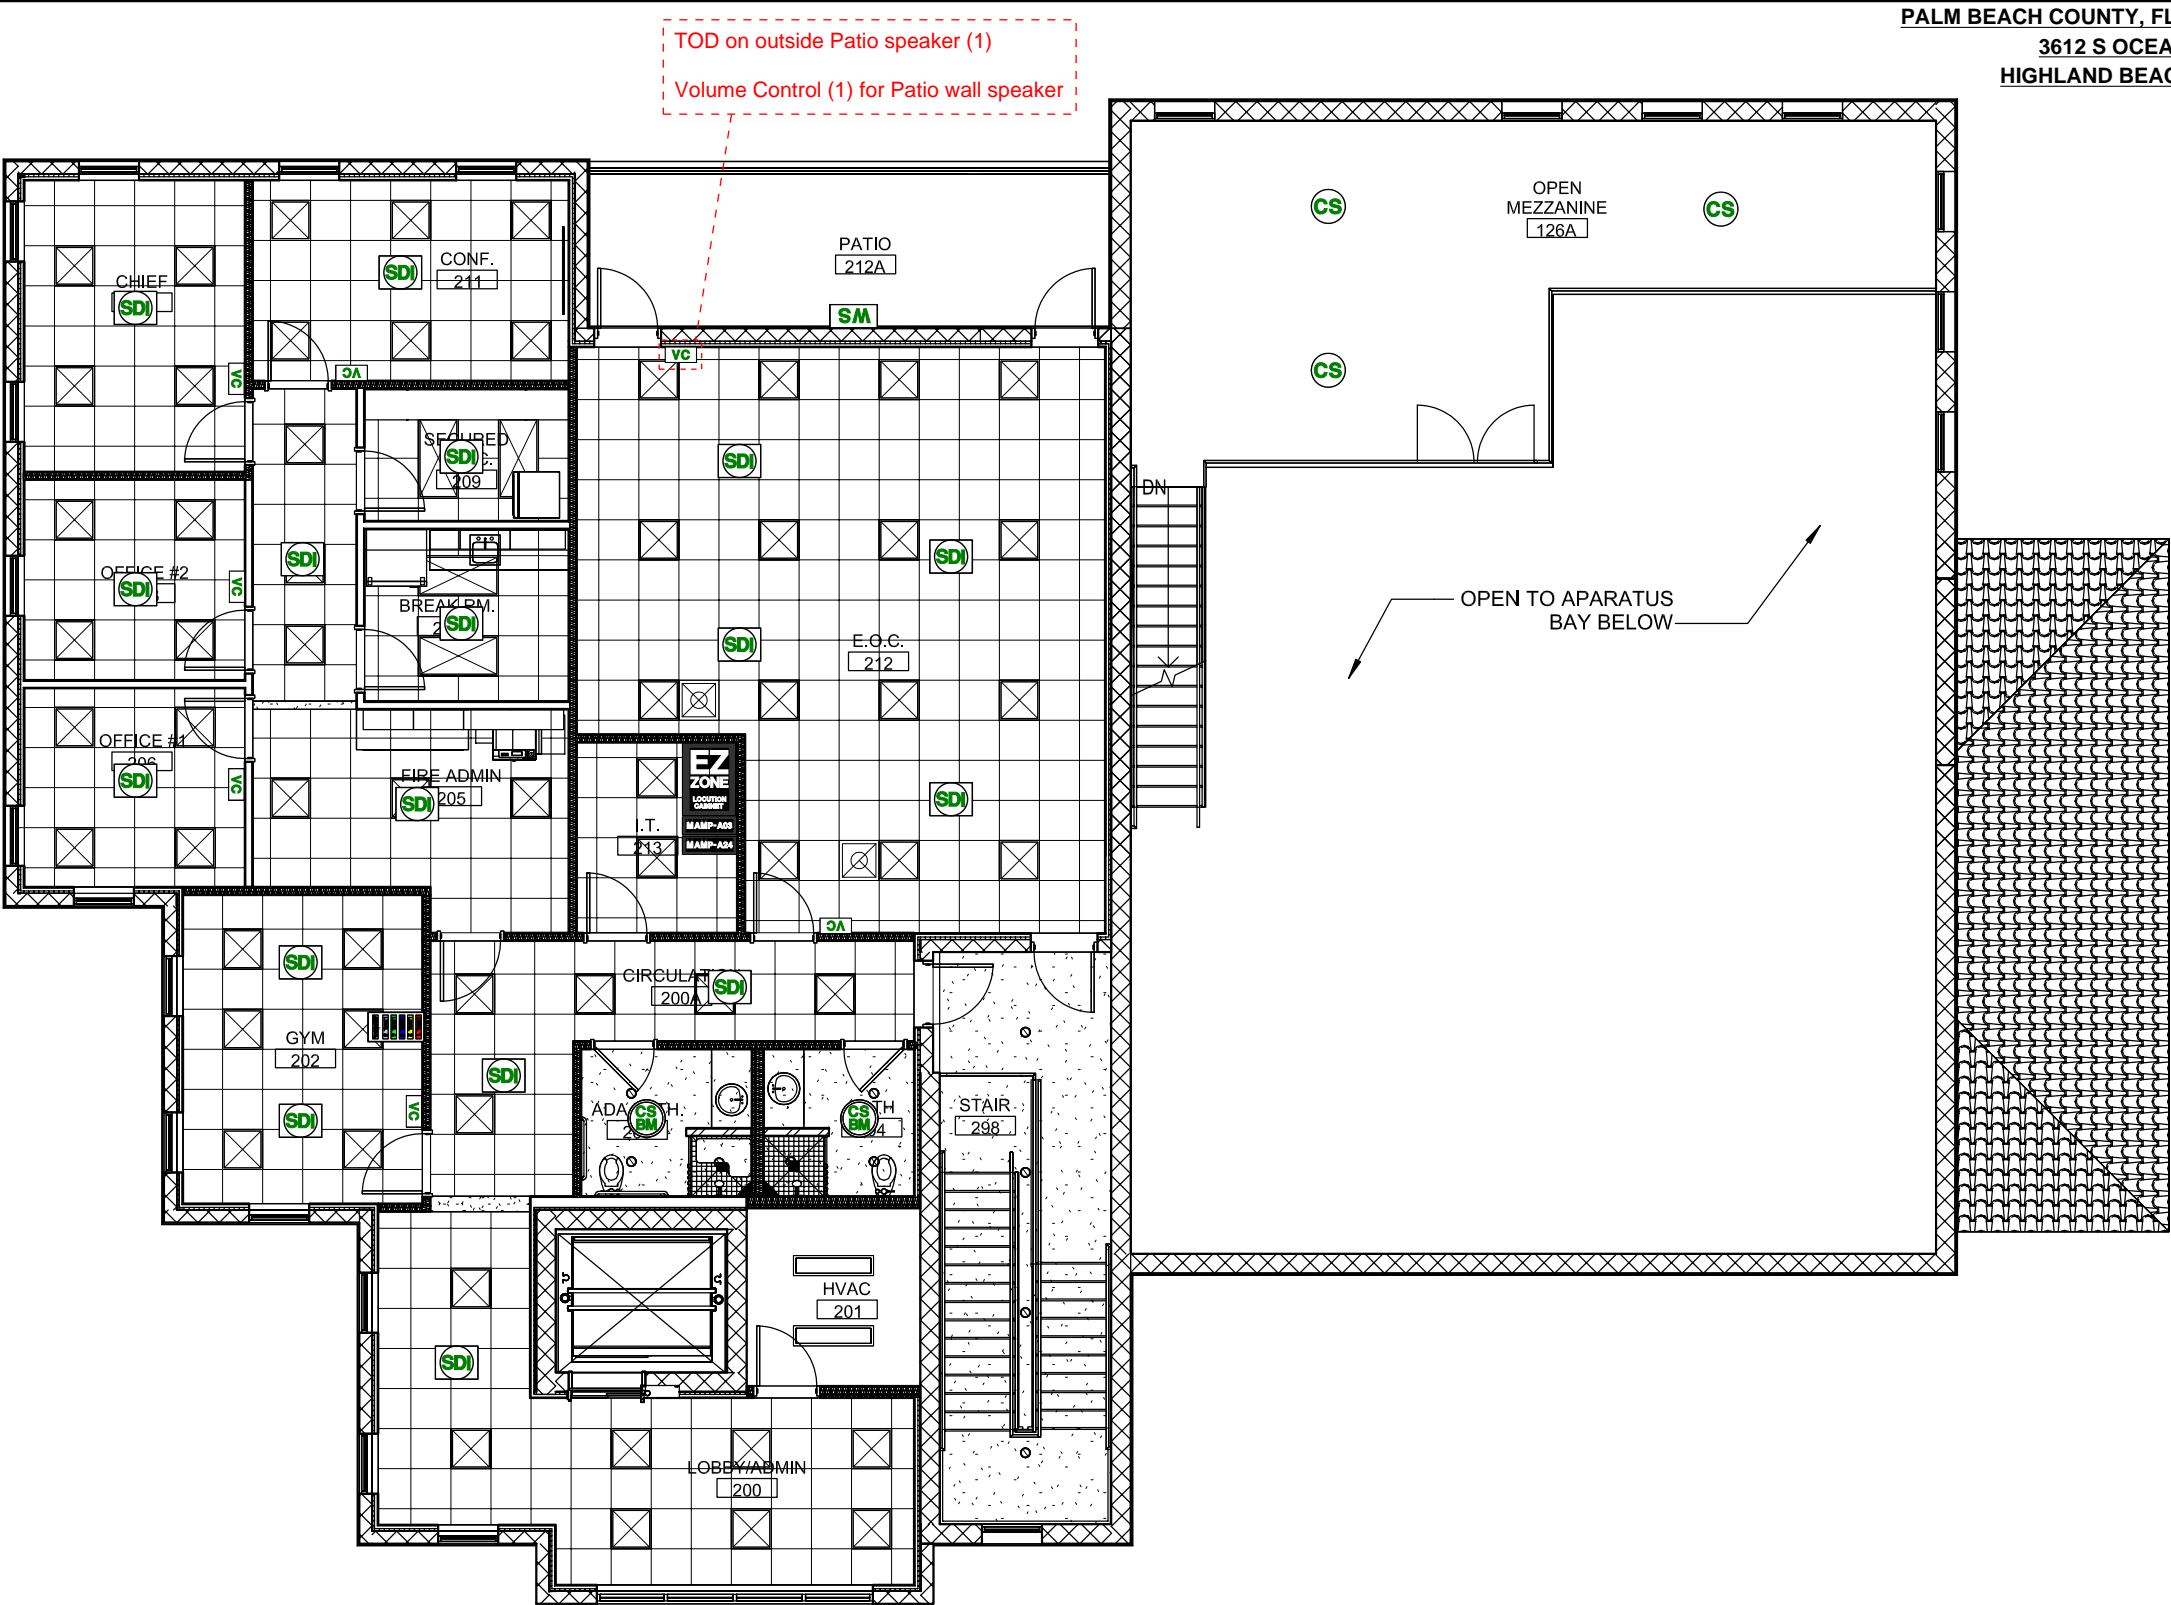



LOCUTION SYSTEMS FSA		
TYPE = EZ-ZONE		
PA TYPE = FULL		
Equipment Icons		
	Description	Quantity
	Amplifier - Single 35W - MAMP-A03	1
	Amplifier - Single 240W - MAMP-A24	1
	Door Bell - LSWI-DB	1
	Locution EZ-Zone Cabinet - LCPN33-EZ	1
	MUI - Flush Mount - 5 Position - TMUI-FM5	2
	NVI - Wall Mount - EZ-Zone - LNVI-EZ-H	8
	NVI - Wall or Ceiling Mount - LNVI-H	8
	Reader Board - 1 Line - MLRB-1L	1
	Speaker - Ceiling - Blind Mount - TSPK-CL-BM	8
	Speaker - Ceiling - TSPK-CL	3
	Speaker - Ceiling Tile - TSPK-TL	25
	Speaker - Ceiling Tile Device Ready - TSPK-TL-DR	11
	Speaker - Horn - TSPK-HR	5
	Speaker - Wall Baffle - TSPK-WB	5
	Station Zone Tracker (Touch Panel) - MZTS	1
	Volume Control - TAVC	23



PALM BEACH COUNTY, FL - FIRE STATION #116
3612 S OCEAN BLVD.
HIGHLAND BEACH, FL 33487

INSTALLATION REFERENCE NOTES TO CIRCUIT NUMBERS ON PRINT FOR LOCUTION FSA HARDWARE	
*Circuits 1 - 20. Only circuits applicable to print shown.	

INSTALLATION NOTES AND ENHANCEMENTS	

This drawing is an approximation based on customer provided prints and may contain inaccuracies, pertaining but not limited to, building features, dimensions, and scale. This is for the purpose of Locution FSA equipment installation only.			
PRINT SUBJECT TO CHANGE WITHOUT NOTICE CONFIDENTIAL DOCUMENT LOCUTION SYSTEMS			
<p>All copies of drawings, technical document, documentation and data prepared or developed by Locution Systems, Inc. and furnished to the Client shall be the property of the Client. However, the proprietary information and rights of Locution Systems, Inc. in the nature of ideas, inventions, design, copyrights, works of authorship and methods of fabrication developed or utilized by Locution Systems, Inc. as specified in this print shall remain the property of Locution Systems, Inc. Therefore, in order to protect the proprietary nature of such information, the Client agrees that any such copies of drawings, technical documents, documentation, and data furnished by Locution Systems, Inc. that are clearly marked proprietary or confidential information of Locution Systems, Inc. will be kept confidential by the Client, and will be maintained and kept in the same manner that the Client maintains and keeps its own confidential and proprietary information. Further, such confidential or proprietary information or rights belonging to Locution Systems, Inc. cannot be copied, transferred, or disclosed to third parties by the Client without the prior written permission of Locution Systems, Inc.</p> <p>Locution Systems, Inc. is not supplying the services of a Registered Professional Engineer. This design layout and our System Proposal is for technical engineering services and equipment supply based on system evaluation and experience in the field. No representation other than this is intended or implied.</p>			
 GOLDEN, COLORADO 80401 303-301-7300			REV B
REVISION DESCRIPTION (REV#) Added ceiling speakers and volume control to EOC room. Added ceiling speakers Mezzanine.			
LOCUTION FSA EQUIPMENT ONLY PALM BEACH COUNTY, FL FIRE STATION #116 SECOND FLOOR & MEZZANINE MARKED PRINT			
PHASE	DRAWN	DATE:	REVIEWED DATE:
TEMPLATE	TB	01/26/2023	TB 01/26/2023
MARK-UP	BK	03/13/2023	XX MODA/202X
CIRCUIT	XX	MODA/202X	XX MODA/202X
SIZE		17 x 11	SHEET 2 OF 2