




LEFT ELEVATION
SCALE: 1/4"=1'-0"

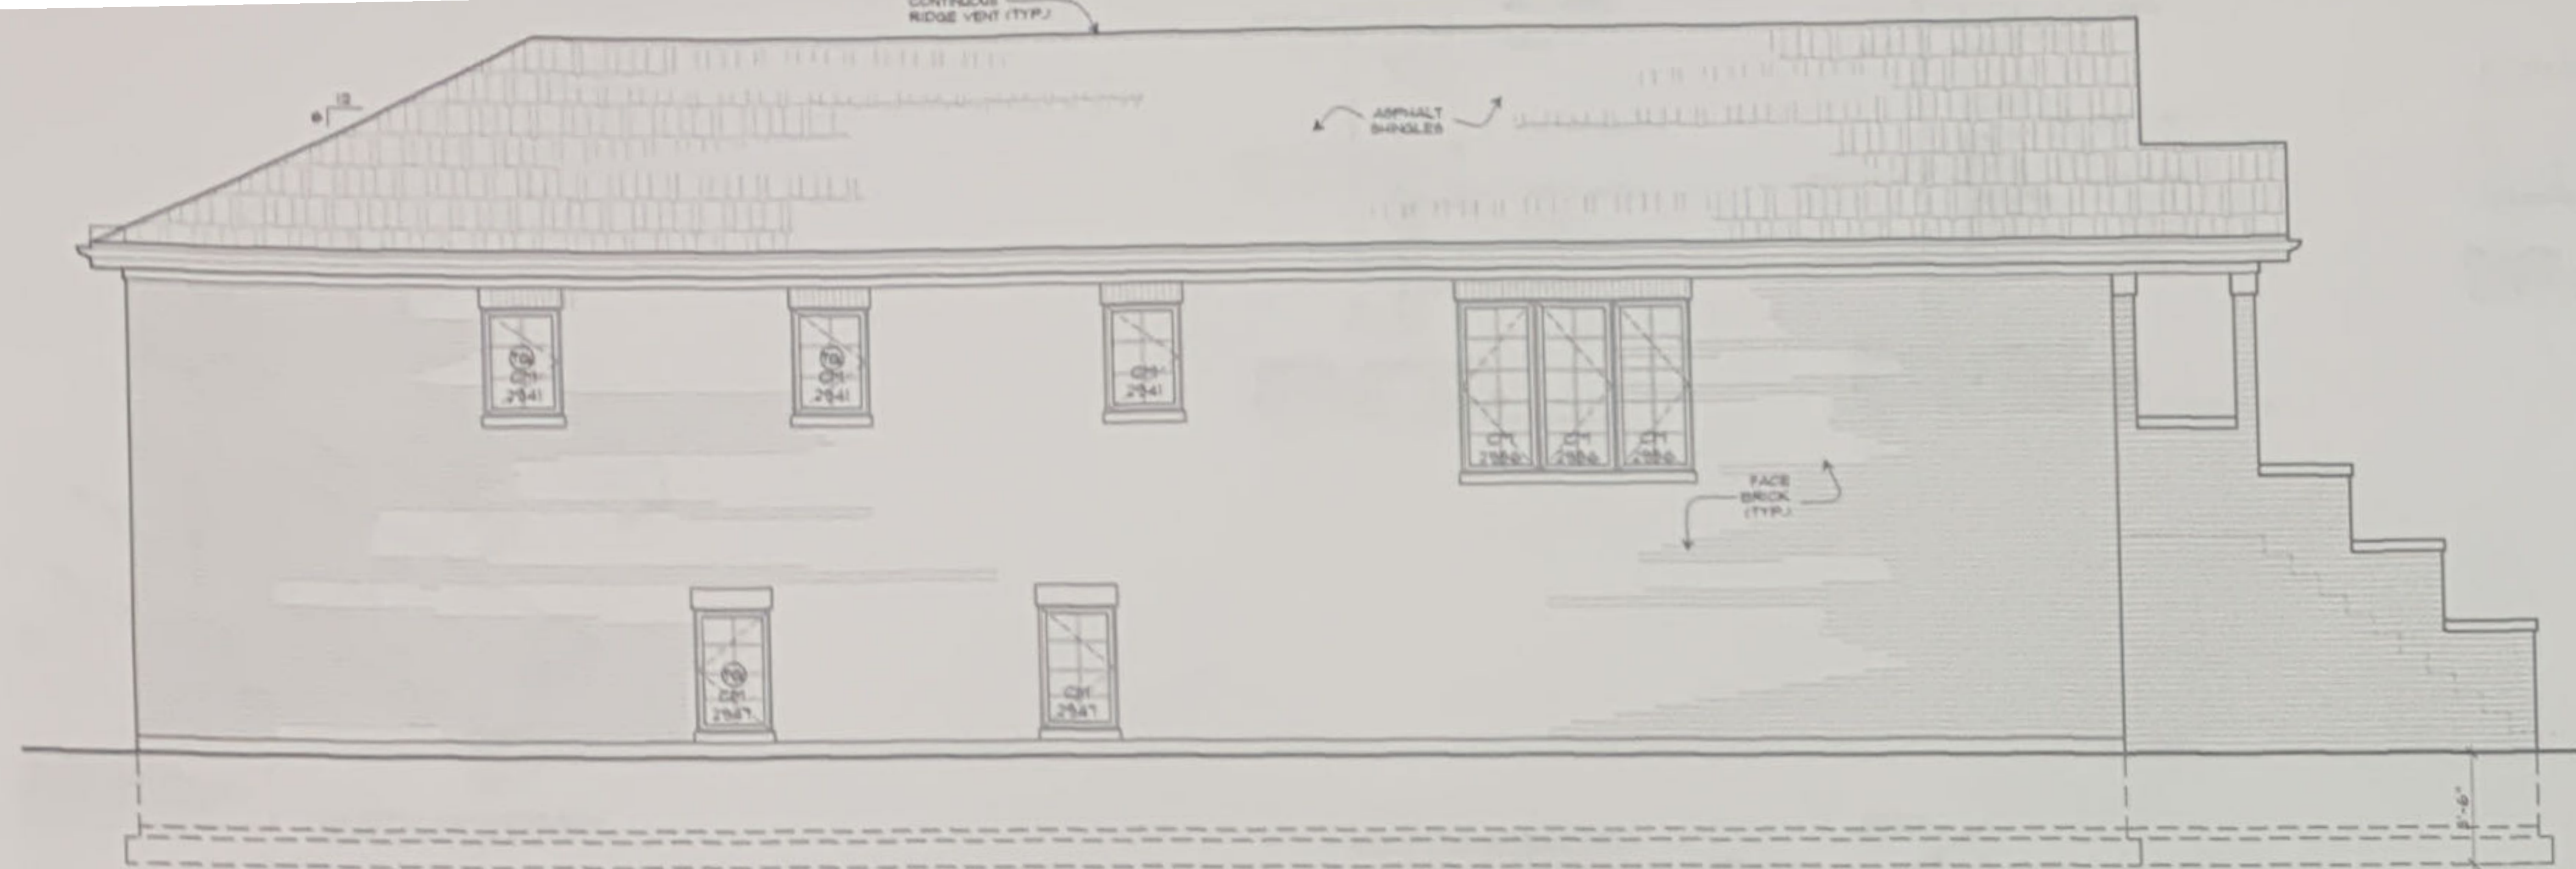

FRONT ELEVATION
SCALE: 1/4"=1'-0"

ELEVATION GENERAL NOTES:

- * FELLA PRO LINE SERIES OR EQUAL
UNIT NUMBERS (NOT GLASS SIZES) SHOWN ON ELEVATIONS
- ALL ROOF VENTS AND THROUGH ROOF MECHANICAL TO
BE LOCATED 4" REAR OF ROPE AND PAINTED TO
MATCH ROOF.
- SHEET METAL FLASHING OVER ALL WINDOWS, DOORS AND WOOD TRIM
- SHEET METAL FLASHING AT ALL ROOF AND WALL INTERSECTIONS

NOTE:
EVERT SLEEPING ROOM SHALL HAVE AT LEAST ONE OPERABLE WINDOW OR EXTERIOR
DOOR APPROVED FOR EMERGENCY EGRESS OR RESCUE. THE UNITS MUST BE OPERABLE
FROM THE INSIDE TO A FULL CLEAR OPENING WITHOUT THE USE OF SEPARATE TOOLS
UNLESS UNITS ARE PROVIDED AS A MEANS OF EGRESS OR RESCUE THEY SHALL HAVE
A FULL HEIGHT OF NOT MORE THAN 44" INCHES ABOVE THE FLOOR.
ALL EGRESS OR RESCUE WINDOWS FROM SLEEPING ROOMS MUST HAVE MINIMUM
NET CLEAR OPENING OF 5.7 SQ. FT. THE MINIMUM NET CLEAR OPENING
HEIGHT DIMENSION SHALL BE 24". THE MINIMUM NET CLEAR OPENING
WIDTH DIMENSION SHALL BE 20".


REFLECTED GLASS
EVERT WINDOW

OPENING SIZE	REQUIRED LINTEL	BEARING
4'-0"	L 3 12"x12"x16"	4"
5'-0"	L 4 12"x12"x16"	4"
6'-0"	L 5 12"x12"x16"	4"
7'-0"	L 6 12"x12"x16"	4"
8'-0"	L 7 12"x12"x16"	4"
9'-0"	L 8 12"x12"x16"	4"
10'-0"	L 9 12"x12"x16"	4"

TYP. HEADER SCHEDULE				
SIZE OF WOOD HEADER	SUPPORTING ROOF ONLY	SUPPORTING ONE STORY ABOVE	SUPPORTING TWO STORIES ABOVE	NOT SUPPORTING FLOORS OR ROOFS
2-2x8	4'	-	-	6'
2-2x8	4 TO 6'	-	-	6 TO 8'
2-2x10	6 TO 8'	4 TO 6'	-	8 TO 10'
2-2x12	8 TO 10'	6 TO 8'	4 TO 6'	10 TO 12'
2-12x12	10 TO 12'	8 TO 10'	6 TO 8'	12 TO 14'
ALL OTHER SIZES SEE FLOOR PLANS				

STUD SCHEDULE			
STUD SIZE	SPACING	MAXIMUM STUD HEIGHT	MAXIMUM STORIES SUPPORTED
2x4	16"	14'	ONE STORY PLUS ROOF
2x4	24"	14'	ROOF ONLY
2x6	16"	20'	TWO FLOORS PLUS ROOF
2x6	24"	20'	ONE STORY PLUS ROOF

REFRIGERATION SCHEDULE												
ITEM NO.	MANUF.	TYPE/AMOUNT OF FREON	H.P.	TON	NO. OF UNITS 1 TON OF COOLING CAPACITY REQUIRE	S/C	REMOTE	DIA. OF LL	DIA. OF SL	UNIT SERVING	UNIT LOCATION	
CU-1	REEST	6-22, 53"	33	30	1.25	1.25	X	3/8"	1/2"	BT FLOOR	AT GRADE	
LIGHT & VENT SCHEDULE												
	ROOM	AREA	LIGHT		VENT		BTUH LOSS	SUPPLY		EXHAUST		REMARKS
			REQ'D	ACT	REQ'D	ACT		REQ'D	ACT	REQ'D	ACT	
1ST FLR.	KITCHEN / LIVING RM./DINING RM.	540.0	43.2	72.7	21.6	82.2	21600		500		500	FU-1 SUPPLY
	MASTER BEDROOM	207.0	20.7	26.4	10.4	30.0	8280		200		200	FU-1 SUPPLY
	BEDROOM #2	117.0	11.7	13.2	5.9	15.0	4680		100		100	FU-1 SUPPLY
	BEDROOM #3	117.0	11.7	13.2	5.9	15.0	4680		100		100	FU-1 SUPPLY
	MASTER BATH	63.0	N.R.	6.6	94.5	94 CFM	2520		100	94 CFM	100	EF-2 EXHAUST
	BATH #2	60.0	N.R.	6.6	90.0	90 CFM	2400		90	90CFM	90	EF-2 EXHAUST
BASEMENT	BEDROOM	265.0	10.6	14.1	5.3	15.3	10600		200		200	FU-1 SUPPLY
	RECREATION RM.	559.0	22.4	24.5	11.2	31.5	22360		400		400	FU-1 SUPPLY
	EXERCISE RM.	140.0	5.6	N.R.	5.6	5.8	5600		100		100	FU-1 SUPPLY
	BATH	60.0	N.R.	6.6	90.0	90 CFM	2400		90	90CFM	90	EF-2 EXHAUST
	TOTAL:						85120		1880		1880	

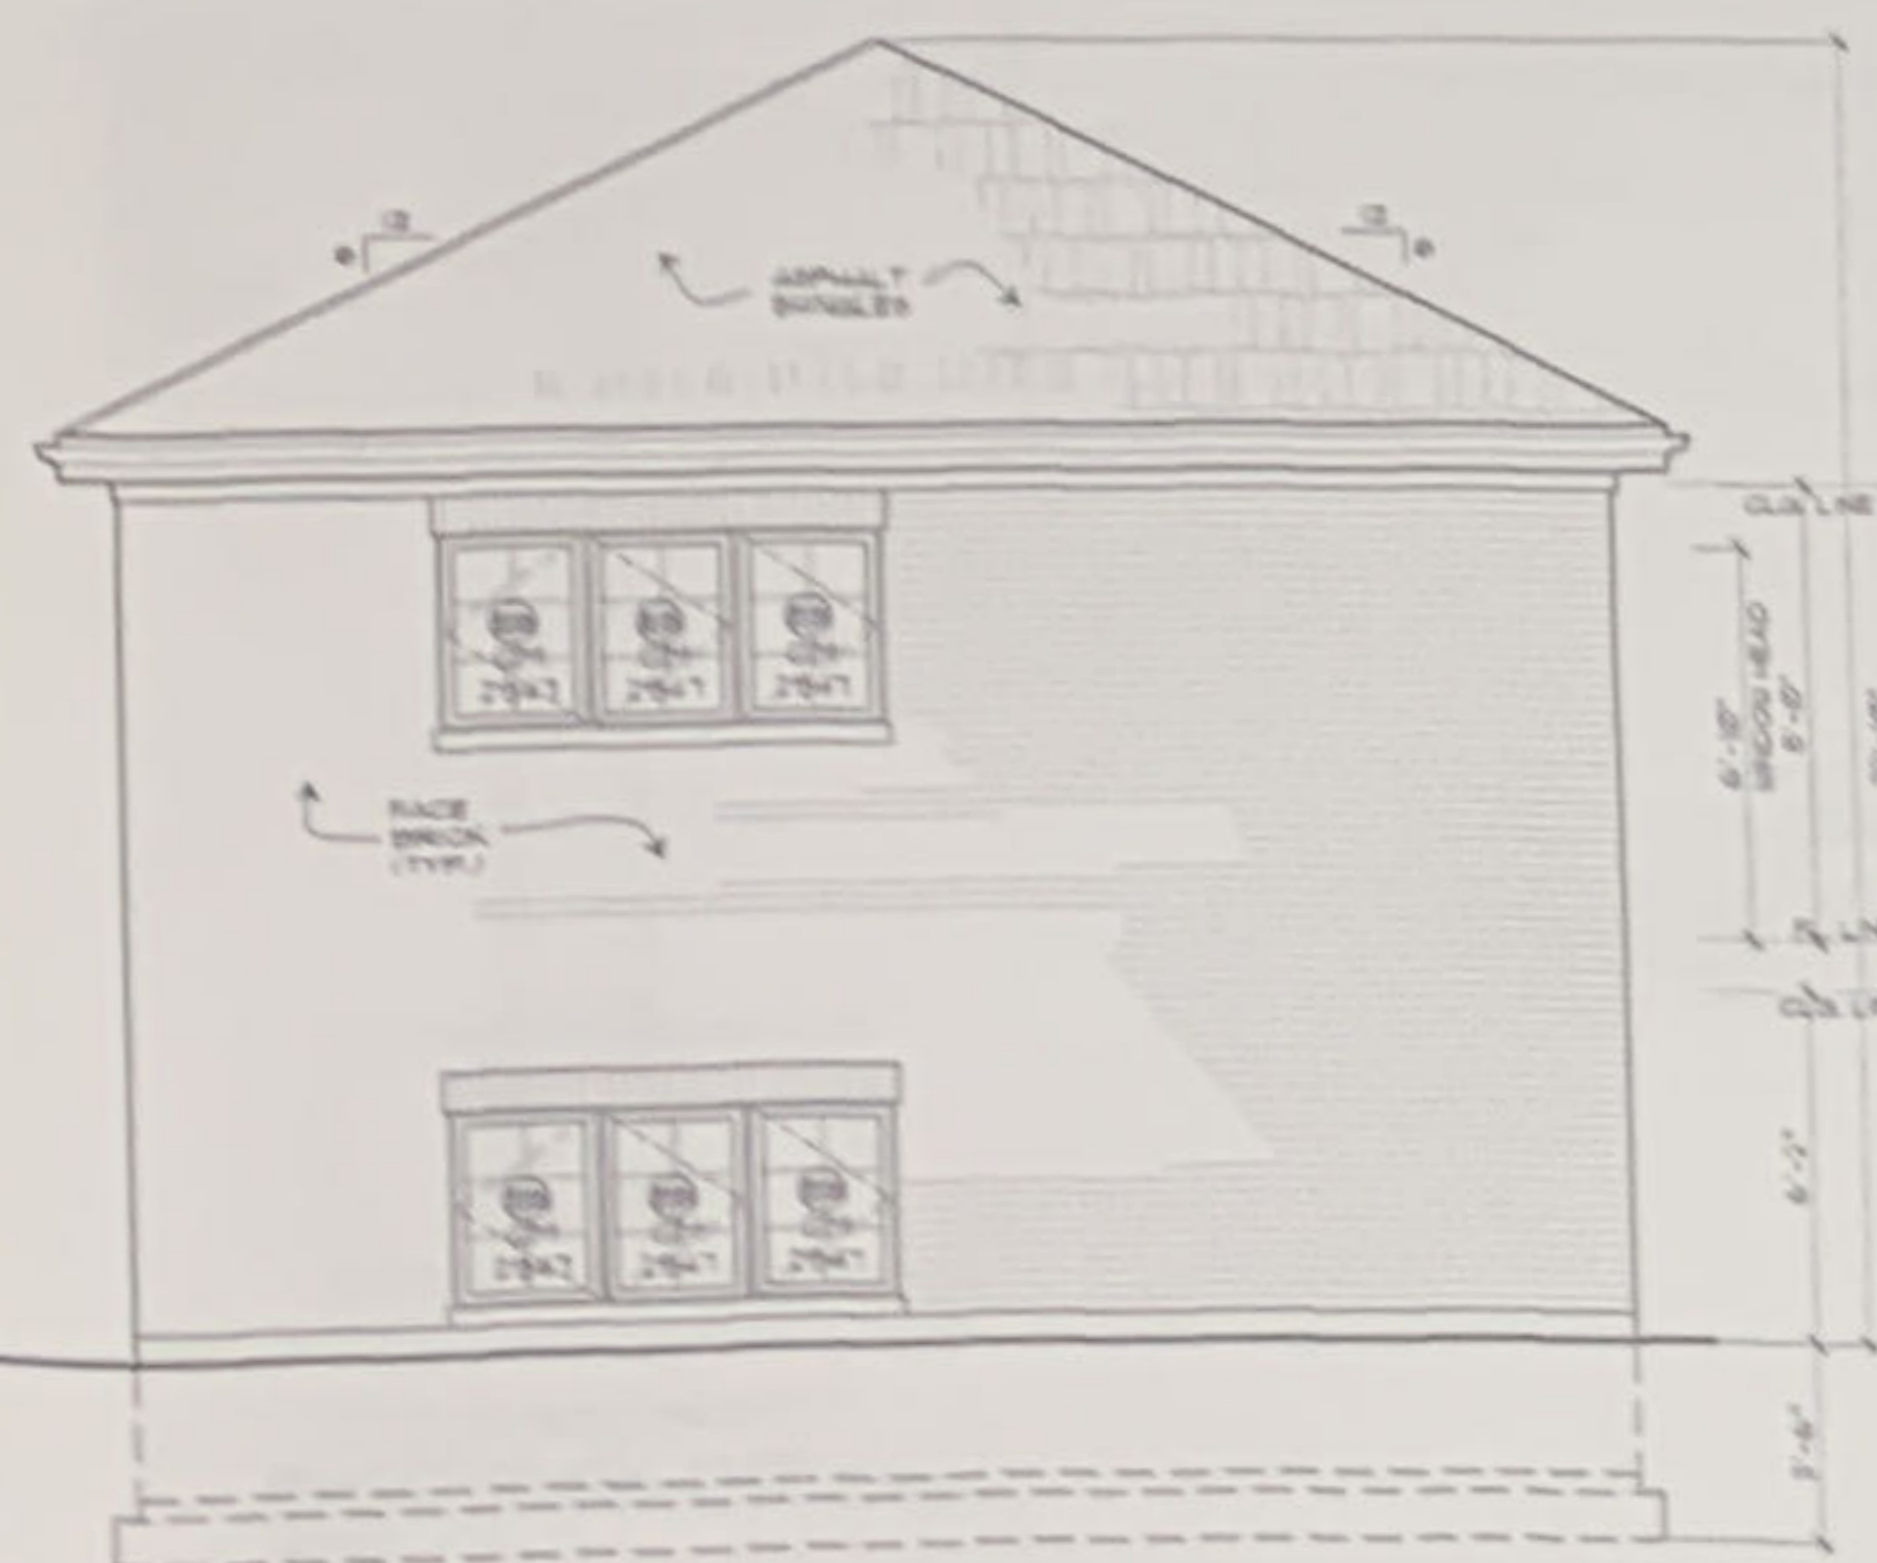

REAR ELEVATION
SCALE: 1/4"=1'-0"



RIGHT ELEVATION
SCALE: 1/4"=1'-0"