



60 West Main Street
Hyrum, Utah 84319
Ph. (435) 245-6033
www.hyumcity.gov

City Council Agenda Information

To: Mayor Miller and City Council
From: Larry Coleman, Power & Light Superintendent
Date: 4/9/2026
Subject: UDOT Power Connection at AJ Park

Summary:

UDOT is asking for approval of a power connection in order to install a camera to monitor traffic and roadway conditions during the summer and winter months.

The camera will be pole-mounted and located near the hydro dam up Blacksmith Fork Canyon. This will provide the best view of both east and west travel lanes.

Because of the area, there is limited sunshine to allow for a solar powered camera, UDOT has experimented with some trial applications the past two winters with solar powered cameras in and around AJ's Park and the hydro dam. The batteries will not last more than 2-3 days without having adequate time to charge.

UDOT will pay for all incurred costs associated with this project, including materials, labor, and equipment. This camera will also be metered so they will be billed the monthly fees and usage.

There will be no incurred cost to Hyrum City

Hyrum City Ordinance 25-02 amending City Code 12.16.235(see attached), requires City Council approval of a connection outside of Hyrum City limits for public infrastructure, I am here on behalf of UDOT to make this request.

Recommendation:

Larry Coleman, Power Superintendent, is recommending approval of a pole-mounted camera to be installed by UDOT near the Hydro Dam up Blacksmith Fork Canyon.

City Council Meeting Details:

- Meeting Date: 4/16/2026
- Council Role: vote to approve a power connection to UDOT in Blacksmith Fork Canyon

Attachments: (2)

-Map of proposed area

-Ordinance 25-02 amending City Code 13.16.235

17-001-0002
STATE OF UTAH

NO RECORD


Proposed UDOT
Camera

Transformer (Point of
Connection)

ESR-101

17-001-0002
STATE OF UTAH

NO RECORD

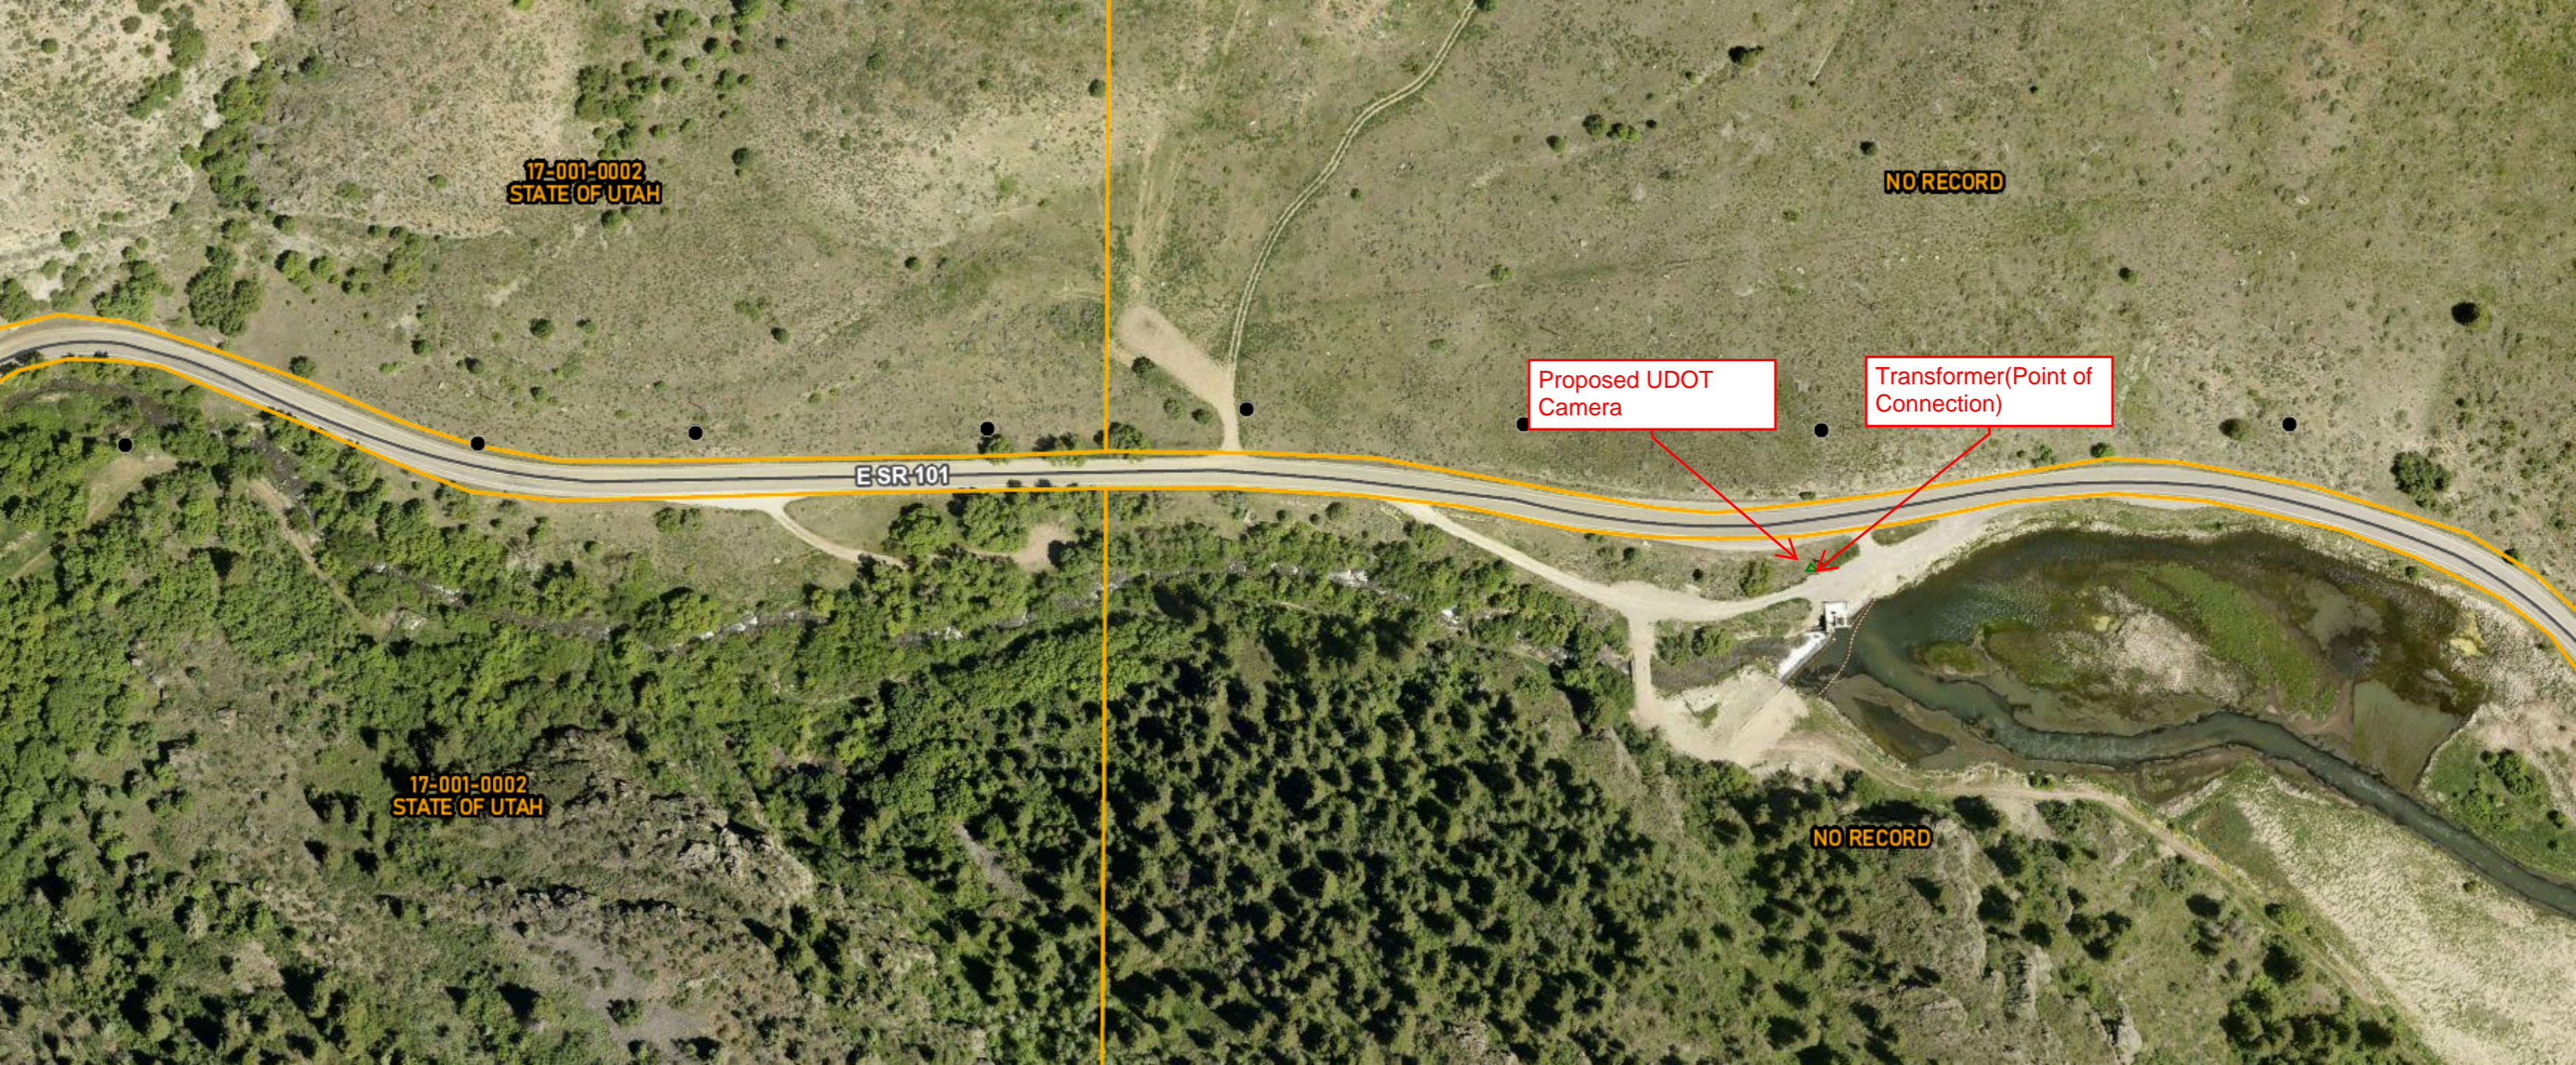

13.16.235 Distribution System Extension - Outside City Limits

Extensions of and connections to the the municipal electrical distribution system will not be approved outside city limits unless it is on Hyrum City's property or for Hyrum City Corporation, and/pr public or quasi-public infrastructure needs and any requests need to be approved by the Hyrum City Council.

HISTORY

Approved by Ord. [25-02](#) on 1/16/2025