



2/2/2024, 2:12:33 PM

	Abandoned Mains	—	Water Mains			Hammer #4		Ridgecrest
	PRV Station	Ð	Water Valves			100 North	—	Sewer
\$	Culinary Leaks	Power	rlines Feeders		_	46 kV	—	Secondary
—	Service Line		No Feeder cct \	/alue Assigned		Canyon	Locati	ons
	Fire Water Line		Hammer #1			Lincoln	0	No Location Type Value Assig
	Fire Hydrants		Hammer #2			MC	•	Building
•	Water Meters		Hammer #3		_	RMP	۲	Decorative Pole

lidgecrest	Θ	Junction Box 3 Phase	٠	Power Pole Primary	۸	Transformer	☆	Outfalls
iewer		Junction Box Secondary	٠	Power Pole Secondary		Pad	0	Blow Out
econdary	F	Junction Box Single Phase	٠	Reclosure	•	Transmission Pole		Service Line
IS	B	Pole Millers Private	۸	Regulators	٠	Sumps	Press	urized Mains
Io Location Type Value Assigned	P	Pole Private	\times	Sub Station	\oplus	Storm Drain MH		
uilding	B	Pole US West	2	Switch Fuse	•	Storm Drain CB		Pressurized
ecorative Pole		Power Meters	\bowtie	Switch Gear		Retention Basins	Gravit	ty Mains



Cache County GIS Maxar, Microsoft | City and JUB engineering |

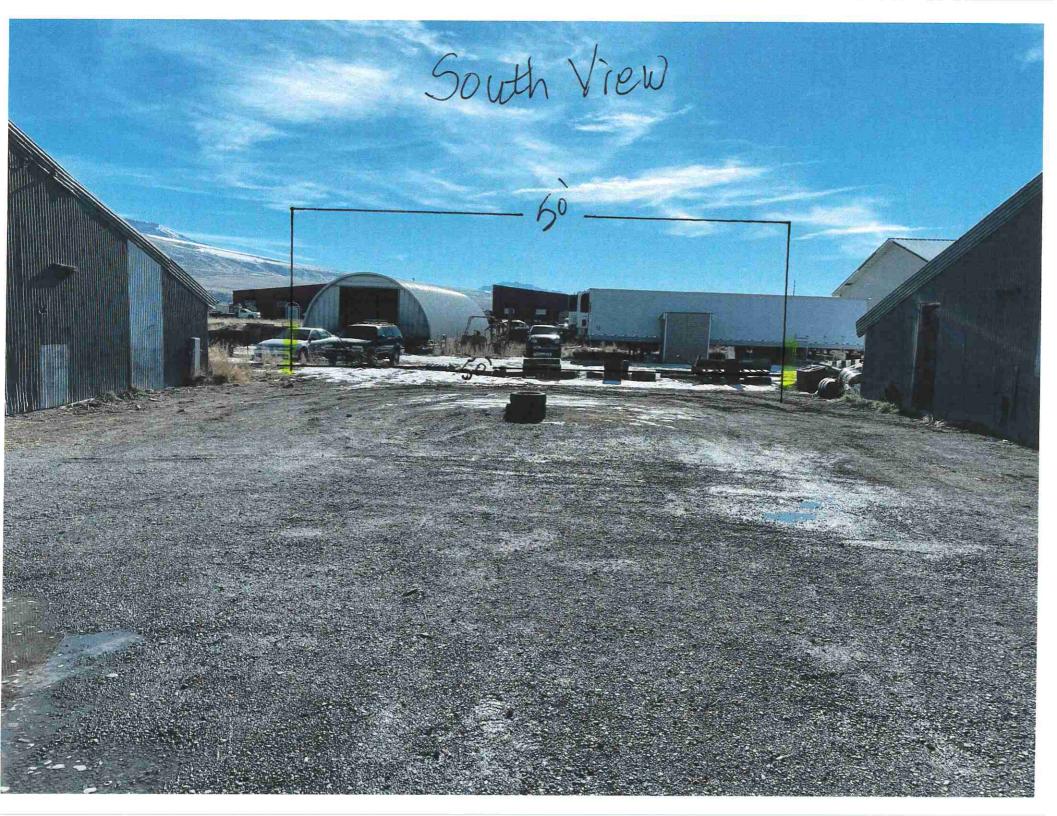



North CEDAR VALLEY RANSPORTING 5 461 MOLEOCZEOCAR DAIRY, HEALTH PRODUCTS INC Mc # 635 COLOCIZION A second se 28 \mathbb{O} 35

