

MEMBERS OF COUNCIL

HON. KIM REYNOLDS
GOVERNOR

HON. PAUL D. PATE
SECRETARY OF STATE

HON. ROB SAND
AUDITOR OF STATE

HON. ROBY SMITH
TREASURER OF STATE

HON. MIKE NAIG
SECRETARY OF AGRICULTURE



Executive Council of Iowa

CAPITOL BUILDING
DES MOINES, IOWA 50319
PHONE: 515 281-5368

October 7, 2024

Accounting Department
Office of the Treasurer
Lucas Building
321 E 12th Street
Des Moines, IA, 50319

The Executive Council, in a meeting held on today's date, approved the Department of Public Safety's request for an emergency allocation in the amount of \$10,000.00, subject to an audit of actual invoices. On July 30, 2024, a lightning strike damaged the Adair County ISICS Communication Tower. Request was to cover repair costs.

EXECUTIVE COUNCIL OF IOWA

Kristi Onstot

Kristi Onstot
Executive Secretary

cc: Lieutenant Heath Hove, Interoperability Communications Bureau, Department of Public Safety
Sergeant Joshua Duden, Interoperability Communications Bureau, Department of
Public Safety
Matt Bender, Department of Management
Heather Hackbarth, Department of Management

AOS Claim # 3893
TOS Job # _____



OFFICE OF AUDITOR OF STATE
STATE OF IOWA

Rob Sand
Auditor of State

State Capitol Building
Des Moines, Iowa 50319-0004
Telephone (515) 281-5834

August 30, 2024

Kristi Onstot
Executive Council
L O C A L

Subject: Damages to Adair County ISICS Communication South Tower due to Lightning
Strike on July 30, 2024
Department of Public Safety
Claim dated August 15, 2024
AOS Claim ID: 3893

In accordance with Executive Council policy, we have examined the claim for 29C.20 funds for the above-mentioned damages. It is our conclusion that the above damage incurred by the Department of Public Safety is covered by Chapter 29C.20 of the Code of Iowa. Therefore, we recommend Executive Council approval in the amount of \$10,000.00, subject to an audit of actual invoices.

Sincerely,

A handwritten signature in black ink, appearing to read "Brian R. Brustkern".

Brian R. Brustkern, CPA
Deputy Auditor of State

cc: Lieutenant Joshua Duden, Communications & Interoperability Bureau, Department
of Public Safety
Heather Hackbarth, Department of Management

Kim Reynolds
Governor
Adam Gregg
Lt. Governor



Department of Public Safety

Stephan Bayens
Commissioner

August 15, 2024

AON 29C20 allocation request ref. Adair South ISICS tower site surge arrestor damage

State of Iowa Executive Council:

On 7-31-24 a Motorola Tech was investigating system alarms at the ISICS Adair South tower site. He found a surge arrestor with melted cards in it. This was most likely cause by a lightning strike from the 7-30-24 overnight storms that went through that area.

Motorola Warranty Representative Dave Gordon was able to provide the DPS Interoperability Communications Bureau an estimate of \$10,000 for repairs to the tower. Repairs will commence when a tower crew becomes available.

The DPS Interoperability Communications Bureau is respectfully submitting a 29C20 Allocation Request for \$10,000 regarding this act of nature damage.

Thank you for your consideration.

Sincerely,

A handwritten signature in blue ink that reads "Joshua Duden".

Lieutenant Joshua Duden
Iowa DPS Communications & Interoperability Bureau
Office of the Commissioner
215 E. 7th Street
Des Moines, IA 50319

From: [Tammy Hollingsworth](#)
To: [Hove Heath](#); ExecutiveCouncil@tos.iowa.gov
Cc: [Duden Joshua](#); [Dostal Sandra](#); [DAVID GORDON](#)
Subject: ** External Email Alert ** RE: Initial notification of 29C20 claim - Adair South - Surge Damage Report
Date: Sunday, August 4, 2024 10:46:44 PM

****External Email Alert**** This email is from outside DPS. **DO NOT CLICK** links or attachments unless you expected them. If unsure please forward to ITOC for review.

Notification of 29C.20 Damages Received – AOS Claim #3893

From: Hove Heath <hove@dps.state.ia.us>
Sent: Wednesday, July 31, 2024 11:02 AM
To: ExecutiveCouncil@tos.iowa.gov; Tammy Hollingsworth <Tammy.Hollingsworth@AOS.IOWA.GOV>
Cc: Duden, Joshua [DPS] <duden@dps.state.ia.us>; Dostal, Sandra [DPS] <dostal@dps.state.ia.us>; DAVID GORDON <dave.gordon@motorolasolutions.com>
Subject: Initial notification of 29C20 claim - Adair South - Surge Damage Report

CAUTION: This email originated from outside of AOS. Do not click links or open attachments unless you recognize the sender and know the content is safe.

Executive Council and Tammy,

On 7-31-24 a Motorola Tech was investigating system alarms at the ISICS Adair South tower site for several alarms going off. He found a surge arrester with melted cards in it. This was most likely cause by a lightning strike from the 7-30-24 overnight storms that went through that area. Please accept this as the initial notification for a 29C20 damage.

Thank you.

Captain Heath Hove, 385

Bureau Chief

Interoperability Communications Bureau
Iowa Department of Public Safety
215 East 7th Street, Des Moines, Iowa 50319
Office: [515-725-6092](tel:515-725-6092)
Mobile: [515-204-7288](tel:515-204-7288)
hove@dps.state.ia.us
<https://dps.iowa.gov/>
<https://dpscareers.com/>



NOTICE This email message (including any file attachments transmitted with it) is for the sole use of the

intended recipient(s) and may contain confidential and legally privileged information. Any unauthorized use or disclosure of this email by an unintended recipient is prohibited. If you have received this e-mail in error please notify the sender by return e-mail and destroy all copies of the original message. No representation is made that this email or any attachments are free of viruses. Virus scanning is recommended and is the responsibility of the recipient.

From: Dave Gordon <dave.gordon@motorolasolutions.com>

Sent: Wednesday, July 31, 2024 10:54 AM

To: ISICSAdmin <isicsadmin@dps.state.ia.us>

Cc: ISICS Statewide FSO <IOWAFSO@motorolasolutions.com>; DAVID GORDON <dave.gordon@motorolasolutions.com>

Subject: ** External Email Alert ** Adair South - Surge Damage Report

****External Email Alert**** This email is from outside DPS. **DO NOT CLICK** links or attachments unless you expected them. If unsure please forward to ITOC for review.

Good Morning,

Sorry again for the email snafu earlier.


Jon Neal was on site yesterday investigating various alarms. When he arrived he found several of the breakers tripped in the panel. He also found that the surge arrestor #2 had melted cards in it. See pictures below:









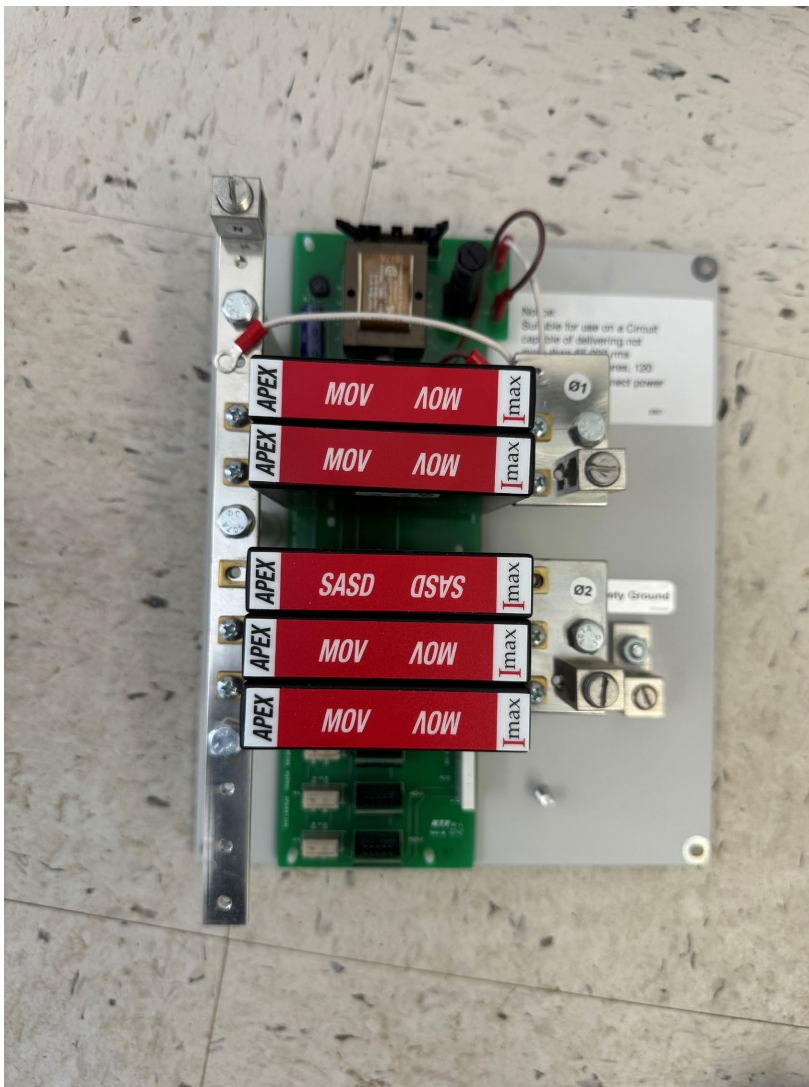

There was some sort of power surge at the site to cause this damage and trip the breakers.

He replaced the surge arrester and cards with our spare unit. He also reset the breakers and all of the alarms cleared.

This will need to be a 29C20 claim.

Please contact me with any questions.

Thanks,

--

Dave Gordon
Customer Support Manager
Motorola Solutions, Inc.
State of Iowa

M: +1.319.321.1134

E: dave.gordon@motorolasolutions.com

For more information on how and why we collect your personal information, please visit our [Privacy Policy](#).

This email message and its attachments may contain confidential information that is exempt from disclosure under Iowa Code chapters 22, 139A, and other applicable law. Confidential information is for the sole use of the intended recipient. If you believe that you have received this transmission in error, please reply to the sender, and then delete all copies of this message and any attachments. If you are not the intended recipient, you are hereby notified that any review, use, retention, dissemination, distribution, or copying of this message may be prohibited by law.

Auditor.Iowa.Gov

Kim Reynolds
Governor
Adam Gregg
Lt. Governor



Department of Public Safety

Stephan Bayens
Commissioner

August 15, 2024

AON 29C20 allocation request ref. Adair South ISICS tower site surge arrestor damage

State of Iowa Executive Council:

On 7-31-24 a Motorola Tech was investigating system alarms at the ISICS Adair South tower site. He found a surge arrestor with melted cards in it. This was most likely cause by a lightning strike from the 7-30-24 overnight storms that went through that area.

Motorola Warranty Representative Dave Gordon was able to provide the DPS Interoperability Communications Bureau an estimate of \$10,000 for repairs to the tower. Repairs will commence when a tower crew becomes available.

The DPS Interoperability Communications Bureau is respectfully submitting a 29C20 Allocation Request for \$10,000 regarding this act of nature damage.

Thank you for your consideration.

Sincerely,

Lieutenant Joshua Duden
Iowa DPS Communications & Interoperability Bureau
Office of the Commissioner
215 E. 7th Street
Des Moines, IA 50319

From: [Tammy Hollingsworth](#)
To: [Hove Heath](#); ExecutiveCouncil@tos.iowa.gov
Cc: [Duden Joshua](#); [Dostal Sandra](#); [DAVID GORDON](#)
Subject: ** External Email Alert ** RE: Initial notification of 29C20 claim - Adair South - Surge Damage Report
Date: Sunday, August 4, 2024 10:46:44 PM

****External Email Alert**** This email is from outside DPS. **DO NOT CLICK** links or attachments unless you expected them. If unsure please forward to ITOC for review.

Notification of 29C.20 Damages Received – AOS Claim #3893

From: Hove Heath <hove@dps.state.ia.us>
Sent: Wednesday, July 31, 2024 11:02 AM
To: ExecutiveCouncil@tos.iowa.gov; Tammy Hollingsworth <Tammy.Hollingsworth@AOS.IOWA.GOV>
Cc: Duden, Joshua [DPS] <duden@dps.state.ia.us>; Dostal, Sandra [DPS] <dostal@dps.state.ia.us>; DAVID GORDON <dave.gordon@motorolasolutions.com>
Subject: Initial notification of 29C20 claim - Adair South - Surge Damage Report

CAUTION: This email originated from outside of AOS. Do not click links or open attachments unless you recognize the sender and know the content is safe.

Executive Council and Tammy,

On 7-31-24 a Motorola Tech was investigating system alarms at the ISICS Adair South tower site for several alarms going off. He found a surge arrester with melted cards in it. This was most likely cause by a lightning strike from the 7-30-24 overnight storms that went through that area. Please accept this as the initial notification for a 29C20 damage.

Thank you.

Captain Heath Hove, 385

Bureau Chief

Interoperability Communications Bureau
Iowa Department of Public Safety
215 East 7th Street, Des Moines, Iowa 50319
Office: [515-725-6092](tel:515-725-6092)
Mobile: [515-204-7288](tel:515-204-7288)
hove@dps.state.ia.us
<https://dps.iowa.gov/>
<https://dpscareers.com/>



NOTICE This email message (including any file attachments transmitted with it) is for the sole use of the

intended recipient(s) and may contain confidential and legally privileged information. Any unauthorized use or disclosure of this email by an unintended recipient is prohibited. If you have received this e-mail in error please notify the sender by return e-mail and destroy all copies of the original message. No representation is made that this email or any attachments are free of viruses. Virus scanning is recommended and is the responsibility of the recipient.

From: Dave Gordon <dave.gordon@motorolasolutions.com>

Sent: Wednesday, July 31, 2024 10:54 AM

To: ISICSAdmin <isicsadmin@dps.state.ia.us>

Cc: ISICS Statewide FSO <IOWAFSO@motorolasolutions.com>; DAVID GORDON <dave.gordon@motorolasolutions.com>

Subject: ** External Email Alert ** Adair South - Surge Damage Report

****External Email Alert**** This email is from outside DPS. **DO NOT CLICK** links or attachments unless you expected them. If unsure please forward to ITOC for review.

Good Morning,

Sorry again for the email snafu earlier.


Jon Neal was on site yesterday investigating various alarms. When he arrived he found several of the breakers tripped in the panel. He also found that the surge arrestor #2 had melted cards in it. See pictures below:









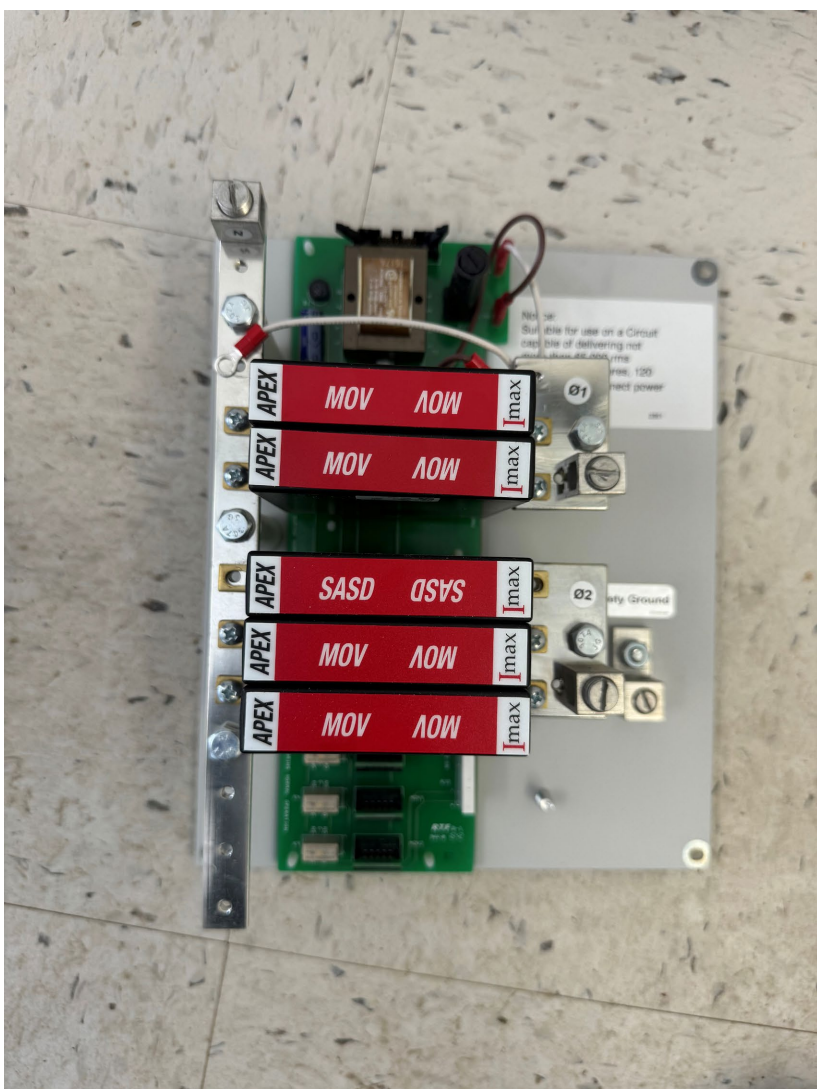

There was some sort of power surge at the site to cause this damage and trip the breakers.

He replaced the surge arrester and cards with our spare unit. He also reset the breakers and all of the alarms cleared.

This will need to be a 29C20 claim.

Please contact me with any questions.

Thanks,

--

Dave Gordon
Customer Support Manager
Motorola Solutions, Inc.
State of Iowa

M: +1.319.321.1134

E: dave.gordon@motorolasolutions.com

For more information on how and why we collect your personal information, please visit our [Privacy Policy](#).

This email message and its attachments may contain confidential information that is exempt from disclosure under Iowa Code chapters 22, 139A, and other applicable law. Confidential information is for the sole use of the intended recipient. If you believe that you have received this transmission in error, please reply to the sender, and then delete all copies of this message and any attachments. If you are not the intended recipient, you are hereby notified that any review, use, retention, dissemination, distribution, or copying of this message may be prohibited by law.

Auditor.Iowa.Gov

From: [Hove Heath](#)
To: ExecutiveCouncil@tos.iowa.gov; [Tammy Hollingsworth](#)
Cc: [Duden Joshua](#); [Dostal Sandra](#); [DAVID.GORDON \(dave.gordon@davorolasolutions.com\)](mailto:DAVID.GORDON@davorolasolutions.com)
Subject: Initial notification of 29C20 claim - Adair South - Surge Damage Report
Date: Wednesday, July 31, 2024 11:02:00 AM

Executive Council and Tammy,

On 7-31-24 a Motorola Tech was investigating system alarms at the ISICS Adair South tower site for several alarms going off. He found a surge arrestor with melted cards in it. This was most likely cause by a lightning strike from the 7-30-24 overnight storms that went through that area. Please accept this as the initial notification for a 29C20 damage.

Thank you.

Captain Heath Hove, 385

Bureau Chief

Interoperability Communications Bureau
Iowa Department of Public Safety
215 East 7th Street, Des Moines, Iowa 50319
Office: [515-725-6092](tel:515-725-6092)
Mobile: [515-204-7288](tel:515-204-7288)
hove@dps.state.ia.us
<https://dps.iowa.gov/>
<https://dpscareers.com/>



NOTICE This email message (including any file attachments transmitted with it) is for the sole use of the intended recipient(s) and may contain confidential and legally privileged information. Any unauthorized use or disclosure of this email by an unintended recipient is prohibited. If you have received this e-mail in error please notify the sender by return e-mail and destroy all copies of the original message. No representation is made that this email or any attachments are free of viruses. Virus scanning is recommended and is the responsibility of the recipient.

From: Dave Gordon <dave.gordon@motorolasolutions.com>
Sent: Wednesday, July 31, 2024 10:54 AM
To: ISICSAdmin <isicsadmin@dps.state.ia.us>
Cc: ISICS Statewide FSO <IOWAFSO@motorolasolutions.com>; DAVID GORDON <dave.gordon@motorolasolutions.com>
Subject: ** External Email Alert ** Adair South - Surge Damage Report

****External Email Alert**** This email is from outside DPS. **DO NOT CLICK** links or attachments unless you expected them. If unsure please forward to ITOC for review.

Good Morning,

Sorry again for the email snafu earlier.


Jon Neal was on site yesterday investigating various alarms. When he arrived he found several of the breakers tripped in the panel. He also found that the surge arrestor #2 had melted cards in it. See pictures below:









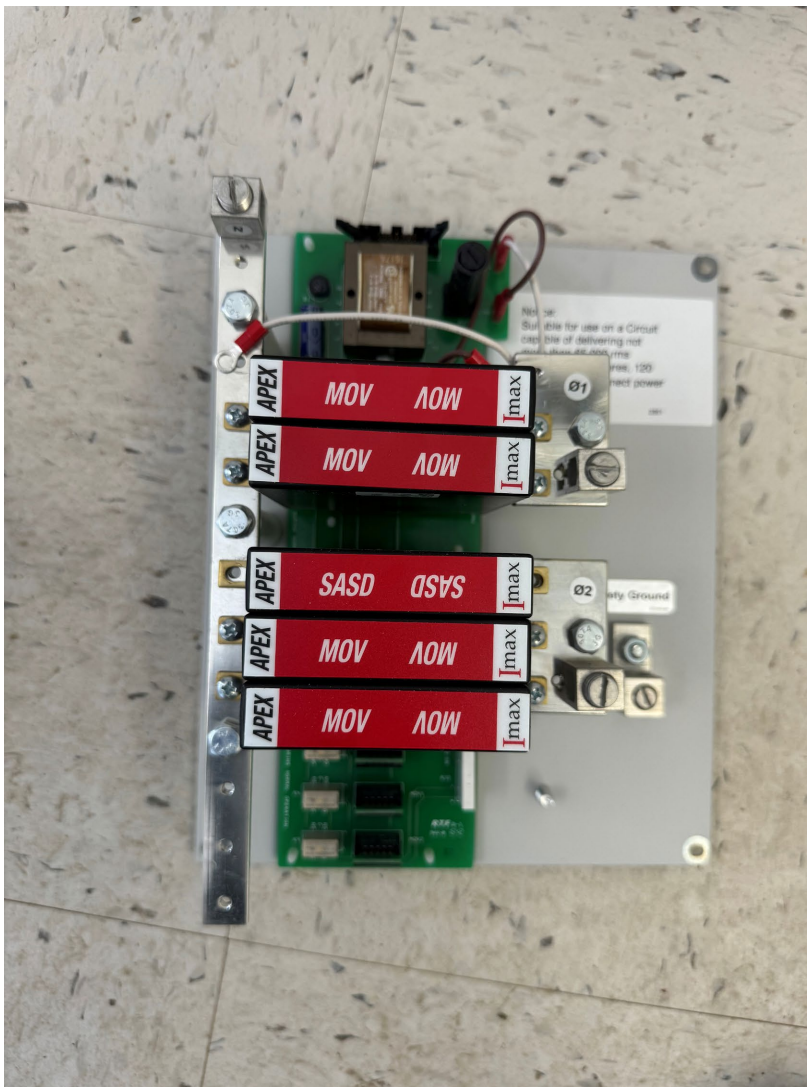

There was some sort of power surge at the site to cause this damage and trip the breakers.

He replaced the surge arrester and cards with our spare unit. He also reset the breakers and all of the alarms cleared.

This will need to be a 29C20 claim.

Please contact me with any questions.

Thanks,

--

Dave Gordon
Customer Support Manager
Motorola Solutions, Inc.
State of Iowa

M: +1.319.321.1134

E: dave.gordon@motorolasolutions.com

For more information on how and why we collect your personal information, please visit our [Privacy Policy](#).