JUSTIFICATION STATEMENT
THE WATERFORD
Site Plan Amendment – Site Plan and Appearance Review
Initial Submittal: February 26, 2025, Resubmittal: April 23, 2025

REQUEST

On behalf of the Applicant, WGI is requesting the following:

1) **Site Plan Amendment** to modify the approved site plan package.
2) **Special Exception** to modify the approved development.

Per coordination with the Town of Juno Beach staff, this application will be formally submitted under the Site Plan and Appearance Review Process. This is an amendment to the plan approved by the Town of Juno Beach Town Council on April 27th, 2022. The Waterford is an existing development, and is currently under construction per the 2022 approved site plan. The Applicant is requesting to modify the approved site plan for additional needs of the development. These modifications will reduce the overall density/intensity of the development and modify parking and circulation on the site. The overall development program in terms of uses, programming, and architectural character will remain the same upon approval of these changes.

SITE CHARACTERISTICS

The existing 15.97-acre subject site, known as "The Waterford," is located southwest of the Universe Boulevard and US Highway One intersection in the Town of Juno Beach. The property is identified by Parcel Control Number (PCN) 28-43-41-33-11-001-0000 and address 601 Universe Blvd, Juno Beach, FL 33408. The subject property retains a Town of Juno Beach Future Land Use (FLU) designation of High Density Residential, up to 20 units per acre (HDR) and a zoning district classification Planned Unit Development (PUD) / Commercial Office (CO). The Waterford is an existing senior living facility with multiple structures arranged in a campus style setting.

Figure 1 – Site Aerial



The following table outlines site information for the Waterford development.

Table 1 – Property Information

PCN	Owner Information	Address	FLU	Zoning	Area
28-43-41-33-11-001-0000	Lifespace Communities, Inc.	601 Universe Blvd.	HDR	PUD/CO	15.97 AC.

SURROUNDING PROPERTIES

The following is a summary of the uses surrounding the subject site.

Table 2 – Surrounding Property Information

	FLU	Zoning	Existing Use
North	Commercial (COM)	Commercial Office (CO)	Professional Offices
South	*(Palm Beach County)* Medium Residential, 5 Units Per Acre (MR-5)	*(Palm Beach County)* Multifamily Residential High Density (RH)	Single Family Residential
East	*(Palm Beach County)* Low Residential, 2 Units Per Acre (LR-2)	*(Palm Beach County)* Multifamily Residential High Density (RH)	Single Family Residential
West	Moderate Density Residential (MODR)	Residential Multiple Family – Moderate Density (RM-2)/PUD	Multi-Family Residential

North: Immediately north of the subject site is the Universe Boulevard ROW. The property located on the north side of Universe Blvd. is the NextEra Energy site, which retains a FLU designation of Commercial and a Zoning designation of CO.

South: Immediately south of the subject site is the Pleasant Ridge Subdivision. This community retains an unincorporated FLU designation of MR-5, a Zoning designation of RH, and is comprised of single family homes.

East: East of the subject site is the Power Financial Credit Union office building and the US Highway 1 ROW. The Power Financial Credit Union office retains a FLU designation of Commercial and a Zoning designation of CO. East, across US Highway 1 there are two single family residential communities known as Seminole Landing and Captain's Key. The Seminole Landing community retains an unincorporated FLU designation of LR-1 and RH/RS Zoning designation. The Captain's Key Community retains an unincorporated FLU designation of LR-2 and RS Zoning designation.

West: Immediately west of the subject site is the Ocean Trace community. This community retains a FLU designation of Moderate Density Residential (Up to 15 DU/AC) (MDR), and a Zoning designation of Residential Multiple Family – Moderate Density (RM-2) with a PUD overlay.

The areas surrounding the subject site include a mix of residential uses to the west, south, and east and nonresidential uses to the north. The development pattern in the context of the larger planning area is diverse, with a mix of medium and low density residential and commercial uses along the US Highway 1 Corridor.

The proposed site plan modifications will not alter the overall character of the area, as the Waterford senior living facility already exists and is in operation. The proposed changes are consistent with the surrounding areas and current development. Upon approval of the proposed amendment, the Waterford will be compatible with the development patterns established within this area and will accommodate for the continuation of services within the campus.

APPROVAL HISTORY

The existing Waterford campus has received development approvals through the Town of Juno Beach. The Waterford was initially approved in November 1979 under Ordinance 213. Over the past several decades, additional requests have been made to expand and modify the development. The table below summarizes the recent development history affected by this proposed site plan modification:

Table 3 – Approval History

RESOLUTION/ ORDINANCE	DATE	SUMMARY
R-2022-04	04/27/2022	Vacating and abandoning an unconstructed portion of the Osceola Right-of-Way north of Pleasant Drive.
R-2022-05	04/27/2022	Modification of the development plan for the Waterford Planned Unit Development Special Exception to allow for the reconfiguration and expansion of the existing campus to provide for a continuum of care.
Ordinance No. 739	04/27/2022	Annexing approximately 1.453 acres of real property consisting of lots 8 through 15 and an unconstructed portion of the Osceola road right-of-way as depicted on the plat of Pleasant Ridge.
Ordinance No. 750	04/27/2022	Small-Scale Amendment to the Town's Comprehensive Development Plan to Amend the Future Land Use Classification of seven annexed parcels … from the Palm Beach County Medium Residential, 5 units per acre (MR-5) classification to the Town's high density residential (HDR) classification.
Ordinance No. 751	04/27/2022	Rezoning seven annexed parcels of real property and adjacent right-of-way located on the north side of pleasant drive west of U.S. Highway One, totaling approximately 1.453 acres, from the Palm Beach County Multi-Family Residential High Zoning District to the Town of Juno Beach Commercial Office (CO) Zoning District.

PROPOSED MODIFICATIONS

The current development proposal is for a Major Site Plan Modification to the existing 15.97-acre Waterford Campus. The site is currently under construction per the Approved 2022 Major Site Plan Amendment. Construction is underway on the site, and upon further evaluation during this process, it has been determined that additional modifications are needed. The current amendment proposes to reconfigure buildings and reduce the number of overall beds in the development from 638 to 578, reducing density from 16.71 dwelling units per acre to 15.15 dwelling units per acre. A breakdown of the proposed modifications is outlined below.

1. ***Building A – Reconfiguration***
   Building A, the 2-story building that serves as the commons and lobby area, is modified to include a division between both the commons and lobby area, which were previously a combined space.

2. ***Building B - Reconfiguration and Change of use***
   Building B, which was previously approved in 2022 as one building with Memory Care/Assisted Living on the southern portion and Independent Living on the northern portion, is now proposed as two separate buildings. The separate buildings are Building B – Assisted Memory Care and Building H – Independent Living.

   Building B was previously approved to be 7 stories (90 feet) tall on the Independent Living section and 3 stories (25 feet) tall on the Memory Care/Assisted Living section. Proposed Building B is 3 stories (51 feet) tall and Building H is 4 stories (64 feet) tall. The proposed height reduction reduces intensity of the development.

3. ***Improved Pedestrian Connection/Circulation***
   Additional pedestrian connections are provided around proposed buildings B and H on the southeast corner of the site. These connections will allow emergency services such as the Fire Department to access the perimeter of the building safely, while improving connectivity throughout the site. Circulation around Building A has been modified as well to update the sidewalk layout. These changes will improve pedestrian connectivity between buildings.

4. ***Overall Parking Reduction***
   Due to the modification of buildings and uses, parking has been modified as well. Since the 2022 site plan approval, the number of provided parking spaces has reduced from 453 to 380 spaces. A breakdown of the changes to parking is included in the Development Program section of this report.

5. ***Modification to Open Space***
   The open space area on the southern portion of the site, between buildings F and E is reconfigured and labeled as 6,881 square feet of open space.

DEVELOPMENT PROGRAM

The Waterford Campus is a 15.57-acre campus with independent living, skilled nursing, assisted living, memory care, and accessory uses and amenities. The proposed modifications are designed in accordance with Chapter 34-Zoning in the code. Refer to the sections below for details of the development program and compliance with the Code.

Density

Per the High Density Residential, up to 20 units per acre (HDR) Future Land Use designation, the maximum density of the site is 20 dwelling units per acre. The approved Waterford development has never reached the maximum density, and the proposed amendment will decrease overall density. The 2022 approval allowed for a total of 638 beds on the 15.97-acre site, resulting in an overall density of 16.71 dwelling units per acre *(638 beds/2.39 persons=267 units/15.97 acres = 16.71 dwelling units per acre).* The current amendment proposes 578 beds, which results in an overall density of 15.15 dwelling units per acre (578 beds/2.39 persons=242 units/15.97 acres = 15.15 dwelling units per acre).

Uses

The subject site is zoned Planned Unit Development/Commercial Office (PUD/CO). The Waterford includes independent living, assisted living, memory care, and skilled nursing uses. All of these uses were previously approved and this amendment will maintain the permitted uses. A breakdown of uses and beds prior to 2022, the 2022 approval which is in construction, and current proposal is in the table below:

Table 4 – Use Breakdown

Existing Development		2022 Approval (R-2022-05)		Current Proposal	
Use	**# of Beds**	**Use**	**# of Beds**	**Use**	**# of Beds**
Independent Living*	432	**Independent Living**	538	**Independent Living**	478
Skilled Nursing	60	**Skilled Nursing**	60	**Skilled Nursing**	60
-	-	**Assisted Living**	24	**Assisted Living**	24
-	-	**Memory Care**	16	**Memory Care**	16
TOTAL	492	**TOTAL**	638	**TOTAL**	578

Parking

Discussed above, the use breakdown on site has been modified, therefore parking has been affected. Parking has decreased from 453 to 380 spaces per the new development program. The Town of Juno Beach code has not been updated to keep up with current industry standards for the proposed uses. Based on the parking study

approved in 2022, it was determined that the subject site best fits the parking rates adopted by the 5th Edition of the Parking Generation Manual from the Institute of Transportation Engineers (ITE).

An updated parking study is provided. Due to the site's unique geometry, and existing conditions, there is a limitation on providing the parking required by the Town's Code. Furthermore, the previously approved parking study identified that the parking rate adopted by the ITE will be able to accommodate the demand of proposed expansion during peak conditions. The tables below provide a breakdown of required and proposed parking.

Table 5 - 2022 Approved Parking – Approved Per Parking Study

Component	Requirement	Quantity (Spaces)
Independent Living Unit (356 Units)	1 Sp./0.46 Units	164
Assisted Living (24 Beds)	1 Sp./0.58 Beds	14
Memory Care (16 Beds)	1 Sp./0.58 Beds	9
Skilled Nursing (60 Beds)	1 Sp./0.58 Beds	35
Total		**222**

Table 6 - Revised Parking Demand – Per ITE Manual

Component	Requirement	Quantity (Spaces)
Independent Living Unit (304 Units)	1 Sp./0.46 Units	134
Assisted Living (24 Beds)	1 Sp./0.58 Beds	14
Memory Care (16 Beds)	1 Sp./0.58 Beds	9
Skilled Nursing (60 Beds)	1 Sp./0.58 Beds	35
Total		**192**

Table 7 – Provided Parking

Parking Type	Quantity (Spaces)
Proposed Surface Spaces	341
Proposed Garage Spaces	39
Handicap Spaces (Included in total)	*8*
Total	**380**

Of the total parking provided, 329 are surface spaces distributed throughout, and 39 are located in the proposed parking garage. 8 handicap spaces are required, and are included in the total number of spaces. In addition, 4 loading spaces are proposed.

Height

Proposed Buildings B and H are consistent with the existing development, and compliant with height regulations. The tallest building on the Waterford Campus is the Independent living tower, which has already been constructed. This structure is 12 stories, has 182 units/236 beds, and a maximum height of 121 feet.

The proposed structures for this amendment do not exceed the existing development height nor what was approved in 2022. Building B was previously approved to be 7 stories (90 feet) tall on the Independent Living section and 3 stories (25 feet) tall on the Memory Care/Assisted Living section. Proposed Building B is 3 stories (51 feet) tall and Building H is 4 stories (64 feet) tall.

The PUD Zoning District utilizes the Residential High (RH) district maximum height for its standards per Sec. 34-1333(3)b.1. Per Sec. 34-368(11), Multiple-Family structures in the RH district are permitted to be a maximum of 12 stories or 130 feet in height. Therefore, the proposed amendment retains compliance with Chapter 34 of the code. Please refer to the architectural plans and elevations provided.

Buffer
The previously approved buffers ranged from 8 to 15 feet in width, and will remain consistent with what was approved and compliant with the code. A 15-foot landscape buffer is provided along the southern property line. A 6-foot masonry wall is also proposed within the buffer to provide additional screening. Refer to the provided landscape plans.

Access and Circulation
Access points will remain consistent with the approved 2022 site plan. Primary access remains on Universe Blvd, with a centrally located main entrance and secondary entrance on the northeast corner of the site. Pedestrian pathways and sidewalks are reconfigured throughout the site, specifically near proposed Buildings B and H, surrounding Building A, and to the north of the Health Center Building.

Vehicular circulation continues to follow the previous approval, with adjustments in the southeast corner where Buildings B and H are located. The 2022 approval included surface parking lot to the west of Building B, and additional parking spaces along the 25-foot drive isle. The drive isle wrapped around the perimeter of the building and along the south property line. Now, the existing lake on the southeast corner is proposed to remain. To accommodate preservation of the existing lake, and the road no longer loops around the buildings in the southeast corner. It instead runs internal to the site.

Setbacks
Setbacks are modified slightly with the proposed amendment. The table below outlines the Commercial Office Zoning District required setbacks per Sec. 34-658. - Building site area regulations, setbacks approved in 2022, and proposed setbacks with the current amendment.

Table 8 - Setbacks

	Required By Code	2022 Approval	Current Proposal
Front	30 feet	30 feet	30 feet
Side	10 feet	57 feet	28 feet (US Highway 1)
Rear (Classified as Front)	15 feet (Based on PUD Reduction)*	17 feet	17 feet

** The previous approval included a reduction in setback requirements for a PUD. Per Section 34-1333(b)(3)(b)(2), there is an allowance within the PUD section of the Town's code which allows for the reduction of the front setback requirement in order to allow design flexibility. The rear yard of the subject property is classified as a front setback. The front yard setback was approved to be reduced to 15 feet for any portion of a dwelling except for that portion of a house which is a front end loaded garage. No garages or primary entrances are facing Pleasant Drive, which allowed approval of the 15-foot setback.*

Phasing
A Phase line is included on the plan to indicate the impact of the proposed amendments on the site.

AMENDMENT TO A PUD
The proposed Site Plan Amendment is being reviewed through the Site Plan and Appearance Review Process. However, as the site is a PUD, the minor amendments are in compliance with *Sec. 34-1334. - Minor amendments.* Compliance with the standards in this section are outlined below.

1. **An increase in the total floor area of any principal structure does not exceed ten percent and there is no increase in the number of principal structures, or in the number of residential dwelling units as specified by the adopted master plan. However, a decrease in the total floor area of any building, or reduction in the number of principal structures, stories, or units as specified by the master plan may be approved as minor amendments.**
   The proposed amendment is a reduction on the total square footage to the previously approved master plan for The Waterford.

2. **There is no change in the boundary of the planned development.**
   The boundary of the Waterford Planned Development is not changing as part of this amendment.

3. **Rearrangement of uses or locations on a property may be permitted unless they conflict with a specific provision of the adopted planned unit development approval.**
   Uses are proposed to be reconfigured from the approved site plan. However, the modifications maintain the overall development program as a mix of independent living, assisted living, memory care, and skilled nursing are dispersed throughout.

4. **There is a relocation of no more than ten percent of the total building footprint on a site. For example, if there are two buildings on a site and each has 5,000 square feet of building footprint, then the total building footprint for the site is 10,000 square feet. If one building relocates 500 square feet and the other building relocates 1,000 square feet, then the total relocation is 1,500 square feet out of 10,000 square feet, which is a relocation of 15 percent of the total building footprint. This would qualify as a major amendment under this provision.**
   The proposed plan shows the elimination of the previously approved RCB building which had a gross square footage of 261,739 square feet. The reconfigured site depicts Buildings B and H, with a total of 136,700 square feet of gross floor area. This constitutes a 48% reduction of square footage from the previous approval.

5. **Any increase in traffic generation shall be by no more than ten percent above that established by the development plan approved by the town council. However, the county's traffic performance standards, as specified in section 7.9 of the Palm Beach County Unified Land Development Code, must be adhered to.**
   The overall density and number of beds for the development is decreasing, therefore traffic generation will remain or decrease. Refer to the provided traffic study.

6. **Any increase in traffic generation shall be by no more than ten percent above that established by the development plan approved by the town council. However, the county's traffic performance standards, as specified in section 7.9 of the Palm Beach County Unified Land Development Code, must be adhered to.**
   The overall density and number of beds for the development is decreasing, therefore traffic generation will remain or decrease.

7. **There is no major alteration in the architectural design. Major alteration in design shall mean any change in the character of the structure. However, an amendment to a previously approved planned unit development that was not reviewed under the current appearance criteria in section 34-116(2)b may be amended in architectural design to conform with the current appearance standards and not be considered a major alteration.**
   The architectural character of the development will remain consistent with the latest approval. Although certain elements are changing, the overall character remains the same.

8. **The amendment does not violate any of the conditions which were placed on the approval.**
   The proposed amendment does not violate any conditions of approval associated with the latest approval.

SITE PLAN CRITERIA – STANDARDS

The Applicant is requesting approval of the Site Plan Amendment through the Site Plan and Appearance Review process. *Section 34-116 (3)a. - Site Plan Criteria* requires compliance with the following criteria:

1. **Is in conformity with the comprehensive plan and is not detrimental to the neighboring land use;**
   The proposed amendment to the approved site plan is in conformity with the Comprehensive Plan, and is not detrimental to the neighboring land use.

   - **Policy 1.2: Regulate the use, density, and intensity of land development that is consistent with this FUTURE LAND USE element.**
     The proposed amendments to the senior living facility modifications are consistent with the existing land use designation in which they are located, and decrease the overall density and intensity of the site. The existing future land use designation of High Density Residential requires density not to exceed 20 dwelling units per acre (du/ac). The proposed site plan modification will allow the site to retain a density of 15.15 dwelling units per acre. This is well below the permitted density of 20 dwelling units per acre and previously approved 16.71 dwelling units per acre.

   - **Policy 1.12: Residential subdivisions or development areas shall be designed to include an efficient system of internal circulation of both vehicular and non-vehicular traffic including the provision of collector streets to feed vehicular traffic to arterial roads and highways, as well as provision of pedestrian and bicycle paths.**
     The Waterford campus will maintain its existing vehicular and pedestrian circulation systems. The proposed amendment will modify circulation in the southeast region of the site slightly. Despite these changes, the circulation of the overall site will be maintained to prioritize safe and efficient circulation.

2. **Has an efficient pedestrian and vehicular traffic system, including pedestrian, bicycle, and automotive linkages and proper means of ingress and egress to the streets;**
   The existing development has efficient pedestrian and vehicular systems, and will be improved in this proposed amendment. Improved sidewalks and pathways are proposed throughout the site to improve internal connections. Ingress and egress to the site itself are not changing. The entrances along Universe Blvd are to remain.

3. **Has adequate provision for public services, including, but not limited to, access for police, fire and solid waste collection;**
   The previously approved Waterford development had adequate access to public services. The Waterford campus will maintain access to public services with the proposed amendment, especially since it is a decrease in density and intensity. Stated previously, the overall density of the site decreased from 16.71 dwelling units per acre to 15.15 dwelling units per acre, and the number of beds decreased from 638 to 578.

4. **Complies with the provisions of chapter 20, article III, regarding potable water, sanitary sewer, solid waste, drainage, recreation and open space, and road facilities;**
   The proposed amendment to the Waterford Campus complies with the provisions of Chapter 20, article III. The site is located within the Southern planning area of the Town of Juno Beach, and is currently within the maximum day water consumption rate of 181.7 gallons/day. Upon approval of the site plan amendment and decrease in density/intensity, the water consumption rate is expected to decrease.

5. **Is planned in accordance with natural characteristics of the land, including, but not limited to, slope, elevation, drainage patterns (low areas shall be used for lakes or drainage easements), natural vegetation and habitats, and unique physical features;**
   The Waterford development, including the proposed site plan amendment, has been planned in accordance with the natural characteristics of the land. A 0.59-acre lake exists on the southeast corner of the site which will be maintained as part of this amendment. The previous approval removed this lake, and now it is proposed to remain. Proposed buildings B and H are designed to wrap around the natural shape of the existing lake. A 5-foot sidewalk has been added along the three proposed buildings, furthering pedestrian access and circulation of the site, and providing a walking path with a view of the lake. Grading and drainage modifications have been considered with these modifications, are in compliance with building design standards, and are subject to review by applicable agencies during the permitting process.

6. **Preserves environmental features and native vegetation to the maximum extent possible, and complies with the Environmentally Sensitive Lands Ordinance;**
   The subject site is already improved, and does not include extensive vegetation or environmental features. The proposed modifications are designed to minimize impact to existing environmental features on the site and are in compliance with the Environmentally Sensitive Lands Ordinance.

7. **Protects estuarine areas when concerning marina siting, drainage plans, alteration of the shoreline, provisions for public access and other concerns related to water quality and habitat protection;**
   This criteria is not applicable, as the subject site is not located in close proximity to the shoreline. The existing development and approved site plan currently protects estuarine areas, and the proposed amendments will maintain these protection efforts.

8. **Complies with all sections of this chapter.**
   The proposed site plan modifications and development comply with Chapter 34 – Zoning. Refer to the Development Program section of this report on Page 4 for justification on how the proposed amendment

APPEARANCE REVIEW CRITERIA

1. **Is of an architectural style representative of or reflecting the vernacular of Old Florida style which is indigenous to the town and which is commonly known and identified by its late Victorian (Key West Cracker), Spanish revival (Mediterranean), Modern (early to mid-20th century), or combination thereof style of architecture. Summarized briefly, common features of the vernacular of Old Florida style that identify the Victorian (Key West Cracker), and Spanish revival (Mediterranean) architectural style include wood or concrete block with stucco siding; simple pitched roofs; tile, metal, or asphalt roofs; ornate details such as but not limited to exposed soffits, individualized vent and louver shapes, reliefs, and detailed window and door treatments; lush landscaping with private yards; and use of porches, balconies and patios. Common features of the vernacular of Old Florida Style that identify the Modern (early to mid-20th century) architectural style include clean geometric lines, often at right angles; an emphasis on function; materials such as glass, steel, iron, and concrete; and the use of natural light though large and expansive windows;**

   The existing Waterford Campus was previously reviewed and approved to be in compliance with the aforementioned appearance review standards. The proposed modifications maintain said standards by providing the common architectural features to give the campus an aesthetically appealing style consistent with Juno Beach adopted styles.

2. **Is of a design and proportion which enhances and is in harmony with the area. The concept of harmony shall not imply that buildings must look alike or be of the same style. Harmony can be achieved through the proper consideration of setback, scale, mass, bulk, proportion, overall height, orientation, site planning, landscaping, materials, and architectural components including but not limited to porches, roof types, fenestration, entrances, and stylistic expression. For the purpose of this section, the comparison of harmony between buildings shall consider the preponderance of buildings or structures within 300 feet from the proposed site of the same zoning district;**
   The proposed site modifications to the Waterford Campus are designed to enhance the existing development as well as the surrounding area. The design follows the standards set forth in **Division 14 – Community Appearance Standards,** as discussed under number 7 below. The proposed Phase 2 modifications are in harmony with and will enhance the Waterford Campus for current and future needs of the development and its residents.

3. **Elevator and stairwell shafts and other modern operations and features of a building shall be either completely concealed or shall incorporate the elements of the architectural style of the structure; rooftop equipment and elevator and mechanical penthouse protrusions shall be concealed; and parking garages and other accessory structures shall be designed with architectural features and treatments so that they are well proportioned and balanced and in keeping with the architectural style of the principal structure;**
   Elevators and stairwell shafts, and other features proposed are designed to be well proportioned and balanced, while maintaining the architectural style of the principal structure and development as a whole. Proposed Buildings B and H are multi-story and will have elevator and stairwells. The structures are designed to match the existing architectural character of the Waterford campus and will adequately fulfill this criteria.

4. **Shall have all on-site structures and accessory features (such as but not limited to light fixtures, benches, litter containers, including recycling bins, traffic and other signs, letter boxes, and bike racks) compatible in design, materials, and color;**
   Accessory features that were previously approved include light fixtures, benches, litter containers, recycling bins, bike racks are included on the site. These features are designed to be compatible with the overall development and structures.

5. **Shall have a design in which buildings over 40 feet in height shall appear more horizontal or nondirectional in proportion rather than vertical, accomplished by the use of architectural treatments as described in these criteria;**

   The proposed structures for this amendment are shorter in height than what was approved in 2022. Building B was approved to be 7 stories (90 feet) tall on the Independent Living section and 3 stories (25 feet) tall on the Memory Care/ Assisted Living section. Now, Building B- Assisted Memory Care section will be 3 stories (51 feet) tall and Building H- Independent Living will be four stories (64 feet) tall. These structures are designed to meet this standard. Please refer to the architectural plans and elevations provided.

6. **Shall locate and design mechanical equipment with architectural treatments so that any noise or other negative impact is minimized;**
   Mechanical equipment on the site is designed with architectural treatments to minimize negative impacts, and will remain upon approval of the proposed amendment. Any new mechanical equipment proposed in this amendment will also comply with this criteria.

7. **Complies with the town's community appearance standards (see article IV, division 14 of this chapter).**
   The proposed amendment is in compliance with the Town of Juno Beach Community Appearance Standards. Compliance is outlined below:

   Section 34-1302 – Intent and purpose

   The community appearance standards for the town are designed to enhance the appearance and environment of the streets, bicycle and pedestrian ways, and public spaces of the town as well as provide vehicular (motorized and nonmotorized) and pedestrian access to all public and private land.

   The proposed modifications to The Waterford campus are in compliance with the intent and purpose of the Town's community appearance standards. The proposal enhances the appearance and environment of the campus as discussed in this report.

   Sec. 34-1304. - Permits required.
   All improvements within a right-of-way, such as but not limited to road construction, landscaping, sidewalks, lights, and traffic signs, require town approval as well as a right-of-way permit from the right-of-way agency prior to installation. In addition, any improvements within an easement require approval from the easement holder.

   All applicable permits will be applied for following approval of the site plan amendment.

   Sec. 34-1305. - Street enhancement; diagrams

   a) **The diagrams that follow this division show how the streets and rights-of-way in the town shall be enhanced. A development shall be required to enhance the public street or right-of-way adjacent to its property up to the centerline as shown in the following diagrams. If a particular street is not shown, or a new public street is created within a development, then the general streetscape diagram shall be used for minimum requirements. The bike lanes shown on existing streets require approval and construction by the respective right-of-way agency, unless otherwise specified in a development approval. Notwithstanding the foregoing, the town council retains the discretionary authority to modify the sidewalk and walkway designs depicted in the diagrams referenced herein to delete or revise the requirements relating to brick pavers and brick accents.**

   b) **The streetscape and design standards depicted in the diagrams that follow this division for signs within streets and rights-of-way throughout the town shall only be required for street signs, stop signs, combination street/stop signs, and any attachments thereto.**

   c) **All improvements within a right-of-way shall meet the minimum requirements of the state Manual of Uniform Minimum Standards for the Design, Construction, and Maintenance of Streets and Highways (FDOT Green Book), as amended from time to time.**

      The approved development incorporated the street enhancement standards in the design. The approved development includes concrete pedestrian walkways with brick paver accents, as well as a green area between the walkways and edge of pavement of the street which are elements included in the Streetscape Diagram. The proposed amendment will not impact these elements of design. Landscaping and streetscapes previously approved will be maintained.

Sec. 34-1306. - Public parks, open spaces, and access easements
Improvements within all public parks, open spaces, and access easements shall follow as closely as possible the standards in this division.
This criteria is not applicable to the proposed amendment.

Sec. 34-1307. - Landscaping of streets.
This section of the code outlines requirements for landscaping of street sections. The proposed amendment is in compliance with this section. Refer to the landscape plans provided.

SPECIAL EXCEPTION REQUEST

The Town has requested that the Applicant file a Special Exception Application for the proposed Site Plan Amendment. Please note that the Special Exception request is not to request a new use on the site, but to update the approved Development. Compliance with the Special Exception Criteria Application form are below.

1. **Provide for ingress and egress to the property and structures with particular reference to automotive and pedestrian safety and convenience, traffic flow and access in case of fire or catastrophe;**
   Ingress and egress are not impacted by the proposed amendment. The site will retain primary access from Universe Blvd. Internal automotive and pedestrian circulation will continue to follow the general layout as previously approved.

2. **Provide for parking and loading areas, refuse and service areas, with particular attention to item (1) above and to effects on surrounding property;**
   Parking and loading areas are provided on site in a consistent manner with the previously approved design. The majority of parking and loading are existing and not to be impacted by this amendment. The amended areas of the plan are designed to minimize impact on the surrounding properties.

3. **Provide for screening and buffering-type, dimensions and location;**
   The proposed amendments have adequate screening and buffering which are consistent with the previous approval. Buffers and screening are shown on the plan.

4. **Provide for signs, if any, and proposed lighting;**
   Proposed signage will be provided at the time of permitting. Photometric plans that show proposed lighting are provided.

5. **Provide for required yards and other open space**
   Open space is included on the plan, and consistent with the previous approval. 4.92 acres of open space are provided.

6. **Not adversely affect the public interest,**
   The Waterford is an existing senior living community that is in operation and actively serving the community, specifically the senior population. The proposed amendment to the site plan will continue the previously approved uses that are currently in operation.

7. **Comply with specific requirements governing the special exception requested;**
   The special exception request is not related to a specific use approval. Juno Beach staff has requested that the Applicant apply for this application to allow an amendment to the previous approval. Therefore, this criteria is not applicable.

8. **With conditions and safeguards attached, would be generally compatible with adjacent properties and or property within the district;**

Stated previously, the Special Exception request is not to request a new use on the site, but to update the approved Development. The existing uses in operation will remain, and no new uses are proposed. Therefore, the amendment is compatible with adjacent properties.

9. **Not generate excessive noise or traffic;**
   The current uses on the site are related to senior living and care, which do not generate excessive noise. The proposed amendment reduces the overall number of beds and density. Therefore, traffic is anticipated to reduce.

10. **Not tend to create fire, disease or other equally or greater dangerous hazard;**
    The current uses on site do not create fire, disease, or dangerous hazards. No change in use is requested as part of this amendment. Therefore, the amendment is compliant with this standard.

11. **Be in harmony and compatible with the present and/or future developments of the area concerned;**
    The proposed amendment is compatible with the present and/or future developments of the area. The Waterford is currently in operation and was approved previously for consistency with the area. Proposed amendments to the site plan are minor and will allow the site to remain harmony and compatibility with the area.

12. **Conserve the value of buildings and encourage the most appropriate use of the land and water;**
    The proposed amendment is designed to conserve the value of buildings and encourage the most appropriate use of the land. Stated previously, the site is already developed and in operation. Appropriate used already exist on site, and the amendment will continue said uses.

13. **Provide adequate light and air.**
    The proposed amendment remains consistent with and is less dense than previous approvals. Density and heights of certain buildings have been reduced. Adequate lighting is provided on site as well.

14. **Promote such distribution of population and such classification of land uses, development and utilization as will tend to facilitate and provide adequate provisions for public requirements, including be not limited to transportation, water flowage, water supply, drainage, sanitation, educational opportunities, and recreation;**
    The proposed amendment meets requirements for public facilities and utilities. Density and intensity is reduced from what was previously approved. Therefore, it is anticipated that adequate public facility requirements are met.

15. **Conform to the character of the district and its peculiar suitability for particular uses;**
    Stated previously, this special exception request is not to request a special exception for a type of use. The proposed amendment remains consistent with the character of the district. Previously approved uses remain on the site and are designed to meet the intent and character of the area.

16. **Be consistent with the needs of the Town for land areas for specific purposes to serve population and economic activities;**
    The proposed amendment is consistent with the needs of the Town, specifically the aging population. The Waterford development serves the senior community of Juno Beach, and this amendment will continue said operations.

17. **Protect the tax base; and not create a financial burden on the Town; and**
    The proposed amendment to the existing Waterford Development will not create any financial burdens for the Town of Juno Beach.

18. **Not be disruptive to the character of neighborhoods nor adverse to playgrounds, parks, schools and recreation areas; nor adverse to the promotion of the public health, safety, comfort, convenience, order, appearance, prosperity or general welfare;**
    The proposed amendment is not disruptive to the character of the neighborhood, nor creates adverse effects to the community or general welfare. Uses and operational activities that currently exist on site are being continued but with a revised layout.

CONCLUSION

Based on the above justification and attached information, the petitioner respectfully requests approval of the Site Plan Amendment application for the Waterford PUD through the Site Plan and Appearance Review process, and Special Exception application to amend the approved development.

TOWN OF JUNO BEACH
PLANNING AND ZONING DEPARTMENT
340 OCEAN DRIVE
JUNO BEACH, FL 33048
PHONE 561.626.1122 • FAX 561.775.0812

For Official Use Only
Date Stamp

Application for Development and Site Plan Review

Applicant: Yoan Machado (WGI, Inc,) (Agent)
Project: The Waterford

Location: 601 Universe Boulevard, Juno Beach, FL

Owner(s): Lifespace Communities, Inc.

Signature(s): Applicant: [signature]
Owner(s): Lifespace Communities, Inc. (See attached Owner's Agreement for signatures)
Agent (if other than Applicant/Owner):

Mailing Address
Applicant: WGI, Inc - 2035 Vista Parkway, West Palm Beach, FL 33411 Phone: 561-839-1712
Owner(s): See applicant information. Phone: See applicant information.
Agent: See applicant information. Phone: See applicant information.

Architect: THW Design (2100 River Edge Pkwy, Ste 900, Atlanta, GA 30328) Phone: 561-839-1712 (Agent)
Engineer: WGI Inc (2035 Vista Pwky, West Palm Beach, FL 33411 Phone: 561-839-1712 (Agent)
Planner: WGI Inc (2035 Vista Pwky, West Palm Beach, FL 33411 Phone: 561-839-1712 (Agent)
Landscape Architect: WGI Inc (2035 Vista Pwky, West Palm Beach, FL 33411 Phone: 561-839-1712 (Agent)

(I) (We) affirm and certify that (I) (We) understand and will comply with the provisions and regulations of the Town of Juno Beach Zoning Code. (I) (We) further certify that the above statements and the statements made in any paper or plans submitted herewith are true to the best of (my) (our) knowledge and belief. Further, (I) (We) understand that this application, attachments and fees become part of the Official Records of the Planning Department and are not returnable.

04/16/2025
Date

[signature]
Signature of Applicant

THE APPLICANT (OR REPRESENTATIVE) MUST SCHEDULE A MEETING WITH THE PLANNING & ZONING DIRECTOR TO SUBMIT THE MATERIALS NECESSARY FOR EACH APPLCIATION. ALL SITE PLANS SUBMITTED MUST BE BOUND AND ROLLED.

Site Plan and Appearance Approval Checklist

The following checklist is designed to assist applicants in preparing required materials for review. The applicant should check off each item to insure that it is included. Items omitted will delay review procedures. All plans must be bound and rolled: letters must be submitted separately and collated in complete sets.

Eight (8) 24" x 36" sets of detailed plans drawn to scale. An engineering scale with adequate resolution for verification of measurement should be used. The site plan shall include the following:

X (a) Name of proposed project.

X (b) Date, north arrow, and graphic scale.

X (c) Vicinity map showing property in relation to adjacent area.

X (d) Adjacent land uses, including footprints of any structures or vehicular uses areas on adjacent areas.

X (e) Location of property line, right-of-way, proposed/existing easements, water sources, dune crestline, vegetation line, Coastal Construction Control Line, and other essential features.

X (f) Streets, bike lanes, sidewalks, driveways, intersections, curb cuts and turning lanes adjacent to and across from the subject property, and means of access to site.

X (g) Location and dimensions of all perimeter treatment (sidewalks, bike paths, fences, walls and berms).

Provided on Civil Plan (h) The footprints of all buildings showing their proposed uses, setbacks, dimensions, floor area, number of stories, height, points of access, and finished floor elevation in relation to **mean sea level (NAVD 1988).**

Signage to be provided at permitting. (i) Location, height, colors, materials and dimensions of all signs, retaining walls and other accessory structures.

N/A (j) Phasing Plan of the site, including any temporary facilities or treatments such as landscaping and accesses.

X (k) Location and width of any proposed dedication of property for public or private road right-of-way and any other form of easement.

X (l) Layout and location of all on-street and off-street parking, loading and other vehicular use areas, including where applicable, distance from the principle uses.

X (m) Location and dimensions of all parking and handicap spaces, bicycle parking facilities, driveways and aisled, dumpsters, and loading zones.

N/A (n) Loading Demand Statement for all non-residential uses, detailing the land use's projected normal demands for loading and unloading.

N/A (o) Statement of estimated need for bicycle parking facilities for all uses.

Provided on Photometrics. (p) Location, height and detail of all outdoor illuminations.

X (q) Location of existing and proposed fire hydrants (or operational equivalents) on and near site.

X (r) Location, percentage, and size of acres to be conveyed, dedicated or reserves as open space, public parks, recreational, and similar uses.

X (s) Location and screening of all garbage/trash features including recycling bins, mechanical equipment, satellite dishes, and other accessory structures.

X (t) Supply a site data table which indicates the following:

1. Existing/proposed land use and zoning.
2. Total acres of project.
3. Intensity, total gross building square footage.
4. Gross building footprint square footage.
5. Percent of open space/landscaping, lot coverage and impermeable surface.
6. Acres and percent of water bodies.
7. Density, number of dwelling units (residential), and total living area per unit.
8. Parking computations (parking required, parking provided, parking ratio, & handicap spaces provided).
9. Building Height – to correspond with data from survey and proposed finished floor elevation.
10. Loading spacing required & provided.

X (u) NPDES permit, if required (required when subject property has an area of 1 acre or greater). For projects/sites requiring such permit, the applicant must also include a binding letter from the developer/applicant, which will provide that the storm drain system shall be monitored and maintained (and produce a corresponding report) on an annual basis, according to the standards identified in the NPDES permit. Such annual reports shall be made available upon

completion to the Town of Juno Beach Public Works Director.

___ ½ acre of less (exempt)

___ greater than ½ acre (requires permit though Department of Environmental Protection).

_X_ (v) Landscape plan, including the following:

1. Location and number of all proposed landscaping and location of landscape buffers;
2. A separate list of both the species and common name of proposed landscaping;
3. Native and non-native plant designation, and percentage of native plant material utilized for each type of plant, including trees, shrubs, and groundcover;
4. Size, as appropriate, of all proposed landscaping;
5. Total square feet of landscaping and pervious surface;
6. Percentage of landscaping and pervious surface of the total site area;
7. Statement that all landscape areas will be provided with permanent, automatic irrigation where needed; and
8. Calculations for provision of landscaping for vehicular parking and circulation areas.

_X_ (w) Engineering plans, including water and sewer, drainage, paving, and grading. High and low points must be shown on drainage, paving and grading plans. Cross sections are required at all perimeter conditions. Coordination with the Landscape Plans is required.

_X_ (x) Survey; signed and sealed by a Professional Land Surveyor registered in the State of Florida.

N/A (y) Preliminary Plat, if re-plat or subdivision is required.

N/A (z) School Concurrency application, analysis and School District Approval.

Eight (8) copies of the following items must also be submitted:

___ 1. 8 ½" x 11" location map showing site and uses adjacent to and across from site.
___ 2. Front, side and rear elevations of all buildings.
___ 3. Typical floor plans.
___ 4. Graphic survey of existing vegetation, delineating all viable native vegetation and all trees greater than four (4) inches in diameter (caliper) at 4 feet above ground, on site. (An individual single family dwelling or duplex on less than four (4) acres are exempt from this requirement).
___ 5. Traffic Impact Study:
   a) A traffic Impact Study is required that is in compliance with the Palm Beach Countywide Traffic performance Standards Ordinance;
   b) The Palm Beach County Department of Engineering and Public works shall have completed a review of the traffic study for the proposed project, pursuant to the countywide traffic performance standards and the minimum review thresholds established therein, prior to submission of the application to the Town. Appropriate written verification of the completion of the review by that department shall be submitted with the application.

N/A 6. Market Study may be required by the Director of Planning & Zoning.
___ 7. Letter from applicant stating the following:
   a) General description of request.
   b) General Background information on project and site.
   c) Justification (special reasons or basis for the request).
___ 8. Written confirmation of the provision of all necessary facilities and systems for water supply, sewage treatment, storm drainage, garbage collection, and Fire Rescue and the ability of these services to be delivered with the proposed site plan.
___ 9. Warranty deed, copy of purchase contract of written consent of owner.
___ 10. Letter authorizing agent to represent developer/owner.
N/A 11. Environmental Impact Study, if required by the Town's Environmental Sensitive Lands Ordinance.
___ 12. Adequate Facilities Determination must be made by Planning & Zoning Director.
___ 13. Color and Material samples will be required by the Director of Planning & Zoning.
___ 14. Written responses to the Town's Zoning Code Sections dealing with Site Plan criteria, appearance, etc.
N/A 15. A school concurrency application and study, accordingly, if any portion of the project involves residential use. This item shall also be the applicant's responsibility to obtain a sufficient determination from the Director of Planning & Zoning.

NOTE: Site plan review fee and any other applicable fees must accompany

submission. The submission will be considered incomplete until all items outlined on this application have been received and determined complete by Staff. At any time, the Director of Planning & Zoning may determine that the applicant's submission packet is incomplete based on missing or improperly prepared material, which will result in the applicant having to submit/resubmit the incomplete or improperly prepared material. This may also result in the application/petition being postponed to the next P7Z Board/Town Council Meeting.

GUIDELINES

1. A state registered Architect, Engineer and landscape Architect seal is required on all corresponding plans submitted with the applications for review by the Planning and Zoning Board, other than plans submitted for single family or duplex construction.

2. All application deadlines are **strictly** enforced. Any applications submitted to the Town of Juno Beach Planning & Zoning Department must be in no later than **12:00 p.m.** on the day of the deadline. In order to be accepted, the application must contain all pertinent items and information described in the application attachments. Partial applications **will not be accepted** for placement on the Planning and Zoning Board agenda until all such materials are submitted.

3. The **correct number** of required plans must be submitted.

4. If revised plans, documents, etc., are submitted during the review process, it is **the applicant's responsibility** to insert revised documents into the previously submitted plans. Non-adherence to this policy **will cause a delay in processing.**

Applicant Signature

04/16/2025

Date

TOWN OF JUNO BEACH
PLANNING AND ZONING DEPARTMENT
340 OCEAN DRIVE
JUNO BEACH, FL 33048
PHONE 561.626.1122 • FAX 561.775.0812

For Official Use Only
Date Stamp

Application for Special Exception Petitions

A ***Special Exception*** is a use which may be allowed within a zoning district subject to the provisions of the Town of Juno Beach Comprehensive Zoning Ordinance (Ordinance 207 and subsequent amendments).

Section I

Instructions for Completion:

1. Complete Section II of this application, and respond (in written form) to the criteria listed in Section III. You may wish to attach a separate sheet of paper for this item.

2. Sign and date the application under Section III. If appropriate, complete the power of attorney form on page 6 of this application.

3. Attach any information (maps, drawings, survey, letters, legal descriptions, etc.) in order to clarify your petition/application.

4. A filing fee of $1,500.00 (other than single family), $250.00 (single family) must accompany each application upon submittal.

Section II

Please Complete the Following:

Applicant/Agent Information:

Name of Applicant: Yoan Machado (WGI, Inc,) (Agent) Contact Phone #: 561-839-1712
Address of Applicant: 2035 Vista Pwky, West Palm Beach, FL 33411

*If the applicant has an agent, or will be represented by anyone other than the applicant.

*Name of Agent: See applicant information. Contact Phone #: See applicant information.
*Address of Agent: See applicant information.

Regarding the Subject Location (where the special exception is being requested):

Street Location: 601 Universe Boulevard, Juno Beach, FL

Name of Subdivision: Waterford Replat (Plat Book 44, Pages 9-97)

Block: _____ Lot: _____

Regarding the Special Exception Petition:

Please describe the special exception being requested: _____

Special exception to revise the approved development program.

Section III

Please address (in written form) the criteria listed below:

Before taking action on any special exception request, the Planning & Zoning Board/Town Council shall make written findings of fact addressing the issues of whether the requirements of the section of the ordinance described (herein) have been met, and whether, satisfactory provision and arrangement has been made that the special exception use will, where applicable:

1. Provide for ingress and egress to the property and structures with particular reference to automotive and pedestrian safety and convenience, traffic flow and access in case of fire or catastrophe;

Applicant Response: See provided justification statement.

2. Provide for parking and loading areas, refuse and service areas, with particular attention to item (1) above and to effects on surrounding property;

Applicant Response: See provided justification statement.

3. Provide for screening and buffering-type, dimensions and location;

Applicant Response: See provided justification statement.

4. Provide for signs, if any, and proposed lighting;

Applicant Response: See provided justification statement.

5. Provide for required yards and other open space;
Applicant Response: See provided justification statement.

6. Not adversely affect the public interest;
Applicant Response: See provided justification statement.

7. Comply with specific requirements governing the special exception requested;
Applicant Response: See provided justification statement.

8. With conditions and safeguards attached, would be generally compatible with adjacent properties and or property within the district;
Applicant Response: See provided justification statement.

9. Not generate excessive noise or traffic;
Applicant Response: See provided justification statement.

10. Not tend to create fire, disease or other equally or greater dangerous hazard;
Applicant Response: See provided justification statement.

11. Be in harmony and compatible with the present and/or future developments of the area concerned;
Applicant Response: See provided justification statement.

12. Conserve the value of buildings and encourage the most appropriate use of the land and water;
Applicant Response: See provided justification statement.

13. Provide adequate light and air;
Applicant Response: See provided justification statement.

14. Promote such distribution of population and such classification of land uses, development and utilization as will tend to facilitate and provide adequate provisions for public requirements, including be not limited to transportation, water flowage, water supply, drainage, sanitation, educational opportunities, and recreation;
Applicant Response: See provided justification statement.

15. Conform to the character of the district and its peculiar suitability for particular uses;
Applicant Response: See provided justification statement.

16. Be consistent with the needs of the Town for land areas for specific purposes to serve population and economic activities;
Applicant Response: See provided justification statement.

17. Protect the tax base; and not create a financial burden on the Town; and
Applicant Response: See provided justification statement.

18. Not be disruptive to the character of neighborhoods nor adverse to playgrounds, parks, schools and recreation areas; nor adverse to the promotion of the public health, safety, comfort, convenience, order, appearance, prosperity or general welfare;
Applicant Response: See provided justification statement.

According to Ordinance 207, Town of Juno Beach, Florida, in granting any variance, the Board of Adjustment shall prescribe appropriate conditions and safeguards in conforming with the Zoning Ordinance. The Board of Adjustment may also prescribe a reasonable time limit within which the action for which the variance is required shall commence, be completed, or both.

Among other conditions and safeguards, the Town Council may prescribe reasonable time limits within which actions shall commence, be completed, or both.

Applicant's Signature

04/17/2025
Date

Joan Machado
Print Name

Witness' Signature

04/17/2025
Date

ARIANNA HILLIARD
Print Name

Special Exception Land Use Power of Attorney

Name of Property Owner(s): Lifespace Communities, Inc.
Mailing Address: 3501 Olympus Blvd, Suite 300, Dallas, TX 75019
Property Address: 601 Universe Blvd, Juno Beach, FL 33408
Property Control Number: 28-43-41-33-30-001-0000
Name of Applicant: Yoan Machado (WGI, Inc,) (Agent)
Contact Phone Number: 561-839-1712

The Undersigned being the record title owner(s) of the real property described above does (do) hereby grant unto the Applicant stated above the full right and power of attorney to make application to the Town of Juno Beach to change the land use of said property. This land use change may include rezoning of the property, granting of special exceptions, variances or appeals of decisions of the Planning & Zoning Department. It is understood that conditions, limitations and restrictions may be placed upon the use of operation of the property. Misstatements upon application or in any hearing may result in the termination of any special exception and/or a proceeding to rezone the property to the original classification. This power of attorney may be terminated only by a written statement of such termination effective upon receipt by the Planning & Zoning Department.

In witness whereof the undersigned have set their hands and seals this 27Th day of march 19 2025

Nicholas Ann Powell
Witness

Owner

Witness


Owner

Before me the undersigned authority personally appeared the owner(s) named above who upon being duly sworn acknowledged before me that they are the owners of the real property described above and that they executed the power of attorney for the purposes stated therein, sworn and subscribed this
27Th day of march 19 2025


Notary Public

SEAL

NOTARIAL SEAL IOWA
ANN POWELL
Commission Number 833928
My Commission Expires
August 20, 2027

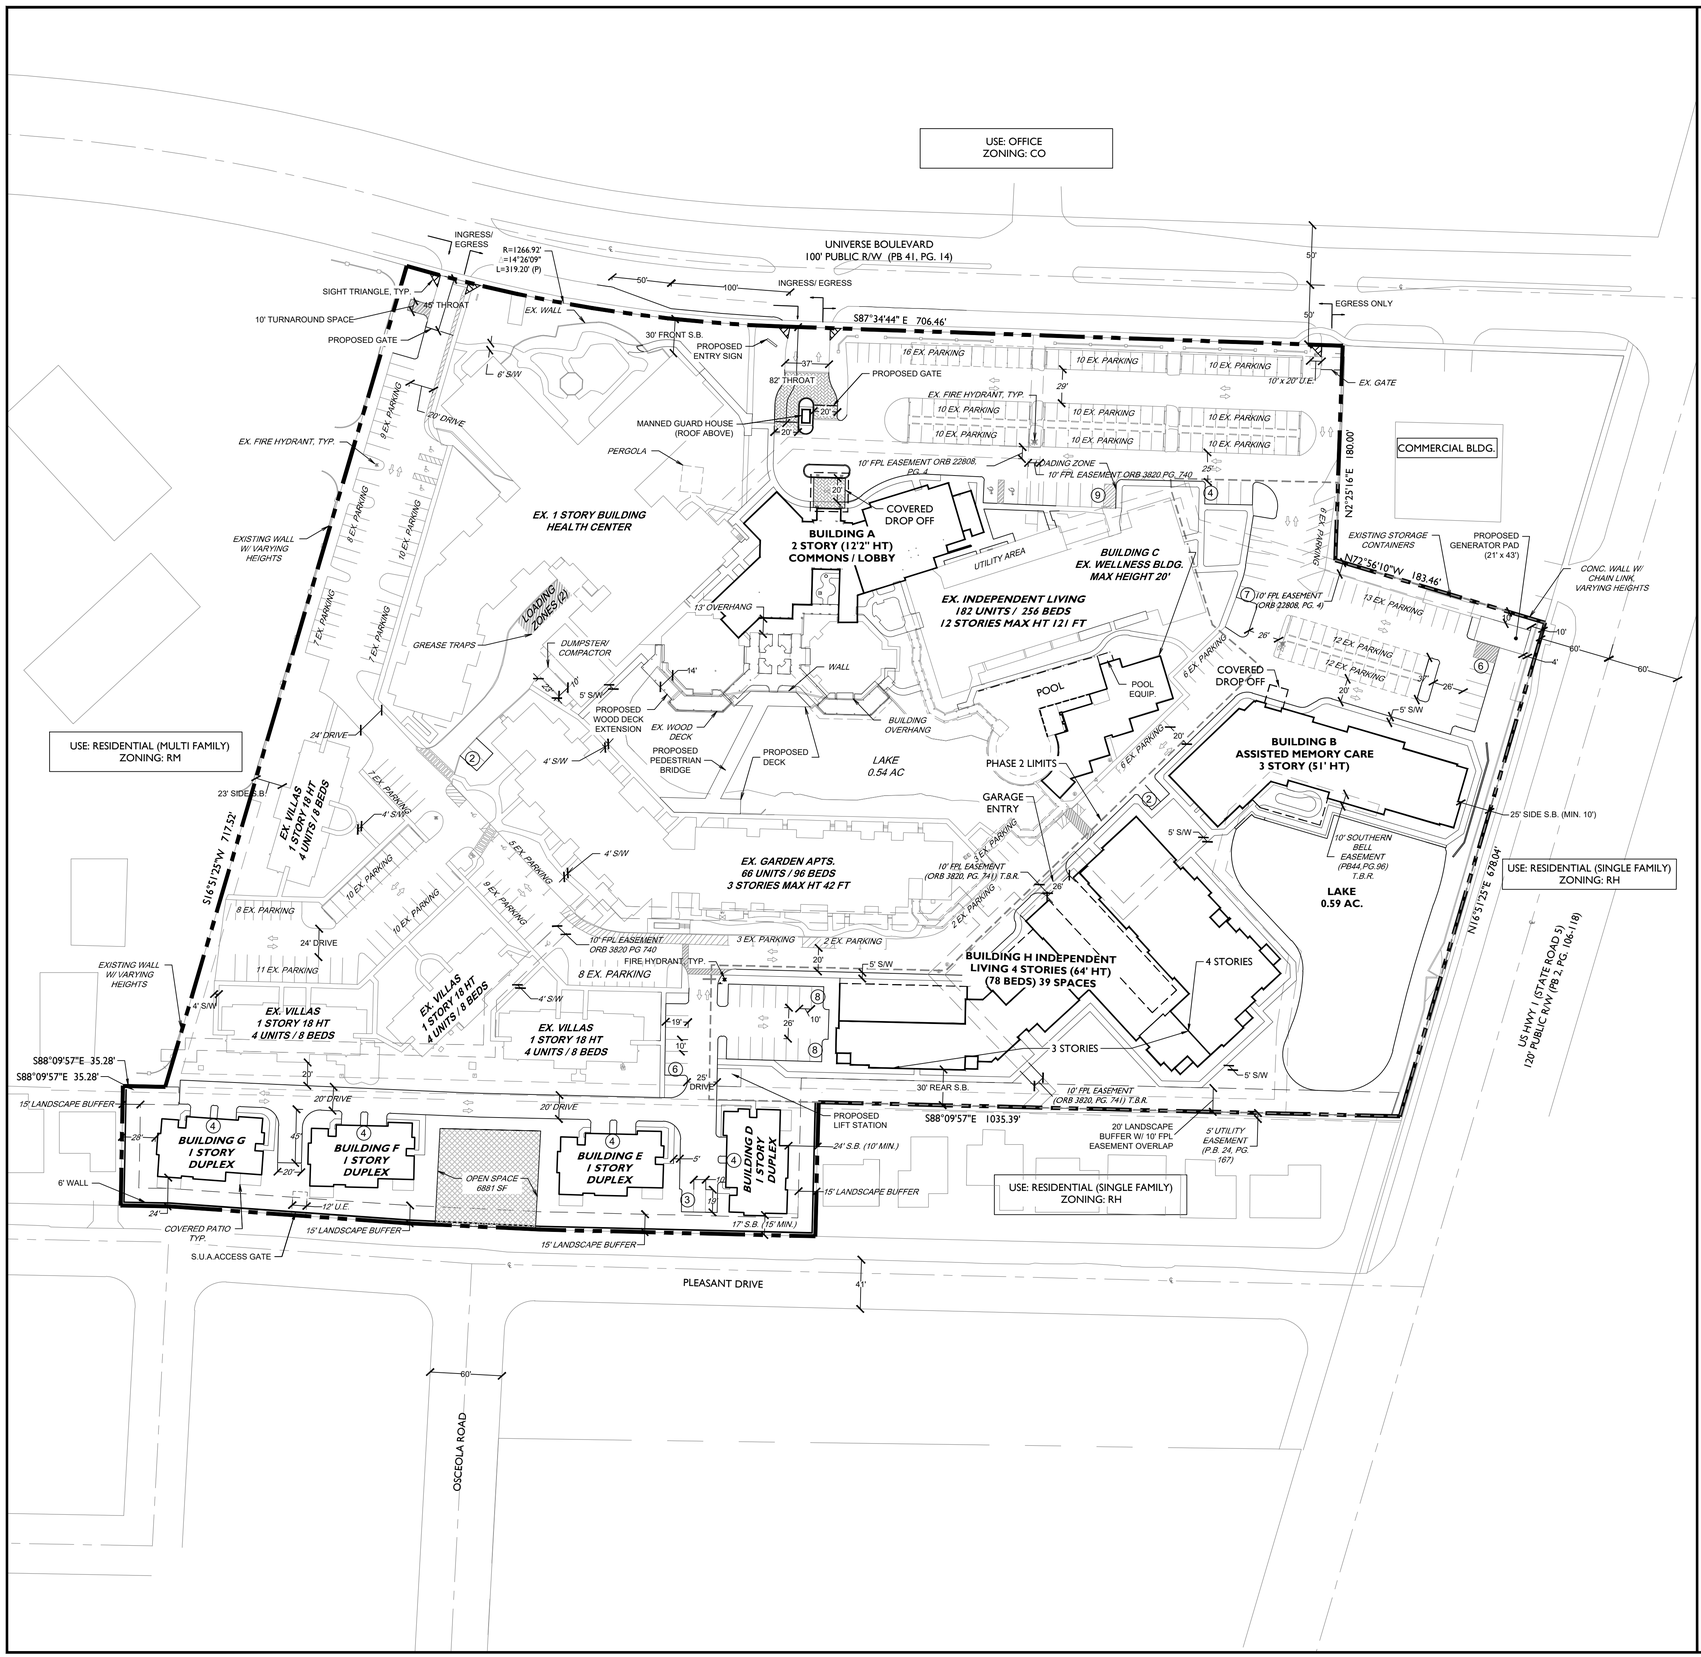

LOCATION MAP

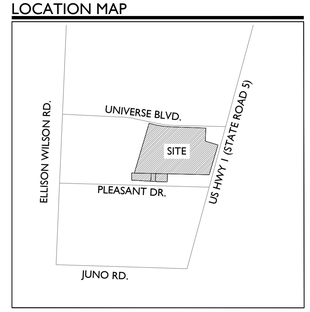

N

0 30 60 120

SCALE: 1" = 60'

SITE DATA

NAME OF APPLICATION	THE WATERFORD
EXISTING/PROPOSED LAND USE	HDR
EXISTING/PROPOSED ZONING	CO/PUD
TOTAL ACREAGE	15.97 AC
TOTAL BUILDING S.F.	486,179 S.F.
PROPOSED BUILDING A	13,431 S.F.
PROPOSED BUILDING B	46,500 S.F.
PROPOSED BUILDING H	90,200 S.F.
EX. WELLNESS BLDG. (BUILDING C)	5,025 S.F.
EX. BUILDINGS D-G (4,180 S.F. EACH)	16,720 S.F.
EX. INDEPENDENT LIVING	217,764 S.F.
EX. GARDEN APTS.	77,151 S.F.
EX. VILLAS (4)	19,388 S.F.
LOT COVERAGE	5.49 AC. (34.4%)
OPEN SPACE	4.72 AC. (29.6%)
IMPERMEABLE SURFACE	4.49 AC. (28.1%)
WATER BODIES	1.1 AC. (6.9%)
APPROVED BEDS	638 BEDS
INDEPENDENT LIVING	538 BEDS
GARDEN APARTMENTS	96 BEDS
INDEPENDENT LIVING TOWER	256 BEDS
INDEPENDENT LIVING VILLAS	32 BEDS
RESIDENT CARE BUILDING	138 BEDS
DUPLEX VILLAS	16 BEDS
ASSISTED LIVING	24 BEDS
MEMORY CARE	16 BEDS
SKILLED NURSING	60 BEDS
PROPOSED BEDS	
INDEPENDENT LIVING	
* RESIDENT CARE BUILDING BEDS TO BE REMOVED	138 BEDS
*INDEPENDENT LIVING BUILDING H	78 BEDS
TOTAL BEDS	578 BEDS
INDEPENDENT LIVING	478 BEDS
ASSISTED LIVING	24 BEDS
MEMORY CARE	16 BEDS
SKILLED NURSING	60 BEDS
DENSITY (578/2.39=242 UNITS/15.97 AC)	15.15 UNITS/ AC.
MAX. BUILDING HEIGHT	12 STORY (121 FT.)
PARKING APPROVED PER PARKING STUDY	222 SP.
INDEPENDENT LIVING UNIT 0.46 SP. / 1 UNIT @ 356 UNITS	164 SP.
ASSISTED LIVING 0.58 SP. / 1 BED @ 24 BEDS	14 SP.
MEMORY CARE 0.58 SP. / 1 BED @ 16 BEDS	9 SP.
SKILLED NURSING 0.58 SP. / 1 BED @ 60 BEDS	35 SP.
PARKING DEMAND	192 SP.
INDEPENDENT LIVING UNIT 0.46 SP. / 1 UNIT @ 290 UNITS	134 SP.
ASSISTED LIVING 0.58 SP. / 1 BED @ 24 BEDS	14 SP.
MEMORY CARE 0.58 SP. / 1 BED @ 16 BEDS	9 SP.
SKILLED NURSING 0.58 SP. / 1 BED @ 60 BEDS	35 SP.
PARKING PROVIDED	380 SP.
PROPOSED SURFACE SPACES	341 SP.
PROPOSED GARAGE SPACES	39 SP.
HANDICAP SPACE REQUIRED (INCL. IN TOTAL)	8 SP.
HANDICAP SPACES PROVIDED (INCL. IN TOTAL)	8 SP.
LOADING SPACING PROVIDED	4 SP.

* THE RATE TO DETERMINE THE AMOUNT OF PARKING REQUIRED HAS BEEN BASED UPON THE MOST RECENT PARKING STANDARDS ADOPTED BY THE INSTITUTE OF TRANSPORTATION ENGINEERS, 5TH EDITION PARKING GENERATION MANUAL.

* BICYCLE PARKING FACILITIES REQUIREMENTS WAVED BY STAFF WITH APPROVAL OF ORD. NO. 751 ON APRIL 21, 2022, DUE TO THE SPECIAL NATURE OF THE OPERATION AS AN ADULT LIVING FACILITY AND ITS AGING RESIDENTS

LEGEND

AC. = ACRES
D.E. = DRAINAGE EASEMENT
DRO = DEVELOPMENT REVIEW OFFICERS
D.U. = DWELLING UNITS
EX. = EXISTING
FLU = FUTURE LAND USE
L.A.E. = LIMITED ACCESS EASEMENT
L.M.E. = LAKE MAINTENANCE EASEMENT
OHME = OVERHANG/MAINTENANCE EASEMENT
O.R.B. = OFFICIAL RECORD BOOK
P.B. = PLAT BOOK
PDR = PROPERTY DEVELOPMENT REGULATIONS
PG. = PAGE
R = RADIUS
R.O.W. = RIGHT-OF-WAY
R/W = RIGHT-OF-WAY
S.F. = SQUARE FEET
T.B.A = TO BE ABANDONED
T.B.R. = TO BE RELOCATED
TYP = TYPICAL
U.E. = UTILITY EASEMENT
ULDC = UNIFIED LAND DEVELOPMENT CODE
WFH = WORKFORCE HOUSING

No.	DATE	REVISION	BY

WGI.
WGInc.com
2035 VISTA PARKWAY, WEST PALM BEACH, FLORIDA 33411
561.687.2220
CERT NO. 6991

PRELIMINARY

NOT FOR CONSTRUCTION, BIDDING, OR PERMIT PURPOSES.

PREPARED UNDER THE SUPERVISION OF WGI, INC. ON 2025-04-25

INITIAL SUBMITTAL FEBRUARY 28, 2025


THE WATERFORD
601 UNIVERSE BOULEVARD
JUNO BEACH, FL 33408

SITE PLAN


SHEET
SP-1
1 OF 1

2920.04

SAVED: 4/21/2025 11:04 AM
PLOTTED: 4/21/2025 11:05 AM
PLOTTED BY: ISABELLA ENRIQUEZ
PATHNAME: S:\Projects\2920.04 Waterford Campus Redev\PLANNING\2920.04-PL-SITE.dwg

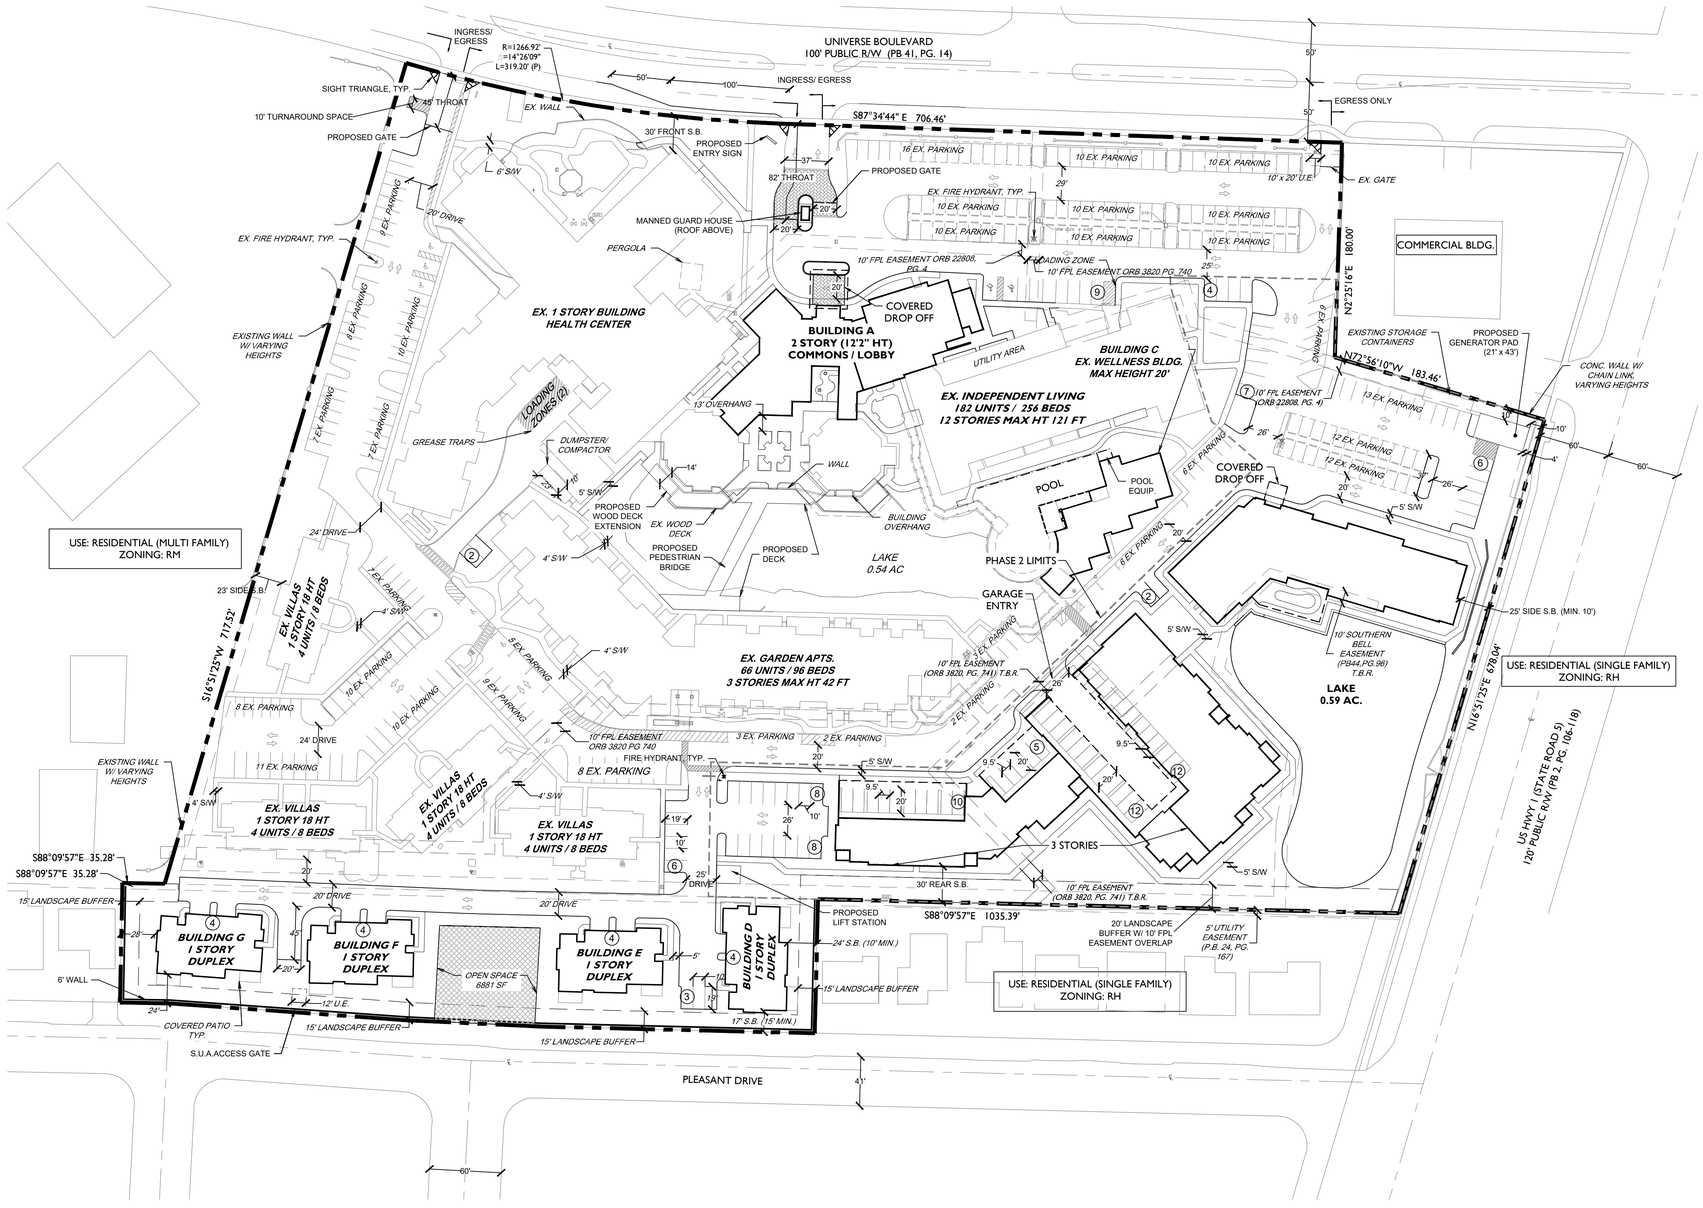

LOCATION MAP

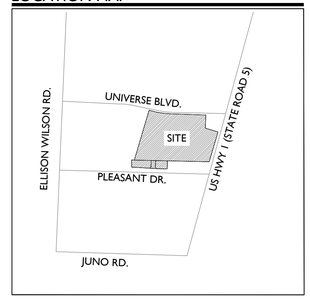

N

0 10 20 40

SCALE: 1" = 20'

SITE DATA

TOTAL PARKING	380 SPACES
EXISTING	296 SPACES
PROPOSED SURFACE PARKING	45 SPACES
PROPOSED GARAGE PARKING	39 SPACES

LEGEND

A.C. = ACRES
D.E. = DRAINAGE EASEMENT
DRO = DEVELOPMENT REVIEW OFFICERS
D.U. = DWELLING UNITS
EX. = EXISTING
FLU = FUTURE LAND USE
L.A.E. = LIMITED ACCESS EASEMENT
L.M.E. = LAKE MAINTENANCE EASEMENT
OHME = OVERHANG/MAINTENANCE EASEMENT
O.R.B. = OFFICIAL RECORD BOOK
P.B. = PLAT BOOK
PDR = PROPERTY DEVELOPMENT REGULATIONS
PG. = PAGE
R = RADIUS
R.O.W. = RIGHT-OF-WAY
R/W = RIGHT-OF-WAY
S.F. = SQUARE FEET
T.B.R. = TO BE RELOCATED
TYP = TYPICAL
U.E. = UTILITY EASEMENT
ULDC = UNIFIED LAND DEVELOPMENT CODE
WFH = WORKFORCE HOUSING
— — — — = PHASE 2 LIMITS

No.	DATE	REVISION	BY

CERT NO. 6991
WGI.
WGInc.com
2035 VISTA PARKWAY, WEST PALM BEACH, FLORIDA 33411
561.687.2220

PRELIMINARY

NOT FOR CONSTRUCTION, BIDDING, OR PERMIT PURPOSES.

PREPARED UNDER THE SUPERVISION OF WGI, INC. ON 2025-04-25

INITIAL SUBMITTAL
FEBRUARY 28, 2025

THE WATERFORD


601 UNIVERSE BOULEVARD
JUNO BEACH, FL

REGULATING PLAN


SHEET
RP-1
1 OF 2


2920.04

SAVED: 4/25/2025 10:04 AM
PLOTTED: 4/25/2025 10:05 AM
PLOTTED BY: ISABELLA ENRIQUEZ
DRAWING: P:\2920\04\Waterford Campus Redev\PLAN\CAD\2920.04 PL-SITE.dwg

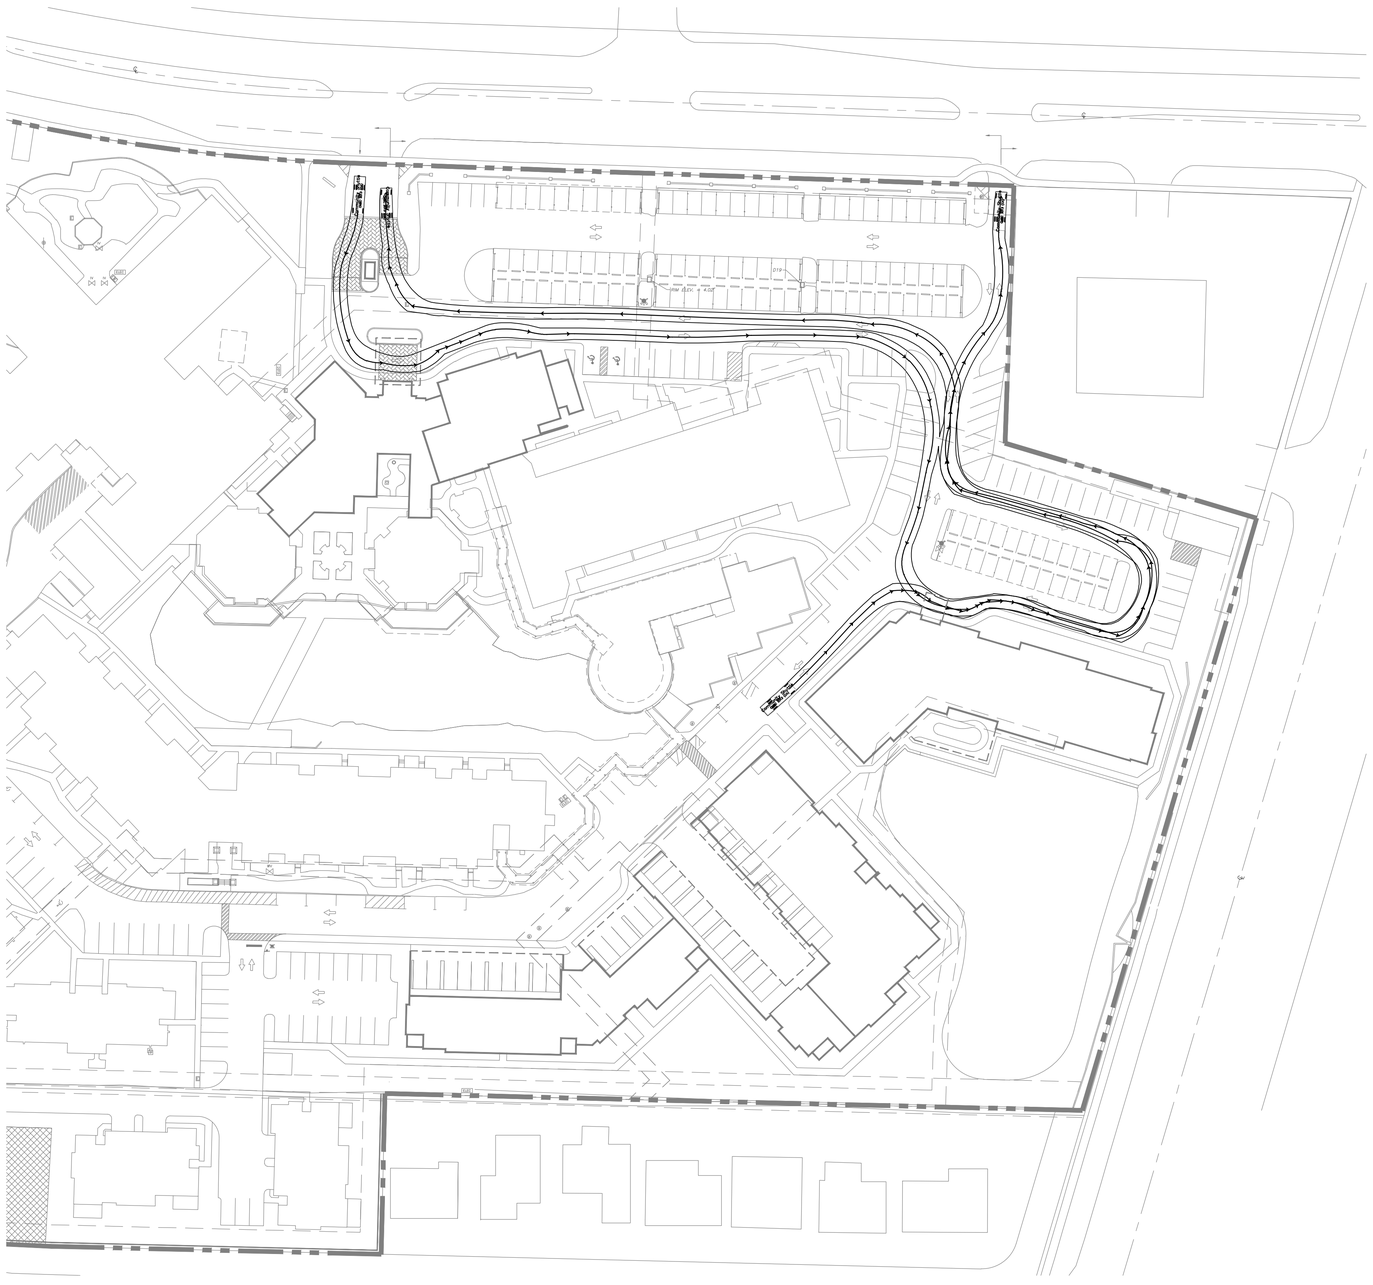


LOCATION MAP

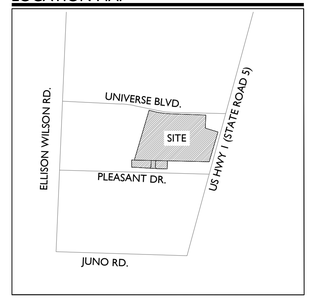



BUS DETAIL



Community Shuttle	feet
Width	: 7.87
Track	: 7.87
Lock to Lock Time	: 6.0
Steering Angle	: 37.8

LEGEND

AC. = ACRES
D.E. = DRAINAGE EASEMENT
DRO = DEVELOPMENT REVIEW OFFICERS
D.U. = DWELLING UNITS
EX. = EXISTING
FLU = FUTURE LAND USE
L.A.E. = LIMITED ACCESS EASEMENT
L.M.E. = LAKE MAINTENANCE EASEMENT
OHME = OVERHANG/MAINTENANCE EASEMENT
O.R.B. = OFFICIAL RECORD BOOK
P.B. = PLAT BOOK
PDR = PROPERTY DEVELOPMENT REGULATIONS
PG. = PAGE
R = RADIUS
R.O.W. = RIGHT-OF-WAY
R/W = RIGHT-OF-WAY
S.F. = SQUARE FEET
T.B.R. = TO BE RELOCATED
TYP = TYPICAL
U.E. = UTILITY EASEMENT
ULDC = UNIFIED LAND DEVELOPMENT CODE
WFH = WORKFORCE HOUSING

No.	DATE	REVISION	BY

CERT NO. 6991
WGI.
WGInc.com
2035 VISTA PARKWAY, WEST PALM BEACH, FLORIDA 33411
561.687.2220

PRELIMINARY

NOT FOR CONSTRUCTION, BIDDING, OR PERMIT PURPOSES.

PREPARED UNDER THE SUPERVISION OF WGI, INC. ON 2025-04-25

INITIAL SUBMITTAL
FEBRUARY 28, 2025


THE WATERFORD
601 UNIVERSE BOULEVARD
JUNO BEACH, FL

REGULATING PLAN - TURN ANALYSIS

SHEET
RP-2
2 OF 2

2920.04

SAVED: 4/29/2025 10:59 AM
PLOTTED: 4/29/2025 11:00 AM
PLOTTED BY: ISABELLA ENRIQUEZ
XREFS: C:\2920\04\Waterford Campus Redev\PLANS\CAD\2920.04-PA-SITE.dwg

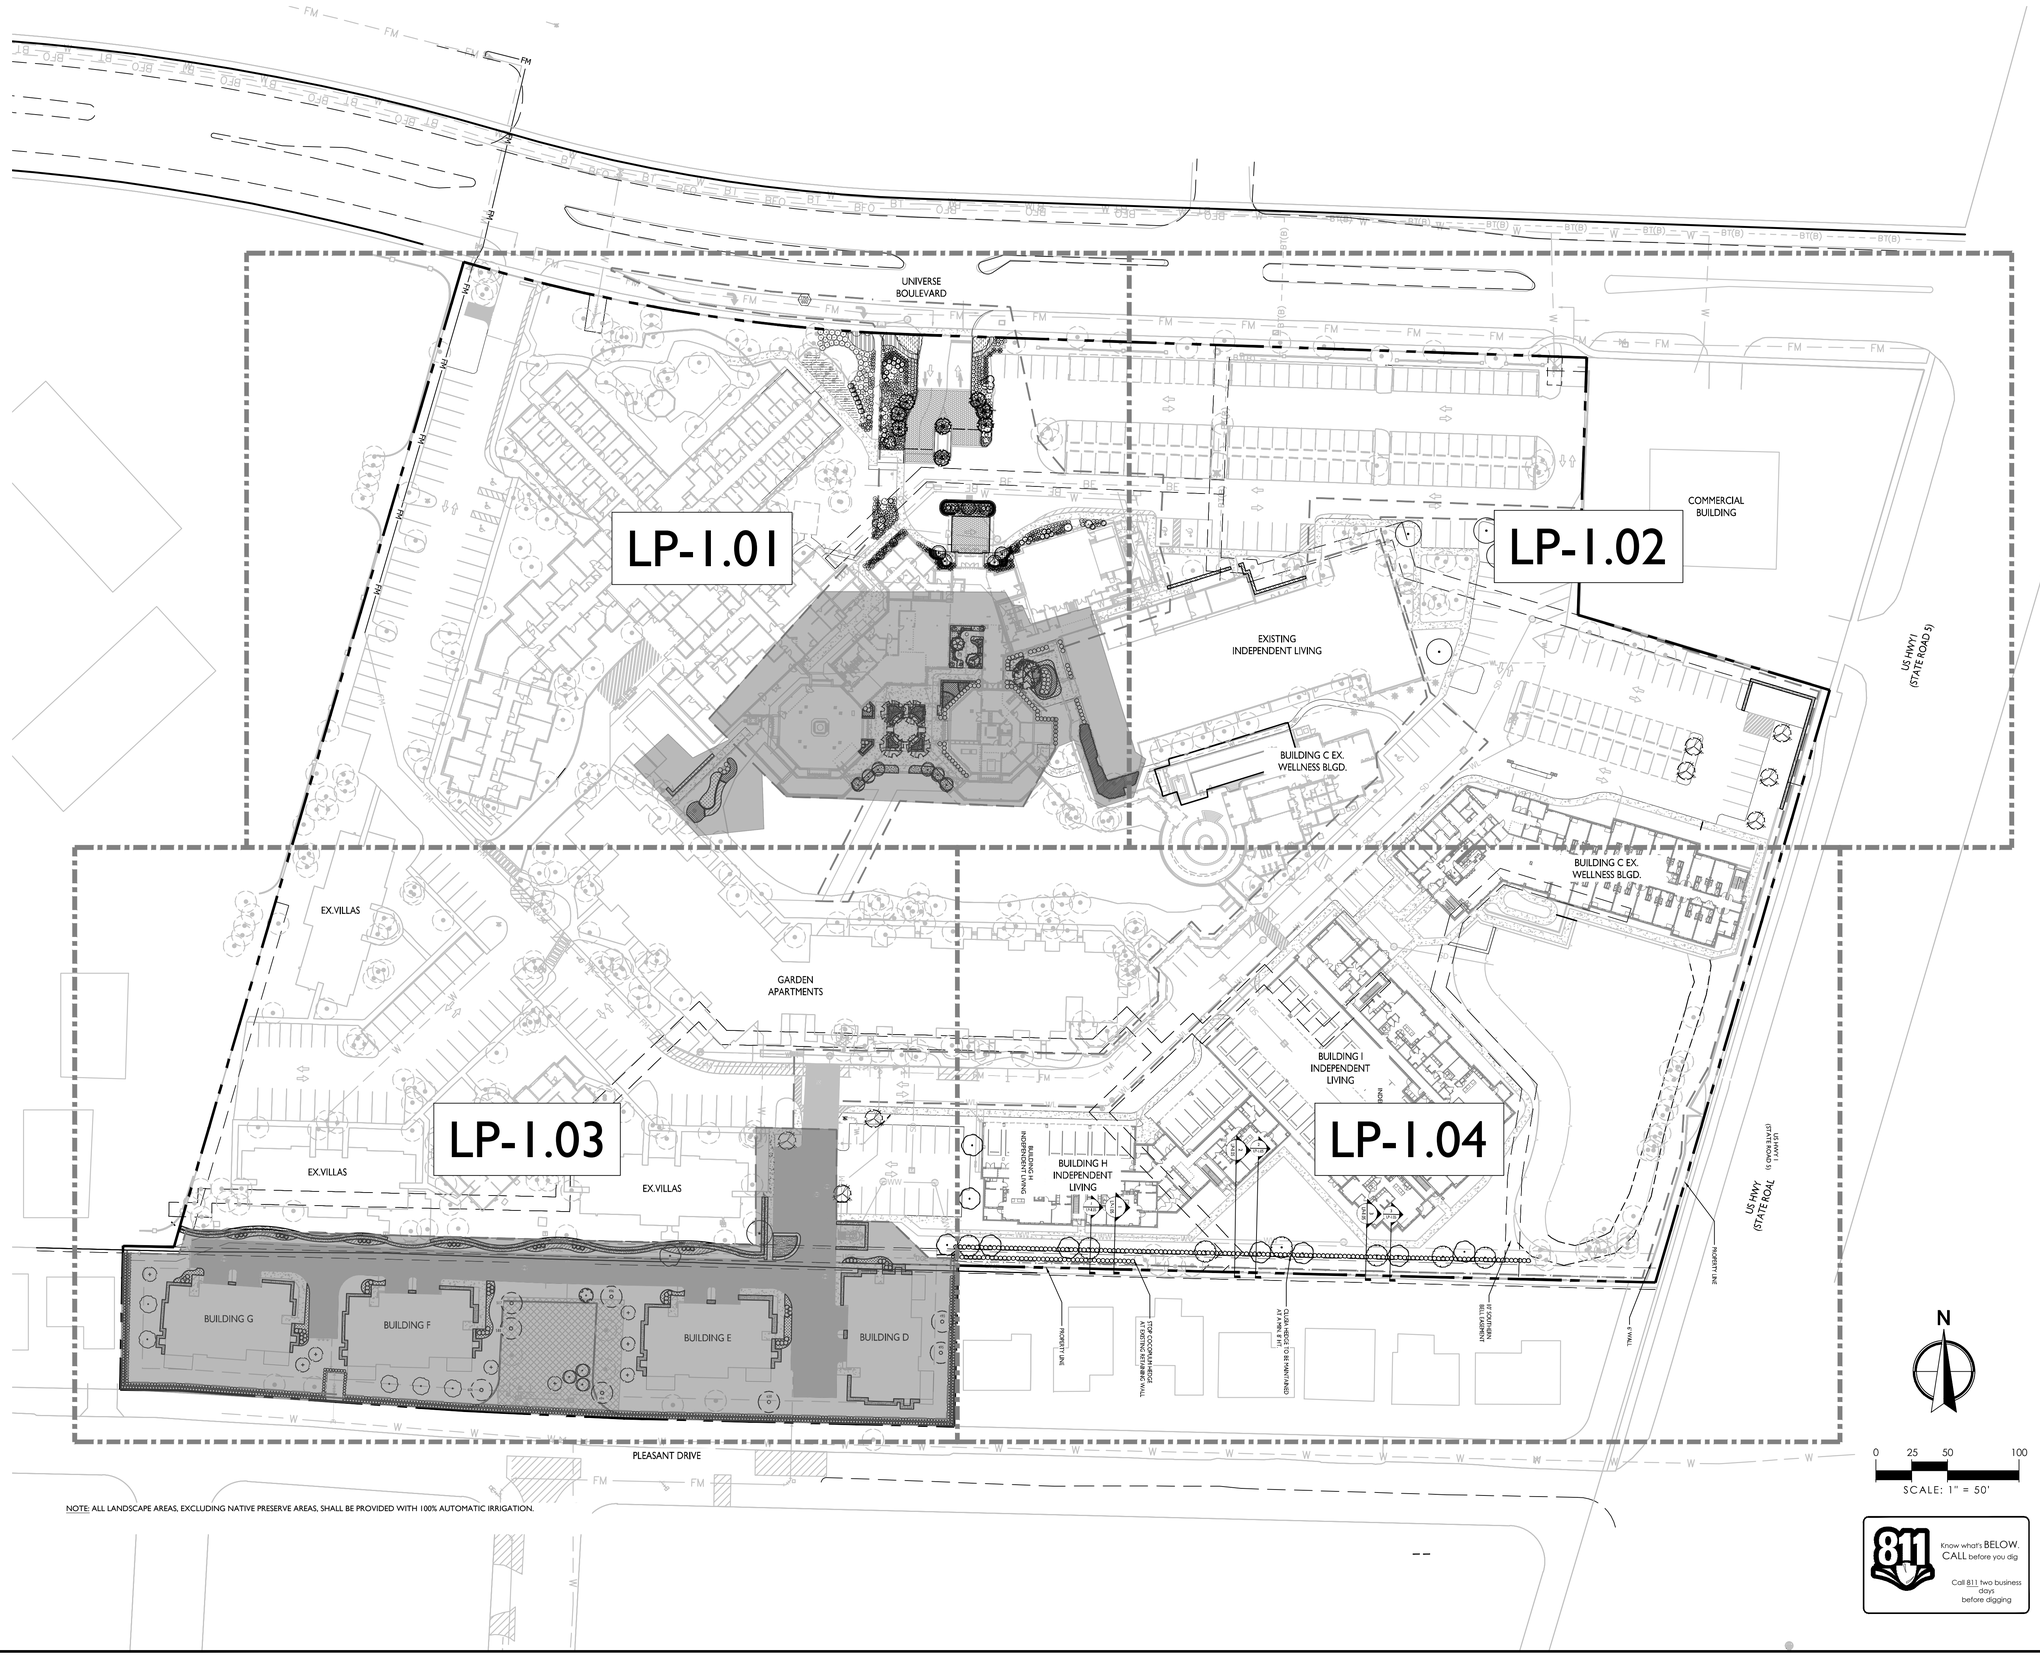

NOTE: ALL LANDSCAPE AREAS, EXCLUDING NATIVE PRESERVE AREAS, SHALL BE PROVIDED WITH 100% AUTOMATIC IRRIGATION.

Know what's BELOW. CALL before you dig

Call 811 two business days before digging

WGI
2035 Vista Parkway, West Palm Beach, FL 33411
Phone No. 866.909.2220 www.wginc.com
Cert No. 6091 - LB No. 7055

NOT AUTHORIZED FOR CONSTRUCTION PRIOR TO FORMAL TOWN APPROVAL

REVISIONS

NO.	DATE	DESCRIPTION	BY
1	2/26/2025	SITE PLAN AMENDMENT	KV
2	7/31/2025	SITE PLAN AMENDMENT	CKW
3	10/6/2025	SITE PLAN AMENDMENT	CKW

CAD 2920.04_LP REVISION.DWG	
JOB NO.	2920.04
DRAWN BY	CKW
CHECK BY	YM
DATE	10/06/2025

LANDSCAPE ARCHITECT OF RECORD
COREY A. KISSELL WONG, PLA
FL # LA6667017


REGISTERED LANDSCAPE ARCHITECT
COREY A. KISSELL WONG
LA 6667017
STATE OF FLORIDA

THE WATERFORD
601 UNIVERSE BOULEVARD
JUNO BEACH, FL
OVERALL LANDSCAPE PLAN

SHEET:
LP-1.00

Corey Kissell Wong P:\2920\2920.04 Waterford Campus Redev\LA\Drawings\Landscape\2920.04_LP revision.dwg — Plotted: 10/6/2025 2:42:15 PM Saved: 10/6/2025 2:02:36 PM

SHEET KEY MAP

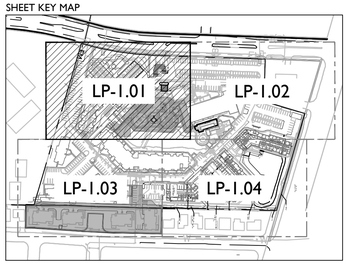

LEGEND

- # TREE/ PALM TO PRESERVE
- # RELOCATED TREE/ PALM
- ROOT BARRIER

N

0 10 20 40

SCALE: 1" = 20'

811 Know what's BELOW. CALL before you dig

Call 811 two business days before digging

SIGHT TRIANGLE, TYP.
10' TURNAROUND SPACE
45' THROAT
12' U.E.
PROPERTY LINE
EX. WALL
PROPOSED GATE
20' DRIVE
6' S/W
30' FRONT S.B.
UNIVERSE BOULEVARD
TRA 692
EX. FIRE HYDRANT, TYP.
EX. PARKING
EXISTING WALL W/ VARYING HEIGHTS
EX. HEALTH CENTER
PERGOLA
10' FPL EASEMENT
MANNED GUARD HOUSE (ROOF ABOVE)
COVERED DROP OFF
EX. PARKING
MATCHLINE LP-1.01
MATCHLINE LP-1.02
LIMITS OF IL COMMONS CONSTRUCTION (UNDER CONSTRUCTION)
PLANTING IN SHADED AREA IS CURRENTLY UNDER CONSTRUCTION.
BUILDING A
13' OVERHANG
LOADING ZONES
GREASE TRAPS
DUMPSTER COMPACTOR
WALL
PROPOSED WOOD DECK EXTENSION
EX. WOOD DECK
PROPOSED WOOD DECK
PROPOSED PEDESTRIAN BRIDGE
LAKE
MATCHLINE LP-1.01
MATCHLINE LP-1.03
MATCHLINE LP-1.01
MATCHLINE LP-1.04

NOTE: ALL LANDSCAPE AREAS, EXCLUDING NATIVE PRESERVE AREAS, SHALL BE PROVIDED WITH 100% AUTOMATIC IRRIGATION.

WGI
2035 Vista Parkway, West Palm Beach, FL 33411
Phone No. 866.909.2220 www.wginc.com
Cert No. 6091 - LB No. 7055

NOT AUTHORIZED FOR CONSTRUCTION PRIOR TO FORMAL TOWN APPROVAL

REVISIONS

NO.	DATE	DESCRIPTION	BY
1	2/26/2025	SITE PLAN AMENDMENT	KV
2	7/31/2025	SITE PLAN AMENDMENT	CKW
3	10/6/2025	SITE PLAN AMENDMENT	CKW

CAD: 2920.04_LP REVISION.DWG
JOB NO.: 2920.04
DRAWN BY: CKW
CHECK BY: YM
DATE: 10/06/2025

LANDSCAPE ARCHITECT OF RECORD
COREY A. KISSELL WONG, PLA
FL # LA6667017

REGISTERED LANDSCAPE ARCHITECT
COREY A. KISSELL WONG
LA 6667017
STATE OF FLORIDA

THE WATERFORD
601 UNIVERSE BOULEVARD
JUNO BEACH, FL
LANDSCAPE PLAN

SHEET:
LP-1.01

Corey Kissell Wong P:\2920\2920.04 Waterford Campus Redev\LA\Drawings\Landscape\2920.04_LP revision.dwg — Plotted: 10/6/2025 2:42:48 PM Saved: 10/6/2025 2:02:36 PM

PROPERTY LINE

10'X20' UTILITY EASEMENT

10' FPL EASEMENT

COVERED PARKING

EX. PARKING

EX. GATE

CONC WALL W/ CHAIN LINK, VARYING HEIGHTS

MATCHLINE LP-1.01

MATCHLINE LP-1.02

10' FPL EASEMENT

EX. FIRE HYDRANT, TYP.

LOADING ZONE

10' FPL EASEMENT

5' S/W

UTILITY AREA

EXISTING INDEPENDENT LIVING

LIMITS OF IMPROVEMENTS

BUILDING C EX. WELLNESS BLDG. MAX HEIGHT 20'

POOL EQUIP.

POOL

BUILDING C EX. WELLNESS BLDG.

COMMERCIAL BUILDING

CONC WALL W/ CHAIN LINK, VARYING HEIGHTS

EXISTING STORAGE CONTAINERS

CONC WALL W/ CHAIN LINK, VARYING HEIGHTS

US HWY1 (STATE ROAD 9)

EX. PARKING

PROPOSED GENERATOR PAD (21' X 43')

COVERED PARKING

COVERED DROP OFF


10' FPL EASEMENT

5' S/W

MATCHLINE LD-1.02

MATCHLINE LD-1.04

SHEET KEY MAP

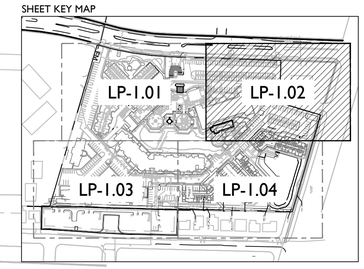

LEGEND

- # TREE/ PALM TO PRESERVE
- # RELOCATED TREE/ PALM
- ROOT BARRIER

N

0 10 20 40

SCALE: 1" = 20'

Know what's BELOW. CALL before you dig

Call 811 two business days before digging

NOTE: ALL LANDSCAPE AREAS, EXCLUDING NATIVE PRESERVE AREAS, SHALL BE PROVIDED WITH 100% AUTOMATIC IRRIGATION.

WGI
2035 Vista Parkway, West Palm Beach, FL 33411
Phone No. 866.909.2220 www.wginc.com
Cert No. 6091 - LB No. 7055

NOT AUTHORIZED FOR CONSTRUCTION PRIOR TO FORMAL TOWN APPROVAL

REVISIONS

NO.	DATE	DESCRIPTION	BY
1	2/26/2025	SITE PLAN AMENDMENT	KV
2	7/31/2025	SITE PLAN AMENDMENT	CKW
3	10/6/2025	SITE PLAN AMENDMENT	CKW

CAD 2920.04_LP REVISION.DWG	
JOB NO.	2920.04
DRAWN BY	CKW
CHECK BY	YM
DATE	10/06/2025

LANDSCAPE ARCHITECT OF RECORD
COREY A. KISSELL WONG, PLA
FL # LA6667017

REGISTERED LANDSCAPE ARCHITECT
COREY A. KISSELL WONG
LA 6667017
STATE OF FLORIDA


THE WATERFORD

601 UNIVERSE BOULEVARD
JUNO BEACH, FL
LANDSCAPE PLAN

SHEET:
LP-1.02

Corey Kissell Wong P:\2800\2920.04 Waterford Campus Review\LA\Drawings\Landscape\2920.04_LP revision.dwg — Plotted: 10/6/2025 2:43:20 PM Saved: 10/6/2025 2:42:39 PM

SHEET KEY MAP

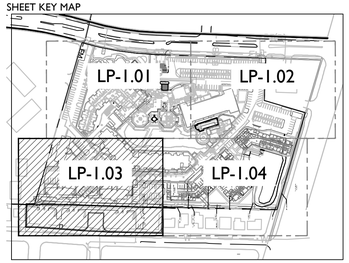

LEGEND

- # TREE/ PALM TO PRESERVE
- # RELOCATED TREE/ PALM
- ROOT BARRIER

N

0 10 20 40

SCALE: 1" = 20'

811 Know what's BELOW. CALL before you dig

Call 811 two business days before digging

PROPERTY LINE

EXISTING WALL W/ VARYING HEIGHTS

EX.VILLAS

EX. PARKING

24' DRIVE

20' DRIVE

25' DRIVE

4' S/W

10' FPL EASEMENT

MATCHLINE LP-1.01

MATCHLINE LP-1.03

MATCHLINE LP-1.04

PROPOSED PEDESTRIAN BRIDGE

PROPOSED WOOD DECK

GARDEN APARTMENTS

FIRE HYDRANT, TYP.

ROOT BARRIER TYP.

PROPOSED LIFT STATION

15' LANDSCAPE BUFFER

BUILDING G

BUILDING F

BUILDING E

BUILDING D

OPEN SPACE 6881 SF

LIMITS OF VILLA DUPLEX CONSTRUCTION (CONSTRUCTED)

COVERED PATIO TYP.

12' U.E.

6' WALL

S.U.A. ACCESS GATE

PLANTING IN SHADED AREA HAS BEEN INSPECTED AND INSTALLED. A CERTIFICATE OF OCCUPANCY HAS BEEN ISSUED BASED ON THIS WORK

NOTE: ALL LANDSCAPE AREAS, EXCLUDING NATIVE PRESERVE AREAS, SHALL BE PROVIDED WITH 100% AUTOMATIC IRRIGATION.

WGI
2035 Vista Parkway, West Palm Beach, FL 33411
Phone No. 866.909.2220 www.wginc.com
Cert No. 6091 - LB No. 7055

NOT AUTHORIZED FOR CONSTRUCTION PRIOR TO FORMAL TOWN APPROVAL

REVISIONS

NO.	DATE	DESCRIPTION	BY
1	2/26/2025	SITE PLAN AMENDMENT	KV
2	7/31/2025	SITE PLAN AMENDMENT	CKW
3	10/6/2025	SITE PLAN AMENDMENT	CKW

CAD 2920.04_LP REVISION.DWG	
JOB NO.	2920.04
DRAWN BY	CKW
CHECK BY	YM
DATE	10/06/2025

LANDSCAPE ARCHITECT OF RECORD
COREY A. KISSELL WONG, PLA
FL # LA6667017

REGISTERED LANDSCAPE ARCHITECT COREY A. KISSELL WONG LA 6667017 STATE OF FLORIDA

Corey A. Kissell Wong

THE WATERFORD
601 UNIVERSE BOULEVARD
JUNO BEACH, FL
LANDSCAPE PLAN

SHEET:
LP-1.03

Corey Kissell Wong P:\2800\2920.04 Waterford Campus Review\LA\Drawings\Landscape\2920.04_LP revision.dwg — Plotted: 10/6/2025 2:43:53 PM Saved: 10/6/2025 2:42:39 PM

MATCHLINE LP-1.01
MATCHLINE LP-1.04
MATCHLINE LD-1.02
MATCHLINE LD-1.04
MATCHLINE LP-1.03
MATCHLINE LP-1.04

LAKE

GARDEN APARTMENTS

BUILDING C EX. WELLNESS BLGD.

BUILDING I INDEPENDENT LIVING

BUILDING H INDEPENDENT LIVING

GARAGE ENTRY

10' FPL EASEMENT

10' SOUTHERN BELL EASEMENT

6' WALL

PROPERTY LINE

HEDGE TO BE MAINTAINED AT A MIN. 8' HT.

STOP COCOPULM HEDGE AT EXISTING RETAINING WALL

5' M.S.S.W.

5' S.W.

1 LP-1.05
2 LP-1.05
3 LP-1.05

CS 2
CO 7
CS 7
CLG2 134
CI 41

N

0 10 20 40
SCALE: 1" = 20'

Know what's BELOW. CALL before you dig
Call 811 two business days before digging

US HWY1
(STATE ROAD 5)

LEGEND

- # TREE/ PALM TO PRESERVE
- # RELOCATED TREE/ PALM
- ROOT BARRIER

SHEET KEY MAP

LP-1.01 LP-1.02 LP-1.03 LP-1.04

NOTE: ALL LANDSCAPE AREAS, EXCLUDING NATIVE PRESERVE AREAS, SHALL BE PROVIDED WITH 100% AUTOMATIC IRRIGATION.

WGL
2035 Vista Parkway, West Palm Beach, FL 33411
Phone No. 866.909.2220 www.wginc.com
Cert No. 6091 - LB No. 7055

NOT AUTHORIZED FOR CONSTRUCTION PRIOR TO FORMAL TOWN APPROVAL

REVISIONS

NO.	DATE	DESCRIPTION	BY
1	2/26/2025	SITE PLAN AMENDMENT	KV
2	7/31/2025	SITE PLAN AMENDMENT	CKW
3	10/6/2025	SITE PLAN AMENDMENT	CKW

CAD: 2920.04_LP PREVISION.DWG	
JOB NO.	2920.04
DRAWN BY	CKW
CHECK BY	YM
DATE	10/06/2025


LANDSCAPE ARCHITECT OF RECORD
COREY A. KISSELL WONG, PLA
FL. # LA6667017

REGISTERED LANDSCAPE ARCHITECT
COREY A. KISSELL WONG
LA 6667017
STATE OF FLORIDA

THE WATERFORD
601 UNIVERSE BOULEVARD
JUNO BEACH, FL
LANDSCAPE PLAN


SHEET:
LP-1.04

Corey Kissell Wong P:\2920\2920.04 Waterford Campus Review\LA\Drawings\Landscape\2920.04_LP revision.dwg — Plotted: 10/6/2025 2:44:24 PM Saved: 10/6/2025 2:05:36 PM

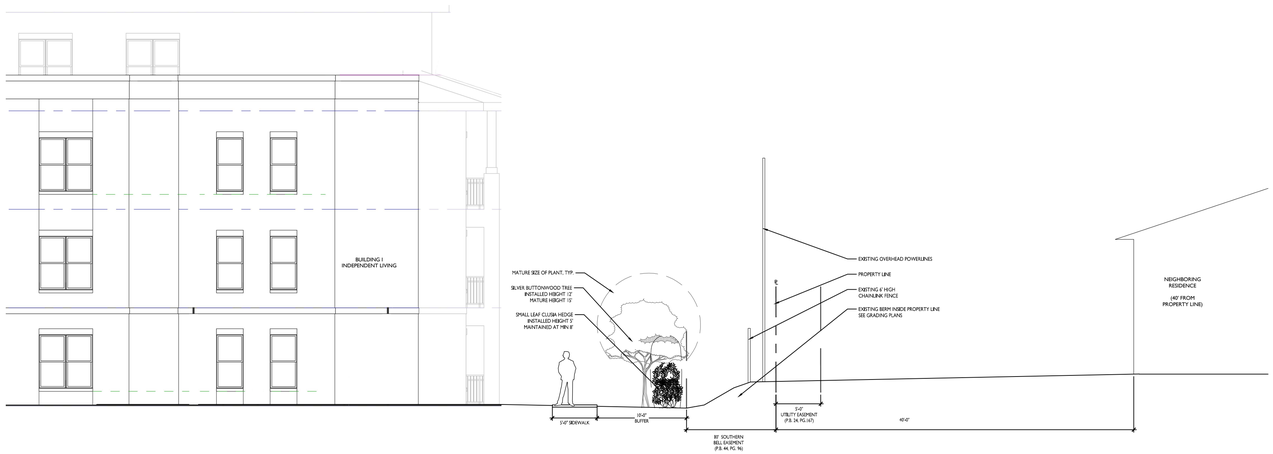


1 SOUTH BUFFER SECTION 1

1/8" = 1'

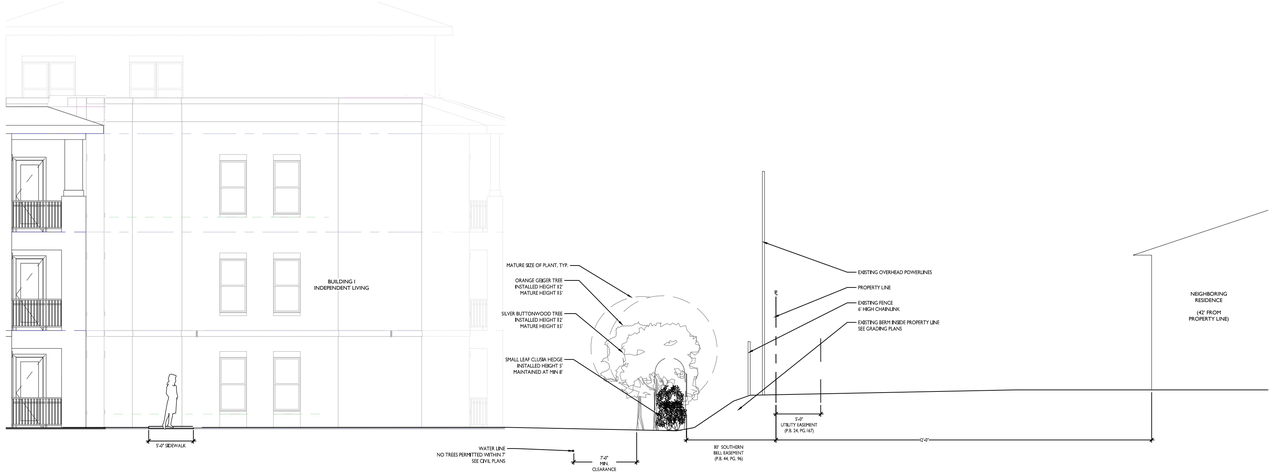

2 SOUTH BUFFER SECTION 2


1/8" = 1'

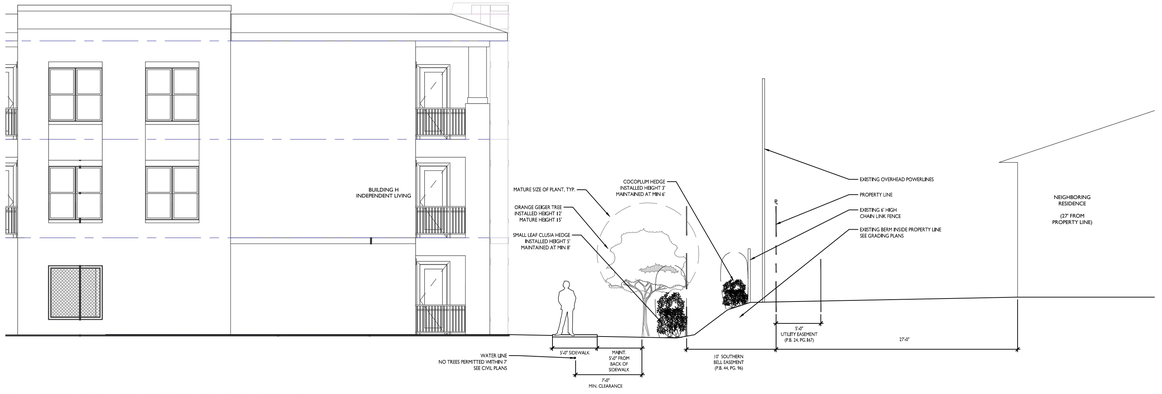


3 SOUTH BUFFER SECTION 3

1/8" = 1'

NOTE: ALL LANDSCAPE AREAS, EXCLUDING NATIVE PRESERVE AREAS, SHALL BE PROVIDED WITH 100% AUTOMATIC IRRIGATION.

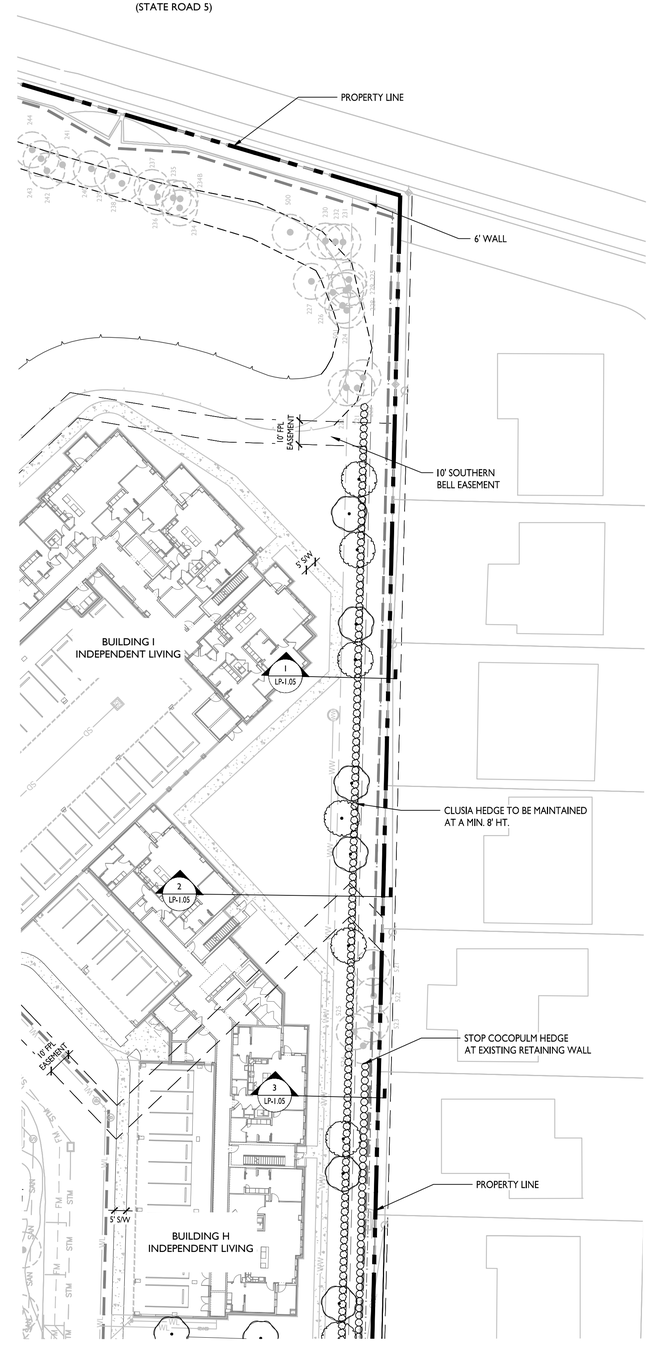

3 SOUTH BUFFER ENLARGEMENT



Know what's BELOW. CALL before you dig

Call 811 two business days before digging

WGI
2035 Vista Parkway, West Palm Beach, FL 33411
Phone No. 866.909.2220 www.wginc.com
Cert No. 6091 - LB No. 7055

NOT AUTHORIZED FOR CONSTRUCTION PRIOR TO FORMAL TOWN APPROVAL

REVISIONS

NO.	DATE	DESCRIPTION	BY
1	2/20/2025	SITE PLAN AMENDMENT	EV
2	7/31/2025	**SITE PLAN AMENDMENT**	CKW
3	10/6/2025	SITE PLAN AMENDMENT	CKW

CAD: 2920.04_LP PREVISION.DWG	
JOB NO.	2920.04
DRAWN BY	CKW
CHECK BY	YM
DATE	10/06/2025

LANDSCAPE ARCHITECT OF RECORD
COREY A. KISSELL WONG, PLA
FL # LA6667017

REGISTERED LANDSCAPE ARCHITECT
COREY A. KISSELL WONG
LA 6667017
STATE OF FLORIDA

THE WATERFORD
601 UNIVERSE BOULEVARD
JUNO BEACH, FL
LANDSCAPE SECTIONS

SHEET:
LP-1.05

Sid Stephens P:\2900\2920.04 Waterford Campus Redev\LA\Drawings\Landscape\2920.04_LP revision.dwg — Plotted: 10/7/2025 9:36:54 AM Saved: 10/6/2025 7:04:18 PM

LANDSCAPE REQUIREMENTS

JUNO BEACH, FLORIDA

CHAPTER 34 - ZONING	PROVIDED
ARTICLE III. - DISTRICT REGULATIONS DIVISION 15. COMMERCIAL OFFICE (CO) ZONING DISTRICT	
SEC. 34-658. - BUILDING SITE AREA REGULATIONS	
MINIMUM LANDSCAPED OPEN SPACE	
10% OF TOTAL LOT AREA	TOTAL LOT AREA: 695,719 SF MIN 69,572 SF (10%) OF LANDSCAPED OPEN SPACE HAS BEEN PROVIDED
ARTICLE IV. - SUPPLEMENTAL REGULATIONS DIVISION 6. SIGNS	
SEC. 34-1053. - GENERAL REGULATIONS	
LANDSCAPING	
LANDSCAPE AREA AT THE BASE OF A FREE STANDING SIGN SHALL EXTEND MIN 3' IN ALL DIRECTIONS FROM SIGN FACE AND ENDS. HEIGHT OF THE LANDSCAPING SHALL BE WITHIN MIN ONE-FOOT DISTANCE OF THE LOWER EDGE OF THE SIGN AREA.	LANDSCAPE AREA PROVIDED AT THE BASE OF THE ENTRANCE SIGN EXTENDS BEYOND 3' ON ALL SIDES HEIGHT REQUIREMENTS HAVE BEEN MET
ARTICLE IV. - SUPPLEMENTAL REGULATIONS DIVISION 7. LANDSCAPING REQUIREMENTS	
SEC. 34-1084. - LANDSCAPE REQUIREMENTS	
ALL PLANT MATERIAL OF EACH TYPE (TREES, SHRUBS, GROUND COVER) SHALL BE MIN 50% NATIVE MAX 50% OF ALL REQUIRED TREES MAY BE PALMS	PERCENT NATIVE TREES: 90% NATIVE PALMS: 54% NATIVE SHRUBS: 82% NATIVE GROUNDCOVERS: 75% NATIVE
SEC. 34-1087. - PARKING AREA LANDSCAPING	
ADJACENT TO STREET	
MIN 5' WIDE LANDSCAPE STRIP BETWEEN ABUTTING STREET AND OFF-STREET PARKING AREA OR OTHER VEHICULAR USE AREA SHALL BE PROVIDED LANDSCAPE STRIP SHALL INCLUDE: MIN ONE TREE PER 30 LINEAR FEET HEDGE OF MIN 24" HT (TO GROW 4' WITHIN ONE YEAR)	REQUIRED LANDSCAPING BETWEEN ABUTTING STREETS AND PARKING / VUA HAS BEEN PROVIDED (EXCEPT WHERE UTILITIES AND/OR EXISTING VEGETATION PRESENT)
ABUTTING PROPERTIES	
MIN 5' WIDE LANDSCAPE STRIP BETWEEN ABUTTING PROPERTY AND OFF-STREET PARKING AREA OR OTHER VEHICULAR USE AREA SHALL BE PROVIDED LANDSCAPE STRIP SHALL INCLUDE: MIN ONE TREE PER 30 LINEAR FEET HEDGE OF MIN 24" HT (TO GROW 4' WITHIN ONE YEAR)	REQUIRED LANDSCAPING BETWEEN ABUTTING PROPERTIES AND PARKING / VUA HAS BEEN PROVIDED (EXCEPT WHERE UTILITIES AND/OR EXISTING VEGETATION PRESENT)
INTERIOR PARKING AREAS	
MIN 20 SF OF LANDSCAPING PER PARKING SPACE SHALL BE PROVIDED WITHIN THE INTERIOR OF AN OFF-STREET PARKING AREA MIN ONE TREE PER PARKING ISLAND MIN ONE TREE PER 30 LINEAR FEET SHALL BE PLANTED WITHIN EACH DIVIDER MEDIAN. TREES MAY BE CLUSTERED WITH MAX SPACING OF 40'	MIN INTERIOR PARKING LANDSCAPE AREA AND MIN ONE TREE PER PARKING ISLAND HAVE BEEN PROVIDED (EXCEPT WHERE UTILITIES AND/OR EXISTING VEGETATION PRESENT)

BUILDINGS AND BUFFER PLANT SCHEDULE

SYMBOL	CODE	QTY	COMMON NAME	BOTANICAL NAME	NATIVE	REMARKS
TREES						
	CD	8	Pigeon Plum	Coccoloba diversifolia	YES	12` HT X 6` SPRD., 2.5" CAL
	CE4	5	Green Buttonwood	Conocarpus erectus	YES	12` HT. X 6` SPRD., 2.5" MIN. CAL.
	CS	10	Silver Buttonwood	Conocarpus erectus `Sericeus`	YES	12` HT. X 6` SPRD., 2.5" MIN. CAL.
	CO	7	Orange Geiger Tree	Cordia sebestena	YES	12` HT. X 6` SPRD., 2.5" MIN. CAL.
	DR	1	Royal Poinciana	Delonix regia	NO	18` HT. MIN. X 10` SPRD. MIN., 6" DBH MIN., SPECIMEN
MITIGATION TREES						
	CC-M	8	Sea Grape	Coccoloba uvifera	YES	12' HT. X 6' SPRD., 2.5" MIN. CAL.
	PU-M	1	Screw Pine	Pandanus utilis	NO	MULTI-TRUNK, 6" DBH MIN. LA TO APPROVE SELECTION.
	QV-M	5	Southern Live Oak	Quercus virginiana	YES	12' HT. X 6' SPRD., 2.5" MIN. CAL.
MITIGATION PALM TREES						
	SP-M	3	Sabal Palm	Sabal palmetto	YES	12' OVERALL HT, 8' CT
PALM TREES						
	DC	2	Cabada Palm	Dypsis cabadae	NO	12'-14' OA. HT., MIN. 6 TRUNKS
	PDM	4	Medjool Date Palm	Phoenix dactylifera 'Medjool'	NO	18' CT, SHELF CUT
	SP	6	Sabal Palm	Sabal palmetto	YES	12' OVERALL HT, 8' CT
SHRUBS						
	ALO	72	Dwarf Elephant Ear	Alocasia odora `California`	NO	24" HT. X 24" SPRD.
	CI	121	Cocoplum	Chrysobalanus icaco	YES	36" HT. X 36" SPRD
	CI2	792	Cocoplum	Chrysobalanus icaco	YES	24" HT. X 24" SPRD. @ 24" O.C.
	CLG2	135	Small Leaf Clusia	Clusia guttifera	NO	60" HT. X 48" SPRD
	PR	6	Rojo Congo Philodendron	Philodendron x `Rojo Congo`	NO	24" HT. x 24" SPRD. @ 36" O.C.
	RH	5	Lady Palm	Rhapis excelsa	NO	36" HT. X 36" SPRD., FULL TO BASE
	SR3	21	Orange Bird of Paradise	Strelitzia reginae	NO	36" HT. X 36" SPRD.
	SPG	8	Eugenia	Syzygium paniculatum 'Globulus'	NO	TOPIARY, CONE SHAPE, 3' OA. HT., FULL TO BASE

ENTRANCE AREA PLANT SCHEDULE

SYMBOL	CODE	QTY	COMMON NAME	BOTANICAL NAME	NATIVE	REMARKS
TREES						
	CSB	8	Wishing Tree	Cassia bakeriana	NO	12' HT. X 5' SPRD., 2.5" CAL. MULTI-TRUNK
	PHR	2	Pygmy Date Palm Multi-Trunk	Phoenix roebelenii	NO	6' MIN. OA. HT., MIN 3 TRUNKS
	RR	7	Royal Palm	Roystonea regia	YES	14' MIN. HT., 8' CT.
SHRUBS						
	AWF	4	Firestorm Wilkes' Copperleaf	Acalypha wilkesiana 'Firestorm'	NO	36" HT. X 36" SPRD. @ 36" O.C.
	ASD	41	Asparagus Fern	Asparagus densiflorus	NO	18" HT. X 24" SPRD. @ 24" O.C.
	CFR	36	Red Sister Ti Plant	Cordyline fruticosa 'Red Sister'	NO	48" HT. X 36" SPRD. @ 48" O.C.
	CSW	5	Red Button Ginger	Costus woodsonii	NO	48" HT. X 48" SPRD. @ 48" O.C.
	DIE	22	Fortnight Lily	Dietes bicolor	NO	36" HT. X 48" SPRD @ 48" O.C.
	FIB	11	Weeping Fig	Ficus benjamina	NO	60" HT. X 48" SPRD @ 48" O.C.
	FIL	3	Fiddle Leaf Fig	Ficus lyrata	NO	60" HT. X 48" SPRD. @ 48" O.C.
	HLP	13	Parrot Heliconia	Heliconia psittacorum	NO	48" HT. X 48" SPRD. @ 48" O.C.
	HIS	5	Chinese Hibiscus	Hibiscus rosa-sinensis	NO	72" HT. X 72" SPRD. TRIMMED TO STANDARD
	HYL	131	Spider Lily	Hymenocallis littoralis	YES	36" HT. X 24" SPRD. @ 24" O.C.
	LIG	251	Giant Liriope	Liriope gigantea	NO	36" HT. X 36" SPRD. @ 36" O.C.
	LIM	130	Densiflora Lilyturf	Liriope muscari 'Densiflora'	NO	12" HT. X 12" SPRD. @ 12" O.C.
	NEB	119	Macho Fern	Nephrolepis biserrata	YES	36" HT. X 36" SPRD. @ 36" O.C.
	PHX	109	Xanadu Philodendron	Philodendron x 'Xanadu'	NO	36" HT. X 36" SPRD. @ 36" O.C.
	SCH	16	Emerald Green Schefflera	Schefflera arboricola 'Emerald Green'	NO	60" HT. X 60" SPRD. @ 60" O.C.
SHRUB AREAS						
	AGP	167	Peter Pan African Lily	Agapanthus africanus `Peter Pan`	NO	24" HT. X 18" SPRD. @ 18" O.C.
	ACC	205	Golden Trumpet	Allamanda cathartica 'compacta'	NO	24" HT. X 18" SPRD. @ 18" O.C.
	BEG	38	Red Explorer Viking Begonia	Begonia x `Explorer Viking`	NO	12" HT. X 18" SPRD. @ 18" O.C.
	OPH	42	Variegated Dwarf Mondo Grass	Ophiopogon japonicus `Nana Variegata`	NO	10" HT. X 12" SPRD. @ 12" O.C.
GROUND COVERS						
	TRA	692	Asiatic Jasmine	Trachelospermum asiaticum	NO	6" HT. X 12" SPRD. @ 12" O.C.

BUILDINGS AND BUFFER PLANT SCHEDULE CON'T.

SYMBOL	CODE	QTY	COMMON NAME	BOTANICAL NAME	NATIVE	REMARKS
SHRUB AREAS						
	AZ2	25	Shell Ginger	Alpinia zerumbet	NO	36" HT X 36" SPRD. @ 36" O.C.
	BX	59	Vera Deep Purple Bougainvillea	Bougainvillea spectabilis 'Rpboug 327'	NO	10" HT. X 30" SPRD. @ 30" O.C.
	CI3	471	Cocoplum	Chrysobalanus icaco	YES	24" HT. X 24" SPRD. @ 24" O.C.
	CI4	294	Cocoplum	Chrysobalanus icaco	YES	36" HT. X 24" SPRD. @ 24" O.C.
	CH	325	Horizontal Cocoplum	Chrysobalanus icaco `Horizontalis`	YES	12" HT. X 12" SPRD. @ 18" O.C.
	MC2	64	Pink Muhly	Muhlenbergia capillaris	YES	24" HT. X 24" SPRD. @ 36" O.C.
	MF3	273	Simpson's Stopper	Myrcianthes fragrans	YES	36" HT. X 24" SPRD. @ 24" O.C.
	NE	20	Boston Fern	Nephrolepis exaltata	YES	18" HT. X 18" SPRD. @ 24" O.C.
	PB2	234	Burle Marx Philodendron	Philodendron x `Burle Marx`	NO	16" HT. X 16" SPRD. @ 16" O.C.
	PM2	82	Yew Pine	Podocarpus macrophyllus	NO	48" HT. X 24" SPRD. @ 24" O.C
	FAK	48	Fakahatchee Grass	Tripsacum dactyloides	YES	24" HT. X 24" SPRD. @ 24" O.C.
GROUND COVERS						
	IV2	25	Yaupon Holly	Ilex vomitoria	YES	12" HT. X 12" SPRD. @18" O.C.
	MS	2,104	Sunshine Mimosa	Mimosa strigillosa	YES	6" HT. X 6" SPRD. @ 8" O.C.
	NE3	20	Boston Fern	Nephrolepis exaltata	YES	18" HT. X 18" SPRD. @ 24" O.C.
	PEP	182	Baby Rubber Plant	Peperomia obtusifolia	YES	12" HT. X 12" SPRD. @ 12" O.C.

WGI
2035 Vista Parkway, West Palm Beach, FL 33411
Phone No. 866.909.2220 www.wginc.com
Cert No. 6091 - LB No. 7055

NOT AUTHORIZED FOR CONSTRUCTION PRIOR TO FORMAL TOWN APPROVAL

NO.	DATE	DESCRIPTION	BY
1	2/26/2025	SITE PLAN AMENDMENT	RV
2	7/31/2025	SITE PLAN AMENDMENT	CKW
3	10/6/2025	SITE PLAN AMENDMENT	CKW

CAD 2920.04_LP REVISION.DWG
JOB NO. 2920.04
DRAWN BY CKW
CHECK BY YM
DATE 10/06/2025

LANDSCAPE ARCHITECT OF RECORD
COREY A. KISSELL WONG, PLA
FL # LA6667017

REGISTERED LANDSCAPE ARCHITECT
COREY A. KISSELL WONG
LA 6667017
STATE OF FLORIDA

THE WATERFORD
601 UNIVERSE BOULEVARD
JUNO BEACH, FL
CODE CHART & OVERALL PLAN SCHEDULE


SHEET:
LP-2.01

Corey Kissell Wong P:\2920\2920.04 Waterford Campus Review\LA\Drawings\Landscape\2920.04_LP revision.dwg — Plotted: 10/6/2025 2:45:48 PM Saved: 10/6/2025 2:02:36 PM

SMALL PALM STAKING PLAN

NTS.


NOTE:
1. APPLICABLE TO ALL PALMS WITH CALIPER SIZE OF LESS THAN SIX (6) INCHES.
2. ALL TREE SUPPORTS MATERIALS ARE TO BE REMOVED FROM EACH TREE ONCE IT IS ESTABLISHED. TYPICALLY SIX MONTHS FOR SHADE TREES OR ONE YEAR FOR PALMS.

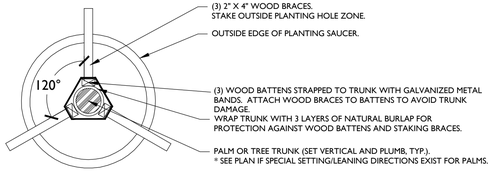

LARGE PALM OR TREE STAKING PLAN


NTS.

NOTE:
1. APPLICABLE TO ALL MULTI-TRUNK PALMS AND PALMS WITH CALIPER SIZE OF SIX (6) INCHES OR GREATER.
2. ALL TREE SUPPORTS MATERIALS ARE TO BE REMOVED FROM EACH TREE ONCE IT IS ESTABLISHED. TYPICALLY SIX MONTHS FOR SHADE TREES OR ONE YEAR FOR PALMS.

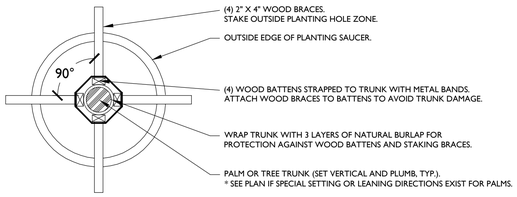

PALM PLANTING DETAIL


NTS.

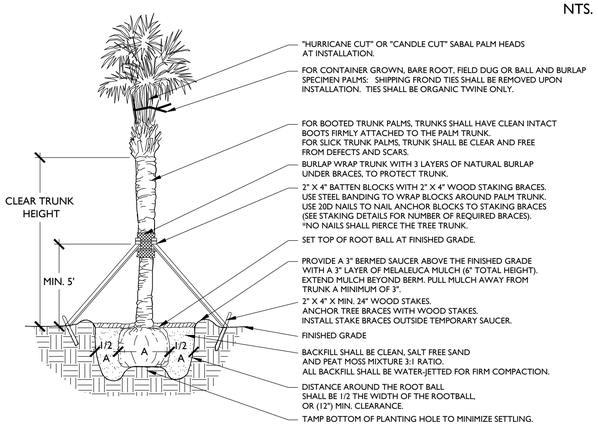

TREE PLANTING DETAIL

NOTE:
1. ALL TREE SUPPORT MATERIALS ARE TO BE REMOVED FROM EACH TREE ONCE IT IS ESTABLISHED. TYPICALLY SIX MONTHS TO ONE YEAR AFTER PLANTING FOR SHADE TREES.


NTS.

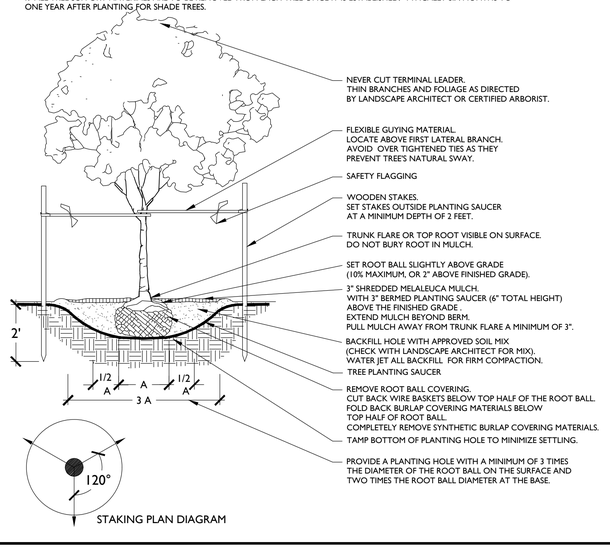

STAKING PLAN DIAGRAM

GROUNDCOVER DETAIL

NTS.

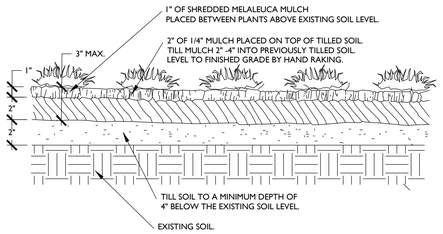


PLANT SPACING DETAIL

NTS.


SPACING "D"	ROW "A"
6" O.C.	5.2"
8" O.C.	6.93"
10" O.C.	8.66"
12" O.C.	10.4"
18" O.C.	15.6"
24" O.C.	20.8"
30" O.C.	26.0"
36" O.C.	31.2"
48" O.C.	41.6"

PLANT SPACING CHART



SHRUB PLANTING DETAIL

NTS.

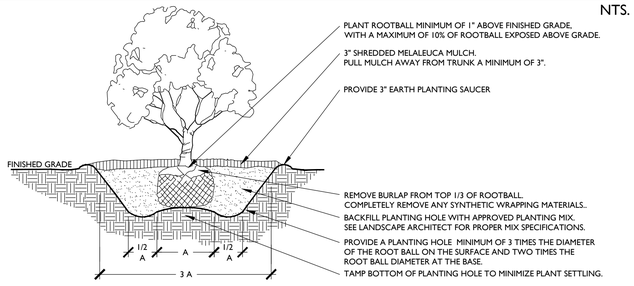


LANDSCAPE NOTES:

1. STRUCTURAL ELEMENTS AND HARDSCAPE FEATURES INDICATED ON LANDSCAPE PLANS ARE FOR INFORMATIONAL PURPOSES ONLY. LANDSCAPE PLANS ARE TO BE UTILIZED FOR LOCATION OF LIVING PLANT MATERIAL ONLY. LANDSCAPE PLANS SHOULD NOT BE UTILIZED FOR STAKING AND LAYOUT OR LOCATION OF ANY STRUCTURAL SITE FEATURES INCLUDING BUT NOT LIMITED TO: BUILDINGS, SIGNAGE, PATHWAYS, EASEMENTS, BERMS, WALL, FENCES, UTILITIES OR ROADWAYS.
2. CONTRACTOR SHALL ACQUIRE ALL APPLICABLE FEDERAL, STATE, LOCAL, JURISDICTIONAL OR UTILITY COMPANY PERMITS REQUIRED PRIOR TO REMOVAL, RELOCATION, AND/OR INSTALLATION OF LANDSCAPE MATERIALS INDICATED WITHIN PLAN DOCUMENTS. THE CONTRACTOR SHALL HAVE PERMITS "IN HAND" PRIOR TO STARTING WORK. LANDSCAPE ARCHITECT SHALL BEAR NO RESPONSIBILITY FOR WORK PERFORMED WITHOUT PERMITTED DRAWINGS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL CHANGES TO THE WORK, AT NO ADDITIONAL COST TO THE OWNER, AS A RESULT OF UNAUTHORIZED WORK PRIOR TO RECEIPT OF PERMIT.
3. TREES SHOWN ON THIS PLAN ARE FOR GRAPHIC REPRESENTATION ONLY. TREE SPACING IS BASED ON DESIGN REQUIREMENTS AND THE TREES SHOWN ON THESE PLANS ATTEMPT TO ACCOMPLISH THAT SPACING WHILE MAINTAINING THE REQUIRED SETBACKS FROM UTILITIES. IN THE EVENT OF A CONFLICT, AFFECTED PLANT MATERIAL SHALL BE FIELD ADJUSTED WITH THE APPROVAL OF THE LANDSCAPE ARCHITECT TO AVOID CONFLICTS WITH THE WITH EXISTING AND PROPOSED UTILITIES, LIGHT POLES, DRAINAGE STRUCTURES OR LINES, LAKE MAINTENANCE EASEMENTS OR OTHER AFFECTED SITE FEATURES.
4. ANY PLANTING WITHIN THE SIGHT TRIANGLES SHALL PROVIDE UNOBSTRUCTED VIEWS AT A LEVEL BETWEEN 30" AND 8' ABOVE THE PAVEMENT.
5. ALL UTILITY BOXES/ STRUCTURES TO BE SCREENED ON 3 SIDES W/ APPROVED PLANTING MATERIAL.
6. IRRIGATION IS REQUIRED PROVIDING 100% COVERAGE WITH A MAXIMUM OF 50% OVERLAP, AN AUTOMATIC RAIN SENSOR MUST BE INCLUDED.
7. ALL PLANT MATERIAL TO BE INSTALLED SHALL CONFORM TO FLORIDA POWER AND LIGHT'S (FPL'S) RIGHT TREE RIGHT PLACE GUIDELINES.
8. IN CASE OF DISCREPANCIES PLANS TAKE PRECEDENCE OVER PLANT LIST.
9. LANDSCAPE CONTRACTOR RESPONSIBLE FOR VERIFICATION OF ALL QUANTITIES PRIOR TO BIDDING.
10. REMOVAL OF EXISTING VEGETATION IS RESPONSIBILITY OF LANDSCAPE CONTRACTOR.
11. RELOCATION OF EXISTING VEGETATION IS RESPONSIBILITY OF LANDSCAPE CONTRACTOR. REFER TO SPECIFICATIONS FOR RELOCATION INSTRUCTIONS.
12. ALL PLANT MATERIAL TO BE FLORIDA GRADE #1 AT TIME OF INSTALLATION UNLESS OTHERWISE NOTED.

TYPICAL PLANTING DIAGRAM


NTS.

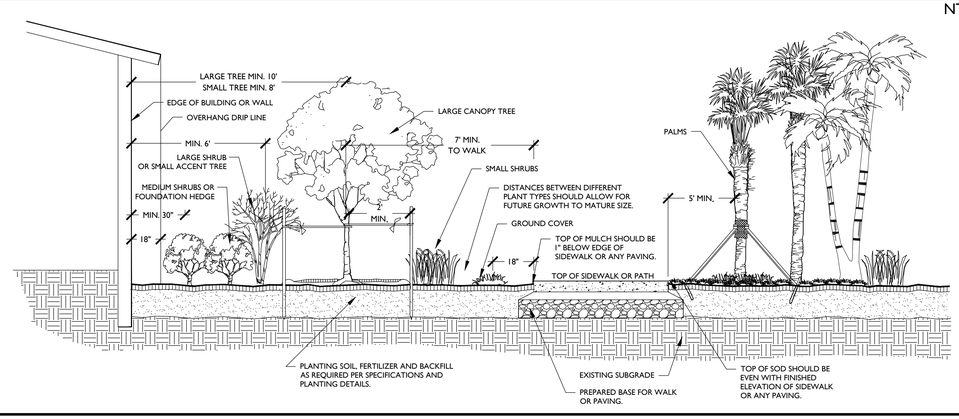

TREE PROTECTION DETAIL


NOTE: 1. THIS DETAIL APPLIES TO ALL TREES THAT WILL BE PRESERVED IN PLACE OR BE RELOCATED.


NTS.



SHRUB AND GROUNDCOVER PLANTING DETAIL

NTS.

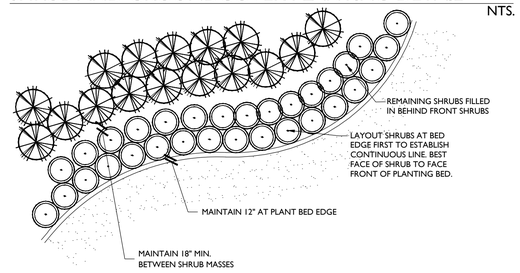

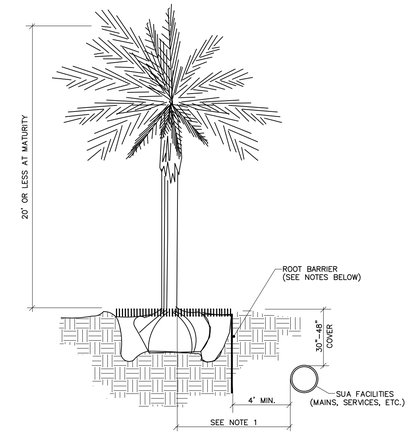


NOTES: (PLEASE REFER TO WRITTEN SPECIFICATIONS FOR ADDITIONAL REQUIREMENTS)

1. THIS DISTANCE SHALL BE 7' MINIMUM WITH ROOT BARRIER AND 10' MINIMUM IF NO ROOT BARRIER IS USED.
2. ALL ROOT BARRIERS SHALL BE 4'MINIMUM FROM ALL SEACOAST FACILITIES.
3. THE INSTALLATION OF ROOT BARRIERS SHALL BE COORDINATED WITH SEACOAST AND INSPECTED BY SEACOAST PRIOR TO BACKFILLING. ALL ROOT BARRIERS SHALL EXTEND UP TO FINISHED GRADE.
4. ROOT BARRIERS SHALL BE MINIMUM 36" DEEP. APPROVED PRODUCTS INCLUDE "DEEP ROOT" AND "ROOT SOLUTIONS".
5. ALL ROOT BARRIERS SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURERS WRITTEN INSTRUCTIONS.

Typical Shrub, Small Tree or Palm Tree with Root Barrier

AUGUST 26, 2020 (Rev C-16)

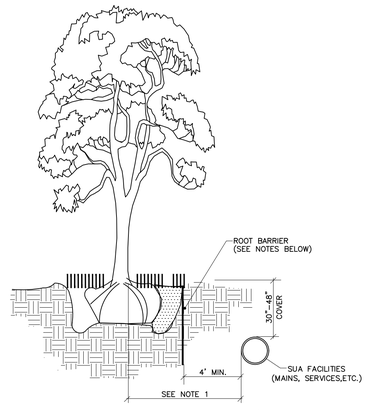

NOTES: (PLEASE REFER TO WRITTEN SPECIFICATIONS FOR ADDITIONAL REQUIREMENTS)

1. THIS DISTANCE SHALL BE 10' MINIMUM WITH ROOT BARRIER AND 15' MINIMUM IF NO ROOT BARRIER IS USED.
2. ALL ROOT BARRIERS SHALL BE 4' MINIMUM FROM ALL SEACOAST FACILITIES.
3. THE INSTALLATION OF ROOT BARRIERS SHALL BE COORDINATED WITH SEACOAST AND INSPECTED BY SEACOAST PRIOR TO BACKFILLING. ALL ROOT BARRIERS SHALL EXTEND UP TO FINISHED GRADE.
4. ROOT BARRIERS SHALL BE MINIMUM 36" DEEP. APPROVED PRODUCTS INCLUDE "DEEP ROOT" AND "ROOT SOLUTIONS".
5. ALL ROOT BARRIERS SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURERS WRITTEN INSTRUCTIONS.
6. LARGE PALM TREES INCLUDE ROYAL, WASHINGTONIAN, BISMARK AND SIMILAR SIZED SPECIES.

Typical Canopy Tree, Large or Exotic Palm Tree with Root Barrier

AUGUST 26, 2020 (Rev C-16)

WGI
2035 Vista Parkway, West Palm Beach, FL 33411
Phone No. 866.909.2220 www.wginc.com
Cert No. 6091 - LB No. 7055

NOT AUTHORIZED FOR CONSTRUCTION PRIOR TO FORMAL TOWN APPROVAL

NO.	DATE	DESCRIPTION	BY
1	2/26/2025	SITE PLAN AMENDMENT	KV
2	7/31/2025	SITE PLAN AMENDMENT	CKW
3	10/6/2025	SITE PLAN AMENDMENT	CKW

REVISIONS

CAD: 2920.04_LP REVISIONS.DWG
JOB NO.: 2920.04
DRAWN BY: CKW
CHECK BY: YM
DATE: 10/06/2025

LANDSCAPE ARCHITECT OF RECORD
COREY A. KISSELL WONG, PLA
FL # LA6667017

REGISTERED LANDSCAPE ARCHITECT
COREY A. KISSELL
LA 6667017
STATE OF FLORIDA

THE WATERFORD
601 UNIVERSE BOULEVARD
JUNO BEACH, FL
LANDSCAPE DETAILS

SHEET:
LP-3.01

Corey Kissell Wong P:\2920\2920.04 Waterford Campus Redev\LA\Drawings\Landscape\2920.04_LP revision.dwg — Plotted, 10/6/2025 2:45:49 PM Saved: 10/6/2025 2:02:36 PM

LANDSCAPE NOTES

PART I. GENERAL

I. DESCRIPTION OF WORK
A. PROVIDE ALL EXTERIOR PLANTING AS SHOWN ON THE DRAWINGS OR INFERABLE THEREFROM AND/OR AS SPECIFIED IN ACCORDANCE WITH THE REQUIREMENTS OF THE CONTRACT DOCUMENTS. LANDSCAPE PLANS PROVIDED INDICATE THE PROPOSED LOCATION OF LIVING PLANT MATERIAL ONLY. STRUCTURAL ELEMENTS AND HARDSCAPE FEATURES INDICATED ON THE LANDSCAPE PLANS ARE FOR INFORMATION PURPOSES ONLY. LANDSCAPE PLANS ARE NOT TO BE UTILIZED FOR STAKING AND LAYOUT OR LOCATION OF ANY STRUCTURAL SITE FEATURES INCLUDING BUT NOT LIMITED TO, BUILDINGS, SIGNAGE, PATHWAYS, EASEMENTS, UTILITIES OR ROADWAYS.
B. THESE SPECIFICATIONS INCLUDE STANDARDS NECESSARY FOR AND INCIDENTAL TO THE EXECUTION AND COMPLETION OF PLANTING AS INDICATED ON THE PREPARED DRAWINGS AND SPECIFIED HEREIN.
C. ALL APPLICABLE FEDERAL, STATE AND LOCAL PERMITS SHALL BE ATTAINED PRIOR TO THE REMOVAL, RELOCATION, OR INSTALLATION OF PLANT MATERIALS INDICATED WITHIN THE PLAN DOCUMENTS.
D. PROTECTION OF EXISTING FEATURES, DURING CONSTRUCTION, PROTECT ALL EXISTING TREES, SHRUBS, AND OTHER SPECIFIED VEGETATION, SITE FEATURES AND IMPROVEMENTS, STRUCTURES, AND UTILITIES SPECIFIED HEREIN AND/OR ON SUBMITTED DRAWINGS. REMOVAL OR DESTRUCTION OF EXISTING PLANTINGS IS PROHIBITED UNLESS SPECIFICALLY AUTHORIZED BY THE OWNER, AND WITH PERMIT AS REQUIRED BY ASSOCIATED FEDERAL, STATE AND LOCAL GOVERNMENT AGENCIES.

II. APPLICABLE STANDARDS
A. AMERICAN NATIONAL STANDARDS FOR TREE CARE OPERATIONS, ANSI A300. AMERICAN NATIONAL STANDARDS INSTITUTE, 11 WEST 42ND STREET, NEW YORK, N.Y. 10036.
B. AMERICAN STANDARD FOR NURSERY STOCK, ANSI Z60.1. AMERICAN NURSERY AND LANDSCAPE ASSOCIATION, 1250 EYE STREET, NW, SUITE 500, WASHINGTON, D.C. 20005.
C. HORTUS THIRD, THE STAFF OF THE L.H. BAILEY HORTORIUM. 1976. MACMILLAN PUBLISHING CO., NEW YORK.
D. FLORIDA DEPARTMENT OF AGRICULTURE "GRADES AND STANDARDS FOR NURSERY PLANTS", MOST RECENT ADDITION.
E. NATIONAL ARBORIST ASSOCIATION- PRUNING STANDARDS FOR SHADE TREES
F. ALL STANDARDS SHALL INCLUDE THE LATEST ADDITIONS AND AMENDMENTS AS OF THE DATE OF ADVERTISEMENT FOR BIDS

III. QUALIFICATIONS
A. LANDSCAPE PLANTING AND RELATED WORK SHALL BE PERFORMED BY A FIRM WITH A MINIMUM OF FIVE YEARS EXPERIENCE SPECIALIZING IN THIS TYPE OF WORK. ALL CONTRACTORS AND THEIR SUB-CONTRACTORS WHO WILL BE PERFORMING ANY LANDSCAPE WORK INCLUDED IN THIS SECTION OF THE SPECIFICATION SHALL BE APPROVED BY THE LANDSCAPE ARCHITECT.
B. LANDSCAPE CONTRACTOR SHALL BE LICENSED AND SHALL CARRY ANY NECESSARY INSURANCE AND SHALL PROTECT THE LANDSCAPE ARCHITECT AND OWNER AGAINST ALL LIABILITIES, CLAIMS OR DEMANDS FOR INJURIES OR DAMAGE TO ANY PERSON OR PROPERTY GROWING OUT OF THE PERFORMANCE OF THE WORK UNDER THIS CONTRACT. ALL WORKERS SHALL BE COVERED BY WORKMAN'S COMPENSATION INSURANCE.

IV. REQUIREMENTS OF REGULATORY AGENCIES
A. CERTIFICATES OF INSPECTION SHALL ACCOMPANY THE INVOICE FOR EACH SHIPMENT OF PLANTS AS MAY BE REQUIRED BY LAW FOR TRANSPORTATION. FILE CERTIFICATES WITH THE LANDSCAPE ARCHITECT PRIOR TO ACCEPTANCE OF THE MATERIAL. INSPECTION BY FEDERAL OR STATE AUTHORITIES AT PLACE OF GROWTH DOES NOT PRECLUDE REJECTION OF THE PLANTS AT THE SITE.

V. SUBMITTALS
A. MANUFACTURER'S DATA: SUBMIT COPIES OF THE MANUFACTURER'S AND/OR SOURCE DATA FOR ALL MATERIALS SPECIFIED, INCLUDING SOILS, SOIL AMENDMENTS AND FERTILIZER MATERIALS. COMPLY WITH REGULATIONS APPLICABLE TO LANDSCAPE MATERIALS.
B. SAMPLES: SUBMIT SAMPLES OF ALL TOPSOIL, SOIL MIXES, MULCHES, AND ORGANIC MATERIALS. SAMPLES SHALL WEIGH 1 KG (2 LB) AND BE PACKAGED IN PLASTIC BAGS. SAMPLES SHALL BE TYPICAL OF THE LOT OF MATERIAL TO BE DELIVERED TO THE SITE AND PROVIDE AN ACCURATE INDICATION OF COLOR, TEXTURE, AND ORGANIC MAKEUP OF THE MATERIAL.
C. NURSERY SOURCES: SUBMIT A LIST OF ALL NURSERIES THAT WILL SUPPLY PLANTS, ALONG WITH A LIST OF THE PLANTS THEY WILL PROVIDE AND THE LOCATION OF THE NURSERY.
D. SOIL TEST: SUBMIT SOIL TEST ANALYSIS REPORT FOR EACH SAMPLE OF TOPSOIL AND PLANTING MIX FROM A SOIL TESTING LABORATORY APPROVED BY THE LANDSCAPE ARCHITECT.
1. PROVIDE A PARTICLE SIZE ANALYSIS, INCLUDING THE FOLLOWING GRADIENT OF MINERAL CONTENT:

USDA DESIGNATION	SIZE IN MM
GRAVEL	+2 MM
VERY COURSE SAND	1-2 MM
COARSE SAND	0.5-1 MM
MEDIUM SAND	0.25-0.5 MM
FINE SAND	0.1-0.25 MM
VERY FINE SAND	0.05-0.1 MM
SILT	0.002-0.05 MM
CLAY	SMALLER THAN 0.002

2. PROVIDE A CHEMICAL ANALYSIS, INCLUDING THE FOLLOWING:
a. PH AND BUFFER PH
b. PERCENTAGE OF ORGANIC CONTENT BY OVEN-DRIED WEIGHT.
c. NUTRIENT LEVELS BY PARTS PER MILLION, INCLUDING PHOSPHORUS, POTASSIUM MAGNESIUM, MANGANESE, IRON, ZINC, AND CALCIUM. NUTRIENT TEST SHALL INCLUDE THE TESTING LABORATORY RECOMMENDATIONS FOR SUPPLEMENTAL ADDITIONS TO THE SOIL BASED ON THE REQUIREMENTS OF HORTICULTURAL PLANTS.
d. SOLUBLE SALT BY ELECTRICAL CONDUCTIVITY OF A 1:2, SOIL: WATER, SAMPLE MEASURED IN MILLIMHO PER CM.
e. CATION EXCHANGE CAPACITY (CEC).
E. MATERIAL TESTING: SUBMIT THE MANUFACTURERS PARTICLE SIZE ANALYSIS, AND THE PH ANALYSIS AND PROVIDE A DESCRIPTION AND SOURCE LOCATION FOR THE CONTENT MATERIAL OF ALL ORGANIC MATERIALS.
F. MAINTENANCE INSTRUCTIONS: PRIOR TO THE END OF MAINTENANCE PERIOD, LANDSCAPE CONTRACTOR SHALL FURNISH THREE COPIES OF WRITTEN MAINTENANCE INSTRUCTIONS TO THE LANDSCAPE ARCHITECT FOR TRANSMITTAL TO THE OWNER FOR MAINTENANCE AND CARE OF INSTALLED PLANTS THROUGH THEIR FULL GROWING SEASON.

VI. UTILITY VERIFICATION
A. THE CONTRACTOR SHALL CONTACT THE LOCAL UTILITY COMPANIES FOR VERIFICATION OF THE LOCATION OF ALL UNDERGROUND UTILITY LINES IN THE AREA OF THE WORK. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL DAMAGE RESULTING FROM NEGLECT OR FAILURE TO COMPLY WITH THIS REQUIREMENT.

PART 2. MATERIALS

I. PLANTS
A. PLANTS SHALL BE TRUE TO SPECIES AND VARIETY SPECIFIED AND NURSERY-GROWN IN ACCORDANCE WITH GOOD HORTICULTURAL PRACTICES UNDER CLIMATIC CONDITIONS SIMILAR TO THOSE IN THE LOCALITY OF THE PROJECT FOR AT LEAST TWO YEARS. THEY SHALL HAVE BEEN FRESHLY DUG.
1. ALL PLANT NAMES AND DESCRIPTIONS SHALL BE AS DEFINED IN HORTUS THIRD.
2. ALL PLANTS SHALL BE GROWN AND HARVESTED IN ACCORDANCE WITH THE AMERICAN STANDARD FOR NURSERY STOCK AND FLORIDA DEPARTMENT OF AGRICULTURE GRADES AND STANDARDS FOR NURSERY PLANTS.
3. UNLESS APPROVED BY THE LANDSCAPE ARCHITECT, PLANTS SHALL HAVE BEEN GROWN AT A LATITUDE NOT MORE THAN 325 KM (200 MILES) NORTH OR SOUTH OF THE LATITUDE OF THE PROJECT UNLESS THE PROVENANCE OF THE PLANT CAN BE DOCUMENTED TO BE COMPATIBLE WITH THE LATITUDE AND COLD HARDINESS ZONE OF THE PLANTING LOCATION.
B. UNLESS SPECIFICALLY NOTED, ALL PLANTS SHALL BE EXCEPTIONALLY HEAVY, SYMMETRICAL, AND SO TRAINED OR FAVORED IN DEVELOPMENT AND APPEARANCE AS TO BE UNQUESTIONABLY AND OUTSTANDINGLY SUPERIOR IN FORM, COMPACTNESS, AND SYMMETRY. THEY SHALL BE SOUND, HEALTHY, VIGOROUS, WELL BRANCHED, AND DENSELY FOLIATED WHEN IN LEAF; FREE OF DISEASE AND INSECTS, EGGS, OR LARVAE; AND SHALL HAVE HEALTHY, WELL-DEVELOPED ROOT SYSTEMS. THEY SHALL BE FREE FROM PHYSICAL DAMAGE OR OTHER CONDITIONS THAT WOULD PREVENT VIGOROUS GROWTH,
1. TREES WITH MULTIPLE LEADERS, UNLESS SPECIFIED, WILL BE REJECTED. TREES WITH A DAMAGED OR CROOKED LEADER, BARK ABRASIONS, SUNSCALD, DISFIGURING KNOTS, INSECT DAMAGE, OR CUTS OF LIMBS OVER 20 MM (3/4 IN.) IN DIAMETER THAT ARE NOT COMPLETELY CLOSED WILL BE REJECTED.
C. PLANTS SHALL CONFORM TO THE MEASUREMENTS SPECIFIED, EXCEPT THAT PLANTS LARGER THAN THOSE SPECIFIED MAY BE USED IF APPROVED BY THE LANDSCAPE ARCHITECT. USE OF LARGER PLANTS SHALL NOT INCREASE THE CONTRACT PRICE. IF LARGER PLANTS ARE APPROVED, THE ROOT BALL SHALL BE INCREASED IN PROPORTION TO THE SIZE OF THE PLANT.
1. CALIPER MEASUREMENTS SHALL BE TAKEN ON THE TRUNK 150 MM (6 IN.) ABOVE THE NATURAL GROUND LINE FOR TREES UP TO AND INCLUDING 100 MM (4 IN.) IN CALIPER, AND 300 MM (12 IN.) ABOVE THE NATURAL GROUND LINE FOR TREES OVER 100 MM (4 IN.) IN CALIPER. HEIGHT AND SPREAD DIMENSIONS SPECIFIED REFER TO THE MAIN BODY OF THE PLANT AND NOT FROM BRANCH TIP TO BRANCH TIP. PLANTS SHALL BE MEASURED WHEN BRANCHES ARE IN THEIR NORMAL POSITION. IF A RANGE OF SIZES IS GIVEN, NO PLANT SHALL BE LESS THAN THE MINIMUM SIZE, AND NO LESS THAN 50 PERCENT OF THE PLANTS SHALL BE AS LARGE AS THE MAXIMUM SIZE SPECIFIED. MEASUREMENTS SPECIFIED ARE MINIMUM SIZES ACCEPTABLE AFTER PRUNING, WHERE PRUNING IS REQUIRED. PLANTS THAT MEET MEASUREMENTS BUT DO NOT POSSESS A STANDARD RELATIONSHIP BETWEEN HEIGHT AND SPREAD, ACCORDING TO THE FLORIDA DEPARTMENT OF AGRICULTURE GRADES AND STANDARDS FOR NURSERY PLANTS, SHALL BE REJECTED.
D. SUBSTITUTIONS OF PLANT MATERIALS WILL NOT BE PERMITTED UNLESS AUTHORIZED IN WRITING BY THE LANDSCAPE ARCHITECT. IF PROOF IS SUBMITTED IN WRITING THAT A PLANT SPECIFIED IS NOT OBTAINABLE, CONSIDERATION WILL BE GIVEN TO THE NEAREST AVAILABLE SIZE OR SIMILAR VARIETY, WITH A CORRESPONDING ADJUSTMENT OF THE CONTRACT PRICE.
E. THE PLANT SCHEDULE PROVIDED AT THE END OF THIS SECTION, OR ON THE DRAWING, IS FOR THE CONTRACTOR'S INFORMATION ONLY, AND NO GUARANTEE IS EXPRESSED OR IMPLIED THAT QUANTITIES THEREIN ARE CORRECT OR THAT THE LIST IS COMPLETE. THE CONTRACTOR SHALL ENSURE THAT ALL PLANT MATERIALS SHOWN ON THE DRAWINGS ARE INCLUDED IN HIS OR HER BID.
F. ALL PLANTS SHALL BE LABELED BY PLANT NAME. LABELS SHALL BE ATTACHED SECURELY TO ALL PLANTS, BUNDLES, AND CONTAINERS OF PLANT MATERIALS WHEN DELIVERED. PLANT LABELS SHALL BE DURABLE AND LEGIBLE, WITH INFORMATION GIVEN IN WEATHER-RESISTANT INK OR EMBOSSED PROCESS LETTERING.
G. SELECTION AND TAGGING
1. PLANTS SHALL BE SUBJECT TO INSPECTION FOR CONFORMITY TO SPECIFICATION REQUIREMENTS AND APPROVAL BY THE LANDSCAPE ARCHITECT AT THEIR PLACE OF GROWTH AND UPON DELIVERY. SUCH APPROVAL SHALL NOT IMPAIR THE RIGHT OF INSPECTION AND REJECTION DURING PROGRESS OF THE WORK.
2. A WRITTEN REQUEST FOR THE INSPECTION OF PLANT MATERIAL AT THEIR PLACE OF GROWTH SHALL BE SUBMITTED TO THE LANDSCAPE ARCHITECT AT LEAST TEN CALENDAR DAYS PRIOR TO DIGGING. THIS REQUEST SHALL STATE THE PLACE OF GROWTH AND THE QUANTITY OF PLANTS TO BE INSPECTED. THE LANDSCAPE ARCHITECT MAY REFUSE INSPECTION AT THIS TIME IF, IN HIS OR HER JUDGMENT, SUFFICIENT QUANTITIES OF PLANTS ARE NOT AVAILABLE FOR INSPECTION OR LANDSCAPE ARCHITECT DEEMS INSPECTION IS NOT REQUIRED.
3. ALL FIELD GROWN DECIDUOUS TREES SHALL BE MARKED TO INDICATE THE TREES NORTH ORIENTATION IN THE NURSERY. PLACE A 1-IN. DIAMETER SPOT OF WHITE PAINT ONTO THE NORTH SIDE OF THE TREE TRUNK WITHIN THE BOTTOM 12 INCHES OF THE TRUNK.
H. ANTI-DESICCANTS
1. ANTI-DESICCANTS, IF SPECIFIED, ARE TO BE APPLIED TO PLANTS IN FULL LEAF IMMEDIATELY BEFORE DIGGING OR AS REQUIRED BY THE LANDSCAPE ARCHITECT. ANTI-DESICCANTS ARE TO BE SPRAYED SO THAT ALL LEAVES AND BRANCHES ARE COVERED WITH A CONTINUOUS PROTECTIVE FILM.
I. BALLED AND BURLAPPED (B&B) PLANT MATERIALS
1. TREES DESIGNATED B&B SHALL BE PROPERLY DUG WITH FIRM, NATURAL BALLS OF SOIL RETAINING AS MANY FIBROUS ROOTS AS POSSIBLE, IN SIZES AND SHAPES AS SPECIFIED IN THE FLORIDA DEPARTMENT OF AGRICULTURE GRADES AND STANDARDS FOR NURSERY PLANTS. BALLS SHALL BE FIRMLY WRAPPED WITH SYNTHETIC, NATURAL, OR TREATED BURLAP, AND/OR WIRE. ALL SYNTHETIC FABRIC SHOULD BE REMOVED FROM THE ROOTBALL PRIOR TO PLANTING. TRUE BIODEGRADABLE BURLAP CAN BE LEFT AROUND THE ROOT BALL. THE ROOT COLLAR SHALL BE APPARENT AT SURFACE OF BALL. TREES WITH LOOSE, BROKEN, PROCESSED, OR MANUFACTURED ROOT BALLS WILL NOT BE ACCEPTED, EXCEPT WITH SPECIAL WRITTEN APPROVAL BEFORE PLANTING.
J. CONTAINER PLANTS
1. PLANTS GROWN IN CONTAINERS SHALL BE OF APPROPRIATE SIZE FOR THE CONTAINER AS SPECIFIED IN THE MOST RECENT EDITION OF THE FLORIDA DEPARTMENT OF AGRICULTURE GRADES AND STANDARDS FOR NURSERY PLANTS AND BE FREE OF CIRCLING ROOTS ON THE EXTERIOR AND INTERIOR OF THE ROOT BALL.
2. CONTAINER PLANTS SHALL HAVE BEEN GROWN IN THE CONTAINER LONG ENOUGH TO HAVE ESTABLISHED ROOTS THROUGHOUT THE GROWING MEDIUM.
K. BAREROOT AND COLLECTED PLANTS
1. PLANTS DESIGNATED AS BAREROOT OR COLLECTED PLANTS SHALL CONFORM TO THE AMERICAN STANDARD FOR NURSERY STOCK.
2. BAREROOT MATERIAL SHALL NOT BE DUG OR INSTALLED AFTER BUD BREAK OR BEFORE DORMANCY.
3. COLLECTED PLANT MATERIAL THAT HAS NOT BEEN TAKEN FROM ACTIVE NURSERY OPERATIONS SHALL BE DUG WITH A ROOT BALL SPREAD AT LEAST 1/3 GREATER THAN NURSERY GROWN PLANTS. WHEN SPECIFIED OR APPROVED, SHALL BE IN GOOD HEALTH, FREE FROM DISEASE, INSECT OR WEED INFESTATION AND SHALL NOT BE PLANTED BEFORE INSPECTION AND ACCEPTANCE AT THE SITE. TESTING MAY BE REQUIRED AT THE DISCRETION OF THE LANDSCAPE ARCHITECT AND/OR THE OWNER AND SHALL BE PROVIDED AT NO ADDITIONAL COST.
L. SPECIMEN MATERIAL: PLANT MATERIAL SPECIFIED AS SPECIMENS ARE TO BE APPROVED BY THE LANDSCAPE ARCHITECT BEFORE BEING BROUGHT TO THE SITE. UNLESS OTHERWISE NOTED ON THE DRAWINGS, THESE PLANTS SHALL BE FLORIDA FANCY.
M. PALMS
1. COCONUT PALMS SHALL BE GROWN FROM A CERTIFIED SEED.
2. ALL PALM SPECIES EXCEPT SABAL PALMETTO SHALL HAVE ROOTS ADEQUATELY WRAPPED BEFORE TRANSPORTING.
3. SABAL PALMS SHALL HAVE A HURRICANE CUT. SABAL PALMS SHALL BE INSTALLED ON SITE AT THE EARLIEST OPPORTUNITY IN THE CONSTRUCTION PROCESS. ALL SABAL PALMS SHALL BE FROM PALM BEACH COUNTY OR OTHER SANDY SOILS. ALL SABAL PALMS SHALL BE FLORIDA FANCY.
4. FOR BOOTED TRUNK PALMS, TRUNKS SHALL HAVE CLEAN INTACT BOOTS FIRMLY ATTACHED TO THE PALM TRUNK. FOR SLICK TRUNK PALMS, TRUNK SHALL BE CLEAR AND FREE FROM DEFECT AND SCARS.
5. THE CONTRACTOR SHALL TREAT ALL PALMS AS REQUIRED TO PREVENT INFESTATION BY THE PALMETTO WEEVIL.
N. SOD
1. SOD SHALL BE GRADED #1 OR BETTER. SOD SHALL BE LOAM OR MUCK GROWN WITH A FIRM, FULL TEXTURE AND GOOD ROOT DEVELOPMENT. SOD SHALL BE THICK, HEALTHY AND FREE FROM DEFECTS AND DEBRIS INCLUDING BUT NOT LIMITED TO DEAD THATCH, INSECTS, FUNGUS, DISEASES AND CONTAMINATION BY WEEDS, OTHER GRASS VARIETIES OR OBJECTIONABLE PLANT MATERIAL.
2. SOD SHALL BE SUFFICIENTLY THICK TO INSURE A DENSE STAND OF LIVE GRASS. SOD SHALL BE LIVE, FRESH, AND UNINJURED AT THE TIME OF PLANTING. PLANT SOD WITHIN 48 HOURS AFTER HARVESTING.
3. SOD AREA SHALL BE ALL AREAS NOT OTHERWISE IDENTIFIED AND SHALL INCLUDE THE AREA BEYOND THE PROPERTY LINE TO THE EDGE OF PAVEMENT AND/OR EDGE OF WATER.
O. IMMEDIATELY AFTER HARVESTING PLANTS, PROTECT FROM DRYING AND DAMAGE UNTIL SHIPPED AND DELIVERED TO THE PLANTING SITE. ROOTBALLS SHALL BE CHECKED REGULARLY AND WATERED SUFFICIENTLY TO MAINTAIN ROOT VIABILITY.
P. TRANSPORTATION AND STORAGE OF PLANT MATERIAL
1. BRANCHES SHALL BE TIED WITH ROPE OR TWINE ONLY, AND IN SUCH A MANNER THAT NO DAMAGE WILL OCCUR TO THE BARK OR BRANCHES.
2. DURING TRANSPORTATION OF PLANT MATERIAL, THE CONTRACTOR SHALL EXERCISE CARE TO PREVENT INJURY AND DRYING OUT OF THE TREES. SHOULD THE ROOTS BE DRIED OUT, LARGE BRANCHES BROKEN, BALLS OF EARTH BROKEN OR LOOSENED, OR AREAS OF BARK TORN, THE LANDSCAPE ARCHITECT MAY REJECT THE INJURED TREE(S) AND ORDER THEM REPLACED AT NO ADDITIONAL COST TO THE OWNER. ALL LOADS OF PLANTS SHALL BE COVERED AT ALL TIMES WITH TARPAULIN OR CANVAS. LOADS THAT ARE NOT PROTECTED WILL BE REJECTED.
3. ALL BAREROOT STOCK SENT FROM THE STORAGE FACILITY SHALL BE ADEQUATELY COVERED WITH WET SOIL, SAWDUST, WOODCHIPS, MOSS, PEAT, STRAW, HAY, OR OTHER ACCEPTABLE MOISTURE-HOLDING MEDIUM, AND SHALL BE COVERED WITH A TARPAULIN OR CANVAS. LOADS THAT ARE NOT PROTECTED IN THE ABOVE MANNER MAY BE REJECTED.
4. PLANTS MUST BE PROTECTED AT ALL TIMES FROM SUN OR DRYING WINDS. THOSE THAT CANNOT BE PLANTED IMMEDIATELY ON DELIVERY SHALL BE KEPT IN THE SHADE, WELL PROTECTED WITH SOIL, WET MULCH, OR OTHER ACCEPTABLE MATERIAL, AND KEPT WELL WATERED. PLANTS SHALL NOT REMAIN UNPLANTED ANY LONGER THAN THREE DAYS AFTER DELIVERY. PLANTS SHALL NOT BE BOUND WITH WIRE OR ROPE AT ANY TIME SO AS TO DAMAGE THE BARK OR BREAK BRANCHES. PLANTS SHALL BE LIFTED AND HANDLED WITH SUITABLE SUPPORT OF THE SOIL BALL TO AVOID DAMAGING IT.
Q. MECHANIZED TREE SPADE REQUIREMENTS
TREES MAY BE MOVED AND PLANTED WITH AN APPROVED MECHANICAL TREE SPADE. THE TREE SPADE SHALL MOVE TREES LIMITED TO THE MAXIMUM SIZE ALLOWED FOR A SIMILAR B&B ROOT-BALL DIAMETER ACCORDING TO THE AMERICAN STANDARD FOR NURSERY STOCK OR THE MANUFACTURER'S MAXIMUM SIZE RECOMMENDATION FOR THE TREE SPADE BEING USED, WHICHEVER IS SMALLER. THE MACHINE SHALL BE APPROVED BY THE LANDSCAPE ARCHITECT PRIOR TO USE. TREES SHALL BE PLANTED AT THE DESIGNATED LOCATIONS IN THE MANNER SHOWN IN THE PLANS AND IN ACCORDANCE WITH APPLICABLE SECTIONS OF THE SPECIFICATIONS.

II MATERIALS FOR PLANTING
A. MULCH: EXCEPT AS OTHERWISE SPECIFIED, MULCH SHALL BE SHREDDED MELALEUCA MULCH - GRADE "A". ALL MELALEUCA MULCH SHALL BE MADE ENTIRELY FROM THE WOOD AND BARK OF THE MELALEUCA QUINQUINERVA TREE. IT SHALL NOT CONTAIN MORE THAN 10% BARK (BY VOLUME). SHREDS AND CHIPS SHALL NOT BE LARGER THE ¾" DIAMETER AND 1½" IN LENGTH. MULCH SHALL BE FREE OF WEEDS, SEEDS, AND ANY OTHER ORGANIC OR INORGANIC MATERIAL OTHER THAN MELALEUCA WOOD AND BARK. IT SHALL NOT CONTAIN STONES OR OTHER FOREIGN MATERIAL THAT WILL PREVENT ITS EVENTUAL DECAY. THIS SHALL BE APPLIED TO ALL PLANTED AREAS WHERE INDICATED SO THAT, AFTER INSTALLATION, THE MULCH THICKNESS WILL NOT BE LESS THAN 3". SUBMIT SAMPLE FOR APPROVAL.
B. PEAT: SHALL BE HORTICULTURAL PEAT COMPOSED OF NOT LESS THAN 60% DECOMPOSED ORGANIC MATTER BY WEIGHT, ON AN OVEN DRIED BASIS. PEAT SHALL BE DELIVERED TO THE SITE IN A WORKABLE CONDITION FREE FROM LUMPS.
C. GRAVEL MULCH: USE ONLY WHERE SPECIFICALLY INDICATED ON THE PLANS OF THE SIZE AND TYPE SHOWN. UNLESS OTHERWISE SPECIFIED IT SHALL BE WATER-WORN, HARD DURABLE GRAVEL, WASHED FREE OF LOAM, SAND, CLAY AND OTHER FOREIGN SUBSTANCES. IT SHALL BE A MINIMUM OF 3" DEEP AND SHALL BE CONTAINED WITH EDGING OR OTHER APPROVED GRAVEL STOP AS INDICATED ON THE PLANS. IT SHALL BE A MAXIMUM OF 1 1/2", A MINIMUM OF 3/4" AND OF A READILY-AVAILABLE NATURAL GRAVEL COLOR RANGE. PROVIDE GEOTEXTILE FILTER FABRIC BELOW AGGREGATE ROCK.
SUBMIT SAMPLE FOR APPROVAL.
D. ROOT BARRIER: WHERE SPECIFIED, ROOT BARRIERS SHALL BE INSTALLED ON ALL TREE AND PALM MATERIAL IN ACCORDANCE WITH THE ROOT BARRIER DETAIL PROVIDED WITHIN THE PLAN DRAWINGS. ROOT BARRIERS SHALL COMPLY WITH ALL REQUIREMENTS OF THE MUNICIPALITY WITHIN WHICH THEY ARE LOCATED AS WELL AS WITH ANY UTILITY HOLDER REQUIREMENTS OF ANY AFFECTED UTILITIES. IN THE EVENT THAT CONFLICTING REQUIREMENTS EXIST BETWEEN THE ROOT BARRIER DETAIL PROVIDED WITHIN THE PLAN DOCUMENTS AND THE MUNICIPALITY/UTILITY HOLDER REQUIREMENTS, THE MORE STRINGENT OF THE REQUIREMENTS SHALL BE APPLICABLE.
E. PLANTER EDGING: USE ONLY WHERE SPECIFICALLY INDICATED ON PLANS. EDGING SHALL BE THE COLOR BLACK.
F. ANTI-DESICCANT: SHALL BE AN EMULSION SPECIFICALLY MANUFACTURED FOR AGRICULTURAL USE, WHICH PROVIDES A PROTECTIVE FILM OVER PLANT SURFACES. ANTI-DESICCANTS SHALL BE DELIVERED IN CONTAINERS OF THE MANUFACTURER AND SHALL BE MIXED ACCORDING TO THE MANUFACTURER'S DIRECTIONS. SUBMIT MANUFACTURER LITERATURE FOR APPROVAL.

III. MATERIALS FOR SOIL AMENDMENT
A. PINE BARK: HORTICULTURAL-GRADE MILLED PINE BARK, WITH 80 PERCENT OF THE MATERIAL BY VOLUME SIZED BETWEEN 0.1 AND 15.0 MM.
1. PINE BARK SHALL BE AGED SUFFICIENTLY TO BREAK DOWN ALL WOODY MATERIAL. PINE BARK SHALL BE SCREENED.
2. PH SHALL RANGE BETWEEN 4 AND 7.0.
3. SUBMIT MANUFACTURER LITERATURE FOR APPROVAL.
B. ORGANIC MATTER: LEAF MATTER AND YARD WASTE COMPOSTED SUFFICIENTLY TO BREAK DOWN ALL WOODY FIBERS, SEEDS, AND LEAF STRUCTURES, AND FREE OF TOXIC AND NONORGANIC MATTER. ORGANIC MATTER SHALL BE COMMERCIALLY PREPARED COMPOST. SUBMIT 0.5 KG (1 LB) SAMPLE AND SUPPLIERS LITERATURE FOR APPROVAL.
C. COURSE SAND: COURSE CONCRETE SAND, ASTM C-33 FINE AGGREGATE, WITH A FINES MODULUS INDEX OF 2.75 OR GREATER.
1. SANDS SHALL BE CLEAN, SHARP, NATURAL SANDS FREE OF LIMESTONE, SHALE AND SLATE PARTICLES.
2. PROVIDE THE FOLLOWING PARTICLE SIZE DISTRIBUTION:

SIEVE	PERCENTAGE PASSING
3/8 IN (9.5 MM)	100
NO. 4 (4.75 MM)	95-100
NO. 8 (2.36 MM)	80-100
NO. 16 (1.18 MM)	50-85
NO. 30 (0.60 MM)	25-60
NO. 50 (0.30 MM)	10-30
NO. 100 (0.15 MM)	2-10

D. LIME: SHALL BE GROUND, PALLETIZED, OR PULVERIZED LIME MANUFACTURED TO MEET AGRICULTURAL STANDARDS AND CONTAIN A MAXIMUM OF 60 PERCENT OXIDE (I.E. CALCIUM OXIDE PLUS MAGNESIUM OXIDE). SUBMIT MANUFACTURER LITERATURE FOR APPROVAL.
E. SULFUR: SHALL BE FLOWERS OF SULFUR, PELLETIZED OR GRANULAR SULFUR, OR IRON SULFATE. SUBMIT MANUFACTURER LITERATURE FOR APPROVAL.
F. FERTILIZER: AGRICULTURAL FERTILIZER OF A FORMULA INDICATED BY THE SOIL TEST. FERTILIZERS SHALL BE ORGANIC, SLOW-RELEASE COMPOSITIONS WHENEVER APPLICABLE. SUBMIT MANUFACTURER LITERATURE FOR APPROVAL.

IV. PLANTING MIX
A. PLANTING MIX
1. PLANTING MIX FOR TREES, SHRUBS, GROUNDCOVERS AND VINES: CHECK WITH LANDSCAPE ARCHITECT FOR APPROPRIATE MIXTURE.
2. PLANTING MIX FOR PALMS: MIXTURE OF COURSE SAND AND PEAT MIXED TO THE FOLLOWING PROPORTION:

COMPONENT	PERCENT BY VOLUME
COARSE SAND	75%
PEAT	25%

B. PLANTING MIX SHALL BE THOROUGHLY MIXED, SCREENED, AND SHREDDED.
C. PRIOR TO BEGINNING THE MIXING PROCESS, SUBMIT A 1-KG (2-LB) SAMPLE OF THE PROPOSED MIX WITH SOIL TEST RESULTS THAT INDICATE THE MIX RATIO AND THE RESULTS ACHIEVED.
D. DURING THE MIXING PROCESS BUT PRIOR TO INSTALLING THE MIX, SUBMIT A 1-KG (2-LB) SAMPLE FOR EACH 200 CUBIC METERS (250 CUBIC YARDS) OF PLANTING MIX, TAKEN RANDOMLY FROM THE FINISHED SOIL MIX, WITH SOIL TEST RESULTS FOR APPROVAL. IN THE EVENT THAT THE TEST RESULTS DO NOT MEET THE REQUIRED PARTICLE SIZE DISTRIBUTION, REMIX AND RESUBMIT A REVISED PLANTING MIX.
E. MAKE ALL AMENDMENTS OF LIME/SULFUR AND FERTILIZER INDICATED BY THE SOIL TEST RESULTS AT THE TIME OF MIXING.
F. ALL MIXING SHALL TAKE PLACE IN THE CONTRACTORS YARD, USING COMMERCIAL MIXING EQUIPMENT SUFFICIENT TO THOROUGHLY MIX ALL COMPONENTS UNIFORMLY
G. PROTECT THE PLANTING MIX FROM EROSION PRIOR TO INSTALLATION.

PART 3. EXECUTION

I. EXCAVATION OF PLANTED AREAS
A. LOCATIONS FOR PLANTS AND/OR OUTLINES OF AREAS TO BE PLANTED ARE TO BE STAKED OUT AT THE SITE. LOCATE AND MARK ALL SUBSURFACE UTILITY LINES. APPROVAL OF THE STAKEOUT BY THE LANDSCAPE ARCHITECT IS REQUIRED BEFORE EXCAVATION BEGINS.
B. TREE, SHRUB, AND GROUNDCOVER BEDS ARE TO BE EXCAVATED TO THE DEPTH AND WIDTHS INDICATED ON THE LANDSCAPE PLAN DETAIL DRAWINGS. IF THE PLANTING AREA UNDER ANY TREE IS INITIALLY DUG TOO DEEP, THE SOIL ADDED TO BRING IT UP TO THE CORRECT LEVEL SHOULD BE THOROUGHLY TAMPED.
1. THE SIDES OF THE EXCAVATION OF ALL PLANTING AREAS SHALL BE SLOPED AT A 45 DEGREES. THE BOTTOM OF ALL BEDS SHALL SLOPE PARALLEL TO THE PROPOSED GRADES OR TOWARD ANY SUBSURFACE DRAIN LINES WITHIN THE PLANTING BED. THE BOTTOM OF THE PLANTING BED DIRECTLY UNDER ANY TREE SHALL BE HORIZONTAL SUCH THAT THE TREE SITS PLUMB.
2. MAINTAIN ALL REQUIRED ANGLES OF REPOSE OF THE ADJACENT MATERIALS AS SHOWN ON THE DRAWINGS. DO NOT EXCAVATE COMPACTED SUBGRADES OF ADJACENT PAVEMENT OR STRUCTURES.
3. SUBGRADE SOILS SHALL BE SEPARATED FROM THE TOPSOIL, REMOVED FROM THE AREA, AND NOT USED AS BACKFILL IN ANY PLANTED OR LAWN AREA. EXCAVATIONS SHALL NOT BE LEFT UNCOVERED OR UNPROTECTED OVERNIGHT.
C. FOR TREES AND SHRUBS PLANTED IN INDIVIDUAL HOLES IN AREAS OF GOOD SOIL THAT IS TO REMAIN IN PLACE AND/OR TO RECEIVE AMENDMENT IN THE TOP 150-MM (6 IN.) LAYER, EXCAVATE THE HOLE TO THE DEPTH OF THE ROOT BALL AND TO WIDTHS SHOWN ON THE DRAWING. SLOPE THE SIDES OF THE EXCAVATION AT A 45 DEGREE ANGLE UP AND AWAY FROM THE BOTTOM OF THE EXCAVATION.
1. IN AREAS OF SLOWLY DRAINING SOILS, THE ROOT BALL MAY BE SET UP TO 75 MM (3 IN.) OR 1/8 OF THE DEPTH OF THE ROOT BALL ABOVE THE ADJACENT SOIL LEVEL.
2. SAVE THE EXISTING SOIL TO BE

LANDSCAPE NOTES CONTINUED

III. FINE GRADING

A. IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO FINISH GRADE (MIN. 6" BELOW ADJACENT F.F.E.). FINISH GRADES IN PLANTING AREAS SHALL BE ONE INCH LOWER THAN ADJACENT PAVING AND ARE TO INCLUDE 3" OF MULCHING. NEW EARTHWORK SHALL BLEND SMOOTHLY INTO THE EXISTING EARTHWORK, AND GRADES SHALL PITCH EVENLY BETWEEN SPOT GRADES. ALL PLANTED AREAS MUST PITCH TO DRAIN AT A MINIMUM OF 1/4" PER FOOT. ANY DISCREPANCIES NOT ALLOWING THIS TO OCCUR SHALL BE REPORTED TO THE LANDSCAPE ARCHITECT PRIOR TO CONTINUING WORK.

B. FILL ALL DIPS AND REMOVE ANY BUMPS IN THE OVERALL PLANE OF THE SLOPE.
1. THE TOLERANCE FOR DIPS AND BUMPS IN LAWN AREAS SHALL BE A 12-MM (1/2 IN.) DEVIATION FROM THE PLANE IN 3,000 MM (10 FT).
2. THE TOLERANCE FOR DIPS AND BUMPS IN SHRUB PLANTING AREAS SHALL BE A 25-MM (1 IN.) DEVIATION FROM THE PLANE IN 3,000 MM (10 FT).
3. ALL FINE GRADING SHALL BE INSPECTED AND APPROVED BY THE LANDSCAPE ARCHITECT PRIOR TO PLANTING, MULCHING, SODDING, OR SEEDING.

C. BERMING SHALL NOT BE PLACED WITHIN 10' OF ANY EXISTING TREE NOR WILL IT BE ALLOWED TO ENCROACH UPON ANY UTILITY, DRAINAGE, OR MAINTENANCE EASEMENT. BERMING SHALL NOT IMPEDE OR OBSTRUCT ANY NECESSARY SWALES NEEDED TO DRAIN OTHER AREAS FOR THE PROPERTY.

IV. PLANTING OPERATIONS

A. PLANTS SHALL BE SET ON FLAT-TAMPED OR UNEXCAVATED PADS AT THE SAME RELATIONSHIP TO FINISHED GRADE AS THEY WERE TO THE GROUND FROM WHICH THEY WERE DUG, UNLESS OTHERWISE NOTED ON THE DRAWINGS. PLANTS MUST BE SET PLUMB AND BRACED IN POSITION UNTIL TOPSOIL OR PLANTING MIX HAS BEEN PLACED AND TAMPED AROUND THE BASE OF THE ROOT BALL. IMPROPER COMPACTING OF THE SOIL AROUND THE ROOT BALL MAY RESULT IN THE TREE SETTLING OR LEANING. PLANTS SHALL BE SET SO THAT THEY WILL BE AT THE SAME DEPTH AND SO THAT THE ROOT BALL DOES NOT SHIFT OR MOVE LATERALLY ONE YEAR LATER.
1. DETERMINE THE ELEVATION OF THE ROOT FLARE AND ENSURE THAT IT IS PLANTED AT GRADE. THIS MAY REQUIRE THAT THE TREE BE SET HIGHER THAN THE GRADE IN THE NURSERY.
2. IF THE ROOT FLARE IS LESS THAN 50 MM (2 IN.) BELOW THE SOIL LEVEL OF THE ROOT BALL, PLANT THE TREE THE APPROPRIATE LEVEL ABOVE THE GRADE TO SET THE FLARE EVEN WITH THE GRADE. IF THE FLARE IS MORE THAN 50 MM (2 IN) AT THE CENTER OF THE ROOT BALL THE TREE SHALL BE REJECTED.

B. LIFT PLANTS ONLY FROM THE BOTTOM OF THE ROOT BALLS OR WITH BELTS OR LIFTING HARNESSES OF SUFFICIENT WIDTH NOT TO DAMAGE THE ROOT BALLS. DO NOT LIFT TREES BY THEIR TRUNK OR USE THE TRUNK AS A LEVER IN POSITIONING OR MOVING THE TREE IN THE PLANTING AREA.

C. REMOVE PLASTIC, PAPER, OR FIBER POTS FROM CONTAINERIZED PLANT MATERIAL. PULL ROOTS OUT OF THE ROOT MAT. LOOSEN THE POTTING MEDIUM AND SHAKE AWAY FROM THE ROOT MAT. IMMEDIATELY AFTER REMOVING THE CONTAINER, INSTALL THE PLANT SUCH THAT THE ROOTS DO NOT DRY OUT. PACK PLANTING MIX AROUND THE EXPOSED ROOTS WHILE PLANTING.

D. THE ROOTS OF BARE-ROOT TREES SHALL BE PRUNED AT THE TIME OF PLANTING TO REMOVE DAMAGED OR UNDESIRABLE ROOTS (THOSE LIKELY TO BECOME A DETRIMENT TO FUTURE GROWTH OF THE ROOT SYSTEM). BARE-ROOT TREES SHALL HAVE THE ROOTS SPREAD TO APPROXIMATE THE NATURAL POSITION OF THE ROOTS AND SHALL BE CENTERED IN THE PLANTING PIT. THE PLANTING-SOIL BACKFILL SHALL BE WORKED FIRMLY INTO AND AROUND THE ROOTS, WITH CARE TAKEN TO FILL IN COMPLETELY WITH NO AIR POCKETS.

E. CUT ROPES OR STRINGS FROM THE TOP OF SHRUB ROOT BALLS AND TREES SMALLER THAN 3 IN. CALIPER AFTER PLANT HAS BEEN SET. REMOVE BURLAP OR CLOTH WRAPPING AND ANY WIRE BASKETS FROM AROUND TOP HALF OF BALLS. DO NOT TURN UNDER AND BURY PORTIONS OF BURLAP AT TOP OF BALL.
1. DO NOT IMMEDIATELY REMOVE THE ROPES AND BURLAP FROM TREES LARGER THAN 3 IN. CALIPER. RETURN TO EACH TREE THREE MONTHS AFTER PLANTING AND CUT ALL ROPES AROUND THE TRUNKS AND TOPS OF THE ROOT BALLS OF THESE TREES.
2. COMPLETELY REMOVE ANY WATERPROOF OR WATER-REPELLANT STRINGS OR WRAPPINGS FROM THE ROOT BALL AND TRUNK BEFORE BACKFILLING.

F. SET BALLED AND BURLAPPED TREES IN THE HOLE WITH THE NORTH MARKER FACING NORTH UNLESS OTHERWISE APPROVED BY THE LANDSCAPE ARCHITECT.

G. PLACE NATIVE SOIL, TOPSOIL, OR PLANTING MIX INTO THE AREA AROUND THE TREE, TAMPING LIGHTLY TO REDUCE SETTLEMENT.
1. FOR PLANTS PLANTED IN INDIVIDUAL HOLES IN EXISTING SOIL, ADD ANY REQUIRED SOIL AMENDMENTS TO THE SOILS, AS THE MATERIAL IS BEING BACKFILLED AROUND THE PLANT. ENSURE THAT THE AMENDMENTS ARE THOROUGHLY MIXED INTO THE BACKFILL.
2. FOR PLANTS PLANTED IN LARGE BEDS OF PREPARED SOIL, ADD SOIL AMENDMENTS DURING THE SOIL INSTALLATION PROCESS.
3. ENSURE THAT THE BACKFILL IMMEDIATELY AROUND THE BASE OF THE ROOT BALL IS TAMPED WITH FOOT PRESSURE SUFFICIENT TO PREVENT THE ROOT BALL FROM SHIFTING OR LEANING.

H. SOLID SOD SHALL BE LAID WITH CLOSELY ABUTTING JOINTS WITH A TAMPED OR ROLLED, EVEN SURFACE. STAGGER STRIPS TO OFFSET JOINTS IN ADJACENT COURSES. BRING THE SOD EDGE IN A NEAT, CLEAN MANNER TO THE EDGE OF ALL PAVING AND SHRUB AREAS. SOD ALONG SLOPES SHALL BE PEGGED TO HOLD SOD IN PLACE ALONG SLOPES OR BANKS A WOOD PEG ACCEPTABLE TO THE LANDSCAPE ARCHITECT SHALL BE USED AT NO ADDITIONAL COST TO THE OWNER. IF, IN THE OPINION OF THE LANDSCAPE ARCHITECT, TOP-DRESSING IS NECESSARY AFTER ROLLING, CLEAN SAND WILL BE EVENLY APPLIED OVER THE ENTIRE SURFACE AND THOROUGHLY WASHED IN WITHOUT ADDITIONAL CHARGE.

I. THOROUGHLY WATER ALL PLANTS IMMEDIATELY AFTER PLANTING. APPLY WATER BY HOSE DIRECTLY TO THE ROOT BALL AND THE ADJACENT SOIL.

J. REMOVE ALL TAGS, LABELS, STRINGS, ETC. FROM ALL PLANTS.

K. REMOVE ANY EXCESS SOIL, DEBRIS, AND PLANTING MATERIAL FROM THE JOB SITE AT THE END OF EACH WORKDAY.

L. FORM WATERING SAUCERS 100 MM (4 IN.) HIGH IMMEDIATELY OUTSIDE THE AREA OF THE ROOT BALL OF EACH TREE AS INDICATED ON THE DRAWINGS.

V. RELOCATION OF EXISTING MATERIAL:

A. LANDSCAPE CONTRACTOR SHALL ROOT PRUNE TREES WHICH ARE TO BE RELOCATED IN ACCORDANCE WITH APPROVED HORTICULTURAL PRACTICES AND THE FOLLOWING PROCEDURES.
1. SELECT A HEALTHY TREE
2. SELECTIVELY TRIM THE CANOPY REMOVING DEAD LIMBS, CROSS BRANCHING OVER CROWNED AREAS, AND LOWER UNDESIRABLE LIMBS. FERTILIZE AND WATER TREES BEFORE PRUNING.
3. ROOT PRUNE 50% OF THE ROOT SYSTEM APPROXIMATELY 18"-2' DEEP (DEPENDING UPON SPECIES AND SIZE). THIS IS DONE BY HAND WITH SHARP HAND TOOLS OR A ROOT PRUNING SAW. THE DIAMETER OF THE ROOT BALL TO BE PRUNED IS 8-12 INCHES PER EVERY ONE INCH OF DIAMETER AT BREAST HEIGHT OF THE TREE.
4. BACK FILL THE EXISTING SOIL WITH PEAT MOSS TO STIMULATE NEW ROOT GROWTH OF THE PRUNED ROOTS.
5. WATER IN THOROUGHLY AND TREAT WITH A MYCORRHIZAE AND A LOW NITROGEN FERTILIZER (SO NOT TO BURN THE PRUNED ROOTS), BRACE TREES IF DEEMED NECESSARY.
6. THE ROOT PRUNED TREE SHOULD BE WATERED EVERY DAY (ESPECIALLY DURING WARM MONTHS OF THE SEASON), THE EQUIVALENT OF 5 GALLONS FOR EVERY DBH OF TREE PER DAY.
7. ROOT PRUNED TREES SHOULD BE LET TO STAND FOR A MINIMUM OF 6 WEEKS FOR TREES LESS THAN 8" DBH AND AS LONG AS 3 MONTHS FOR LARGER SPECIMENS PRIOR TO TRANSPLANTING.
8. FOR BEST RESULTS AND SURVIVORSHIP, NEW ROOT GROWTH SHOULD BE EVIDENT ON ROOT PRUNED TREES PRIOR TO TRANSPLANTING.
9. UPON TRANSPLANTING, WATER SHOULD BE APPLIED EVERY DAY AS OUTLINED IN STEP 6 FOR AT LEAST ONE YEAR.

VI. STAKING AND GUYING

A. THE CONTRACTOR SHALL STAKE ALL TREES AND PALMS IN ACCORDANCE WITH THE TREE AND PALM STAKING DETAILS PROVIDED WITHIN THE PLAN DRAWINGS. ALTERNATE METHODS OF GUYING OR STAKING MAY BE EMPLOYED WITH THE PRIOR APPROVAL OF THE LANDSCAPE ARCHITECT.

B. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE REPLACEMENT OR ADJUSTMENT OF ALL TREES, PALMS OR SHRUBS THAT FALL OR LEAN DURING THE GUARANTEE PERIOD. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ANY DAMAGE CAUSED BY THE FALLING OR LEANING OF TREES.

C. STAKES AND GUYS SHALL BE INSTALLED IMMEDIATELY UPON APPROVAL OR PLANTING, AND SHALL BE REMOVED IN ACCORDANCE WITH THE STAKING DETAILS PROVIDE WITHIN THE PLAN DRAWINGS. ANY TREE THAT IS NOT STABLE AT THE END OF THE WARRANTY PERIOD SHALL BE REJECTED.

VII. PRUNING

A. PLANTS SHALL NOT BE HEAVILY PRUNED AT THE TIME OF PLANTING. PRUNING IS REQUIRED AT PLANTING TIME TO CORRECT DEFECTS IN THE TREE STRUCTURE, INCLUDING REMOVAL OF INJURED BRANCHES, WATERSPOUTS, SUCKERS, AND INTERFERING BRANCHES. HEALTHY LOWER BRANCHES AND INTERIOR SMALL TWIGS SHOULD NOT BE REMOVED EXCEPT AS NECESSARY TO CLEAR WALKS AND ROADS. IN NO CASE SHOULD MORE THAN ONE-QUARTER OF THE BRANCHING STRUCTURE BE REMOVED. RETAIN THE NORMAL OR NATURAL SHAPE OF THE PLANT.

B. ALL PRUNING SHALL BE COMPLETED USING CLEAN, SHARP TOOLS. ALL CUTS SHALL BE CLEAN AND SMOOTH, WITH THE BARK INTACT WITH NO ROUGH EDGES OR TEARS.

C. PRUNING OF LARGE TREES SHALL BE DONE FROM A HYDRAULIC MAN-LIFT SUCH THAT IT IS NOT NECESSARY TO CLIMB THE TREE.

VIII. MULCHING

A. ALL TREES, PALMS, SHRUBS, AND OTHER PLANTINGS WILL BE MULCHED WITH MULCH PREVIOUSLY APPROVED BY THE LANDSCAPE ARCHITECT. THE MULCH SHALL BE A MINIMUM 3" THICK LAYER OVER ALL TREE, SHRUB AND GROUND COVER PLANTING AREAS, UNLESS OTHERWISE SPECIFIED. ALL MULCH LAYERS SHALL BE OF THE SPECIFIED THICKNESS AT THE TIME OF THE FINAL ACCEPTANCE OF THE WORK. MULCH MUST NOT BE PLACED WITHIN 3 INCHES OF THE TRUNKS OF TREES, PALMS OR SHRUBS.

B. PLACE MULCH AT LEAST 3" IN DEPTH IN A CIRCLE AROUND ALL TREES LOCATED IN LAWN AREAS. THE DIAMETER OF THE CIRCLE SHALL BE 18" IN DIAMETER LARGER THAN THE BALL OF THE PLANT PROVIDED. MULCH MUST NOT BE PLACED WITHIN 3 INCHES OF THE TRUNKS OF TREES, PALMS OR SHRUBS.

IX. MAINTENANCE OF TREES, SHRUBS, AND VINES

A. MAINTENANCE SHALL BEGIN IMMEDIATELY AFTER EACH PLANT IS PLANTED AND CONTINUE UNTIL ITS ACCEPTANCE HAS BEEN CONFIRMED BY THE LANDSCAPE ARCHITECT.

B. MAINTENANCE SHALL CONSIST OF PRUNING, WATERING, CULTIVATING, WEEDING, MULCHING, FERTILIZING, TIGHTENING AND REPAIRING GUYS AND STAKES, RESETTING PLANTS TO PROPER GRADES OR UPRIGHT POSITION, RESTORING OF THE PLANTING SAUCER, AND FURNISHING AND APPLYING SUCH SPRAYS OR OTHER MATERIALS AS NECESSARY TO KEEP PLANTINGS FREE OF INSECTS AND DISEASES AND IN VIGOROUS CONDITION.

C. PLANTING AREAS AND PLANTS SHALL BE PROTECTED AT ALL TIMES AGAINST TRESPASSING AND DAMAGE OF ALL KINDS FOR THE DURATION OF THE MAINTENANCE PERIOD. IF A PLANT BECOMES DAMAGED OR INJURED, IT SHALL BE TREATED OR REPLACED AS DIRECTED BY THE LANDSCAPE ARCHITECT AT NO ADDITIONAL COST.

D. WATERING: CONTRACTOR SHALL IRRIGATE AS REQUIRED TO MAINTAIN VIGOROUS AND HEALTHY TREE GROWTH. OVERWATERING OR FLOODING SHALL NOT BE ALLOWED. THE CONTRACTOR SHALL MONITOR, ADJUST, AND USE EXISTING IRRIGATION FACILITIES, IF AVAILABLE, AND FURNISH ANY ADDITIONAL MATERIAL, EQUIPMENT, OR WATER TO ENSURE ADEQUATE IRRIGATION. ROOT BALLS OF ALL TREES AND LARGE SHRUBS SHALL BE SPOT WATERED USING HANDHELD HOSES DURING THE FIRST FOUR MONTHS AFTER PLANTING, AS REQUIRED TO ENSURE ADEQUATE WATER WITHIN THE ROOT BALL.

E. DURING PERIODS OF RESTRICTED WATER USAGE, ALL GOVERNMENTAL REGULATIONS (PERMANENT AND TEMPORARY) SHALL BE FOLLOWED. THE CONTRACTOR MAY HAVE TO TRANSPORT WATER FROM PONDS OR OTHER SOURCES, AT NO ADDITIONAL EXPENSE TO THE OWNER WHEN IRRIGATION SYSTEMS ARE UNAVAILABLE.

F. REMOVE SOIL RIDGES FROM AROUND WATERING BASINS PRIOR TO END OF MAINTENANCE PERIOD, AS DIRECTED BY LANDSCAPE ARCHITECT

X. ACCEPTANCE

A. THE LANDSCAPE ARCHITECT SHALL INSPECT ALL WORK FOR ACCEPTANCE UPON WRITTEN REQUEST OF THE CONTRACTOR. THE REQUEST SHALL BE RECEIVED AT LEAST TEN CALENDAR DAYS BEFORE THE ANTICIPATED DATE OF INSPECTION.

B. ACCEPTANCE OF PLANT MATERIAL SHALL BE FOR GENERAL CONFORMANCE TO SPECIFIED SIZE, CHARACTER, AND QUALITY AND SHALL NOT RELIEVE THE CONTRACTOR OF RESPONSIBILITY FOR FULL CONFORMANCE TO THE CONTRACT DOCUMENTS, INCLUDING CORRECT SPECIES.

C. UPON COMPLETION AND RE-INSPECTION OF ALL REPAIRS OR RENEWALS NECESSARY IN THE JUDGMENT OF THE LANDSCAPE ARCHITECT, THE LANDSCAPE ARCHITECT SHALL CERTIFY IN WRITING THAT THE WORK HAS BEEN ACCEPTED.

XI. ACCEPTANCE IN PART

A. WORK MAY BE ACCEPTED IN PARTS WHEN THE LANDSCAPE ARCHITECT AND CONTRACTOR DEEM THAT PRACTICE TO BE IN THEIR MUTUAL INTEREST. APPROVAL MUST BE GIVEN IN WRITING BY THE LANDSCAPE ARCHITECT TO THE CONTRACTOR VERIFYING THAT THE WORK IS TO BE COMPLETED IN PARTS. ACCEPTANCE OF WORK IN PARTS SHALL NOT WAIVE ANY OTHER PROVISION OF THIS CONTRACT.

XII. GUARANTEE PERIOD AND REPLACEMENTS

A. THE GUARANTEE PERIOD FOR TREES AND SHRUBS SHALL BEGIN AT THE DATE OF ACCEPTANCE.

B. THE CONTRACTOR SHALL GUARANTEE ALL PLANT MATERIAL TO BE IN HEALTHY AND FLOURISHING CONDITION FOR A PERIOD OF ONE YEAR FROM THE DATE OF ACCEPTANCE.

C. WHEN WORK IS ACCEPTED IN PARTS, THE GUARANTEE PERIODS EXTEND FROM EACH OF THE PARTIAL ACCEPTANCES TO THE TERMINAL DATE OF THE GUARANTEE OF THE LAST ACCEPTANCE. THUS, ALL GUARANTEE PERIODS TERMINATE AT ONE TIME.

D. THE CONTRACTOR SHALL REPLACE, WITHOUT COST, AS SOON AS WEATHER CONDITIONS PERMIT, AND WITHIN A SPECIFIED PLANTING PERIOD, ALL PLANTS DETERMINED BY THE LANDSCAPE ARCHITECT TO BE DEAD OR IN AN UNACCEPTABLE CONDITION DURING AND AT THE END OF THE GUARANTEE PERIOD. TO BE CONSIDERED ACCEPTABLE, PLANTS SHALL BE FREE OF DEAD OR DYING BRANCHES AND BRANCH TIPS AND SHALL BEAR FOLIAGE OF NORMAL DENSITY, SIZE, AND COLOR. REPLACEMENTS SHALL CLOSELY MATCH ADJACENT SPECIMENS OF THE SAME SPECIES. REPLACEMENTS SHALL BE SUBJECT TO ALL REQUIREMENTS STATED IN THIS SPECIFICATION.

E. THE GUARANTEE OF ALL REPLACEMENT PLANTS SHALL EXTEND FOR AN ADDITIONAL PERIOD OF ONE YEAR FROM THE DATE OF THEIR ACCEPTANCE AFTER REPLACEMENT. IN THE EVENT THAT A REPLACEMENT PLANT IS NOT ACCEPTABLE DURING OR AT THE END OF SAID EXTENDED GUARANTEE PERIOD, THE LANDSCAPE ARCHITECT MAY ELECT SUBSEQUENT REPLACEMENT OR CREDIT FOR THAT ITEM.

F. AT THE END OF THE GUARANTEE, THE CONTRACTOR SHALL RESET GRADES THAT HAVE SETTLED BELOW THE PROPOSED GRADES ON THE DRAWINGS.

G. THE CONTRACTOR SHALL MAKE PERIODIC INSPECTIONS, AT NO EXTRA COST, DURING THE GUARANTEE PERIOD TO DETERMINE WHAT CHANGES, IF ANY, SHOULD BE MADE IN THE MAINTENANCE PROGRAM. IF CHANGES ARE RECOMMENDED, THEY SHALL BE SUBMITTED IN WRITING TO THE LANDSCAPE ARCHITECT. CLAIMS BY THE CONTRACTOR THAT THE OWNERS MAINTENANCE PRACTICES OR LACK OF MAINTENANCE RESULTED IN DEAD OR DYING PLANTS WILL NOT BE CONSIDERED IF SUCH CLAIMS HAVE NOT BEEN DOCUMENTED BY THE CONTRACTOR DURING THE GUARANTEE PERIOD.

XIII. FINAL INSPECTION AND FINAL ACCEPTANCE

AT THE END OF THE GUARANTEE PERIOD AND UPON WRITTEN REQUEST OF THE CONTRACTOR, THE LANDSCAPE ARCHITECT WILL INSPECT ALL GUARANTEED WORK FOR FINAL ACCEPTANCE. THE REQUEST SHALL BE RECEIVED AT LEAST TEN CALENDAR DAYS BEFORE THE ANTICIPATED DATE FOR FINAL INSPECTION. UPON COMPLETION AND RE-INSPECTION OF ALL REPAIRS OR RENEWALS NECESSARY IN THE JUDGMENT OF THE LANDSCAPE ARCHITECT AT THAT TIME, THE LANDSCAPE ARCHITECT SHALL CERTIFY, IN WRITING, THAT THE PROJECT HAS RECEIVED FINAL ACCEPTANCE.

Corey Kissell Wong P:\2920\2920.04 Waterford Campus Review\LA\Drawings\Landscape\2920.04_LP revision.dwg — Plotted: 10/6/2025 2:46:02 PM Saved: 10/6/2025 2:02:26 PM

WGL
2035 Vista Parkway, West Palm Beach, FL 33411
Phone No. 866.909.2220 www.wginc.com
Cert No. 6091 - LB No. 7055

NOT AUTHORIZED FOR CONSTRUCTION PRIOR TO FORMAL TOWN APPROVAL

REVISIONS

NO.	DATE	DESCRIPTION	BY
1	2/26/2025	SITE PLAN AMENDMENT	KV
2	7/31/2025	SITE PLAN AMENDMENT	CKW
3	10/6/2025	SITE PLAN AMENDMENT	CKW

CAD 2920.04_LP REVISION.DWG
JOB NO. 2920.04
DRAWN BY CKW
CHECK BY YM
DATE 10/06/2025

LANDSCAPE ARCHITECT OF RECORD
COREY A. KISSELL WONG, PLA
FL # LA6667017

REGISTERED LANDSCAPE ARCHITECT
COREY A. KISSELL WONG
LA 6667017
STATE OF FLORIDA

THE WATERFORD
601 UNIVERSE BOULEVARD
JUNO BEACH, FL
LANDSCAPE SPECIFICATIONS

SHEET:
LP-3.03



NOTE: CONTRACTOR SHALL NOTIFY THE TOWN THREE WEEKS PRIOR TO THE REMOVAL OF NATIVE TREES AND PALMS SO THE TOWN MAY NOTIFY RESIDENTS OF AVAILABLE VEGETATION FOR REUSE.

811 Know what's BELOW. CALL before you dig

Call 811 two business days before digging

WGI
2035 Vista Parkway, West Palm Beach, FL 33411
Phone No. 866.909.2220 www.wginc.com
Cert No. 6091 - LB No. 7055

NOT AUTHORIZED FOR CONSTRUCTION PRIOR TO FORMAL TOWN APPROVAL

REVISIONS

NO.	DATE	DESCRIPTION	BY
1	2/26/2025	SITE PLAN AMENDMENT	KW
2	7/31/2025	SITE PLAN AMENDMENT	CKW
3	10/6/2025	SITE PLAN AMENDMENT	CKW

CAD 2920.04_LD.DWG	
JOB NO.	2920.04
DRAWN BY	CKW
CHECK BY	YM
DATE	10/06/2025

LANDSCAPE ARCHITECT OF RECORD
COREY A. KISSELL WONG, PLA
FL # LA6667017

REGISTERED LANDSCAPE ARCHITECT
COREY A. KISSELL WONG
LA 6667017
STATE OF FLORIDA

THE WATERFORD


601 UNIVERSE BOULEVARD
JUNO BEACH, FL

OVERALL TREE DISPOSITION PLAN

SHEET:
LD-1.00

Corey Kissell Wong P:\2020\2920.04 Waterford Campus Redev\LA\Drawings\Landscape\2920.04_LD.dwg --- Plotted: 10/6/2025 3:03:31 PM Saved: 10/6/2025 12:00:10 PM

SHEET KEY MAP

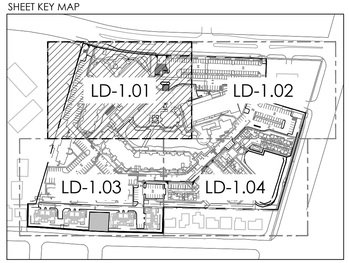

LEGEND

- TREE/ PALM TO PRESERVE
- TREE/ PALM TO RELOCATED
- TREE/ PALM TO REMOVE

N

0 10 20 40

SCALE: 1" = 20'

811 Know what's BELOW. CALL before you dig. Call 811 two business days before digging

SIGHT TRIANGLE, TYP.
10' TURNAROUND SPACE
45'-0" THROAT
PROPOSED GATE
20' DRIVE
12'-0" U.E.
PROPERTY LINE
EX. WALL
6'-0" SW
30' FRONT S.B.
UNIVERSE BOULEVARD
EXISTING ENTRY SIGN
EX. PARKING
MATCHLINE LD-1.01
MATCHLINE LD 1.02
37'-0"
PROPOSED GATE
20'-0"
MANNED GUARD HOUSE (ROOF ABOVE)
10'-0" FPL EASEMENT
COVERED DROP OFF
EX. FIRE HYDRANT, TYP.
EX. HEALTH CENTER
PERGOLA
EX. PARKING
EXISTING WALL W/ VARYING HEIGHTS
LOADING ZONES
GREASE TRAPS
DUMPSTER COMPACTOR
24' DRIVE
5'-0" SW
BUILDING A
13' OVERHANG
WALL
PROPOSED WOOD DECK EXTENSION
EX. WOOD DECK
PROPOSED WOOD DECK
BUILDING OVERHANG
PROPOSED PEDESTRIAN BRIDGE
LAKE
MATCHLINE LD-1.01
MATCHLINE LD-1.03
MATCHLINE LD-1.04

WGL
2035 Vista Parkway, West Palm Beach, FL 33411
Phone No. 866.909.2220 www.wginc.com
Cert No. 6091 - LB No. 7055

NOT AUTHORIZED FOR CONSTRUCTION PRIOR TO FORMAL TOWN APPROVAL

REVISIONS

NO.	DATE	DESCRIPTION	BY
1	2/26/2025	SITE PLAN AMENDMENT	CKW
2	7/31/2025	SITE PLAN AMENDMENT	CKW
3	10/6/2025	SITE PLAN AMENDMENT	CKW

CAD 2020.04_LD.DWG	
JOB NO.	2920.04
DRAWN BY	CKW
CHECK BY	YM
DATE	10/06/2025

LANDSCAPE ARCHITECT OF RECORD
COREY A. KISSELL WONG, PLA
FL # LA6667017

REGISTERED LANDSCAPE ARCHITECT COREY A. KISSELL WONG LA 6667017 STATE OF FLORIDA

THE WATERFORD
601 UNIVERSE BOULEVARD
JUNO BEACH, FL

TREE DISPOSITION PLAN

SHEET:
LD-1.01

Corey Kissell Wong P:\2020\2020.04 Waterford Campus Redev\LA\Drawings\Landscape\2020.04_LD.dwg — Plotted: 10/6/2025 3:03:48 PM Saved: 10/6/2025 12:00:19 PM



SHEET KEY MAP

LEGEND

- # TREE/ PALM TO PRESERVE
- # TREE/ PALM TO RELOCATED
- # TREE/ PALM TO REMOVE

N

Know what's BELOW. CALL before you dig

Call 811 two business days before digging

0 10 20 40

SCALE: 1" = 20'

WGI
2035 Vista Parkway, West Palm Beach, FL 33411
Phone No. 866.909.2220 www.wginc.com
Cert No. 6091 - LB No. 7055

NOT AUTHORIZED FOR CONSTRUCTION PRIOR TO FORMAL TOWN APPROVAL

REVISIONS

NO.	DATE	DESCRIPTION	BY
1	2/4/2025	SITE PLAN AMENDMENT	CKW
2	7/31/2025	SITE PLAN AMENDMENT	CKW
3	10/6/2025	SITE PLAN AMENDMENT	CKW

CAD 2920.04_LD.DWG	
JOB NO.	2920.04
DRAWN BY	CKW
CHECK BY	YM
DATE	10/06/2025

LANDSCAPE ARCHITECT OF RECORD
COREY A. KISSELL WONG, PLA
FL # LA6667017

REGISTERED LANDSCAPE ARCHITECT
COREY A. KISSELL WONG
LA 6667017
STATE OF FLORIDA

THE WATERFORD


601 UNIVERSE BOULEVARD
JUNO BEACH, FL

TREE DISPOSITION PLAN

SHEET:
LD-1.02

Corey Kissell Wong P:\2920\2920.04 Waterford Campus Redev\LA\Drawings\Landscape\2920.04_LD.dwg — Plotted: 10/6/2025 3:04:04 PM Saved: 10/6/2025 12:00:10 PM

SHEET KEY MAP

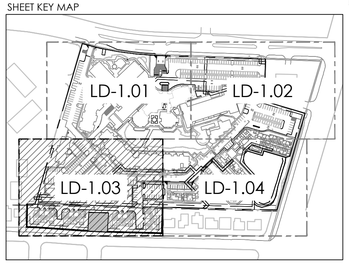

LEGEND

- TREE/ PALM TO PRESERVE
- TREE/ PALM TO RELOCATED
- TREE/ PALM TO REMOVE

MATCHLINE LD-1.01

MATCHLINE LD-1.03

MATCHLINE LD-1.04

PROPERTY LINE

EXISTING WALL W/ VARYING HEIGHTS

EX.VILLAS

EX. PARKING

GARDEN APARTMENTS

PROPOSED PEDESTRIAN BRIDGE

PROPOSED WOOD DECK

4' S/W

10'-0" FPL EASEMENT

24' DRIVE

20'-0" DRIVE

25' DRIVE

FIRE HYDRANT, TYP.

BUILDING H INDEPENDENT LIVING

PROPOSED LIFT STATION

15'-0" LANDSCAPE BUFFER

BUILDING G

BUILDING F

BUILDING E

BUILDING D

COVERED PATIO TYP.

OPEN SPACE 6881 SF

12'-0" U.E.

6' WALL

S.U.A. ACCESS GATE

PLEASANT DRIVE

N

Know what's BELOW. CALL before you dig

Call 811 two business days before digging

0 10 20 40

SCALE: 1" = 20'

WGI
2035 Vista Parkway, West Palm Beach, FL 33411
Phone No. 866.909.2220 www.wginc.com
Cert No. 6091 - LB No. 7055

NOT AUTHORIZED FOR CONSTRUCTION PRIOR TO FORMAL TOWN APPROVAL

REVISIONS

NO.	DATE	DESCRIPTION	BY
1	2/3/2025	SITE PLAN AMENDMENT	CKW
2	7/31/2025	SITE PLAN AMENDMENT	CKW
3	10/6/2025	SITE PLAN AMENDMENT	CKW

CAD 292004_LD.DWG	
JOB NO.	2920.04
DRAWN BY	CKW
CHECK BY	YM
DATE	10/06/2025

LANDSCAPE ARCHITECT OF RECORD
COREY A. KISSELL WONG, PLA
FL # LA6667017

REGISTERED LANDSCAPE ARCHITECT
COREY A. KISSELL WONG
LA 6667017
STATE OF FLORIDA

THE WATERFORD

601 UNIVERSE BOULEVARD
JUNO BEACH, FL

TREE DISPOSITION PLAN

SHEET:
LD-1.03

Corey Kissell Wong P:\2900\2920.04 Waterford Campus Redev (LA)\Drawings\Landscape\2920.04_LD.dwg — Plotted: 10/6/2025 3:04:21 PM Saved: 10/6/2025 12:00:10 PM

MATCHLINE LD-1.01

MATCHLINE LD-1.04

MATCHLINE LD-1.03

MATCHLINE LD-1.04

LAKE

GARDEN APARTMENTS

BUILDING C EX. WELLNESS BLGD.

GARAGE ENTRY

BUILDING I INDEPENDENT LIVING

BUILDING H INDEPENDENT LIVING

10'-0" FPL EASEMENT

5'-0" SWK

10' SOUTHERN BELL EASEMENT


6' WALL

20'-0" LANDSCAPE BUFFER

PROPERTY LINE

US HWY 1 (STATE ROAD 5)

SHEET KEY MAP

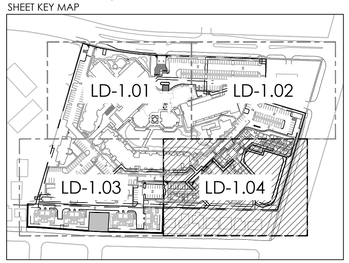

LEGEND

- # TREE/ PALM TO PRESERVE
- # TREE/ PALM TO RELOCATED
- # TREE/ PALM TO REMOVE

N

Know what's BELOW. CALL before you dig

Call 811 two business days before digging

0 10 20 40

SCALE: 1" = 20'

WGI
2035 Vista Parkway, West Palm Beach, FL 33411
Phone No. 866.909.2220 www.wginc.com
Cert No. 6091 - LB No. 7055

NOT AUTHORIZED FOR CONSTRUCTION PRIOR TO FORMAL TOWN APPROVAL

NO.	DATE	DESCRIPTION	BY
1	2/20/2025	SITE PLAN AMENDMENT	CKW
2	7/31/2025	SITE PLAN AMENDMENT	CKW
3	10/6/2025	SITE PLAN AMENDMENT	CKW

REVISIONS

CAD: 2920.04_LD.DWG	
JOB NO.	2920.04
DRAWN BY	CKW
CHECK BY	YM
DATE	10/06/2025

LANDSCAPE ARCHITECT OF RECORD
COREY A. KISSELL WONG, PLA
FL. # LA6667017

REGISTERED LANDSCAPE ARCHITECT
COREY A. KISSELL WONG
LA 6667017
STATE OF FLORIDA

THE WATERFORD

601 UNIVERSE BOULEVARD
JUNO BEACH, FL

TREE DISPOSITION PLAN

SHEET:
LD-1.04

Corey Kissell Wong P:\2920\2920.04 Waterford Campus Redev\LA\Drawings\Landscape\2920.04_LD.dwg — Plotted: 10/6/2025 2:04:37 PM Saved: 10/6/2025 12:00:10 PM

Tag #	Common Name	Scientific Name	DBH (inches)*	Disposition	Notes
1	Christmas Palm	*Veitchia merillii*	9'	Preserve	Double
2	Christmas Palm	*Veitchia merillii*	8'	Preserve	Double
3	Christmas Palm	*Veitchia merillii*	8'	Preserve	Double
4	Christmas Palm	*Veitchia merillii*	9'	Preserve	Double
5	Christmas Palm	*Veitchia merillii*	8'	Preserve	Double
6	Christmas Palm	*Veitchia merillii*	8'	Preserve	Double
7	Christmas Palm	*Veitchia merillii*	10'	Preserve	Quad
8	Christmas Palm	*Veitchia merillii*	10'	Preserve	Multi-trunk
9	Christmas Palm	*Veitchia merillii*	8'	Preserve	Double
10	Christmas Palm	*Veitchia merillii*	8'	Preserve	Double
11	Christmas Palm	*Veitchia merillii*	9'	Preserve	Double
12	Christmas Palm	*Veitchia merillii*	9'	Preserve	Triplet
13	Christmas Palm	*Veitchia merillii*	9'	Preserve	Triplet
14	Christmas Palm	*Veitchia merillii*	10'	Remove	Double
15	Christmas Palm	*Veitchia merillii*	10'	Remove	Triplet
16	Christmas Palm	*Veitchia merillii*	10'	Preserve	
17	Christmas Palm	*Veitchia merillii*	10'	Preserve	
18	Christmas Palm	*Veitchia merillii*	10'	Preserve	Triplet
19	Christmas Palm	*Veitchia merillii*	9'	Preserve	Triplet
20	Christmas Palm	*Veitchia merillii*	7'	Remove	Triplet
21	Christmas Palm	*Veitchia merillii*	11'	Preserve	Triplet
22	Christmas Palm	*Veitchia merillii*	12'	Preserve	Triplet
23	Christmas Palm	*Veitchia merillii*	11'	Preserve	Triplet
24	Christmas Palm	*Veitchia merillii*	10'	Preserve	Triplet
25	Christmas Palm	*Veitchia merillii*	11'	Preserve	Triplet
26	Christmas Palm	*Veitchia merillii*	11'	Preserve	Triplet
27	Christmas Palm	*Veitchia merillii*	12'	Preserve	Triplet
28	Christmas Palm	*Veitchia merillii*	10'	Preserve	Triplet
29	Christmas Palm	*Veitchia merillii*	6'	Preserve	Triplet
30	Christmas Palm	*Veitchia merillii*	9'	Remove	Triplet
31	Christmas Palm	*Veitchia merillii*	8'	Remove	Double
32	Christmas Palm	*Veitchia merillii*	9'	Preserve	Double
33	Christmas Palm	*Veitchia merillii*	8'	Preserve	Double
34	Christmas Palm	*Veitchia merillii*	8'	Remove	Double
35	Christmas Palm	*Veitchia merillii*	12'	Preserve	Triplet
36	Christmas Palm	*Veitchia merillii*	5'	Preserve	
37	Christmas Palm	*Veitchia merillii*	9'	Preserve	Triplet
38	Crimson Bottlebrush	*Callistemon citrinus*	8	Preserve	
39	Crimson Bottlebrush	*Callistemon citrinus*	6	Preserve	Multi-leader
40	Christmas Palm	*Veitchia merillii*	9'	Preserve	Quad
41	Christmas Palm	*Veitchia merillii*	10'	Preserve	Double
42	Christmas Palm	*Veitchia merillii*	10'	Preserve	Double
43	Crimson Bottlebrush	*Callistemon citrinus*	10	Remove	Multi-leader
44	Crimson Bottlebrush	*Callistemon citrinus*	11	Remove	Multi-leader
45	Crimson Bottlebrush	*Callistemon citrinus*	7	Remove	Multi-leader
46	Christmas Palm	*Veitchia merillii*	8'	Remove	Double
47	Sabal Palm	*Sabal palmetto*	18'	Preserve	
48	Sabal Palm	*Sabal palmetto*	16'	Preserve	
49	Sabal Palm	*Sabal palmetto*	12'	Preserve	
50	Sabal Palm	*Sabal palmetto*	12'	Preserve	
51	Sabal Palm	*Sabal palmetto*	18'	Preserve	
52	Sabal Palm	*Sabal palmetto*	10'	Preserve	
53	Sabal Palm	*Sabal palmetto*	22'	Preserve	
54	Sabal Palm	*Sabal palmetto*	16'	Remove	
55	Sabal Palm	*Sabal palmetto*	18'	Preserve	
56	Sabal Palm	*Sabal palmetto*	18'	Preserve	
57	Sabal Palm	*Sabal palmetto*	12'	Preserve	
58	Sabal Palm	*Sabal palmetto*	12'	Preserve	
59	Sabal Palm	*Sabal palmetto*	12'	Preserve	
60	Sabal Palm	*Sabal palmetto*	12'	Preserve	
61	Sabal Palm	*Sabal palmetto*	14'	Preserve	
62	Sabal Palm	*Sabal palmetto*	18'	Preserve	
63	Sabal Palm	*Sabal palmetto*	16'	Preserve	
64	Sabal Palm	*Sabal palmetto*	20'	Preserve	
65	Sabal Palm	*Sabal palmetto*	18'	Preserve	
66	Sabal Palm	*Sabal palmetto*	25'	Preserve	
67	Sabal Palm	*Sabal palmetto*	17'	Preserve	
68	Sabal Palm	*Sabal palmetto*	18'	Preserve	
69	Sabal Palm	*Sabal palmetto*	16'	Preserve	
70	Sabal Palm	*Sabal palmetto*	10'	Preserve	
71	Sabal Palm	*Sabal palmetto*	16'	Preserve	
72	Sabal Palm	*Sabal palmetto*	18'	Preserve	
73	Sabal Palm	*Sabal palmetto*	12'	Preserve	
74	Sabal Palm	*Sabal palmetto*	18'	Preserve	
75	Sabal Palm	*Sabal palmetto*	16'	Preserve	
76	Sabal Palm	*Sabal palmetto*	12'	Preserve	
77	Sabal Palm	*Sabal palmetto*	10'	Preserve	
78	Sabal Palm	*Sabal palmetto*	16'	Preserve	
79	Sabal Palm	*Sabal palmetto*	20'	Preserve	
80	Sabal Palm	*Sabal palmetto*	12'	Preserve	
81	Sabal Palm	*Sabal palmetto*	10'	Preserve	
82	Sabal Palm	*Sabal palmetto*	18'	Preserve	
83	Sabal Palm	*Sabal palmetto*	18'	Preserve	
84	Sabal Palm	*Sabal palmetto*	18'	Preserve	
85	Sabal Palm	*Sabal palmetto*	16'	Preserve	
86	Sabal Palm	*Sabal palmetto*	18'	Preserve	
87	Sabal Palm	*Sabal palmetto*	18'	Preserve	
88	Sabal Palm	*Sabal palmetto*	16'	Preserve	
89	Sabal Palm	*Sabal palmetto*	16'	Preserve	
90	Sabal Palm	*Sabal palmetto*	18'	Preserve	
91	Sabal Palm	*Sabal palmetto*	12'	Preserve	
92	Sabal Palm	*Sabal palmetto*	12'	Preserve	
93	Sabal Palm	*Sabal palmetto*	16'	Preserve	
94	Sabal Palm	*Sabal palmetto*	12'	Preserve	
95	Sabal Palm	*Sabal palmetto*	16'	Preserve	
96	Sabal Palm	*Sabal palmetto*	16'	Preserve	
97	Sabal Palm	*Sabal palmetto*	18'	Preserve	
98	Sabal Palm	*Sabal palmetto*	18'	Preserve	
99	Sabal Palm	*Sabal palmetto*	18'	Preserve	
100	Sabal Palm	*Sabal palmetto*	16'	Preserve	
101	Sabal Palm	*Sabal palmetto*	18'	Preserve	
102	Sabal Palm	*Sabal palmetto*	18'	Preserve	
103	Sabal Palm	*Sabal palmetto*	18'	Preserve	
104	Sabal Palm	*Sabal palmetto*	20'	Preserve	
105	Sabal Palm	*Sabal palmetto*	20'	Preserve	
106	Sabal Palm	*Sabal palmetto*	7'	Preserve	
107	Sabal Palm	*Sabal palmetto*	10'	Preserve	
108	Sabal Palm	*Sabal palmetto*	12'	Preserve	
109	Sabal Palm	*Sabal palmetto*	17'	Preserve	
110	Sabal Palm	*Sabal palmetto*	16'	Preserve	
111	Sabal Palm	*Sabal palmetto*	16'	Preserve	
112	Sabal Palm	*Sabal palmetto*	15'	Preserve	
113	Sabal Palm	*Sabal palmetto*	18'	Preserve	
114	Sabal Palm	*Sabal palmetto*	12'	Preserve	
115	Sabal Palm	*Sabal palmetto*	20'	Preserve	
116	Sabal Palm	*Sabal palmetto*	16'	Preserve	
117	Sabal Palm	*Sabal palmetto*	18'	Preserve	
118	Sabal Palm	*Sabal palmetto*	20'	Preserve	
119	Sabal Palm	*Sabal palmetto*	20'	Preserve	
120	Sabal Palm	*Sabal palmetto*	18'	Preserve	
121	Coconut Palm	*Cocos nucifera*	25'	Preserve	
122	Coconut Palm	*Cocos nucifera*	20'	Preserve	
123	Coconut Palm	*Cocos nucifera*	22'	Preserve	
124	Sabal Palm	*Sabal palmetto*	20'	Preserve	
125	Sabal Palm	*Sabal palmetto*	18'	Preserve	
126	Sabal Palm	*Sabal palmetto*	20'	Preserve	
127	Sabal Palm	*Sabal palmetto*	10'	Preserve	
128	Sabal Palm	*Sabal palmetto*	12'	Preserve	
129	Sabal Palm	*Sabal palmetto*	16'	Preserve	
130	Sabal Palm	*Sabal palmetto*	16'	Preserve	
131	Sabal Palm	*Sabal palmetto*	12'	Preserve	
132	Sabal Palm	*Sabal palmetto*	14'	Preserve	
133	Sabal Palm	*Sabal palmetto*	12'	Preserve	
134	Sabal Palm	*Sabal palmetto*	18'	Preserve	
135	Sabal Palm	*Sabal palmetto*	10'	Preserve	
136	Sabal Palm	*Sabal palmetto*	12'	Preserve	
137	Sabal Palm	*Sabal palmetto*	18'	Preserve	
138	Sabal Palm	*Sabal palmetto*	16'	Preserve	
139	Sabal Palm	*Sabal palmetto*	22'	Preserve	
140	Sabal Palm	*Sabal palmetto*	22'	Preserve	
141	Sabal Palm	*Sabal palmetto*	22'	Preserve	
142	Sabal Palm	*Sabal palmetto*	10'	Preserve	
143	Sabal Palm	*Sabal palmetto*	12'	Preserve	
144	Sabal Palm	*Sabal palmetto*	12'	Preserve	
145	Sabal Palm	*Sabal palmetto*	14'	Preserve	
146	Sabal Palm	*Sabal palmetto*	18'	Preserve	
147	Sabal Palm	*Sabal palmetto*	20'	Preserve	
148	Sabal Palm	*Sabal palmetto*	19'	Preserve	
149	Sabal Palm	*Sabal palmetto*	20'	Preserve	
150	Sabal Palm	*Sabal palmetto*	20'	Preserve	
151	Sabal Palm	*Sabal palmetto*	20'	Preserve	
152	Sabal Palm	*Sabal palmetto*	20'	Preserve	
153	Sabal Palm	*Sabal palmetto*	22'	Preserve	
154	Sabal Palm	*Sabal palmetto*	20'	Preserve	
155	Sabal Palm	*Sabal palmetto*	20'	Preserve	
156	Bird of Paradise	*Strelitzia nicolai*	5	Preserve	Cluster
157	Foxtail Palm	*Wodyetia bifurcata*	18'	Preserve	
158	Alexander Palm	*Archontophoenix alexandrae*	12'	Preserve	
159	Areca Palm	*Dypsis lutescens*		Preserve	Cluster
160	Sabal Palm	*Sabal palmetto*	20'	Preserve	
161	Sabal Palm	*Sabal palmetto*	20'	Preserve	
162	Sabal Palm	*Sabal palmetto*	9'	Remove	
163	Sabal Palm	*Sabal palmetto*	25'	Remove	
164	Sabal Palm	*Sabal palmetto*	22'	Remove	
165	Sabal Palm	*Sabal palmetto*	22'	Remove	
166	Sabal Palm	*Sabal palmetto*	22'	Remove	
167	Sabal Palm	*Sabal palmetto*	22'	Remove	
168	Areca Palm	*Dypsis lutescens*		Remove	Cluster
169	Weeping Fig	*Ficus benjamina*	4	Preserve	Hedge
170	Sabal Palm	*Sabal palmetto*	18'	Preserve	
171	Sabal Palm	*Sabal palmetto*	18'	Preserve	
172	Sabal Palm	*Sabal palmetto*	16	Preserve	
173	Sabal Palm	*Sabal palmetto*	18'	Preserve	
174	Sabal Palm	*Sabal palmetto*	18'	Preserve	
175	Alexander Palm	*Archontophoenix alexandrae*	22'	Preserve	Double
176	Weeping Fig	*Ficus benjamina*	5	Preserve	Hedge
177	Alexander Palm	*Archontophoenix alexandrae*	14'	Preserve	
178	Sabal Palm	*Sabal palmetto*	22'	Preserve	
179	Sabal Palm	*Sabal palmetto*	20'	Preserve	
180	Sabal Palm	*Sabal palmetto*	18'	Preserve	
181	Sabal Palm	*Sabal palmetto*	18'	Preserve	
182	Sabal Palm	*Sabal palmetto*	18'	Preserve	
183	Sabal Palm	*Sabal palmetto*	18'	Preserve	
184	Sabal Palm	*Sabal palmetto*	18'	Preserve	
185	Alexander Palm	*Archontophoenix alexandrae*	9'	Preserve	Triplet
186	Yellow Tabebuia	*Tabebuia sp.*		Preserve	Tabebuia
187	Sabal Palm	*Sabal palmetto*	18'	Remove	
188	Sabal Palm	*Sabal palmetto*	18'	Remove	
189	Sabal Palm	*Sabal palmetto*	16'	Remove	
190	Sabal Palm	*Sabal palmetto*	20'	Remove	
191	Sabal Palm	*Sabal palmetto*	20'	Remove	
192	Sabal Palm	*Sabal palmetto*	20'	Remove	
193	Sabal Palm	*Sabal palmetto*	18'	Remove	
194	Sabal Palm	*Sabal palmetto*	18'	Remove	
195	Sabal Palm	*Sabal palmetto*	18'	Remove	
196	Sabal Palm	*Sabal palmetto*	20'	Remove	
197	Sabal Palm	*Sabal palmetto*	17'	Remove	
198	Sabal Palm	*Sabal palmetto*	18'	Remove	
199	Sabal Palm	*Sabal palmetto*	22'	Remove	
200	Sabal Palm	*Sabal palmetto*	22'	Remove	
201	Sabal Palm	*Sabal palmetto*	18'	Remove	
202	Sabal Palm	*Sabal palmetto*	18'	Remove	
203	Sabal Palm	*Sabal palmetto*	18'	Remove	
204	Sabal Palm	*Sabal palmetto*	18'	Remove	
205	Sabal Palm	*Sabal palmetto*	19'	Remove	
206	Sabal Palm	*Sabal palmetto*	16'	Remove	
207	Sabal Palm	*Sabal palmetto*	16'	Remove	
208	Sabal Palm	*Sabal palmetto*	16'	Remove	
210	Sabal Palm	*Sabal palmetto*	18'	Remove	
211	Sabal Palm	*Sabal palmetto*	18'	Remove	
212	Sabal Palm	*Sabal palmetto*	18'	Remove	
213	Sabal Palm	*Sabal palmetto*	18'	Remove	
214	Sabal Palm	*Sabal palmetto*	16'	Remove	
215	Sabal Palm	*Sabal palmetto*	24'	Remove	
216	Sabal Palm	*Sabal palmetto*	20'	Remove	
217	Sabal Palm	*Sabal palmetto*	22'	Remove	
218	Sabal Palm	*Sabal palmetto*	16'	Remove	
219	Sabal Palm	*Sabal palmetto*	16'	Remove	
220	Sabal Palm	*Sabal palmetto*	16'	Remove	
221	Sabal Palm	*Sabal palmetto*	18'	Remove	
222	Sabal Palm	*Sabal palmetto*	18'	Remove	
223	Sabal Palm	*Sabal palmetto*	18'	Remove	
224	Sabal Palm	*Sabal palmetto*	20'	Preserve	
225	Sabal Palm	*Sabal palmetto*	12'	Preserve	
226	Sabal Palm	*Sabal palmetto*	20'	Preserve	
227	Sabal Palm	*Sabal palmetto*	20'	Preserve	
228	Royal Palm	*Roystonea sp*	25'	Preserve	
229	Royal Palm	*Roystonea sp*	25'	Preserve	
230	Sabal Palm	*Sabal palmetto*	20'	Preserve	
231	Sabal Palm	*Sabal palmetto*	16'	Preserve	
232	Sabal Palm	*Sabal palmetto*	16'	Preserve	
234	Sabal Palm	*Sabal palmetto*	18'	Preserve	
235	Sabal Palm	*Sabal palmetto*	22'	Preserve	
236	Sabal Palm	*Sabal palmetto*	18'	Preserve	
237	Sabal Palm	*Sabal palmetto*	18'	Preserve	
238	Royal Palm	*Roystonea sp*	30'	Preserve	
239	Royal Palm	*Roystonea sp*	30'	Preserve	
240	Royal Palm	*Roystonea sp*	28'	Preserve	
241	Sabal Palm	*Sabal palmetto*	18'	Preserve	
242	Sabal Palm	*Sabal palmetto*	18'	Preserve	
243	Sabal Palm	*Sabal palmetto*	18'	Preserve	
244	Sabal Palm	*Sabal palmetto*	18'	Preserve	
245	Sabal Palm	*Sabal palmetto*	18'	Remove	
246	Sabal Palm	*Sabal palmetto*	18'	Remove	
247	Sabal Palm	*Sabal palmetto*	18'	Remove	
248	Alexander Palm	*Archontophoenix alexandrae*	20'	Remove	Double
249	Sabal Palm	*Sabal palmetto*	16'	Remove	
250	Sabal Palm	*Sabal palmetto*	16'	Remove	
251	Sabal Palm	*Sabal palmetto*	16'	Remove	
252	Sabal Palm	*Sabal palmetto*	16'	Remove	
253	Sabal Palm	*Sabal palmetto*	16'	Remove	
254	Sabal Palm	*Sabal palmetto*	18'	Remove	
255	Sabal Palm	*Sabal palmetto*	18'	Remove	
256	Sabal Palm	*Sabal palmetto*	18'	Remove	
257	Sabal Palm	*Sabal palmetto*	18'	Remove	
258	Sabal Palm	*Sabal palmetto*	18'	Remove	
259	Sabal Palm	*Sabal palmetto*	12'	Remove	
260	Sabal Palm	*Sabal palmetto*	12'	Remove	
261	Sabal Palm	*Sabal palmetto*	14'	Remove	
262	Sabal Palm	*Sabal palmetto*	16'	Remove	
263	Royal Palm	*Roystonea sp*	18'	Remove	
264	Sabal Palm	*Sabal palmetto*	18'	Remove	
265	Sabal Palm	*Sabal palmetto*	12'	Remove	
266	Sabal Palm	*Sabal palmetto*	20'	Remove	
267	Sabal Palm	*Sabal palmetto*	14'	Remove	
268	Sabal Palm	*Sabal palmetto*	18'	Remove	
269	Sabal Palm	*Sabal palmetto*	20'	Remove	
270	Sabal Palm	*Sabal palmetto*	20'	Remove	
271	Sabal Palm	*Sabal palmetto*	14'	Remove	
272	Sabal Palm	*Sabal palmetto*	18'	Remove	
273	Sabal Palm	*Sabal palmetto*	18'	Remove	
274	Sabal Palm	*Sabal palmetto*	20'	Remove	
275	Sabal Palm	*Sabal palmetto*	20'	Remove	
276	Sabal Palm	*Sabal palmetto*	20'	Remove	
277	Sabal Palm	*Sabal palmetto*	14'	Remove	
278	Sabal Palm	*Sabal palmetto*	17'	Remove	
279	Sabal Palm	*Sabal palmetto*	14'	Remove	
280	Sabal Palm	*Sabal palmetto*	16'	Remove	
281	Sabal Palm	*Sabal palmetto*	16'	Remove	
282	Sabal Palm	*Sabal palmetto*	18'	Remove	
283	Sabal Palm	*Sabal palmetto*	16'	Remove	
284	Sabal Palm	*Sabal palmetto*	12'	Remove	
285	Queen Palm	*Syagrus romanzoffiana*	14'	Preserve	
286	Queen Palm	*Syagrus romanzoffiana*	18'	Preserve	
287	Sabal Palm	*Sabal palmetto*	12'	Preserve	
288	Sabal Palm	*Sabal palmetto*	20'	Preserve	
289	Sabal Palm	*Sabal palmetto*	22'	Preserve	
290	Sabal Palm	*Sabal palmetto*	18'	Preserve	
291	Sabal Palm	*Sabal palmetto*	22'	Preserve	
292	Sabal Palm	*Sabal palmetto*	16'	Preserve	
293	Sabal Palm	*Sabal palmetto*	16'	Preserve	
294	Sabal Palm	*Sabal palmetto*	22'	Preserve	
295	Sabal Palm	*Sabal palmetto*	22'	Preserve	
296	Sabal Palm	*Sabal palmetto*	22'	Preserve	
297	Areca Palm	*Dypsis lutescens*		Preserve	Cluster
298	Areca Palm	*Dypsis lutescens*		Remove	Cluster
299	Areca Palm	*Dypsis lutescens*		Remove	Cluster
300	Sabal Palm	*Sabal palmetto*	25'	Remove	
301	Sabal Palm	*Sabal palmetto*	25'	Remove	
302	Sabal Palm	*Sabal palmetto*	20'	Remove	
303	Sabal Palm	*Sabal palmetto*	22'	Remove	
304	Sabal Palm	*Sabal palmetto*	22'	Remove	
305	Sabal Palm	*Sabal palmetto*	22'	Remove	
306	Sabal Palm	*Sabal palmetto*	18'	Remove	
307	Sabal Palm	*Sabal palmetto*	18'	Remove	
308	Royal Palm	*Roystonea sp*	22'	Remove	
309	Sabal Palm	*Sabal palmetto*	16'	Remove	
310	Sabal Palm	*Sabal palmetto*	16'	Remove	
311	Sabal Palm	*Sabal palmetto*	16'	Remove	
312	Sylvester Palm	*Phoenix sylvestris*	16'	Remove	Palm
313	Royal Palm	*Roystonea sp*	30'	Preserve	
314	Royal Palm	*Roystonea sp*	30'	Preserve	
315	Royal Palm	*Roystonea sp*	30'	Preserve	
316	Royal Palm	*Roystonea sp*	30'	Preserve	
317	Sylvester Palm	*Phoenix sylvestris*	20'	Preserve	Palm
318	Royal Palm	*Roystonea sp*	35'	Preserve	
319	Royal Palm	*Roystonea sp*	25'	Preserve	
320	Sabal Palm	*Sabal palmetto*	18'	Preserve	
321	Sabal Palm	*Sabal palmetto*	20'	Preserve	
322	Sabal Palm	*Sabal palmetto*	18'	Preserve	
323	Sabal Palm	*Sabal palmetto*	16'	Preserve	
324	Royal Palm	*Roystonea sp*	25'	Preserve	Top rotted
325	Sabal Palm	*Sabal palmetto*	22'	Preserve	
326	Sabal Palm	*Sabal palmetto*	18'	Preserve	
327	Sabal Palm	*Sabal palmetto*	18'	Preserve	
328	Sabal Palm	*Sabal palmetto*	18'	Preserve	
329	Sabal Palm	*Sabal palmetto*	18'	Preserve	
330	Sabal Palm	*Sabal palmetto*	18'	Preserve	
331	Sabal Palm	*Sabal palmetto*	16'	Preserve	
332	Sabal Palm	*Sabal palmetto*	16'	Preserve	
333	Sabal Palm	*Sabal palmetto*	18'	Remove	
334	Sabal Palm	*Sabal palmetto*	18'	Remove	
335	Sabal Palm	*Sabal palmetto*	18'	Remove	
336	Sabal Palm	*Sabal palmetto*	18'	Remove	
337	Sabal Palm	*Sabal palmetto*	18'	Remove	
338	Sabal Palm	*Sabal palmetto*	18'	Remove	
340	Sabal Palm	*Sabal palmetto*	18'	Remove	
341	Sabal Palm	*Sabal palmetto*	18'	Remove	
342	Sabal Palm	*Sabal palmetto*	18'	Preserve	
343	Sabal Palm	*Sabal palmetto*	18'	Remove	
344	Sabal Palm	*Sabal palmetto*	22'	Preserve	
345	Sabal Palm	*Sabal palmetto*	20'	Preserve	
346	Washingtonia Palm	*Washingtonia sp.*	20'	Remove	Palm
347	Washingtonia Palm	*Washingtonia sp.*	20'	Preserve	Palm
348	Washingtonia Palm	*Washingtonia sp.*	18'	Preserve	Palm
349	Washingtonia Palm	*Washingtonia sp.*	20'	Preserve	Palm
350	Washingtonia Palm	*Washingtonia sp.*	25'	Remove	Palm

*All palms are measured in feet to clear trunk

WGI
2035 Vista Parkway, West Palm Beach, FL 33411
Phone No. 866.909.2220 www.wginc.com
Cert No. 6091 - LB No. 7055

NOT AUTHORIZED FOR CONSTRUCTION PRIOR TO FORMAL TOWN APPROVAL

NO	DATE	DESCRIPTION	BY
1	2/04/2025	SITE PLAN AMENDMENT	CKW
2	7/31/2025	SITE PLAN AMENDMENT	CKW
3	10/6/2025	SITE PLAN AMENDMENT	

REVISIONS

CAD 2920.04_LD.DWG	
JOB NO.	2920.04
DRAWN BY	CKW
CHECK BY	YM
DATE	10/06/2025

LANDSCAPE ARCHITECT OF RECORD
COREY A. KISSELL WONG, PLA
FL # LA6667017

REGISTERED LANDSCAPE ARCHITECT
COREY A. KISSELL WONG
LA 6667017
STATE OF FLORIDA

THE WATERFORD
601 UNIVERSE BOULEVARD
JUNO BEACH, FL
TREE DISPOSITION LIST

SHEET:
LD-2.00

Corey Kissell Wong P:\2900\2920.04 Waterford Campus Redev\LA\Drawings\Landscape\2920.04_LD.dwg — Plotted: 10/6/2025 3:04:38 PM Saved: 10/6/2025 12:20:10 PM

351	Sabal Palm	*Sabal palmetto*	20'	Remove	
352	Sabal Palm	*Sabal palmetto*	20'	Remove	
353	Sabal Palm	*Sabal palmetto*	20'	Remove	
354	Sabal Palm	*Sabal palmetto*	20'	Remove	
355	Sabal Palm	*Sabal palmetto*	25'	Preserve	
356	Sabal Palm	*Sabal palmetto*	18'	Preserve	
357	Sabal Palm	*Sabal palmetto*	18'	Preserve	
358	Sabal Palm	*Sabal palmetto*	20'	Preserve	
359	Sabal Palm	*Sabal palmetto*	20'	Preserve	
360	Sabal Palm	*Sabal palmetto*	20'	Preserve	
361	Royal Palm	*Roystonea sp*	30'	Preserve	
362	Live Oak	*Quercus virginiana*	11	Preserve	
363	Queen Palm	*Syagrus romanzoffiana*	30'	Preserve	
364	Queen Palm	*Syagrus romanzoffiana*	30'	Preserve	
365	Queen Palm	*Syagrus romanzoffiana*	30'	Preserve	
366	Queen Palm	*Syagrus romanzoffiana*	30'	Preserve	
367	Coconut Palm	*Cocos nucifera*	18'	Preserve	
368	Coconut Palm	*Cocos nucifera*	18'	Preserve	
369	Coconut Palm	*Cocos nucifera*	22'	Preserve	
370	Coconut Palm	*Cocos nucifera*	22'	Preserve	
371	Live Oak	*Quercus virginiana*	8	Preserve	
372	Mango Tree	*Mangifera indica*	10	Remove	
373	Sabal Palm	*Sabal palmetto*	20'	Preserve	
374	Sabal Palm	*Sabal palmetto*	20'	Preserve	
375	Sabal Palm	*Sabal palmetto*	20'	Preserve	
376	Fishtail Palm	*Caryota sp.*	16'	Preserve	
377	Sabal Palm	*Sabal palmetto*	25'	Preserve	
378	Fishtail Palm	*Caryota sp.*	18'	Preserve	
379	Sabal Palm	*Sabal palmetto*	25'	Preserve	
380	Fishtail Palm	*Caryota sp.*	18'	Preserve	
381	Fishtail Palm	*Caryota sp.*	18'	Preserve	
382	Royal Palm	*Roystonea sp*	18'	Preserve	Poor condition
383	Laurel Oak	*Quercus laurifolia*	8	Preserve	
384	Sabal Palm	*Sabal palmetto*	18'	Preserve	
385	Sabal Palm	*Sabal palmetto*	18'	Preserve	
386	Coconut Palm	*Cocos nucifera*	20'	Preserve	
387	Coconut Palm	*Cocos nucifera*	22'	Preserve	
388	Sabal Palm	*Sabal palmetto*	20'	Preserve	
389	Coconut Palm	*Cocos nucifera*	30'	Preserve	
390	Coconut Palm	*Cocos nucifera*	30'	Preserve	
391	Coconut Palm	*Cocos nucifera*	30'	Preserve	
392	Royal Palm	*Roystonea sp*	18'	Preserve	
393	Royal Palm	*Roystonea sp*	20'	Preserve	
394	Royal Palm	*Roystonea sp*	20'	Preserve	
395	Queen Palm	*Syagrus romanzoffiana*	25'	Preserve	
396	Royal Palm	*Roystonea sp*	12'	Preserve	
397	Alexander Palm	*Archontophoenix alexandrae*	20'	Preserve	Double
398	Royal Palm	*Roystonea sp*	18'	Preserve	
399	Royal Palm	*Roystonea sp*	18'	Preserve	
400	Royal Palm	*Roystonea sp*	18'	Preserve	
401	Queen Palm	*Syagrus romanzoffiana*	24'	Preserve	
402	Coconut Palm	*Cocos nucifera*	25'	Preserve	
403	Coconut Palm	*Cocos nucifera*	25'	Preserve	
404	Coconut Palm	*Cocos nucifera*	25'	Preserve	
405	Royal Palm	*Roystonea sp*	18'	Preserve	
406	Royal Palm	*Roystonea sp*	18'	Preserve	
407	Sylvester Palm	*Phoenix sylvestris*	20'	Preserve	Palm
408	Royal Palm	*Roystonea sp*	20'	Preserve	
409	Alexander Palm	*Archontophoenix alexandrae*	25'	Preserve	Double
410	Royal Palm	*Roystonea sp*	20'	Preserve	
411	Royal Palm	*Roystonea sp*	20'	Preserve	
412	Royal Palm	*Roystonea sp*	20'	Preserve	
413	Queen Palm	*Syagrus romanzoffiana*	22'	Preserve	
414	Royal Palm	*Roystonea sp*	20'	Preserve	
415	Royal Palm	*Roystonea sp*	18'	Preserve	
416	Areca Palm	*Dypsis lutescens*		Preserve	Cluster
417	Areca Palm	*Dypsis lutescens*		Preserve	Cluster
418	Sabal Palm	*Sabal palmetto*	20'	Remove	
419	Sabal Palm	*Sabal palmetto*	20'	Preserve	
420	Black Olive	*Bucida buceras*	26	Preserve	
421	Black Olive	*Bucida buceras*	24	Preserve	
422	Fishtail Palm	*Caryota sp.*	9'	Preserve	Cluster
423	Sabal Palm	*Sabal palmetto*	20'	Preserve	
424	Sabal Palm	*Sabal palmetto*	20'	Preserve	
425	Sabal Palm	*Sabal palmetto*	20'	Preserve	
426	Areca Palm	*Dypsis lutescens*		Preserve	Cluster
427	Pink Tabebuia	*Tabebuia sp.*	9	Preserve	
428	Cassia	*Cassia fistula*	11	Preserve	Trk split/dam
429	Pink Tabebuia	*Tabebuia sp.*	9	Preserve	
430	Pink Tabebuia	*Tabebuia sp.*	7	Preserve	
431	Live Oak	*Quercus virginiana*	27	Preserve	
432	Live Oak	*Quercus virginiana*	27	Preserve	
433	Live Oak	*Quercus virginiana*	21	Preserve	
434	Live Oak	*Quercus virginiana*	26	Preserve	
435	Live Oak	*Quercus virginiana*	24	Preserve	damaged
436	Live Oak	*Quercus virginiana*	21	Preserve	
437	Senegal Date Palm	*Phoenix reclinata*	25'	Remove	Palm
438	Live Oak	*Quercus virginiana*	24	Preserve	
439	Queen Palm	*Syagrus romanzoffiana*	20'	Preserve	
440	Queen Palm	*Syagrus romanzoffiana*	20'	Preserve	
441	Queen Palm	*Syagrus romanzoffiana*	20'	Preserve	
442	Viburnum Sp.	*Viburnum Sp.*	4	Preserve	Sp.
443	Viburnum Sp.	*Viburnum Sp.*	5	Preserve	Sp.
444	Ficus	*Ficus sp.*	5	Preserve	
445	Viburnum Sp.	*Viburnum Sp.*	5	Preserve	Sp.
446	Laurel Oak	*Quercus laurifolia*	4	Preserve	
447	Ficus	*Ficus sp.*	5	Preserve	
448	Live Oak	*Quercus virginiana*	14	Remove	
449	Crimson Bottlebrush	*Callistemon citrinus*	6	Preserve	
450	Live Oak	*Quercus virginiana*	25	Preserve	
451	Live Oak	*Quercus virginiana*	24	Preserve	
452	Sabal Palm	*Sabal palmetto*	20'	Preserve	
453	Sabal Palm	*Sabal palmetto*	22'	Preserve	
454	Sabal Palm	*Sabal palmetto*	20'	Preserve	
455	Sabal Palm	*Sabal palmetto*	24'	Preserve	
456	Sabal Palm	*Sabal palmetto*	25'	Preserve	
457	Sabal Palm	*Sabal palmetto*	26'	Preserve	
458	Tibouchina	*Tibouchinas sp.*	4	Preserve	Tibouchina
459	Christmas Palm	*Veitchia merillii*	8'	Remove	Double
460	Avocado	*Persea americana*	8	Preserve	
461	Sabal Palm	*Sabal palmetto*	16'	Preserve	
462	Sabal Palm	*Sabal palmetto*	16'	Preserve	
463	Christmas Palm	*Veitchia merillii*	9'	Preserve	Triplet
464	Sabal Palm	*Sabal palmetto*	22'	Preserve	
465	Sabal Palm	*Sabal palmetto*	18'	Preserve	

466	Live Oak	*Quercus virginiana*	10	Preserve	
467	Pink Tabebuia	*Tabebuia sp.*	10	Preserve	
468	Jatropha	*Jatropha intergerrima*	5	Preserve	
469	Jatropha	*Jatropha intergerrima*	5	Preserve	
470	Jatropha	*Jatropha intergerrima*	4	Preserve	
471	Pink Tabebuia	*Tabebuia sp.*	9	Preserve	
472	Pink Tabebuia	*Tabebuia sp.*	9	Preserve	
473	Live Oak	*Quercus virginiana*	14	Preserve	
474	Jatropha	*Jatropha intergerrima*	4	Preserve	
475	Jatropha	*Jatropha intergerrima*	5	Preserve	
476	Jatropha	*Jatropha intergerrima*	6	Preserve	
477	Jatropha	*Jatropha intergerrima*	5	Preserve	
478	Plumeria	*Plumeria sp.*	6	Preserve	
479	Crimson Bottlebrush	*Callistemon citrinus*	6	Preserve	
480	Crimson Bottlebrush	*Callistemon citrinus*	10	Preserve	
481	Live Oak	*Quercus virginiana*	22	Preserve	
482	Live Oak	*Quercus virginiana*	25	Preserve	
483	Live Oak	*Quercus virginiana*	21	Preserve	
484	Live Oak	*Quercus virginiana*	14	Preserve	
485	Live Oak	*Quercus virginiana*	15	Preserve	
486	Live Oak	*Quercus virginiana*	11	Preserve	
487	Live Oak	*Quercus virginiana*	13	Preserve	
488	Laurel Oak	*Quercus laurifolia*	31	Remove	
489	Live Oak	*Quercus virginiana*	16	Remove	
490	Live Oak	*Quercus virginiana*	20	Remove	
491	Live Oak	*Quercus virginiana*	18	Remove	
492	Pongam Tree	*Millettia pinnata*	20	Remove	
493	Live Oak	*Quercus virginiana*	6	Relocate	
494	Live Oak	*Quercus virginiana*	10	Relocate	
495	Live Oak	*Quercus virginiana*	11	Relocate	
496	Live Oak	*Quercus virginiana*	12	Relocate	
497	Live Oak	*Quercus virginiana*	18	Remove	
498	Gumbo Limbo	*Bursera simaruba*	19	Remove	
499	Royal Poinciana	*Delonix regia*	14'	Preserve	
500	Gumbo Limbo	*Bursera simaruba*	25	Preserve	
501	Pongam Tree	*Millettia pinnata*	8	Preserve	
502	Pongam Tree	*Millettia pinnata*	26	Remove	
503	Gumbo Limbo	*Bursera simaruba*	11	Remove	
504	Live Oak	*Quercus virginiana*	5	Remove	
505	Black Olive	*Bucida buceras*	22	Remove	
506	Black Olive	*Bucida buceras*	22	Remove	
507	Mahogany	*Swietenia mahagoni*	23	Remove	
508	Gumbo Limbo	*Bursera simaruba*	15	Remove	
509	Live Oak	*Quercus virginiana*	15	Remove	
510	Live Oak	*Quercus virginiana*	16	Remove	
511	Live Oak	*Quercus virginiana*	10	Preserve	
512	Live Oak	*Quercus virginiana*	12	Preserve	
513	Live Oak	*Quercus virginiana*	9	Preserve	
514	Mahogany	*Swietenia mahagoni*	20	Remove	
515	Mahogany	*Swietenia mahagoni*	15	Remove	
516	Live Oak	*Quercus virginiana*	19	Remove	
517	Live Oak	*Quercus virginiana*	11	Relocate	
518	Gumbo Limbo	*Bursera simaruba*	7	Relocate	
519	Mahogany	*Swietenia mahagoni*	11	Remove	
520	Live Oak	*Quercus virginiana*	15	Remove	
521	Bischofia	*Bischofia javonica*	13	Preserve	
522	Bischofia	*Bischofia javonica*	12	Preserve	
523	Bischofia	*Bischofia javonica*	17	Preserve	
524	Bischofia	*Bischofia javonica*	17	Preserve	
525	Bischofia	*Bischofia javonica*	10	Preserve	
526	Magnolia	*Magnolia grandiflora*	7	Preserve	
527	Sabal Palm	*Sabal palmetto*	16'	Remove	
528	Sabal Palm	*Sabal palmetto*	18'	Remove	
529	Sabal Palm	*Sabal palmetto*	18'	Remove	
530	Sabal Palm	*Sabal palmetto*	22'	Preserve	
531	Sabal Palm	*Sabal palmetto*	22'	Preserve	
532	Sabal Palm	*Sabal palmetto*	22'	Preserve	
533	Sabal Palm	*Sabal palmetto*	20'	Preserve	
534	Sabal Palm	*Sabal palmetto*	20'	Preserve	
535	Sabal Palm	*Sabal palmetto*	20'	Preserve	
536	Pongam Tree	*Millettia pinnata*	16	Preserve	
537	Sabal Palm	*Sabal palmetto*	20'	Preserve	
538	Sabal Palm	*Sabal palmetto*	20'	Preserve	
539	Sabal Palm	*Sabal palmetto*	20'	Preserve	
540	Sabal Palm	*Sabal palmetto*	18'	Preserve	
541	Sabal Palm	*Sabal palmetto*	20'	Preserve	
542	Sabal Palm	*Sabal palmetto*	18'	Preserve	
543	Sabal Palm	*Sabal palmetto*	18'	Preserve	
544	Sabal Palm	*Sabal palmetto*	20'	Preserve	
545	Sabal Palm	*Sabal palmetto*	20'	Preserve	
546	Sabal Palm	*Sabal palmetto*	20'	Preserve	
547	Pongam Tree	*Millettia pinnata*	16	Preserve	
548	Sabal Palm	*Sabal palmetto*	20'	Preserve	
549	Sabal Palm	*Sabal palmetto*	20'	Preserve	
550	Sabal Palm	*Sabal palmetto*	20'	Preserve	
551	Sabal Palm	*Sabal palmetto*	20'	Preserve	
552	Sabal Palm	*Sabal palmetto*	22'	Preserve	
553	Sabal Palm	*Sabal palmetto*	22'	Preserve	
554	Sabal Palm	*Sabal palmetto*	18'	Preserve	
555	Sabal Palm	*Sabal palmetto*	18'	Preserve	
556	Sabal Palm	*Sabal palmetto*	18'	Preserve	
557	Sabal Palm	*Sabal palmetto*	18'	Preserve	
558	Sabal Palm	*Sabal palmetto*	18'	Preserve	
559	Sabal Palm	*Sabal palmetto*	18'	Preserve	
560	Live Oak	*Quercus virginiana*	16	Preserve	
561	Live Oak	*Quercus virginiana*	17	Preserve	
562	Live Oak	*Quercus virginiana*	13	Preserve	
563	Pongam Tree	*Millettia pinnata*	15	Preserve	
564	Areca Palm	*Dypsis lutescens*		Preserve	Cluster
565	Areca Palm	*Dypsis lutescens*		Preserve	Cluster
566	Pongam Tree	*Millettia pinnata*	15	Preserve	
567	Alexander Palm	*Archontophoenix alexandrae*	22'	Remove	
568	Alexander Palm	*Archontophoenix alexandrae*	22'	Remove	
569	Alexander Palm	*Archontophoenix alexandrae*	22'	Remove	
570	Alexander Palm	*Archontophoenix alexandrae*	22'	Remove	
571	Alexander Palm	*Archontophoenix alexandrae*	22'	Remove	
572	Alexander Palm	*Archontophoenix alexandrae*	20'	Remove	
573	Alexander Palm	*Archontophoenix alexandrae*	20'	Remove	
574	Laurel Oak	*Quercus laurifolia*	8	Preserve	
575	Black Olive	*Bucida buceras*	20	Preserve	
576	Sabal Palm	*Sabal palmetto*	18'	Remove	
577	Sabal Palm	*Sabal palmetto*	25'	Remove	
578	Sabal Palm	*Sabal palmetto*	25'	Remove	
579	Sabal Palm	*Sabal palmetto*	20'	Remove	

580	Sabal Palm	*Sabal palmetto*	20'	Remove	
581	Sabal Palm	*Sabal palmetto*	20'	Remove	
582	Christmas Palm	*Veitchia merillii*	10'	Remove	
583	Sabal Palm	*Sabal palmetto*	22'	Preserve	
584	Sabal Palm	*Sabal palmetto*	20'	Remove	
585	Sabal Palm	*Sabal palmetto*	12'	Preserve	
586	Sabal Palm	*Sabal palmetto*	10'	Preserve	
587	Sabal Palm	*Sabal palmetto*	10'	Preserve	
588	Sabal Palm	*Sabal palmetto*	16'	Preserve	
589	Sabal Palm	*Sabal palmetto*	18'	Preserve	
590	Sabal Palm	*Sabal palmetto*	16'	Preserve	
591	Sabal Palm	*Sabal palmetto*	18'	Preserve	
592	Sabal Palm	*Sabal palmetto*	7'	Preserve	
593	Sabal Palm	*Sabal palmetto*	8'	Preserve	
594	Weeping Fig	*Ficus benjamina*	24	Remove	
595	Live Oak	*Quercus virginiana*	17	Remove	
596	Live Oak	*Quercus virginiana*	11	Remove	
597	Live Oak	*Quercus virginiana*	13	Remove	
598	Live Oak	*Quercus virginiana*	14	Remove	
599	Live Oak	*Quercus virginiana*	8	Remove	
600	Live Oak	*Quercus virginiana*	9	Preserve	
601	Lead Tree	*Leucaena leucocephala*	8	Remove	Multi-leader
602	Sabal Palm	*Sabal palmetto*	12'	Remove	Vines; Close to lead tree
603	Sabal Palm	*Sabal palmetto*	14'	Remove	Curved; Close to lead tree
604	Areca cluster	*Dypsis lutescens*	8	Remove	
605	Areca cluster	*Dypsis lutescens*	12	Remove	
606	Live Oak	*Quercus virginiana*	18	Relocate	
607	Sabal Palm	*Sabal palmetto*	15'	Remove	
608	Live Oak	*Quercus virginiana*	10	Remove	
609	Lead Tree	*Leucaena leucocephala*	14	Remove	
610	Sabal Palm	*Sabal palmetto*	11'	Remove	
611	Weeping Fig	*Ficus benjamina*	36	Remove	
612	Golden Raintree	*Koelreuteria formosana*	8	Remove	Trunk damage
613	Live Oak	*Quercus virginiana*	10	Preserve	
614	Live Oak	*Quercus virginiana*	12	Remove	
615	Live Oak	*Quercus virginiana*	12	Remove	
616	Triangle palm	*Dypsis decaryi*	6'	Remove	
617	Live Oak	*Quercus virginiana*	10	Remove	
618	Live Oak	*Quercus virginiana*	7	Remove	
619	Live Oak	*Quercus virginiana*	9	Remove	
620	Sabal Palm	*Sabal palmetto*	18'	Remove	
621	Beauty Leaf	*Calophyllum antillanum*	7	Remove	
622	Fiddle-leaf Fig	*Ficus lyrata*	18	Remove	
623	Live Oak	*Quercus virginiana*	13	Remove	
630	Sabal Palm	*Sabal palmetto*	11'	Remove	
631	Strangler Fig	*Ficus aurea*	80	Remove	
632	Laurel Fig	*Ficus microcarpa*	90	Preserve	
633	Seagrape	*Coccoloba uvifera*	12	Preserve	Cluster
634	Sabal Palm	*Sabal palmetto*	19'	Preserve	
635	Seagrape	*Coccoloba uvifera*	8	Preserve	Cluster
636	Screw Pine	*Pandanus utilis*	6	Preserve	Multi-leader
637	Coconut palm	*Cocos nucifera*	22	Preserve	
638	Magnolia	*Magnolia grandiflora*	5	Preserve	Multi-leader
639	Seagrape	*Coccoloba uvifera*	6	Preserve	Large cluster, 5x30ft
641	Live Oak	*Quercus virginiana*	18	Remove	
642	Live Oak	*Quercus virginiana*	10	Preserve	
643	Live Oak	*Quercus virginiana*	12	Preserve	
644	Live Oak	*Quercus virginiana*	6	Remove	
645	Live Oak	*Quercus virginiana*	7	Preserve	
646	Live Oak	*Quercus virginiana*	14	Preserve	
647	Live Oak	*Quercus virginiana*	14	Remove	
648	Sabal Palm	*Sabal palmetto*	12'	Remove	Close to carrotwood
649	Live Oak	*Quercus virginiana*	12	Remove	
650	Live Oak	*Quercus virginiana*	13	Relocate	
651	Live Oak	*Quercus virginiana*	9	Remove	
652	Spanish Bayonet	*Yucca aloifolia*	9	Remove	Multi-leader
653	Sabal Palm	*Sabal palmetto*	6'	Remove	
655	Sabal Palm	*Sabal palmetto*	8'	Remove	
656	Avocado	*Persea americana*	9	Remove	Multi-leader
657	Sabal Palm	*Sabal palmetto*	20'	Remove	
659	Sabal Palm	*Sabal palmetto*	20'	Remove	Vines; fair condition
660	Live Oak	*Quercus virginiana*	14	Remove	
661	Live Oak	*Quercus virginiana*	12	Remove	
662	Areca Palm	*Dypsis lutescens*	5	Preserve	5ft x 5ft cluster
663	Sabal Palm	*Sabal palmetto*	3	Remove	
664	Gumbo limbo	*Bursera simaruba*	16	Remove	
665	Sabal Palm	*Sabal palmetto*	18'	Remove	Vine intrusion
666	Weeping Fig	*Ficus benjamina*	8	Remove	Growing through fence
667	Sabal Palm	*Sabal palmetto*	15'	Remove	
668	Christmas Palm	*Veitchia merillii*	10'	Remove	
669	Bird of Paradise	*Strelitzia nicolai*	10	Remove	10ft x 10ft cluster
670	Sabal Palm	*Sabal palmetto*	8'	Remove	Abut fence
671	Seagrape	*Coccoloba uvifera*	10	Remove	Multi-trunk
672	Seagrape	*Coccoloba uvifera*	10	Remove	Multi-trunk
673	Seagrape	*Coccoloba uvifera*	15	Remove	Multi-trunk
15b	Christmas Palm	*Veitchia merillii*	10'	Preserve	
212b	Sabal Palm	*Sabal palmetto*	16'	Remove	
234b	Sabal Palm	*Sabal palmetto*	20'	Preserve	

*All palms are measured in feet to clear trunk

TOTAL TREES/ PALMS PRESERVED: 430
TOTAL TREES/PALMS REMOVED: 224
TOTAL TREES/ PALMS RELOCATED: 10

NOTE: CONTRACTOR SHALL NOTIFY THE TOWN THREE WEEKS PRIOR TO THE REMOVAL OF NATIVE TREES AND PALMS SO THE TOWN MAY NOTIFY RESIDENTS OF AVAILABLE VEGETATION FOR REUSE.

WGI
2035 Vista Parkway, West Palm Beach, FL 33411
Phone No. 866.909.2220 www.wginc.com
Cert No. 6091 - LB No. 7055

NOT AUTHORIZED FOR CONSTRUCTION PRIOR TO FORMAL TOWN APPROVAL

REVISIONS

NO	DATE	DESCRIPTION	BY
1	2/6/2025	SITE PLAN AMENDMENT	CKW
2	7/31/2025	SITE PLAN AMENDMENT	CKW
3	10/6/2025	SITE PLAN AMENDMENT	

CAD: 2920.04_LD.DWG	
JOB NO.	2920.04
DRAWN BY	CKW
CHECK BY	YM
DATE	10/06/2025

LANDSCAPE ARCHITECT OF RECORD
COREY A. KISSELL WONG, PLA
FL # LA6667017

REGISTERED LANDSCAPE ARCHITECT
COREY A. KISSELL WONG
LA 6667017
STATE OF FLORIDA

THE WATERFORD
601 UNIVERSE BOULEVARD
JUNO BEACH, FL
TREE DISPOSITION LIST

SHEET:
LD-2.01


Corey Kissell Wong P:\2020\2020.04 Waterford Campus Redev\LA\Drawings\Landscape\2920.04_LD.dwg — Plotted: 10/6/2025 3:04:40 PM Saved: 10/6/2025 12:00:10 PM

THE WATERFORD


601 UNIVERSE BOULEVARD,
JUNO BEACH, FL 33408

PRELIMINARY CIVIL ENGINEERING PLANS

PREPARED FOR:
LIFESPACE COMMUNITIES
WEST DES MOINES, IA 50266

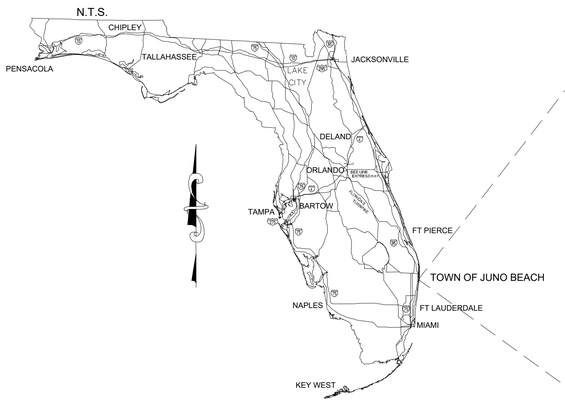

LOCATION MAP

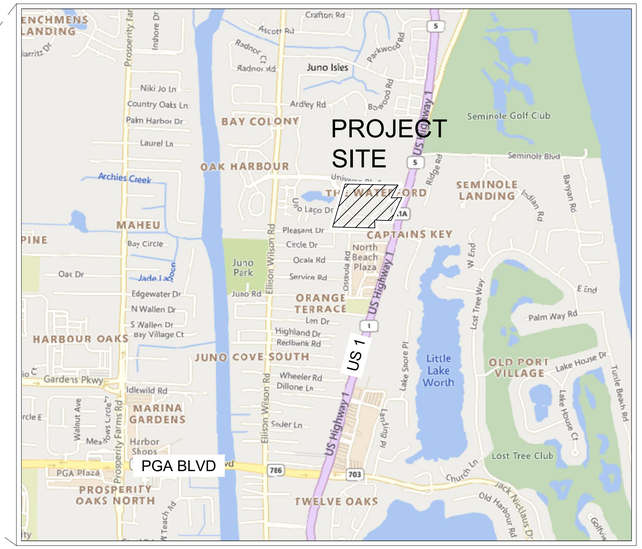

PROJECT LOCATED IN
SECTION 33 / TOWNSHIP 41 SOUTH / RANGE 43 EAST
PALM BEACH COUNTY, FL

Sheet List Table	
Sheet Number	Sheet Title
C-001	COVER
C-002	GENERAL NOTES
C-101	EROSION AND SEDIMENTATION CONTROL PLAN
C-102	DEMOLITION PLAN
C-201	PAVING AND GRADING PLAN
C-301	DRAINAGE PLAN
C-401	WATER AND WASTEWATER PLAN
C-501	SIGNING AND PAVEMENT MARKING PLAN

PERMIT TRACKING			
PERMITTING AGENCY	PERMIT NAME	PERMIT NUMBER	EXPIRATION DATE
SFWMD	ERP		
PBC HEALTH DEPARTMENT	WATER PERMIT		
PBC HEALTH DEPARTMENT	SEWER PERMIT		
PBC LAND DEVELOPMENT	U/T PERMIT		
PBC FIRE	FIRE REVIEW		

VERTICAL DATUM: NORTH AMERICAN VERTICAL DATUM OF 1988 (NAVD88)

HORIZONTAL DATUM: NORTH AMERICAN DATUM OF 1983, FLORIDA STATE PLANES, EAST ZONE, U.S. FEET (NAD83)

811 Know what's below. Call before you dig.

PREPARED BY:
WGI
2035 Vista Parkway, West Palm Beach, FL 33411
Phone No. 866.909.2220 www.wginc.com
Cert No. 6091 - LB No. 7055

CONSULTANTS:

PROJECT TITLE:

THE WATERFORD
601 UNIVERSE BOULEVARD
JUNO BEACH, FLORIDA 33408

ENGINEER OF RECORD
CHRIS J. HOLMES, PE
P.E. #66344
ON 2025-02-26

NO:	DATE:	DESCRIPTION:

DRAWN DATE:	2/26/2025
DRAWN BY:	LL/GAT
CHECKED BY:	CJH
PROJECT #:	2920.04

PRELIMINARY CIVIL ENGINEERING PLANS

SHEET #:	TOTAL SHEETS
C-001	8

GENERAL NOTES

1. REGULATIONS - ALL CONSTRUCTION SHALL BE DONE IN A WORKMAN LIKE MANNER AND SHALL CONFORM TO ALL COUNTY, STATE AND FEDERAL REGULATIONS AND OR CODES INCLUDING BUT NOT LIMITED TO THE CURRENT PALM BEACH COUNTY AND FLORIDA DEPARTMENT OF TRANSPORTATION (FDOT) LATEST REGULATIONS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL PERMITS AND LICENSES TO BEGIN WORK AND PAY ALL REQUIRED FEES ASSOCIATED WITH SAME.
2. STANDARD DETAILS AND SPECIFICATIONS - STATE, COUNTY AND CITY CONSTRUCTION DETAILS AND SPECIFICATIONS SHALL BE APPLIED TO THE APPROPRIATE AREAS OF THE PLANS, GENERALLY DIFFERENTIATED BY PROPERTY OWNERSHIP LINES OR INTENT OF THE DESIGN. ANY CONFLICTS BETWEEN GOVERNING STANDARDS SHALL BE BROUGHT TO THE ATTENTION OF THE ENGINEER.
3. DATUM - UNLESS OTHERWISE NOTED, ELEVATIONS SHOWN HEREON REFER TO NORTH AMERICAN VERTICAL DATUM OF 1988 (NAVD 88). HORIZONTAL DATA SHOWN HEREON REFERS TO N.A.D. 83 FLORIDA STATE PLANE EAST ZONE. ANY DISCREPANCY SHALL BE BROUGHT TO THE ATTENTION OF THE ENGINEER BEFORE CONSTRUCTION BEGINS OR RESUMES.
4. CHANGES - ALL CHANGES SHALL BE SUBMITTED IN WRITING AND APPROVED BY THE OWNER AND ENGINEER PRIOR TO CONSTRUCTION.
5. GUARANTEE - THE CONTRACTOR SHALL GUARANTEE ALL WORK AND MATERIAL FOR A PERIOD OF ONE YEAR FROM THE DATE OF PROJECT ACCEPTANCE, DURING WHICH ALL FAULTY CONSTRUCTION AND/OR MATERIAL SHALL BE REPLACED AT THE CONTRACTORS EXPENSE.
6. SHOP DRAWINGS - PRIOR TO CONSTRUCTION, THE CONTRACTOR SHALL SUBMIT SHOP DRAWINGS TO THE ENGINEER FOR REVIEW AND SEACOAST UTILITY AUTHORITY(SUA) APPROVAL. STRUCTURE SHOP DRAWINGS SHALL BE SIGNED AND SEALED BY A PROFESSIONAL STRUCTURAL ENGINEER REGISTERED IN THE STATE OF FLORIDA.
7. MAINTENANCE OF TRAFFIC (M.O.T.) - UNLESS OTHERWISE PERMITTED, THE CONTRACTOR SHALL MAINTAIN EXISTING PEDESTRIAN AND VEHICULAR TRAFFIC AND ACCESS AT ALL TIMES DURING CONSTRUCTION AND SHALL PROVIDE THE NECESSARY TEMPORARY PAVEMENT, BARRICADES, LIGHTING, SIGNS, FLAGMEN, ETC. FOR THE SAFETY OF THE PUBLIC. THE CONTRACTOR SHALL SUBMIT M.O.T. AND A.D.A. ACCESS PLANS TO THE ENGINEER FOR REVIEW AND CITY, COUNTY AND STATE APPROVAL OF WORK TO BE DONE WITHIN THEIR RIGHTS OF WAY. M.O.T. SHALL BE IN ACCORDANCE WITH A.D.A., M.U.T.C.D. AND F.D.O.T. INDEX OF STANDARD PLANS.
8. RECORD DRAWINGS - THE CONTRACTOR SHALL SUBMIT RECORD DRAWINGS TO THE ENGINEER FOR REVIEW AND APPROVAL. RECORD DRAWINGS MUST BE SIGNED AND SEALED BY A PROFESSIONAL SURVEYOR REGISTERED IN THE STATE OF FLORIDA AND BE REFERENCED TO THE DATUM SHOWN IN THE CONSTRUCTION PLANS. ANY UNMARKED UTILITIES ENCOUNTERED DURING CONSTRUCTION SHALL BE INCORPORATED INTO THE RECORD DRAWINGS. ALL UTILITIES MUST BE SHOWN IN THEIR AS-BUILT LOCATION.
9. RESPONSIBILITY - THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL EXISTING UTILITIES WHETHER SHOWN ON THE PLANS OR NOT. THE CONTRACTOR SHALL VERIFY THE LOCATION, SIZE AND MATERIAL OF ALL UTILITIES PRIOR TO THE COMMENCEMENT OF CONSTRUCTION. ANY DISCREPANCIES SHALL BE BROUGHT TO THE ATTENTION OF THE ENGINEER. THE APPROPRIATE UTILITY COMPANY SHALL BE NOTIFIED PRIOR TO ANY CONSTRUCTION IN OR AROUND THAT UTILITY. CALL "SUNSHINE STATE ONE CALL" AT 1-800-432-4770 PRIOR TO ANY EXCAVATION. THE ENGINEER AND OWNER SHALL BE HELD HARMLESS AGAINST ALL CLAIMS OR DAMAGES.
10. RESTORATION - THE CONTRACTOR SHALL IMMEDIATELY REPAIR AND RESTORE EXISTING SITE FEATURES INCLUDING PAVEMENT, DRIVEWAYS, PIPES, FENCES, TRAFFIC CONTROL DEVICES, MAILBOXES AND PROPERTY CORNERS DAMAGED AS A RESULT OF CONSTRUCTION ACTIVITIES. THE REPAIR AND RESTORATION SHALL CONFIRM TO APPLICABLE STANDARDS AS GOVERNED.
11. OPEN TRENCHES - ALL OPEN TRENCHES AND HOLES SHALL BE PROPERLY MARKED AND BARRICADED TO INSURE THE SAFETY OF VEHICULAR AND PEDESTRIAN TRAFFIC. NO OPEN TRENCHES OR HOLES SHALL BE LEFT OPEN DURING NIGHT TIME HOURS WITHOUT EXPRESSED PERMISSION FROM THE OWNER, ENGINEER AND REGULATING AGENCIES. ALL TRENCHES SHALL COMPLY WITH OSHA TRENCH SAFETY ACT PROVISIONS.
12. CONFLICTS - ANY CONFLICTING INFORMATION BETWEEN REGULATING AGENCIES AND THE CONSTRUCTION DOCUMENTS SHALL BE IMMEDIATELY BROUGHT TO THE ATTENTION OF THE ENGINEER. AFFECTED CONSTRUCTION SHALL NOT COMMENCE OR RESUME UNTIL PERMISSION IS GRANTED BY THE ENGINEER OR OWNER.

CLEARING AND GRUBBING

1. CLEARING - CLEARING SHALL BE LIMITED TO THE CONSTRUCTION AREA AND/OR AS DIRECTED BY THE ENGINEER OR OWNER AND APPROVED BY THE TOWN OF JUNO BEACH.
2. GRUBBING - ALL STUMPS, ROOTS, BURIED LOGS OR OTHER UNSUITABLE MATERIAL WITHIN THE LIMITS OF PAVEMENT CONSTRUCTION SHALL BE REMOVED TO A DEPTH OF 3 FEET BELOW FINISHED PAVEMENT ELEVATION AND REPLACED WITH CLEAN FILL.
3. DEBRIS REMOVAL - ALL DEBRIS SHALL BE REMOVED FROM THE SITE AND LEGALLY DISPOSED. ANY MATERIAL RETAINED ON-SITE FOR MORE THAN 30 DAYS SHALL BE STORED IN CONTAINERS APPROVED BY THE ENGINEER AND TOWN OF JUNO BEACH.
4. PROTECTION - THE CONTRACTOR SHALL BE RESPONSIBLE TO PROTECT ALL EXISTING BUILDINGS, UTILITIES, STRUCTURES THAT ARE ABOVE OR BELOW GROUND AND SHALL HOLD THE ENGINEER AND OWNER HARMLESS AGAINST ALL CLAIMS OR DAMAGES.
5. LANDSCAPED AREAS - ALL LANDSCAPE PLANTING AREAS SHALL BE FREE OF BASE ROCK AND CONSTRUCTION DEBRIS AND EXCAVATED TO A MINIMUM DEPTH OF 30" OR TO CLEAN, NATIVE SOIL. REFER TO THE LANDSCAPE PLANS (BY OTHERS) FOR ADDITIONAL PLANTING INFORMATION AND DETAILS.
6. MUCK - ANY MUCK ENCOUNTERED WITHIN 10' OF THE PAVEMENT AND BUILDING AREAS SHALL BE REMOVED AND REPLACED WITH CLEAN FILL MATERIAL.
7. HARDPAN - ANY HARDPAN ENCOUNTERED IN THE DETENTION AREA SHALL BE REMOVED AND REPLACED WITH CLEAN, GRANULAR FILL MATERIAL.

UTILITY CONTACTS

CROWN CASTLE FIBER:
DANNY HASKETT
(786)-610-2931
ALT. (786)-246-7073
DANNY.HASKETT@FPL.COM

FPL:
TIM BONNER
(561)-575-6302
TIMOTHY.BONNER@FPL.COM

FLORIDA PUBLIC UTILITIES:
MAURO RUINI
(561)-838-1719
ALT. (561)-602-4150
MRUINI@FPUC.COM

SEACOAST UTILITY AUTHORITY:
SCOTT SERRA
(561)-627-2700
SSERRA@SUA.COM

ATT-FLORIDA:
PAUL HERRON
(561)-540-9262
PH3103@ATT.COM

WATER AND SEWER NOTES

1. ALL WATER AND SANITARY SEWER IMPROVEMENTS SHALL BE DESIGNED AND CONSTRUCTED IN ACCORDANCE WITH SEACOAST UTILITY AUTHORITY (SUA) REQUIREMENTS.
2. RIM ELEVATIONS ARE BASED ON PROPOSED FINISH GRADES. VERTICAL ADJUSTMENTS OF RIMS AND VALVE BOXES MAY BE NECESSARY DUE TO FIELD CONDITIONS. ADJUSTMENTS ARE TO BE MADE BY THE CONTRACTOR WHEN THE BASE COURSE IS IN PLACE OR SITE GRADING IS COMPLETE. COST OF ADJUSTING IS TO BE INCLUDED IN BASE BID.
3. WATER AND SEWER MAINS AND SERVICES TO CLEAR DRAINAGE MANHOLES AND INLETS BY A MINIMUM HORIZONTAL DISTANCE OF 5'.
4. DIP WATER MAINS SHALL BE LAID WITH NO DEFLECTIONS AT THE JOINTS AND PIPES SHALL NOT BE DEFLECTED.
5. WATER MAIN AND FITTINGS SHALL BE COLOR CODED IN ACCORDANCE WITH SUBPARAGRAPH 62-555.320 OF THE F.A.C.
6. SEWER FORCE MAINS AND FITTINGS SHALL BE COLOR CODED IN ACCORDANCE WITH SUBPARAGRAPH 62-604.300 OF THE F.A.C.
7. DETECTABLE MAGNETIC TAPE SHALL BE INSTALLED 12" ABOVE CROWN OF PIPE. TAPE OVER WATER MAINS SHALL BE 6" BLUE. TAPE OVER FORCE MAINS SHALL BE 6" GREEN. THE TAPE SHALL BE MAGNETIC AND MANUFACTURED BY SUA STANDARD OR APPROVED EQUAL.
8. ELECTROMAGNETIC SENSOR (EMS) MARKERS SHALL BE PLACED ACCORDING TO THE STANDARD DETAIL AS WELL AS ALL CHANGES IN PIPE DIRECTION AND AT 500' (MAX) INTERVALS ALONG ENTIRE LENGTH.
9. MEGALUG RESTRAINTS, SECURED WITH THRUST BLOCKS AND/OR TIE-RODS (SEE DETAIL SHEETS), SHALL BE USED ON ALL UNDERGROUND FITTINGS. ABOVE GROUND FITTINGS SHALL BE FLANGED. RESTRAINED JOINTS AND FITTINGS SHALL BE VISUALLY INSPECTED AND ACCEPTED BY THE ENGINEER PRIOR TO BACKFILLING.
10. PIPE JOINT DEFLECTIONS SHALL NOT EXCEED 75% OF THE MANUFACTURER'S RECOMMENDATION.
11. FIRE HYDRANTS SHALL BE A MAXIMUM OF 12 FEET FROM ROAD ACCESS.
12. MAINTAIN A 6' CLEAR AREA AROUND ALL FIRE DEPARTMENT CONNECTIONS.
13. FIRE LINES SHALL BE CERTIFIED IN ACCORDANCE WITH F.S. 633.
14. ALL SERVICES SHALL HAVE AN RPZ BFP DEVICE INSTALLED ON THE DISCHARGE SIDE OF THE METER.
15. VALVE BOX COVERS ARE NOT TO FALL WITHIN CURBS.
16. UNLESS CALLED FOR IN THE PLANS, ALL WATER MAINS AND FORCE MAINS SHALL HAVE 36" MIN. COVER.
17. ALL SANITARY SEWER SERVICE LATERALS UPSTREAM OF SUA POINT OF SERVICE CLEANOUT SHALL BE PRIVATE.
18. ALL MANHOLE LIDS SHALL HAVE SANITARY SEWER INSCRIBED THEREON (NEW & EXISTING).
19. NO CONNECTIONS SHALL BE MADE TO ANY FIRE HYDRANT OR BLOW-OFF WITHOUT FIRST OBTAINING PERMISSION AND A CONSTRUCTION METER FROM SUA.
20. PRESSURE TEST CRITERIA SHALL CONFORM TO PBCHD AND SUA STANDARDS. EACH SEGMENT SHALL BE TESTED FOR TWO (2) HOURS AT A MINIMUM PRESSURE OF 150 PSI IN ACCORDANCE WITH THE CURRENT AWWA C-600 STANDARD. UNLESS OTHERWISE SHOWN IN THE PLANS, NO MORE THAN 2,000 FEET OF FORCE MAIN SHALL BE TESTED AT ONE TIME. THE MAXIMUM QUANTITY OF WATER THAT MUST BE SUPPLIED INTO THE TESTED PIPE TO MAINTAIN THE SPECIFIED PRESSURE SHALL NOT EXCEED 50% OF THE APPLICABLE AWWA C-600 STANDARD.
21. HORIZONTAL PIPE SEPARATION DIMENSIONS ARE FROM WALL TO WALL OF PIPES AND STRUCTURES UNLESS NOTED OR EXPLICITLY SHOWN.
22. PRESSURE FITTINGS AND PIPE TO BE RESTRAINED PER SUA SPECIFICATIONS.
23. ALL EXISTING VALVES, MANHOLES, AND FIRE HYDRANTS SHALL BE ACCESSIBLE AT ALL TIMES DURING CONSTRUCTION AND SHALL BE ADJUSTED TO FINAL FINISHED GRADE BEFORE COMPLTEION

SUA INSTALLATION PROTOCOL

1. ALL PIPE IS TO BE LAID IN A CLEAN DRY TRENCH.
2. ALL MUCK AND UNSUITABLE MATERIALS ENCOUNTERED IN TRENCH BOTTOM SHALL BE REMOVED AND REPLACED WITH COMPACTED GRANULAR MATERIAL TO 95% OF MAXIMUM DENSITY PER AASHTO T-180.PROCTOR AND DENSITY TEST RESULTS SHALL BE SUBMITTED TO THE EOR WITH A COPY TO THE AUTHORITY.
3. ALL BACKFILL WITHIN ROAD RIGHTS-OF-WAY SHALL BE PLACED IN 12 INCH LIFTS AND COMPACTED BY MECHANICAL MEANS TO 98% OF MAXIMUM DENSITY PER AASHTO T-180 OR AS OTHERWISE REQUIRED BY THE PERMITTING AGENCY. PROCTOR AND DENSITY TEST RESULTS SHALL BE SUBMITTED TO THE EOR WITH A COPY TO THE AUTHORITY. FLOWABLE FILL OR CONTROLLED LOW STRENGTH MATERIAL (CLSM) SHALL BE AN ALTERNATIVE TO A COMPACTED BACKFILL WITH THE APPROVAL OF THE PERMITTING AGENCY AND THE AUTHORITY. THESE MATERIALS SHALL BE USED FOR GENERAL BACKFILL APPLICATIONS FOR TRENCHES AND ABUTMENTS. FLOWABLE FILL SHALL BE EXCAVATABLE AND HAVE A COMPRESSIVE STRENGTH THAT SHALL BE LESS THAN 200 PSI AT TWENTY-EIGHT (28) DAYS.
4. UTILITIES CROSSING ROAD RIGHTS-OF-WAY SHALL BE INSTALLED PRIOR TO ROAD CONSTRUCTION AND BACKFILLED AND COMPACTED WITHIN RIGHT-OF-WAY LIMITS IN STRICT ACCORDANCE WITH THE DIRECTIONS OF THE EOR AND REQUIREMENTS OF ALL AGENCIES OF JURISDICTION.
5. EMBEDMENT MATERIALS BELOW PIPE SHALL CONFORM TO UNIFIED SOIL CLASSIFICATION SYSTEM (U.S.C.S.) SOIL CLASSIFICATION CLASS I OR II AS NOTED IN ASTM D2321.
6. ALL LINES UNDER CONSTRUCTION SHALL BE PLUGGED WITH A WING PLUG, AND ALL PRESSURE PIPES ARE TO BE PLUGGED WITH A MECHANICAL PLUG OR CAP AT THE END OF THE WORKING DAY TO PREVENT GROUND WATER AND POTENTIAL CONTAMINANTS FROM ENTERING COMPLETED LINES AND LINES UNDER CONSTRUCTION.
7. ABOVE GROUND PIPING, INCLUDING BUT NOT LIMITED TO, AERIAL CROSSINGS, LIFT STATION PIPING, FIRE LINES, METER/BACKFLOW PREVENTION DEVICE ASSEMBLIES, ETC. SHALL BE FLANGED AND BE COATED IN THE FOLLOWING MANNER:

SANDBLAST AND REMOVE ALL PAINT AND ANY LOOSE MATERIAL IN ACCORDANCE WITH SSPC-SP10 OR NAPF 500-03 (DUCTILE IRON SURFACES). SANDBLASTING SHALL BE PERFORMED USING NON-SILCIA MEDIA. PAINT ALL EXTERIOR FERROUS METAL SURFACES. THE MANUFACTURER'S RECOMMENDATIONS FOR SURFACE PREPARATION, PRIMING, RECOATING, ETC. SHALL BE STRICTLY FOLLOWED. DO NOT PAINT OR COAT ANY NAMEPLATES, BRASS OR STAINLESS STEEL MATERIAL. CONTRACTOR SHALL USE THE FOLLOWING PAINT SYSTEM OR APPROVED EQUAL.

SUA INSTALLATION PROTOCOL

TNEMEC

a. PRIMER: TNEMEC CHEMBUILD- MODIFIED POLYAMIDOAMINE EPOXY #135 (3.0 TO 5.0 MILS DFT) ALUMINUM COLOR.

b. INTERMEDIATE COAT: TNEMEC CHEMBUILD-MODIFIED POLYAMIDOAMINE EPOXY #135 (3.0 TO 5.0 MILS DFT) OFF WHITE COLOR

c. FINISH COAT: SERIES 1074 ENDURA-SHIELD II WITH 644 UV BLOCKER (2.0 TO 3.0 MILS)

THE FINISHED COAT OF PAINT SHALL BE BLACK IN COLOR FOR SANITARY SEWER, SAFETY PURPLE (5C08) FOR RECLAIMED APPURTENANCES AND DELFT (6B03) BLUE FOR POTABLE WATER APPURTENANCES.

INSPECTIONS BY THE AUTHORITY ARE REQUIRED AFTER SANDBLAST AND BEFORE PRIMER, AFTER PRIMER AND AFTER INTERMEDIATE COAT.

8. ALL FLANGED PIPE SHALL BE CAULKED BETWEEN EACH FLANGE AND THREADS WITH SIKA 1 A URETHANE CAULK.
9. ALL TIE RODS, BOLTS, NUTS, ETC. INSTALLED UNDERGROUND MUST BE COR TEN AND SHALL BE PAINTED WITH SHERWIN WILLIAMS TARGUARD - COAL TAR EPOXY OR AN AUTHORITY APPROVED EQUAL. BRASS AND STAINLESS STEEL HARDWARE IS EXEMPT FROM THIS REQUIREMENT.
10. COATINGS AND LININGS DAMAGED DURING CONSTRUCTION DUE TO FIELD CUTTING, MISHANDLING OR OTHERWISE MUST BE REPAIRED IN STRICT ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS.

    THIS INCLUDES, BUT IS NOT LIMITED TO: CEMENT MORTAR AND POLYETHYLENE PIPE LININGS. PROTECTO 401, GALVANIZED COATINGS, PVC FENCE COATINGS AND OTHER PAINT TYPE COATINGS. SPECIFIC APPROVAL MUST BE OBTAINED FROM AUTHORITY PRIOR TO PERFORMING COATING AND LINING REPAIRS.
11. ALL STAINLESS STEEL NUTS, BOLTS AND HARDWARE REFERENCED IN THESE STANDARDS, SHALL BE SS 316 GRADE AND SHALL BE SO STAMPED BY THE MANUFACTURER TO VERIFY ALLOY. THE USE OF ANY OTHER STAINLESS STEEL ALLOY WILL REQUIRE SPECIFIC APPROVAL BY AUTHORITY. IN GENERAL, STAINLESS STEEL NUTS, BOLTS AND HARDWARE ARE REQUIRED IN AND AROUND LIFT STATIONS AND FOR FACILITIES INSTALLED OVER OR UNDER BRACKISH OR MARINE WATERS. THIS REQUIREMENT APPLIES TO FLANGE BOLTS AND NUTS ON FLANGED PIPING, MOUNTING BRACKETS, ALL THREAD ROD, ANCHOR BOLTS, WASHERS, CLAMPS AND OTHER MISCELLANEOUS HARDWARE. ANTI-GALLING COMPOUND ANTI-SEIZE LUBRICANT SHALL BE APPLIED TO THE THREADS OF ALL STAINLESS STEEL BOLTS PRIOR TO INSTALLATION. ANTI-SEIZE LUBRICANT SHALL BE GRAPHITE 50 ANTI-SEIZE BY LOCTITE CORPORATION, 1000 ANTI-SEIZE PASTE BY DOW CORNING, 3M LUBE AND ANTI-SEIZE BY 3M.
12. ALL RUBBER AND SYNTHETIC ELASTOMERIC COMPONENTS OF PRODUCTS THAT COME IN CONTACT WITH POTABLE WATER SHALL BE MANUFACTURED WITH CHLORAMINE RESISTANT ELASTOMERS AND SHALL BEAR NSF APPROVAL.
13. ALL MAINS, INCLUDING FITTINGS, SHALL BE EASILY IDENTIFIABLE AS TO THEIR CONTENTS AND SHALL BE COLOR CODED OR MARKED USING THE UNIVERSAL COLOR CODE OF BLUE FOR WATER, GREEN FOR SEWER AND LAVENDER FOR RECLAIMED. PIPE STRIPED DURING MANUFACTURING OF THE PIPE SHALL HAVE CONTINUOUS STRIPES THAT RUN PARALLEL TO THE AXIS OF THE PIPE, THAT ARE LOCATED AT NO GREATER THAN 90-DEGREE INTERVALS AROUND THE PIPE, AND THAT WILL REMAIN INTACT DURING AND AFTER INSTALLATION OF THE PIPE. IF TAPE IS USED TO STRIPE PIPE DURING INSTALLATION OF THE PIPE, THE TAPE SHALL BE APPLIED IN A CONTINUOUS LINE THAT RUNS PARALLEL TO THE AXIS OF THE PIPE AND THAT IS LOCATED ALONG THE TOP OF THE PIPE; FOR PIPES WITH AN INTERNAL DIAMETER OF 24 INCHES OR GREATER, TAPE SHALL BE APPLIED IN CONTINUOUS LINES ALONG EACH SIDE OF THE PIPE AS WELL AS ALONG THE TOP OF THE PIPE. TAPE SHALL BE VINYL PLASTIC ADHESIVE BACK WITH A MINIMUM WIDTH OF 6 INCHES. FIELD APPLICATION OF PAINT SHALL NOT BE ACCEPTABLE.
14. FIRE HYDRANTS SHALL BE CLEARLY IDENTIFIED AS OUT OF SERVICE UNTIL MAINS HAVE BEEN RELEASED FOR SERVICE AND THE AUTHORITY HAS VERIFIED THE SYSTEM IS FULLY OPERATIONAL.
15. ANY LINES TAKEN OUT OF SERVICE SHALL BE EITHER REMOVED OR GROUTED IN PLACE AS REQUIRED. THOSE LINES GROUTED IN PLACE SHALL BE GROUTED FULL WITH AN EXCAVATABLE FLOWABLE GROUT MIXTURE. SHOP DRAWINGS OF THE MIXTURE SHALL BE SUBMITTED AND APPROVED PRIOR TO PLACEMENT.

PAVING AND DRAINAGE

1. SUBGRADE - SUBGRADE SHALL BE COMPACTED TO 98% MAXIMUM DENSITY IN ACCORDANCE WITH AASHTO T-180 (ASTM-D1557) SPECIFICATIONS. ALL STUMPS, ROOTS, AND OTHER DELETERIOUS MATERIAL ENCOUNTERED SHALL BE REMOVED TO A DEPTH OF 3 FEET BELOW FINISHED ROAD GRADE AND REPLACED WITH CLEAN FILL COMPACTED TO NOT LESS THAN 100% OF MAXIMUM DENSITY. ALL SUCH MATERIAL SHALL BE REMOVED FROM WITHIN 8 FEET OF THE EDGE OF PAVEMENT. STABILIZED SUBGRADE SHALL CONFORM TO SECTION 160 OF FDOT SPECIFICATIONS FOR ROAD AND BRIDGE CONSTRUCTION AND HAVE A MINIMUM LBR OF 40.
2. BASE - APPROVED SHELLROCK AND LIMEROCK SHALL CONFORM TO APPLICABLE SECTIONS OF THE 2007 FDOT SPECIFICATIONS. BASE COURSE SHALL BE COMPACTED TO 98% OF THE MAXIMUM DENSITY AS DETERMINED BY ASTM-D1557. PRIME COAT MINIMUM APPLICATION RATE OF 0.10 GAL/S.Y. TACK COAT MINIMUM APPLICATION RATE OF 0.05 GAL/SY.
3. ASPHALT CONCRETE - STRUCTURAL AND SURFACE COURSES SHALL CONFORM TO APPLICABLE SECTIONS OF THE CURRENT FDOT SPECIFICATIONS.
4. STRUCTURES - INLETS AND MANHOLES SHALL BE AS SPECIFIED ON THE PLANS AND SHALL BE CONSTRUCTED IN ACCORDANCE WITH APPLICABLE SECTIONS OF THE CURRENT FDOT SPECIFICATIONS. INLET GRATES SHALL BE SECURED IN ACCORDANCE WITH FDOT INDEX NO 201.
5. PIPES - DRAINAGE PIPES SHALL CONFORM WITH THE APPLICABLE SECTIONS OF THE CURRENT FDOT SPECIFICATIONS.
6. REINFORCING STEEL - ALL REINFORCING STEEL SHALL CONFORM TO ASTM A- 615 SPECIFICATIONS.

ABBREVIATIONS

BFP	BACKFLOW PREVENTER	MH	MANHOLE
BLDG	BUILDING	NAD	NORTH AMERICAN DATUM
BOT	BOTTOM OF PIPE	NGVD	NATIONAL GEODETIC VERTICAL DATUM
BV	BUTTERFLY VALVE		
CAP	CORRUGATED ALUMINUM PIPE	NAVD	NORTH AMERICAN VERTICAL DATUM
CO	CLEANOUT	PBC	PALM BEACH COUNTY
CR	CURB RAMP	PBCHD	PBCHEALTH DEPARTMENT
CS	CONTROL STRUCTURE	PBCWUD	PBC WATER UTILITIES DEPARTMENT
DBO	DESIGNED BY OTHERS	PVC	POLYVINLY CHLORIDE
DCDA	DOUBLE CHECK DETECTOR ASSEMBLY	P/L	PROPERTY LINE
DIP	DUCTILE IRON PIPE	RCP	REINFORCED CONCRETE PIPE
EL	ELEVATION	RED	REDUCER
EX	EXISTING	R/W	RIGHT OF WAY
FDC	FIRE DEPARTMENT CONNECTION	RPZ	REDUCED PRESSURE ZONE
FF	FINISHED FLOOR	SW	SIDEWALK
FH	FIRE HYDRANT	SAN	SANITARY SEWER
FL	FLANGE	SP	SAMPLE POINT
FM	FORCE MAIN	STM	STORM SEWER
GR	GRATE ELEVATION	SW	SIDEWALK
GV	GATE VALVE	TOB	TOP OF BANK
HC	HANDICAP ACCESSIBLE RAMP	TOP	TOP, TOP OF PIPE
HDPE	HIGH DENSITY POLYETHLENE PIPE	TYP	TYPICAL
HP	HIGH POINT	UE	UTILITY EASEMENT
I	INLET	YD	YARD DRAIN
INV	INVERT	WM	WATER MAIN
LME	LAKE MAINTENANCE EASEMENT		

PAVING AND DRAINAGE - CONTINUED

7. CONCRETE - CONCRETE SHALL DEVELOP A 28-DAY MINIMUM COMPRESSIVE STRENGTH OF 4000 PSI UNLESS OTHERWISE NOTED ON THE PLANS AND SHALL CONFORM TO THE APPLICABLE SECTIONS OF THE CURRENT FDOT SPECIFICATIONS.
8. PIPE BACKFILL - PIPE BACKFILL SHALL CONFORM TO THE APPLICABLE SECTIONS OF THE CURRENT FDOT SPECIFICATIONS. PIPE BACKFILL SHALL BE PLACED IN 6" LIFTS AND COMPACTED TO NOT LESS THAN 95% MAXIMUM DENSITY AS DEFINED BY ASTM D-1557.
9. TRAFFIC CONTROL DEVICES - ALL TRAFFIC CONTROL DEVICES, PAVEMENT MARKINGS AND SIGNS SHALL BE AS DEFINED IN THE MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES FOR STREETS AND HIGHWAYS (MUTCD), PALM BEACH COUNTY TYPICAL #T-P-18 AND/OR THE CURRENT FDOT SPECIFICATIONS, WHERE APPLICABLE. THERMOPLASTIC MATERIAL SHALL BE USED FOR FINAL PAVEMENT MARKINGS EXCEPT PARKING SPACES. IF PAVER BRICKS ARE USED IN MARKED PAVEMENT, BRICKS OF APPROPRIATE COLOR AND CONTRAST SHALL BE USED IN LIEU OF PAINT OR THERMOPLASTIC MATERIAL. PAINT MAY BE USED FOR TEMPORARY STRIPING.
10. WHERE CONNECTIONS TO AN EXISTING DRAINAGE SYSTEM ARE PROPOSED, SAID EXISTING DRAINAGE STRUCTURES AND LINES SHALL BE CLEANED OF ALL SILT AND OTHER DEBRIS PRIOR TO SAID CONNECTIONS BEING MADE, AND WHERE THE EXISTING DRAINAGE SYSTEM INCLUDES DITCHES, SAID DITCHES SHALL BE CLEARED AND REWORKED, AS NECESSARY, TO RESTORE THEM TO AN APPROVED DESIGN SECTION. DRAINAGE SYSTEMS ARE TO BE CLEANED AND/OR GRADED TO THE POINT OF LEGAL POSITIVE OUTFALL.
11. ALL HANDICAP ACCESSIBLE RAMPS SHALL MEET ALL APPLICABLE LOCAL, STATE, AND FEDERAL ACCESSIBILITY GUIDELINES AND REGULATIONS. ANY MODIFICATIONS SHALL BE APPROVED BY THE ENGINEER OF RECORD. HANDICAP PARKING SIGNS SHALL BE PLACED A) BEHIND THE SIDEWALK OR B) ATTACHED TO BUILDING WALLS IN AREAS WHERE A SIDEWALK AND/OR BUILDING ABUTS THE STALL OR C) OUTSIDE THE TWO (2') FEET OVERHANG AREA WHERE WHEEL STOPS ARE NOT PROVIDED.
12. CONTRACTOR SHALL CONTACT PALM BEACH COUNTY TRAFFIC OPERATIONS AT 561-233-3900 FORTY-EIGHT (48) HOURS PRIOR TO CONSTRUCTION IF WORK IS BEING DONE WITHIN 10 FEET OF ANY SIGNAL EQUIPMENT
13. DAMAGES TO LOOPS OR ANY SIGNAL EQUIPMENT CAUSED BY CONSTRUCTION OF THIS PROJECT MUST BE REPAIRED OR REPLACED TO ORIGINAL OR BETTER CONDITION AT NO COST TO PALM BEACH COUNTY.

FIELD OBSERVATIONS AND TESTING

1. NOTIFICATION - THE CONTRACTOR SHALL NOTIFY THE ENGINEER, GOVERNMENT AND OTHER PERMITTING AGENCIES 48 HOURS PRIOR TO SCHEDULING FIELD OBSERVATIONS AND SHALL SUPPLY ALL EQUIPMENT NECESSARY TO TEST THE COMPLETED WORK. CALL "SUNSHINE ONE CALL" AT 1-800-432-4770 PRIOR TO ANY EXCAVATION.
2. THE UNDERGROUND CONTRACTOR SHALL SUBMIT ALL RECORD DATA, SIGNED AND SEALED BY A PROFESSIONAL SURVEYOR AND MAPPER REGISTERED IN THE STATE OF FLORIDA, TO THE ENGINEER FOR REVIEW AND APPROVAL PRIOR TO CURB AND PAVEMENT CONSTRUCTION. ANY NECESSARY ADJUSTMENTS AT THIS TIME SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR.
3. DRAINAGE PIPES AND STRUCTURES SHALL BE INSPECTED BY THE ENGINEER PRIOR TO BACKFILLING. ALL DRAINAGE SYSTEMS SHALL BE PUMPED DOWN TO BELOW THE INVERT AND LAMPED AS A REQUIREMENT OF THE FINAL DRAINAGE INSPECTION.
4. ALL TESTS SHALL BE SIGNED AND SEALED BY A PROFESSIONAL ENGINEER REGISTERED IN THE STATE OF FLORIDA AND ARE TO BE PAID FOR BY THE CONTRACTOR.
5. THE BASE ROCK CHEMICAL AND SIEVE ANALYSIS AND THE ASPHALT MIX AND DESIGN CRITERIA SHALL BE SUBMITTED TO THE ENGINEER FOR REVIEW PRIOR TO CONSTRUCTION.
6. PROCTOR AND DENSITY TESTS FOR SUBGRADE AND BASE MATERIAL SHALL BE TAKEN AS DIRECTED BY THE ENGINEER. PAVING DENSITY TESTS SHALL BE TAKEN A MINIMUM OF ONE PER 500 S.Y.
7. DENSITY TEST FOR PIPE TRENCHES SHALL BE TAKEN AT THE PIPE SPRING-LINE AND AT MAXIMUM ONE FOOT (1') LIFTS AS MEASURED FROM THE TOP OF PIPE. THE TESTS SHALL BE TAKEN AT A MAXIMUM SPACING OF EVERY 300 FEET MEASURED FROM THE STRUCTURE OR AT LEAST ONE TEST AT THE CENTER OF THE PIPE SEGMENT BETWEEN TWO STRUCTURES IF LESS THEN 300 FEET. TESTS SHALL BE TAKEN ON ALL SIDES WITHIN FIVE (5') OF EACH STRUCTURE. THE TEST LOCATION AT THE STRUCTURE SHALL BE ON ALTERNATING SIDES OF THE STRUCTURE WITH EACH LIFT TESTED. THE LOCATION AND DEPTH OF ALL TESTS SHALL BE CLEARLY INDICATED IN THE DESCRIPTION AREA ON THE TEST REPORT OR ILLUSTRATED IN A MAP.
8. TESTING - TEST RESULTS SHALL BE SUBMITTED TO THE ENGINEER FOR REVIEW AND APPROVAL. TESTING REQUIREMENTS SHALL INCLUDE, BUT MAY NOT BE LIMITED TO, BACKFILL DENSITY, PIPELINE INTEGRITY (HYDROSTATIC PRESSURE) AND ANY OTHERS REQUIRED BY THE ENGINEER, PERMITTING AGENCIES.

Know what's below. Call before you dig.

NOT AUTHORIZED FOR CONSTRUCTION PRIOR TO FORMAL CITY APPROVAL

WGI
WGInc.com
2035 VISTA PARKWAY, WEST PALM BEACH, FLORIDA 33411
561.687.2220
CERT NO: 6991

PRELIMINARY

NOT FOR CONSTRUCTION, BIDDING, OR PERMIT PURPOSES.

PREPARED UNDER THE SUPERVISION OF CHRIS J. HOLMES P.E. #66344 ON 2025-02-26

THE WATERFORD
601 UNIVERSE BOULEVARD
JUNO BEACH, FLORIDA 33408

GENERAL NOTES

SHEET
C-002

2920.04

SAVED: 2/26/2025 9:50 AM
PLOTTED: 2/26/2025 9:51 AM
PLOTTED BY: KYLE ROHLILER
PATH: N:\2920\04\Civil\1 waterford campus redev\CIVIL\10-CAD\20-Shts\2920.04-Cover.dwg

PHASE 2

LIMITS OF IL COMMONS CONSTRUCTION
(UNDER CONSTRUCTION)

EX INDEPENDENT LIVING BUILDING

LIMITS OF IMPROVEMENTS (TYP)

SILT FENCE (TYP)

EX BUILDING

EX WET DETENTION AREA

BUILDING B
(ASSISTED MEMORY CARE)

EX GARDEN APTS
BUILDING

FLOATING TURBIDITY BARRIER

EX WET DETENTION AREA

PROPERTY LINE (TYP)

BUILDING H
(INDEPENDENT LIVING)

US HWY 1
(STATE ROAD 5)


LIMITS OF VILLA DUPLEX CONSTRUCTION
(CONSTRUCTED)

N

0 20' 40' 80'

LEGEND

- BOUNDARY / R.O.W.
- SILT FENCE
- TURBIDITY BARRIER
- IF — INLET FILTER



LOCATION MAP
SCALE: N.T.S.

EROSION CONTROL NOTES:

1. SWPPP CONTROLS ARE SHOWN IN CONCEPTUAL LOCATIONS AND MAY BE SYMBOLIC IN SIZE DUE TO THE SCALE OF THE DRAWING. ACTUAL CONDITIONS AND LOCATIONS OF CONSTRUCTION ACCESS POINTS. CONTROLS SHALL BE INSTALLED ACCORDING TO THE DETAILS AND AS DIRECTED BY THE WATERFORD.
2. PORTABLE TOILETS, FUEL STATIONS, AND OTHER SOURCES OF POTENTIAL POLLUTION SHALL HAVE BERMS CONSTRUCTED AROUND THEM TO PREVENT DIRECT SURFACE FLOW INTO STORM SEWERS AND RETENTION AREAS.
3. DO NOT CONSTRUCT SILT FENCES ACROSS PERMANENT FLOWING WATER COURSES. SILT FENCE TO BE AT UPLAND LOCATION AND TURBIDITY BARRIERS USED AT PERMANENT BODIES.
4. REFERENCE SHEET C-002 FOR ADDITIONAL EROSION & SEDIMENTATION CONTROL NOTES.

NOT AUTHORIZED FOR CONSTRUCTION PRIOR TO FORMAL CITY APPROVAL

CERT NO. 6991

WGI.
WGInc.com

2035 VISTA PARKWAY, WEST PALM BEACH, FLORIDA 33411

561.687.2220

PRELIMINARY

NOT FOR CONSTRUCTION, BIDDING, OR PERMIT PURPOSES.

PREPARED UNDER THE SUPERVISION OF
CHRIS J. HOLMES
P.E. #66344
ON 2025-02-26

THE WATERFORD


601 UNIVERSE BOULEVARD
JUNO BEACH, FLORIDA 33408

EROSION AND SEDIMENTATION CONTROL PLAN

SHEET
C-101

2920.04

SAVED: 2/6/2025 10:51 AM
PLOTTED: 2/6/2025 10:51 AM
PLOTTED BY: KYLE MCMULLEN
DRAWING: G:\2020\2920.04 waterford campus redev\CIVIL\10-CAD\20-Sheets\2920.04_Erosion Control.dwg

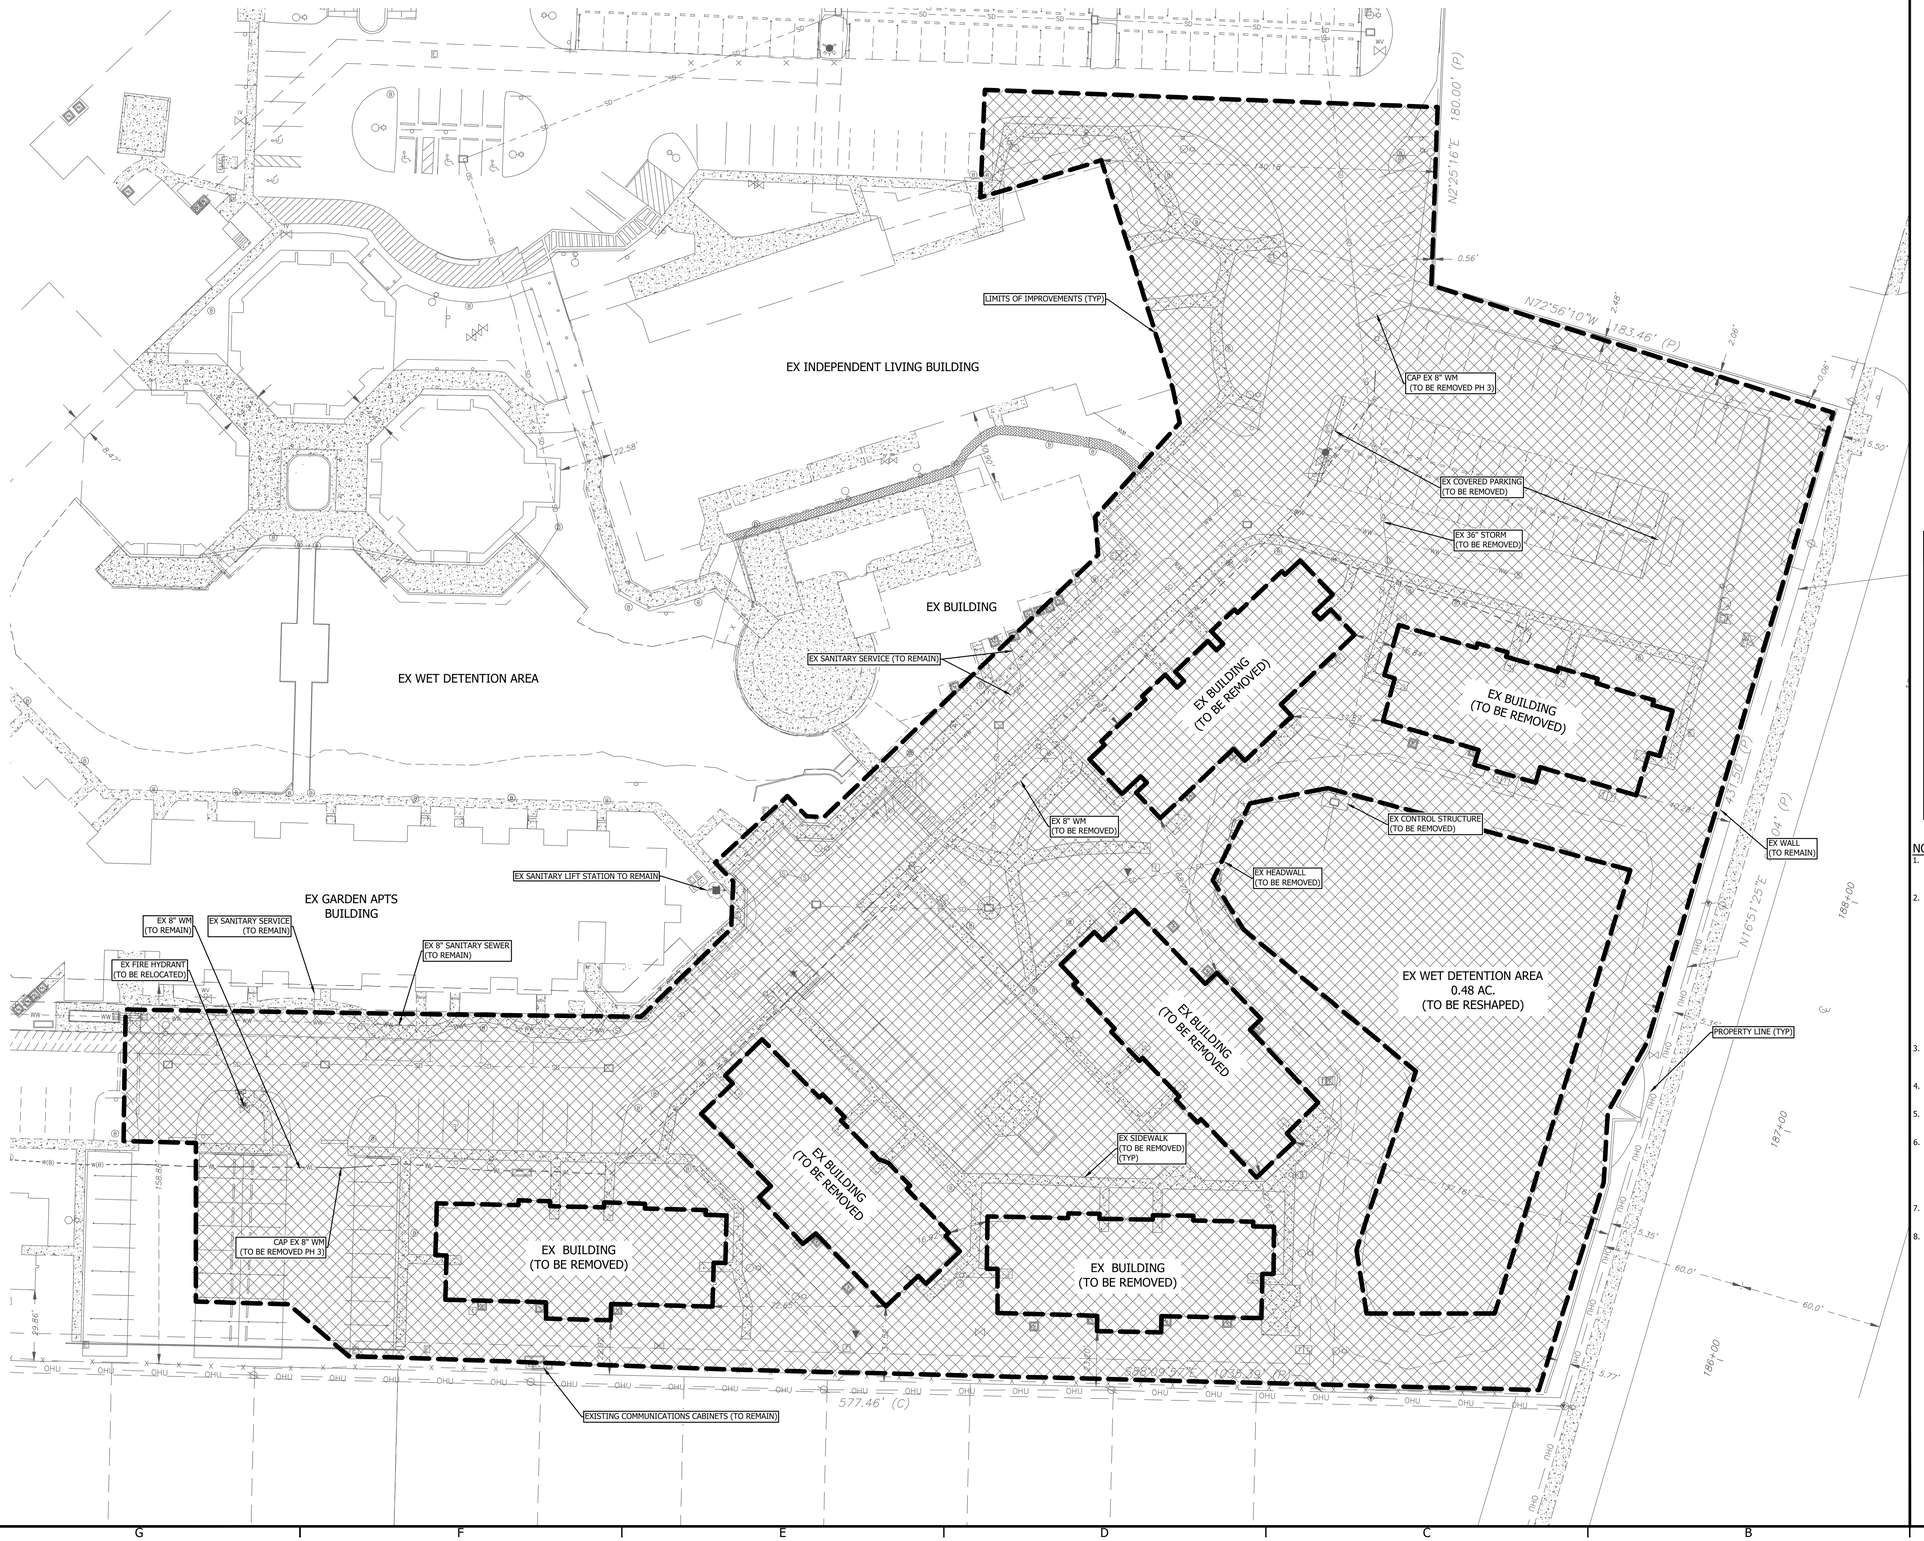

LEGEND

- BOUNDARY / R.O.W.
- EASEMENT / SETBACK
- CONTOUR
- WATER LINE
- WASTEWATER LINE
- STORM DRAIN LINE
- OVERHEAD UTILITY
- BURIED ELECTRIC
- BURIED FIBER OPTICS
- BURIED TELECOM
- DEMOLITION AREA: ALL ITEMS WITHIN THIS AREA TO BE REMOVED OR RELOCATED AS NOTED



LOCATION MAP
SCALE: N.T.S.

NOTES:

1. EROSION/SEDIMENTATION CONTROL AND TREE PROTECTION MUST BE INSTALLED PRIOR TO ANY DEMOLITION. REFERENCE EROSION & SEDIMENTATION CONTROL PLAN SHEET.
2. THE CONTRACTOR IS SPECIFICALLY CAUTIONED THAT THE LOCATION AND/OR ELEVATION OF EXISTING UTILITIES AND STRUCTURES AS SHOWN ON THESE PLANS IS BASED ON RECORDS OF VARIOUS UTILITY COMPANIES AND WHERE POSSIBLE, MEASUREMENTS TAKEN IN THE FIELD. THIS INFORMATION IS NOT TO BE RELIED ON AS BEING EXACT OR COMPLETE. THE LOCATION OF ALL UNDERGROUND UTILITIES AND STRUCTURES SHALL BE VERIFIED IN THE FIELD PRIOR TO THE START OF CONSTRUCTION, THE CONTRACTOR MUST CONTACT THE APPROPRIATE UTILITY COMPANY, ANY GOVERNING PERMITTING AUTHORITY, AND "DIG TEST" AT LEAST 72 HOURS PRIOR TO ANY EXCAVATION WORK TO REQUEST EXACT FIELD LOCATION OF UTILITIES INTERFERING WITH THE PROPOSED CONSTRUCTION AND APPROPRIATE REMEDIAL ACTION TAKEN BEFORE PROCEEDING WITH THE WORK. IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO RELOCATE ALL EXISTING UTILITIES WHICH CONFLICT WITH THE PROPOSED IMPROVEMENTS SHOWN ON THE PLAN PER THE APPROPRIATE REMEDIAL ACTION AGREED UPON BY THE ENGINEER.
3. WHERE A STATE OR LOCAL MUNICIPAL STANDARD DETAIL DUPLICATES A DETAIL SHOWN IN THE PLANS, THE MORE STRINGENT DETAIL, AS DETERMINED BY THE REVIEWING AGENCY, SHALL APPLY.
4. NO SITE DISTURBANCE SHALL OCCUR UNTIL THE PRECONSTRUCTION MEETING WITH THE ENVIRONMENTAL INSPECTOR IS HELD.
5. ALL DEMOLITION OF EXISTING CURBING AND SIDEWALKS MUST BE DONE BY HAND WHEN WORKING WITHIN THE 1/2 CRITICAL ROOT ZONE OF EXISTING TREES.
6. TREE PROTECTION FENCE MOVED DURING CONSTRUCTION MUST BE RE-INSTATED AS SOON AS DEMOLITION WORK IS COMPLETED. ANY WORK BEING DONE WITHIN THE TREE PROTECTION FENCE AREA MUST NOT IMPACT TREE(S); NO ROOT DAMAGE AND NO BRANCH OR TRUNK DAMAGE. ADD A 12" LAYER OF MULCH WITHIN THE TREE PROTECTION FENCE AREA PRIOR TO CONDUCTING ANY WORK INSIDE FENCE AREA.
7. LIMITS OF CONSTRUCTION ARE SHOWN ON THE EROSION & SEDIMENTATION CONTROL PLAN(S).
8. REFERENCE "TREE LIST" SHEET AND EROSION & SEDIMENTATION CONTROL PLAN(S) FOR TREE INFORMATION.

NOT AUTHORIZED FOR CONSTRUCTION PRIOR TO FORMAL CITY APPROVAL

CERT NO. 6991
WGI.
WGInc.com
2035 VISTA PARKWAY, WEST PALM BEACH, FLORIDA 33411
561.687.2220

PRELIMINARY

NOT FOR CONSTRUCTION, BIDDING, OR PERMIT PURPOSES.

PREPARED UNDER THE SUPERVISION OF
CHRIS J. HOLMES
P.E. #66344
ON 2025-02-26

THE WATERFORD
601 UNIVERSE BOULEVARD
JUNO BEACH, FLORIDA 33408

DEMOLITION PLAN

SHEET
C-102

2920.04

SAVED: 2/25/2025 10:18:49 AM
PLOTTED: 2/26/2025 11:11:11 AM
PLOTTED BY: KYLE HOWLLEN
DRAWING: P:\2020\2920.04 waterford campus redev\CIVIL\10-CAD\20-Sheets\2920.04_Demo.dwg

PHASE 2

LIMITS OF IL COMMONS CONSTRUCTION
(UNDER CONSTRUCTION)

EX INDEPENDENT LIVING BUILDING
FFE: 7.37 NAVD

LIMITS OF IMPROVEMENTS (TYP)

CONTROL STRUCTURE

EX BUILDING
FFE: 7.34 NAVD

EX WET DETENTION AREA

BUILDING B
(ASSISTED MEMORY CARE)
FFE: 7.50 NAVD

EX CONTROL STRUCTURE

EX GARDEN APTS
BUILDING
FFE: 7.39 NAVD

BUILDING H
(INDEPENDENT LIVING)
FFE: 7.50 NAVD

EX WET DETENTION AREA

RETENTION WALL

PROPOSED WALL

LAKE OUTFALL

CONNECT TO EXISTING
TOP OF BANK

PROPERTY LINE (TYP)

EDGE OF WATER

TOP OF BANK

STAMPED CONCRETE
(BY OTHERS)

SAW CUT NEAT
AND MATCH TO
EXISTING GRADE

5' SIDEWALK
(TYP)

CONNECT TO EXISTING
TOP OF BANK

US HWY 1
(STATE ROAD 5)

LIMITS OF VILLA DUPLEX CONSTRUCTION
(CONSTRUCTED)

0 20' 40' 80'

LEGEND

	BOUNDARY / R.O.W.
	EASEMENT / SETBACK
###	PROPOSED CONTOUR
##	EXISTING CONTOUR
x x	FENCE
XXX.XX	SPOT ELEVATION CALLOUT
FF	FINISHED FLOOR
ME	MATCH EXISTING
RIM	RIM
	PAVEMENT
	MILL AND RESURFACE
	CONCRETE
SD	STORM DRAIN LINE
WL	WATER LINE
WW	WASTEWATER LINE
WL	EX WATER LINE
WW	EX WASTEWATER LINE
FM	EX FORCE MAIN
SD	EX DRAINAGE LINE
OHE	EX OVERHEAD ELECTRIC
UGE	EX BURIED ELECTRIC
	STORM DRAIN INLET
SD	STORM DRAIN MANHOLE
SD	YARD DRAIN
	FLOW ARROW



LOCATION MAP
SCALE: N.T.S.

NOTES:

1. ALL ELEVATIONS ARE BASED ON NORTH AMERICAN VERTICAL DATUM OF 1988 (NAVD 88). NAVD 88 = NGVD 29 - 1.51
2. SIDEWALKS IN FRONT OF BUILDINGS TO BE CONSTRUCTED DURING BUILDING CONSTRUCTION. SIDEWALKS IN COMMON AREAS TO BE BUILT WITH REST OF SITE DEVELOPMENT.
3. CONTRACTOR SHALL FORM SIDEWALKS AND VERIFY SLOPES PRIOR TO POURING CONCRETE. CONTRACTOR SHALL ENSURE THAT CROSS SLOPES ARE NO GREATER THAN 1.5% ALONG THE ACCESSIBLE ROUTE AND RUNNING SLOPE IS NO GREATER THAN 5%, UNLESS THE RUNNING SLOPE MATCHES THE EXISTING STREET SLOPE. IF ANY DISCREPANCY ARISES, CONTRACTOR SHALL CONTACT ENGINEER FOR SOLUTION.

NOT AUTHORIZED FOR CONSTRUCTION PRIOR TO FORMAL CITY APPROVAL

CERT NO. 6991
WGI.
WGInc.com
2035 VISTA PARKWAY, WEST PALM BEACH, FLORIDA 33411
561.687.2220

PRELIMINARY

NOT FOR CONSTRUCTION, BIDDING, OR PERMIT PURPOSES.

PREPARED UNDER THE SUPERVISION OF
CHRIS J. HOLMES
P.E. #66344
ON 2025-02-26

THE WATERFORD
601 UNIVERSE BOULEVARD
JUNO BEACH, FLORIDA 33408

PAVING AND GRADING PLAN

SHEET
C-201

2920.04

SAVED: 2/26/2025 11:34 AM
PLOTTED: 2/27/2025 11:35 AM
PLOTTED BY: KYLE MCMULLEN
DRAWING: J:\2020\2920.04 Waterford campus redevt\CIVIL\15-CAD\20-Sitep\2920.04-Paving, Grading Plan.dwg

LIMITS OF IL COMMONS CONSTRUCTION
(UNDER CONSTRUCTION)

EX INDEPENDENT LIVING BUILDING

LIMITS OF IMPROVEMENTS (TYP)

CONTROL STRUCTURE

EX 36" RCP

DRAINAGE PIPE
(TYP)

EX BUILDING

EX WET DETENTION AREA

BUILDING B
(ASSISTED MEMORY CARE)

DRAINAGE INLET
(TYP)

EX CONTROL
STRUCTURE

EXTEND EXISTING
DRAINAGE PIPE

STORM MANHOLE
(TYP)

RETAINING WALL

LAKE OUTFALL

EX GARDEN APTS
BUILDING

EX WET DETENTION AREA

PROPERTY LINE
(TYP)

CORE INTO EXISTING
DRAINAGE STRUCTURE

BUILDING H
(INDEPENDENT LIVING)

US HWY 1
(STATE ROAD 5)

LIMITS OF VILLA DUPLEX CONSTRUCTION
(CONSTRUCTED)

0 20' 40' 80'

LEGEND

	BOUNDARY / R.O.W.
	EASEMENT / SETBACK
###	PROPOSED CONTOUR
##	EXISTING CONTOUR
x x	FENCE
XXX.XX	SPOT ELEVATION CALLOUT
FF	FINISHED FLOOR
ME	MATCH EXISTING
RIM	RIM
	ASPHALT
	MILL AND RESURFACE
	CONCRETE
SD	STORM DRAIN LINE
WL	WATER LINE
WW	WASTEWATER LINE
WL	EX WATER LINE
WW	EX WASTEWATER LINE
FM	EX FORCE MAIN
SD	EX DRAINAGE LINE
OHE	EX OVERHEAD ELECTRIC
UGE	EX BURIED ELECTRIC
	STORM DRAIN INLET
	STORM DRAIN MANHOLE

LOCATION MAP
SCALE: N.T.S.

NOTES:

1. ALL ELEVATIONS ARE BASED ON NORTH AMERICAN VERTICAL DATUM OF 1988 (NAVD 1988). NAVD 88 = NGVD 29 - 1.51
2. RIM ELEVATIONS ARE BASED ON PROPOSED FINISH GRADES. ADJUSTMENTS MAY BE NECESSARY DUE TO FIELD CONDITIONS. ADJUSTMENTS ARE TO BE MADE BY THE CONTRACTOR WHEN THE BASE COURSE IS IN PLACE OR THE GRADING IS COMPLETE. COST OF ADJUSTING RIMS IS TO BE INCLUDED IN THE BASE BID.
3. ALL ITEMS ARE TO BE FURNISHED & INSTALLED BY THE CONTRACTOR. REFERENCE CONSTRUCTION DETAILS SHEETS FOR ADDITIONAL INFORMATION.
4. ON ALL GRAVITY LINES, CONTRACTOR MUST START AT DOWNSTREAM END AND PROCEED UPSTREAM TAKING CARE TO EXPOSE ALL EXISTING UTILITIES AND STRUCTURES WHICH MAY CONFLICT WITH THE PROPOSED LINE. ANY OTHER SEQUENCE OF CONSTRUCTION WILL BE AT THE CONTRACTORS RISK.
5. CONTRACTOR SHALL EXPOSE ALL EXISTING UTILITIES CROSSING PROPOSED GRAVITY LINES AND ENSURE THERE WILL BE NO CONFLICTS PRIOR TO BEGINNING CONSTRUCTION. ADDITIONALLY, CONTRACTOR TO PLAN UTILITY LINE INSTALLATIONS IN A MANNER TO AVOID CONFLICTS WITH PROPOSED GRAVITY LINES.

NOT AUTHORIZED FOR CONSTRUCTION PRIOR TO FORMAL CITY APPROVAL

CERT NO. 6991
WGI
WGInc.com
2035 VISTA PARKWAY, WEST PALM BEACH, FLORIDA 33411
561.687.2220

PRELIMINARY

NOT FOR CONSTRUCTION, BIDDING, OR PERMIT PURPOSES.

PREPARED UNDER THE SUPERVISION OF
CHRIS J. HOLMES
P.E. #66344
ON 2025-02-26

THE WATERFORD
601 UNIVERSE BOULEVARD
JUNO BEACH, FLORIDA 33408

DRAINAGE PLAN

SHEET
C-301

2920.04

SAVED: 2/6/2025 11:18 AM
PLOTTED: 2/6/2025 11:19 AM
PLOTTED BY: KYLE MCMULLEN
C:\Users\kyle.mcmullen\Desktop\waterford campus redev\C3\01\LU\CAD\2D Sheets\2920.04 Drainage Plan.dwg

PHASE 2

LIMITS OF IL COMMONS CONSTRUCTION
(UNDER CONSTRUCTION)

EX INDEPENDENT LIVING BUILDING

EX BUILDING

EX WET DETENTION AREA

BUILDING B
(ASSISTED MEMORY CARE)

BUILDING H
(INDEPENDENT LIVING)

EX GARDEN APTS
BUILDING

LIMITS OF VILLA DUPLEX CONSTRUCTION
(CONSTRUCTED)

CONNECT TO EXISTING WATER MAIN

EX FIRE HYDRANT

EX SEWER MANHOLE (TYP)

EX SANITARY SEWER PIPE (TYP)

CONNECT TO EXISTING SANITARY SEWER

SANITARY SERVICE CONNECTION

FIRE DEPARTMENT CONNECTION (TYP)

8" BACKFLOW PREVENTER (TYP)

8" PVC WATER MAIN (TYP)

FIRE HYDRANT

PROPERTY LINE (TYP)

EX LIFT STATION

EX 6" FORCE MAIN CAPPED FOR FUTURE USE

US HWY 1
(STATE ROAD 5)

0 20' 40' 80'

GENERAL LEGEND

- BOUNDARY / R.O.W.
- EASEMENT / SETBACK
- WL — WATER LINE
- WW — WASTEWATER LINE
- SD — STORM DRAINAGE LINE
- WL — EX WATER LINE
- WW — EX WASTE WATER LINE
- FM — EX FORCE MAIN
- SD — EX DRAINAGE LINE
- WATER VALVE
- WW — WASTEWATER MANHOLE
- CLEAN-OUT
- SD — STORM DRAIN INLET
- SD — STORM DRAIN MANHOLE

LOCATION MAP
SCALE: N.T.S.

WATER AND SEWER NOTES:

1. ALL ELEVATIONS ARE BASED ON NORTH AMERICAN VERTICAL DATUM OF 1988 (NAVD 1988).
2. CONTRACTOR SHALL FURNISH AND INSTALL ALL MATERIALS AND APPURTENANCES AS CALLED OUT ON PLANS.
3. ALL PUBLIC POTABLE WATER PIPE (WITHIN R.O.W. AND UTILITY EASEMENTS) TO BE DUCTILE IRON CLASS 350 FOR PIPE 12-INCH IN DIAMETER AND SMALLER, AND CLASS 250 MIN. FOR PIPES GREATER THAN 12-INCH DIAMETER. FIRE HYDRANT LEADS TO BE DUCTILE IRON CLASS 350 PER DETAIL. SERVICE LEADS TO BE TYPE K COPPER PER DETAIL..
4. ALL VERTICAL AND HORIZONTAL WATER LINE BENDS SHALL BE RESTRAINED TO THE MAIN USING MECHANICAL JOINT RESTRAINT DEVICES SUCH AS MEGA-LUG OR APPROVED EQUAL.
5. FILL, COMPACT & TEST GROUND AT PROPOSED FINISHED GRADE ELEVATION TO 95% DENSITY PRIOR TO UTILITY CONSTRUCTION.
6. REPAIR ASPHALT AS REQUIRED FOR INSTALLATION OF WATER & WASTEWATER LINES. REFERENCE CONSTRUCTION DETAILS.
7. EXISTING SERVICE LINE LOCATIONS ARE APPROXIMATE AND NEED TO BE FIELD VERIFIED.
8. ALL GRAVITY LINES ARE TO BE INSTALLED FROM DOWNSTREAM TO UPSTREAM.
9. DEFLECT WATER LINES UNDER STORM WHERE NECESSARY TO MAINTAIN 1' MINIMUM VERTICAL SEPARATION.

NOT AUTHORIZED FOR CONSTRUCTION PRIOR TO FORMAL CITY APPROVAL

CERT NO. 6991
WGI
WGInc.com
2035 VISTA PARKWAY, WEST PALM BEACH, FLORIDA 33411
561.687.2220

PRELIMINARY

NOT FOR CONSTRUCTION, BIDDING, OR PERMIT PURPOSES.

PREPARED UNDER THE SUPERVISION OF
CHRIS J. HOLMES
P.E. #66344
ON 2025-02-26

THE WATERFORD
601 UNIVERSE BOULEVARD
JUNO BEACH, FLORIDA 33408

WATER AND WASTEWATER PLAN

SHEET
C-401

2920.04

SAVED: 2/6/2025 11:41:34 AM
PLOTTED: 2/6/2025 11:43:13 AM
PLOTTED BY: ANTHONY ROZZO
DRAWING: J:\2920\Civil\Waterford Campus Redev\CIVIL\10-CAD\20-Shts\2920.04-Water_Sewer Plan.dwg

LIMITS OF IL COMMONS CONSTRUCTION
(UNDER CONSTRUCTION)

LIMITS OF IMPROVEMENTS (TYP)

EX INDEPENDENT LIVING BUILDING

EX BUILDING

EX WET DETENTION AREA

BUILDING B
(ASSISTED MEMORY CARE)

EX GARDEN APTS
BUILDING

BUILDING H
(INDEPENDENT LIVING)

EX WET DETENTION AREA

PROPERTY LINE
(TYP)

LIMITS OF VILLA DUPLEX CONSTRUCTION
(CONSTRUCTED)

RIM ELEV. = 4.02'

0 20' 40' 80'

LEGEND

- BOUNDARY / R.O.W.
- EASEMENT / SETBACK
- WL — WATER LINE
- WW — WASTEWATER LINE
- SD — STORM DRAINAGE LINE



LOCATION MAP
SCALE: N.T.S.

PAVEMENT PLAN KEY NOTES

1	WHITE DIRECTIONAL ARROW
2	WHITE PARKING STRIPING
3	CROSS WALK
4	STOP SIGN
5	STOP BAR

NOT AUTHORIZED FOR CONSTRUCTION PRIOR TO FORMAL CITY APPROVAL

CERT NO: 6991
WGInc.com
2035 VISTA PARKWAY, WEST PALM BEACH, FLORIDA 33411
561.687.2220

PRELIMINARY

NOT FOR CONSTRUCTION, BIDDING, OR PERMIT PURPOSES.

PREPARED UNDER THE SUPERVISION OF
CHRIS J. HOLMES
P.E. #66344
ON 2025-02-26

THE WATERFORD
PRELIMINARY CIVIL ENGINEERING PLANS
601 UNIVERSE BOULEVARD
JUNO BEACH, FLORIDA 33408

SIGNING AND PAVEMENT MARKING PLAN

SHEET
C-501

2920.04

SAVED: 2/26/2025 11:47 AM
PLOTTED: 2/26/2025 11:48 AM
PLOTTED BY: KYLE MCMULLEN
PLOTTED: K:\JOBS\2920.04 waterford campus redev\CIVIL\10-CAD\20-Site\2920.04-Signage and Marking.dwg

South Florida Water Management District
Individual Environmental Resource Permit No. 50-106597-P
Date Issued: October 10, 2022

Permittee: Lifespace Communities, Inc
4201 Corporate Drive
West Des Moines, IA 50266-5906

Project: The Waterford

Application No. 220126-32841

Location: Palm Beach County, See Exhibit 1

Your application for an Individual Environmental Resource Permit is approved. This action is taken based on Chapter 373, Part IV, of Florida Statutes (F.S.) and the rules in Chapter 62-330, Florida Administrative Code (F.A.C.). Unless otherwise stated, this permit constitutes certification of compliance with state water quality standards under section 401 of the Clean Water Act, 33 U.S.C. 1341, and a finding of consistency with the Florida Coastal Management Program. Please read this entire agency action thoroughly and understand its contents.

This permit is subject to:

- Not receiving a filed request for a Chapter 120, F.S., administrative hearing.
- The attached General Conditions for Environmental Resource Permits.
- The attached Special Conditions.
- All referenced Exhibits.

All documents are available online through the District's ePermitting site at www.sfwmd.gov/ePermitting.

If you object to these conditions, please refer to the attached "Notice of Rights" which addresses the procedures to be followed if you desire a public hearing or other review of the proposed agency action. Please contact this office if you have any questions concerning this matter. If we do not hear from you in accordance with the "Notice of Rights", we will assume that you concur with the District's action.

The District does not publish notices of action. If you wish to limit the time within which a person may request an administrative hearing regarding this action, you are encouraged to publish, at your own expense, a notice of agency action in the legal advertisement section of a newspaper of general circulation in the county or counties where the activity will occur. Legal requirements and instructions for publishing a notice of agency action, as well as a noticing format that can be used, are available upon request. If you publish a notice of agency action, please send a copy of the affidavit of publication provided by the newspaper to the District's West Palm Beach office for retention in this file.

If you have any questions regarding your permit or need any other information, please call us at 1-800-432-2045 or email epermits@sfwmd.gov.

Jesse Markle, P.E.
Bureau Chief, Environmental Resource Bureau

South Florida Water Management District
Individual Environmental Resource Permit No. 50-106597-P

Date Issued: October 10, 2022	**Expiration Date:** October 10, 2027
Project Name:	The Waterford
Permittee:	Lifespace Communities, Inc 4201 Corporate Drive West Des Moines, IA 50266-5906
Operating Entity:	Lifespace Communities, Inc 4201 Corporate Drive West Des Moines, IA 50266-5906
Location:	Palm Beach County
Permit Acres:	15.97 acres
Project Land Use:	Residential
Special Drainage District:	N/A
Water Body Classification:	Class III
FDEP Water Body ID:	3226W1
Conservation Easement to District:	No
Sovereign Submerged Lands:	No

Project Summary
This Environmental Resource Permit (ERP) authorizes Construction and Operation of a stormwater management (SWM) system serving 15.97 acres of residential development known as The Waterford.

The proposed works include demolition of existing features and construction of four residential buildings, one healthcare building, and one commons/lobby building with associated parking and infrastructure improvements. The SWM system proposes collection and conveyance to an expanded wet detention pond and to a relocated wet detention pond for water quality treatment and attenuation prior to discharging into the Universe Blvd. drainage system and ultimately to the Intracoastal Waterway system. The proposed entrance turn lane from Universe Blvd. is exempt from permitting pursuant to 62-330.051(4)(c)4.b, F.A.C. Refer to Exhibit Nos. 2.0 and 2.1 for SWM plans and calculations, respectively.

Issuance of this permit constitutes certification of compliance with state water quality standards in accordance with Rule 62-330.062, F.A.C..

Site Description
The project site is an existing senior living community located at 601 Universe Blvd. in Juno Beach, Palm Beach County. Refer to Exhibit No. 1.0 for a location map.

For information on wetland and other surface water (OSW) impacts, please see the Wetlands and OSWs section of this permit.

Background
Permit No. 50-00784-S, Application No. 05300-C granted construction authorization for a SWM system to serve a 16.65-acre residential facility known as The Waterford. ERP No. 50-103511-P, Application No. 200521-3510, issued August 7, 2020, authorized construction and operation of a SWM system serving 15.97 acres of residential development known as The Waterford.

Ownership, Operation and Maintenance
Perpetual operation and maintenance of the SWM system will be the responsibility of Lifespace Communities, Inc. Upon conveyance or division of ownership or control of the property or the system, the permittee must notify the Agency in writing within 30 days, and the new owner must request transfer of the permit.

Engineering Evaluation:

Land Use
Refer to the Engineering Data Tables for land use details.

Water Quality
The project is located within a watershed identified by the Florida Department of Environmental Protection as impaired; therefore, the design includes a site-specific pollutant loading analysis and an additional 50% water quality treatment volume above the amounts required pursuant to Section 4.2.1, ERP Applicant's Handbook (AH) Volume (Vol.) II, as reasonable assurances that the project's discharge will not cause or contribute to violations of State water quality standards. The project provides 3.21-ft of water quality treatment.

The project includes implementation of a Turbidity and Erosion Control Plan, (Exhibit No. 2.0), as additional reasonable assurance of compliance with water quality criteria during construction.

Water Quantity

Discharge
The discharge rate is based on the permitted 25-year/24-hour design storm. As found in the Water Quantity Data Table and Exhibit No. 2.1, the project discharge is within the allowable limit for the area.

Parking Lot Design
As found in the Water Quantity Data Table, minimum parking lot elevations have been set at or above the calculated design storm flood elevation.

Perimeter Berm
As found in the Water Quantity Data Table, perimeter berm elevations have been set at or above the calculated design storm flood elevation.

Finished Floors
As found in the Water Quantity Data Table, minimum finished floor elevations have been set at or above the calculated design storm flood elevation.

Certification, Operation, and Maintenance
Pursuant to Chapter 62-330.310, F.A.C., Individual Permits will not be converted from the construction phase to the operation phase until construction completion certification of the project is submitted to and accepted by the District. This includes compliance with all permit conditions, except for any long term maintenance and monitoring requirements. It is suggested that the permittee retain the services of an appropriate professional registered in the State of Florida for periodic observation of construction of the project.

For projects permitted with an operating entity that is different from the permittee, it should be noted that until the construction completion certification is accepted by the District and the permit is transferred to an acceptable operating entity pursuant to Sections 12.1 - 12.3, ERP AH Vol. I and Section 62-330.310, F.A.C., the permittee is liable for operation and maintenance in compliance with the terms and conditions of this permit.

In accordance with Section 373.416(2), F.S., unless revoked or abandoned, all SWM systems and works permitted under Part IV of Chapter 373, F.S., must be operated and maintained in perpetuity.

The efficiency of SWM systems, dams, impoundments, and most other project components will decrease over time without periodic maintenance. The operation and maintenance entity must perform periodic inspections to identify if there are any deficiencies in structural integrity, degradation due to insufficient maintenance, or improper operation of projects that may endanger public health, safety, or welfare, or the water resources. If deficiencies are found, the operation

and maintenance entity is responsible for correcting the deficiencies in a timely manner to prevent compromises to flood protection and water quality. See Section 12.4, ERP AH Vol. I for Minimum Operation and Maintenance Standards.

Notable project components requiring routine inspection and maintenance may include but are not limited to:

- Side slopes for stormwater lakes and ponds – maintain side slopes no steeper than 4:1 (horizontal:vertical) to a depth of 2.0 feet below the control elevation and nurtured or planted from 2.0 feet below to 1.0 feet above the control elevation pursuant to Section 5.4.2, ERP AH Vol. II.

- Conveyance pipes, conveyance structures and discharge structures – all pipes and structures must be inspected for structural integrity and be maintained clear of trash, sediment and vegetative debris.

- Exfiltration trenches – all pipes and structures must be inspected for structural integrity and be maintained clear of trash, sediment and vegetative debris.

- Swales – maintain the permitted cross-section and vegetative cover.

- Underground storage facilities – all facilities must be inspected for structural integrity and be maintained clear of trash, sediment and vegetative debris.

- Pumps – float switches should be inspected and any obstructions removed to ensure proper operation; intake and discharge pipes should be maintained clear of trash, sediment and vegetative debris; motors should be maintained to ensure proper operation.

Engineering Evaluation Tables:

Land Use

Basin	Land Type	Area (ac)	% of Total Basin
Waterford Basin: Ponds 1 & 2	Building Coverage	4.68	29.30
	Pavement	5.30	33.19
	Wet Detention	1.15	7.20
	Open Space	4.84	30.31
	Total:	15.97	100%

Water Quality

Basin	Treatment Type	Treatment System	Volume Required (ac-ft)	Volume Provided (ac-ft)	Area (ac)	Overflow Elevation (ft NAVD88)
Waterford Basin: Ponds 1 & 2	Treatment	WET DETENTION	3.21	3.21	1.15	4.15

Water Quantity

Basin	Elevation Type	Storm Event (Yr/Day)	Precipitation Depth (in)	Peak Stage (ft NAVD88)	Min. EL (ft NAVD88)	Peak Discharge Rate (cfs)	Allowable Discharge Rate (cfs)
Waterford Basin: Ponds 1 & 2	Finished Floor	100Y3D	16.50	7.32	7.50	N/A	N/A
	Perimeter Berm/ Discharge	25YR1D	11.00	5.58	6.93	18.54	18.98
	Parking Lot	5YR1D	6.60	4.80	4.80	N/A	N/A

Bleeder

Basin	Control EL (ft NAVD88)	Structure #	Structure Type	Count	Type	Dia.(in)	Invert EL (ft NAVD88)	Receiving Body
Waterford Basin: Ponds 1 & 2	1.50	CS-1	Water Quality	1	Circular Orifice	3.00	1.50	Universe Blvd. to Intracoastal

Inlets

Basin	Control EL (ft NAVD88)	Structure #	Structure Type	Count	Type	Length (in)	Width (in)	Crest EL (ft NAVD88)	Receiving Body
Waterford Basin: Ponds 1 & 2	1.50	CS-1	Discharge	1	INLET	66.0	48.0	5.15	Universe Blvd. to Intracoastal

Weir

Basin	Control EL (ft NAVD88)	Structure #	Structure Type	Count	Type	Width (in)	Height (in)	Crest EL (ft NAVD88)	Receiving Body
Waterford Basin: Ponds 1 & 2	1.50	CS-1	Discharge	1	V-Notch	12.00	12.00	4.15	Universe Blvd. to Intracoastal

Environmental Evaluation:

Wetlands and OSWs
There are no wetlands or OSWs located within the project site or affected by this project.

The project includes filling of an existing, previously permitted, SWM lake. In accordance with rules 62-340.700(5) and (7), F.A.C., the lake is not delineated as OSWs because it meets the exemption criteria in rule 62-340.700(2)(a), F.A.C.

Related Concerns:

Water Use Permit Status
Water Use Permit No. 50-09059-W is in effect for landscape irrigation at the project site.

The permittee has indicated that dewatering is required for construction of this project. The applicant has demonstrated that proposed dewatering qualifies for the permit by rule under Rule 40E-2.061, F.A.C.

This permit does not release the permittee from obtaining all necessary Water Use authorization(s) prior to the commencement of activities which will require such authorization, including construction dewatering and irrigation.

Water and Wastewater Service
Seacoast Utility Authority.

Historical/ Archeological Resources
The District has received correspondence from the Florida Department of State, Division of Historical Resources indicating that no significant archaeological or historical resources are recorded on the project site; therefore, the project is unlikely to have an effect upon any such resources.

This permit does not release the permittee from complying with any other agencies requirements in the event that historical and/or archaeological resources are found on the site.

General Conditions for Individual Environmental Resource Permits, 62-330.350, F.A.C.

1. All activities shall be implemented following the plans, specifications and performance criteria approved by this permit. Any deviations must be authorized in a permit modification in accordance with rule 62-330.315, F.A.C. Any deviations that are not so authorized may subject the permittee to enforcement action and revocation of the permit under Chapter 373, F.S.

2. A complete copy of this permit shall be kept at the work site of the permitted activity during the construction phase, and shall be available for review at the work site upon request by the Agency staff. The permittee shall require the contractor to review the complete permit prior to beginning construction.

3. Activities shall be conducted in a manner that does not cause or contribute to violations of state water quality standards. Performance-based erosion and sediment control best management practices shall be installed immediately prior to, and be maintained during and after construction as needed, to prevent adverse impacts to the water resources and adjacent lands. Such practices shall be in accordance with the State of Florida Erosion and Sediment Control Designer and Reviewer Manual (Florida Department of Environmental Protection and Florida Department of Transportation, June 2007), and the Florida Stormwater Erosion and Sedimentation Control Inspector's Manual (Florida Department of Environmental Protection, Nonpoint Source Management Section, Tallahassee, Florida, July 2008), which are both incorporated by reference in subparagraph 62-330.050(9)(b)5., F.A.C., unless a project-specific erosion and sediment control plan is approved or other water quality control measures are required as part of the permit.

4. At least 48 hours prior to beginning the authorized activities, the permittee shall submit to the Agency a fully executed Form 62-330.350(1), "Construction Commencement Notice," (October 1, 2013), (http://www.flrules.org/Gateway/reference.asp?No=Ref-02505), incorporated by reference herein, indicating the expected start and completion dates. A copy of this form may be obtained from the Agency, as described in subsection 62-330.010(5), F.A.C., and shall be submitted electronically or by mail to the Agency. However, for activities involving more than one acre of construction that also require a NPDES stormwater construction general permit, submittal of the Notice of Intent to Use Generic Permit for Stormwater Discharge from Large and Small Construction Activities, DEP Form 62-621.300(4)(b), shall also serve as notice of commencement of construction under this chapter and, in such a case, submittal of Form 62-330.350(1) is not required.

5. Unless the permit is transferred under rule 62-330.340, F.A.C., or transferred to an operating entity under rule 62-330.310, F.A.C., the permittee is liable to comply with the plans, terms, and conditions of the permit for the life of the project or activity.

6. Within 30 days after completing construction of the entire project, or any independent portion of the project, the permittee shall provide the following to the Agency, as applicable:
   a. For an individual, private single-family residential dwelling unit, duplex, triplex, or quadruplex- "Construction Completion and Inspection Certification for Activities Associated With a Private Single-Family Dwelling Unit"[Form 62-330.310(3)]; or
   b. For all other activities- "As-Built Certification and Request for Conversion to Operational Phase" [Form 62-330.310(1)].
   c. If available, an Agency website that fulfills this certification requirement may be used in lieu of the form.

7. If the final operation and maintenance entity is a third party:
   a. Prior to sales of any lot or unit served by the activity and within one year of permit issuance, or within 30 days of as-built certification, whichever comes first, the permittee shall submit, as

applicable, a copy of the operation and maintenance documents (see sections 12.3 thru 12.3.4 of Volume I) as filed with the Florida Department of State, Division of Corporations, and a copy of any easement, plat, or deed restriction needed to operate or maintain the project, as recorded with the Clerk of the Court in the County in which the activity is located.
b. Within 30 days of submittal of the as-built certification, the permittee shall submit "Request for Transfer of Environmental Resource Permit to the Perpetual Operation and Maintenance Entity" [Form 62-330.310(2)] to transfer the permit to the operation and maintenance entity, along with the documentation requested in the form. If available, an Agency website that fulfills this transfer requirement may be used in lieu of the form.

8. The permittee shall notify the Agency in writing of changes required by any other regulatory agency that require changes to the permitted activity, and any required modification of this permit must be obtained prior to implementing the changes.

9. This permit does not:
   a. Convey to the permittee any property rights or privileges, or any other rights or privileges other than those specified herein or in Chapter 62-330, F.A.C.;
   b. Convey to the permittee or create in the permittee any interest in real property;
   c. Relieve the permittee from the need to obtain and comply with any other required federal, state, and local authorization, law, rule, or ordinance; or
   d. Authorize any entrance upon or work on property that is not owned, held in easement, or controlled by the permittee.

10. Prior to conducting any activities on state-owned submerged lands or other lands of the state, title to which is vested in the Board of Trustees of the Internal Improvement Trust Fund, the permittee must receive all necessary approvals and authorizations under Chapters 253 and 258, F.S. Written authorization that requires formal execution by the Board of Trustees of the Internal Improvement Trust Fund shall not be considered received until it has been fully executed.

11. The permittee shall hold and save the Agency harmless from any and all damages, claims, or liabilities that may arise by reason of the construction, alteration, operation, maintenance, removal, abandonment or use of any project authorized by the permit.

12. The permittee shall notify the Agency in writing:
    a. Immediately if any previously submitted information is discovered to be inaccurate; and
    b. Within 30 days of any conveyance or division of ownership or control of the property or the system, other than conveyance via a long-term lease, and the new owner shall request transfer of the permit in accordance with Rule 62-330.340, F.A.C. This does not apply to the sale of lots or units in residential or commercial subdivisions or condominiums where the stormwater management system has been completed and converted to the operation phase.

13. Upon reasonable notice to the permittee, Agency staff with proper identification shall have permission to enter, inspect, sample and test the project or activities to ensure conformity with the plans and specifications authorized in the permit.

14. If prehistoric or historic artifacts, such as pottery or ceramics, projectile points, stone tools, dugout canoes, metal implements, historic building materials, or any other physical remains that could be associated with Native American, early European, or American settlement are encountered at any time within the project site area, the permitted project shall cease all activities involving subsurface disturbance in the vicinity of the discovery. The permittee or other designee shall contact the Florida Department of State, Division of Historical Resources, Compliance Review Section (DHR), at (850)245-6333, as well as the appropriate permitting agency office. Project activities shall not resume without verbal or written authorization from

the Division of Historical Resources. If unmarked human remains are encountered, all work shall stop immediately and the proper authorities notified in accordance with section 872.05, F.S. For project activities subject to prior consultation with the DHR and as an alternative to the above requirements, the permittee may follow procedures for unanticipated discoveries as set forth within a cultural resources assessment survey determined complete and sufficient by DHR and included as a specific permit condition herein.

15. Any delineation of the extent of a wetland or other surface water submitted as part of the permit application, including plans or other supporting documentation, shall not be considered binding unless a specific condition of this permit or a formal determination under Rule 62-330.201, F.A.C., provides otherwise.

16. The permittee shall provide routine maintenance of all components of the stormwater management system to remove trapped sediments and debris. Removed materials shall be disposed of in a landfill or other uplands in a manner that does not require a permit under Chapter 62-330, F.A.C., or cause violations of state water quality standards.

17. This permit is issued based on the applicant's submitted information that reasonably demonstrates that adverse water resource-related impacts will not be caused by the completed permit activity. If any adverse impacts result, the Agency will require the permittee to eliminate the cause, obtain any necessary permit modification, and take any necessary corrective actions to resolve the adverse impacts.

18. A Recorded Notice of Environmental Resource Permit may be recorded in the county public records in accordance with Rule 62-330.090(7), F.A.C. Such notice is not an encumbrance upon the property.

Special Conditions for Individual Environmental Resource Permits, 62-330.350, F.A.C.

1. The construction authorization for this permit shall expire on the date shown on page 2.

2. Operation and maintenance of the SWM system shall be the responsibility of Lifespace Communities, Inc. The permittee shall notify the Agency in writing within 30 days of any conveyance or division of ownership or control of the property of the system, and the new owner must request transfer of the permit in accordance with Rule 62-330.340, F.A.C.

3. A stable, permanent and accessible elevation reference shall be established on or within 100 feet of all permitted discharge structures no later than the submission of the certification report. The location of the elevation reference must be noted on or with the certification report.

4. Lake side slopes shall be no steeper than 4:1 (horizontal:vertical) to a depth of 2.0 feet below the control elevation. Side slopes shall be nurtured or planted from 2.0 feet below to 1.0 feet above control elevation to insure vegetative growth.

5. Prior to initiating construction activities associated with this ERP, the permittee is required to hold a pre-construction meeting with field representatives, consultants, contractors, District Environmental Resource Bureau (ERB) staff, and any other local government entities as necessary. The purpose of the pre-construction meeting is to discuss construction methods, sequencing, best management practices, identify work areas, staking and roping of preserves where applicable, and to facilitate coordination and assistance amongst relevant parties. To schedule a pre-construction meeting, please contact ERB staff from the West Palm Beach Office at (561) 686-8800 or via e-mail at: precon@sfwmd.gov. When sending a request for a pre-construction meeting, please include the application number, permit number, and contact name and phone number.

6. This permit does not authorize the permittee to cause any adverse impact to or “take” of state listed species and other regulated species of fish and wildlife. Compliance with state laws regulating the take of fish and wildlife is the responsibility of the owner or permittee associated with this project. Please refer to Chapter 68A-27, F.A.C. for definitions of “take” and a list of fish and wildlife species. If listed species are observed onsite, FWC staff are available to provide decision support information or assist in obtaining the appropriate FWC permits. Most marine endangered and threatened species are statutorily protected and a “take” permit cannot be issued. Requests for further information or review can be sent to: FWCConservationPlanningServices@MyFWC.com.

Project Work Schedule for Permit No. 50-106597-P

The following activities are requirements of this Permit and shall be completed in accordance with the Project Work Schedule below. Please refer to General Conditions, Special Conditions and/or Specific Conditions for more information. Any deviation from these time frames will require prior approval from the District's Environmental Resources Bureau and may require a minor modification to this permit. Such requests must be made in writing and shall include: (1) reason for the change, (2) proposed start/finish and/or completion dates, and (3) progress report on the status of the project.

Condition No.	Date Added	Description (Application Number)	Due Date	Date Satisfied
GC 4	10/10/2022	Construction Commencement Notice	Prior to Construction	
GC 6	10/10/2022	Submit Certification	30 Days After Construction Completion	
SC 5	10/10/2022	Pre-Construction Meeting	Prior to Construction	

GC = General Condition

SC = Special Condition

Distribution List

Travis Douglas, WGI

Div of Recreation and Park - District 5

US Army Corps of Engineers - Permit Section

Lake Worth Drainage District

Palm Beach County - Environmental Resource Management

Palm Beach County Engineer

City Of Greenacres

Exhibits

The following exhibits to this permit are incorporated by reference. The exhibits can be viewed by clicking on the links below or by visiting the District's ePermitting website at http://my.sfwmd.gov/ePermitting and searching under this application number 220126-32841 .

Exhibit No. 1.0 Location Map

Exhibit No. 2.0 SWM Plans

Exhibit No. 2.1 Calculations

NOTICE OF RIGHTS

As required by Chapter 120, Florida Statutes, the following provides notice of the opportunities which may be available for administrative hearing pursuant to Sections 120.569 and 120.57, Florida Statutes, or judicial review pursuant to Section 120.68, Florida Statutes, when the substantial interests of a party are determined by an agency. Please note that this Notice of Rights is not intended to provide legal advice. Some of the legal proceedings detailed below may not be applicable or appropriate for your situation. You may wish to consult an attorney regarding your legal rights.

RIGHT TO REQUEST ADMINISTRATIVE HEARING

A person whose substantial interests are or may be affected by the South Florida Water Management District's (District) action has the right to request an administrative hearing on that action pursuant to Sections 120.569 and 120.57, Florida Statutes. Persons seeking a hearing on a District decision which affects or may affect their substantial interests shall file a petition for hearing in accordance with the filing instructions set forth herein within 21 days of receipt of written notice of the decision unless one of the following shorter time periods apply: (1) within 14 days of the notice of consolidated intent to grant or deny concurrently reviewed applications for environmental resource permits and use of sovereign submerged lands pursuant to Section 373.427, Florida Statutes; or (2) within 14 days of service of an Administrative Order pursuant to Section 373.119(1), Florida Statutes. "Receipt of written notice of agency decision" means receipt of written notice through mail, electronic mail, posting, or publication that the District has taken or intends to take final agency action. Any person who receives written notice of a District decision and fails to file a written request for hearing within the timeframe described above waives the right to request a hearing on that decision.

If the District takes final agency action that materially differs from the noticed intended agency decision, persons who may be substantially affected shall, unless otherwise provided by law, have an additional point of entry pursuant to Rule 28-106.111, Florida Administrative Code.

Any person to whom an emergency order is directed pursuant to Section 373.119(2), Florida Statutes, shall comply therewith immediately, but on petition to the board shall be afforded a hearing as soon as possible.

A person may file a request for an extension of time for filing a petition. The District may grant the request for good cause. Requests for extension of time must be filed with the District prior to the deadline for filing a petition for hearing. Such requests for extension shall contain a certificate that the moving party has consulted with all other parties concerning the extension and whether the District and any other parties agree to or oppose the extension. A timely request for an extension of time shall toll the running of the time period for filing a petition until the request is acted upon.

FILING INSTRUCTIONS

A petition for administrative hearing must be filed with the Office of the District Clerk. Filings with the Office of the District Clerk may be made by mail, hand-delivery, or e-mail. Filings by facsimile will not be accepted. A petition for administrative hearing or other document is deemed filed upon receipt during normal business hours by the Office of the District Clerk at the District's headquarters in West Palm Beach, Florida. The District's normal business hours are 8:00 a.m. – 5:00 p.m., excluding weekends and District holidays. Any document received by the Office of the District Clerk after 5:00 p.m. shall be deemed filed as of 8:00 a.m. on the next regular business day.

Additional filing instructions are as follows:

- Filings by mail must be addressed to the Office of the District Clerk, 3301 Gun Club Road, West Palm Beach, Florida 33406.
- Filings by hand-delivery must be delivered to the Office of the District Clerk. Delivery of a petition to the District's security desk does not constitute filing. It will be necessary to request that the District's security officer contact the Office of the District Clerk. An employee of the District's Clerk's office will receive and process the petition.
- Filings by e-mail must be transmitted to the Office of the District Clerk at clerk@sfwmd.gov. The filing date for a document transmitted by electronic mail shall be the date the Office of the District Clerk receives the complete document.

INITIATION OF ADMINISTRATIVE HEARING

Pursuant to Sections 120.54(5)(b)4. and 120.569(2)(c), Florida Statutes, and Rules 28-106.201 and 28-106.301, Florida Administrative Code, initiation of an administrative hearing shall be made by written petition to the District in legible form and on 8 1/2 by 11 inch white paper. All petitions shall contain:

1. Identification of the action being contested, including the permit number, application number, District file number or any other District identification number, if known.
2. The name, address, any email address, any facsimile number, and telephone number of the petitioner, petitioner's attorney or qualified representative, if any.
3. An explanation of how the petitioner's substantial interests will be affected by the agency determination.
4. A statement of when and how the petitioner received notice of the District's decision.
5. A statement of all disputed issues of material fact. If there are none, the petition must so indicate.
6. A concise statement of the ultimate facts alleged, including the specific facts the petitioner contends warrant reversal or modification of the District's proposed action.
7. A statement of the specific rules or statutes the petitioner contends require reversal or modification of the District's proposed action.
8. If disputed issues of material fact exist, the statement must also include an explanation of how the alleged facts relate to the specific rules or statutes.
9. A statement of the relief sought by the petitioner, stating precisely the action the petitioner wishes the District to take with respect to the District's proposed action.

MEDIATION

The procedures for pursuing mediation are set forth in Section 120.573, Florida Statutes, and Rules 28-106.111 and 28-106.401–.405, Florida Administrative Code. The District is not proposing mediation for this agency action under Section 120.573, Florida Statutes, at this time.

RIGHT TO SEEK JUDICIAL REVIEW


Pursuant to Section 120.68, Florida Statutes, and in accordance with Florida Rule of Appellate Procedure 9.110, a party who is adversely affected by final District action may seek judicial review of the District's final decision by filing a notice of appeal with the Office of the District Clerk in accordance with the filing instructions set forth herein within 30 days of rendition of the order to be reviewed, and by filing a copy of the notice with the appropriate district court of appeals via the Florida Courts E-Filing Portal.

EXTERIOR COLOR PALETTE

A. SW7028 - INCREDIBLE WHITE
B. SW7030 - ANEW GRAY
C. SW7018 - DOVETAIL
D. SW7020 - BLACK FOX



4 EXTERIOR ELEVATION - 4
3/32" = 1'-0"

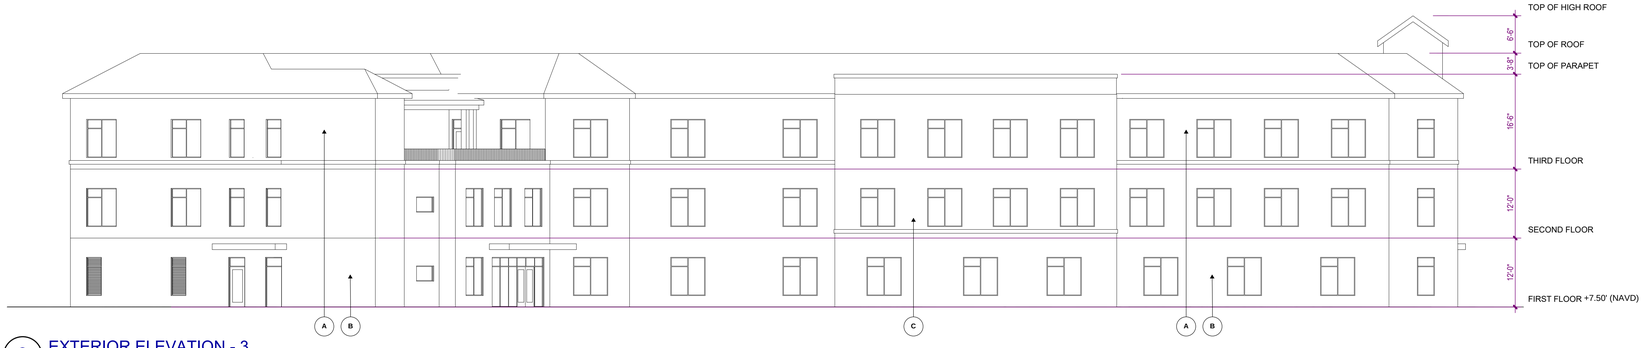

3 EXTERIOR ELEVATION - 3
3/32" = 1'-0"



2 EXTERIOR ELEVATION - 2
3/32" = 1'-0"



1 EXTERIOR ELEVATION - 1
3/32" = 1'-0"

NO.	DATE	DESCRIPTION

WATERFORD CAMPUS - ASSISTED LIVING MEMORY CARE BUILDING

601 UNIVERSE BLVD JUNO BEACH , FL 33048

THW DESIGN

COPYRIGHT © 2017
THOMPSON HANCOCK WITTE & ASSOCIATES, INC.

2100 RiverEdge Parkway
Suite 900
Atlanta, GA 30328

2632 Broadway Street
Suite 201, South Building
San Antonio, TX 78215

PH: 770 916 2220
FAX: 770 916 2299

www.thw.com

PRELIMINARY DRAWINGS. NOT TO BE USED FOR RECORDING, IMPLEMENTATION, REGULATORY APPROVAL, PERMITTING, OR CONSTRUCTION.

ENTITLEMENT

Project No.: 2021009
Date: 11/04/24

EXTERIOR ELEVATIONS

A-200

c:\Users\dgruss\Documents\2021009_WCR_MC-AL-BLDG_ARCH_R24__davidgruss.rvt

2/6/2025 10:06:27 AM

EXTERIOR COLOR PALETTE

A. SW7028 - INCREDIBLE WHITE
B. SW7030 - ANEW GRAY
C. SW7018 - DOVETAIL
D. SW7020 - BLACK FOX

NO.	DATE	DESCRIPTION



3 ELEVATION - 3
3/32" = 1'-0"



2 ELEVATION - 2
3/32" = 1'-0"



1 ELEVATION - 1
3/32" = 1'-0"

WATERFORD CAMPUS
IL BUILDING
601 UNIVERSE BLVD. JUNO BEACH, FL 33408

THW DESIGN

COPYRIGHT © 2017
THOMPSON HANCOCK WITTE & ASSOCIATES, INC.

2100 RiverEdge Parkway
Suite 900
Atlanta, GA 30328

PH: 770 916 2220
FAX: 770 916 2299

www.thw.com

PRELIMINARY DRAWINGS. NOT TO BE USED FOR RECORDING, IMPLEMENTATION, REGULATORY APPROVAL, PERMITTING, OR CONSTRUCTION.

Project Status

Project No.: 2021009
Date:

EXTERIOR ELEVATIONS

A-200

c:\Users\dgruss\Documents\2021009_WCR_IL-BLDG_ARCH_R24_davidgruss.rvt

2/6/2025 2:59:36 PM

EXTERIOR COLOR PALETTE

A. SW7028 - INCREDIBLE WHITE
B. SW7030 - ANEW GRAY
C. SW7018 - DOVETAIL
D. SW7020 - BLACK FOX

NO.	DATE	DESCRIPTION



3 ELEVATION - 6
3/32" = 1'-0"



2 ELEVATION - 5
3/32" = 1'-0"



1 ELEVATION - 4
3/32" = 1'-0"

WATERFORD CAMPUS
IL BUILDING
601 UNIVERSE BLVD. JUNO BEACH, FL 33408

THW
DESIGN

COPYRIGHT © 2017
THOMPSON HANCOCK WITTE & ASSOCIATES, INC.

2100 RiverEdge Parkway
Suite 900
Atlanta, GA 30328

PH: 770 916 2220
FAX: 770 916 2299

www.thw.com

PRELIMINARY DRAWINGS. NOT TO BE USED FOR RECORDING, IMPLEMENTATION, REGULATORY APPROVAL, PERMITTING, OR CONSTRUCTION.

Project Status


Project No.: 2021009
Date:

EXTERIOR ELEVATIONS

A-201

c:\Users\dgruss\Documents\2021009_WCR_IL-BLDG_ARCH_R24_davidgruss.rvt

2/6/2025 2:59:36 PM

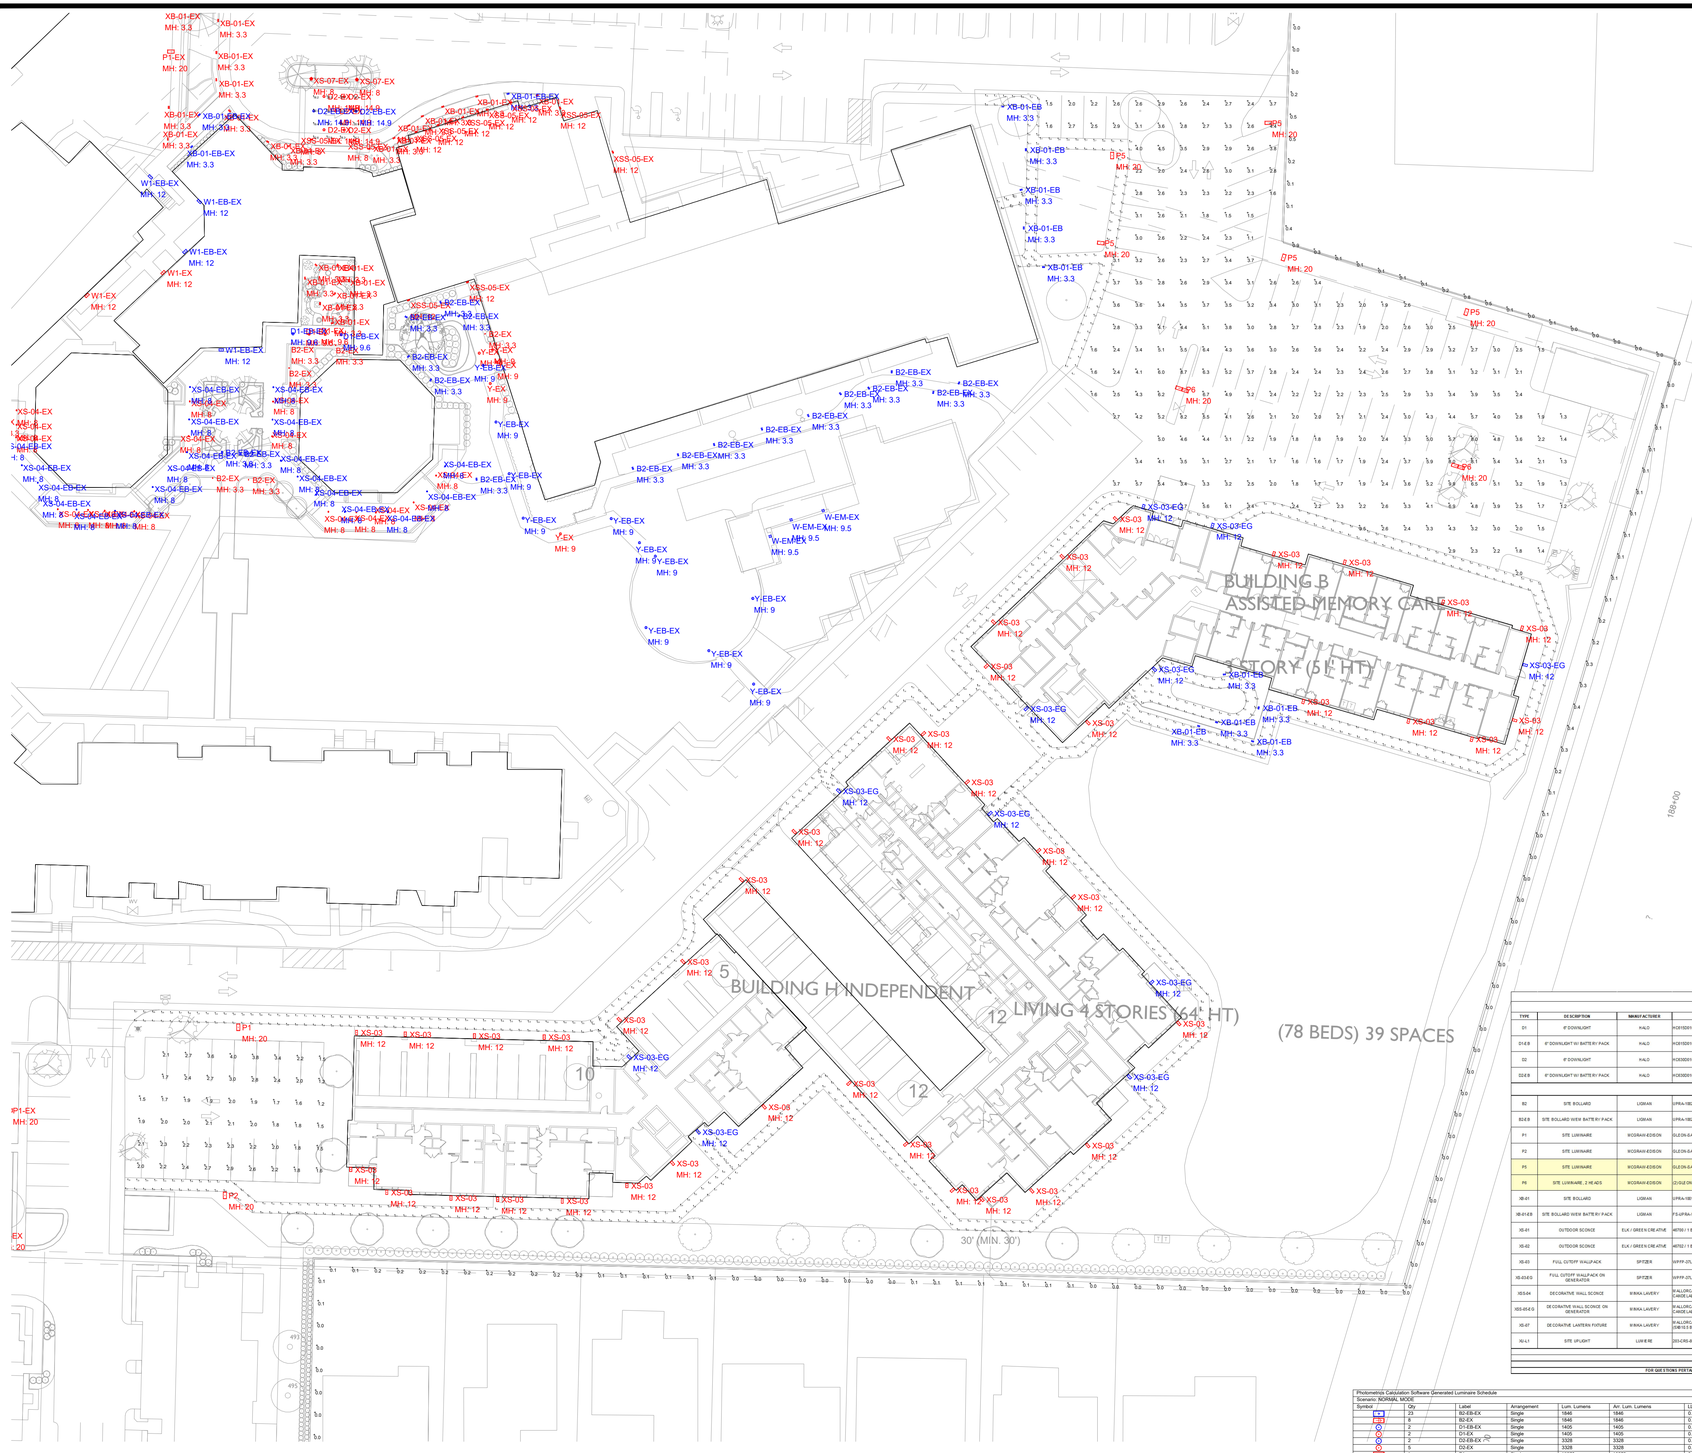

THE WATERFORD
LIGHTING FIXTURE SCHEDULE

TYPE	DESCRIPTION	MANUFACTURER	CATALOG NUMBER	VOLT	LAMP COLOR	LUMENS	LAMP TYPE	DIM TYPE	WATTS	MOUNTING	NOTES
D1	6" DOWNLIGHT	HALO	HCR150510 H1R950930 610 HDW	120V	3000	1500	LED	0-10V	14.5	RE CE SSCO	
D1-E.B	6" DOWNLIGHT W/ BATTERY PACK	HALO	HCR150910RE 6T H1R950930 610 HDW	120V	3000	1500	LED	0-10V	14.5	RE CE SSCO	
D2	8" DOWNLIGHT	HALO	HCR300510 H1R936830 610 HDC	120V	3000	3000	LED	0-10V	29.5	RE CE SSCO	
D2-E.B	8" DOWNLIGHT W/ BATTERY PACK	HALO	HCR300910RE 6T H1R936830 610 HDC	120V	3000	3000	LED	0-10V	29.5	RE CE SSCO	
SITE											
B2	SITE BOLLARD	LIGMAN	LPRA-18B22-200V-T1-W3K46-189DTTV	120V	3000	2422	LED	0-10V	20	GROUND	
B2-E.B	SITE BOLLARD W/EM BATTERY PACK	LIGMAN	LPRA-18B22-200V-T1-W3K46-189DTTV-E WG	120V	3000	2422	LED	0-10V	20	GROUND	
P1	SITE LUMINAIRE	WOODHAVEN-EDISON	GLEON-EAZD-740-U-TAFT-BK / WA1836-BK	120V	4000	15970	LED	0-10V	129	20' P.OLE	NOTE 1
P2	SITE LUMINAIRE	WOODHAVEN-EDISON	GLEON-EAZD-740-U-SLS-BK / WA1836-BK	120V	4000	8124	LED	0-10V	67	20' P.OLE	NOTE 1
P5	SITE LUMINAIRE	WOODHAVEN-EDISON	GLEON-EAZD-740-U-TAFT-BK-KSS / WA1836-BK	120V	4000	15970	LED	0-10V	129	20' P.OLE	NOTE 1
P6	SITE LUMINAIRE, 2 HEADS	WOODHAVEN-EDISON	(2) GLE ON-EAZD-740-U-TAFT-BK / WA1836-BK	120V	4000	2 X 15970	LED	0-10V	2 X 129	20' P.OLE	NOTE 1
XB-01	SITE BOLLARD	LIGMAN	LPRA-18B12-149-WE -W3K45-189DTTV	120V	3000	1660	LED	0-10V	149	GROUND	
XB-01-E.B	SITE BOLLARD W/EM BATTERY PACK	LIGMAN	PS-UPRA-18B12-149-WE-W3K45-189DTTV-E WG	120V	3000	1660	LED	0-10V	149	GROUND	
XS-01	OUTDOOR SCONCE	ELK / GREEN CREATIVE	46782 / 1 BULB 36752	120V	3000	1150	LED	N/A	1090	WALL	
XS-02	OUTDOOR SCONCE	ELK / GREEN CREATIVE	46782 / 1 BULB 36752	120V	3000	1150	LED	N/A	1090	WALL	
XS-03	FULL CUTOFF WALLPACK	SPITZER	WPFP-27LC-UCC-TS-CCP-WSH	120V	3000/4000/5000	3700	LED	0-10V	2440	WALL	
XS-03-EG	FULL CUTOFF WALLPACK ON GENERATOR	SPITZER	WPFP-27LC-UCC-TS-CCP-WSH	120V	3000/4000/5000	3700	LED	0-10V	2440	WALL	
XS-04	DECORATIVE WALL SCONCE	WINKA LAVERY	M MALLORCA OUTDOOR WALL LANTERN - WK129183 (QB)11 CANDELABRA E26 BULB)	120V	3000	PER BULB	LED	N/A	1090	WALL	
XS-05-E.B	DECORATIVE WALL SCONCE ON GENERATOR	WINKA LAVERY	M MALLORCA OUTDOOR POCKET LIGHT - WK1287/05 (2)A15 CANDELABRA E12 BULB)	120V	3000	PER BULB	INCANDESCENT	N/A	1200W	WALL	
XS-07	DECORATIVE LANTERN FIXTURE	WINKA LAVERY	M MALLORCA OUTDOOR WALL LANTERN - 89825-AZB + 41" (QB)11.5 BULB)	120V	3000	PER BULB	LED	N/A	60W/ BULB	WALL	
XU-L1	SITE UPLIGHT	LUMIERE	305-CRS-BLED-30-36-12-F/WSH	12V	3000	360	LED	N/A	6W	GROUND	
FIXTURE SCHEDULE NOTE 1											
GENERAL NOTE 1: ADOBE FINISH & CRASTIC PER DRAWINGS											
NOTE 5: FUTURE MOUNTED ON 14A30SY ANCHOR BASE. 20' POLE #1500-4000TSA (QUOTE A FINISH											
FOR QUESTIONS PERTAINING TO THIS FIXTURE SCHEDULE PLEASE CONTACT LIGHTING DYNAMICS QUOTATIONS@LIGHTINGDYNAMICS.COM (954) 944-0286											

Calculation Summary
Scenario: NORMAL MODE

Label	CalcType	Units	Avg	Max	Min	Avg/Min	Max/Min
PARKING LOT N OF BLDG B	Illuminance	Fc	3.14	9.9	1.1	2.85	9.00
PARKING LOT WEST ADJACENT TO BLDG H	Illuminance	Fc	2.18	4.0	1.2	1.82	3.33
PROP LINE EAST @ SFT AFG	Illuminance	Fc	0.11	0.9	0.0	N.A.	N.A.
PROP LINE NORTH@ SFT AFG	Illuminance	Fc	0.01	0.1	0.0	N.A.	N.A.
PROP LINE S @ SFT AFG	Illuminance	Fc	0.02	0.3	0.0	N.A.	N.A.
PROP LINE S RESIDENTIAL @ SFT AFG	Illuminance	Fc	0.06	0.2	0.0	N.A.	N.A.
PROP LINE WEST @ SFT AFG	Illuminance	Fc	0.00	0.0	0.0	N.A.	N.A.
SIDEWALK 1	Illuminance	Fc	7.54	52.7	0.5	15.08	105.40
SIDEWALK 2	Illuminance	Fc	2.95	5.4	1.0	2.95	5.40
SIDEWALK 3 (BLDG B PERIMETER)	Illuminance	Fc	3.85	49.8	0.5	7.70	99.20
SIDEWALK 4 (BLDG B PEDESTRIAN PATH)	Illuminance	Fc	6.15	49.4	0.5	12.30	98.80
SIDEWALK 5 (BLDG H NORTH PERIMETER)	Illuminance	Fc	4.07	8.5	0.7	5.81	12.14
SIDEWALK 6 (BLDG H EAST PERIMETER)	Illuminance	Fc	3.66	8.6	0.6	6.10	14.33
SIDEWALK 7 (BLDG H SOUTH PERIMETER)	Illuminance	Fc	3.85	8.9	0.5	7.70	17.80

Photometrics Calculation Software Generated Luminaire Schedule
Scenario: NORMAL MODE

Symbol	Qty	Label	Arrangement	Lum. Lumens	Arr. Lum. Lumens	LLF	Lum. Watts	Arr. Watts
	23	B2-EB-EX	Single	1846	1846	0.900	20	20
	8	B2-EX	Single	1846	1846	0.900	20	20
	2	D1-EB-EX	Single	1605	1605	0.900	14	14
	2	D1-EX	Single	1605	1605	0.900	14	14
	2	D2-EB-EX	Single	3326	3326	0.900	28	28
	5	D2-EX	Single	3326	3326	0.900	28	28
	1	P1	Single	15970	15970	0.900	129	129
	9	P1-EX	Single	15970	15970	0.900	129	129
	1	P2	Single	8124	8124	0.900	67	67
	1	P2-EX	Single	8124	8124	0.900	67	67
	5	P5	Single	11273	11273	0.900	129	129
	2	P6	Back-Back	15970	31940	0.900	129	258
	3	W-EM-EX	Single	613	613	1.000	17.2	17.2
	5	W1-EB-EX	Single	9729	9729	0.900	66	66
	2	W1-EX	Single	9729	9729	0.900	66	66
	10	XB-01-EB	Single	1633	1633	0.900	13.9	13.9
	6	XB-01-EB-EX	Single	1633	1633	0.900	13.9	13.9
	27	XB-01-EX	Single	1633	1633	0.900	13.9	13.9
	2	XS-01-EX	Single	1334	1334	0.900	9.03	9.03
	41	XS-03	Single	6943	6943	0.477	23.3	23.3
	11	XS-03-EG	Single	6943	6943	0.477	23.3	23.3
	20	XS-04-EB-EX	Single	1529	1529	0.900	15.8	15.8
	16	XS-04-EX	Single	1529	1529	0.900	15.8	15.8
	2	XS-07-EX	GROUP	N.A.	2730	0.900	N.A.	25.7
	11	XSS-05-EX	GROUP	N.A.	1092	0.900	N.A.	10.28
	11	Y-EB-EX	Single	3263	3263	0.513	20	20
	5	Y-EX	Single	3263	3263	0.513	20	20

Scenario/Channel Summary
Scenario: NORMAL MODE

Channel	Switched	Dimming	# Lums
B2-EB-EX	On	1.00	23
B2-EX	On	1.00	8
D1-EB-EX	On	1.00	2
D1-EX	On	1.00	2
D2-EB-EX	On	1.00	2
D2-EX	On	1.00	5
P1	On	1.00	1
P1-EX	On	1.00	9
P2	On	1.00	1
P2-EX	On	1.00	1
P5	On	1.00	5
P6	On	1.00	2
W-EM-EX	On	1.00	3
W1-EB-EX	On	1.00	5
W1-EX	On	1.00	2
XB-01-EB	On	1.00	10
XB-01-EB-EX	On	1.00	6
XB-01-EX	On	1.00	27
XS-01-EX	On	1.00	2
XS-03	On	1.00	41
XS-03-EG	On	1.00	11
XS-04-EB-EX	On	1.00	20
XS-04-EX	On	1.00	16
XS-07-EX	On	1.00	2
XSS-05-EX	On	1.00	11
Y-EB-EX	On	1.00	11
Y-EX	On	1.00	5

LIGHTING DYNAMICS INCORPORATED

Based on the information provided, all dimensions and luminaire locations shown represent recommended positions. The engineer and/or architect must determine applicability of the layout to existing or future field conditions. This lighting pattern represents illumination levels calculated from laboratory data taken under controlled conditions utilizing current industry standard lamp ratings in accordance with Illuminating Engineering Society approved methods. Actual performance of any manufacturer's luminaire may vary due to variation in electrical voltage, tolerance in lamps and other variable field conditions.

NOTES:

No.	Revision/Issue	Date
1	PHOTOMETRIC STUDY	04/14/25

LIGHTING DYNAMICS, INC.
7835 West Commercial Blvd.
Tamarac, FL 33351
(954) 944-0286
www.lightingdynamics.com

Project Name and Address
THE WATERFORD
PHASE 2 - SITE LIGHTING STUDY
Normal Mode
Juno Beach, FL

FILE P:\PROJECTS\2023\MAR
CLIENT THW DESIGN

Project	THE WATERFORD	Sheet L0
Date	04/14/2025	
Scale	1/32" = 1'	DRAWN BY JV / MF










EXTERIOR WALL FINISH: 3-COAT DIRECT APPLIED STUCCO ON CMU BACKUP WALL - FINISH COLORS AS INDICATED ON ELEVATIONS AND BELOW:

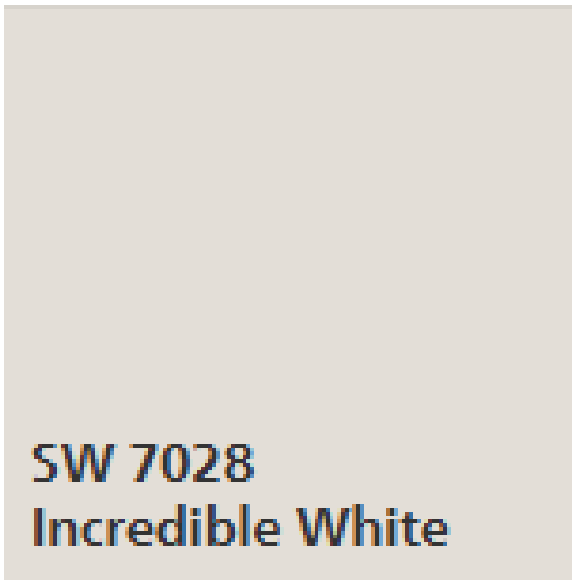







Fire Rescue
Chief Patrick J. Kennedy
405 Pike Road
West Palm Beach, FL 33411
(561) 616-7000
www.pbc.gov

Palm Beach County Board of County Commissioners
Maria G. Marino, Mayor
Sara Baxter, Vice Mayor
Gregg K. Weiss
Joel Flores
Marci Woodward
Maria Sachs
Bobby Powell, Jr.

County Administrator
Verdenia C. Baker

"An Equal Opportunity Affirmative Action Employer"

Official Electronic Letterhead

April 1, 2025

WGI
Attention: Arianna Hilliard
2035 Vista Parkway
West Palm Beach, FL 33411

Re: The Waterford

Dear Arianna Hilliard:

Per your request for response time information to the subject property located at 601 Universe Blvd, Juno Beach. This property is served currently by Palm Beach County Fire-Rescue Station #15, which is located at 12870 US Highway 1. The maximum distance traveled to subject property is approximately 1.00 mile from the station. The estimated response time to the subject property is 4 minutes 30 seconds. For fiscal year 2024, the average response time (call received to on scene) for this stations zone is 6:46.

Changing the land use of this property will have minimal impact on Fire Rescue.

If you have any further questions, please feel free to contact me at 561-616-6909.

Sincerely,

Cheryl Allan

Cheryl Allan, Planner II
Palm Beach County Fire-Rescue

Seacoast Utility Authority

Mailing Address:
4200 Hood Road
Palm Beach Gardens,
FL 33410-9602

October 5, 2022

Travis Douglas
WGI
2035 Vista Parkway
West Palm Beach, FL 33411

Re: The Waterford

Dear Mr. Douglas:

This letter is in response to your request for administration and connection fees. Should account 63500010 remain active this project is vested for 18.591 water ERC's, and 23.295 sewer ERC's for the 4,000 sf building and 24 MFU's. The following fees are based on the proposed additional 146 assisted living beds, additional 4 duplex units, 13,431 sf common building and are subject to change should plans indicate otherwise. If fountains or irrigation are planned for this project, additional connection fees will be required. Please note a Developer Agreement will be required for the additional ALF beds, common building, and single family units.

Connection Fees

53.091 assisted living ERC's x $2,700.00 (water & sewer) =	$ 143,345.70
4.884 building ERC's x $ 2,700.00 (water & sewer) =	$ 13,186.80
8 SFU duplex ERC's x $ 2,700.00 (water & sewer) =	$ 21,600.00
Connection Fees Due =	$ 178,132.50
Less 18.591 vested ERC's x $ 1,500.00 (water) =	*$ 27,886.50*
Less 23.295 vested ERC's x $ 1,200.00 (sewer) =	*$ 27,954.00*
Total Connection Fees =	**$ 122,292.00**

100% of Connection Fees are due at the time of executing the Developer Agreement.

Administration Fee:

The Administration Fee for this project in the amount of $ 6,968.16 (4% of Connection Fees) was paid via check # 1040611 on 3/11/22.

A general list of project requirements can be found on our website http:// under Project Forms (Exhibit A – Project Documentation and Submittal Guidelines). Please call Mia Galicki at 561.627.2900, ext. 1375 or email to mailto:mgalicki to schedule a pre-engineering meeting to discuss the particular items on this list and other aspects of your project prior to initiating any design work.

Sincerely,

SEACOAST UTILITY AUTHORITY

Jennifer Millette

Jennifer Millette
Engineering Services Specialist

Jeff Sabin
Public Sector Manager
Waste Management Inc. of Florida
7700 SE Bridge Road
Hobe Sound, FL 33455
772-545-1327

April 04, 2025

Arianna Hilliard
WGI
2035 Vista Parkway
West Palm Beach, FL 33411

RE: The Waterford, 601 Universe Boulevard, Juno Beach FL 3408

To whom it may concern:

Please find this letter in response to your request for confirmation of service and capacity availability for the above location. WM of Martin County can adequately accommodate the prescribed services at this location as provided for in our Solid Waste and Recyclable Materials Collection Services Agreement with the Town of Juno Beach

We appreciate the opportunity to service this location and look forward to working with the developers and builders in making it an environmentally friendly project.

If you have any questions or concerns, please contact Sales Manager Robert Holden at 561-662-9988, or me at 772-263-0017.

Sincerely,

JEFF SABIN
Public Sector Manager

Cc: Robert Holden

J F O G R O U P I N C
Traffic Engineering • Transportation Planning

www.jfogroupinc.com

Revised July 14, 2025
February 25, 2025

Sent via e-mail: Yoan.Machado@wginc.com

Yoan Machado, Senior Project Manager
WGI INC
2035 Vista Parkway
West Palm Beach, FL 33411

Re: The Waterford (Juno Beach) • WGI2920.04
PARKING STATEMENT
PCN 28-43-41-33-11-001-0000/00-43-41-32-07-000-0150/-0140/-0130/-0120/-0110/-0091/-0080

JFO Group Inc. has been retained to prepare a parking statement regarding the proposed parking supply for The Waterford development. The property is located at the southwest corner of US 1 and Universe Boulevard in the Town of Juno Beach, Florida. The Property Control Numbers associated with this project are 28-43-41-33-11-001-0000, 00-43-41-32-07-000-0150, -0140, -0130, -0120, -0110, -0091, and -0080.

Exhibit 1 contains a copy of the preliminary site plan for The Waterford property. According to the proposed plan, The Waterford project includes 380 parking spaces, whereas the code requires 353 parking spaces.

Currently, The Waterford consists of 333[1] dwelling units (DUs) with 492[2] beds, operating as Independent Living and Skilled Nursing. Additionally, it is approved for 356[3] Independent Living units (538[4] beds) and 100[5] Assisted Living beds (85[6] dwelling units) with a total of 453 parking spaces. The proposed changes aim to modify the current 638-bed approval to facilitate the redevelopment and modernization of the campus, resulting in a less intense development than previously approved.

The proposed plan will ultimately include 290 Independent Living units (478 beds) and 100 Assisted Living beds (85 dwelling units). This type of development allows residents to transition seamlessly from independent living to higher levels of care as their medical needs evolve with aging.

Given the unique characteristics of The Waterford, the 6th Edition of the *Parking Generation Manual* from the Institute of Transportation Engineers (ITE) is proposed as the basis for calculating its parking demand.

Exhibit 2 contains excerpts from the *ITE Parking Generation Manual*, detailing land use descriptions and parking rates for a Congregate Care Facility (ITE Land Use 253) and Assisted Living (ITE Land Use 254).



Figure 1 : Project Location

[1]=182 (Independent Living–Tower) + 66 (Independent Living–Gardens) + 40 (Independent Living–Villas) + 45 (Skilled Nursing)
[2]=256 (Independent Living–Tower) + 96 (Independent Living–Gardens) + 80 (Independent Living–Villas) + 60 (Skilled Nursing)
[3]=274 (Independent Living – Tower) + 66 (Independent Living – Gardens) + 16 (Independent Living – Villas)
[4]=410 (Independent Living – Tower) + 96 (Independent Living – Gardens) + 32 (Independent Living – Villas)
[5]=24 (Assisted Living) + 16 (Memory Care) + 60 (Skilled Nursing)
[6]=24 (Assisted Living) + 16 (Memory Care) + 45 (Skilled Nursing)

6671 W Indiantown Rd • Suite 50-324 • Jupiter, Florida • 33458
T: (561) 462-5364 • F: (561) 465-8044 • info@jfo.us

ITE describes *Land Use: 253 Congregate Care Facility* as an independent living development that provides centralized amenities such as dining, housekeeping, communal transportation, and organized social/recreational activities. Each individual dwelling unit often has a kitchenette, rather than a full kitchen. Limited medical services (such as nursing and dental) may or may not be provided. The resident may contract additional medical services or personal assistance. Similarly, ITE defines *Land Use: 254 Assisted Living* as a residential setting that provides either routine general protective oversight or assistance with activities necessary for independent living to mentally or physically limited persons. It commonly has separate living quarters for residents. Its centralized services typically include dining, housekeeping, social and physical activities, medication administration, and communal transportation. These ITE descriptions fit the proposed operations at The Waterford development.

Based on this parking demand analysis, the proposed parking supply will be able to accommodate the demand during peak conditions. Furthermore, the proposed technical deviation (1) will not diminish the site's vehicular or pedestrian operation, (2) will not cause any adverse impacts to the environment, and (3) will not be detrimental to the public welfare, or injurious to property or improvements in the surrounding area or neighborhood.

Table 1: Parking Analysis Summary

	Proposed Development		Parking Required by Town of Juno Beach Land Development Code[7]	Parking Generation Manual, 6th Edition Institute of Transportation Engineers - 85th Percentile -	As required in June 5, 2025 DRC Comments
	# of Units	# of Beds			
Independent Living	290	478	1 per residence (IL) = 290 spaces	290 DUs X 0.48 = 140	1 per residence (IL) = 290 spaces[8]
Assisted Living	24	24	1 for every 4 patients (skilled, Rehab, Memory Care, Assisted Living) - 100 / 4 = 25 spaces 1 per staff = 38 spaces per shift (114 Employees/3)	100 Beds X 0.55 = 55	100 Beds X 0.55[9] = 55
Memory Care	16	16			
Skilled Nursing	45	60			
Total	**375**	**578**	**353**	**195**	**345**
Proposed Parking			**380 Parking Spaces**		

According to Table 1, the 85th percentile parking rates in the latest edition of the *Parking Generation Manual* from the Institute of Transportation Engineers indicate that The Waterford would require 195 parking spaces to meet parking demand. However, the proposed plan provides 380 parking spaces, rather than the 353 spaces required by code. Therefore, we respectfully request approval for The Waterford to provide 380 parking spaces instead of the 353 required by code. This proposed technical deviation represents the minimum necessary adjustment to optimize the use of the property efficiently.

---

[7] Sec. 34-981. b.5.a. Assisted living facilities: 1 parking space for each adult extended care residence plus one parking space per four patient beds or residents plus one space per employee, including nurses and staff doctor, on shift of greatest employment.


[8] As required by DRC Review from June 5, 2025 "use the Juno Beach Schedule of Off-Street Parking for Independent Living Facilities (Code Section 34-981(b)(5). Staff finds that current independent living units are utilizing parking at a 1: 1 ratio, as these current residents are ve1y independent and typically own a car in this climate and suburban environment."

[9] 85th percentile parking rates. 6th Edition of the *Parking Generation Manual* from the Institute of Transportation Engineers (ITE). 41 studies used in determining the parking rate.

6671 W Indiantown Rd • Suite 50-324 • Jupiter, Florida • 33458
T: (561) 602-1506 • www.ifgroupinc.com • info@ifg.us

Sincerely,


JFO GROUP INC
COA Number 32276

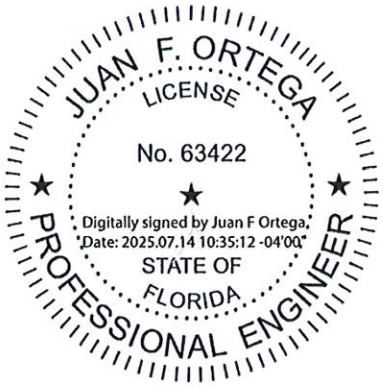


Enclosures: Exhibit 1: Proposed Site Plan
Exhibit 2: ITE Parking Generation Rates
Exhibit 3: June 6, 2025 DRC Review Comments

6671 W Indiantown Rd • Suite 50-324 • Jupiter, Florida • 33458
T: (561) 602-JFOG • www.jfogroupinc.com • info@jfo.us

This Page Intentionally Left Blank

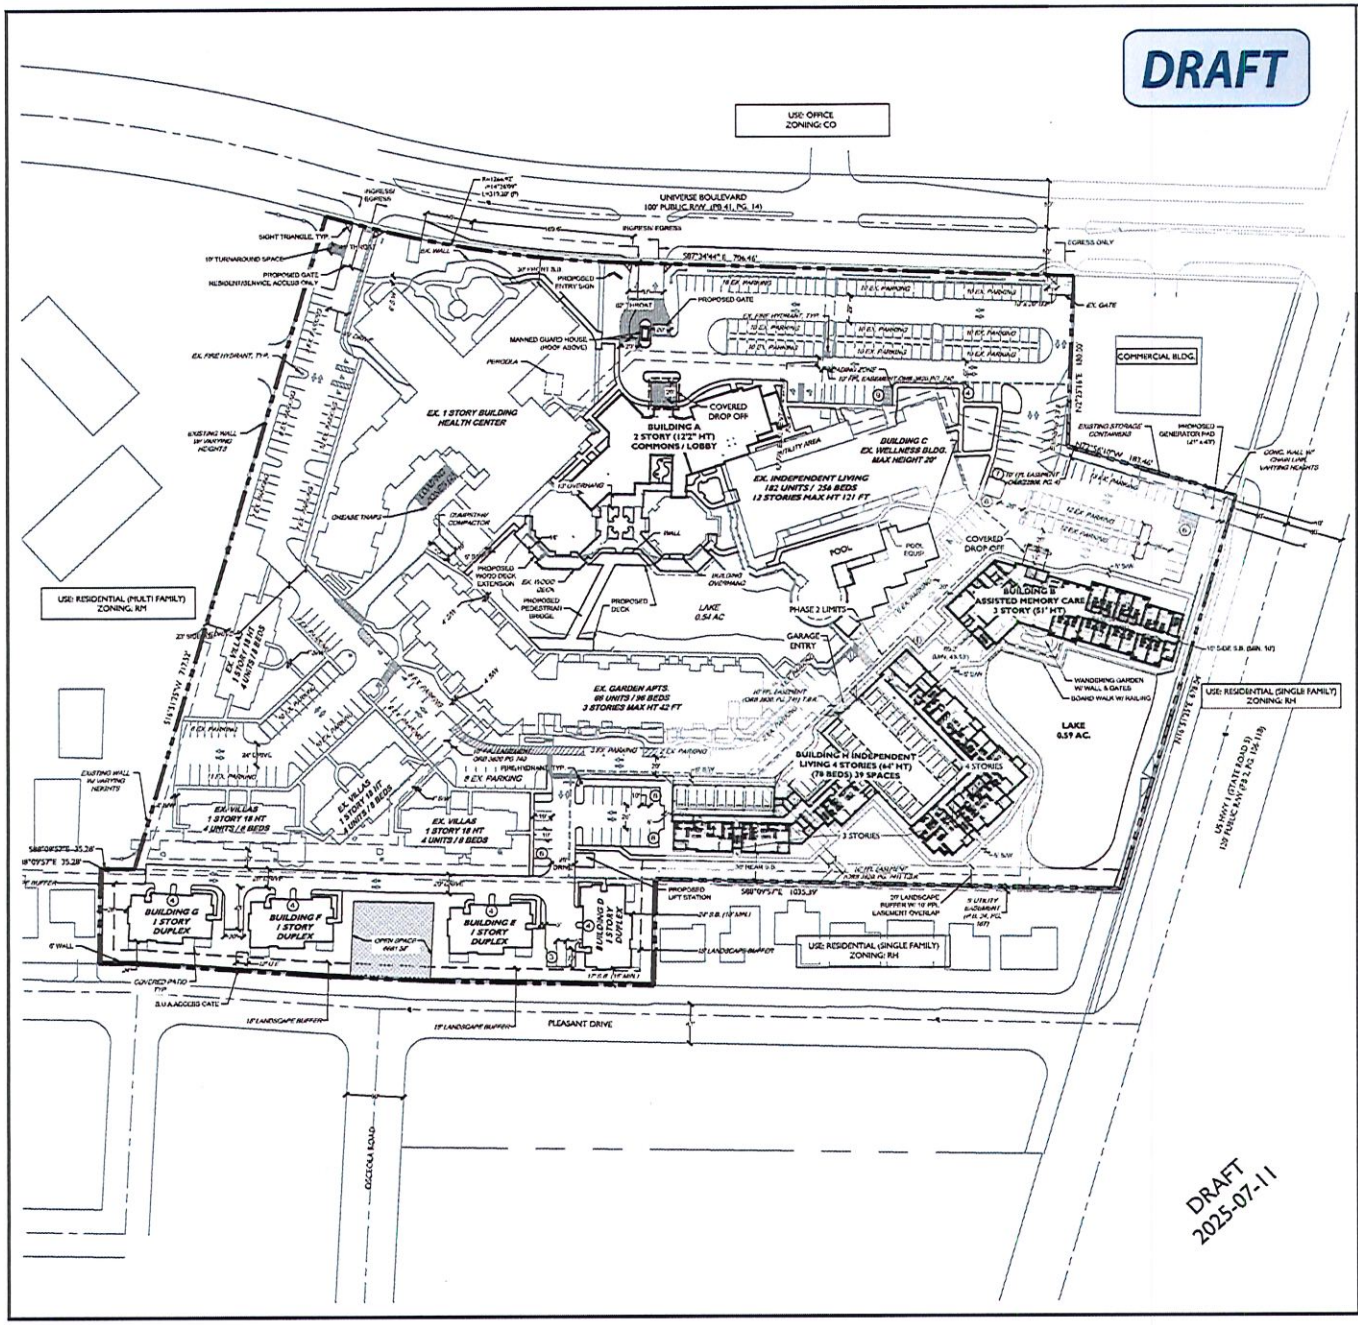

LOCATION MAP



N

0 30 60 120

SCALE: 1" = 60'

SITE DATA

NAME OF APPLICATION	THE WATERFORD
EXISTING/PROPOSED LAND USE	MDR
EXISTING/PROPOSED ZONING	CO/PUD
TOTAL ACREAGE	15.97 AC
TOTAL BUILDING S.F.	496,179 S.F.
PROPOSED BUILDING A	13,431 S.F.
PROPOSED BUILDING B	46,500 S.F.
PROPOSED BUILDING H	90,200 S.F.
EX. WELLNESS BLDG. (BUILDING C)	5,025 S.F.
EX. BUILDINGS D-G (4,180 S.F. EACH)	16,720 S.F.
EX. INDEPENDENT LIVING	217,764 S.F.
EX. GARDEN APTS.	77,151 S.F.
EX. VILLAS (4)	19,398 S.F.
LOT COVERAGE	5.49 AC. (34.4%)
OPEN SPACE	4.72 AC. (29.6%)
IMPERMEABLE SURFACE	4.49 AC. (28.1%)
WATER BODIES	1.1 AC. (6.9%)
APPROVED BEDS	638 BEDS
INDEPENDENT LIVING	538 BEDS
GARDEN APARTMENTS	96 BEDS
INDEPENDENT LIVING TOWER	256 BEDS
INDEPENDENT LIVING VILLAS	32 BEDS
RESIDENT CARE BUILDING	138 BEDS
DUPLEX VILLAS	16 BEDS
ASSISTED LIVING	24 BEDS
MEMORY CARE	16 BEDS
SKILLED NURSING	60 BEDS
PROPOSED BEDS	
INDEPENDENT LIVING	
* RESIDENT CARE BUILDING BEDS TO BE REMOVED	138 BEDS
*INDEPENDENT LIVING BUILDING H	78 BEDS
TOTAL BEDS	578 BEDS
INDEPENDENT LIVING	478 BEDS
ASSISTED LIVING	24 BEDS
MEMORY CARE	16 BEDS
SKILLED NURSING	60 BEDS
DENSITY (578/2.39+242 UNITS/15.97 AC)	15.15 UNITS/ AC.
MAX. BUILDING HEIGHT	12 STORY (121 FT.)
PARKING REQUIRED BY CODE	353 SP.
INDEPENDENT LIVING UNIT (1 SP. / 1 UNIT)	290 SP.
ASSISTED LIVING (1 SP. / 4 BEDS)	6 SP.
MEMORY CARE (1 SP. / 4 BEDS)	4 SP.
SKILLED NURSING (1 SP. / 4 BEDS)	15 SP.
STAFF (1 SP. / 3 STAFF)	38 SP.
PARKING APPROVED PER PARKING STUDY (2022)	222 SP.
INDEPENDENT LIVING UNIT 0.46 SP. / 1 UNIT @ 356 UNITS	164 SP.
ASSISTED LIVING 0.58 SP. / 1 BED @ 24 BEDS	14 SP.
MEMORY CARE 0.56 SP. / 1 BED @ 16 BEDS	9 SP.
SKILLED NURSING 0.58 SP. / 1 BED @ 60 BEDS	35 SP.
PARKING DEMAND	192 SP.
INDEPENDENT LIVING UNIT (0.46 SP. / 1 UNIT @ 290 UNITS	134 SP.
ASSISTED LIVING 0.58 SP. / 1 BED @ 24 BEDS	14 SP.
MEMORY CARE 0.58 SP. / 1 BED @ 16 BEDS	9 SP.
SKILLED NURSING 0.58 SP. / 1 BED @ 60 BEDS	35 SP.
STAFF (	
PARKING PROVIDED	380 SP.
PROPOSED SURFACE SPACES	341 SP.
PROPOSED GARAGE SPACES	39 SP.
HANDICAP SPACE REQUIRED (INCL. IN TOTAL)	8 SP.
HANDICAP SPACES PROVIDED (INCL. IN TOTAL)	8 SP.
LOADING SPACING PROVIDED	4 SP.

* THE RATE TO DETERMINE THE AMOUNT OF PARKING REQUIRED HAS BEEN BASED UPON THE MOST RECENT PARKING STANDARDS ADOPTED BY THE INSTITUTE OF TRANSPORTATION ENGINEERS, 5TH EDITION PARKING GENERATION MANUAL.

* BICYCLE PARKING FACILITIES REQUIREMENTS WAIVED BY STAFF WITH APPROVAL OF ORD. NO. 751 ON APRIL 21, 2022, DUE TO THE SPECIAL NATURE OF THE OPERATION AS AN ADULT LIVING FACILITY AND ITS AGING RESIDENTS

LEGEND

AC. = ACRES
D.E. = DRAINAGE EASEMENT
DRO = DEVELOPMENT REVIEW OFFICERS
D.U. = DWELLING UNITS
EX. = EXISTING
FLU = FUTURE LAND USE
L.A.E. = LIMITED ACCESS EASEMENT
L.M.E. = LAKE MAINTENANCE EASEMENT
OHME = OVERHANG/MAINTENANCE EASEMENT
O.R.B. = OFFICIAL RECORD BOOK
P.B. = PLAT BOOK
PDR = PROPERTY DEVELOPMENT REGULATIONS
PG. = PAGE
R = RADIUS
R.O.W. = RIGHT-OF-WAY
R/W = RIGHT-OF-WAY
S.F. = SQUARE FEET
T.B.A. = TO BE ABANDONED
T.B.R. = TO BE RELOCATED
TYP = TYPICAL
U.E. = UTILITY EASEMENT
ULDC = UNIFIED LAND DEVELOPMENT CODE
WFH = WORKFORCE HOUSING

WGI, Inc.
WGInc.com
2035 VISTA PARKWAY, SUITE 114, WEST PALM BEACH, FLORIDA 33411
561.687.2220

PRELIMINARY

NOT FOR CONSTRUCTION, BIDDING, OR PERMIT PURPOSES.

PREPARED UNDER THE SUPERVISION OF WGI, INC. ON 2025-07-11

INITIAL SUBMITTAL
FEBRUARY 20, 2025

THE WATERFORD
601 UNIVERSE BOULEVARD
JUNO BEACH, FL 33408

SITE PLAN

SHEET
SP-1
1 OF 1
2920.04

Exhibit 1

This Page Intentionally Left Blank

Land Use: 253 Congregate Care Facility

Description

A congregate care facility is an independent living development that provides centralized amenities such as dining, housekeeping, communal transportation, and organized social/recreational activities. Each individual dwelling unit often has a kitchenette. Assistance is typically available for housekeeping or minor household maintenance. Limited medical services (such as nursing and dental) may or may not be provided. The resident may contract additional medical services or personal assistance.

Time-of-Day Distribution for Parking Demand

The current database for this land use does not have sufficient data to produce a detailed, hour-by-hour distribution of parking demand from which the analyst can determine a peak period of parking demand. Based on the time periods for which data were collected for this land use and on a review of comparable land uses with hour-by-hour parking demand data, the presumed peak period for parking demand for this land use is between mid-morning and late-afternoon.

Additional Data

Resident vehicle ownership is typically low at a congregate care facility. Site employees, persons providing services to the residents, and visitors generate the majority of parked vehicles at the site.

The average parking supply ratio for three study sites with parking supply information is 0.61 spaces per dwelling unit. The average peak parking occupancy at these three sites is 52 percent.

The sites were surveyed in the 1990s, the 2000s, and the 2010s in California, New Jersey, Ontario (CAN), and Oregon.

Source Numbers

120, 401, 433, 548


Congregate Care Facility
(253)

Peak Period Parking Demand vs: Dwelling Units
On a: Weekday (Monday - Friday)
Setting/Location: General Urban/Suburban
Number of Studies: 4
Avg. Num. of Dwelling Units: 170

Peak Period Parking Demand per Dwelling Unit

Average Rate	Range of Rates	33rd / 85th Percentile	95% Confidence Interval	Standard Deviation (Coeff. of Variation)
0.36	0.16 - 0.48	0.28 / 0.48	***	0.11 (31%)

Data Plot and Equation

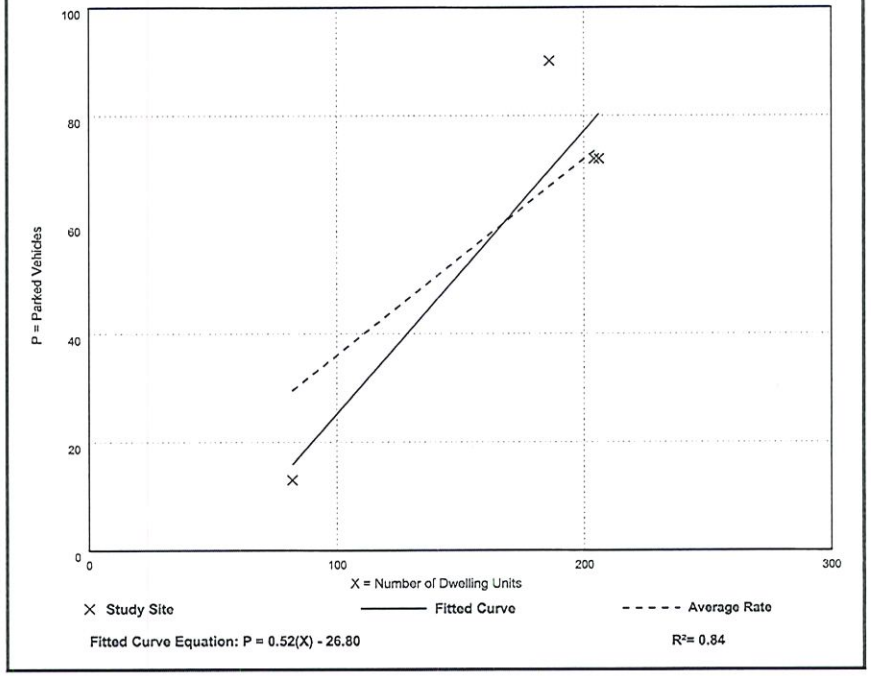

Fitted Curve Equation: P = 0.52(X) - 26.80

R^2= 0.84

Land Use: 254 Assisted Living

Description

An assisted living complex is a residential setting that provides either routine general protective oversight or assistance with activities necessary for independent living to persons with mental or physical limitations. The typical resident has difficulty managing an independent living arrangement but does not require nursing home care. Its centralized services typically include dining, housekeeping, social and physical activities, medication administration, and communal transportation.

The complex commonly provides separate living quarters for each resident. Alzheimer's and ALS care are commonly offered at an assisted living facility. Living quarters for these patients may be located separately from the other residents. Assisted care commonly bridges the gap between independent living and a nursing home. In some areas of the country, an assisted living residence may be called personal care, residential care, or domiciliary care. Staff may be available at an assisted care facility 24 hours a day, but skilled medical care-which is limited in nature-is not required. Nursing Home (Land Use 620) is a related use.

Time-of-Day Distribution for Parking Demand

The following table presents a time-of-day distribution of parking demand on a weekday (13 study sites), a Saturday (seven study sites), and a Sunday (nine study sites) in a general urban/suburban setting.

Hour Beginning	Percent of Peak Parking Demand		
	Weekday	Saturday	Sunday
12:00–4:00 a.m.	–	–	–
5:00 a.m.	–	–	–
6:00 a.m.	–	–	–
7:00 a.m.	–	–	–
8:00 a.m.	–	–	–
9:00 a.m.	78	–	–
10:00 a.m.	82	–	–
11:00 a.m.	93	94	89
12:00 p.m.	96	99	90
1:00 p.m.	100	100	100
2:00 p.m.	95	95	96
3:00 p.m.	85	85	86
4:00 p.m.	75	87	90
5:00 p.m.	–	76	80
6:00 p.m.	–	67	65
7:00 p.m.	–	–	–
8:00 p.m.	–	–	–
9:00 p.m.	–	–	–
10:00 p.m.	–	–	–
11:00 p.m.	–	–	–

Additional Data

The rooms in these facilities may be private or shared accommodations, consisting of either a single room or a small apartment-style unit with a kitchenette and living space.

The average parking supply ratio for 28 study sites in a general urban/suburban setting is 0.54 spaces per dwelling unit. The average peak parking occupancy at these 28 sites is 74 percent.

The sites were surveyed in the 1990s, the 2000s, and the 2010s in Arizona, California, Connecticut, Indiana, New Jersey, New York, Pennsylvania, Tennessee, Utah, and Washington.

Source Numbers

42, 247, 279, 287, 315, 422, 431, 432, 438, 451, 506, 507, 516, 527, 539s


Assisted Living
(254)

Peak Period Parking Demand vs: Beds
On a: Weekday (Monday - Friday)
Setting/Location: General Urban/Suburban
Number of Studies: 41
Avg. Num. of Beds: 85

Peak Period Parking Demand per Bed

Average Rate	Range of Rates	33rd / 85th Percentile	95% Confidence Interval	Standard Deviation (Coeff. of Variation)
0.40	0.24 - 0.74	0.34 / 0.55	0.36 - 0.44	0.12 (30%)

Data Plot and Equation

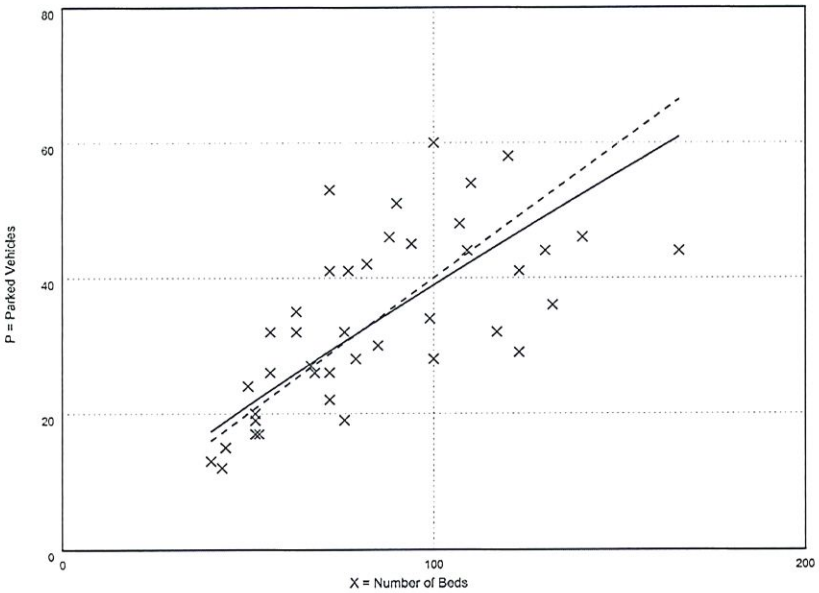

Fitted Curve Equation: Ln(P) = 0.88 Ln(X) - 0.39

R^2= 0.57

This Page Intentionally Left Blank

This Page Intentionally Left Blank

SIMMONS & WHITE
CIVIL & TRAFFIC ENGINEERING

June 4, 2025

Town of Juno Beach
340 Ocean Drive
Juno Beach, Florida 33408

Attention: Mr. Frank Davila

Reference: The Waterford
Town of Juno Beach, Florida

Dear Mr. Davila:

We are in receipt of the site plan application package for the above referenced project dated April 25, 2025. Based on our review (1st review) of the submitted Site Plan application package and traffic report, our office has the following comments:

1. The right turn lane proposed at the main site entrance should be extended to the maximum length feasible. Due to the existing west entrance, the County standard of 280 feet is not obtainable. However, the turn lane should start just east of the west site entrance.

2. How is the west gate proposed to operate? Will it be residents only?

3. The proposed gate on the west site entrance should be relocated south to the maximum extent feasible to allow for additional vehicle queuing.

4. Please provide a drainage statement for the proposed modification to the previous approval.

5. Please address drainage impacts in Universe Blvd due to the proposed right turn lane.

6. Storm water management calculations will be required for final engineering approval, addressing, but not limited to, the following: change in land use intensity, storm attenuation and water quality.

7. Our office has deferred the review of water and sewer system components to Seacoast Utility Authority, FDEP and PBC Fire Rescue.

2581 Metrocentre Blvd. West, Ste 3 | West Palm Beach, FL 33407
561.478.7848 | simmonsandwhite.com | Certificate of Authorization Number 3452

8. Approvals from SFWMD, Seacoast Utility Authority, FDEP and Palm Beach County Fire Rescue will be required prior to final engineering plan approval.

9. Please include the Code required parking on the Site Plan.

10. Update the Parking Study with the latest ITE Parking Generation, 6th Edition rates.

11. It is recognized the ITE has a lower parking rate for the ITE Land Use #253 (Congregate Care Facility). However, the ITE Parking Generation, 6th Edition consists of only 4 studies all from outside of Florida. The provided parking rate does not seem consistent with the actual parking demand of the Waterford. It is recommended the Parking Study utilize the Town code of 1 space per residence (290 spaces) for the independent living portion of the development.

12. Table 1 shows a Code required parking of 100 spaces for staff members. Are 100 staff members present at the facility at one time or is that the total number of employees? The number of spaces per staff should be the maximum amount of staff present at the facility at a given time.

Please note that once the above referenced items are reviewed and found acceptable for site plan approval, an approval letter will be provided to the Town of Juno Beach.

If you have any questions or require any additional information, please contact our office.

Sincerely,

SIMMONS & WHITE, INC.

Paul A. Buri, P.E.

PAB/pb X:/docs/misclt r/buri/24004.7davilaltr

35) Revise the elevations to provide depth and distance, either by using different line weights and/or colors. As an example, the garage entrance appears to be on the same plane as the building behind it.

Parking Study

36) Please revise table 1: Parking Analysis Summary on page 2, Independent Living, to use the Juno Beach Schedule of Off-Street Parking for Independent Living Facilities (Code Section 34-981(b)(5). Staff finds that current independent living units are utilizing parking at a 1:1 ratio, as these current residents are very independent and typically own a car in this climate and suburban environment.

Please confirm that the calculations of assisted living, memory care and skilled nursing account for 1 space for every 4 units, and 1 space for every 3 staff. This reflects the practice of utilizing 3 work shifts to cover 24 hours (24/8 = 3). Please note that the total should then become 348, which is still below the proposed parking count of 380.

Additional Comments:

37) Provide an updated TPS Approval form from the County.

38) While staff appreciates the renderings provided from a wider, aerial perspective, please also provide updated standard architectural renderings of Building B and H, showing four-sided architecture from the street perspective.

39) All fence(s), sign(s), and generator(s) will require separate building permit applications.

40) Per Section 34-905, Walls and Fences, perimeter walls/fences around a development must have an ornamental feature at least every 30 linear feet. Ornamental features, excluding wall caps, may exceed the height limitations, if approved by staff.

41) Per Section 6-109.- Construction Site Standards, and 6-111, Demolition permits, please note that an approved demolition permit for the existing structures and infrastructure to be removed is a requirement of building permit approval. The demolition permit shall include an erosion control plan, parking plan, construction screening plan and truck logistics. The property owner shall submit an affidavit to confirm that notice has been provided to owners within 300 feet at least 30 days prior to demolition activities.

42) The handicap/ADA parking space indicated on the site plan adjacent to the existing villas is not the standard ADA space (the space does not have the

This Page Intentionally Left Blank

J F O G R O U P I N C
Traffic Engineering • Transportation Planning

www.jfogroupinc.com

March 18, 2025

Yoan.Machado@wginc.com

Yoan Machado
WGI INC
Senior Project Manager
2035 Vista Parkway
West Palm Beach, FL 33411

Re: The Waterford (Juno Beach) • WGI#2920.04
TRAFFIC CONCURRENCY
PCN 28-43-41-33-30-001-0000

Dear Yoan,

JFO Group Inc. has been retained to prepare a traffic impact analysis to determine compliance with *Palm Beach County (PBC) - Traffic Performance Standards (TPS) - Article 12 of the PBC Unified Land Development Code (ULDC)*. This traffic statement is associated with a Site Plan amendment application for *The Waterford* property. The property is located at the southwest corner of US-1 and Universe Boulevard, in the City of Juno Beach, Florida. Property Control Numbers associated with this project is 28-43-41-33-30-001-0000. A copy of the property appraiser information data for the site is included as Exhibit 1. Project buildout is expected in the year 2030.



Figure 1 : Project Location

Project trip generation rates used for this analysis were based on *PBC Trip Generation Rates* dated July 25, 2022. Table 1 shows the rates used in order to determine the trip generation for Daily, AM, and PM peak hour conditions. Exhibit 2 includes a copy of the PBC Trip Generation Rates. According to provisions in Article 12 of the PBC ULDC – Section A.3.B.3, *a Project shall be eligible for a 100 percent credit against Project Traffic if the Previously Captured residential Project has received building permits for 80 percent of the units as set forth in the master plan or site plan as applicable.* Exhibit 3 includes an aerial picture from 2019. Exhibit 4 includes a copy of a preliminary site plan for the proposed project.

Currently at The Waterford, there are 288[1] DUs that operate as Independent Living and 60 beds (45 DUs) that operate as Skilled Nursing. The proposed changes to The Waterford include modifying the latest approved site plan, to allow for redevelopment and modernization of the campus. The Waterford will ultimately provide a total of 290 Independent Living units (478 Beds) and 100[2] Assisted Living beds (85[3] DUs). Table 2 provides Daily, AM, and PM peak hour volumes for the vested and proposed development.

[1]=182 (Independent Living–Tower) + 66 (Independent Living–Gardens) + 40 (Independent Living–Villas)
[2]=24 (Assisted Living) + 16 (Memory Care) + 60 (Skilled Nursing)
[3]=24 (Assisted Living) + 16 (Memory Care) + 45 (Skilled Nursing)

6671 W Indiantown Rd • Suite 50-324 • Jupiter, Florida 33458
T: (561) 462-5364 • F: (561) 465-8044 • info@jfo.us

Table 1: Trip Generation Rates

Land Use	ITE Code	Daily	AM Peak Hour			PM Peak Hour		
			In	Out	Total	In	Out	Total
Congregate Care Facility	253	2.21	58%	42%	0.08	49%	51%	0.18
Assisted Living Facility	254	2.60	60%	40%	0.18	39%	61%	0.24

Table 2 summarizes the net Daily, AM, and PM peak trips potentially generated by the proposed development. According to Table 2, the net daily, AM and PM peak trips potentially generated due to the proposed changes are 109, 7 (4 In/3 Out) and 10 (4 In/6 Out) trips respectively.

Table 2: Trip Generation


Land Use	Intensity	Daily	AM Peak Hour			PM Peak Hour		
			In	Out	Total	In	Out	Total
EXISTING DEVELOPMENT								
Congregate Care Facility	288 DUs	636	13	10	23	25	27	52
Assisted Living Facility	60 beds	156	7	4	11	5	9	14
Net Vested Traffic		**792**	**20**	**14**	**34**	**30**	**36**	**66**
PROPOSED DEVELOPMENT								
Congregate Care Facility	290 DUs	641	13	10	23	25	27	52
Assisted Living Facility	100 beds	260	11	7	18	9	15	24
Net Proposed Traffic		**901**	**24**	**17**	**41**	**34**	**42**	**76**
Net Traffic		**109**	**4**	**3**	**7**	**4**	**6**	**10**

Based on the PBC – TPS and the Land Development Design Standards Manual, a left-turn lane is required at each driveway where inbound peak hour left-turning traffic is equal or greater than 30 vehicles. A right-turn lane is required at each driveway where street Average Daily Traffic (ADT) volumes exceed 10,000 vehicles per day, and driveway daily volume is greater than 1,000 trips, with inbound peak hour right-turning traffic being at least 75 vehicles.

Figure 2 provides Daily, AM and PM peak hour driveway volumes for *The Waterford* property. Based on the information presented in Figure 2, *PBC - TPS*, and the *Land Development Design Standards Manual*, additional turn lanes are not warranted at the project driveways.

Project site currently has three (3) driveways which are proposed to remain. Based on the Thoroughfare Right of Way Identification (ROW) Map TE 14.1 from the PBC Comprehensive Plan effective June 11, 2023, the project access are on a 100' ROW width on Universe Boulevard. Consequently, according to Palm Beach County Access Management Standards, the Driveway Connection Spacing should be 245'. Figure 4 includes driveway separation distances. Given the location of the existing access being ±270' to its closest driveway, Access Management standards for driveway separation are met.

6671 W Indiantown Rd • Suite 50-324 • Jupiter, Florida 33458
T: (561) GO2-IFOG • www.ifogroupinc.com • info@ifo.us

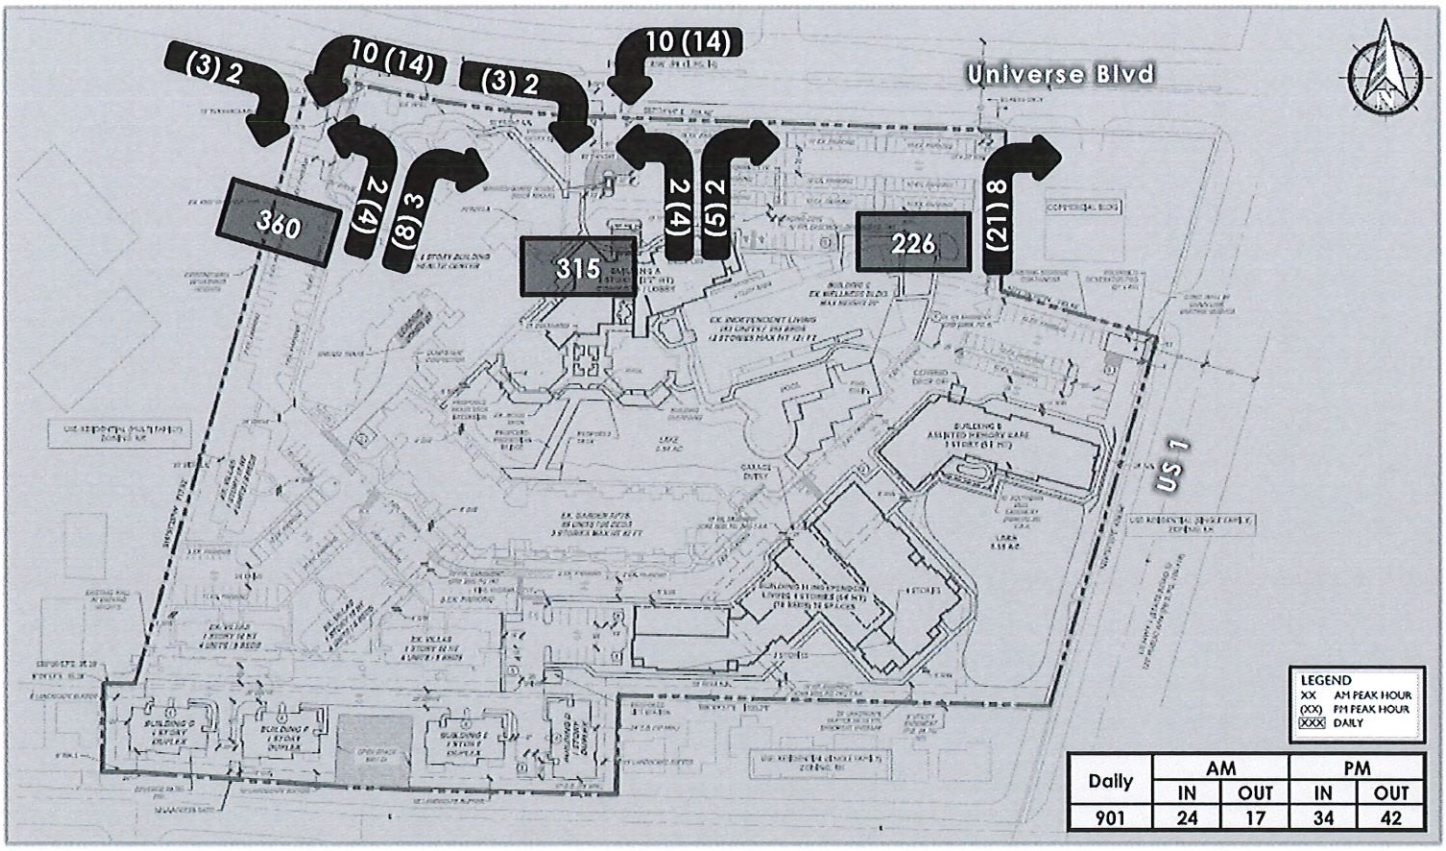

Daily	AM		PM	
	IN	OUT	IN	OUT
901	24	17	34	42

Figure 3: Project Driveway Volumes

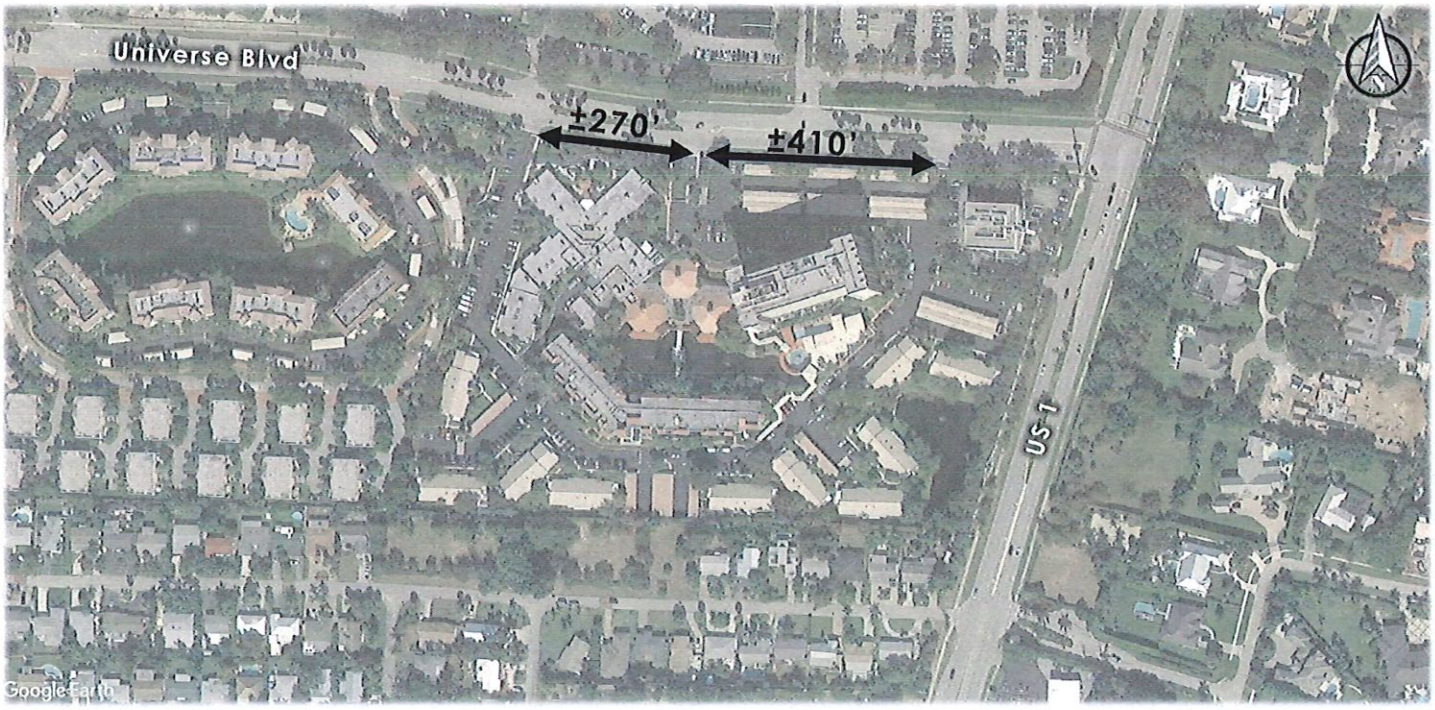



Figure 4: Driveway Separation

6671 W Indiantown Rd • Suite 50-324 • Jupiter, Florida 33458
T: (561) 602-IFOG • www.ifogroupinc.com • info@ifo.us

The proposed changes to *The Waterford* property have been evaluated following *PBC TPS - Article 12 of the PBC ULDC*. This analysis shows that the proposed request to reconfigure the site to replace 288[4] Independent Living DUs and 60 beds (45 DUs) with 290 Independent Living units (478 Beds) and 100[5] Assisted Living beds (85[6] DUs) will generate less than 20 peak-hour trips. Therefore, the proposed development complies with *PBC TPS - Article 12 of the PBC ULDC*. Project build-out is anticipated in 2030.

Sincerely,

JFO GROUP INC
COA Number 32276

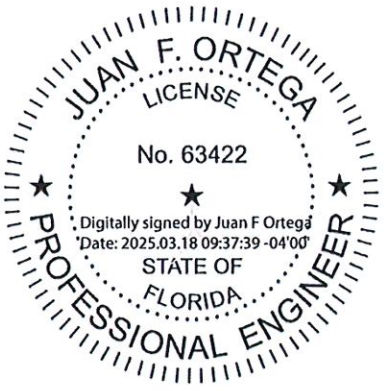

Enclosures:
Exhibit 1: Property Appraiser Information
Exhibit 2: PBC Trip Generation Rates
Exhibit 3: 2019 Aerial
Exhibit 4: Preliminary Site Plan
Exhibit 5: 220113 TPS Approval

[4]=182 (Independent Living–Tower) + 66 (Independent Living–Gardens) + 40 (Independent Living–Villas)
[5]=24 (Assisted Living) + 16 (Memory Care) + 60 (Skilled Nursing)
[6]=24 (Assisted Living) + 16 (Memory Care) + 45 (Skilled Nursing)

6671 W Indiantown Rd • Suite 50-324 • Jupiter, Florida 33458
T: (561) GO2-JFOG • www.jfogroupinc.com • info@jfo.us

Property Detail

Location Address : 601 UNIVERSE BLVD
Municipality : JUNO BEACH
Parcel Control Number : 28-43-41-33-30-001-0000
Subdivision : WATERFORD REPLAT
Official Records Book/Page : /
Sale Date :
Legal Description : WATERFORD REPLAT TR A K/A ALL OF PLAT

Owner Information

Owner(s)

LIFESPACE COMMUNITIES INC

Mailing Address

3501 OLYMPUS BLVD STE 300
COPPELL TX 75019 6292

Sales Information

No Sales Information Available.

Exemption Information

No Exemption Information Available.

Property Information

Number of Units : 356
***Total Square Feet :** 49870
Acres : 15.86
Property Use Code : 0620—LIFE CARE HX
Zoning : CO—COMMERCIAL OFFICE (28-JUNO BEACH)

Building Details

Structural Details


Structural Element for Building 1

Year Built	1982
OFFICE BLDG L/R 1-4S	9870

Subarea and Square Footage for Building 1

Code Description	square Footage
OFFICES	3067
RESTAURANT	3785
OFFICES	3018
Total Square Footage	9870

Sketch for Building 1

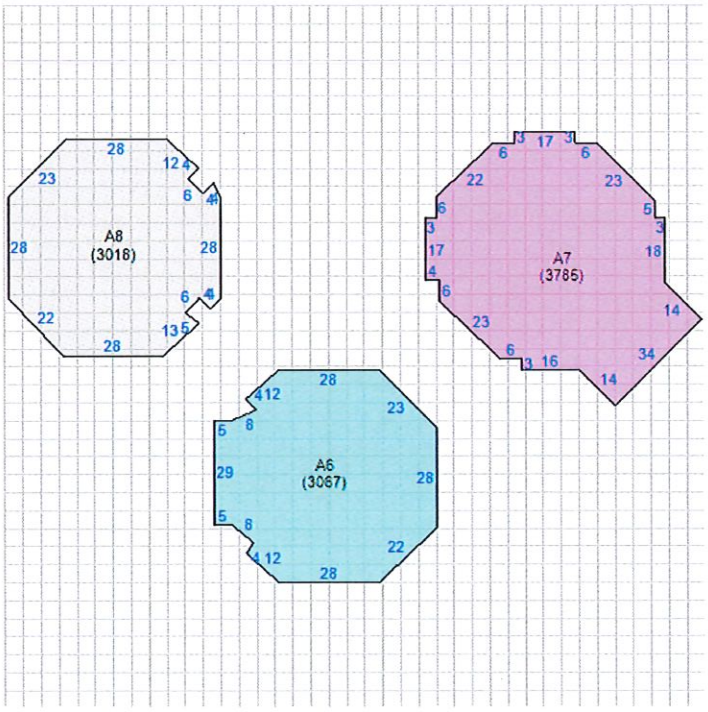

Property Extra Feature

Description	Year Built	Units
Paving- Asphalt	1982	3095
Gazebo	1988	1
Fountain	1996	1
Fence- Wrought Iron	2010	1200
Screen Enclosure	1982	560
Patio	1982	600
Screen Enclosure	1982	1296
Paving- Asphalt	1982	108
Wall	1982	120
Screen Enclosure	1982	1256
Fence- Chain Link 6ft #11 Gaug	1982	178
Walkway-Concrete	1982	2508
Paving- Asphalt	1982	1500
Patio Roof	1982	180
Paving- Asphalt	1982	159994
Patio	1982	1317
Walkway-Concrete	1982	10048
Patio Roof	1982	91
Patio Roof	1982	32947
Screen Enclosure	1982	144
Patio	1982	182
Patio	1982	152
Paving- Asphalt	1982	600
Walkway-Concrete	1982	2964
Patio Roof	1982	180
Screen Enclosure	1982	180
Patio	1982	152
Patio	1982	468
Screen Enclosure	1982	180
Patio	1982	152
Wall	1982	540
Patio	1982	152
Wall	1982	204
Patio	1982	152
Patio Roof	1982	180
Screen Enclosure	1982	180
Patio	1982	152
Wall	1982	204
Patio	1982	152
Patio Roof	1982	180
Patio Roof	1982	180
Wall	1982	204
Screen Enclosure	1982	180
Patio	1982	152
Wall	1982	204
Wall	1982	204
Patio Roof	1982	180
Screen Enclosure	1982	180
Patio	1982	152
Patio Roof	1982	180
Patio Roof	1982	182
Screen Enclosure	1982	180
Screen Enclosure	1982	288
Patio	1982	152
Patio	1982	152

Paving- Asphalt	1982	420
Walkway-Concrete	1982	2604
Patio	1982	152
Patio	1982	152
Wall	1982	468
Wall	2008	352
Paving- Asphalt	2008	220
Wall	1982	152
Walkway-Concrete	1982	2604
Wall	1982	204
Patio	1982	152
Patio	1982	152
Wall	1982	204
Patio	1982	152
Patio Roof	1982	180
Patio Roof	1982	180
Screen Enclosure	1982	180
Screen Enclosure	1982	180
Patio	1982	152
Walkway-Concrete	1982	2652
Patio	1982	152
Wall	1982	264
Paving- Asphalt	2024	18250
Walkway-Concrete	2024	1225
Fence- Chain Link 6ft #11 Gaug	2024	1250
Spa	2024	1

Property Land Details

Land Line #	Description	Zoning	Acres
1	RETIREMENT	CO	15.8639

Appraisals

Tax Year	2024	2023	2022	2021	2020
Improvement Value	$0	$0	$0	$0	$0
Land Value	$0	$0	$0	$0	$0
Total Market Value	$45,527,897	$0	$0	$0	$0

Assessed and Taxable Values

Tax Year	2024	2023	2022	2021	2020
Assessed Value	$41,085,310	$0	$0	$0	$0
Exemption Amount	$17,154,048	$0	$0	$0	$0
Taxable Value	$23,931,262	$0	$0	$0	$0

Taxes

Tax Year	2024	2023	2022	2021	2020
AD VALOREM	$462,836	$0	$0	$0	$0
NON AD VALOREM	$40,581	$0	$0	$0	$0
TOTAL TAX	$503,417	$0	$0	$0	$0

This Page Intentionally Left Blank

Palm Beach County Trip Generation Rates

(Must be used with traffic studies submitted to the County on or after 9/1/2022. However, immediate use is highly recommended)

Gr	Landuse	ITE Code	Unit	Daily Rate/Equation	Pass-By %	AM Peak Hour		PM Peak Hour	
						In/Out	Rate/Equation	In/Out	Rate/Equation
Industrial	General Light Industrial	110	1000 S.F.	4.87	10%	88/12	0.74	14/86	0.65
	Manufacturing	140	1000 S.F.	4.75	10%	76/24	0.68	31/69	0.74
	Warehouse	150	1000 S.F.	1.71	10%	77/23	0.17	28/72	0.18
	Mini-Warehouse/SS	151	1000 S.F.	1.45	10%	59/41	0.09	47/53	0.15
	HCF Center Warehouse - Non Sort	155	1000 S.F.	1.81	10%	81/19	0.15	39/61	0.16
Residential	Single Family Detached	210	Dwelling Unit	10	0%	26/74	0.7	63/37	0.94
	Multifamily Low-Rise Housing upto 3 story (Apartment/Condo/TH)	220	Dwelling Unit	6.74	0%	24/76	0.4	63/37	0.51
	Multifamily Mid-Rise Housing 4-10 story (Apartment/Condo/TH)	221	Dwelling Unit	4.54	0%	23/77	0.37	61/39	0.39
	55+ SF Detached	251	Dwelling Unit	4.31	0%	33/67	0.24	61/39	0.30
	55+ SF Attached	252	Dwelling Unit	3.24	0%	34/66	0.2	56/44	0.25
	Congregate Care Facility	253	Dwelling Unit	2.21	0%	58/42	0.08	49/51	0.18
	Assisted Living Facility	254	Beds	2.6	0%	60/40	0.18	39/61	0.24
Ldg	Hotel	310	Rooms	7.99	10%	56/44	0.46	51/49	0.59
Rec	Golf Course	430	Holes	30.38	5%	79/21	1.76	53/47	2.91
	Health/Fitness Club	492	1000 S.F.	32.93	5%	51/49	1.31	57/43	3.45
Institutional	Elementary School	520	Students	2.27	0%	54/46	0.74	46/54	0.16
	Middle/Junior School	522	Students	2.1	0%	54/46	0.67	48/52	0.15
	High School	525	Students	1.94	0%	68/32	0.52	48/52	0.14
	Private School (K-8)	530	Students	3.17[a]	0%	56/44	1.01	46/54	0.26
	Private School (K-12)	532	Students	2.48	0%	63/37	0.79	43/57	0.17
	Church/Synagogue[b]	560	1000 S.F.	7.6	5%	62/38	0.32	44/56	0.49
	Day Care	565	Students	4.09	50%	53/47	0.78	47/53	0.79
	Library	590	1000 S.F.	72.05	10%	71/29	1	48/52	8.16
Med	Hospital	610	1000 S.F.	10.77	10%	67/33	0.82	35/65	0.86
	Nursing Home	620	Beds	3.06	10%	72/28	0.14	33/67	0.14
Office	General Office (10k-250k SF GFA)[h]	710	1000 S.F.	10.84	10%	88/12	1.52	17/83	1.44
	General Office (>250k SF GFA)[h]	710	1000 S.F.	Ln(T) = 0.87 Ln(X) + 3.05	10%	88/12	Ln(T) = 0.86Ln(X) + 1.16	17/83	1.44
	Small Office Building (<=10k SF GFA)	712	1000 S.F.	14.39	10%	82/18	1.67	34/66	2.16
	Medical Office (Stand-Alone)	720	1000 S.F.	T=42.97(X)-108.01	10%	79/21	3.10	30/70	3.93
	Medical Office (Near Hospital)	720	1000 S.F.	31.86	10%	81/19	2.68	25/75	2.84
	Government Office	730	1000 S.F.	22.59	10%	75/25	3.34	25/75	1.71


This Page Intentionally Left Blank


2019 Aerial



Exhibit 3

This Page Intentionally Left Blank

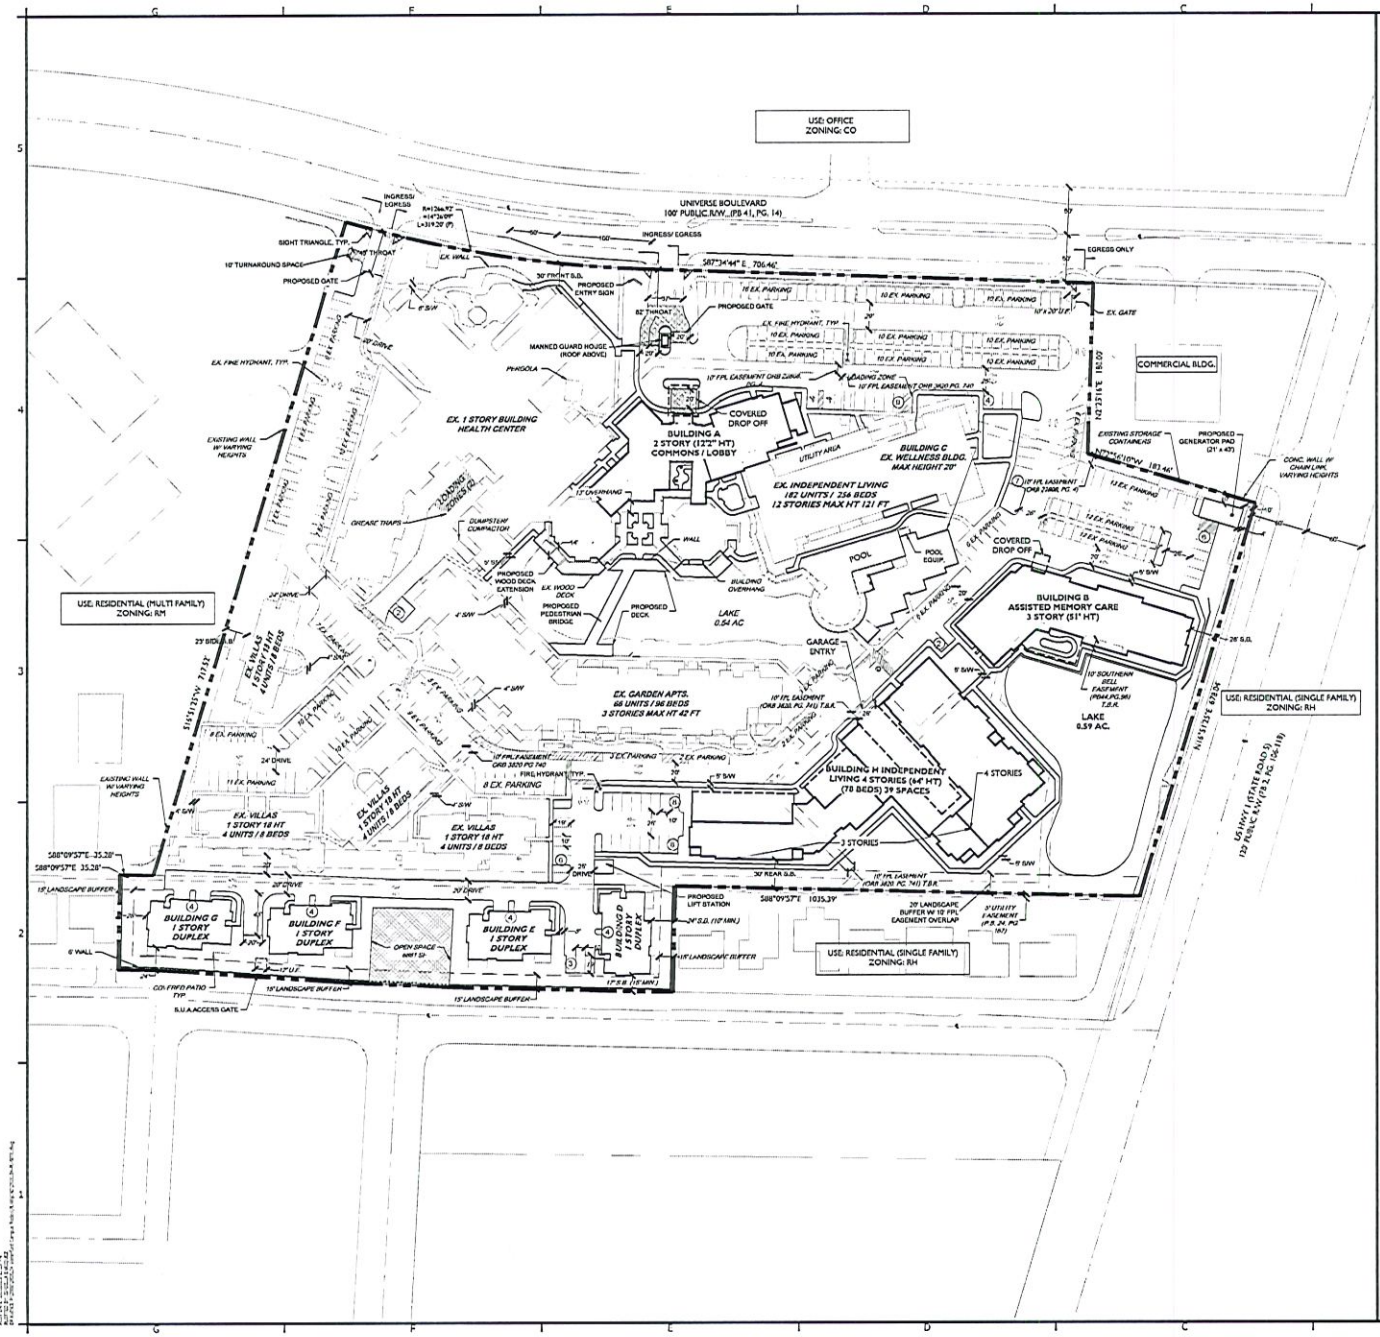

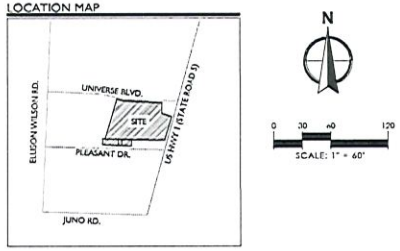

SITE DATA

NAME OF APPLICATION	THE WATERFORD
EXISTING/PROPOSED LAND USE	HDR
EXISTING/PROPOSED ZONING	CO/HJD
TOTAL ACREAGE	15.97 AC
TOTAL BUILDING S.F.	516,832 S.F.
PROPOSED BUILDING A	13,431 S.F.
PROPOSED BUILDING B	44,038 S.F.
PROPOSED BUILDING H	423,363 S.F.
EX. WELLNESS BLDG. (BUILDING C)	5,025 S.F.
EX. BUILDINGS D-G (4,180 S.F. EACH)	16,720 S.F.
EX. INDEPENDENT LIVING	217,764 S.F.
EX. GARDEN APTS.	77,151 S.F.
EX. VILLAS (4)	19,388 S.F.
LOT COVERAGE	5.49 AC. (34.4%)
OPEN SPACE	4.72 AC. (29.6%)
IMPERMEABLE SURFACE	4.49 AC. (28.1%)
WATER BODIES	1.1 AC. (6.9%)
APPROVED BEDS	638 BEDS
INDEPENDENT LIVING	538 BEDS
GARDEN APARTMENTS	96 BEDS
INDEPENDENT LIVING TOWER	256 BEDS
INDEPENDENT LIVING VILLAS	32 BEDS
RESIDENT CARE BUILDING	138 BEDS
DUPLEX VILLAS	16 BEDS
ASSISTED LIVING	24 BEDS
MEMORY CARE	16 BEDS
SKILLED NURSING	60 BEDS
PROPOSED BEDS	
INDEPENDENT LIVING	
* RESIDENT CARE BUILDING BEDS TO BE REMOVED	138 BEDS
*INDEPENDENT LIVING BUILDING H	78 BEDS
TOTAL BEDS	578 BEDS
INDEPENDENT LIVING	478 BEDS
ASSISTED LIVING	24 BEDS
MEMORY CARE	16 BEDS
SKILLED NURSING	60 BEDS
DENSITY (578/2.39+242 UNITS/15.97 AC)	15.15 UNITS/ AC.
MAX. BUILDING HEIGHT	12 STORY (121 FT.)
PARKING APPROVED PER PARKING STUDY	222 SP.
INDEPENDENT LIVING UNIT 0.46 SP. / 1 UNIT @ 256 UNITS	164 SP.
ASSISTED LIVING 0.58 SP. / 1 BED @ 24 BEDS	14 SP.
MEMORY CARE 0.58 SP. / 1 BED @ 16 BEDS	9 SP.
SKILLED NURSING 0.58 SP. / 1 BED @ 60 BEDS	35 SP.
PARKING DEMAND	290 SP.
INDEPENDENT LIVING UNIT 0.46 SP. / 1 UNIT @ 304 UNITS	134 SP.
ASSISTED LIVING 0.58 SP. / 1 BED @ 24 BEDS	14 SP.
MEMORY CARE 0.58 SP. / 1 BED @ 16 BEDS	9 SP.
SKILLED NURSING 0.58 SP. / 1 BED @ 60 BEDS	35 SP.
PARKING PROVIDED	380 SP.
PROPOSED SURFACE SPACES	341 SP.
PROPOSED GARAGE SPACES	39 SP.
HANDICAP SPACE REQUIRED (INCL. IN TOTAL)	8 SP.
HANDICAP SPACES PROVIDED (INCL. IN TOTAL)	8 SP.
LOADING SPACING PROVIDED	4 SP.

* THE RATE TO DETERMINE THE AMOUNT OF PARKING REQUIRED HAS BEEN BASED UPON THE MOST RECENT PARKING STANDARDS ADOPTED BY THE INSTITUTE OF TRANSPORTATION ENGINEERS, 5TH EDITION PARKING GENERATION MANUAL.

LEGEND

AC. = ACRES
D.E. = DRAINAGE EASEMENT
DRO = DEVELOPMENT REVIEW OFFICERS
D.U. = DWELLING UNITS
EX. = EXISTING
FLU = FUTURE LAND USE
L.A.E. = LIMITED ACCESS EASEMENT
L.M.E. = LAKE MAINTENANCE EASEMENT
OHME = OVERHANG/MAINTENANCE EASEMENT
O.R.B. = OHICIAL RECORD BOOK
P.B. = PLAT BOOK
PDR = PROPERTY DEVELOPMENT REGULATIONS
PG. = PAGE
R = RADIUS
R.O.W. = RIGHT-OF-WAY
R/W = RIGHT-OF-WAY
S.F. = SQUARE FEET
T.B.A. = TO BE ABANDONED
T.B.R. = TO BE RELOCATED
TYP = TYPICAL
U.E. = UTILITY EASEMENT
ULDC = UNIFIED LAND DEVELOPMENT CODE
WFH = WORKFORCE HOUSING

WGI.
WGInc.com
2035 VISTA PARKWAY, WEST PALM BEACH, FLORIDA 33411
561.687.2220

PRELIMINARY

NOT FOR CONSTRUCTION, BIDDING, OR PERMIT PURPOSES.

PREPARED UNDER THE SUPERVISION OF WGI, INC. ON 2025-02-21

INITIAL SUBMITTAL FEBRUARY 21, 2025

THE WATERFORD
601 UNIVERSE BOULEVARD
JUNO BEACH, FL 33408

SITE PLAN

SHEET
SP-1
1 OF 1
2920.04

Exhibit 4

This Page Intentionally Left Blank

Department of Engineering and Public Works
P.O. Box 21229
West Palm Beach, FL 33416-1229
(561) 684-4000
FAX: (561) 684-4050
www.pbcgov.com

Palm Beach County Board of County Commissioners
Robert S. Weinroth, Mayor
Gregg K. Weiss, Vice Mayor
Maria G. Marino
Dave Kerner
Maria Sachs
Melissa McKinlay
Mack Bernard

County Administrator
Verdenia C. Baker

"An Equal Opportunity Affirmative Action Employer"

printed on sustainable and recycled paper

January 25, 2022

Dr. Juan F. Ortega, PE
JFO Group Inc.
6671 W Indiantown Road, Suite 50-324
Jupiter, FL 33458

RE: The Waterford
Project #: 220113
Traffic Performance Standards (TPS) Review

Dear Dr. Ortega:

The Palm Beach County Traffic Division has reviewed the above referenced project Traffic Impact Statement, dated January 18, 2022, pursuant to the Traffic Performance Standards in Article 12 of the Palm Beach County Unified Land Development Code (ULDC). The project is summarized as follows:

Municipality:	Juno Beach
Location:	South side of Universe Blvd, just west of US-1
PCN:	28-43-41-33-11-001-0000 (additional PCNs in file)
Access:	Two full and one egress-only access driveway connections onto Universe Blvd (As used in the study and is NOT an approval by the County through this letter)
Existing Uses:	Congregate Care Facility = 288 DUs Assisted Living Facility = 60 Beds
Proposed Uses:	Expand the existing site for a total of: Congregate Care Facility = 356 DUs Assisted Living Facility = 100 Beds
Project Daily Trips:	979
Project Peak Hour Trips:	44 (27/17) AM; 90 (44/46) PM
New Daily Trips:	241
New Peak Hour Trips:	13 (8/5) AM; 22 (10/12) PM
Build-out:	December 31, 2026

Based on our review, the Traffic Division has determined the proposed development does not have significant peak hour traffic impact (as defined in PBC TPS) on the roadway network and, therefore, **meets** the TPS of Palm Beach County.

Please note the receipt of a TPS approval letter does not constitute the review and issuance of a Palm Beach County Right-of-Way (R/W) Construction Permit nor does it eliminate any requirements that may be deemed as site related. For work within Palm Beach County R/W, a detailed review of the project will be provided upon submittal for a R/W permit application. The project is required to comply with all Palm Beach County standards and may include R/W dedication.

No building permits are to be issued by the Town after the build-out date specified above. The County traffic concurrency approval is subject to the Project Aggregation Rules set forth in the Traffic Performance Standards Ordinance.

The approval letter shall be valid no longer than one year from date of issuance, unless an application for a Site Specific Development Order has been approved, an application for a Site Specific Development Order has been submitted, or the approval letter has been superseded by another approval letter for the same property.

If you have any questions regarding this determination, please contact me at 561-684-4030 or email HAkif@pbcgov.org.

Sincerely,

Hanane Akif, P.E.
Professional Engineer
Traffic Division

QB:HA:qg
ec:
Frank Davila, Director, P&Z, Town of Juno Beach
Quazi Bari, P.E., PTOE, Manager – Growth Management, Traffic Division

File: General - TPS - Mun - Traffic Study Review
F:\TRAFFIC\HA\MUNICIPALITIES\APPROVALS\2022\220113 - THE WATERFORD.DOCXN