

CONTRACTOR SHALL LOCATE ALL UTILITIES BEFORE CONSTRUCTION AND NOTIFY ARCHITECT AND OWNER OF ANY INTERFERENCES.

CONTRACTOR SHALL PROVIDE ALL BARRIERS, BARICADES, FENCES AND SAFETY EQUIPMENT AND PRECAUTIONS REQUIRED BY ALL CODES AND SAFE CONSTRUCTION PRACTICES.

ALL CONSTRUCTION SHALL BE DONE IN ACCORDANCE WITH ALL CODES OR AGENCIES HAVING JURISDICTION OVER THE PROJECT.

ALL MATERIALS SHALL BE INSTALLED PER MANUFACTURERS REQUIREMENTS AND RECOMMENDATIONS.

CONSTRUCTION OF THIS BUILDING SHALL MEET OR EXCEED ALL APPLICABLE ORDINANCES, CODES AND STANDARDS. IN THE CASE OF CONFLICT, THE MOST STRINGENT SHALL APPLY. STATE OF WISCONSIN ADMINISTRATIVE CODE.

SHEET INDEX

- A.1 SITE PLAN
- A.2 FIRST FLOOR PLAN
MEZZANINE PLAN
ENLARGED BATHROOM PLAN
BATHROOM FIXTURE ELEVATIONS
- A.3 ROOM FINISH SCHEDULE
DOOR AND FRAME SCHEDULE
WINDOW TYPES
WALL TYPES
MASONRY REINFORCEMENT DETAIL
- A.4 BUILDING ELEVATIONS
- A.5 BUILDING SECTION
ENLARGED STAIR PLAN
ENLARGED STAIR ELEVATION
- A.6 WALL SECTIONS
- A.7 WALL SECTIONS
- S.1 FOUNDATION PLAN
SECOND FLOOR FRAMING PLAN
SCHEDULES - LINTEL, COLUMN AND FOOTING
- S.2 PIER DETAILS
- S.3 STRUCTURAL DETAILS

EROSION CONTROL PLAN

- SILT FENCE 520 LF
- TOP SOIL STOCK PILE
- ▨ TRACKING PAD
- ST—ST— 6" x 8" STORM LATERALS
- (MH) CATCH BASIN STORM

NOTE: PLACE FILTER FABRIC IN ALL STORM LINES IN PARKING LOT & AT CURBS ALONG NORTH RIDGE DRIVE (3) three Locations

SITE PLAN LEGEND

- 111.2'— EXISTING ELEVATION
- 111'-10" NEW ELEVATION
- 120--- CONTOUR LINE (EXISTING GRADES)
- PAVEMENT MARKINGS
- ◇ FIRE HYDRANT
- MANHOLE
- 1" IRON PIPE FOUND
- CATCH BASIN






- MATERIALS
- BITUMINOUS PAVING
- CONCRETE

NOTES

1. STANDARD PARKING SPACE: 9' x 18.5'
- TYPICAL HANDICAP PARKING SPACE: 8' x 16.5' WITH 5' x 18.5' ACCESS AISLE ON ONE SIDE
- VAN ACCESSIBLE HANDICAP PARKING SPACE: 8' x 16.5' WITH 5' x 18.5' ACCESS AISLE ON PASSENGER SIDE
2. ALL SIDEWALKS ARE 5'-0" WIDE UNLESS OTHERWISE NOTED (MEASURED FROM FACE OF CURB WHERE ADJACENT CURB)
3. HANDICAP CURB RAMPS SHALL NOT EXCEED 1:12 SLOPE ALONG PATH OF TRAVEL WITH 1:10 MAX. SLOPE AT FLARED SIDES
4. PROVIDE DETECTABLE WARNING TEXTURE AT CURB RAMPS AND AT AREAS WHERE PEDESTRIAN ACCESSIBLE ROUTE MEETS VEHICULAR PATH.


NOTE: OWNER TO ARRANGE TO HAVE A REGISTERED SITE SURVEYOR VERIFY ALL PROPERTY BOUNDARIES PRIOR TO START OF CONSTRUCTION.

GENERAL CONTRACTOR TO PROVIDE SILT FENCING AND/OR SLOPE STABILIZATION TO PREVENT SOIL WASHOUT DURING CONSTRUCTION.

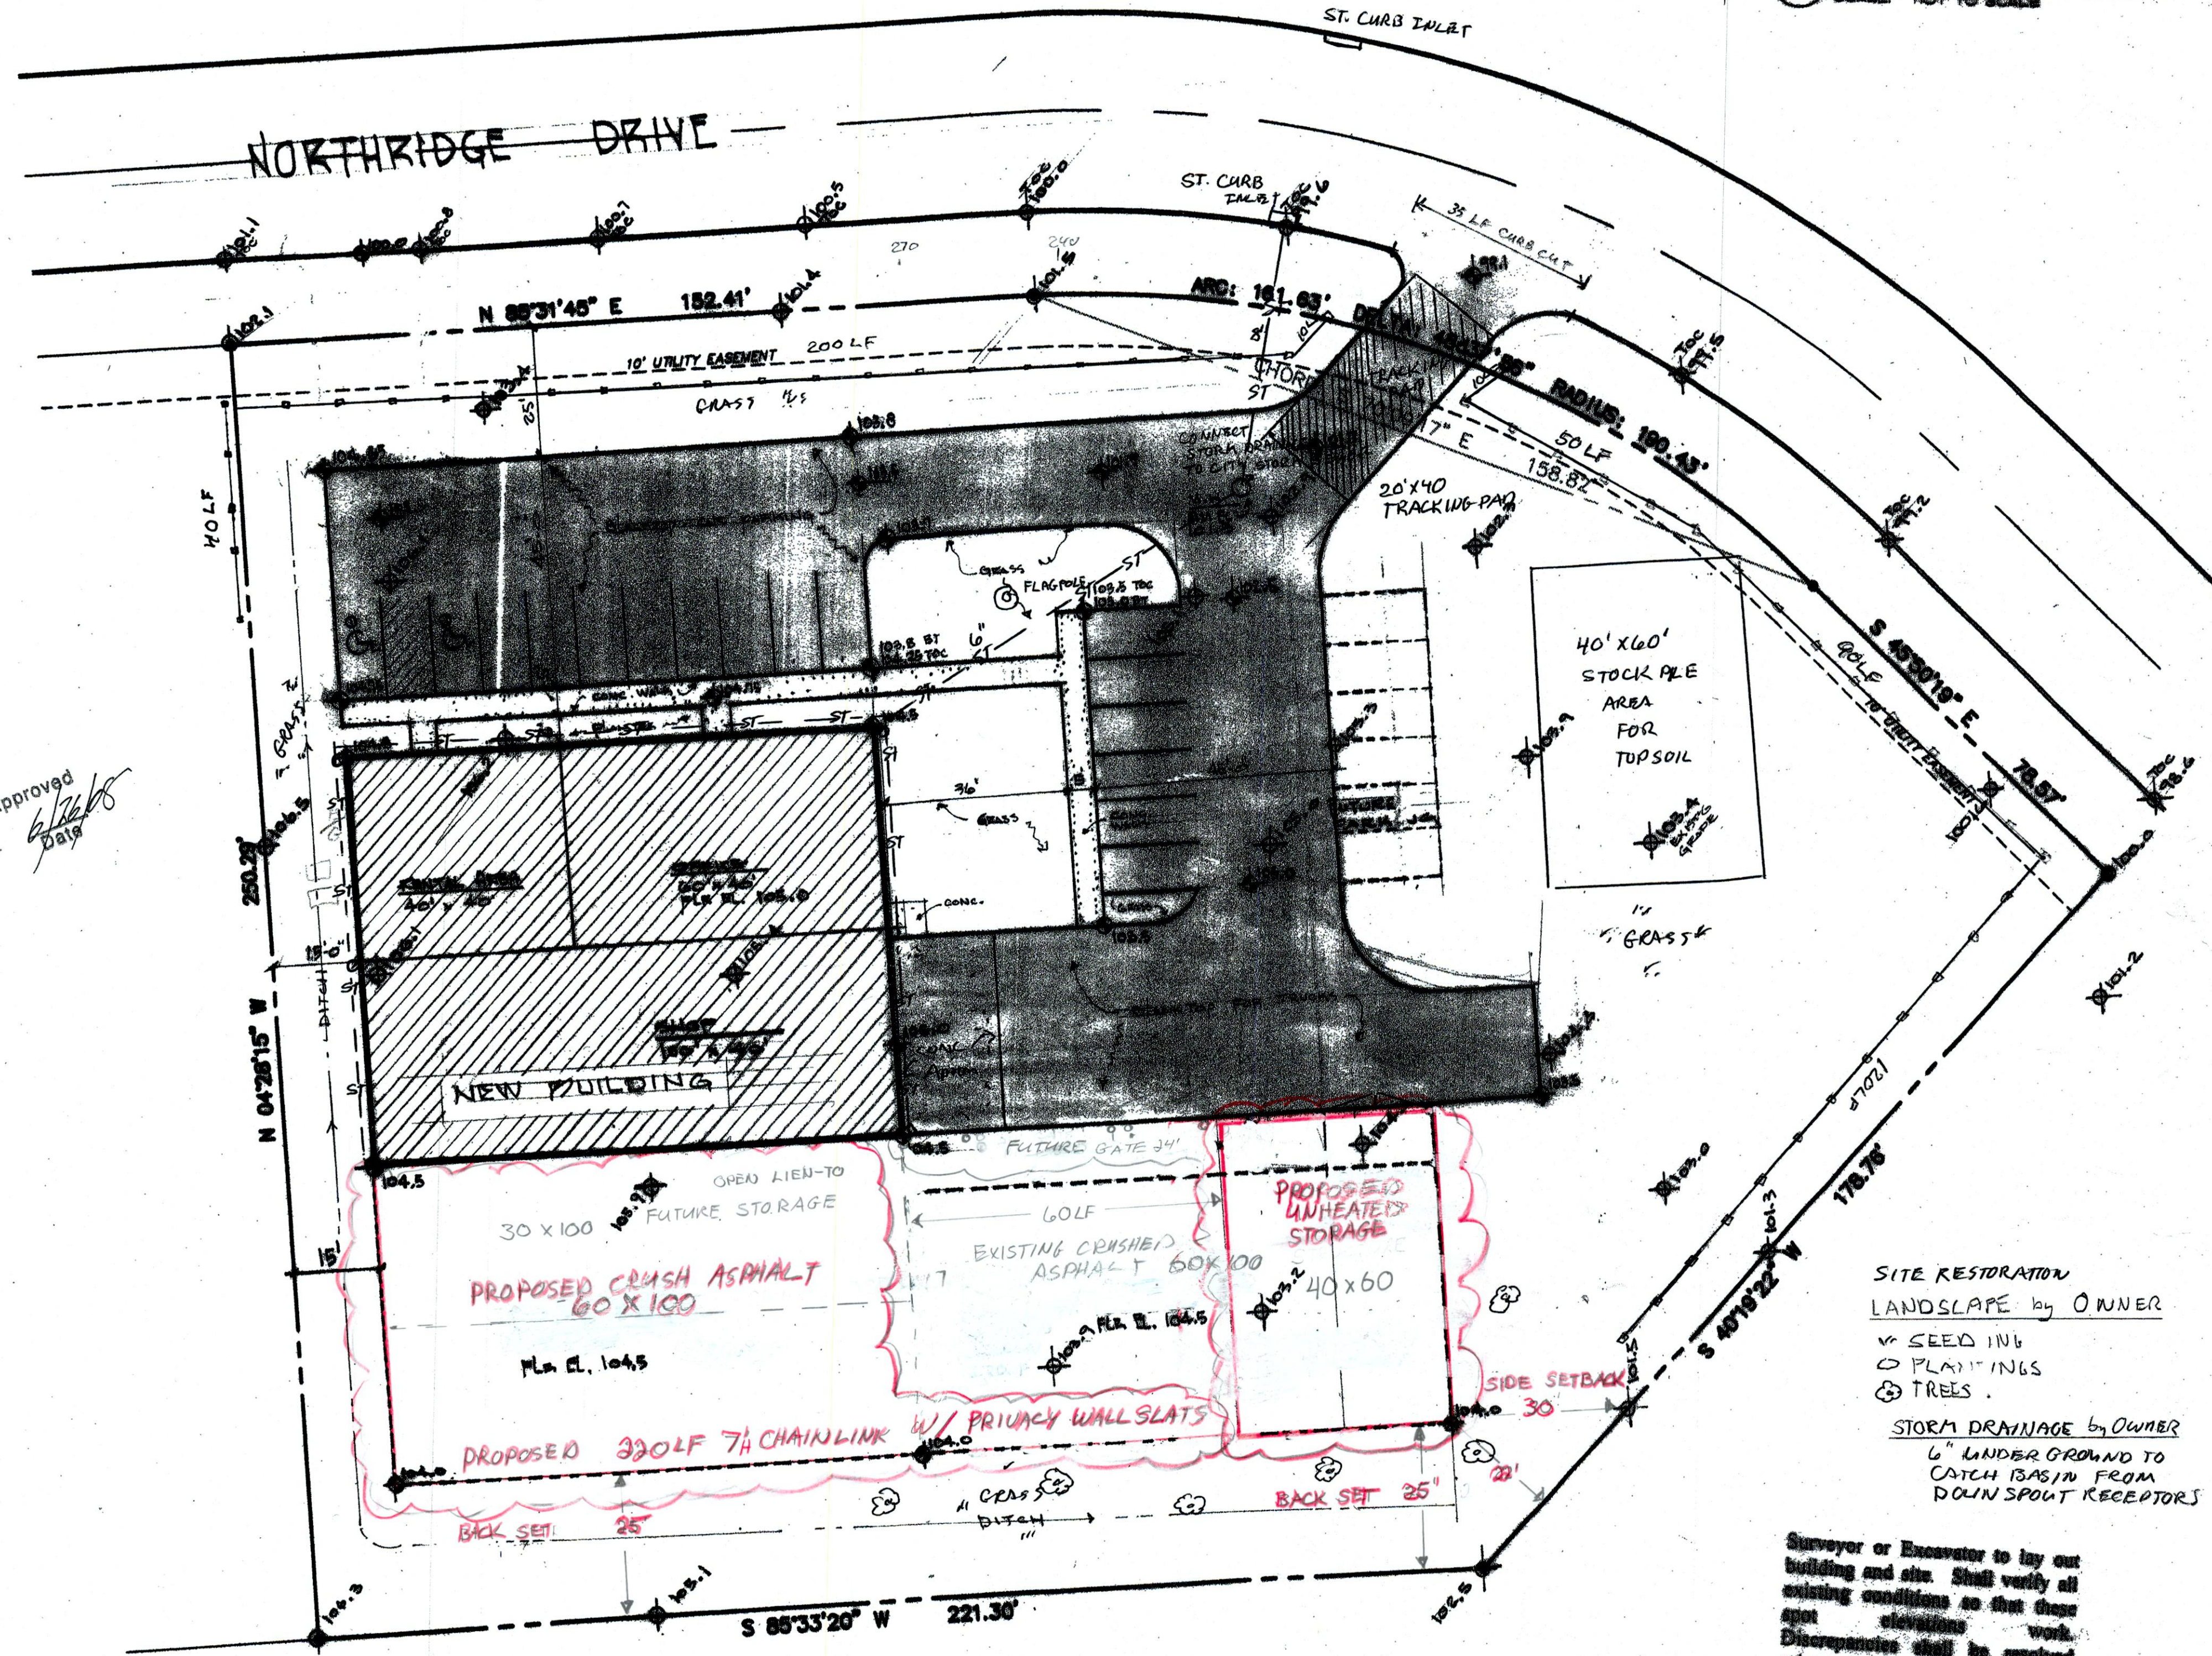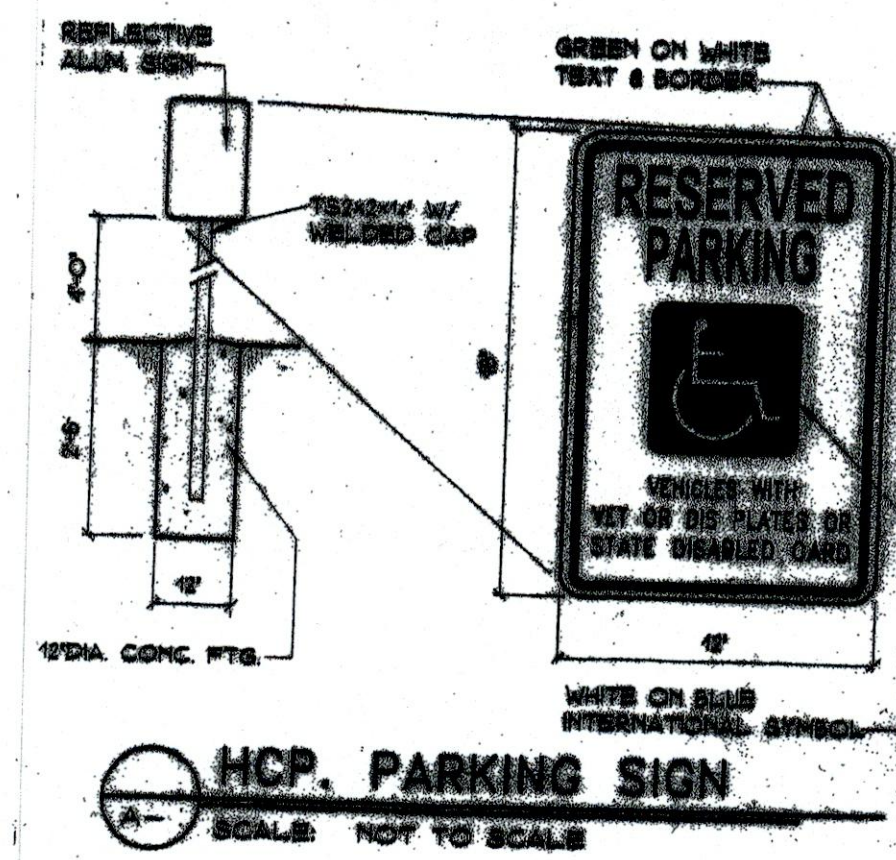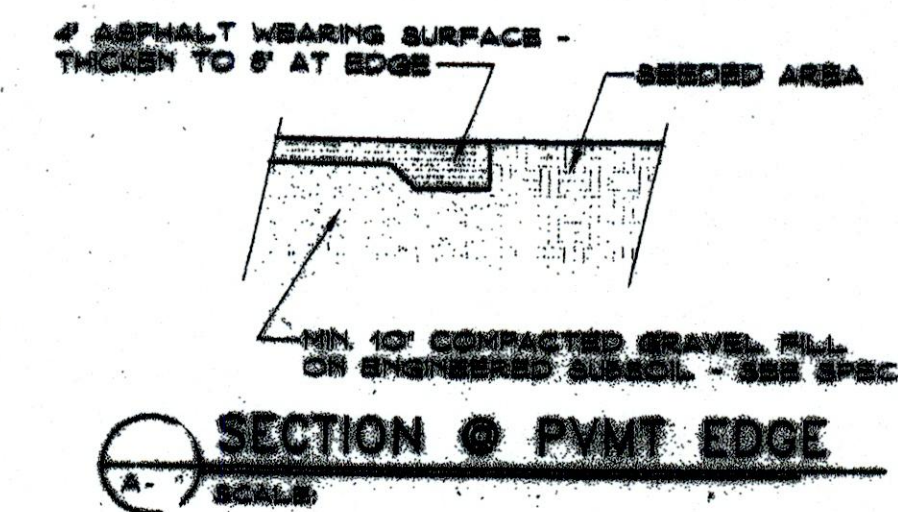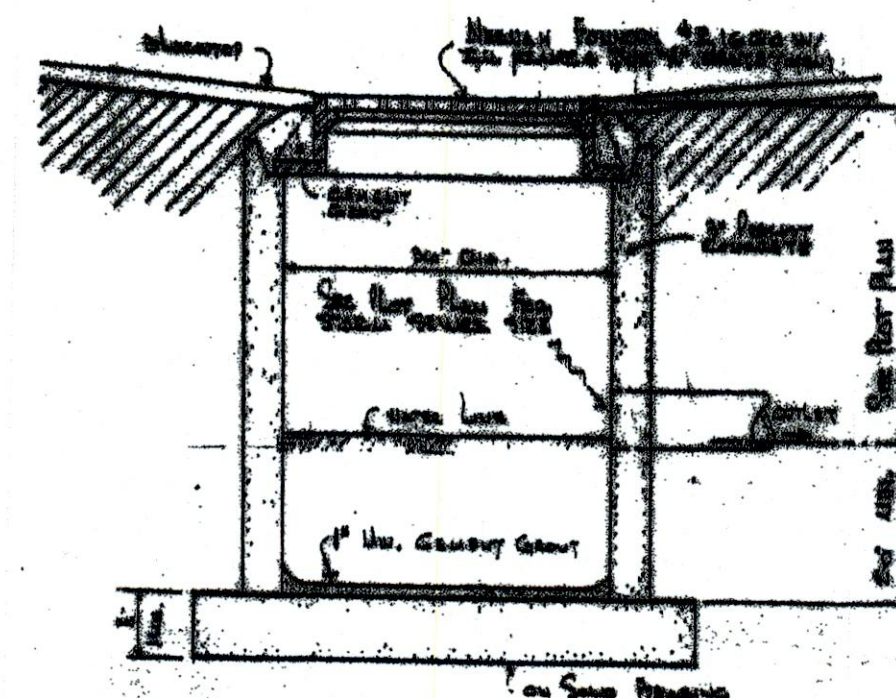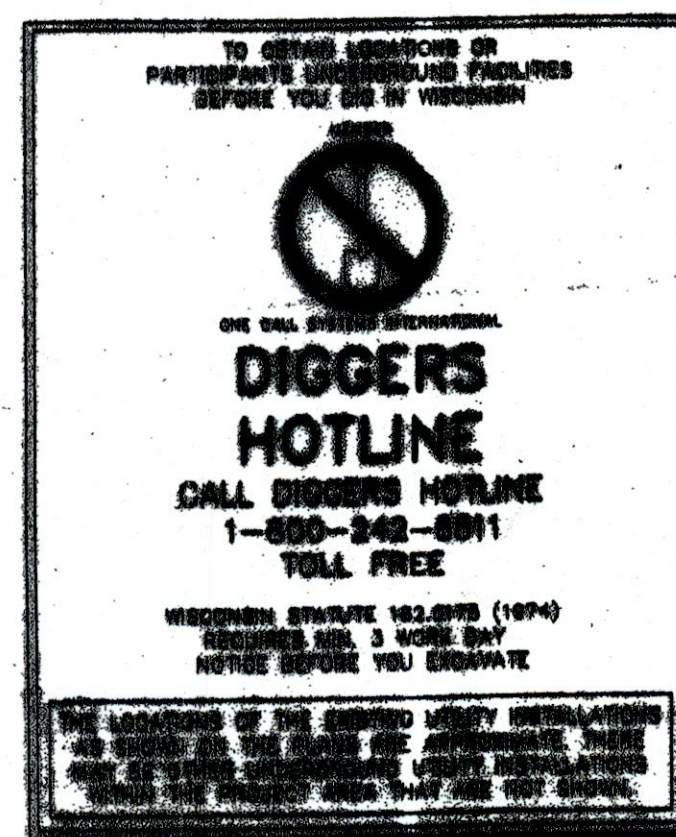

PLOT PLAN

SCALE: 1" = 200'



SITE RESTORATION LANDSCAPE by OWNER
V SEEDING
O PLANTINGS
T TREES
STORM DRAINAGE by OWNER
6" UNDER GROUND TO CATCH BASIN FROM DOWN SPOUT RECEPTORS

Surveyor or Excavator to lay out building and site. Shall verify all existing conditions as they appear on drawings. Discrepancies shall be resolved prior to excavation.


Am Check
Copy of Approval Letter

PROJECT #2
Proposed plans for
MIKE MILDACH CONSTRUCTION
KAUKAUNA, WI.

THOMAS KLOBER
389 Williams Dr.
Kaukauna, WI 54136
(920) 774-8972
(Fax) 920-775-7755


JOB NO.
FILE NO.
DRAWN BY
DATE
SHEET NO.

A.1.1

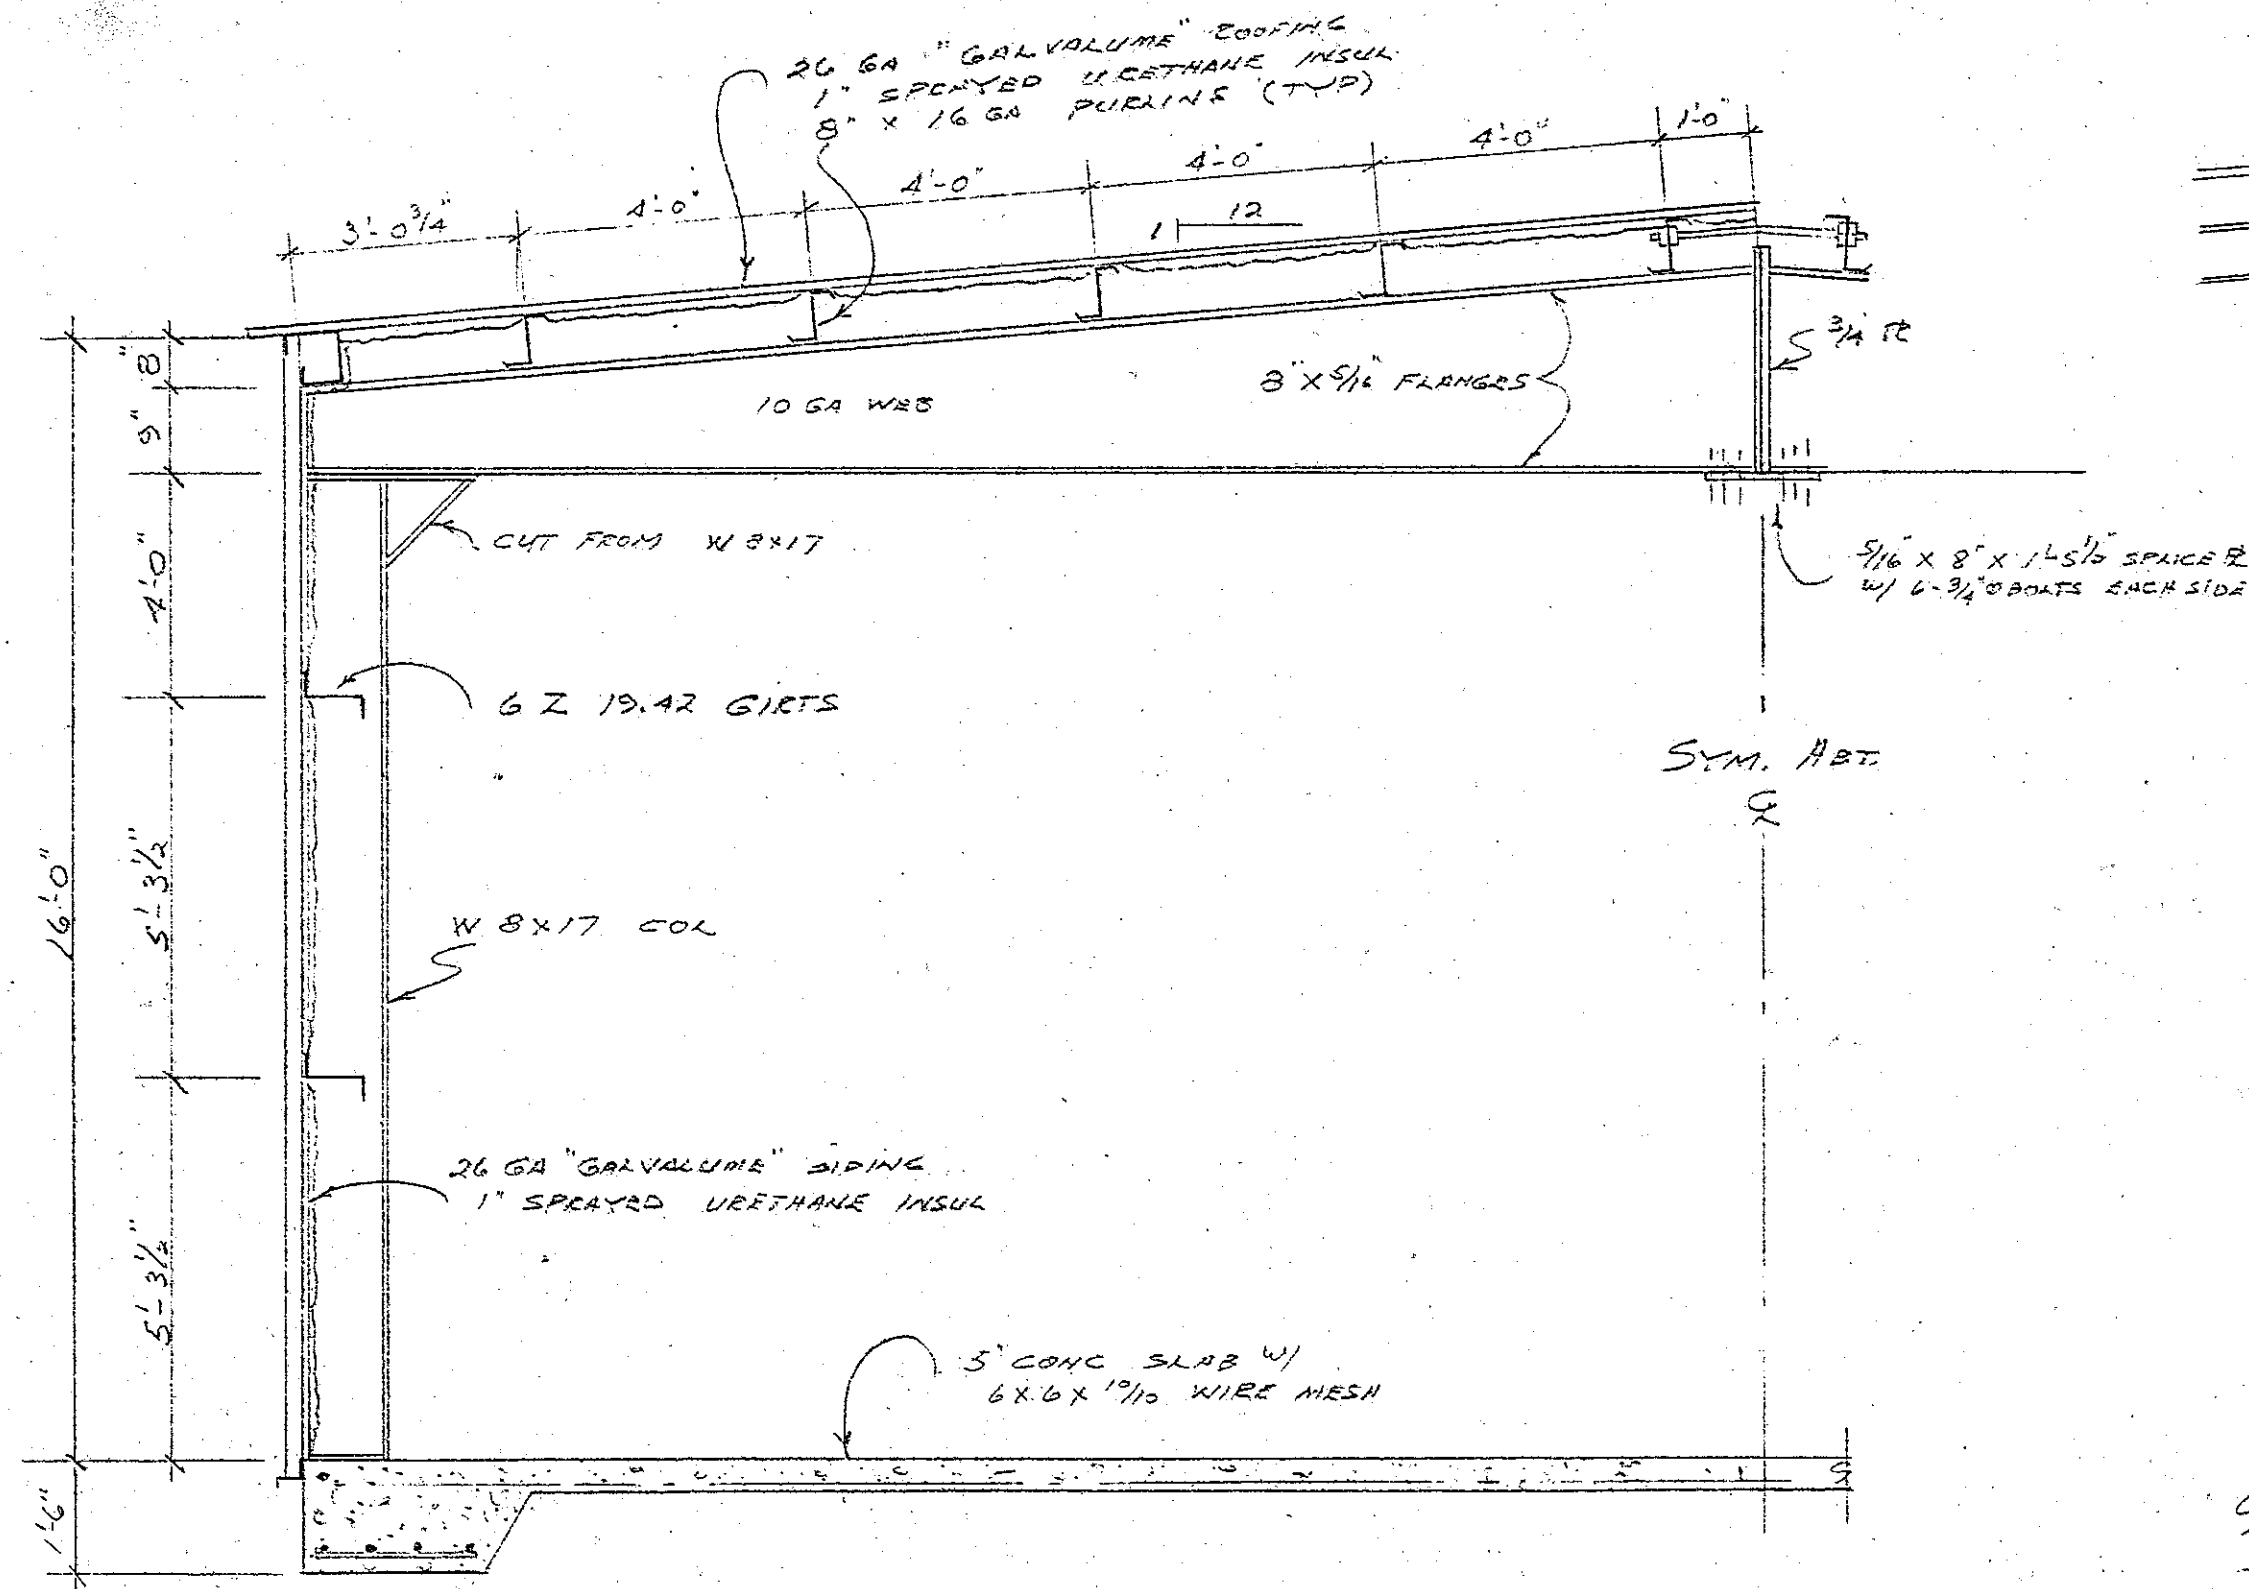


TYPICAL HALF SECTION

SCALE: $\frac{3}{8}" = 1'-0"$

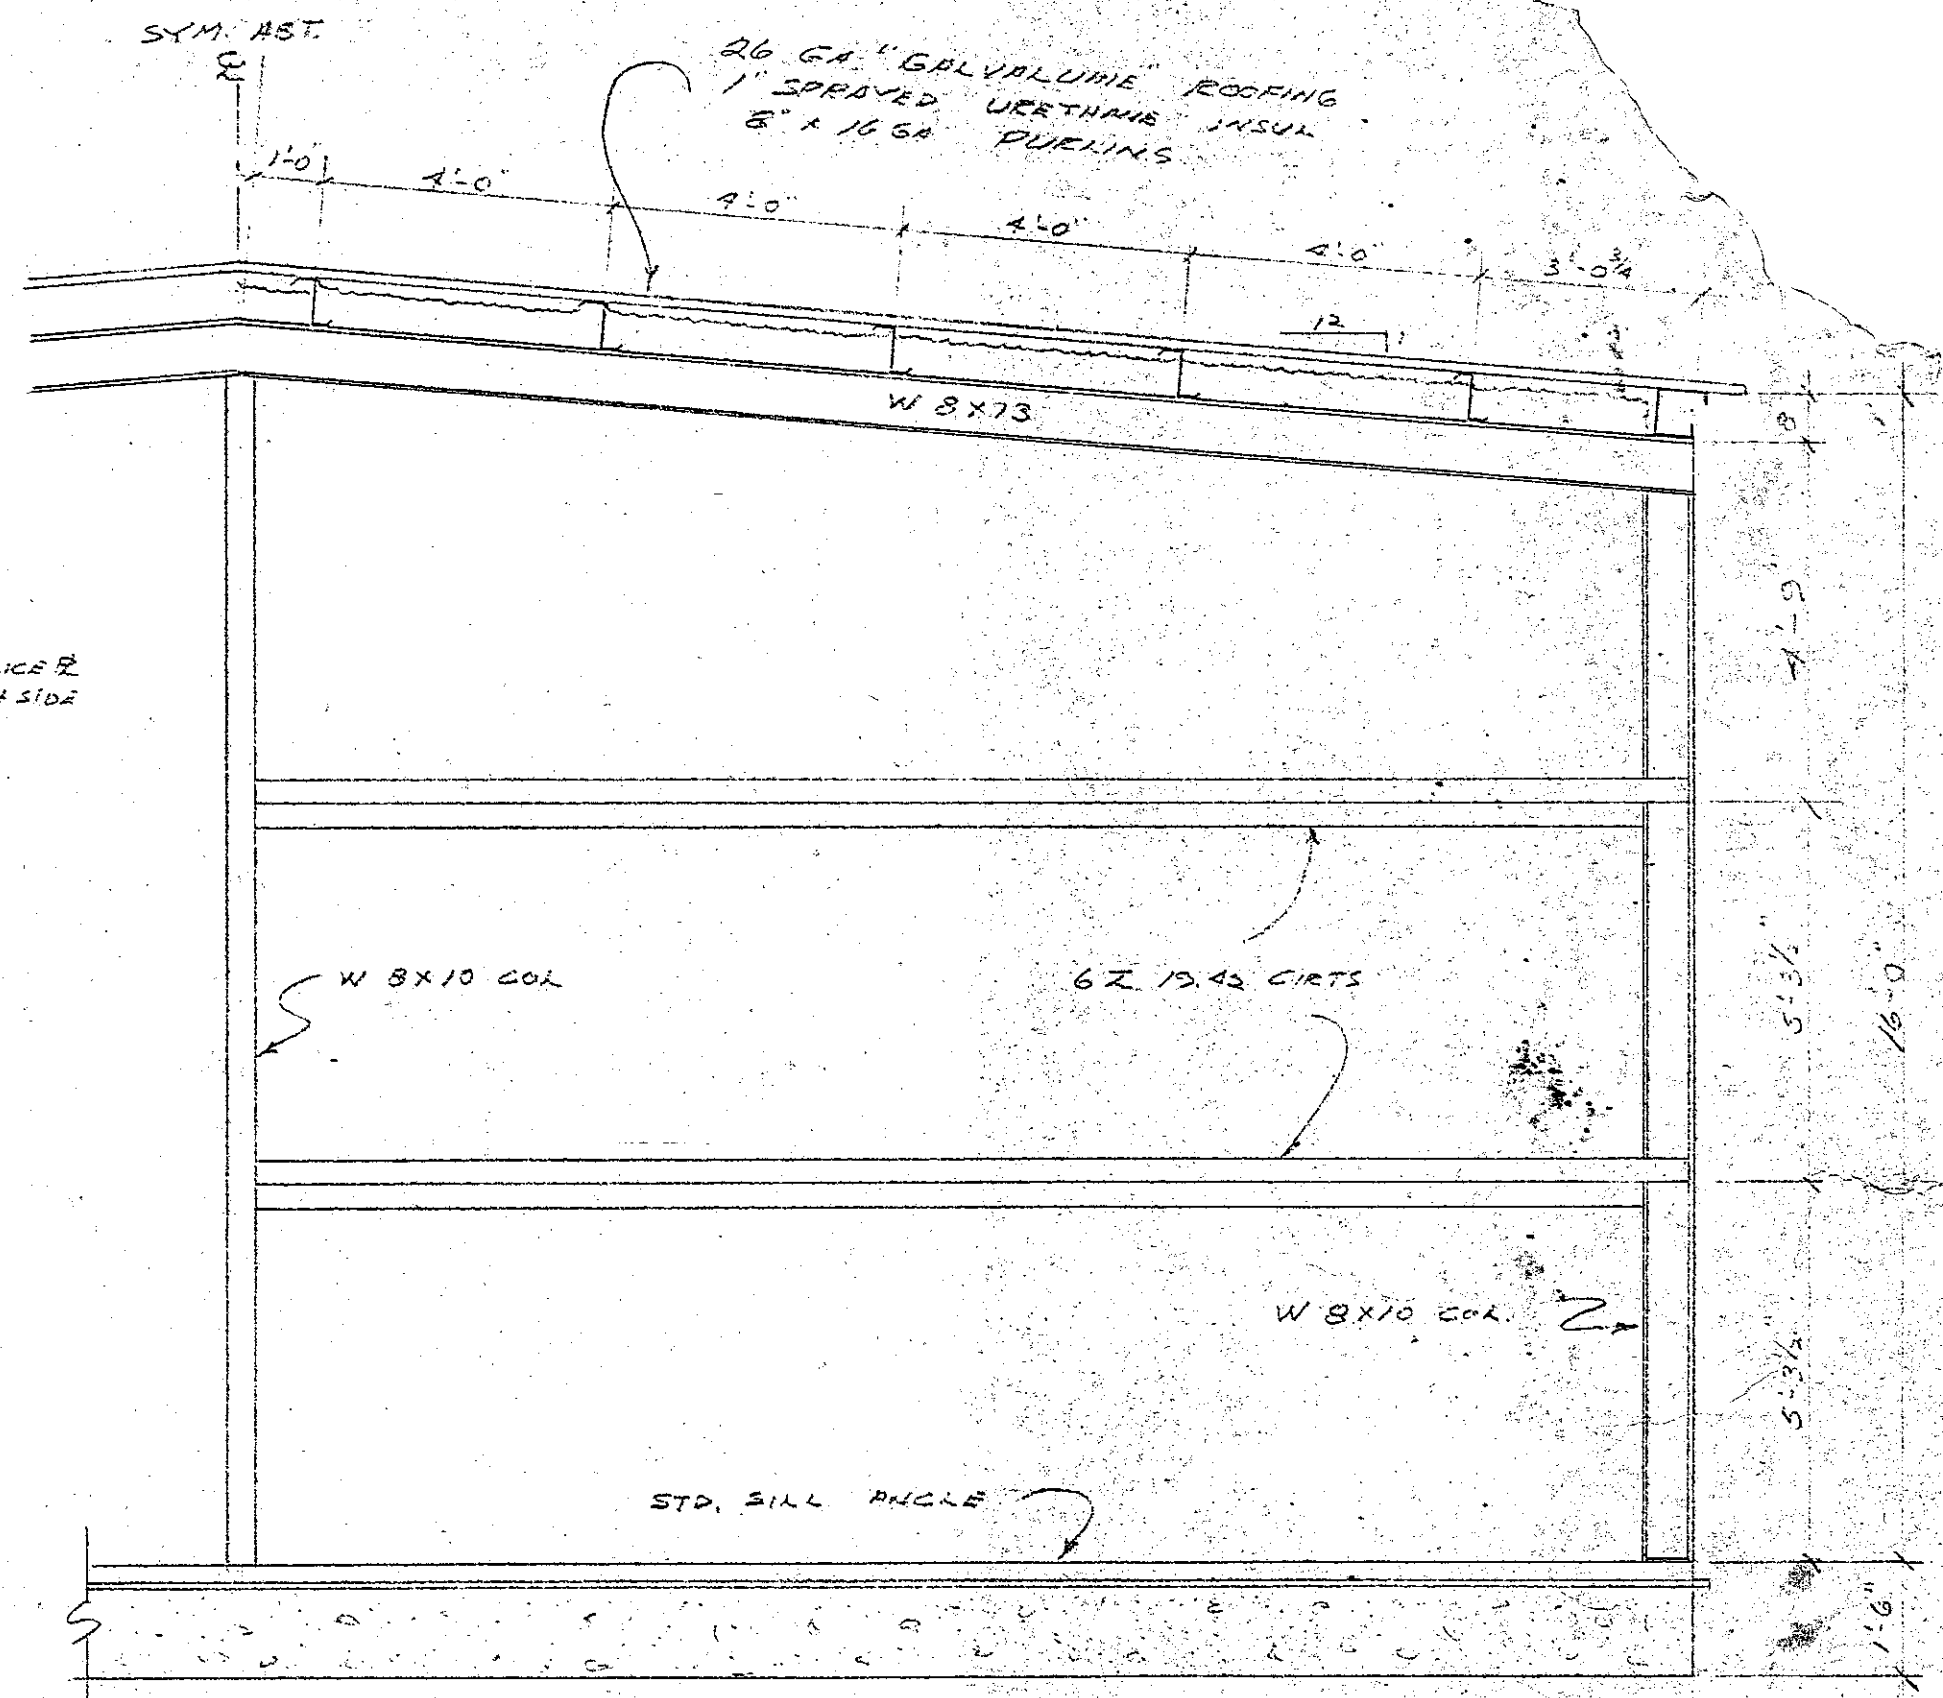


TYPICAL HALF END WALL FRAMING

SCALE: $\frac{3}{8}" = 1'-0"$

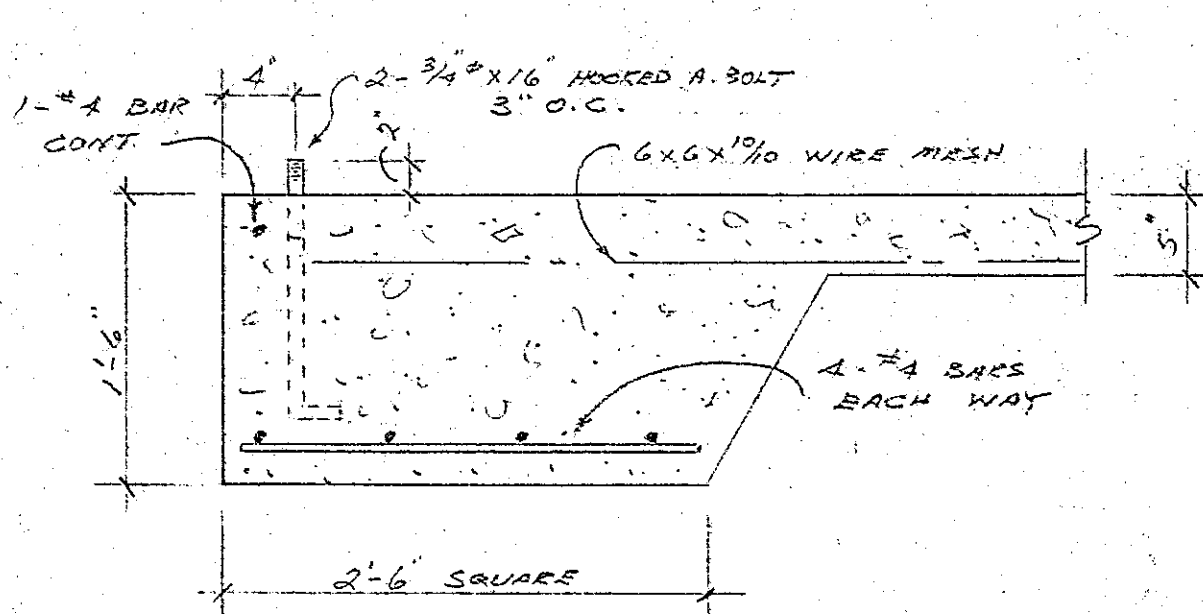


DETAIL $\frac{1}{5}$

SCALE: $1" = 1'-0"$

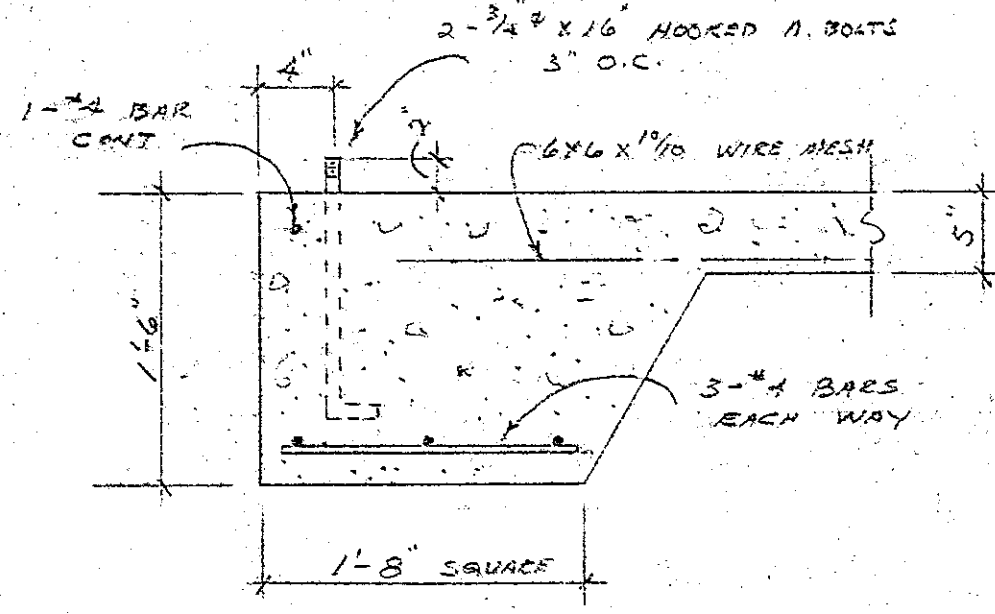


DETAIL $\frac{2}{5}$

SCALE: $1" = 1'-0"$

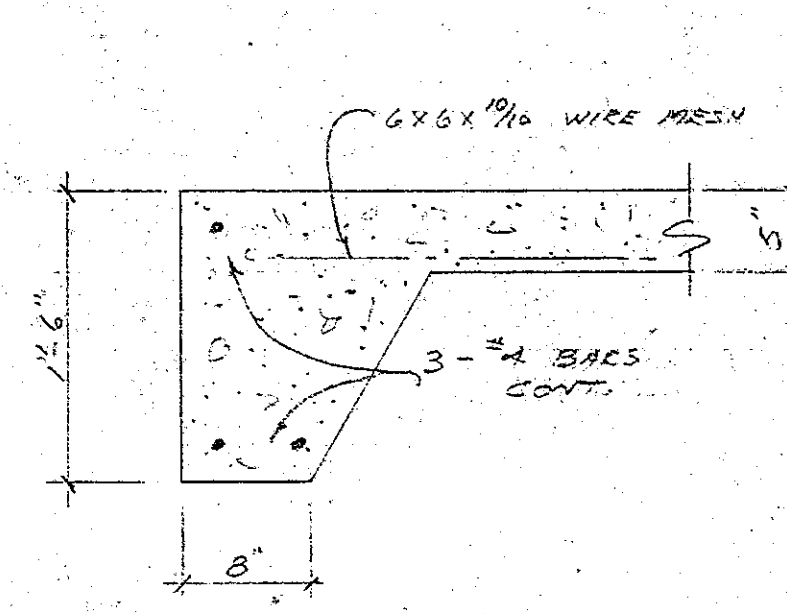

DETAIL $\frac{3}{5}$



SCALE: $1" = 1'-0"$

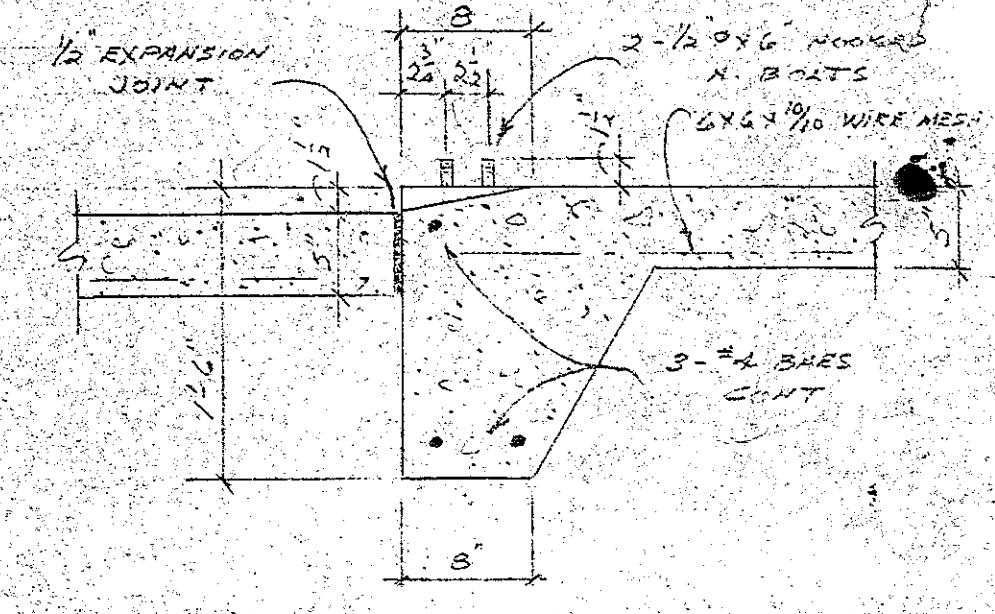


DETAIL $\frac{4}{5}$


SCALE: $1" = 1'-0"$

JOB NO 74122	AUG 24, 1974	SHEET
TOWN OF UNDERHILL FIRE STATION	UNDERHILL, WISCONSIN	5
ENGR: LAWRENCE J. MOUTY	PESHTIGO, WIS.	5

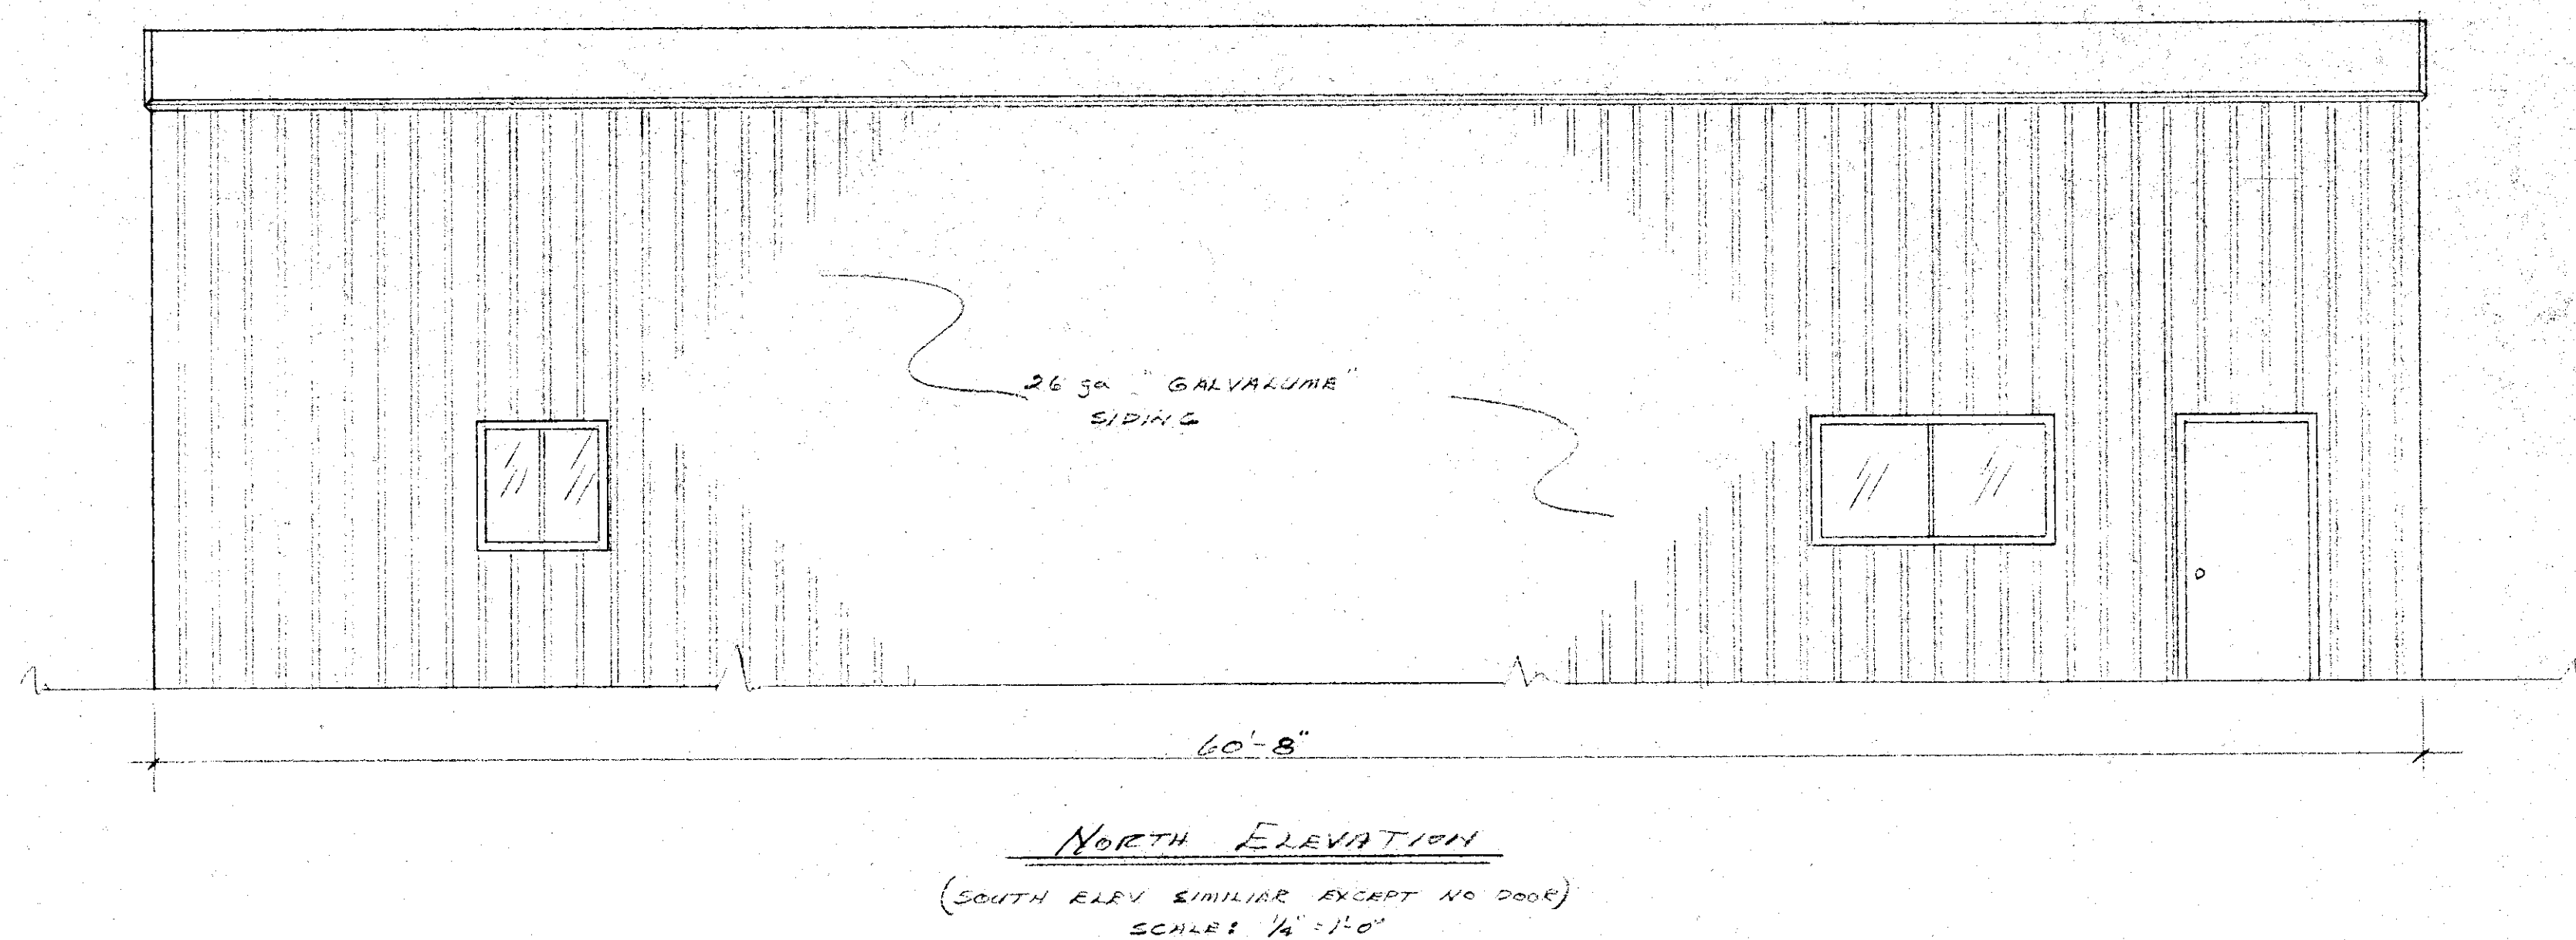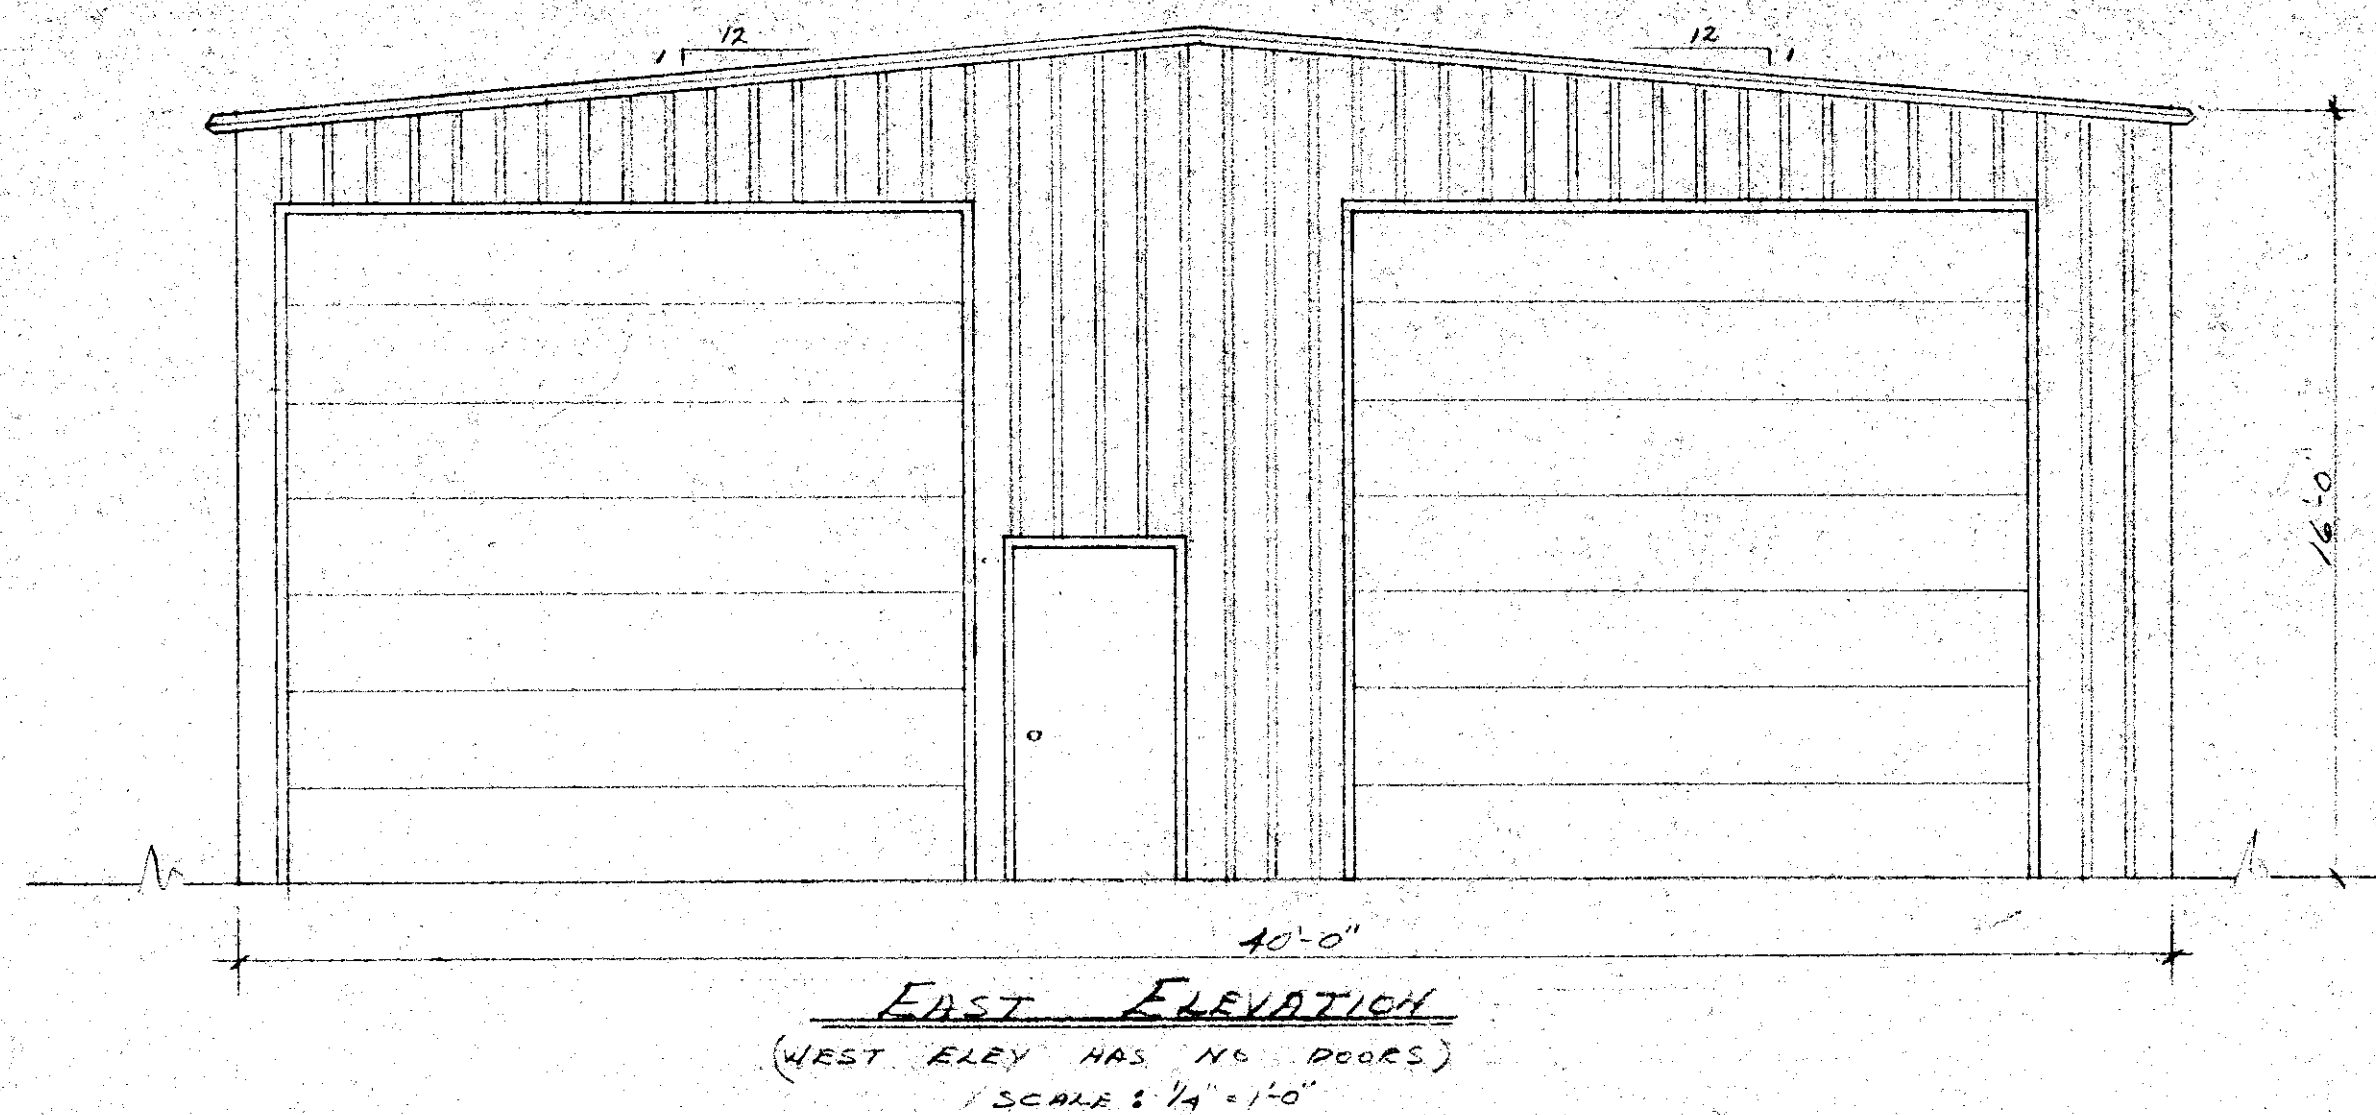

JOB NO 74122	AUG. 24, 1974	SHEET
TOWN OF UNDERHILL FIRE STATION		4
UNDERHILL, WISCONSIN		OF
ENGR: LAWRENCE J. MOUTY, PESHTIGO, WIS.		5

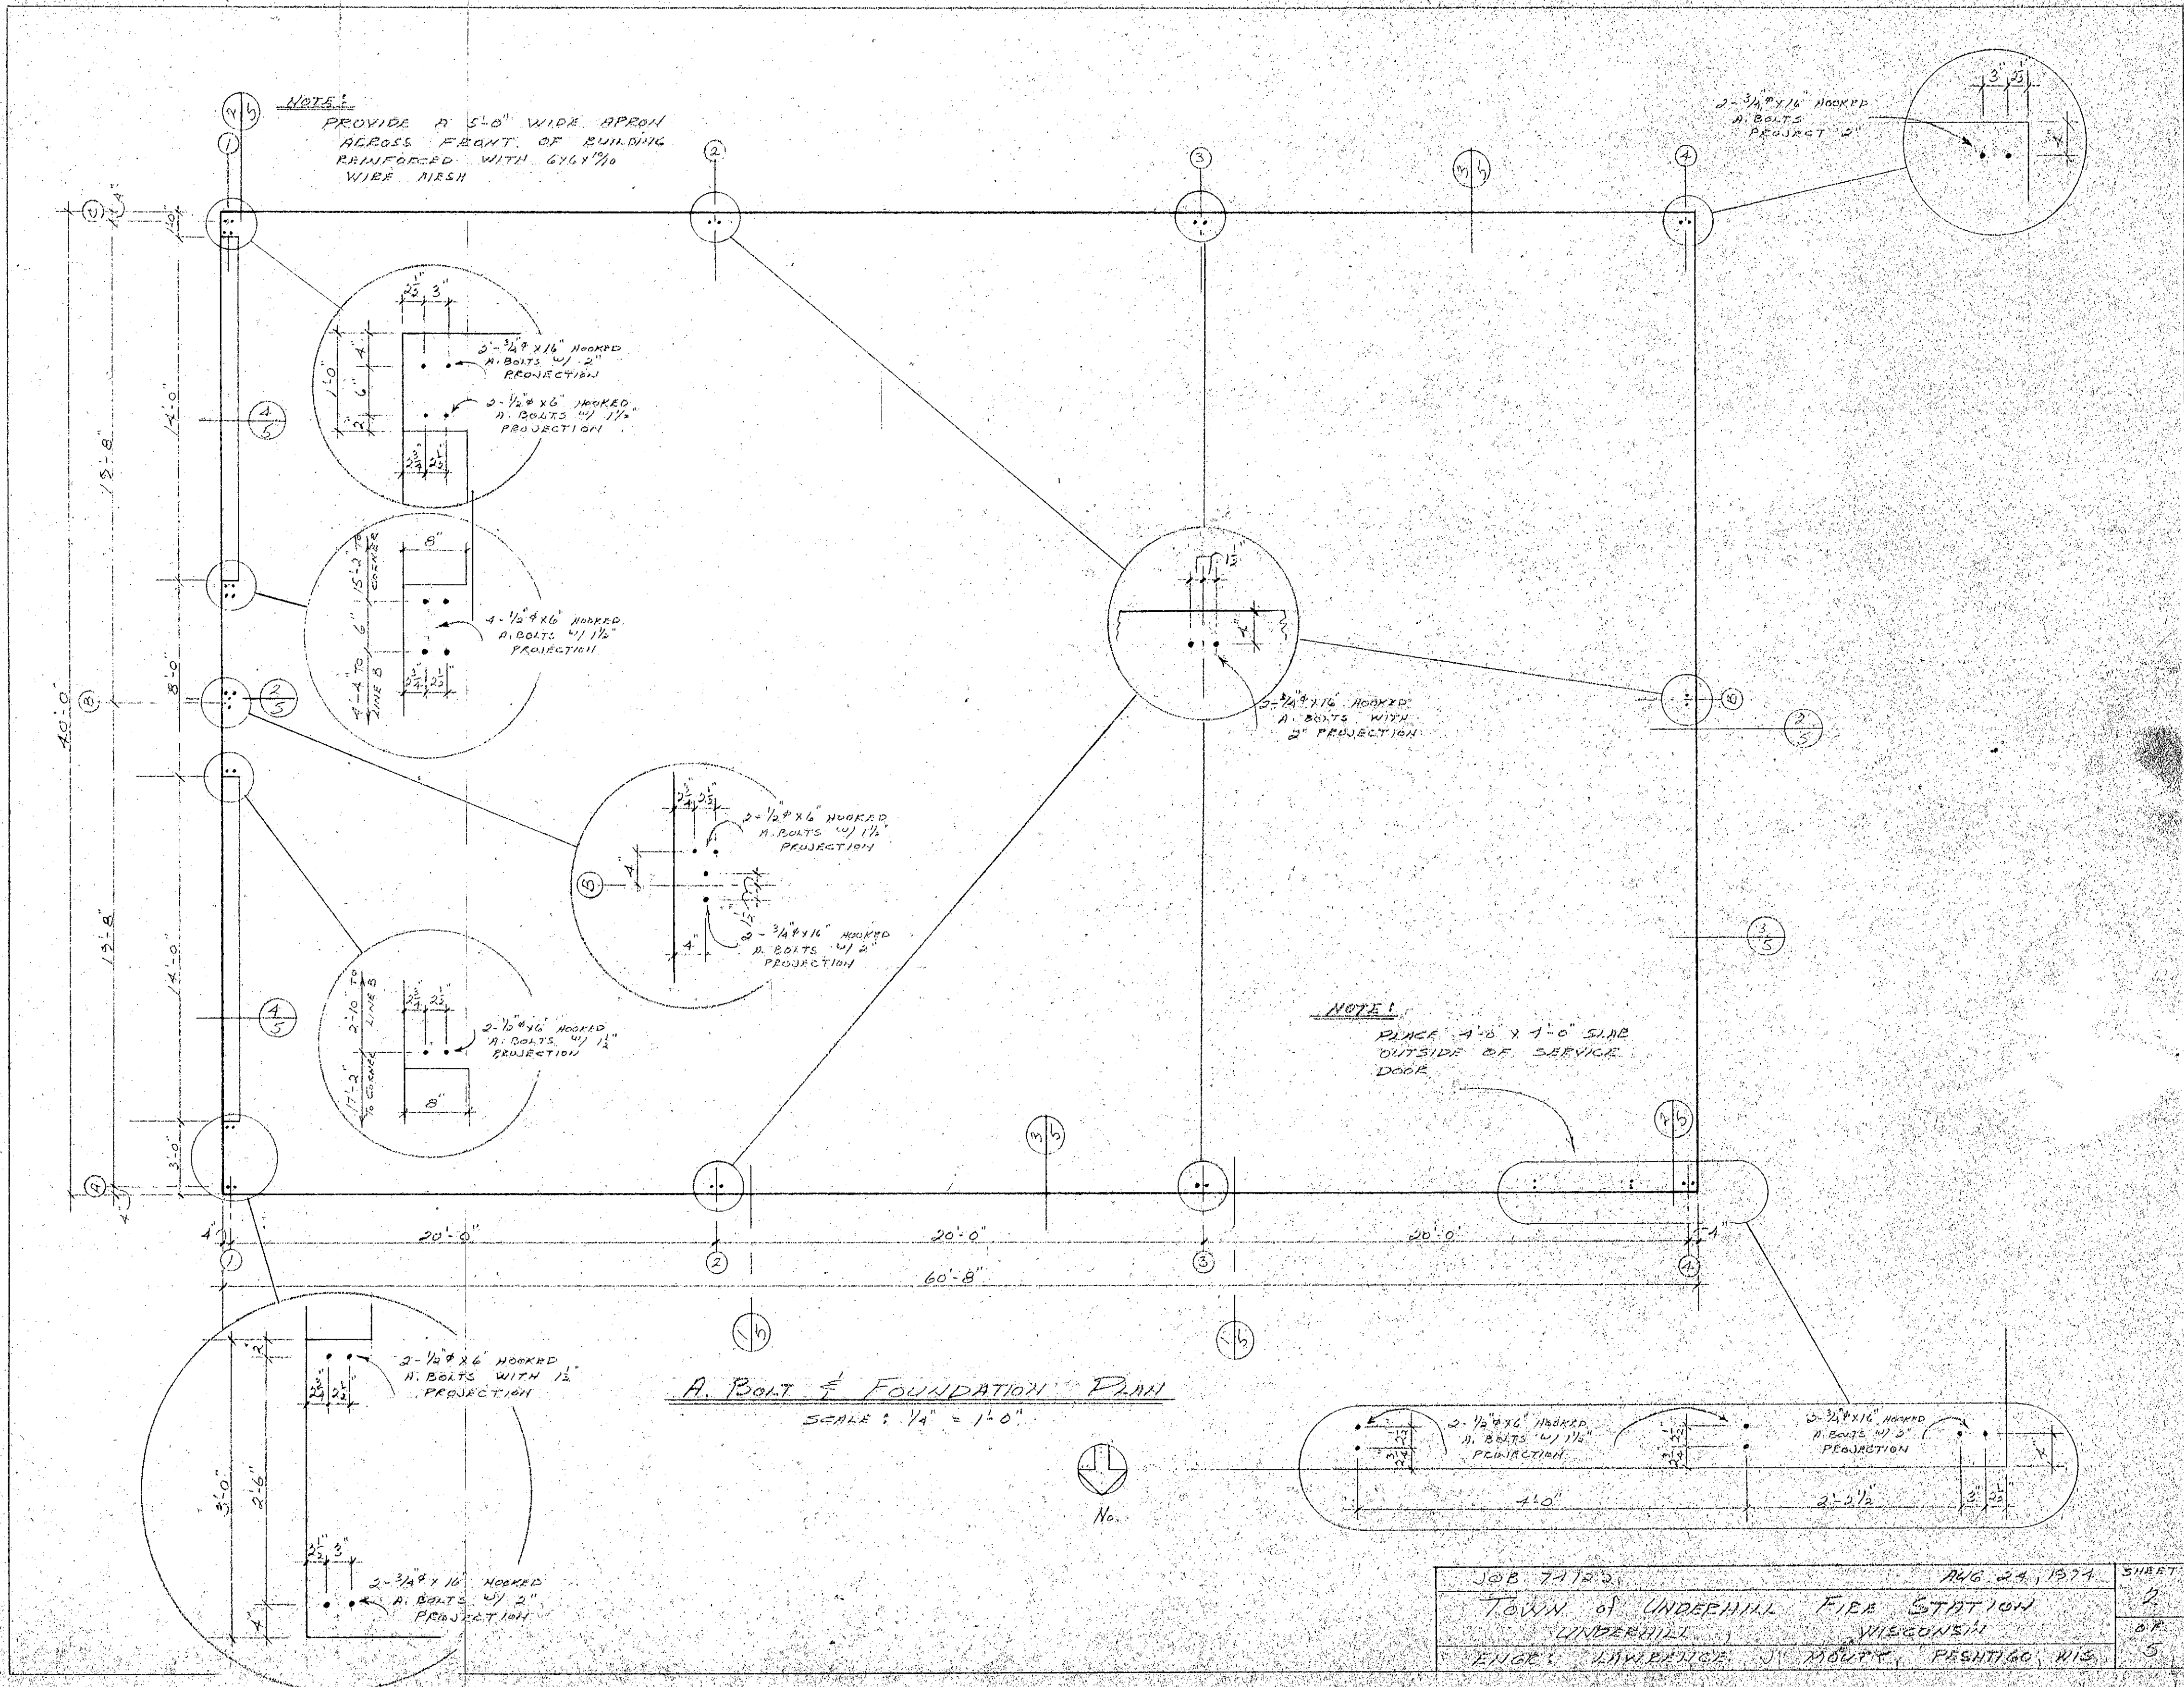


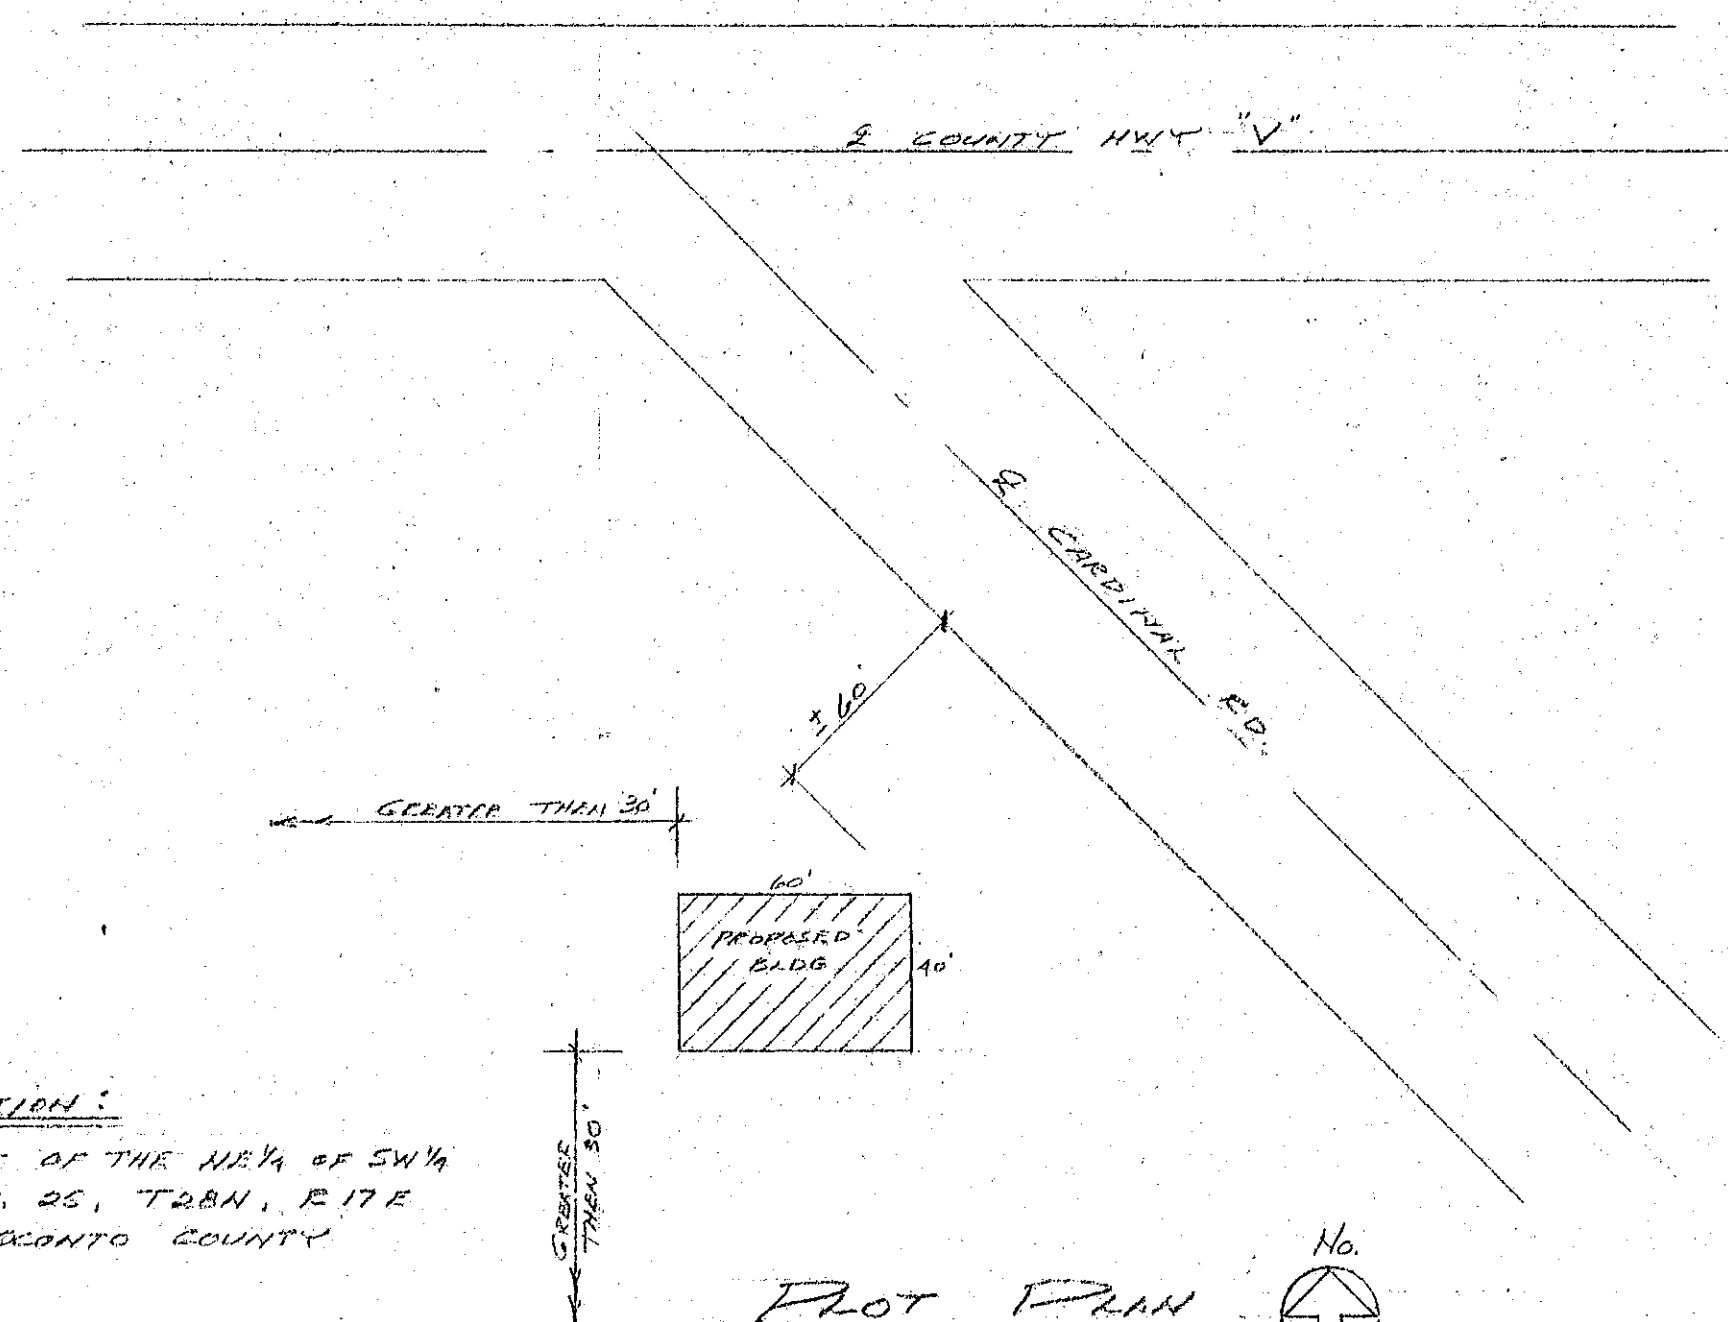

DESCRIPTION:

PART OF THE NE 1/4 OF SW 1/4
SECT. 25, T28N, R17E
IN Oconto COUNTY

Plot Plan
SCALE: 1"=50'



GENERAL NOTES:

1. FLOOR SLAB SHALL BE PLACED ON WELL COMPACTED & WELL DRAINED SOIL.
2. ALL CONCRETE SHALL DEVELOPE A 28 DAY STRENGTH OF 3000 PSI
3. PROVIDE "EXIT" LIGHTS OVER ALL SERVICE DOORS
4. HEATING & VENTILATING PLANS SHALL BE SUBMITTED TO D.I.L.H.R. BY HEATING CONTRACTOR
5. EXIT DOORS SHALL BE EQUIPPED WITH STANDARD APPROVED HARDWARE.
6. BUILDING IS FOR THE STORAGE OF FIVE OR LESS VEHICLES, NO REPAIR

DESIGN DATA

ROOF DEAD LOAD = 3.5 #/ft²
 ROOF LIVE LOAD = 30 #/ft²
 WIND LOAD = 20 #/ft²
 ASSUMED SOIL PRESSURE = 3000 PSF
 28 DAY STRENGTH OF CONCRETE = 3000 PSI

BUILDING PLANS
Conditionally
APPROVED
DEPARTMENT OF INDUSTRY, LABOR AND HUMAN RELATIONS
Paul L. Buehler
SEE CORRESPONDENCE
'SEP 17 1974
74-C-48

Lawrence J. Mouty

JOB NO 74122	AUG. 24, 1974	SHEET
TOWN of UNDERHILL FIRE STATION UNDERHILL, WISCONSIN		1
OWNER: TOWN of UNDERHILL		OF
ENGR: LAWRENCE J. MOUTY, PESHTIGO, WIS.		5