


PANEL

MIN. (2) 1/2" DIA. ANCHOR BOLTS  
 INSTALLED PER s. SPS 321.18(1)(c)  
 WITH 2" x 2" x 3/16" PLATE WASHER

OVER CONCRETE OR MASONRY BLOCK FOUNDATION


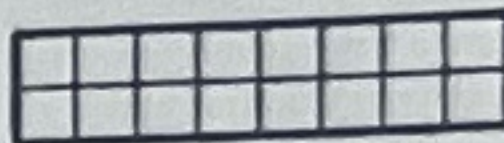
FRONT ELEVATION

NOTE: STEEL HEADERS ARE PERMITTED IF DESIGNED  
NOTE: AS SHOWN IN THE ABOVE CROSS-SECTION, 1/4"  
NOT REQUIRED ON THE INTERIOR SIDE OF THE

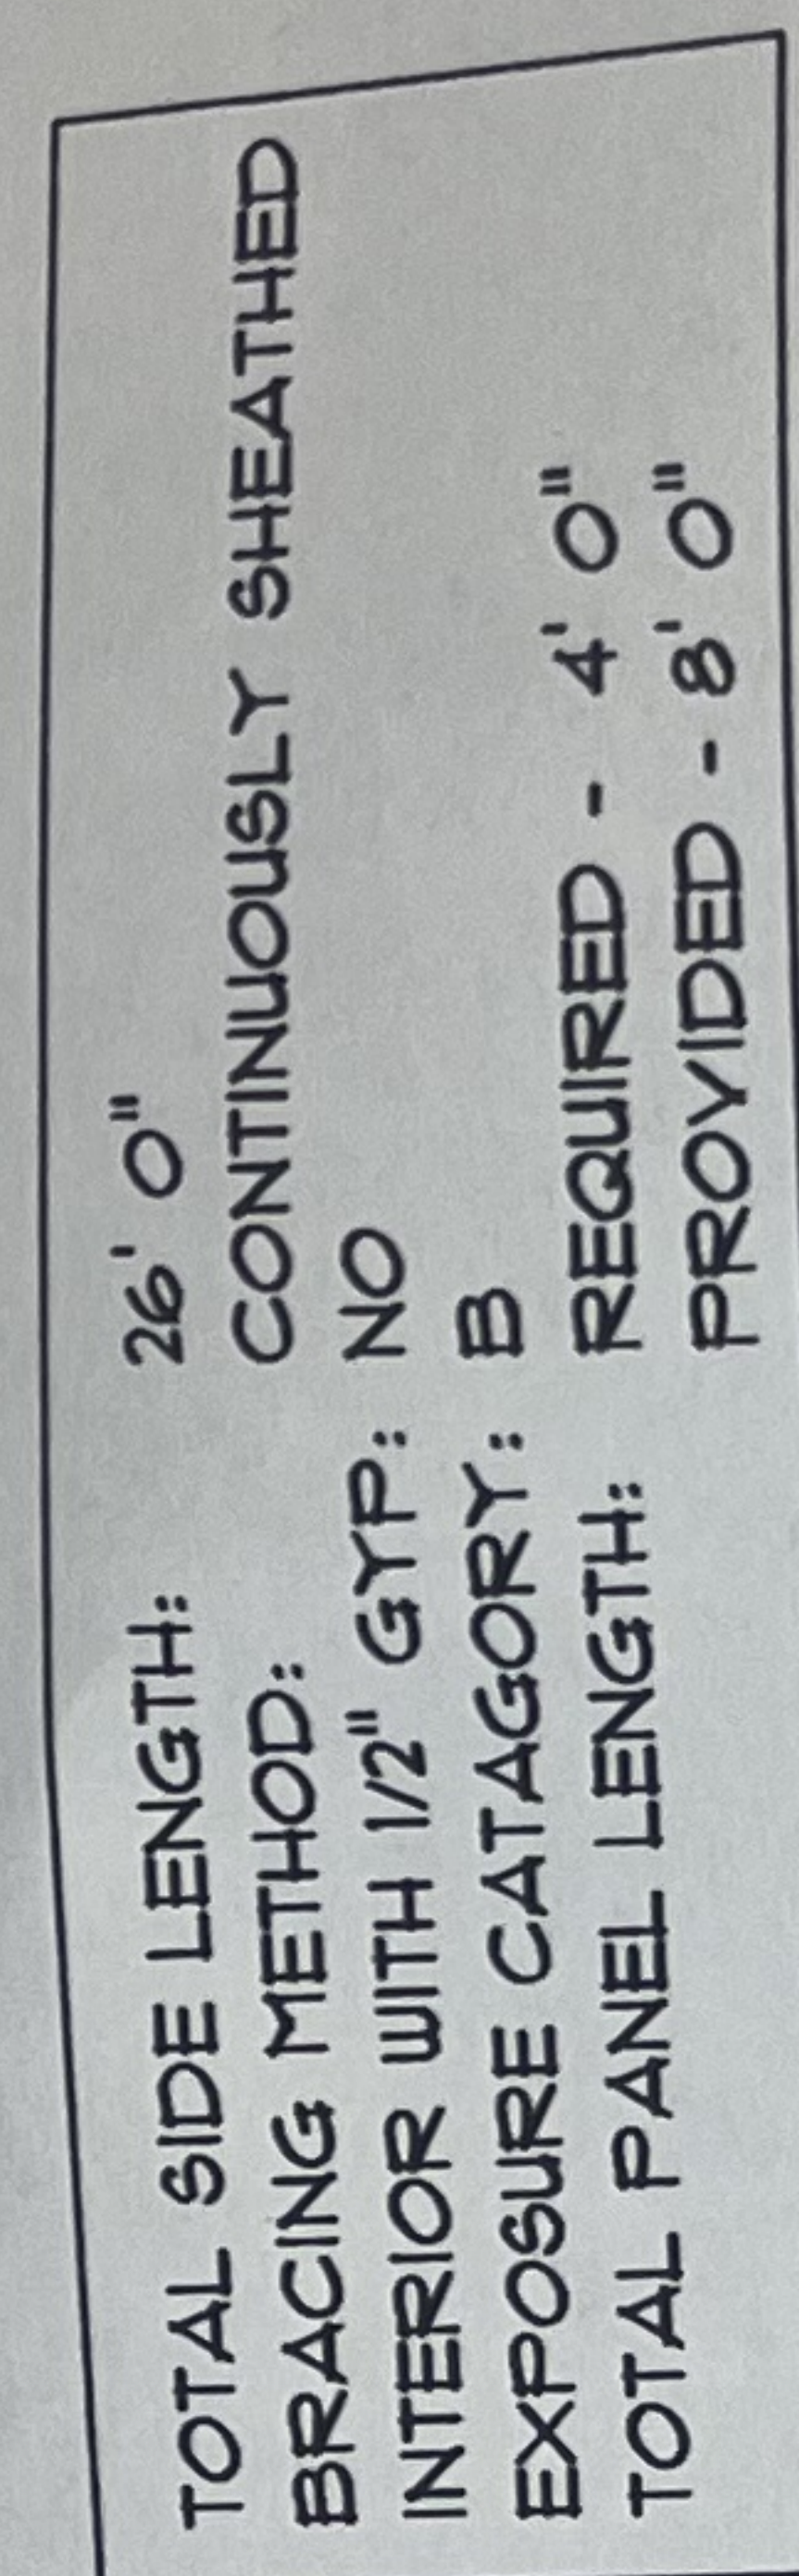

TOTAL SIDE LENGTH: 26' 0"  
BRACING METHOD: CONTINUOUSLY SHEATHED  
INTERIOR WITH 1/2" GYP: NO  
EXPOSURE CATEGORY: B  
TOTAL PANEL LENGTH: REQUIRED - 4' 0"  
PROVIDED - 8' 0"

TOTAL SIDE LENGTH:	25' 0"
BRACING METHOD:	CONTINUOUSLY SHEATHED
INTERIOR WITH 1/2" GYP:	NO
EXPOSURE CATAGORY:	B
TOTAL PANEL LENGTH:	REQUIRED - 4' 0"
	PROVIDED - 4' 0"

WALL BRACING METHODS	
 <p>CS-WSP</p>	<p>CONTINUOUS</p> <p>3/8" SHEATHING            1/16" SHEATHING            FASTEN WITH            OR 1/16"            MAXIMUM PER            NAILS -            STAPLES</p>
 <p>CS-PF</p>	<p>CONTINUOUS</p> <p>REFER TO            OTHER REG.</p>

TAE	
MINIMUM WIDTHS OF	
MAXIMUM OPENING HEIGHT ADJACENT TO BRACED WALL PANEL	
	TAE
5' - 4"	
6' - 8"	
8' - 0"	
9' - 0"	
10' - 0"	
12' - 0"	
a. SHEATHING SHALL EXTEND FROM THE TO AND MAY BE MULTIPLE SHEETS. ALL JOIN b. INTERPOLATION IS PERMITTED.	

## WALL BRACING LAYOUT PLAN

SCALE:  $1/4" = 1' 0"$