

CHAPTER 4

RESIDENTIAL ENERGY EFFICIENCY

SECTION 401 GENERAL

401.1 Scope. This chapter applies to residential buildings.

401.2 Compliance. Projects shall comply with Sections 401, 402.4, 402.5, and 403.1, 403.2.2, 403.2.3, and 403.3 through 403.9 (referred to as the mandatory provisions) and either:

1. Sections 402.1 through 402.3, 403.2.1 and 404.1 (prescriptive); or
2. Section 405 (performance).

401.3 Certificate. A permanent certificate shall be posted on or in the electrical distribution panel. The certificate shall not cover or obstruct the visibility of the circuit directory label, service disconnect label or other required labels. The certificate shall be completed by the builder or registered design professional. The certificate shall list the predominant *R*-values of insulation installed in or on ceiling/roof, walls, foundation (slab, *basement wall*, crawlspace wall and/or floor) and ducts outside conditioned spaces; *U*-factors for fenestration and the solar heat gain coefficient (SHGC) of fenestration. Where there is more than one value for each component, the certificate shall list the value covering the largest area. The certificate shall list the types and efficien-

cies of heating, cooling and service water heating equipment. Where a gas-fired unvented room heater, electric furnace, or baseboard electric heater is installed in the residence, the certificate shall list "gas-fired unvented room heater," "electric furnace" or "baseboard electric heater," as appropriate. An efficiency shall not be *listed* for gas-fired unvented room heaters, electric furnaces or electric baseboard heaters.

SECTION 402 BUILDING THERMAL ENVELOPE

402.1 General (Prescriptive).

402.1.1 Insulation and fenestration criteria. The *building thermal envelope* shall meet the requirements of Table 402.1.1 based on the climate zone specified in Chapter 3.

402.1.2 R-value computation. Insulation material used in layers, such as framing cavity insulation and insulating sheathing, shall be summed to compute the component *R*-value. The manufacturer's settled *R*-value shall be used for blown insulation. Computed *R*-values shall not include an *R*-value for other building materials or air films.

**TABLE 402.1.1
INSULATION AND FENESTRATION REQUIREMENTS BY COMPONENT^a**

CLIMATE ZONE	FENESTRATION U-FACTOR ^p	SKYLIGHT ^b U-FACTOR	GLAZED FENESTRATION SHGC ^{b, q}	CEILING R-VALUE	WOOD FRAME WALL R-VALUE	MASS WALL R-VALUE ⁱ	FLOOR R-VALUE	BASEMENT ^c WALL R-VALUE	SLAB ^d R-VALUE & DEPTH	CRAWL SPACE ^e WALL R-VALUE
1	1.2	0.75	0.30	30	13	3/4	13	0	0	0
2	0.65 ^j	0.75	0.30	30	13	4/6	13	0	0	0
3	0.50 ^j	0.65	0.30	30	13	5/8	19	5/13 ^f	0	5/13
4 except Marine	0.35	0.60	NR	38	13	5/10	19	10/13	10, 2 ft	10/13
5 and Marine 4	0.35	0.60	NR	38	20 or 13+5 ^h	13/17	30 ^g	10/13	10, 2 ft	10/13
6	0.35	0.60	NR	49	20 or 13+5 ^h	15/19	30 ^g	15/19	10, 4 ft	10/13
7 and 8	0.35	0.60	NR	49	21	19/21	38 ^g	15/19	10, 4 ft	10/13

For SI: 1 foot = 304.8 mm.

- a. *R*-values are minimums. *U*-factors and SHGC are maximums. *R*-19 batts compressed into a nominal 2 × 6 framing cavity such that the *R*-value is reduced by *R*-1 or more shall be marked with the compressed batt *R*-value in addition to the full thickness *R*-value.
- b. The fenestration *U*-factor column excludes skylights. The SHGC column applies to all glazed fenestration.
- c. "15/19" means *R*-15 continuous insulated sheathing on the interior or exterior of the home or *R*-19 cavity insulation at the interior of the basement wall. "15/19" shall be permitted to be met with *R*-13 cavity insulation on the interior of the basement wall plus *R*-5 continuous insulated sheathing on the interior or exterior of the home. "10/13" means *R*-10 continuous insulated sheathing on the interior or exterior of the home or *R*-13 cavity insulation at the interior of the basement wall.
- d. *R*-5 shall be added to the required slab edge *R*-values for heated slabs. Insulation depth shall be the depth of the footing or 2 feet, whichever is less in Zones 1 through 3 for heated slabs.
- e. There are no SHGC requirements in the Marine Zone.
- f. Basement wall insulation is not required in warm-humid locations as defined by Figure 301.1 and Table 301.1.
- g. Or insulation sufficient to fill the framing cavity, *R*-19 minimum.
- h. "13+5" means *R*-13 cavity insulation plus *R*-5 insulated sheathing. If structural sheathing covers 25 percent or less of the exterior, insulating sheathing is not required where structural sheathing is used. If structural sheathing covers more than 25 percent of exterior, structural sheathing shall be supplemented with insulated sheathing of at least *R*-2.
- i. The second *R*-value applies when more than half the insulation is on the interior of the mass wall.
- j. For impact rated fenestration complying with Section R301.2.1.2 of the *International Residential Code* or Section 1608.1.2 of the *International Building Code*, the maximum *U*-factor shall be 0.75 in Zone 2 and 0.65 in Zone 3.

2. Site-built windows, doors and skylights.
3. Openings between window and door assemblies and their respective jambs and framing.
4. Utility penetrations.
5. Dropped ceilings or chases adjacent to the thermal envelope.
6. Knee walls.
7. Walls and ceilings separating a garage from conditioned spaces.
8. Behind tubs and showers on exterior walls.
9. Common walls between dwelling units.
10. Attic access openings.
11. Rim joist junction.
12. Other sources of infiltration.

402.4.2 Air sealing and insulation. Building envelope air tightness and insulation installation shall be demonstrated to comply with one of the following options given by Section 402.4.2.1 or 402.4.2.2:

402.4.2.1 Testing option. Building envelope tightness and insulation installation shall be considered acceptable when tested air leakage is less than seven air changes per hour (ACH) when tested with a blower door at a pressure of 50 pascals (1 psf). Testing shall occur after rough in and after installation of penetrations of the building envelope, including penetrations for utilities, plumbing, electrical, ventilation and combustion appliances.

During testing:

1. Exterior windows and doors, fireplace and stove doors shall be closed, but not sealed;
2. Dampers shall be closed, but not sealed, including exhaust, intake, makeup air, backdraft and flue dampers;
3. Interior doors shall be open;
4. Exterior openings for continuous ventilation systems and heat recovery ventilators shall be closed and sealed;
5. Heating and cooling system(s) shall be turned off;
6. HVAC ducts shall not be sealed; and
7. Supply and return registers shall not be sealed.

402.4.2.2 Visual inspection option. Building envelope tightness and insulation installation shall be considered acceptable when the items listed in Table 402.4.2, applicable to the method of construction, are field verified. Where required by the *code official*, an *approved* party independent from the installer of the insulation shall inspect the air barrier and insulation.

402.4.3 Fireplaces. New wood-burning fireplaces shall have gasketed doors and outdoor combustion air.

402.4.4 Fenestration air leakage. Windows, skylights and sliding glass doors shall have an air infiltration rate of no

more than 0.3 cfm per square foot (1.5 L/s/m²), and swinging doors no more than 0.5 cfm per square foot (2.6 L/s/m²), when tested according to NFRC 400 or AAMA/WDMA/CSA 101/I.S.2/A440 by an accredited, independent laboratory and *listed* and *labeled* by the manufacturer.

Exceptions: Site-built windows, skylights and doors.

402.4.5 Recessed lighting. Recessed luminaires installed in the *building thermal envelope* shall be sealed to limit air leakage between conditioned and unconditioned spaces. All recessed luminaires shall be IC-rated and *labeled* as meeting ASTM E 283 when tested at 1.57 psf (75 Pa) pressure differential with no more than 2.0 cfm (0.944 L/s) of air movement from the *conditioned space* to the ceiling cavity. All recessed luminaires shall be sealed with a gasket or caulk between the housing and the interior wall or ceiling covering.

402.5 Maximum fenestration U-factor and SHGC (Mandatory). The area-weighted average maximum fenestration U-factor permitted using trade-offs from Section 402.1.4 or 405 shall be 0.48 in Zones 4 and 5 and 0.40 in Zones 6 through 8 for vertical fenestration, and 0.75 in Zones 4 through 8 for skylights. The area-weighted average maximum fenestration SHGC permitted using trade-offs from Section 405 in Zones 1 through 3 shall be 0.50.

SECTION 403 SYSTEMS

403.1 Controls (Mandatory). At least one thermostat shall be provided for each separate heating and cooling system.

403.1.1 Programmable thermostat. Where the primary heating system is a forced-air furnace, at least one thermostat per dwelling unit shall be capable of controlling the heating and cooling system on a daily schedule to maintain different temperature set points at different times of the day. This thermostat shall include the capability to set back or temporarily operate the system to maintain zone temperatures down to 55°F (13°C) or up to 85°F (29°C). The thermostat shall initially be programmed with a heating temperature set point no higher than 70°F (21°C) and a cooling temperature set point no lower than 78°F (26°C).

403.1.2 Heat pump supplementary heat (Mandatory). Heat pumps having supplementary electric-resistance heat shall have controls that, except during defrost, prevent supplemental heat operation when the heat pump compressor can meet the heating load.

403.2 Ducts.

403.2.1 Insulation (Prescriptive). Supply ducts in attics shall be insulated to a minimum of R-8. All other ducts shall be insulated to a minimum of R-6.

Exception: Ducts or portions thereof located completely inside the *building thermal envelope*.

403.2.2 Sealing (Mandatory). All ducts, air handlers, filter boxes and building cavities used as ducts shall be sealed.

Joints and seams shall comply with Section M1601.4.1 of the *International Residential Code*.

Duct tightness shall be verified by either of the following:

1. Postconstruction test: Leakage to outdoors shall be less than or equal to 8 cfm (226.5 L/min) per 100 ft² (9.29 m²) of *conditioned floor area* or a total leakage less than or equal to 12 cfm (12 L/min) per 100 ft² (9.29 m²) of *conditioned floor area* when tested at a pressure differential of 0.1 inches w.g. (25 Pa) across the entire system, including the manufacturer's air handler enclosure. All register boots shall be taped or otherwise sealed during the test.

2. Rough-in test: Total leakage shall be less than or equal to 6 cfm (169.9 L/min) per 100 ft² (9.29 m²) of *conditioned floor area* when tested at a pressure differential of 0.1 inches w.g. (25 Pa) across the roughed in system, including the manufacturer's air handler enclosure. All register boots shall be taped or otherwise sealed during the test. If the air handler is not installed at the time of the test, total leakage shall be less than or equal to 4 cfm (113.3 L/min) per 100 ft² (9.29 m²) of *conditioned floor area*.

Exceptions: Duct tightness test is not required if the air handler and all ducts are located within *conditioned space*.

TABLE 402.4.2
AIR BARRIER AND INSULATION INSPECTION COMPONENT CRITERIA

COMPONENT	CRITERIA
Air barrier and thermal barrier	Exterior thermal envelope insulation for framed walls is installed in substantial contact and continuous alignment with building envelope air barrier. Breaks or joints in the air barrier are filled or repaired. Air-permeable insulation is not used as a sealing material. Air-permeable insulation is inside of an air barrier.
Ceiling/attic	Air barrier in any dropped ceiling/soffit is substantially aligned with insulation and any gaps are sealed. Attic access (except unvented attic), knee wall door, or drop down stair is sealed.
Walls	Corners and headers are insulated. Junction of foundation and sill plate is sealed.
Windows and doors	Space between window/door jambs and framing is sealed.
Rim joists	Rim joists are insulated and include an air barrier.
Floors (including above-garage and cantilevered floors)	Insulation is installed to maintain permanent contact with underside of subfloor decking. Air barrier is installed at any exposed edge of insulation.
Crawl space walls	Insulation is permanently attached to walls. Exposed earth in unvented crawl spaces is covered with Class I vapor retarder with overlapping joints taped.
Shafts, penetrations	Duct shafts, utility penetrations, knee walls and flue shafts opening to exterior or unconditioned space are sealed.
Narrow cavities	Batts in narrow cavities are cut to fit, or narrow cavities are filled by sprayed/blown insulation.
Garage separation	Air sealing is provided between the garage and conditioned spaces.
Recessed lighting	Recessed light fixtures are air tight, IC rated, and sealed to drywall. Exception—fixtures in conditioned space.
Plumbing and wiring	Insulation is placed between outside and pipes. Batt insulation is cut to fit around wiring and plumbing, or sprayed/blown insulation extends behind piping and wiring.
Shower/tub on exterior wall	Showers and tubs on exterior walls have insulation and an air barrier separating them from the exterior wall.
Electrical/phone box on exterior walls	Air barrier extends behind boxes or air sealed-type boxes are installed.
Common wall	Air barrier is installed in common wall between dwelling units.
HVAC register boots	HVAC register boots that penetrate building envelope are sealed to subfloor or drywall.
Fireplace	Fireplace walls include an air barrier.

TABLE 502.2(1)
BUILDING ENVELOPE REQUIREMENTS - OPAQUE ASSEMBLIES

CLIMATE ZONE	1		2		3		4 EXCEPT MARINE AND MARINE 4		5		6		7		8	
	All other	Group R	All other	Group R	All other	Group R	All other	Group R	All other	Group R	All other	Group R	All other	Group R	All other	Group R
Roofs																
Insulation entirely above deck	R-15ci	R-20ci	R-20ci	R-20ci	R-20ci	R-20ci	R-20ci	R-20ci	R-20ci	R-20ci	R-20ci	R-20ci	R-25ci	R-25ci	R-25ci	R-25ci
Metal buildings (with R-5 thermal blocks ^{a,b})	R-19	R-13 + R-13	R-13 + R-13	R-13 + R-13	R-13 + R-13	R-13 + R-13	R-13 + R-13	R-13 + R-13	R-13 + R-13	R-13 + R-13	R-13 + R-13	R-13 + R-13	R-13 + R-13	R-13 + R-13	R-11 + R-19	R-19 + R-10
Attic and other	R-30	R-38	R-38	R-38	R-38	R-38	R-38	R-38	R-38	R-38	R-38	R-38	R-38	R-38	R-49	R-49
Walls, Above Grade																
Mass	NR	R-5.7ci ^c	R-7.6ci	R-7.6ci	R-9.5ci	R-11.4ci	R-11.4ci	R-11.4ci	R-13.3ci	R-13.3ci	R-13.3ci	R-15.2ci	R-15.2ci	R-15.2ci	R-25ci	R-25ci
Metal building ^b	R-16	R-16	R-16	R-16	R-19	R-19	R-19	R-13 + R-5.6ci	R-13 + R-5.6ci	R-13 + R-5.6ci	R-13 + R-5.6ci	R-13 + R-5.6ci	R-13 + R-5.6ci	R-13 + R-5.6ci	R-19 + R-5.6ci	R-19 + R-5.6ci
Metal framed	R-13	R-13	R-13 + R-3.8ci	R-13 + R-3.8ci	R-13 + R-7.5ci	R-13 + R-7.5ci	R-13 + R-7.5ci	R-13 + R-7.5ci	R-13 + R-7.5ci	R-13 + R-7.5ci	R-13 + R-7.5ci	R-13 + R-7.5ci	R-13 + R-7.5ci	R-13 + R-7.5ci	R-13 + R-7.5ci	R-13 + R-7.5ci
Wood framed and other	R-13	R-13	R-13	R-13	R-13	R-13 + R-3.8ci	R-13 + R-3.8ci	R-13 + R-3.8ci	R-13 + R-7.5ci	R-13 + R-7.5ci	R-13 + R-7.5ci	R-13 + R-7.5ci	R-13 + R-7.5ci	R-13 + R-7.5ci	R-13 + R-7.5ci	R-13 + R-7.5ci
Walls, Below Grade																
Below grade wall ^d	NR	NR	NR	NR	NR	NR	NR	NR	R-7.5ci	R-7.5ci	R-7.5ci	R-7.5ci	R-7.5ci	R-7.5ci	R-7.5ci	R-12.5ci
Floors																
Mass	NR	NR	R-8.3ci	R-8.3ci	R-8.3ci	R-10.4ci	R-10.4ci	R-10.4ci	R-12.5ci	R-12.5ci	R-12.5ci	R-14.6ci	R-14.6ci	R-15ci	R-16.7ci	R-15ci
Joist/Framing (steel/wood)	NR	NR	R-30	R-30	R-30	R-30	R-30	R-30	R-30	R-30	R-30	R-30	R-30	R-30	R-30	R-30 ^e
Slab-on-Grade Floors																
Unheated slabs	NR	NR	NR	NR	NR	NR	NR	NR	R-10 for 24 in. below	R-10 for 24 in. below	R-10 for 24 in. below	R-15 for 24 in. below	R-15 for 24 in. below	R-15 for 24 in. below	R-15 for 24 in. below	R-20 for 24 in. below
Heated slabs	R-7.5 for 12 in. below	R-7.5 for 12 in. below	R-10 for 24 in. below	R-10 for 24 in. below	R-10 for 24 in. below	R-15 for 24 in. below	R-15 for 24 in. below	R-15 for 24 in. below	R-15 for 24 in. below	R-15 for 24 in. below	R-15 for 24 in. below	R-20 for 48 in. below	R-20 for 48 in. below	R-20 for 48 in. below	R-20 for 48 in. below	R-20 for 48 in. below
Opaque doors	U-0.70	U-0.70	U-0.70	U-0.70	U-0.70	U-0.70	U-0.70	U-0.70	U-0.70	U-0.70	U-0.70	U-0.50	U-0.50	U-0.50	U-0.50	U-0.50
Swinging	U-1.45	U-1.45	U-1.45	U-1.45	U-1.45	U-1.45	U-1.45	U-1.45	U-0.50	U-0.50	U-0.50	U-0.50	U-0.50	U-0.50	U-0.50	U-0.50
Roll-up or sliding	U-1.45	U-1.45	U-1.45	U-1.45	U-1.45	U-1.45	U-1.45	U-0.50	U-0.50	U-0.50	U-0.50	U-0.50	U-0.50	U-0.50	U-0.50	U-0.50

For SI: 1 inch = 25.4 mm.

ci = Continuous insulation. NR = No requirement.

a. When using R-value compliance method, a thermal spacer block is required, otherwise use the U-factor compliance method. [see Tables 502.1.2 and 502.2(2)].

b. Assembly descriptions can be found in Table 502.2(2).

c. R-5.7 ci is allowed to be substituted with material having a maximum thermal conductivity of 0.44 Btu-in./hr · ft² · °F. ungrouted cores filled with material having a maximum thermal conductivity of 0.44 Btu-in./hr · ft² · °F.

d. When heated slabs are placed below grade, below-grade walls must meet the exterior insulation requirements for perimeter insulation according to the heated slab-on-grade construction.

e. Steel floor joist systems shall to be R-38.

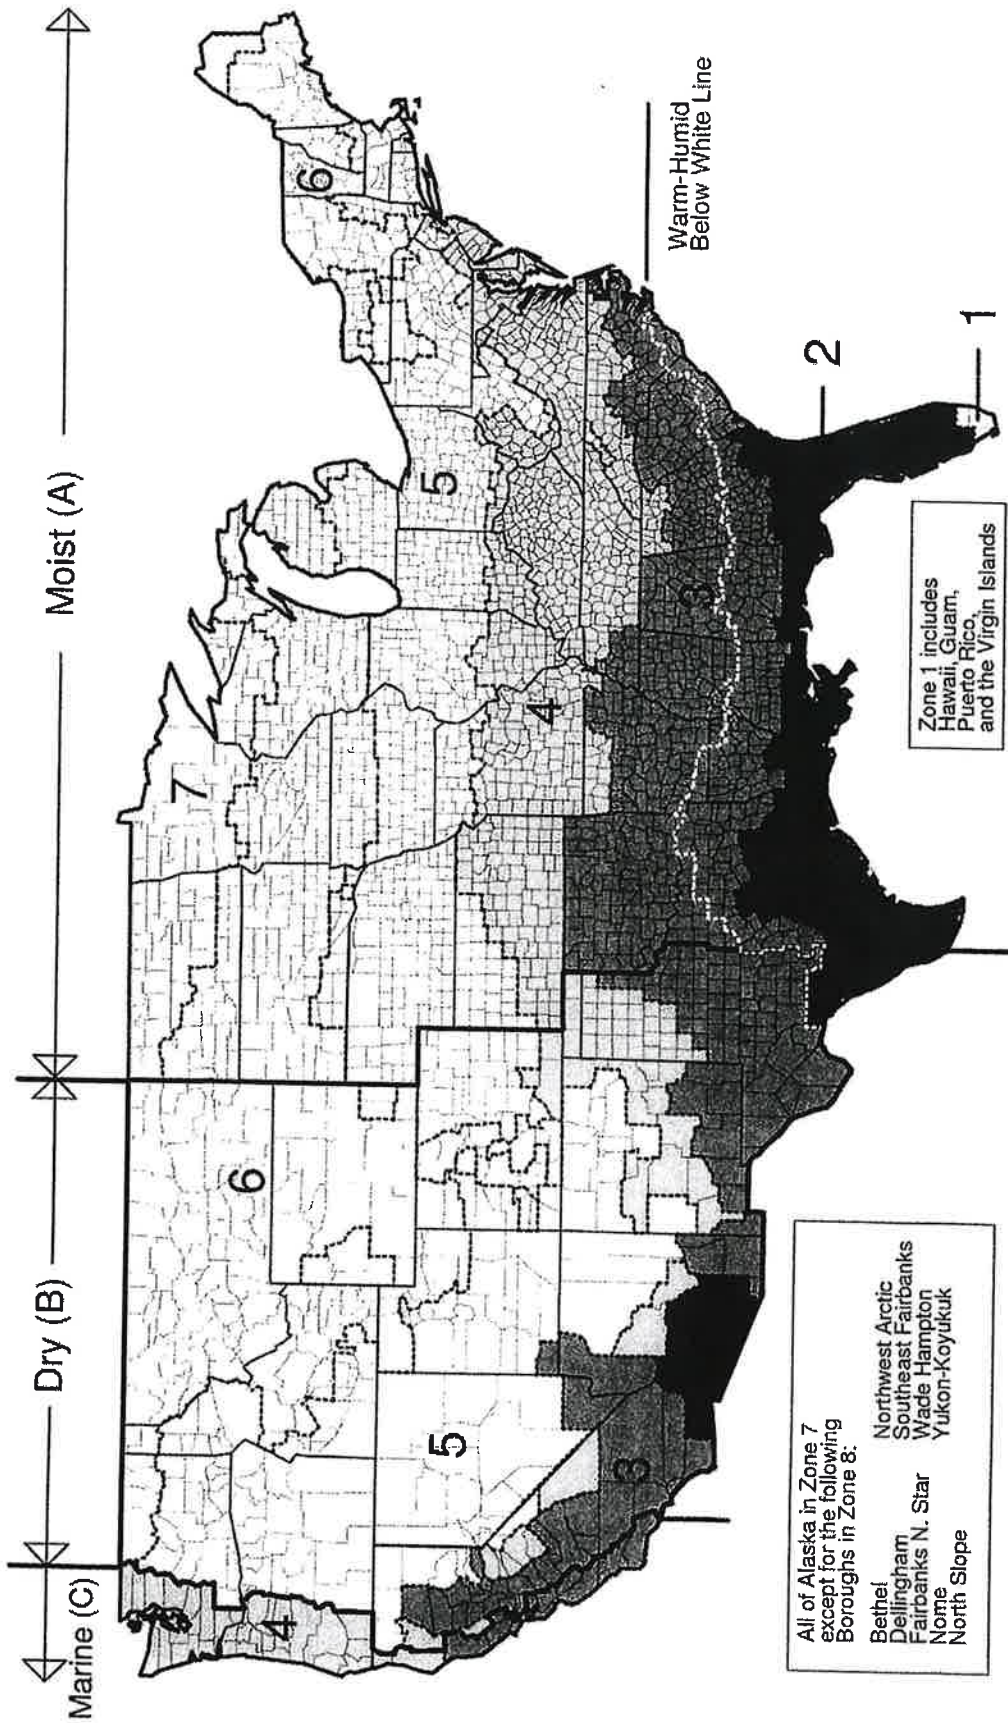


FIGURE 301.1
CLIMATE ZONES