



woodardcurran.com
COMMITMENT & INTEGRITY DRIVE RESULTS

**MONTHLY
STATUS
REPORT
OCTOBER 2024**

**CITY OF
LABELLE, FL**



Prepared for:
**Mayor Julie
Wilkins**

Delivered on
November 5, 2024

TABLE OF CONTENTS

SECTION	PAGE NO.
EXECUTIVE SUMMARY	1-1
1. ADMINISTRATIVE	1-3
1.1 Woodard & Curran Regional Office.....	1-3
1.2 Meetings	1-3
1.3 Vendors	1-3
2. SAFETY	2-5
2.1 Monthly Safety Training	2-5
2.2 Safety Audit Update.....	2-6
3. SEWER USE ORDINANCE, FATS, OIL AND GREASE PROGRAM (FOG)	3-1
3.1 FOG Program Updates for S.....	3-1
4. ENVIRONMENTAL COMPLIANCE	4-1
4.1 Environmental Compliance Activity.....	4-1
4.2 Upcoming Compliance Events	4-2
5. CONSTRUCTION PROJECTS	5-4
5.1 Construction.....	5-4
6. PLANT OPERATIONS	6-1
6.1 Wastewater Treatment.....	6-1
6.2 Chemicals Delivered.....	6-3
6.3 Biosolids	6-3
6.5 Water Treatment.....	6-3
6.6 Chemicals Delivered to the Water Treatment Plant	6-6
7. CORRECTIVE AND PREVENTATIVE WORK ORDERS	7-1
8. FINANCIAL UPDATE	ERROR! BOOKMARK NOT DEFINED.
9. STAFFING	8-1
9.1 Staffing – Corporate Support.....	8-1
9.2 Staffing – Project Support.....	8-2

TABLES

Table 6-1:	WWTP Flows and Loads
Table 6-2:	Biosolids
Table 6-3:	City of LaBelle Water Production and Distribution
Table 8-1:	Project Financials for September
Table 8-2:	Transition Budget Status
Table 9-1:	Corporate Support
Table 9-2:	Project Staff, Title and Certifications

FIGURES

Figure 6-1:	Effluent Flow vs Rainfall in Inches
Figure 6-2:	Effluent Flow vs Influent Flow (MGD)
Figure 6-3:	Effluent Biochemical Oxygen Demand (BOD)
Figure 6-4:	Effluent Total Suspended Solids (TSS)
Figure 6-5:	Deep Injection Well Volume
Figure 6-6:	Finished Water Flow
Figure 6-7:	Finished Water Chlorine Residual
Figure 7-1	Corrective and Preventative Work Order History Report

EXECUTIVE SUMMARY

This Monthly Status Report covers the reporting period from October 1st, 2024, through October 31st, 2024.

October 2024 was another successful month of operations at the City of LaBelle's Water and Wastewater Project. "SAFETY" is always the number one priority at Woodard & Curran and as of October 31st, W&C staff have worked a total of 1157 days without lost time or recordable incident. In October, all the required monthly safety training was completed on time.

Project staff continue to reach out to new Food Service Establishments (FSE's) to ensure enrollment in the new FOG Best Management Practices (BMP) Portal site and compliance with program requirements.

- On October 2nd, the W&C engineering meeting concerns storage tank and or elevated tank and location, drinking water plant and system.
- On October 7th, W&C staff performed weekly generator tests on 4 generators. One at each plant, drinking water and wastewater plant, and one at each well site for drinking water wells #2 & #3. Every Monday these generators are exercised for the Department of Environmental Protection compliance 62-555.320(4)(a) FAC. This October has 4 Mondays which equals 16 generator tests.
- On October 7th, Hurricane Milton preparations, expected land fall October 9th, 2024.
- On October 10th, Hurricane Milton caused a power interruption in the Belmont area affecting the waste plant and a half dozen lift stations. The waste plant, Burger king lift station, and Second Ave lift station were on generators. The remaining lift stations were pumped down by vacuum trucks with aid from Moon Septic and Calusa Septic.
- On October 10th, Synagro facilities are suspended to do logistics from hurricanes Helena and Milton.
- On October 14th, W&C staff submitted the EPA mandated Lead & Copper lead line inventory to the Department of Environmental Protection for rule revisions for (40 CFR 141.84).
- On October 29th, Engineering meeting W&C, City of LaBelle staff, and Hendry County staff capacity issues concerning both utilities.

- October 29th, Quality Enterprises, the construction company on the new county water line for Old Florida RV Park started flushing the water main and intends to keep the main under city pressure. The city installed a 2" construction meter for billing and water losses. As of October 31st, the city has flushed 233,700 gallons through this line.
- On October 31st, the drinking water interconnect was opened with Hendry County. LaBelle sent 249,381 gallons to Hendry County utilities.

1. ADMINISTRATIVE

1.1 Woodard & Curran Regional Office

Woodard & Curran's local office location:
1511 N Westshore Blvd.
Tampa, FL 33607

1.2 Meetings

W&C project staff meet at the Water Plant every morning to discuss and plan the operational events of the day and discuss a daily tailgate safety topic.

- On October 1st, Scada meeting with W&C staff Ron Harris.
- On October 2nd, the W&C engineering meeting regarding concerns about the storage tank and/or elevated tank and location.
- On October 3rd, W&C staff Engineering funding initiative meeting with City staff.
- On October 9th, SCADA meeting with W&C staff Ron Harris. Visit postponed for hurricane Milton.
- On October 14th, W&C staff submitted the EPA mandated Lead & Copper lead line inventory to the Department of Environmental Protection for rule revisions for (40 CFR 141.84).
- On October 24th, commission meeting.
- On October 29th, Engineering meeting W&C, City of LaBelle staff, and Hendry County staff capacity issues concerning both utilities.
-

1.3 Vendors

W&C continues to reach out to potential project vendors to continue the Independent Contractor Agreement (ICA) and Purchase Order (PO) process. As invoices are received from the city, W&C starts the application process to create POs for each vendor. In September, the following vendors were added to a W&C PO and/or (ICA) Independent Contractor Agreement.

- Delta Controls, Walter Bernal, 954-257-3046
4800 NW 26th Ave, Fort Lauderdale FL 33309
- Liquid Engineering Corporation, Misti Moody, 800-438-2187
PO Box 80230 7 East Airport Road, Billings MT 59108-0230
- Momar, Benjamin Fenske, 239-218-9447

1830 Ellsworth Industrial Blvd NW, Atlanta, GA 30318

- American Water Chemical, Beatriz Colacippo 813-846-5448
1802 Corporate Center Lane, Plant City, FL 33563
- PSI Technologies, Jeremy Fisher, 239-645-2698
3520 Investment Lane Unit 33 Riviera Beach FL 33404
- Calusa Environmental, Trina Moore, 863-465-7155
PO Box 1347 LaBelle, FL 33975
- Miller Septic North Environmental Inc. Lydia Billips 386-673-5550
19420 Doris Ln North Fort Myers, FL 33917
- Restoration & Protective Solutions LLC. Peter Giustina II 941-575-1255
12705 Tamiami Trail Punta Gorda, FL 33955
- Advanced Lift station services, Brett 239-292-6406, 1-888-993-5438
1871 Pine Ave Alva FL 33920
- Pittsburg Tank & Tower Group Maintenance Division, Dennis Paquet
dpaquet@pttg.com P: 270-826-9000 Ext: 4604 |F: 270-215-5713 PO Box 1849
Henderson, KY 42419

2. SAFETY

2.1 Monthly Safety Training

Woodard & Curran provides monthly safety training to all employees. Upon being hired, all new LaBelle employees receive an extensive array of health & safety training topics to get them fully up to speed on health and safety requirements. The safety topic for October was “Hand injuries”. Additionally, Woodard & Curran staff members hold regular safety meetings. A brief general safety topic will be discussed as well as any unusual conditions existing at the plants and any additional safety concerns that should be considered given those conditions.



Woodard & Curran has worked 1157 days without lost time or recordable incident as of October 31st, 2024.

All Woodard & Curran personnel assigned to the LaBelle project are participating in the “Safe People are Recognized as the Key to Success” (SPARKS) program. Employees who stay current on their monthly safety training, participate in monthly safety meetings, and who do not incur lost time from a work-related accident, are eligible to receive a SPARKS bonus at the end of the year. This bonus begins at \$200.00 and can reach \$500.00 based upon five successive years of meeting SPARKS goals.

Monthly Safety training completed by W&C staff in October consisted of:

- W&C Health & Safety Daily Orientation (Tailgate).
- On October 14th, W&C staff participated in a spark’s safety meeting on “Insect-stings”.
- W&C staff individually participated in the Pure Safety program in October and the safety stand down in the month of October.

Additional Health & Safety Support Included:

- With the assistance of W&C’s Health & Safety Team, the creation of a Job Safety Analysis (JSA’s) for the LaBelle project was completed and is in the LaBelle team’s folder, for all employees to access.
- In October, there were no “Loss Time” accidents reported at the water or wastewater plant.
- In October, there were no “Loss Time” accidents reported at any of the 24 wastewater lift stations.

2.2 Safety Audit Update

“SAFETY” is always the number one priority at W&C. On October 13th, 2020, and September 11th, 2021, a safety audit was performed at the City of LaBelle’s water utilities which recorded 112 findings that yielded a total of 219 action items to be corrected. W&C’s goal is to correct all action items in a timely manner, except items that require funding from Capital.

As of October 31st, 219 of the 219 items action items have been completed, currently at 100% completion.

3. SEWER USE ORDINANCE, FATS, OIL AND GREASE PROGRAM (FOG)

3.1 FOG Program Updates for October

- In October, project staff worked onsite with waste haulers at different FSE's to ensure that grease traps are being pumped to satisfy Best Management Practices (BMP's) and maintain compliance with the City's FOG ordinance requirements.
- W&C staff continuous to work with numerous Waste Hauler's on manifest interpretation and submittal of forms to the FOG BMP portal site.
- Woodard & Curran staff created an Excel spreadsheet for the city billing office staff and dept. heads to implement/track proper FSE (account) billing.
- As of October 2024, Woodard & Curran Staff worked with 14 FSE's to keep them in compliance.
- As of October 2024, 6 FSE have been referred to City of LaBelle Code enforcement staff for further enforcement actions.

Status of the FOG Ordianance 2023-09	
Total FSE's in City of LaBelle	63
FSE's that have enrolled in FOG BMP Program	57
FSE's in Compliance	51
FSE's Inspected the month of October	12
FSE New Grease Trap Inspection	2
FSE's out of Compliance	6
FSE = (Food Service Establishments)	
FSE out of compliance means = Lack of Cleaning device s ,Not enrolled on FOG/ BMP site/portal,	
No waste hauler agreement/contract, Improper signage are some of the non compliant issues encountered.	
FOG PROGRAM SYNOPSIS	
Woodard & Curran Staff has worked with 19 FSE's to help keep them in compliance, with FOG Ordinance 2023-09.	
After adoption of the FOG Ordianance 2023-09 , Woodard & Curran has worked closely with City of LaBelle staff to impliment the program and identify all FSE locations.	
Woodard & Curran Staff created an all New G.I.S Mapping system highlighting FSE Locations, ultimataly effecting city infrastructure.	
Woodard & Curran Staff has communicated with all FSE's and provided Self Inspection forms for there use, prior to starting staff ordinance driven inspections at the FSE location.	
We are and will Continue to help educate all FSE owners & their staff ,as well as waste haulers on the FOG/ BMP Portal site use/interaction.	

4. ENVIRONMENTAL COMPLIANCE

4.1 Environmental Compliance Activity

Woodard & Curran strives for 100% compliance at both treatment plants. Below is a summary of the compliance activity for the month of October.

- On October 1st, W&C staff submitted the September drinking water monthly operation report to the Department of Environmental portal.
- On October 1st, W&C staff submitted the September Fluoride drinking water monthly operation report to the Health Department Portal in Tallahassee FL.
- On October 1st, W&C staff collected wastewater composite and fecal samples for Sanders Laboratories for the Department of Environmental Protection Permit # FLA014283-007 sent to Sanders Environmental Laboratories for analysis.
- On October 1st, W&C staff collected the 1st set of distribution drinking water bacteriological samples, raw water bacteriological samples for October 2024 for 62-555 FAC, and sent them to Sanders Laboratories for analysis.
- On October 2nd, W&C staff met with Sanders Environmental Laboratories onsite to collect monthly samples on both the upper and lower monitor wells, and the deep injection well samples at the drinking water plant for permit # 98493 329487-004. These are monthly compliance sampling requirements. These samples are coordinated with Sanders Labs on the first Tuesday or Thursday of the first full week of each month.
- On October 7th, W&C staff performed weekly generator tests on both water and wastewater plants including both drinking water wells mandatory for compliance 62-555.320(4)(a) FAC.
- On October 8th, W&C staff collected wastewater composite and fecal samples for Sanders Laboratories for the Department of Environmental Protection Permit # FLA014283-007 sent to Sanders Environmental Laboratories for analysis.
- On October 14th, W&C staff submitted the EPA mandated Lead & Copper lead line inventory to the Department of Environmental Protection for rule revisions for (40 CFR 141.84).
- On October 14th, W&C staff performed weekly generator tests on both water and wastewater plants including both drinking water wells mandatory for compliance 62-555.320(4)(a) FAC.

- On October 15th, W&C staff collected wastewater composite and fecal samples for Sanders Laboratories for the Department of Environmental Protection Permit # FLA014283-007 sent to Sanders Environmental Laboratories for analysis.
- On October 15th, W&C staff collected the 2nd set of distribution drinking water bacteriological samples, and the split-fluoride samples for October 2024 for 62-555 FAC, and sent them to Sanders Laboratories for analysis.
- On October 16th, one of the distribution samples from the 15th was present total coliform. Repeat sample and up and down stream samples were submitted within 24 hours, all samples were absent per the revisited total coliform rule and the Department of Environmental Protection was contacted per 62-555 FAC.
- On October 21st, W&C staff performed weekly generator tests on both water and wastewater plants including both drinking water wells mandatory for compliance 62-555.320(4)(a) FAC.
- On October 22nd, W&C staff collected wastewater composite and fecal samples for Sanders Laboratories for the Department of Environmental Protection Permit # FLA014283-007 sent to Sanders Environmental Laboratories for analysis.
- On October 28th, W&C staff performed weekly generator tests on both water and wastewater plants including both drinking water wells mandatory for compliance 62-555.320(4)(a) FAC.
- On October 29th, W&C staff collected wastewater composite and fecal samples for Sanders Laboratories for the Department of Environmental Protection Permit # FLA014283-007 sent to Sanders Environmental Laboratories for analysis.
- On October 31st, the drinking water interconnect was opened with Hendry County. LaBelle sent 249,381 gallons to Hendry County utilities.

4.2 Upcoming Compliance Events

- November 2nd, 2024, the wastewater plant permit expires. The renewal process has begun and on Sept. 30th, W&C supplied 4 Waters Engineering data required for the permit RAI from FDEP. 4 Waters engineering will commence with the permit renewal process.
- In 2025, the drinking water storage tank is due for inspection.
- City distribution valve exercising program (4 Waters engineering working on this plan).

- W&C staff set up a CEU class for certified operators with the help of the Southeast Rural Community Assistance Project (SERCAP) for November 19th, 2024.

5. CONSTRUCTION PROJECTS

5.1 Construction

- Construction continues at Bel Arbor. The city staff administration has assumed the duties with new construction sewer inspections.
- October 29th, Quality Enterprises, the construction company on the new county water line for Old Florida RV Park started flushing the water main and intends to keep the main under city pressure. The city installed a 2" construction meter for billing and water losses. As of October 31st, the city has flushed 233,700 gallons through this line.

6. PLANT OPERATIONS

6.1 Wastewater Treatment

In October, the WWTP had another successful month of operation. In accordance with the FDEP permit, W&C staff collected various compliance samples throughout the month. Summarized in table 6-1 are the total flows for the influent and effluent as well as key permit constituents. The flows are displayed in Million Gallons per Day (MGD) Table 6-1 below, displays a one year rolling average.

Table 6-1: WTP Flows and Loads

<i>WWTP Flows and Loads</i>							
Month	Influent Flow MGD	Influent BOD mg/L	Influent TSS mg/L	Effluent Flow MGD	Effluent BOD mg/L	Effluent TSS mg/L	Total Biosolids Transferred Dry Ton
Nov 2023	0.498	223	102	0.465	3.50	7.80	*
Dec 2023	0.500	327	150	0.466	1.77	11.25	*
Jan 2024	0.531	382	147	0.493	5.00	12.02	34.73
Feb 2024	0.536	261	178	0.501	6.75	13.38	*
Mar 2024	0.522	340	103	0.501	7.00	17.70	*
Apr 2024	0.489	331	120	0.472	6.60	9.84	*
May 2024	0.463	374	164	0.452	6.50	7.83	*
Jun 2024	0.584	377	119	0.577	6.00	5.63	9.19
Jul 2024	0.641	171	116	0.667	6.20	9.72	*
Aug 2024	0.596	357	145	0.633	5.50	10.83	*
Sep 2024	0.565	254	112	0.629	6.75	6.83	9.66
Oct 2024	0.567	376	126	0.650	4.67	7.97	*
Minimum	0.463	171	102	0.452	1.77	5.63	0.00
Maximum	0.641	382	178	0.667	7.00	17.70	34.73
Total	6.494	3,771	1,581	6.507	66.23	120.77	53.58
Average	0.541	314.42	132	0.542	5.52	10.07	4.47

Asterisk (*) denotes no sludge processed during these months.

Figure 6-1: Effluent Flow vs Rainfall in Inches

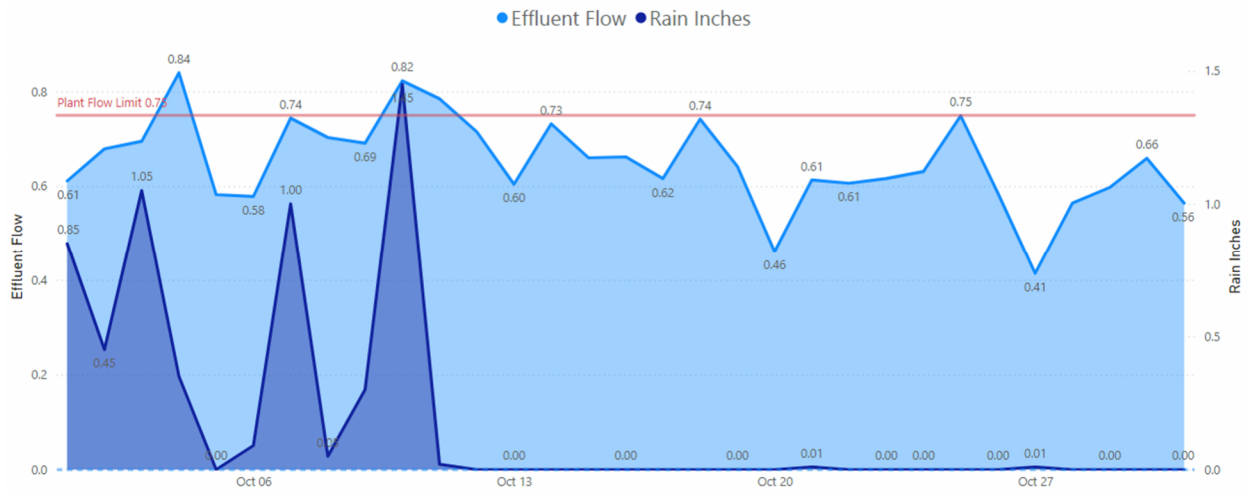


Figure 6-2: Effluent Flow vs Influent Flow (MGD)

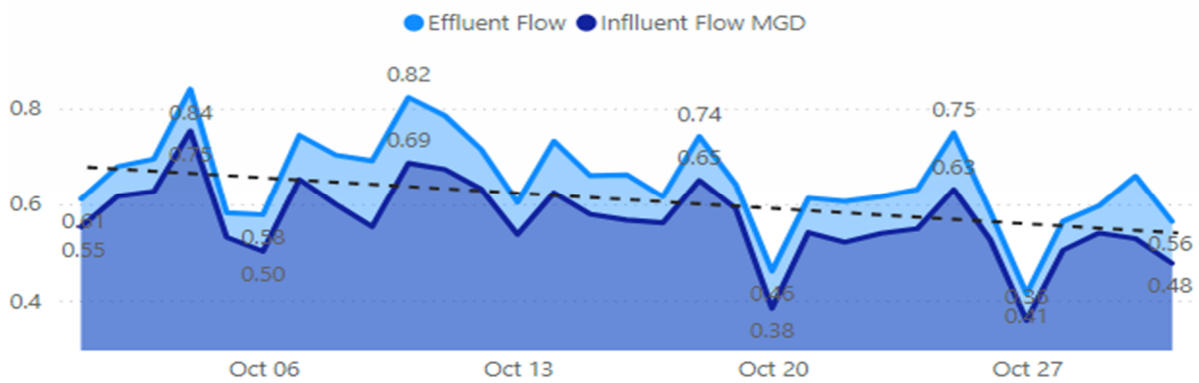


Figure 6-3: Effluent Biochemical Oxygen Demand (BOD)


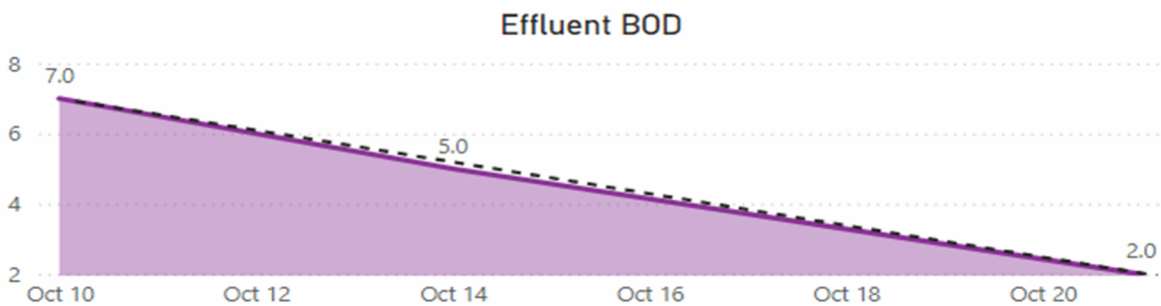


Figure 6-4: Effluent Total Suspended Solids (TSS)

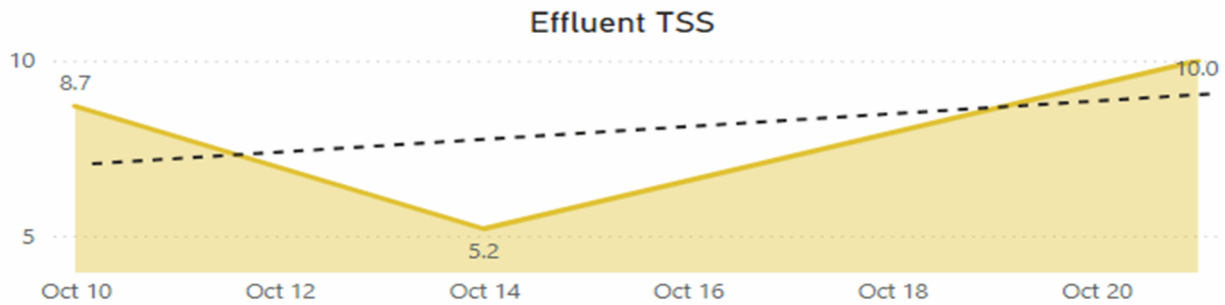

*This graph is awaiting laboratory data from the Laboratory.

6.2 Chemicals Delivered Waste Plant

- On October 15th, Odyssey Manufacturing delivered 1206 gallons of sodium hypochlorite for disinfection.
- On October 25th, Odyssey Manufacturing delivered 907 gallons of sodium hypochlorite for disinfection.

6.3 Biosolids

- In October, no biosolids were processed.

Table 6-2: Biosolids

Wastewater Biosolids			
Month	Liquid Sludge Hauled	Liquid Sludge Hauled	Total Biosolids Transferred
October	Gal	Dry Ton	Dry Ton
	0	0	0


6.4 Water Treatment

Below is a table representing the average MGD of water pumped from the groundwater supply wells and finished treated water leaving the plant. The water loss data derives from the delta between the total treated water leaving the plant and the metered customer usage and is represented in the percentage of water loss. The table represents a 12-month rolling average of the data.

Table 6-3: City of LaBelle Water Production and Distribution

Month	Well 102 Total Flow	Well 103 Total Flow	Total Volume Withdrawn	Finished Water Treated	Total Injection Well Volume	Line 11 Water Loss
	MGD	MGD	MGD	MGD	MG	%
Nov 2023	0.186	0.792	0.953	0.755	0.227	7.01
Dec 2023	0.190	0.705	0.894	0.711	0.208	20.86
Jan 2024	0.231	0.686	0.917	0.724	0.209	22.25
Feb 2024	0.439	0.615	1.033	0.843	0.236	10.50
Mar 2024	0.370	0.647	0.976	0.760	0.211	37.41
Apr 2024	0.434	0.551	0.985	0.789	0.224	21.39
May 2024	0.385	0.732	1.118	0.893	0.223	29.65
Jun 2024	0.625	0.275	0.900	0.738	0.212	11.77
Jul 2024	0.574	0.295	0.870	0.716	0.202	30.46
Aug 2024	0.367	0.597	0.964	0.774	0.223	20.99
Sep 2024	0.462	0.446	0.908	0.738	0.208	98.19
Oct 2024	0.373	0.533	0.906	0.730	0.022	N/A
Minimum	0.186	0.275	0.870	0.711	0.022	7.01
Maximum	0.625	0.792	1.118	0.893	0.236	N/A
Total	4.637	6.874	11.424	9.170	2.405	410.46
Average	0.386	0.573	0.952	0.764	0.200	34.21

Figure 6-5: Deep Injection Well Volume

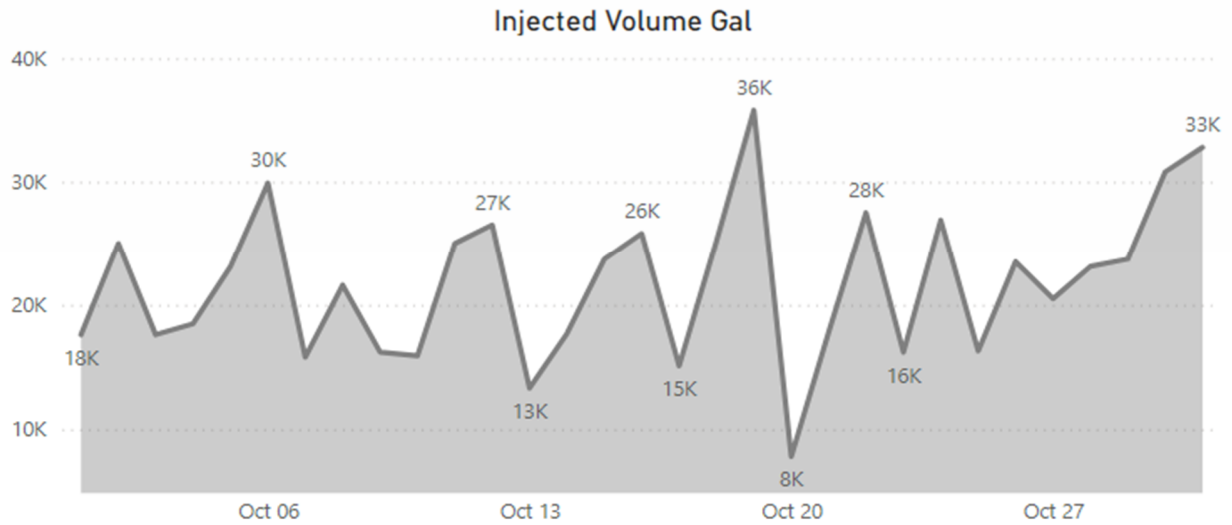

* Instrumentation for the chart above was under maintenance in the month of May preventing data accumulation.

Figure 6-6: Finished Water Flow


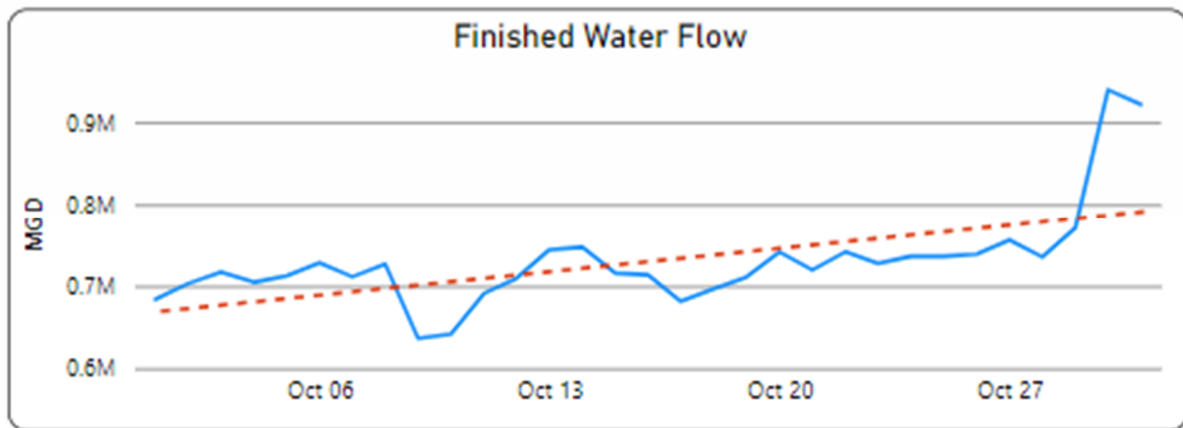


Figure 6-7: Finished Water Chlorine Residual

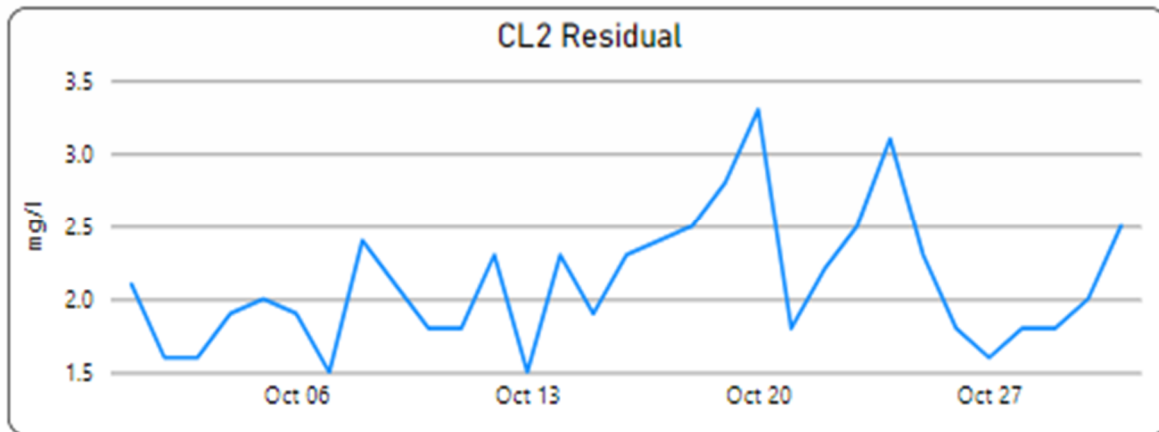


6.5 Chemicals Delivered to the Water Treatment Plant

- On October 17th, Brenntag Chemical delivered 640 gallons of sodium hypochlorite for disinfection to the drinking water plant.
- On October 30th, Brenntag Chemical delivered 180 gallons of ortho phosphate used for corrosion control.
- On October 30th, Brenntag Chemical delivered 360 gallons of Sodium hypochlorite for disinfection.

7. CORRECTIVE AND PREVENTATIVE WORK ORDERS

Figure 7-1 Corrective and Preventative Work Order History Report

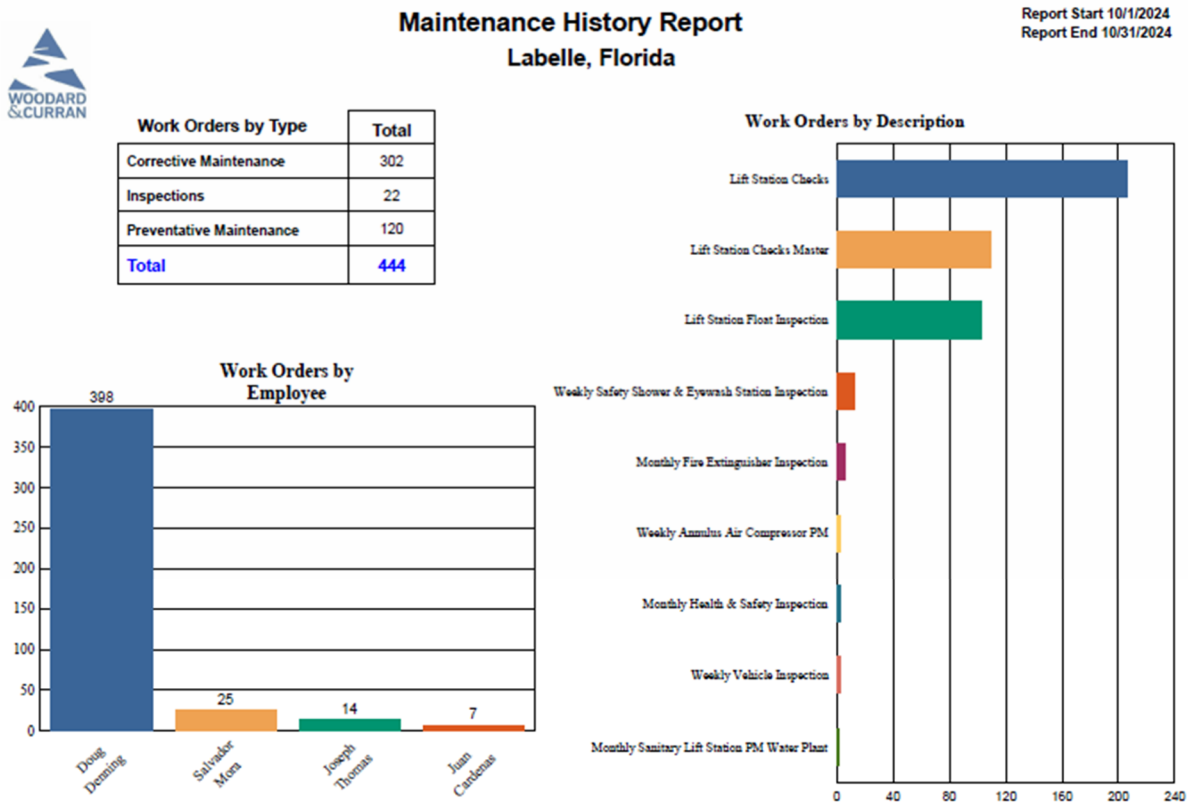

16.1 Corrective Maintenance Work Orders

- On October 8th, W&C staff and K&B pump working on clear well level indicators. Random high-level alarm upon start up is interfering with plant operations.
- On October 9th, W&C staff and K&B pump pull and clean the effluent pumps at the waste plant.
- October 10th, Hurricane Milton update the state of Florida has over 3,000,000 without power this morning. Hendry County has 6,429 without power, according to FPL the Belmont area of LaBelle lost power around 1:15am. The wastewater

plant is on generator power this morning, and one of the effluent pumps has a broken shaft as of last night. Lift stations without power this morning, Bel Arbor, Burger king, 2nd Ave, Barron Park, and City village. Spoke to Zane Mongello at Code enforcement he has been in touch with an FPL representative, and they are working on a main trunk line that feeds the City of LaBelle. The city water plant and wells have FPL power this morning.

- On October 21st, W&C staff started cutting grass at the drinking water plant property.
- On October 22nd, W&C staff Ron Harris on site from information technologies at the drinking water plant working on Scada, multiple communications issues.
- On October 24th, W&C staff Ron Harris working on communication between the flow meters and Scada at the wastewater plant. The PLC in the lab MCC room needs to be replaced. Ron was able to correct some programming issues on the air valve controls (#2 air valve), open and close properly, also allowing the operators to increase the air to the reaction basins.

Table 8-1: Project Financials for October (Year 4)

Budget Category	Month Actual	Month Budget	YTD Actual	YTD Budget	Annual Budget	over(under)	% of budget
Labor (D.L. + FB)	\$53,072	\$56,997	\$53,072	\$56,997	\$683,963	(\$3,925)	8%
Utilities	\$706	\$925	\$706	\$925	\$11,100	(\$219)	6%
Chemicals Costs	\$4,100	\$19,950	\$4,100	\$19,950	\$239,400	(\$15,850)	2%
Maintenance and Repair Costs	\$1,006	\$11,688	\$1,006	\$11,688	\$140,250	(\$10,682)	1%
Sludge Disposal Costs	\$0	\$7,500	\$0	\$7,500	\$90,000	(\$7,500)	0%
Lab Supplies & Equipment	\$0	\$5,750	\$0	\$5,750	\$69,000	(\$5,750)	0%
Office Supplies	\$14	\$283	\$14	\$283	\$3,400	(\$269)	0%
Miscellaneous Expenses	\$7,651	\$5,764	\$7,651	\$5,764	\$69,170	\$1,887	11%
Overhead (G&A of D.L.)	\$14,152	\$15,199	\$14,152	\$15,199	\$182,390	(\$1,047)	8%
Subtotal of Costs for Contract Year 3	\$80,701	\$124,056	\$80,701	\$124,056	\$1,488,673	(\$43,355)	5%
Fixed Fee for Contract Year 3	\$6,456	\$9,924	\$6,456	\$9,924	\$119,094	(\$3,468)	5%
Total	\$87,157	\$133,981	\$87,157	\$133,981	\$1,607,767	(\$46,824)	5%

Table 8-1 highlights the financial status of the O&M Budget for the month of October.

Table 8-2: Transition Budget Status

Total Budget	\$537,032.00
Total Spent as of September 2024	\$437,448
8% Fee	\$34,996
Total	\$472,444
Remaining Balance	\$63,588

Table 8-2 highlights the status of the project transition budget. This budget was created for transitional expenses related to onboarding, implementation of W&C software and programs and the much-needed safety item improvements at the project. The transition budget also funds needed capital items identified at project inception that relate to compliance, operational resiliency, and sustainable delivery of services. Specifically, this work included the purchase, programming, and installation of 6 new Programmable Logic Controllers (PLC's). One at the WWTP and five at the Water Treatment Plant. These items were identified as being key pieces of equipment and due to age, are unsupported by the manufacturer. The old programs were copied from the existing PLC's and have been reprogrammed and installed in the new units.

In June, City staff requested that W&C purchase a used tractor on behalf of the City of LaBelle Public Works Department. The transaction was \$44,753 and has been deducted from the transition budget in July.

In September, the Arc Flash Analysis was completed at the Water Treatment Plant. The remaining balance of the transition fund is \$63,588. **W&C staff will work with city staff to determine how this balance is to be distributed.**

8. STAFFING

8.1 Staffing – Corporate Support

Table 9-1: Corporate Support

Name	Title	Support Provided
Alyson Watson	CEO	Management Support
Brian Bzdawka	Senior Vice President O&M Business Center Manager	Management Support
Marc Thomas	National Operations Leader	Management Support
Paul Roux	East Region Operations Leader	Management Support
Glenn Burden	Area Manager	Management Support
Shannon Eyler	Director of Health & Safety	Health & Safety
Steve Lindeman	Health and Safety Manager	Health & Safety
Renea Shields	Health and Safety Coordinator	Health & Safety
Emily Dunn	SCADA Technician	SCADA and Technical Services
Alan Fabiano	IT Coordinator	SEMS (Computerized Maintenance Management System), HACH WIMS (Laboratory Information Management System), Tablets & Technology
Jeannie Dubois	MIS Support Specialist	Computer and Network set-up and support
Celina Bland	O&M Specialist	Hach WIMs, Utility Cloud and Power BI programming and support
Kim Brierley	Project Administrator	Accounting
Jackie Smith	Senior Project Assistant	Project Support Specialist
Sarah Coen	Human Resources – Benefits Administrator	Employee Benefits
Linsay McAuliffe	Human Resources Generalist	Human Resources
Beth Sweitzer	Senior Talent Management & Acquisition Manager	Human Resources
Lizzie Dovich	Technical Recruiter	Human Resources
Wendy Foreman	Health & Safety Administrator	Health & Safety Support
Sam Stanley	O&M Specialist	O&M Project Support
Justin DeMello	Project Manager II	Engineering Support
Tami Ray	Funding Specialist	Engineering Support

8.2 Staffing – Project Support

Table 9-2: Project Staff, Title and Certifications

Name	Title	Certification
Troy Kepley	Project Manager	<ul style="list-style-type: none"> • FDEP A Wastewater • FDEP C Waster • TREEO/AWWA Backflow Tester/Repairer Certification • OSHA 40 Hour HAZWOPER
Joseph Thomas	Assistant Project Manager	<ul style="list-style-type: none"> • FDEP B Water • FDEP C Wastewater • SEDA RO Specialist
Salvador Mora	Operator I	<ul style="list-style-type: none"> • FDEP C Water • TREEO/AWWA Backflow Tester/Repair Certification
Doug Denning	Operator I	<ul style="list-style-type: none"> • FDEP C Wastewater
Adam Barde	Mechanic/IPP-FOG Coordinator	<ul style="list-style-type: none"> • FIPA C FOG • FIPA C IPP
Juan Cardenas	Operator II	<ul style="list-style-type: none"> • FDEP C Water • FDEP C Wastewater