


VALLA MDAS RESIDENCE

LOS GATOS — CALIFORNIA



GORDON K WONG, ARCHITECT LIC# 34048
710 E MCGILVERY LANE SUITE 109
CAMPBELL, CA 95008 (408) 315-2125
GORDONKWONG@GKWARCHECT.COM
REYN@GKWARCHECT.COM

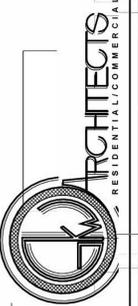

RESIDENCE
14331 Capri Drive
LOS GATOS, CA 95032

| # | REV DATE | DESCRIPTION |
|---|------------|-------------|
| △ | 2024.11.29 | PLANNING |
| △ | 2024.06.06 | PLANNING |
| △ | 2024.09.11 | PLANNING |
| △ | 2025.01.08 | PLANNING |
| △ | 2025.04.30 | PLANNING |

Project Info & Site Plan, Proposed

G000

SCALE 1" = 10'-0"

5/14/2025 4:26:15 PM

SCOPE OF WORK

ZONE CHANGE APPLICATION:
-ZONE CHANGE REQUEST FROM O TO R-1.8 (TO BE APPROVED WITH ARCHITECTURAL & SITE REVIEW)

MINOR RESIDENTIAL APPLICATION - RESIDENTIAL REMODEL & ADDITION
-DEMOLISH NO MORE THAN 50% OF EXISTING ONE-STORY SINGLE FAMILY RESIDENCE
-PROPOSED ADDITION TWO-STORY SINGLE FAMILY RESIDENCE

ARCHITECTURAL & SITE REVIEW:
-DEMOLITION OF EXISTING ONE-STORY SINGLE FAMILY RESIDENCE
-DEMOLITION OF EXISTING DETACHED GARAGE & ADU
-PROPOSED NEW CONSTRUCTION (RESIDENTIAL BUILDING - TWO-STORY SINGLE FAMILY RESIDENCE)

PROJECT INFORMATION

OWNER: 14331 CAPRI DRIVE, LOS GATOS, CA 95032

ARCHITECT: GKW ARCHITECTS, INC.
GORDON K WONG, AIA, LEED GA, CSLB
710 E MCGILVERY LANE SUITE 109
CAMPBELL, CA 95008 (408) 315-2125
GORDONKWONG@GKWARCHECT.COM

PROJECT LOCATION: 14331 CAPRI DRIVE, LOS GATOS, CA 95032

APN: 408-32-004

ZONING: O ZONE CONVERTED TO R-1.8 ZONE

(E) LOT AREA: 13,092 SF / 0.3 ACRES

EXISTING LAND USE: SINGLE FAMILY RESIDENTIAL

OCCUPANCY: R-3

CONSTRUCTION TYPE: TYP-VB

MAX. HEIGHT: 30 FT

MAX. STORIES: 2

(E) STORIES: 1 STORY

(P) STORIES: 2 STORIES

(E) SETBACKS PER ZONE O:

| | | | |
|-----------------|-------|-----------------|-------|
| FRONT: | 25 FT | FRONT: | 25 FT |
| SIDE, INTERIOR: | 10 FT | SIDE, INTERIOR: | 8 FT |
| SIDE, ABUTTING: | 15 FT | SIDE, ABUTTING: | 15 FT |
| REAR: | 20 FT | REAR: | 20 FT |

(P) SETBACKS PER ZONE R-1.8:

| | | | |
|-----------------|-------|-----------------|-------|
| FRONT: | 25 FT | FRONT: | 25 FT |
| SIDE, INTERIOR: | 10 FT | SIDE, INTERIOR: | 8 FT |
| SIDE, ABUTTING: | 15 FT | SIDE, ABUTTING: | 15 FT |
| REAR: | 20 FT | REAR: | 20 FT |

FLOOR AREA BREAKDOWN:

(E) FIRST FLOOR AREA (PRIMARY): 1,128 SF

(E) DETACHED ADU: ~1150 SF (TO BE REMAINED)

(E) SHED + (E) PARTIAL ENCLOSURE: ~123 SF + 242 SF (TO BE DEMO)

(E) TOTAL FLOOR AREA: 2,401 SF

(P) FIRST FLOOR AREA (PRIMARY): 1,637 SF

(P) SECOND FLOOR AREA (PRIMARY): 1,874 SF

(P) ATTACHED GARAGE: 498 SF

(P) TOTAL FLOOR AREA: 3,511 SF (PRIMARY) + 1150 SF (ADU) = 4,661 SF

MAX. FAR ALLOWED (ADU): 1,200 SF

MAX. FAR ALLOWED (MAIN RESIDENCE): +/- 3,797 SF (28.6%)

(E) FAR: 8%

(P) FAR: 26.8% [OK]

MAX. GARAGE ALLOWED: +/- 1,008 SF

(P) GARAGE: 498 SF [OK]

LOT COVERAGE:

MAX LOT COVERAGE: 40% (13,092 SF X .40 = 5,237 SF)

PROPOSED LOT COVERAGE: 2,944.78 SF / 13,092 SF = 22.5% [OK]

AVG. SLOPE OF THE PROPERTY: 1.53%

FIRE SPRINKLERS: PROVIDED

APPLICABLE CODES

- 2022 CALIFORNIA BUILDING CODE
- 2022 CALIFORNIA RESIDENTIAL CODE
- 2022 CALIFORNIA MECHANICAL CODE
- 2022 CALIFORNIA PLUMBING CODE
- 2022 CALIFORNIA ELECTRICAL CODE
- 2022 CALIFORNIA ENERGY CODE
- 2022 CALIFORNIA FIRE CODE
- 2022 CALIFORNIA GREEN BUILDING STANDARDS CODE
- CITY OF LOS GATOS MUNICIPAL CODE
- ALL OTHER STATE AND LOCAL LAWS, ORDINANCES AND REGULATIONS

BUILDING INFORMATION MODEL

VICINITY MAP

SHEET INDEX

| Sheet Number | Sheet Name |
|----------------------|---|
| General | |
| G000 | Project Info & Site Plan, Proposed |
| G001 | Abbreviations, Notes, & Site Plan, Existing |
| G002.1 | General, Green Building Check List |
| G002.2 | General, Green Building Check List |
| G003 | Existing Conditions & Proposed Analysis |
| G004 | Neighborhood & Adjacent Building Analysis |
| G005 | Streetscape & Shadow Study |
| G006 | Site Analysis & Details |
| G007 | Tree Protection Plan |
| G008 | Landscape Plan, Proposed |
| Survey | |
| T1 | Topo & Boundary Survey |
| Civil | |
| C1 | Grading & Drainage Plan |
| C1.1 | Cross Section |
| C2 | Utility Plan |
| C3 | Erosion Control Plan |
| C4 | Detail Sheet |
| C4.1 | Detail Sheet |
| C5 | Construction BMPs |
| Architectural | |
| A100 | Floor & Roof Plans, Existing |
| A100.1 | Floor Plan, Existing, Detached ADU |
| A101 | Floor Plan, Level 1, Proposed |
| A102 | Floor Plan, Level 2, Proposed |
| A103 | Roof Plan, Proposed |
| A200 | Elevations, Existing & Proposed |
| A300 | Sections, Proposed |

TOWN OF LOS GATOS - GENERAL NOTES & REQUIREMENTS

- A SEPARATE BUILDING PERMIT IS REQUIRED FOR THE PV SYSTEM THAT IS REQUIRED FOR THE PV SYSTEM THAT IS REQUIRED BY THE CALIFORNIA ENERGY CODE PERFORMANCE OR PRESCRIPTIVE STANDARDS. THE SEPARATE PV SYSTEM PERMIT MUST BE FINALIZED PRIOR TO ISSUANCE OF CERTIFICATE OF OCCUPANCY.
- THIS RESIDENCE WILL COMPLY WITH THE TOWN'S ALL ELECTRIC APPLIANCE, ELECTRIC VEHICLE AND ENERGY STORAGE SYSTEM REQUIREMENTS IN ACCORDANCE WITH TOWN CODE.
- 5' X 5' LEVEL LANDING, NO MORE THAN 1 INCH OUT OF PLANE WITH THE IMMEDIATE INTERIOR FLOOR LEVEL PER TOWN RESIDENTIAL ACCESSIBILITY STANDARDS.

SITE PLAN, PROPOSED, KEYNOTES

- STUCCO FENCE WALL W/ RAILING, 42" MAX. HEIGHT
- WALKWAY, CONCRETE
- DRIVEWAY, PORTLAND CEMENT CONCRETE
- WOOD FENCE MIN. 72" HEIGHT
- ELECTRICAL PANEL, 200 AMPS
- WATER METER

SITE PLAN NOTES:

- ### INDICATES TREE SPECIES ID # PER ARBORIST REPORT. PLEASE REFER TO TREE PROTECTION PLAN ON SHEET G007 FOR MORE INFORMATION.
- CONTRACTOR TO VERIFY ALL DIMENSIONS AND DESIGN.

SITE PLAN LEGEND


- PROPERTY LINE
- CENTER LINE OF ROAD/ RIGHT-OF-WAY
- BUILDING FOOTPRINT
- SETBACK
- OH (E) OVERHEAD UTILITY
- (P) SEWER LATERAL
- (P) WATER SERVICE LINE
- (P) JOINT UTILITY TRENCH
- (P) GAS METER
- (P) WATER METER
- (P) ELECTRICAL PANEL, 200 AMPS
- (P) AIR CONDENSER, EXTERIOR UNIT

1 Site Plan, Proposed
1" = 10'-0"

Project Info & Site Plan, Proposed

| ABBREVIATIONS | | GENERAL NOTES | |
|---------------|---------------------------|---------------|--------------------------------------|
| A | ABOVE | N | NEW |
| ABV | ASPHALT CONCRETE | (N) | NORTH |
| AC | AREA DRAIN | NIC | NOT IN CONTRACT |
| ADDL | ADDITIONAL | NOM | NOMINAL |
| AFF | ABOVE FINISH FLOOR | NP | NO PARKING |
| ASPH | ASPHALT | NR | NON-RATED |
| | | NTS | NOT TO SCALE |
| B | BITUMINOUS | O | OVERALL |
| BKG | BACKING | OA | ON CENTER |
| BLDG | BUILDING | OC | OUTSIDE DIAMETER/DIMENSION |
| BM | BEAM | OD | OWNER FURNISHED CONTRACTOR INSTALLED |
| BR | BACKER ROD | OFCI | OWNER FURNISHED CONTRACTOR INSTALLED |
| BUR | BU LT-UP-ROOF | | |
| BDR | BEDROOM | OFOI | |
| BW | BOTTOM OF WALL | | |
| C | CABINET | P | PROPOSED |
| CAB | CATCH BASIN | (P) | PENETRATED |
| CB | CEMENT | PERF | PERPENDICULAR |
| CEM | CUBIC FEET | PERP | PLATE |
| CF | CONTROL JOINT | PL | PROPERTY LINE |
| CJ | CLOSET | PL | PLASTER |
| CTL | CENTERLINE | PLAS | PLUMBING |
| CLG | CEILING | PLBG | PLYWOOD |
| CONC | CONCRETE | PLWD | PANEL |
| CPT | CARPET | PNL | POINT OF CONNECTION |
| | | POC | PERMEABLE PAVERS |
| D | DECK | PP | PREFABRICATED |
| D | DECK | PRFAB | POUNDS PER SQUARE FOOT |
| DR | DRAIN | PSF | POUNDS PER SQUARE INCH |
| | | PSI | PANTEED |
| | | PTD | PRESSURE TREATED |
| | | PTR | PRESSURE TREATED WOOD |
| E | EXISTING | PTRWQ | |
| (E) | EXISTING | | |
| E | EAST | Q | QUANTITY |
| ELEC | ELECTRICAL | QTY | |
| EP | ELECTRICAL PANEL | | |
| EXT | EXTERIOR | | |
| F | FOUNDATION | R | REVEAL OR RISER |
| FDN | FIRE HYDRANT | R | RADIUS |
| FH | FINISH | RAD | REINFORCED CONCRETE PIPE |
| FIN | FINISH FLOOR | RCP | ROOF DRAIN |
| FF | FLOW LINE | RD | REFERENCE |
| FL | FLUORESCENT | REF | REFLECTED |
| FLUOR | FACE OF CONCRETE | REFL | REFRIGERATOR |
| FOC | FACE OF FINISH | REFR | RETAINING OR RETARDANT |
| FOF | FACE OF STUD | RET | REGISTER |
| FOS | FIRE RATED | REG | ROUGH OPENING |
| FR | FLOOR SINK | SEG | SEE CIVIL DRAWINGS |
| FS | FIRE SPRINKLER | SCD | SCHEDULE |
| FSL | FOOTING | SCHD | STORM DRAIN |
| gTG | GALVANIZED | SD | SECTION |
| GALV | GENERAL CONTRACTOR | SECT | SEE ELECTRICAL DRAWINGS |
| GC | GLASS | SED | SQUARE FOOT OR FEET |
| GL | GROUND | SFR | SHOWER |
| GND | GYPSON WALL BOARD | SHT | SHEET |
| GWB | GYSUM | SHTG | SHEATHING |
| GYP | | S M | SIMILAR |
| | | SJ | SEISMIC JOINT |
| H | HARDBOARD | SL | SEALANT |
| HDBD | HEADER | SLD | SEE LANDSCAPE DRAWINGS |
| HDR | HARDWARE | SM | SHEET METAL |
| HDWR | HARDWOOD | SMD | SEE MECHANICAL DRAWINGS |
| HDWD | HEATER | SOF | SOFFIT |
| HTR | HEATING, VENT. & A.C. | SOG | SLAB ON GRADE |
| HVAC | | SPD | SEE PLUMBING DRAWINGS |
| | | SPEC | SPECIFICATION |
| | | SQ | SQUARE |
| I | INSULATION | SS | SANITARY SEWER |
| IN | INTERIOR | SSD | SEE STRUCTURAL DRAWINGS |
| INCAND | INTERIOR | STC | SOUND TRANSMISSION COEFFICIENT |
| INSUL | INVERT | STD | STANDARD |
| INT | | STL | STEEL |
| INV | | STOR | STORAGE |
| | | STR | STRUCTURAL |
| | | SY | SQUARE YARD |
| J | JOIST | T | TOP AND BOTTOM |
| JST | JOINT | T&B | TONGUE AND GROOVE |
| JT | | TC | TOP OF CURB |
| K | KITCHEN | TOC | TOP OF CONCRETE |
| K | KICK PLATE | TOP | TOP OF PAVING |
| KIT | | TOS | TOP OF STEEL |
| KP | | TRD | TREAD |
| | | TW | TOP OF WALL |
| L | LOCATION | U | UNDERWRITERS LABORATORIES |
| LOC | LIGHT | UL | UT LITES |
| LT | | UT L | |
| M | MACH NE BOLT | V | VITREOUS CLAY PIPE |
| MB | MEDIUM DENSITY FIBERBOARD | VCP | VERTICAL |
| MDF | MECHANICAL | VTR | VENT THROUGH ROOF |
| MECH | MEMBRANE | W | WEST OR WIDTH |
| MEMB | METAL | WC | WATER CLOSET |
| MET | MANHOLE | WD | WOOD |
| MH | MISCELLANEOUS | WDW | WINDOW |
| MSC | MOUNTED | W/O | WITHOUT |
| MTD | METAL | WP | WATER PROOF |
| MTL | | WPT | WORKING POINT |
| | | WR | WATER RESISTANT |

| GENERAL NOTES | | | |
|-------------------------------|--|--|--------------------------|
| 1. | IT IS THE RESPONSIBILITY OF THE CONTRACTOR AND SUBCONTRACTORS TO CHECK AND VERIFY ALL DIMENSIONS AND CONDITIONS INDICATED ON THESE DRAWINGS AND MAKE KNOWN ANY DISCREPANCIES PRIOR TO COMMENCING THE WORK. | | |
| 2. | ALL WORK SHALL BE PERFORMED IN ACCORDANCE WITH ALL APPLICABLE REGULATIONS INCLUDING BUT NOT LIMITED TO NATIONAL, CITY, STATE, LOCAL CODES AND ORDINANCES WHICH MAY BE IN EFFECT. ALL MATERIALS, INSTALLATION PROCEDURES AND PLANS SHALL BE APPROVED BY ALL APPLICABLE CODE ENFORCEMENT AUTHORITIES HAVING JURISDICTION, AND IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO OBTAIN AND PAY FOR ALL NECESSARY PERMITS AND APPROVALS FOR THE WORK. | | |
| 3. | THESE DRAWINGS ARE INTENDED FOR USE IN A NEGOTIATED CONSTRUCTION CONTRACT AND THEREFORE, MAY NOT SPECIFICALLY DETAIL OR SPECIFY MATERIAL AND/OR MANUFACTURERS. THE CONTRACTOR SHALL PROVIDE ALL SAMPLES AND OR CUTS AS REQUIRED TO ASSIST OWNER OR HIS AGENT IN MAKING MATERIAL SELECTIONS. FOR THE PURPOSE OF ESTIMATING, THE CONTRACTORS SHALL USE THE MATERIALS SELECTED BY THE OWNER, OR IN ABSENCE OF SAME, SHALL PROVIDE AN ALLOWANCE AMOUNT AND SO CONDITION ANY COST ESTIMATE. ALL MATERIALS SPECIFIED IN THESE DRAWINGS SHALL BE INCLUDED IN SUCH ESTIMATE. | | |
| 4. | NO GUARANTEE OF QUALITY OF CONSTRUCTION IS IMPLIED OR INTENDED BY THE ARCHITECTURAL DOCUMENTS, AND THE CONTRACTOR SHALL ASSUME FULL RESPONSIBILITY FOR ANY OR ALL CONSTRUCTION DEFICIENCIES. | | |
| 5. | THE GENERAL CONTRACTOR SHALL HOLD HARMLESS, INDEMNIFY AND DEFEND THE ARCHITECT FROM ANY ACTION INITIATED BY THE OWNER OR ANY SUBSEQUENT OWNERS FOR CONSTRUCTION DEFICIENCIES, MODIFICATIONS OR SUCH CONDITIONS WHICH MAY BE BEYOND THE CONTROL OF THE ARCHITECT. | | |
| 6. | ALL WORK SHALL COMPLY WITH AND RECORD THE CONDITIONS OF ALL EXISTING SITE IMPROVEMENTS INCLUDING PAVED AREAS. THE GENERAL CONTRACTOR SHALL MAKE KNOWN ALL EXISTING DAMAGED OR DISREPAIR ITEMS AND CONDITIONS THAT MAY WORSEN DUE TO THE CONSTRUCTION. ALL ITEMS IN GOOD CONDITION SHALL BE MAINTAINED IN THEIR PRESENT CONDITION AND ANY REPAIR OR DAMAGE WHICH OCCURS DURING CONSTRUCTION SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR. | | |
| 7. | CONTRACTOR SHALL THOROUGHLY EXAMINE THE SITE AND SATISFY HIM OR HERSELF AS OF THE CONDITIONS UNDER WHICH THE WORK IS TO BE PERFORMED. THE CONTRACTOR SHALL VERIFY AT THE SITE ALL MEASUREMENTS AFFECTING HIS OR HER WORK AND SHALL BE RESPONSIBLE FOR THE CORRECTNESS OF SAME. NO EXTRA COMPENSATION WILL BE ALLOWED TO THE CONTRACTOR FOR THE EXPENSES DUE TO HIS OR HER NEGLIGENCE TO EXAMINE OR FAILURE TO DISCOVER CONDITIONS WHICH MAY AFFECT HIS OR HER WORK. | | |
| 8. | ALL WORK SHALL BE COORDINATED WITH THE STRUCTURAL, MECHANICAL, ELECTRICAL, PLUMBING, ARCHITECTURAL, FIRE PROTECTION AND LIGHTING DRAWINGS APPLYING TO THIS PROJECT PRIOR TO SUBMITTING SHOP DRAWINGS FOR FABRICATION APPROVAL. | | |
| 9. | IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO COORDINATE WITH ALL INVOLVED PARTIES AND PREPARE SHOP DRAWINGS. | | |
| 10. | ALL NEW INTERIOR PAINT COLOR, FLOOR, WALLS AND CEILING FINISHES SHALL BE SELECTED BY OWNER AT THE TIME WHEN IT IS NECESSARY FOR THE COMPLETION OF THE PROJECT. | | |
| 11. | THE CONTRACTOR SHALL PERFORM ALL CUTTING AND PATCHING REQUIRED TO COMPLETE THE WORK OR TO MAKE ITS PARTS FIT TOGETHER PROPERLY WITHOUT COMPROMISING THE QUALITY OF THE WORK. | | |
| 12. | THE CONTRACTOR SHALL BE RESPONSIBLE FOR ADEQUATE BRACING, SHORING, AND PROTECTING ALL WORK DURING CONSTRUCTION, AGAINST DAMAGE, BREAKAGE, COLLAPSE, DISTORTIONS, AND OFF ALIGNMENTS ACCORDING TO CODES AND STANDARDS OF GOOD PRACTICE. | | |
| 13. | ALL PUBLIC IMPROVEMENTS SHALL BE MADE IN ACCORDANCE WITH THE LATEST ADOPTED CITY STANDARDS. THE STORING OF GOOD AND MATERIALS ON SIDEWALK AND/OR STREET SHALL NOT BE ALLOWED UNLESS THE CONTRACTOR HAS APPLIED AND SECURED A SPECIAL PERMIT WHICH ALLOW SUCH STORAGE TO BE PLACED. | | |
| 14. | OWNERSHIP OF DRAWINGS: THESE DRAWINGS ARE THE PROPERTY OF GWK ARCHITECTS - GORDON WONG, ARCHITECT, THE DRAWINGS SHALL NOT BE USED FOR ANY OTHER PURPOSE EXCEPT AS APPROVED BY THE ARCHITECT. | | |
| 15. | LIMITATION OF THE WORK: THE LIMITS OF THE WORK ARE ESTABLISHED BY THE DRAWINGS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR COORDINATING TRADESMEN WITH THESE LIMITS. | | |
| 16. | ANY EXISTING TO REMAIN SHALL BE IN GOOD CONDITION PRIOR TO THE PLANNING FINAL INSPECTION. | | |
| 17. | NEW LANDSCAPING SHALL COMPLY WITH STATE WATER EFFICIENCY STANDARDS. | | |
| SITE PLAN & PUBLIC WORK NOTES | | | |
| 1. | CONTRACTOR IS RESPONSIBLE FOR DUST CONTROL AND INSURING AREA ADJACENT TO WORK IS LEFT IN A CLEAN CONDITION. | | |
| 2. | UTILIZE BEST MANAGEMENT PRACTICES (BMP'S), AS REQUIRED BY THE STATE WATER RESOURCES BOARD, FOR ANY ACTIVITY, WHICH DISTURBS SOIL. | | |
| 3. | CONTRACTOR IS RESPONSIBLE FOR ALL TEST, INSPECTIONS AND PROCEDURAL REQUIREMENTS PER CITY OF SAN JOSE. | | |
| 4. | OPERABLE SMOKE DETECTORS MUST BE IN PLACE PRIOR TO RE-OCCUPY DWELLINGS PER CITY OF LOS GATOS CODES. | | |
| 5. | PLUMBING & ELECTRICAL SURVEY REQUIRED FOR METER RELEASE. | | |
| 6. | ADDITIONS, ALTERATIONS OR REPAIRS SHALL CONFORM TO ANY BUILDING OR STRUCTURE WITHOUT REQUIRING THE EXISTING BUILDING OR STRUCTURE TO COMPLY WITH ALL THE REQUIREMENTS OF THE UBC, PROVIDED THE ADDITION ALTERATION OR REPAIR CONFORMS TO THAT REQUIRED FOR NEW BUILDING OR STRUCTURE PER UBC SECTION 3403.2. | | |
| 7. | CONTRACTOR TO VERIFY SIZE & LOCATION OF ALL UTILITY CONNECTIONS. CONTRACTOR TO PROVIDE ALL NEW UTILITY CONNECTIONS AND/OR UPGRADE EXISTING AS REQUIRED. CONTRACTOR SHALL OBTAIN ALL NECESSARY PERMITS AND APPROVALS AS REQUIRED BY GOVERNING AGENCIES. | | |
| 8. | CONTRACTOR SHALL OBTAIN ALL NECESSARY DEMOLITION PERMITS AND APPROVALS INCLUDING ASBESTOS ABATEMENT AS PART OF THE BASE BID. | | |
| 9. | PER CGSBC 301.1.1 - RESIDENTIAL BUILDINGS UNDERGOING PERMITTED ALTERATIONS, ADDITIONS OR IMPROVEMENTS SHALL REPLACE NONCOMPLIANT PLUMBING FIXTURES WITH WATER-CONSERVING PLUMBING FIXTURES. PLUMBING FIXTURES REPLACEMENT IS REQUIRED PRIOR TO ISSUANCE OF A CERTIFICATE OF FINAL COMPLETION, CERTIFICATE OF OCCUPANCY OR FINAL PERMIT APPROVAL BY THE LOCAL BUILDING DEPARTMENT. | | |
| 10. | PER CGSBC 301.1.1 - WHERE ADDITION OR ALTERATION INCREASED THE BUILDING'S CONDITIONED AREA, VOLUME, OR SIZE, THE REQUIREMENTS OF CALGREEN CHAPTER 4 SHALL APPLY ONLY TO AND WITHIN THE SPECIFIC AREA OF THE ADDITION OR ALTERATION. | | |
| GRAPHIC SYMBOLS | | | |
| | CONCRETE PAD | | BUILDING SECTION |
| | DETAIL REFERENCE | | APPROXIMATE LINE OF WORK |
| | INTERIOR ELEVATION | | WINDOW TYPE |
| | WALL TYPE | | REVISION |
| | KEY NOTE | | DATUM REFERENCE |
| | DOOR TYPE | | REMOVE |
| | ROOM TAG | | ROOM TAG |

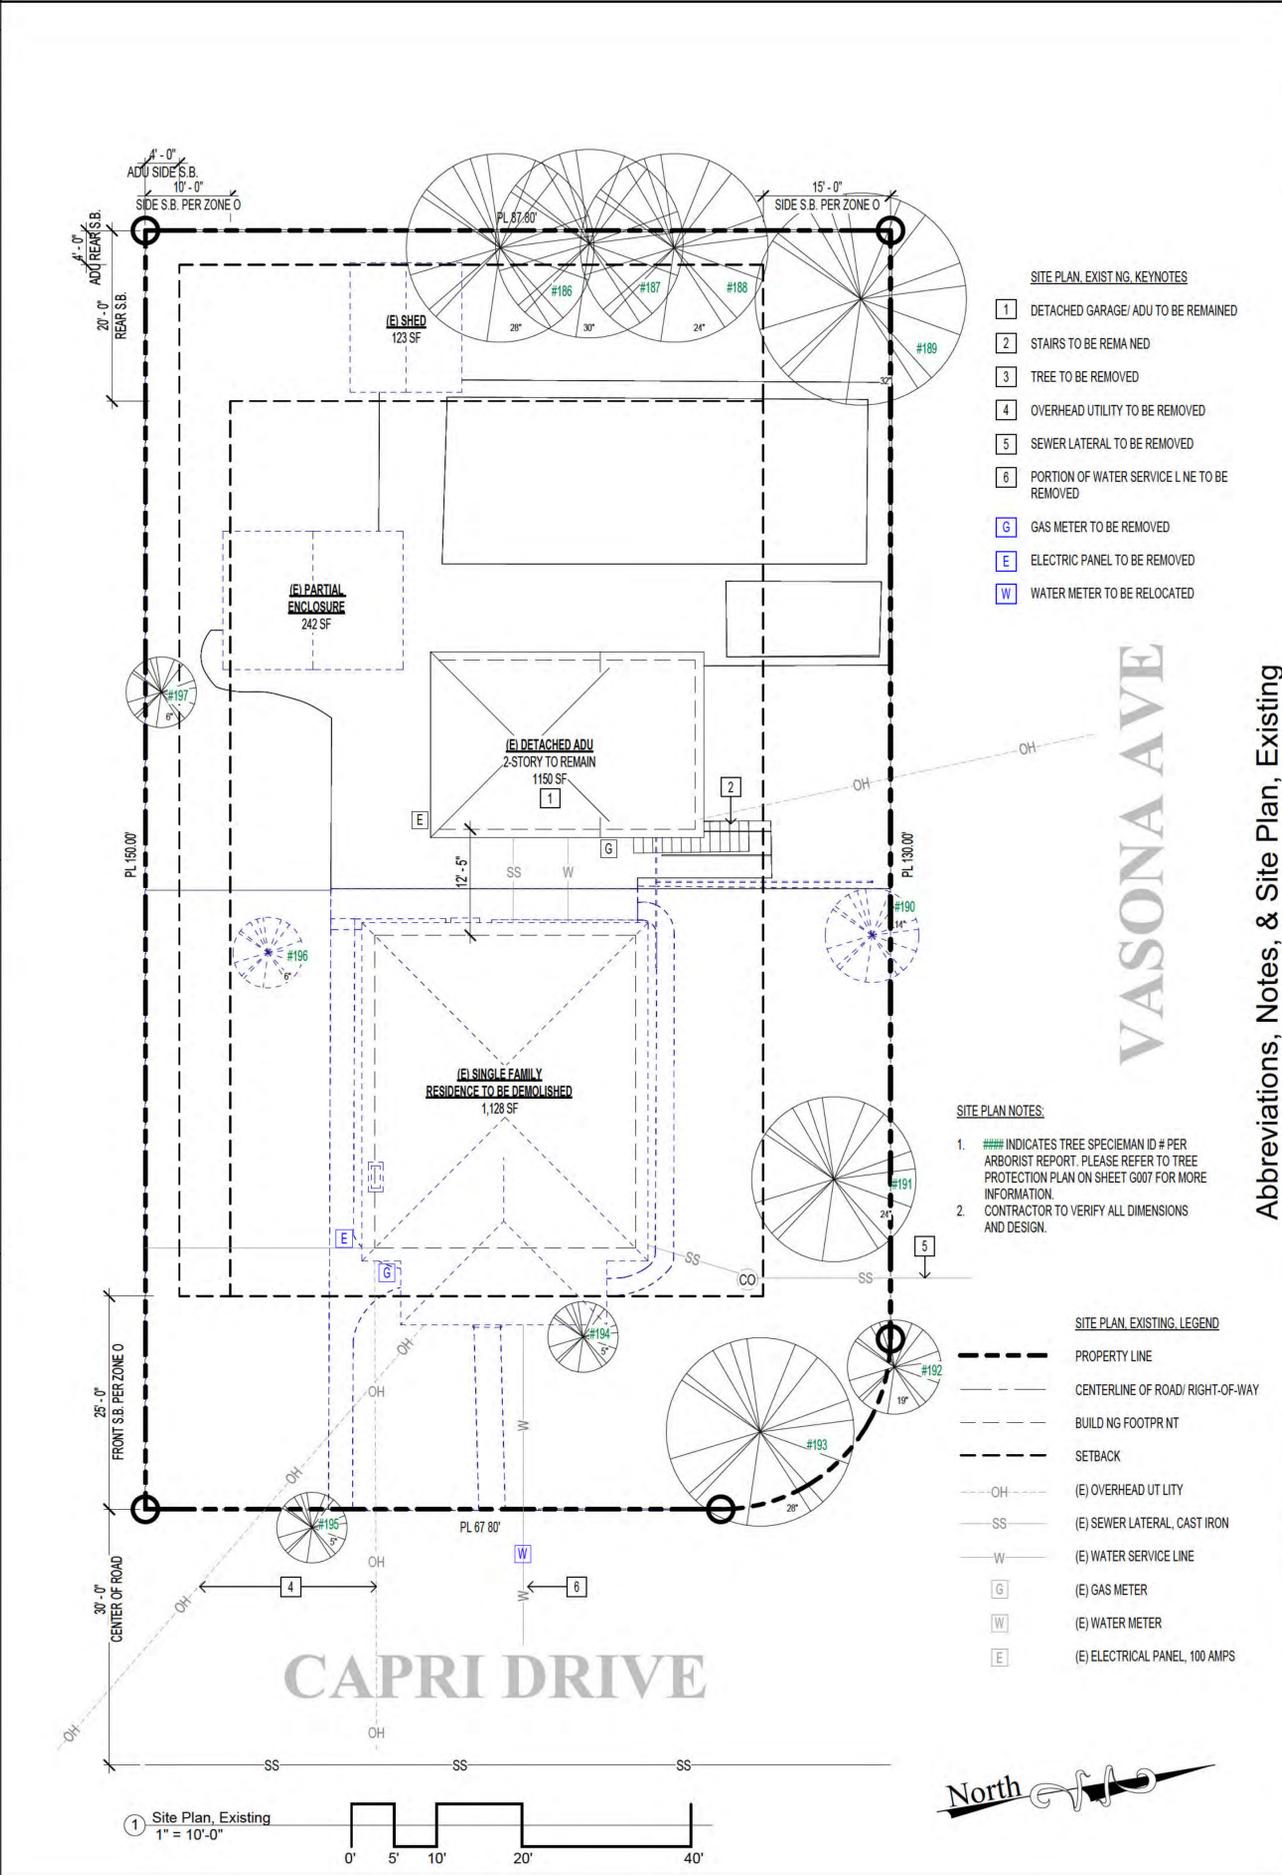

GORDON K WONG, ARCHITECT
 KEVIN YU PROJECT REP
 710E MCCLUNCY LANE SUITE 108
 CAMPBELL, CA 95008 (408) 315-2125
 GORDONKWONG@GKWAARCHITECTS.COM KEVINYU@GKWAARCHITECTS.COM

RESIDENCE
 14331 Capri Drive
 LOS GATOS, CA 95032

| Project Schedule Revision | |
|---------------------------|----------------------|
| # | REV DATE DESCRIPTION |
| △ | 2024.11.29 PLANNING |
| △ | 2024.06.06 PLANNING |
| △ | 2024.09.11 PLANNING |
| △ | 2025.01.08 PLANNING |
| △ | 2025.04.30 PLANNING |

Abbreviations, Notes, & Site Plan, Existing

G001

SCALE As indicated

5/14/2025 4:17:02 PM

2022 CALIFORNIA GREEN BUILDING STANDARDS CODE

RESIDENTIAL MANDATORY MEASURES, SHEET 2 (January 2023)



GORDON K WONG, ARCHITECT LIC# 34045
 7106 MCCLINTOCK LANE SUITE 109
 CAMPBELL, CA 95008 (408) 796-1846
 GORDONKONG@GKARCHITECTS.COM KENNY@GKARCHITECTS.COM



RESIDENCE
 14331 Capri Drive
 LOS GATOS, CA 95032

| # | REV DATE | DESCRIPTION |
|---|------------|-------------|
| △ | 2024.11.29 | PLANNING |
| △ | 2024.06.06 | PLANNING |
| △ | 2024.09.11 | PLANNING |
| △ | 2025.01.08 | PLANNING |
| △ | 2025.04.30 | PLANNING |

General, Green Building Check List

G002.2

SCALE

5/14/2025 4:17:14 PM

MAXIMUM INCREMENTAL REACTIVITY (MIR). The maximum change in weight of ozone formed by adding a compound to the "Base Reactive Organic Gas (ROG) Mixture" per weight of compound added, expressed to hundredths of a gram (g O₃/g ROG).

MOISTURE CONTENT. The weight of the water in wood expressed in percentage of the weight of the oven-dry wood.

PRODUCT-WEIGHTED MIR (PWMIR). The sum of all weighted-MIR for all ingredients in a product subject to this article. The PWMIR is the total product reactivity expressed to hundredths of a gram of ozone formed per gram of product (excluding container and packaging).

REACTIVE ORGANIC COMPOUND (ROC). Any compound that has the potential, once emitted, to contribute to ozone formation in the troposphere.

VOC. A volatile organic compound (VOC) broadly defined as a chemical compound based on carbon chains or rings with vapor pressures greater than 0.1 millimeters of mercury at room temperature. These compounds typically contain hydrogen and may contain oxygen, nitrogen and other elements. See CCR Title 17, Section 94508(a).

4.503 FIREPLACES

4.503.1 GENERAL. Any installed gas fireplace shall be a direct-vent sealed-combustion type. Any installed woodstove or pellet stove shall comply with U.S. EPA New Source Performance Standards (NSPS) emission limits as applicable, and shall have a permanent label indicating they are certified to meet the emission limits. Woodstoves, pellet stoves and fireplaces shall also comply with applicable local ordinances.

4.504 POLLUTANT CONTROL

4.504.1 COVERING OF DUCT OPENINGS & PROTECTION OF MECHANICAL EQUIPMENT DURING CONSTRUCTION. At the time of rough installation, during storage on the construction site and until final startup of the heating, cooling and ventilating equipment, all duct and other related air distribution component openings shall be covered with tape, plastic, sheet metal or other methods acceptable to the enforcing agency to reduce the amount of water, dust or debris which may enter the system.

4.504.2 FINISH MATERIAL POLLUTANT CONTROL. Finish materials shall comply with this section.

4.504.2.1 Adhesives, Sealants and Caulks. Adhesives, sealant and caulks used on the project shall meet the requirements of the following standards unless more stringent local or regional air pollution or air quality management district rules apply:

- Adhesives, adhesive bonding primers, adhesive primers, sealants, sealant primers and caulks shall comply with local or regional air pollution control or air quality management district rules where applicable or SCAQMD Rule 116B VOC limits, as shown in Table 4.504.1 or 4.504.2, as applicable. Such products also shall comply with the Rule 116B prohibition on the use of certain toxic compounds (chloroform, ethylene dichloride, methylene chloride, perchloroethylene and trichloroethylene), except for aerosol products, as specified in Subsection 2 below.
- Aerosol adhesives, and smaller unit sizes of adhesives, and sealant or caulking compounds (in units of product, less packaging, which do not weigh more than 1 pound and do not consist of more than 16 fluid ounces) shall comply with statewide VOC standards and other requirements, including prohibitions on use of certain toxic compounds, of California Code of Regulations, Title 17, commencing with section 94507.

4.504.2.2 Paints and Coatings. Architectural paints and coatings shall comply with VOC limits in Table 1 of the ARB Architectural Suggested Control Measure, as shown in Table 4.504.3, unless more stringent local limits apply. The VOC content limit for coatings that do not meet the definitions for the specialty coatings categories listed in Table 4.504.3 shall be determined by classifying the coating as a Flat, Nonflat or Nonflat-High Gloss coating, based on its gloss, as defined in subsections 4.21, 4.26, and 4.37 of the 2007 California Air Resources Board, Suggested Control Measure, and the corresponding Flat, Nonflat or Nonflat-High Gloss VOC limit in Table 4.504.3 shall apply.

4.504.2.3 Aerosol Paints and Coatings. Aerosol paints and coatings shall meet the Product-weighted MIR Limits for ROC in Section 94522(a)(2) and other requirements, including prohibitions on use of certain toxic compounds and ozone depleting substances, in Sections 94522(a)(1) and (f)(1) of California Code of Regulations, Title 17, commencing with Section 94520; and in areas under the jurisdiction of the Bay Area Air Quality Management District additionally comply with the percent VOC by weight of product limits of Regulation 6, Rule 49.

4.504.2.4 Verification. Verification of compliance with this section shall be provided at the request of the enforcing agency. Documentation may include, but is not limited to, the following:

- Manufacturer's product specification.
- Field verification of on-site product containers.

TABLE 4.504.2 - SEALANT VOC LIMIT
 (Less Water and Less Exempt Compounds in Grams per Liter)

| SEALANTS | VOC LIMIT |
|--------------------------|-----------|
| ARCHITECTURAL | 250 |
| MARINE DECK | 760 |
| NONMEMBRANE ROOF | 300 |
| ROADWAY | 250 |
| SINGLE-PLY ROOF MEMBRANE | 450 |
| OTHER | 420 |

SEALANT PRIMERS

| | |
|---------------------|-----|
| ARCHITECTURAL | 250 |
| NON-POROUS | 250 |
| POROUS | 775 |
| MODIFIED BITUMINOUS | 500 |
| MARINE DECK | 760 |
| OTHER | 750 |

TABLE 4.504.3 - VOC CONTENT LIMITS FOR ARCHITECTURAL COATINGS₂

GRAMS OF VOC PER LITER OF COATING, LESS WATER & LESS EXEMPT COMPOUNDS

| COATING CATEGORY | VOC LIMIT |
|---|-----------|
| FLAT COATINGS | 50 |
| NON-FLAT COATINGS | 100 |
| NONFLAT-HIGH GLOSS COATINGS | 150 |
| SPECIALTY COATINGS | |
| ALUMINUM ROOF COATINGS | 400 |
| BASEMENT SPECIALTY COATINGS | 400 |
| BITUMINOUS ROOF COATINGS | 50 |
| BITUMINOUS ROOF PRIMERS | 350 |
| BOND BREAKERS | 350 |
| CONCRETE CURING COMPOUNDS | 350 |
| CONCRETE/MASONRY SEALERS | 100 |
| DRIVEWAY SEALERS | 50 |
| DRY FOG COATINGS | 150 |
| FAUX FINISHING COATINGS | 350 |
| FIRE RESISTIVE COATINGS | 350 |
| FLOOR COATINGS | 100 |
| FORM-RELEASE COMPOUNDS | 250 |
| GRAPHIC ARTS COATINGS (SIGN PAINTS) | 500 |
| HIGH TEMPERATURE COATINGS | 420 |
| INDUSTRIAL MAINTENANCE COATINGS | 250 |
| LOW SOLIDS COATINGS | 120 |
| MAGNESITE CEMENT COATINGS | 450 |
| MASTIC TEXTURE COATINGS | 100 |
| METALLIC PIGMENTED COATINGS | 500 |
| MULTICOLOR COATINGS | 250 |
| PRETREATMENT WASH PRIMERS | 420 |
| PRIMERS, SEALERS, & UNDERCOATERS | 100 |
| REACTIVE PENETRATING SEALERS | 350 |
| RECYCLED COATINGS | 250 |
| ROOF COATINGS | 50 |
| RUST PREVENTATIVE COATINGS | 250 |
| SHELLACS | CLEAR |
| OPAQUE | 550 |
| SPECIALTY PRIMERS, SEALERS & UNDERCOATERS | 100 |
| STAINS | 250 |
| STONE CONSOLIDANTS | 450 |
| SWIMMING POOL COATINGS | 340 |
| TRAFFIC MARKING COATINGS | 100 |
| TUB & TILE REFINISH COATINGS | 420 |
| WATERPROOFING MEMBRANES | 250 |
| WOOD COATINGS | 275 |
| WOOD PRESERVATIVES | 350 |
| ZINC-RICH PRIMERS | 340 |

TABLE 4.504.1 - ADHESIVE VOC LIMIT₂
 (Less Water and Less Exempt Compounds in Grams per Liter)

| ARCHITECTURAL APPLICATIONS | VOC LIMIT |
|--|-----------|
| INDOOR CARPET ADHESIVES | 50 |
| CARPET PAD ADHESIVES | 50 |
| OUTDOOR CARPET ADHESIVES | 150 |
| WOOD FLOORING ADHESIVES | 100 |
| RUBBER FLOOR ADHESIVES | 60 |
| SUBFLOOR ADHESIVES | 50 |
| CERAMIC TILE ADHESIVES | 65 |
| VCT & ASPHALT TILE ADHESIVES | 50 |
| DRYWALL & PANEL ADHESIVES | 50 |
| COVE BASE ADHESIVES | 50 |
| MULTIPURPOSE CONSTRUCTION ADHESIVE | 70 |
| STRUCTURAL GLAZING ADHESIVES | 100 |
| SINGLE-PLY ROOF MEMBRANE ADHESIVES | 250 |
| OTHER ADHESIVES NOT LISTED | 50 |
| SPECIALTY APPLICATIONS | |
| PVC WELDING | 510 |
| CPVC WELDING | 490 |
| ABS WELDING | 325 |
| PLASTIC CEMENT WELDING | 250 |
| ADHESIVE PRIMER FOR PLASTIC | 550 |
| CONTACT ADHESIVE | 80 |
| SPECIAL PURPOSE CONTACT ADHESIVE | 250 |
| STRUCTURAL WOOD MEMBER ADHESIVE | 140 |
| TOP & TRIM ADHESIVE | 250 |
| SUBSTRATE SPECIFIC APPLICATIONS | |
| METAL TO METAL | 30 |
| PLASTIC FOAMS | 50 |
| POROUS MATERIAL (EXCEPT WOOD) | 50 |
| WOOD | 30 |
| FIBERGLASS | 80 |

1. IF AN ADHESIVE IS USED TO BOND DISSIMILAR SUBSTRATES TOGETHER, THE ADHESIVE WITH THE HIGHEST VOC CONTENT SHALL BE ALLOWED.

2. FOR ADDITIONAL INFORMATION REGARDING METHODS TO MEASURE THE VOC CONTENT SPECIFIED IN THIS TABLE, SEE SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT RULE 116B.

TABLE 4.504.5 - FORMALDEHYDE LIMITS:
 MAXIMUM FORMALDEHYDE EMISSIONS IN PARTS PER MILLION

| PRODUCT | CURRENT LIMIT |
|---------------------------------|---------------|
| HARDWOOD PLYWOOD VENEER CORE | 0.05 |
| HARDWOOD PLYWOOD COMPOSITE CORE | 0.05 |
| PARTICLE BOARD | 0.09 |
| MEDIUM DENSITY FIBERBOARD | 0.11 |
| THIN MEDIUM DENSITY FIBERBOARD: | 0.13 |

1. VALUES IN THIS TABLE ARE DERIVED FROM THOSE SPECIFIED BY THE CALIF. AIR RESOURCES BOARD, AIR TOXICS CONTROL MEASURE FOR COMPOSITE WOOD AS TESTED IN ACCORDANCE WITH ASTM E 1333. FOR ADDITIONAL INFORMATION, SEE CALIF. CODE OF REGULATIONS, TITLE 17, SECTIONS 93120 THROUGH 93120.12.

2. THIN MEDIUM DENSITY FIBERBOARD HAS A MAXIMUM THICKNESS OF 5/16" (8 MM).

DIVISION 4.5 ENVIRONMENTAL QUALITY (continued)

4.504.3 CARPET SYSTEMS. All carpet installed in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specification 01350)

See California Department of Public Health's website for certification programs and testing labs.
<https://www.cdph.ca.gov/Programs/CCDPHP/DEOD/CEH/BAQ/Pages/VOC.aspx>

4.504.3.1 Carpet cushion. All carpet cushion installed in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specification 01350)

See California Department of Public Health's website for certification programs and testing labs.
<https://www.cdph.ca.gov/Programs/CCDPHP/DEOD/CEH/BAQ/Pages/VOC.aspx>

4.504.3.2 Carpet adhesive. All carpet adhesive shall meet the requirements of Table 4.504.1.

4.504.4 RESILIENT FLOORING SYSTEMS. Where resilient flooring is installed, at least 80% of floor area receiving resilient flooring shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specification 01350)

See California Department of Public Health's website for certification programs and testing labs.
<https://www.cdph.ca.gov/Programs/CCDPHP/DEOD/CEH/BAQ/Pages/VOC.aspx>

4.504.5 COMPOSITE WOOD PRODUCTS. Hardwood plywood, particleboard and medium density fiberboard composite wood products used on the interior or exterior of the buildings shall meet the requirements for formaldehyde as specified in ARB's Air Toxics Control Measure for Composite Wood (17 CCR 93120 et seq.), by or before the dates specified in those sections, as shown in Table 4.504.5

4.504.5.1 Documentation. Verification of compliance with this section shall be provided as requested by the enforcing agency. Documentation shall include at least one of the following:

- Product certifications and specifications.
- Chain of custody certifications.
- Product labeled and invoiced as meeting the Composite Wood Products regulation (see CCR, Title 17, Section 93120, et seq.).
- Exterior grade products marked as meeting the PS-1 or PS-2 standards of the Engineered Wood Association, the Australian AS/NZS 2269, European E36 3S standards, and Canadian CSA 0121, CSA 0151, CSA 0153 and CSA 0325 standards.
- Other methods acceptable to the enforcing agency.

4.505 INTERIOR MOISTURE CONTROL

4.505.1 General. Buildings shall meet or exceed the provisions of the California Building Standards Code.

4.505.2 CONCRETE SLAB FOUNDATIONS. Concrete slab foundations required to have a vapor retarder by California Building Code, Chapter 19, or concrete slab-on-ground floors required to have a vapor retarder by the California Residential Code, Chapter 5, shall also comply with this section.

4.505.2.1 Capillary break. A capillary break shall be installed in compliance with at least one of the following:

- A 4-inch (101.6 mm) thick base of 1/2 inch (12.7mm) or larger clean aggregate shall be provided with a vapor barrier in direct contact with concrete and a concrete mix design, which will address bleeding, shrinkage, and curing, shall be used. For additional information, see American Concrete Institute, ACI 302.2R-06.
- Other equivalent methods approved by the enforcing agency.
- A slab design specified by a licensed design professional.

4.505.3 MOISTURE CONTENT OF BUILDING MATERIALS. Building materials with visible signs of water damage shall not be installed. Wall and floor framing shall not be enclosed when the framing members exceed 19 percent moisture content. Moisture content shall be verified in compliance with the following:

- Moisture content shall be determined with either a probe-type or contact-type moisture meter. Equivalent moisture verification methods may be approved by the enforcing agency and shall satisfy requirements found in Section 101.3 of this code.
- Moisture readings shall be taken at a point 2 feet (610 mm) to 4 feet (1219 mm) from the grade stamped end of each piece verified.
- At least three random moisture readings shall be performed on wall and floor framing with documentation acceptable to the enforcing agency provided at the time of approval to enclose the wall and floor framing.

Insulation products which are visibly wet or have a high moisture content shall be replaced or allowed to dry prior to enclosure in wall or floor cavities. Wet-applied insulation products shall follow the manufacturers' drying recommendations prior to enclosure.

4.506 INDOOR AIR QUALITY AND EXHAUST

4.506.1 Bathroom exhaust fans. Each bathroom shall be mechanically ventilated and shall comply with the following:

- Fans shall be ENERGY STAR compliant and be ducted to terminate outside the building.
- Unless functioning as a component of a whole house ventilation system, fans must be controlled by a humidity control.
 - Humidity controls shall be capable of adjustment between a relative humidity range less than or equal to 50% to a maximum of 80%. A humidity control may utilize manual or automatic means of adjustment.
 - A humidity control may be a separate component to the exhaust fan and is not required to be integral (i.e., built-in).

Notes:

- For the purposes of this section, a bathroom is a room which contains a bathtub, shower or tub/shower combination.
- Lighting integral to bathroom exhaust fans shall comply with the California Energy Code.

4.507 ENVIRONMENTAL COMFORT

4.507.2 HEATING AND AIR-CONDITIONING SYSTEM DESIGN. Heating and air conditioning systems shall be sized, designed and have their equipment selected using the following methods:

- The heat loss and heat gain is established according to ANSI/ACCA 2 Manual J - 2011 (Residential Load Calculation), ASHRAE handbooks or other equivalent design software or methods.
- Duct systems are sized according to ANSI/ACCA 1 Manual D - 2014 (Residential Duct Systems), ASHRAE handbooks or other equivalent design software or methods.
- Select heating and cooling equipment according to ANSI/ACCA 3 Manual S - 2014 (Residential Equipment Selection), or other equivalent design software or methods.

Exception: Use of alternate design temperatures necessary to ensure the system functions are acceptable.

CHAPTER 7

INSTALLER & SPECIAL INSPECTOR QUALIFICATIONS

702 QUALIFICATIONS

702.1 INSTALLER TRAINING. HVAC system installers shall be trained and certified in the proper installation of HVAC systems including ducts and equipment by a nationally or regionally recognized training or certification program. Uncertified persons may perform HVAC installations when under the direct supervision and responsibility of a person trained and certified to install HVAC systems or contractor licensed to install HVAC systems. Examples of acceptable HVAC training and certification programs include but are not limited to the following:

- State certified apprenticeship programs.
- Public utility training programs.
- Training programs sponsored by trade, labor or statewide energy consulting or verification organizations.
- Programs sponsored by manufacturing organizations.
- Other programs acceptable to the enforcing agency.

702.2 SPECIAL INSPECTION [HCD]. When required by the enforcing agency, the owner or the responsible entity acting as the owner's agent shall employ one or more special inspectors to provide inspection or other duties necessary to substantiate compliance with this code. Special inspectors shall demonstrate competence to the satisfaction of the enforcing agency for the particular type of inspection or task to be performed. In addition to other certifications or qualifications acceptable to the enforcing agency, the following certifications or education may be considered by the enforcing agency when evaluating the qualifications of a special inspector:

- Certification by a national or regional green building program or standard publisher.
- Certification by a statewide energy consulting or verification organization, such as HERS raters, building performance contractors, and home energy auditors.
- Successful completion of a third party apprentice training program in the appropriate trade.
- Other programs acceptable to the enforcing agency.

Notes:

- Special inspectors shall be independent entities with no financial interest in the materials or the project they are inspecting for compliance with this code.
- HERS raters are special inspectors certified by the California Energy Commission (CEC) to rate homes in California according to the Home Energy Rating System (HERS).

[BSC] When required by the enforcing agency, the owner or the responsible entity acting as the owner's agent shall employ one or more special inspectors to provide inspection or other duties necessary to substantiate compliance with this code. Special inspectors shall demonstrate competence to the satisfaction of the enforcing agency for the particular type of inspection or task to be performed. In addition, the special inspector shall have a certification from a recognized state, national or international association, as determined by the local agency. The area of certification shall be closely related to the primary job function, as determined by the local agency.

Note: Special inspectors shall be independent entities with no financial interest in the materials or the project they are inspecting for compliance with this code.

703 VERIFICATIONS

703.1 DOCUMENTATION. Documentation used to show compliance with this code shall include but is not limited to, construction documents, plans, specifications, builder or installer certification, inspection reports, or other methods acceptable to the enforcing agency which demonstrate substantial conformance. When specific documentation or special inspection is necessary to verify compliance, that method of compliance will be specified in the appropriate section or identified applicable checklist.

DISCLAIMER: THIS DOCUMENT IS PROVIDED AND INTENDED TO BE USED AS A MEANS TO INDICATE AREAS OF COMPLIANCE WITH THE CALIFORNIA GREEN BUILDING STANDARDS (CALGREEN) CODE. DUE TO THE VARIABLES BETWEEN BUILDING DEPARTMENT JURISDICTIONS, THIS CHECKLIST IS TO BE USED ON AN INDIVIDUAL PROJECT BASIS AND MAY BE MODIFIED BY THE END USER TO MEET THOSE INDIVIDUAL NEEDS. THE END USER ASSUMES ALL RESPONSIBILITY ASSOCIATED WITH THE USE OF THIS DOCUMENT, INCLUDING VERIFICATION WITH THE FULL CODE.



(I) EXISTING PARTIAL ENCLOSURE



(E) EXISTING SINGLE FAMILY RESIDENCE - SIDE PERSPECTIVE



(A) EXISTING SINGLE FAMILY RESIDENCE - FRONT PERSPECTIVE



(J) EXISTING SHED



(F) EXISTING TREES



(B) EXISTING SINGLE FAMILY RESIDENCE - SIDE PERSPECTIVE



(K) EXISTING DETACHED ADU & PARTIAL ENCLOSURE



(G) EXISTING TREES



(C) EXISTING SINGLE FAMILY RESIDENCE - SIDE PERSPECTIVE



(L) EXISTING DETACHED ADU & ACCESSORY STRUCTURES



(H) EXISTING SINGLE FAMILY RESIDENCE & DETACHED ADU



(D) EXISTING SINGLE FAMILY RESIDENCE - REAR PERSPECTIVE

FLOOR AREA BREAKDOWN @ SITE


EXISTING

| | DESCRIPTION | FLOOR AREA (SF) |
|---|-----------------------|-----------------|
| A | (E) SINGLE FAMILY | 1128 SF |
| B | (E) DETACHED ADU | 1150 SF |
| C | (E) PARTIAL ENCLOSURE | 242 SF |
| D | (E) SHED | 123 SF |

NOTE: BLUE TEXT TO REPRESENT DEMO

PROPOSED

| | DESCRIPTION | FLOOR AREA (SF) |
|----|---------------------|-----------------|
| A | | |
| B | (E) DETACHED ADU | 1150 SF |
| C | | |
| D | | |
| P1 | (P) 1ST STORY | 1637 SF |
| P2 | (P) 2ND STORY | 1874 SF |
| P3 | (P) ATTACHED GARAGE | 498 SF |

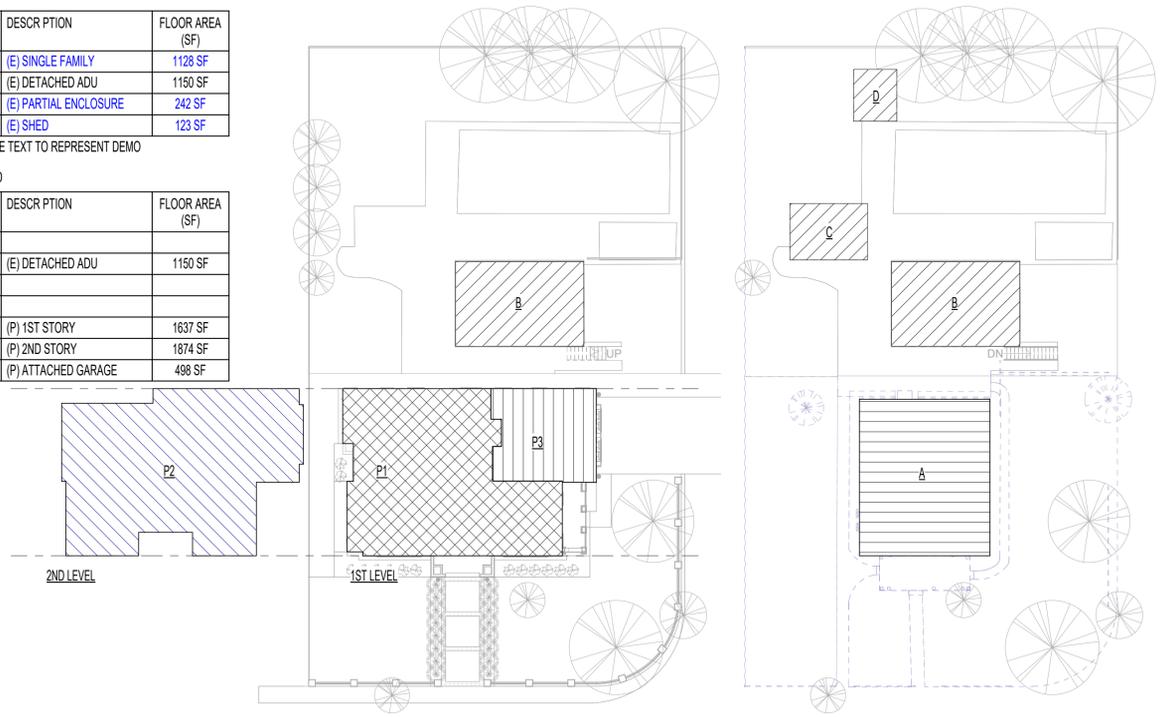

2 Site Area Analysis, Proposed
1" = 20'-0"

1 Site Area Analysis, Existing
1" = 20'-0"

MAX SF CALCULATION (MAIN RESIDENCE)

| | |
|---------------|--------------------------------|
| (E) LOT AREA: | 13,092 SF |
| FAR = | 0.35 - (([A - 5] / 25) X 0.20) |
| FAR = | 0.35 - 0.064 |
| FAR = | 0.284 |
| MAX SF = | +/- 3,797 SF |

PROPOSED SF CALCULATION (MAIN RESIDENCE)

| | |
|---|-------------------------|
| (E) RESIDENCE: | 1,128 SF TO BE DEMO'D |
| (E) DETACHED ADU | 1,150 SF TO BE REMAINED |
| PORTION OF (E) RESIDENCE TO BE CONVERTED TO GARAGE: | N/A |
| (P) FIRST FLOOR AREA: | 1,637 SF |
| (P) SECOND FLOOR AREA: | 1,874 SF |
| (P) ATTACHED GARAGE | 498 SF |

SUMMARY (SF) AFTER CHANGES

| | |
|----------------------------|----------|
| (N) LVL 1: | 1,637 SF |
| (N) LVL 2: | 1,874 SF |
| TOTAL SF (MAIN RESIDENCE): | 3,511 SF |
| (N) GARAGE: | 498 SF |

PROJECT PLAN


- HISTORICAL LIST REMOVAL (TOWN'S HISTORIC PRESERVATION COMMITTEE) - APPROVED
- OFFICE ZONING TO R-1 ZONING CONVERSION
- PLANNING PHASE
- BUILDING PHASE

PROJECT SETBACKS (AFTER REZONE)

| | |
|------------------|-------|
| PER R-1:8 ZONING | |
| FRONT SETBACK: | 25 FT |
| SIDE SETBACK: | 8 FT |
| REAR SETBACK: | 20 FT |
| SIDE ABUTTING: | 15 FT |



GORDON K WONG, ARCHITECT, LIC# 34045
KEVIN YU PROJECT REP
710E MCCLINCY LANE SUITE 109
CAMPBELL, CA 95008 (408) 315-2125
GORDONKONG@GKARCHITECTS.COM KEVINYU@GKARCHITECTS.COM

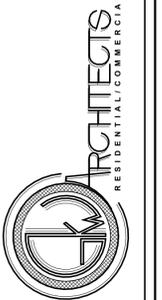

Existing Conditions & Proposed Analysis

RESIDENCE

14331 Capri Drive
LOS GATOS, CA 95032


| # | REV DATE | DESCRIPTION |
|---|------------|-------------|
| △ | 2024.11.29 | PLANNING |
| △ | 2024.06.08 | PLANNING |
| △ | 2024.09.11 | PLANNING |
| △ | 2025.01.08 | PLANNING |
| △ | 2025.04.30 | PLANNING |

Existing Conditions & Proposed Analysis

G003

SCALE As indicated

5/14/2025 4:17:22 PM

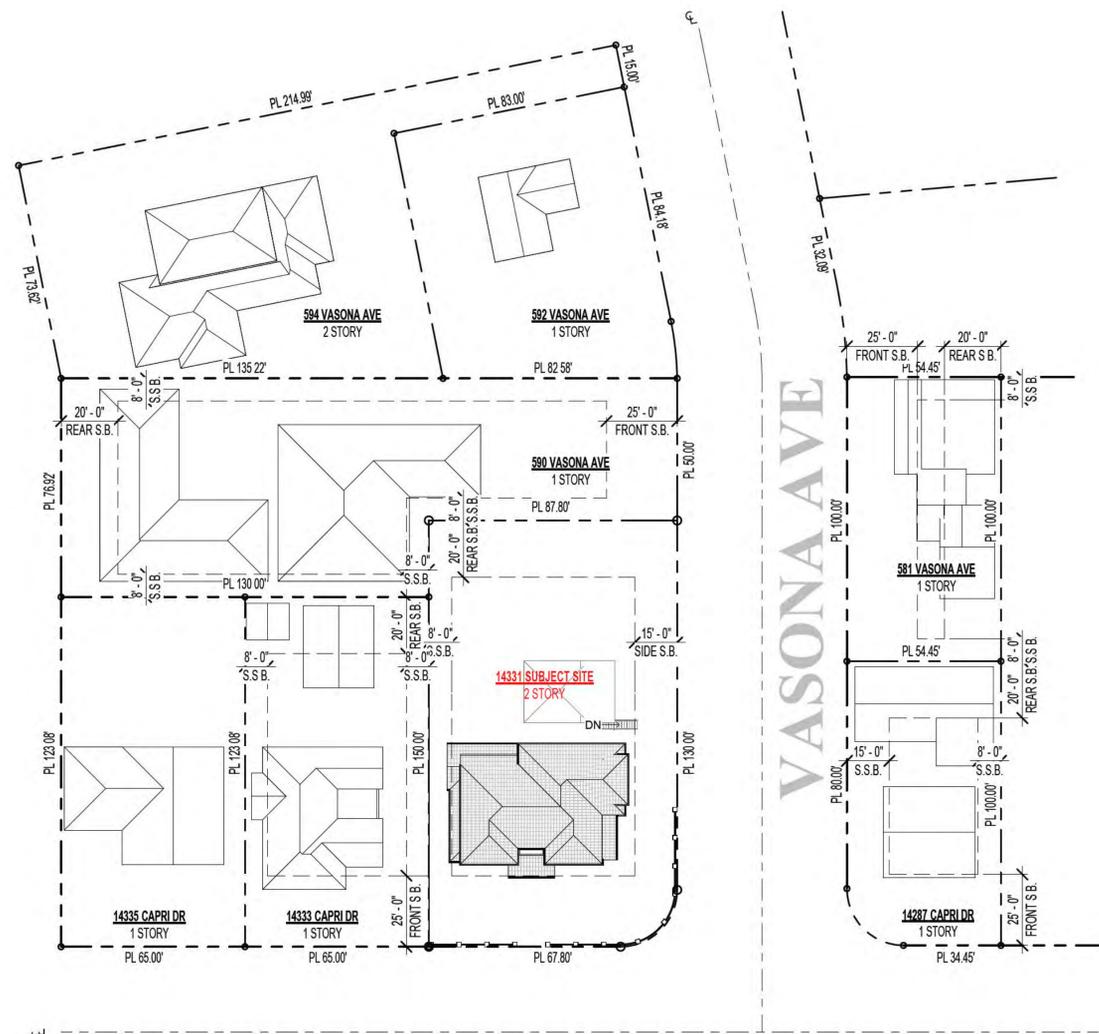

CAPRI DRIVE

1 Site Analysis, Adjacent Properties
1" = 30'-0"



14288 WINCHESTER BLVD, LOS GATOS, CA 95032



14333 CAPRI DR, LOS GATOS, CA 95032



14335 CAPRI DR, LOS GATOS, CA 95032



590 VASONA AVE, LOS GATOS, CA 95032



592 VASONA AVE, LOS GATOS, CA 95032



594 VASONA AVE, LOS GATOS, CA 95032



14287 CAPRI DR, LOS GATOS, CA 95032



581 VASONA AVE, LOS GATOS, CA 95032



GORDON K WONG ARCHITECTS
710E MCCLUNCY LANE SUITE 109
CAMPBELL, CA 95008 (408) 315-2125
GORDONK.WONG@GKWAARCHITECTS.COM KEVINYU@GKWAARCHITECTS.COM



Neighborhood & Adjacent Building Analysis

RESIDENCE

14331 Capri Drive
LOS GATOS, CA 95032

| # | REV DATE | DESCRIPTION |
|---|------------|-------------|
| △ | 2024.11.29 | PLANNING |
| △ | 2024.06.06 | PLANNING |
| △ | 2024.09.11 | PLANNING |
| △ | 2025.01.08 | PLANNING |
| △ | 2025.04.30 | PLANNING |

Neighborhood & Adjacent Building Analysis

G004

SCALE 1" = 30'-0"

5/14/2025 4:17:25 PM




GORDON K WONG ARCHITECTS
 RESIDENTIAL COMMERCIAL
 ARCHITECTS
 7106 MCCLINCY LANE SUITE 109
 CAMPBELL, CA 95008 (408) 315-2125
 KEVIN WU PROJECT REP
 7106 MCCLINCY LANE SUITE 109
 CAMPBELL, CA 95008 (408) 798-1848
 GORDONKWONG@GKWAARCHITECTS.COM KEVINWU@GKWAARCHITECTS.COM

CAPRI DR STREETScape ELEVATIONS:

| | |
|-------------|-------------------------------------|
| 1. ADDRESS: | 14335 CAPRI DR, LOS GATOS, CA 95032 |
| APN: | 406-32-006 |
| HEIGHT: | -16.5 FT |
| 2. ADDRESS: | 14333 CAPRI DR, LOS GATOS, CA 95032 |
| APN: | 406-32-005 |
| HEIGHT: | -15 FT |
| 3. ADDRESS: | 14287 CAPRI DR, LOS GATOS, CA 95032 |
| APN: | 406-28-015 |
| HEIGHT: | -14 FT |


VASONA AVE STREETScape ELEVATIONS:

| | |
|-------------|-------------------------------------|
| 1. ADDRESS: | 590 VASONA AVE, LOS GATOS, CA 95032 |
| APN: | 406-32-003 |
| HEIGHT: | -21.5 FT |
| 2. ADDRESS: | 592 VASONA AVE, LOS GATOS, CA 95032 |
| APN: | 406-32-049 |
| HEIGHT: | -14.75 FT |
| 3. ADDRESS: | 594 VASONA AVE, LOS GATOS, CA 95032 |
| APN: | 406-32-048 |
| HEIGHT: | -24 FT |

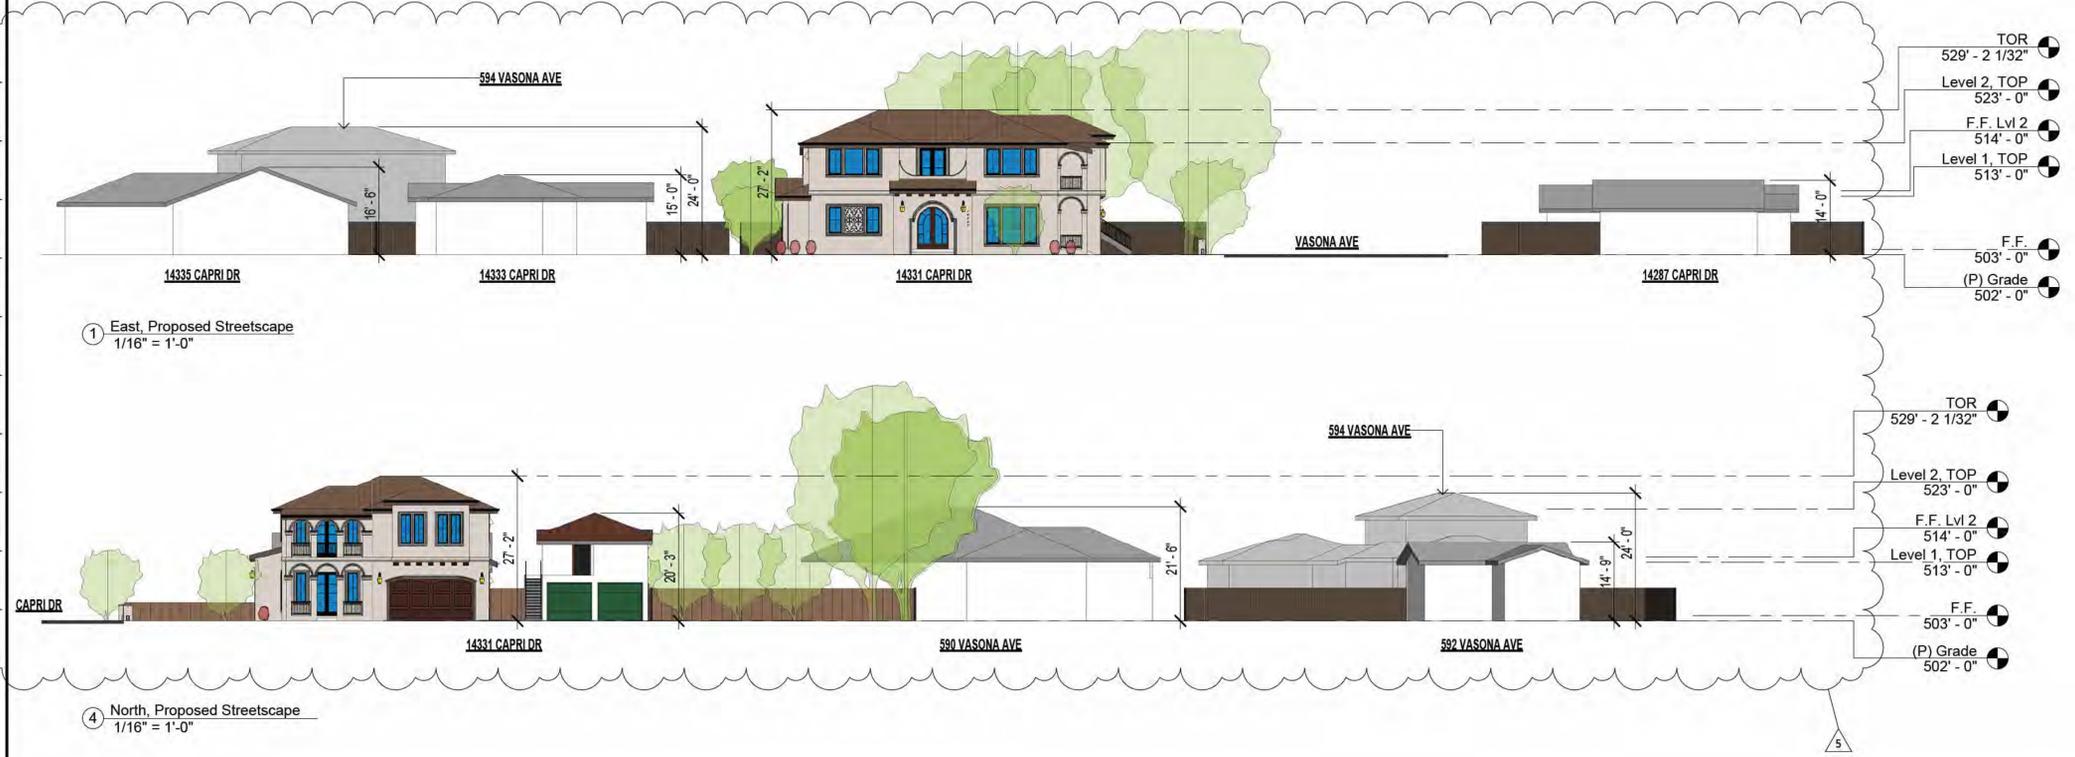

① East, Proposed Streetscape
 1/16" = 1'-0"

④ North, Proposed Streetscape
 1/16" = 1'-0"

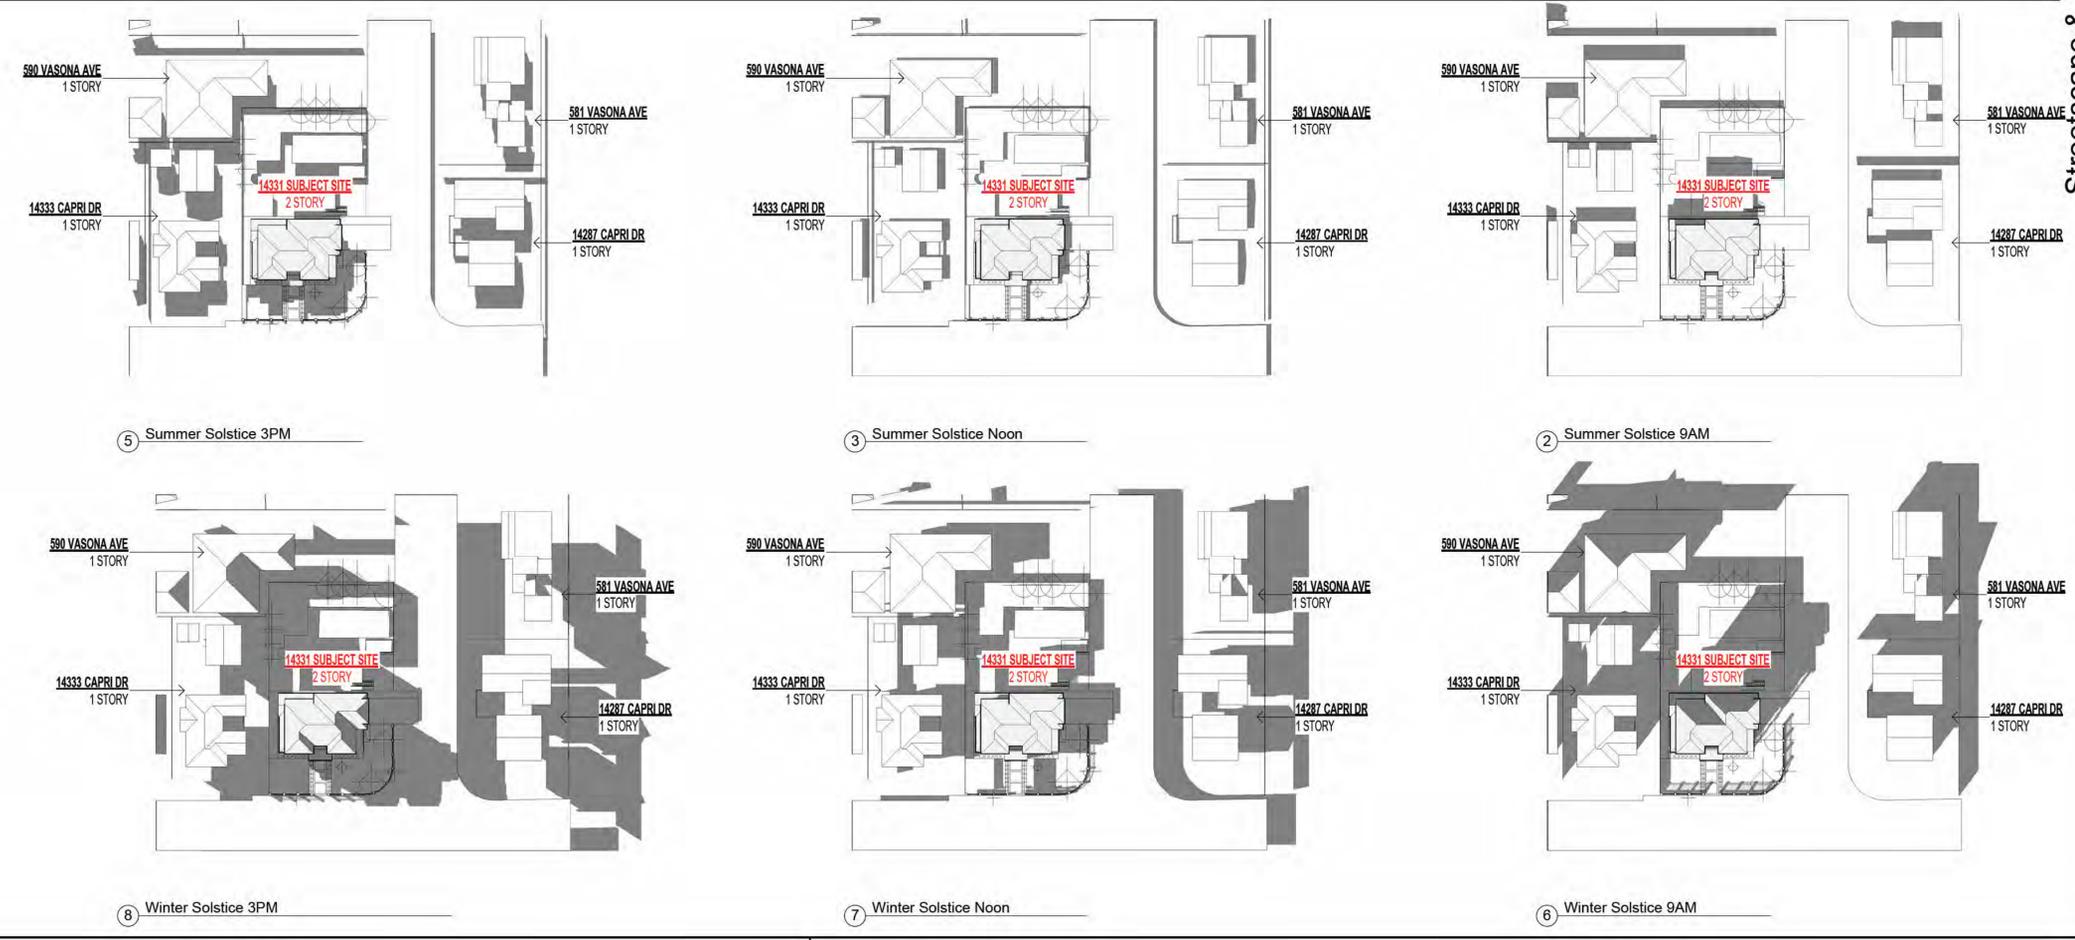

⑤ Summer Solstice 3PM

③ Summer Solstice Noon

② Summer Solstice 9AM

⑧ Winter Solstice 3PM

⑦ Winter Solstice Noon

⑥ Winter Solstice 9AM

Streetscape & Shadow Study

RESIDENCE
 14331 Capri Drive
 LOS GATOS, CA 95032

| Project Schedule Revision | |
|---------------------------|----------------------|
| # | REV DATE DESCRIPTION |
| △ | 2024.11.29 PLANNING |
| △ | 2024.06.06 PLANNING |
| △ | 2024.09.11 PLANNING |
| △ | 2025.01.08 PLANNING |
| △ | 2025.04.30 PLANNING |

Streetscape & Shadow Study

G005

SCALE 1/16" = 1'-0"

5/14/2025 4:17:50 PM



GORDON K WONG, ARCHITECT, LIC# 34045
 710E MCCLINCY LANE SUITE 108
 CAMPBELL, CA 95008 (408) 315-2125
 GORDONKWONG@GKORWARCHITECTS.COM KEVINYU@GKORWARCHITECTS.COM



RESIDENCE
 14331 Capri Drive
 LOS GATOS, CA 95032

| # | REV DATE | DESCRIPTION |
|---|------------|-------------|
| △ | 2024.11.29 | PLANNING |
| △ | 2024.06.06 | PLANNING |
| △ | 2024.09.11 | PLANNING |
| △ | 2025.01.08 | PLANNING |
| △ | 2025.04.30 | PLANNING |


Site Analysis & Details

G006

SCALE As indicated

5/14/2025 4:17:54 PM


Site Analysis & Details

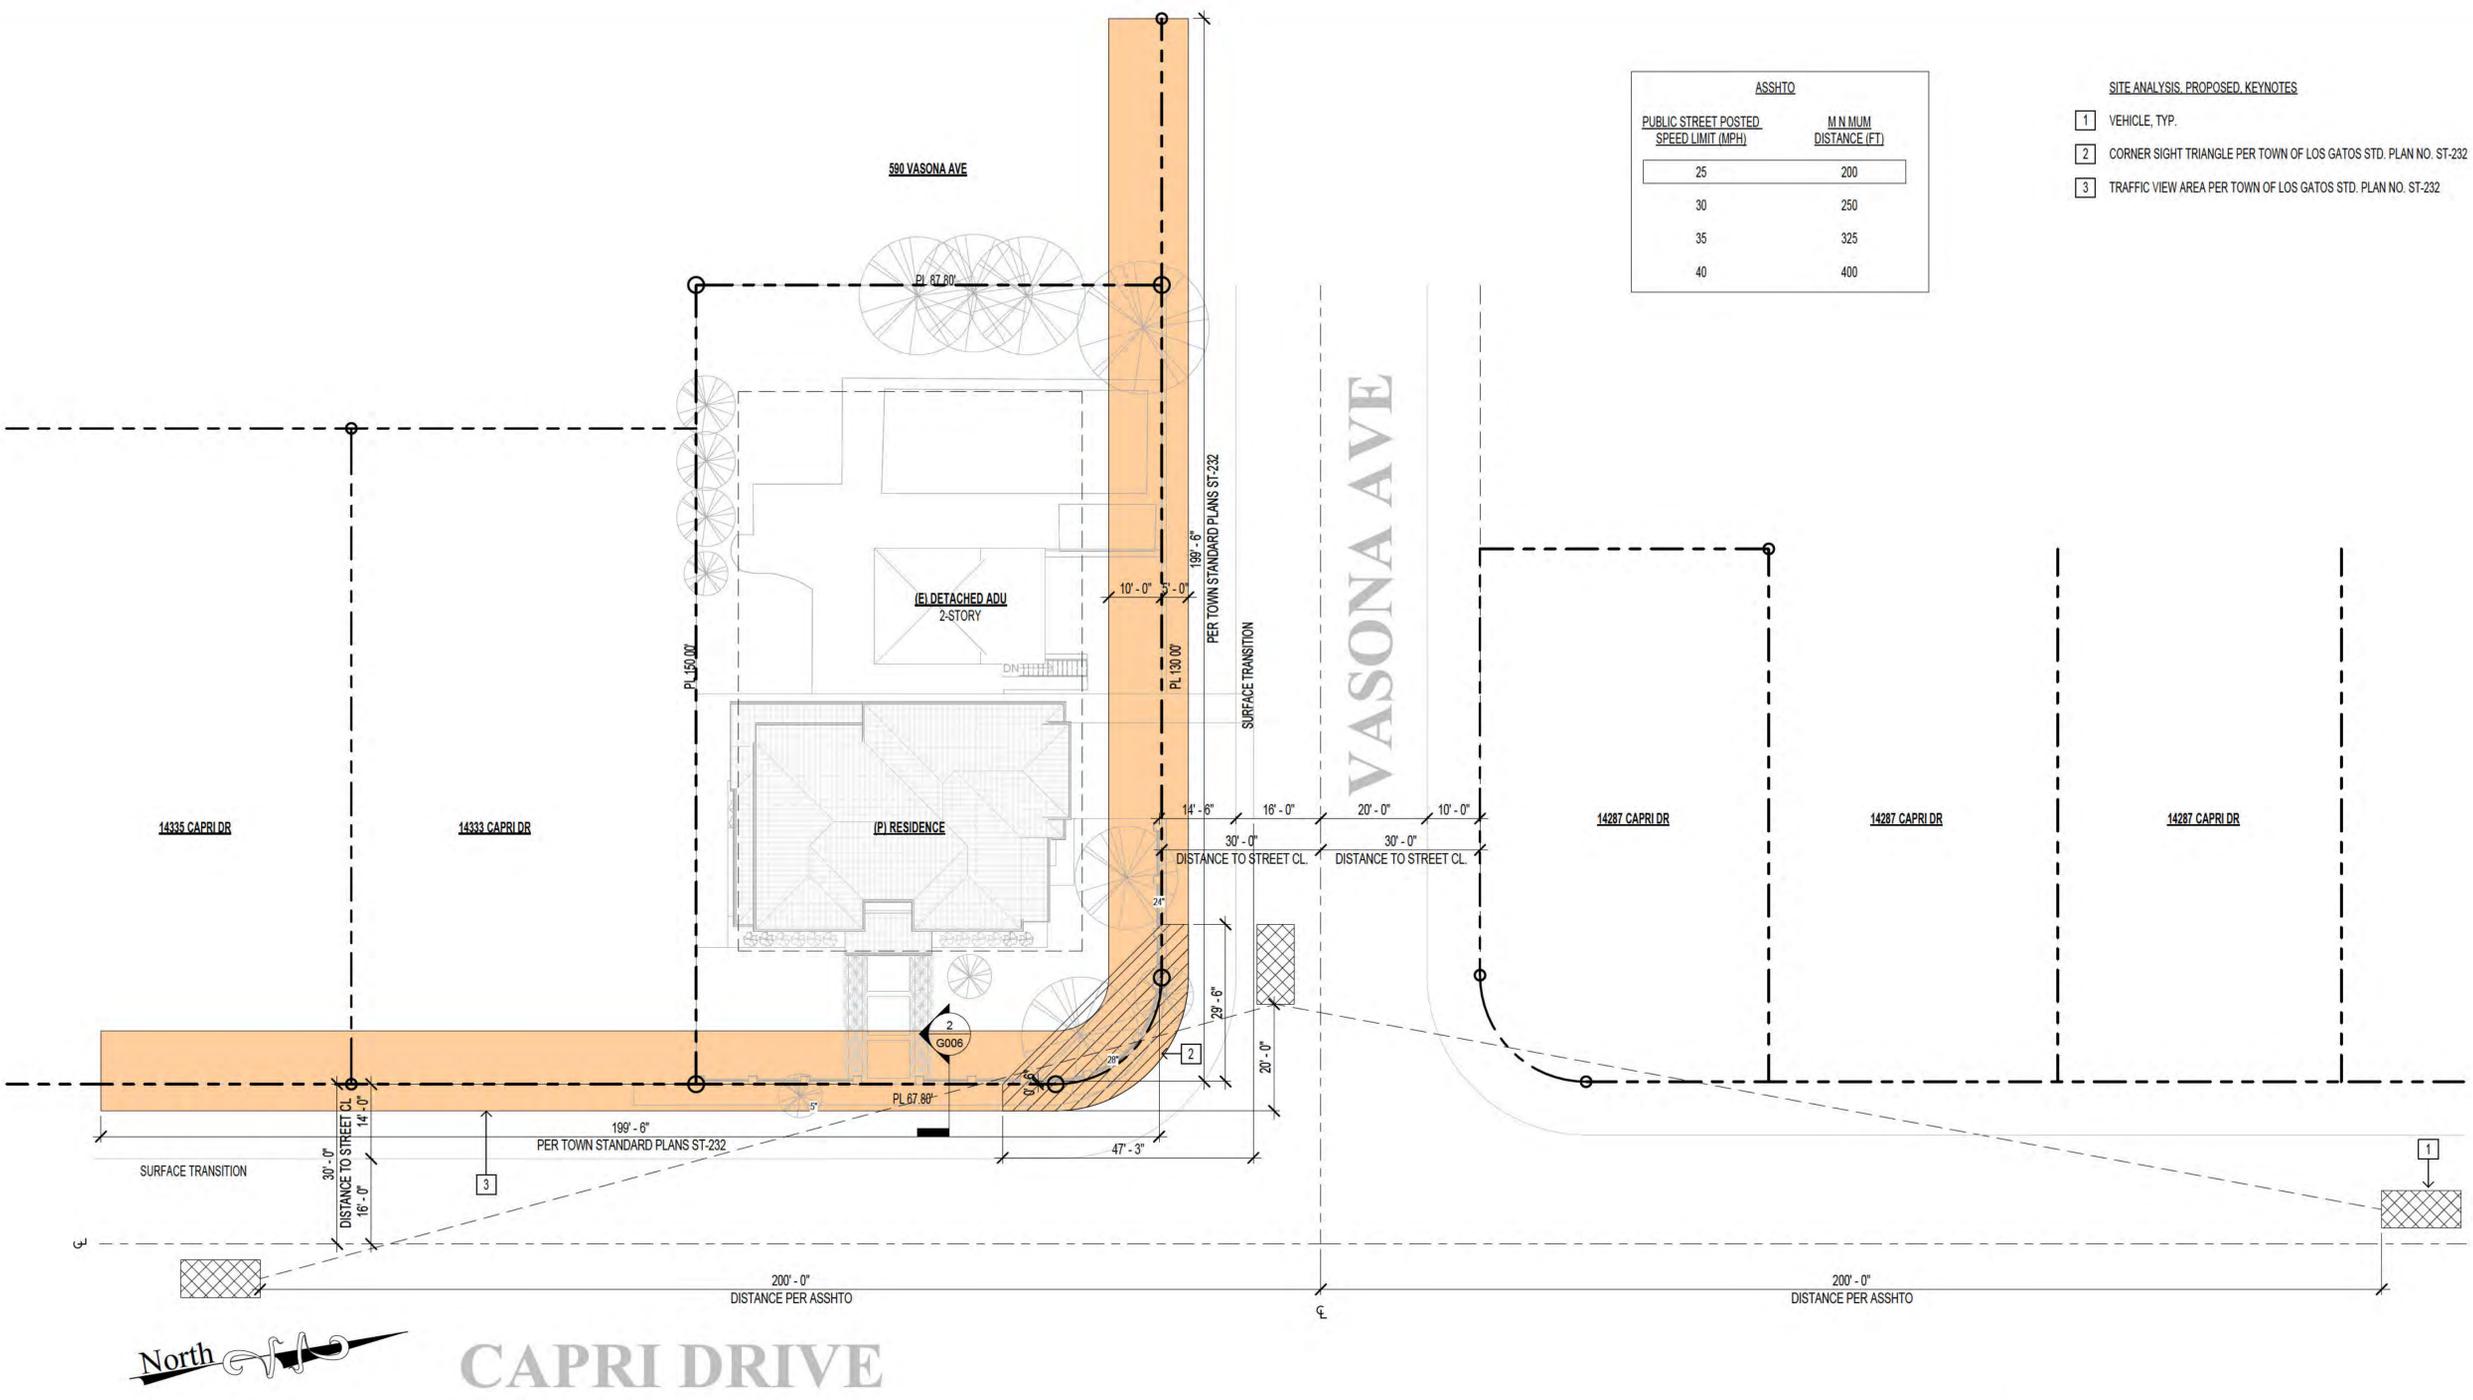

| ASSHTO | |
|--|-----------------------|
| PUBLIC STREET POSTED SPEED LIMIT (MPH) | MINIMUM DISTANCE (FT) |
| 25 | 200 |
| 30 | 250 |
| 35 | 325 |
| 40 | 400 |


- SITE ANALYSIS, PROPOSED, KEYNOTES
- 1 VEHICLE, TYP.
 - 2 CORNER SIGHT TRIANGLE PER TOWN OF LOS GATOS STD. PLAN NO. ST-232
 - 3 TRAFFIC VIEW AREA PER TOWN OF LOS GATOS STD. PLAN NO. ST-232

- NOTES:
- FOLIAGE AT MATURITY AND BERM, IF ANY, SHALL NOT EXCEED 3 FT IN HEIGHT
 - A VISUAL CLEARANCE FROM THE STREET TO 15 FT IN HEIGHT SHALL BE MAINTAINED WITH ALL TREE FOLIAGE WITHIN THE SITE TRIANGLE.
 - A VISUAL CLEARANCE FROM THE SIDEWALK TO 7 FT IN HEIGHT SHALL BE MAINTAINED WITH ALL TREE FOLIAGE WITHIN THE SITE TRIANGLE.

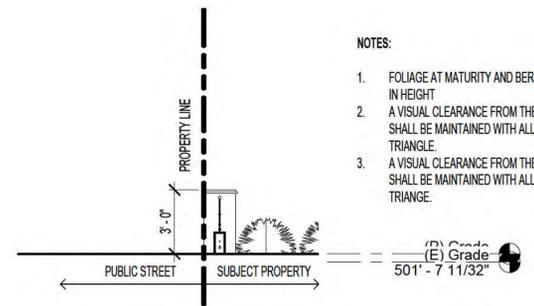


1 Site Analysis, Proposed
 1/16" = 1'-0"


2 Section, Street Visual Clearance
 1/4" = 1'-0"

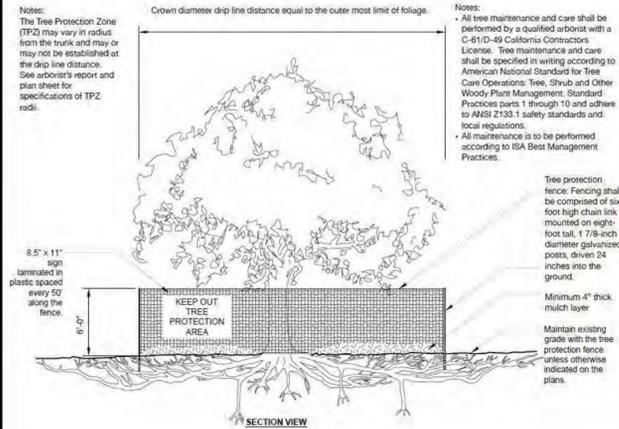

3 Type I Tree Protection NTS

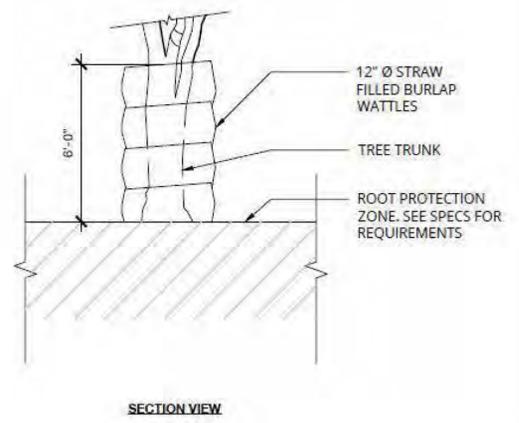

4 Type II Tree Protection NTS

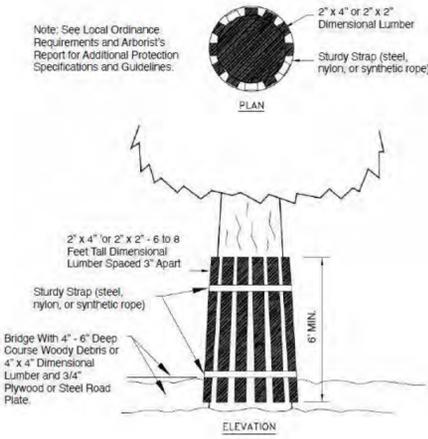

5 Type III Tree Protection NTS

TABLE 1: TREE INVENTORY & ASSESSMENT TABLES PER ARBORIST REPORT DATED DEC 4, 2023

| EXISTING | | | | | | | | |
|----------|--------------------------------------|---------------------|---------------------|--------------------|-----------------|-------------------|---------------------------|--|
| ID # | TREE SPECIES | TRUNK DIAMETER (IN) | CANOPY DIAMETER (N) | PHYSICAL CONDITION | EXPECTED IMPACT | PROTECTION STATUS | SAVED, REMOVED, OR PRUNED | REASON FOR REMOVAL |
| 186 | INCENSE CEDAR (CALOCEDRUS DECURRENS) | 34 | 30 | GOOD | LOW | PROTECTED | SAVED | |
| 187 | COAST LIVE OAK (QUERCUS AGRIFOLIA) | 30 | 35 | GOOD | LOW | PROTECTED | SAVED | |
| 188 | JUNIPER (JUNIPERUS CHINENSIS) | 6, 10, 8 | 15 | FAIR | LOW | PROTECTED | SAVED | |
| 189 | INCENSE CEDAR (CALOCEDRUS DECURRENS) | 36 | 35 | POOR | LOW | PROTECTED | SAVED | |
| 190 | OLIVE (OLEA EUROPAEA) | 12, 14 | 25 | GOOD | MODERATE | PROTECTED | REMOVED | LOCATION IS IN CONFLICT WITH THE PROPOSED DRIVEWAY |
| 191 | OLIVE (OLEA EUROPAEA) | 13, 10, 23 | 25 | GOOD | MODERATE | PROTECTED | PRUNED | |
| 192 | FAN PALM (WASHINGTONIA ROBUSTA) | 19 | 15 | GOOD | LOW | EXEMPT | SAVED | |
| 193 | STONE PINE (PINUS P. NEA) | 28 | 35 | FAIR | LOW | PROTECTED | PRUNED | |
| 194 | ORANGE (CITRUS SINENSIS) | 5, 6 | 10 | FAIR | LOW | EXEMPT | SAVED | |
| 195 | PITTOSPORUM (PITTOSPORUM UNDULATUM) | 5, 5, 5, 5, 2 | 10 | FAIR | LOW | PROTECTED | SAVED | |
| 196 | ORANGE (CITRUS SINENSIS) | 6, 6 | 10 | GOOD | HIGH | EXEMPT | REMOVED | LOCATION IS IN CONFLICT WITH THE PROPOSED BUILDING FOOTPRINT |
| 197 | CAMPHOR (CAMPHORA C. NNAMOMIUM) | 6 | 10 | FAIR | LOW | PROTECTED | SAVED | |

| PROPOSED | | | | | | | | |
|----------|-----------------------|-----------------------|-----------------|------------------------|---------|----|----|---|
| ID # | TREE SPECIES | INITIAL PLANTING SIZE | SIZE @ MATURITY | | FENCING | -- | -- | REASON FOR PROPOSE |
| | | | HEIGHT (FT) | WIDTH OF DRIFLINE (FT) | | | | |
| A | OLIVE (OLEA EUROPAEA) | 24" | 25-30 | 25-30 | -- | -- | -- | REPLACEMENT REQUIREMENT PER CANOPY SIZE OF REMOVED TREE |
| B | OLIVE (OLEA EUROPAEA) | 24" | 25-30 | 25-30 | -- | -- | -- | REPLACEMENT REQUIREMENT PER CANOPY SIZE OF REMOVED TREE |
| C | OLIVE (OLEA EUROPAEA) | 24" | 25-30 | 25-30 | -- | -- | -- | REPLACEMENT REQUIREMENT PER CANOPY SIZE OF REMOVED TREE |

TABLE 2: TOWN OF LOS GATOS TREE CANOPY - REPLACEMENT STANDARD

| CANOPY SIZE OF REMOVED TREE (1) | REPLACEMENT REQUIREMENT (2)(4) | SINGLE FAMILY RESIDENTIAL REPLACEMENT OPTION (3) (4) |
|---------------------------------|---|--|
| 10 FT OR LESS | TWO 24 INCH BOX TREES | TWO 15 GALLON TREES |
| MORE THAN 10 FT TO 25 FT | THREE 24 INCH BOX TREES | THREE 15 GALLON TREES |
| MORE THAN 25 FT TO 40 FT | FOUR 24 INCH BOX TREES OR TWO 36 INCH BOX TREES | FOUR 15 GALLON TREES |
| MORE THAN 40 FT TO 55 FT | SIX 24 INCH BOX TREES; OR THREE 36 INCH BOX TREES | NOT AVAILABLE |
| GREATER THAN 55 FT | TEN 24 INCH BOX TREES; OR FIVE 36 INCH BOX TREES | NOT AVAILABLE |

MITIGATION FOR REMOVAL PER ARBORIST'S RECOMMENDATIONS:


- THE TABLE ABOVE INDICATES THE RECOMMENDED REPLACEMENT VALUES (TABLE 2).
- TO MEASURE AN ASYMMETRICAL CANOPY OF A TREE, THE WIDEST MEASUREMENT SHALL BE USED TO DETERMINE CANOPY SIZE.
 - OFTEN, IT IS NOT POSSIBLE TO REPLACE A SINGLE LARGE, OLDER TREE WITH AN EQUIVALENT TREE(S). IN THIS CASE, THE TREE MAY BE REPLACED WITH A COMBINATION OF BOTH THE TREE CANOPY REPLACEMENT STANDARD AND IN-LIEU PAYMENT IN AN AMOUNT SET FORTH BY TOWN COUNCIL RESOLUTION PAID TO THE TOWN TREE REPLACEMENT FUND.
 - SINGLE FAMILY RESIDENTIAL REPLACEMENT OPTION IS AVAILABLE FOR DEVELOPED SINGLE FAMILY RESIDENTIAL LOTS UNDER 10,000 SQUARE FEET THAT ARE NOT SUBJECT TO THE TOWN'S HILLSIDE DEVELOPMENT STANDARDS AND GUIDELINES. ALL 15-GALLON TREES MUST BE PLANTED ON-SITE. ANY IN-LIEU FEES FOR SINGLE FAMILY RESIDENTIAL SHALL BE BASED ON 24" BOX TREE RATES AS ADOPTED BY TOWN COUNCIL.
 - REPLACEMENT TREES SHALL BE APPROVED BY THE TOWN ARBORIST AND SHALL BE OF A SPECIES SUITED TO THE AVAILABLE PLANTING LOCATION, PROXIMITY TO STRUCTURES, OVERHEAD CLEARANCES, SOIL TYPE, COMPATIBILITY WITH SURROUNDING CANOPY AND OTHER RELEVANT FACTORS. REPLACEMENT WITH NATIVE SPECIES SHALL BE STRONGLY ENCOURAGED. REPLACEMENT REQUIREMENTS IN THE HILLSIDES SHALL COMPLY WITH THE HILLSIDE DEVELOPMENT STANDARDS AND GUIDELINES APPENDIX A AND SECTION 28.10.0987 SPECIAL PROVISIONS - HILLSIDES.

SECTION 28.10.1005 - PROTECTION OF TREES DURING CONSTRUCTION:


- TREE PROTECTION ZONES & FENCE SPECIFICATIONS
- SIZE AND MATERIALS:** SIX (6) FOOT HIGH CHAIN LINK FENCING, MOUNTED ON TWO-INCH DIAMETER GALVANIZED IRON POSTS, SHALL BE DRIVEN INTO THE GROUND TO A DEPTH OF AT LEAST TWO (2) FEET AT NO MORE THAN TEN-FOOT SPACING. FOR PAVING AREA THAT WILL NOT BE DEMOLISHED AND WHEN STIPULATED IN A TREE PRESERVATION, POSTS MAY BE SUPPORTED BY A CONCRETE BASE.
 - AREA TYPE TO BE FENCED:** TYPE I: ENCLOSURE WITH CHAIN LINK FENCING OF EITHER THE ENTIRE DRIFLINE AREA OR AT THE TREE PROTECTION ZONE (TPZ) WHEN SPECIFIED BY A CERTIFIED OR CONSULTING ARBORIST. TYPE II: ENCLOSURE FOR STREET TREES LOCATED IN A PLANTER STRIP: CHAIN LINK FENCE AROUND THE ENTIRE PLANTER STRIP TO THE OUTER BRANCHES. TYPE III: PROTECTION FOR A TREE LOCATED IN A SMALL PLANTER CUTOUT ONLY (SUCH AS DOWNTOWN): ORANGE PLASTIC FENCING SHALL BE WRAPPED AROUND THE TRUNK FROM THE GROUND TO THE FIRST BRANCH WITH TWO-INCH WOODEN BOARDS BOUND SECURELY ON THE OUTSIDE. CAUTION SHALL BE USED TO AVOID DAMAGING ANY BARK OR BRANCHES.
 - DURATION OF TYPE I, II, III FENCING:** FENCING SHALL BE ERRECTED BEFORE DEMOLITION, GRADING, OR CONSTRUCTION PERMITS ARE ISSUED AND REMAIN IN PLACE UNTIL THE WORK IS COMPLETED. CONTRACTOR SHALL FIRST OBTAIN THE APPROVAL OF THE PROJECT ARBORIST ON RECORD PRIOR TO REMOVING A TREE PROTECTION FENCE.
 - WARNING SIGN:** EACH TREE FENCE SHALL HAVE PROMINENTLY DISPLAYED AN EIGHT AND ONE-HALF-FOOT BY ELEVEN-INCH SIGN STATING: "WARNING - TREE PROTECTION ZONE - THIS FENCE SHALL NOT BE REMOVED AND IS SUBJECT TO PENALTY ACCORDING TO TOWN CODE 28.10.1025." TEXT ON THE SIGNS SHOULD BE IN BOTH ENGLISH AND SPANISH (APPENDIX E).

PLAN NOTES PER ARBORIST'S RECOMMENDATIONS:

- PLACE 4-6 INCHES OF MULCH INSIDE THE TREE PROTECTION ZONE. INSTALL TEMPORARY IRRIGATION OR SOAKED HOSES IN THE TPZ. MONITOR WATERING TIMES OR AMOUNTS TO ENSURE ADEQUATE SOIL SATURATION. (A 5/8" SOAKER HOSE REQUIRES ABOUT 200 MINUTES TO DELIVER ONE INCH OF WATER TO A GARDEN. THIS NUMBER IS AFFECTED BY THE LENGTH OF THE HOSE AND THE OVERALL RATE OF FLOW FROM THE FAUCET. A GOOD RULE OF THUMB IS TO EXPECT ABOUT 1/2 GPM AS A STANDARD FAUCET FLOW RATE.) INFREQUENT DEEPER WATERING IS PREFERRED.
- ALL TREE MAINTENANCE AND CARE SHALL BE PERFORMED BY A QUALIFIED ARBORIST WITH A C-81-D-49 CALIFORNIA CONTRACTORS LICENSE. TREE MAINTENANCE AND CARE SHALL BE SPECIFIED IN WRITING ACCORDING TO AMERICAN NATIONAL STANDARD FOR TREE CARE OPERATIONS: TREE, SHRUB, AND OTHER WOODY PLANT MANAGEMENT: STANDARD PRACTICES PARTS 1 THROUGH 10 AND ADHERE TO ANSI Z133.1 SAFETY STANDARDS AND LOCAL REGULATIONS. ALL MAINTENANCE IS TO BE PERFORMED ACCORDING TO ISA BEST MANAGEMENT PRACTICES.
- REFER TO APPENDIX D FOR GENERAL TREE PROTECTION GUIDELINES INCLUDING RECOMMENDATIONS FOR ARBORIST ASSISTANCE WHILE WORKING UNDER TREES, TRENCHING, OR EXCAVATION WITHIN A TREE'S DRIP LINE OR DESIGNATED TPZ/CRZ.
- PROVIDE A COPY OF THIS REPORT TO ALL CONTRACTORS AND PROJECT MANAGERS, INCLUDING THE ARCHITECT, CIVIL ENGINEER, AND LANDSCAPE DESIGNER OR ARCHITECT. IT IS THE RESPONSIBILITY OF THE OWNER TO ENSURE ALL PARTIES ARE FAMILIAR WITH THIS DOCUMENT. ARRANGE A PRE-CONSTRUCTION MEETING WITH THE PROJECT ARBORIST OR LANDSCAPE ARCHITECT TO VERIFY TREE PROTECTION IS IN PLACE, WITH THE CORRECT MATERIALS, AND AT PROPER DISTANCES.

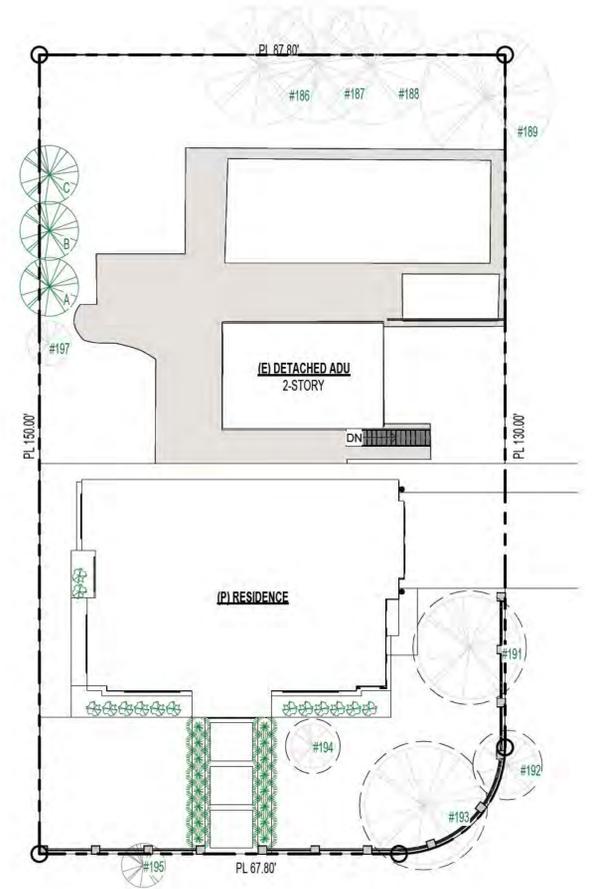

2 Tree Plan, Proposed 1/16" = 1'-0"

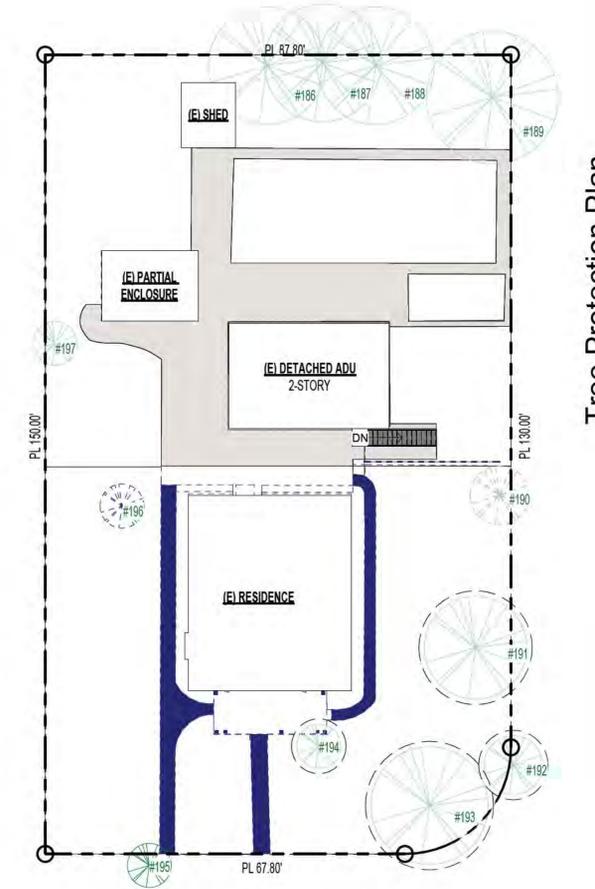

1 Tree Plan, Existing 1/16" = 1'-0"

Tree Protection Plan



GORDON K WONG ARCHITECTS
 710E MCCLINTOCK LANE SUITE 109
 CAMPBELL, CA 95008 (408) 796-1845
 GORDONK@GKARCHITECTS.COM KENNY@GKARCHITECTS.COM



RESIDENCE
 14331 Capri Drive
 LOS GATOS, CA 95032

| # | REV DATE | DESCRIPTION |
|---|------------|-------------|
| ▲ | 2024.11.29 | PLANNING |
| ▲ | 2024.06.06 | PLANNING |
| ▲ | 2024.09.11 | PLANNING |
| ▲ | 2025.01.08 | PLANNING |
| ▲ | 2025.04.30 | PLANNING |

Tree Protection Plan
G007
 SCALE As indicated
 5/14/2025 4:17:57 PM



NERIUM

LAVANDULA

PITTOSPORUM

LOMANDRA



OLEA

PLANT LEGEND AND NOTES

| SYMBOL | SPECIES | SIZE | WATER | WUCOLS |
|--------|----------------------------|-------------|-------|--------|
| A | NERIUM DEANDAR PETITE PINK | 5 GALLON | LOW | 03 |
| B | LAVANDULA MUNSTEAD | 5 GALLON | LOW | 03 |
| C | PITTOSPORUM TOBIRA | 5 GALLON | LOW | 03 |
| D | LOMANDRA BREEZE | 5 GALLON | LOW | 03 |
| E | OLEA EUROPAEA | 24" NCH BOX | LOW | 03 |

NOTES:

1. VERIFY LANDSCAPE DEMOLITION PRIOR TO CONSTRUCTION
2. PROTECT EXISTING TREES TO REMAIN THROUGHOUT CONSTRUCTION.
3. CONTRACTOR TO SUBMIT SOIL SAMPLE TO LAB FOR FERTILITY ANALYSIS AND RECOMMENDATIONS FOR SOIL PREPARATION PRIOR TO PLANTING (IF NEEDED).
4. VERIFY LOCATION OF ALL UNDERGROUND UTILITIES PRIOR TO CONSTRUCTION AND ADJUST LOCATION OF PROPOSED TREES, ETC. AS NEEDED.
5. DOUBLE STAKE ALL TREES.
6. VERIFY LAYOUT OF PLANTING IN FIELD.
7. SPREAD 3" OF WOOD CHIP MULCH (PROCH P EARTHTONE) OR EQUAL. SHREDDED BARK WILL NOT BE ACCEPTED.

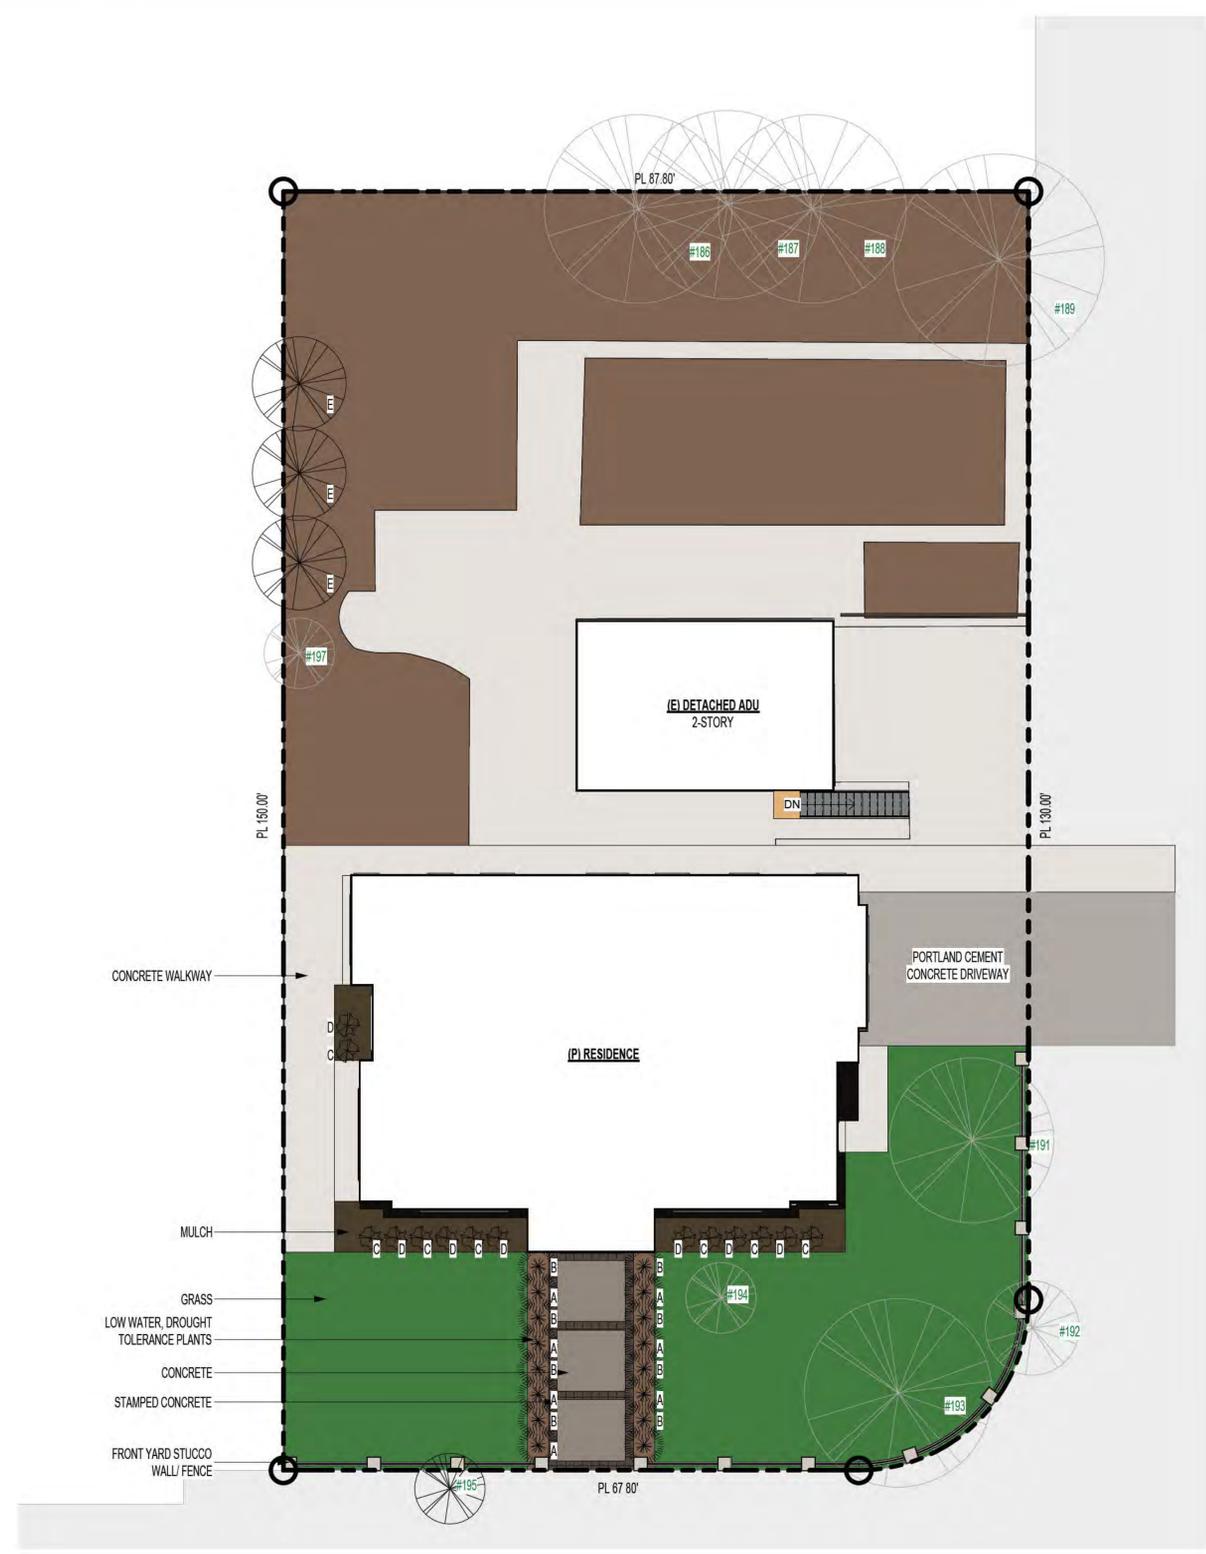

GORDON K WONG, ARCHITECT LIC# 34045
710E MCCLINCY LANE SUITE 108
CAMPBELL, CA 95008 (408) 796-1845
GORDONKONG@GKWARCHITECTS.COM KEVINYU@GKWARCHITECTS.COM



RESIDENCE
14331 Capri Drive
LOS GATOS, CA 95032

Landscape Plan, Proposed

Project Schedule Revision

| # | REV DATE | DESCRIPTION |
|---|------------|-------------|
| 1 | 2024.11.29 | PLANNING |
| 2 | 2024.06.06 | PLANNING |
| 3 | 2024.09.11 | PLANNING |
| 4 | 2025.01.08 | PLANNING |
| 5 | 2025.04.30 | PLANNING |

Landscape Plan, Proposed

G008

SCALE 1" = 10'-0"


5/14/2025 4:18:01 PM

LEGEND

- FOUND AS NOTED
- SET AS NOTED
- PROPERTY LINE
- - - EASEMENT LINE
- TIE LINE
- SS- UG SEWER LINE
- W- UG WATER LINE
- G- UG GAS LINE
- PH- UG PHONE LINE
- E- UG ELEC LINE
- OH- OVERHEAD LINE
- UTILITY BOX
- ⊗ TRAFFIC SIGNAL
- ⊗ LAMP POST
- ⊗ WOOD FENCE
- ⊗ CHAIN LINK FENCE
- ⊗ GUYWIRE
- ⊗ MAILBOX
- CONCRETE
- BUILDING
- BRICKS
- PAVERS
- DOMES
- DECK
- GROOVED CONCRETE
- ⊗ JP JOINT POLE
- ⊗ PP POWER POLE
- ⊗ UP UTILITY POLE
- ⊗ TP TELEPHONE POLE
- ⊗ BOLLARD
- ⊗ VALVE
- ⊗ HCP SYMBOL
- ⊗ SIGN
- TRAFFIC ARROWS
- ⊗ SANITARY SEWER MANHOLE
- ⊗ STORM DRAIN MANHOLE
- ⊗ COMMUNICATION MANHOLE
- ⊗ HVAC UNIT
- ⊗ FIRE HYDRANT
- ⊗ SEWER CLEANOUT
- ⊗ SURVEY CONTROL POINT
- ⊗ ELECTRIC METER
- ⊗ GAS METER
- ⊗ WATER METER
- ⊗ LIGHT POLE AND LIGHT
- ⊗ WALL
- ⊗ DROP INLET
- ⊗ MONITORING WELL

ABBREVIATIONS

- LO LIVE OAK
- WO WHITE OAK
- EUC EUCALYPTUS
- RW REDWOOD
- PUE PUBLIC UTILITY EASEMENT
- FF FINISH FLOOR ELEVATION
- O.R. OFFICIAL RECORDS

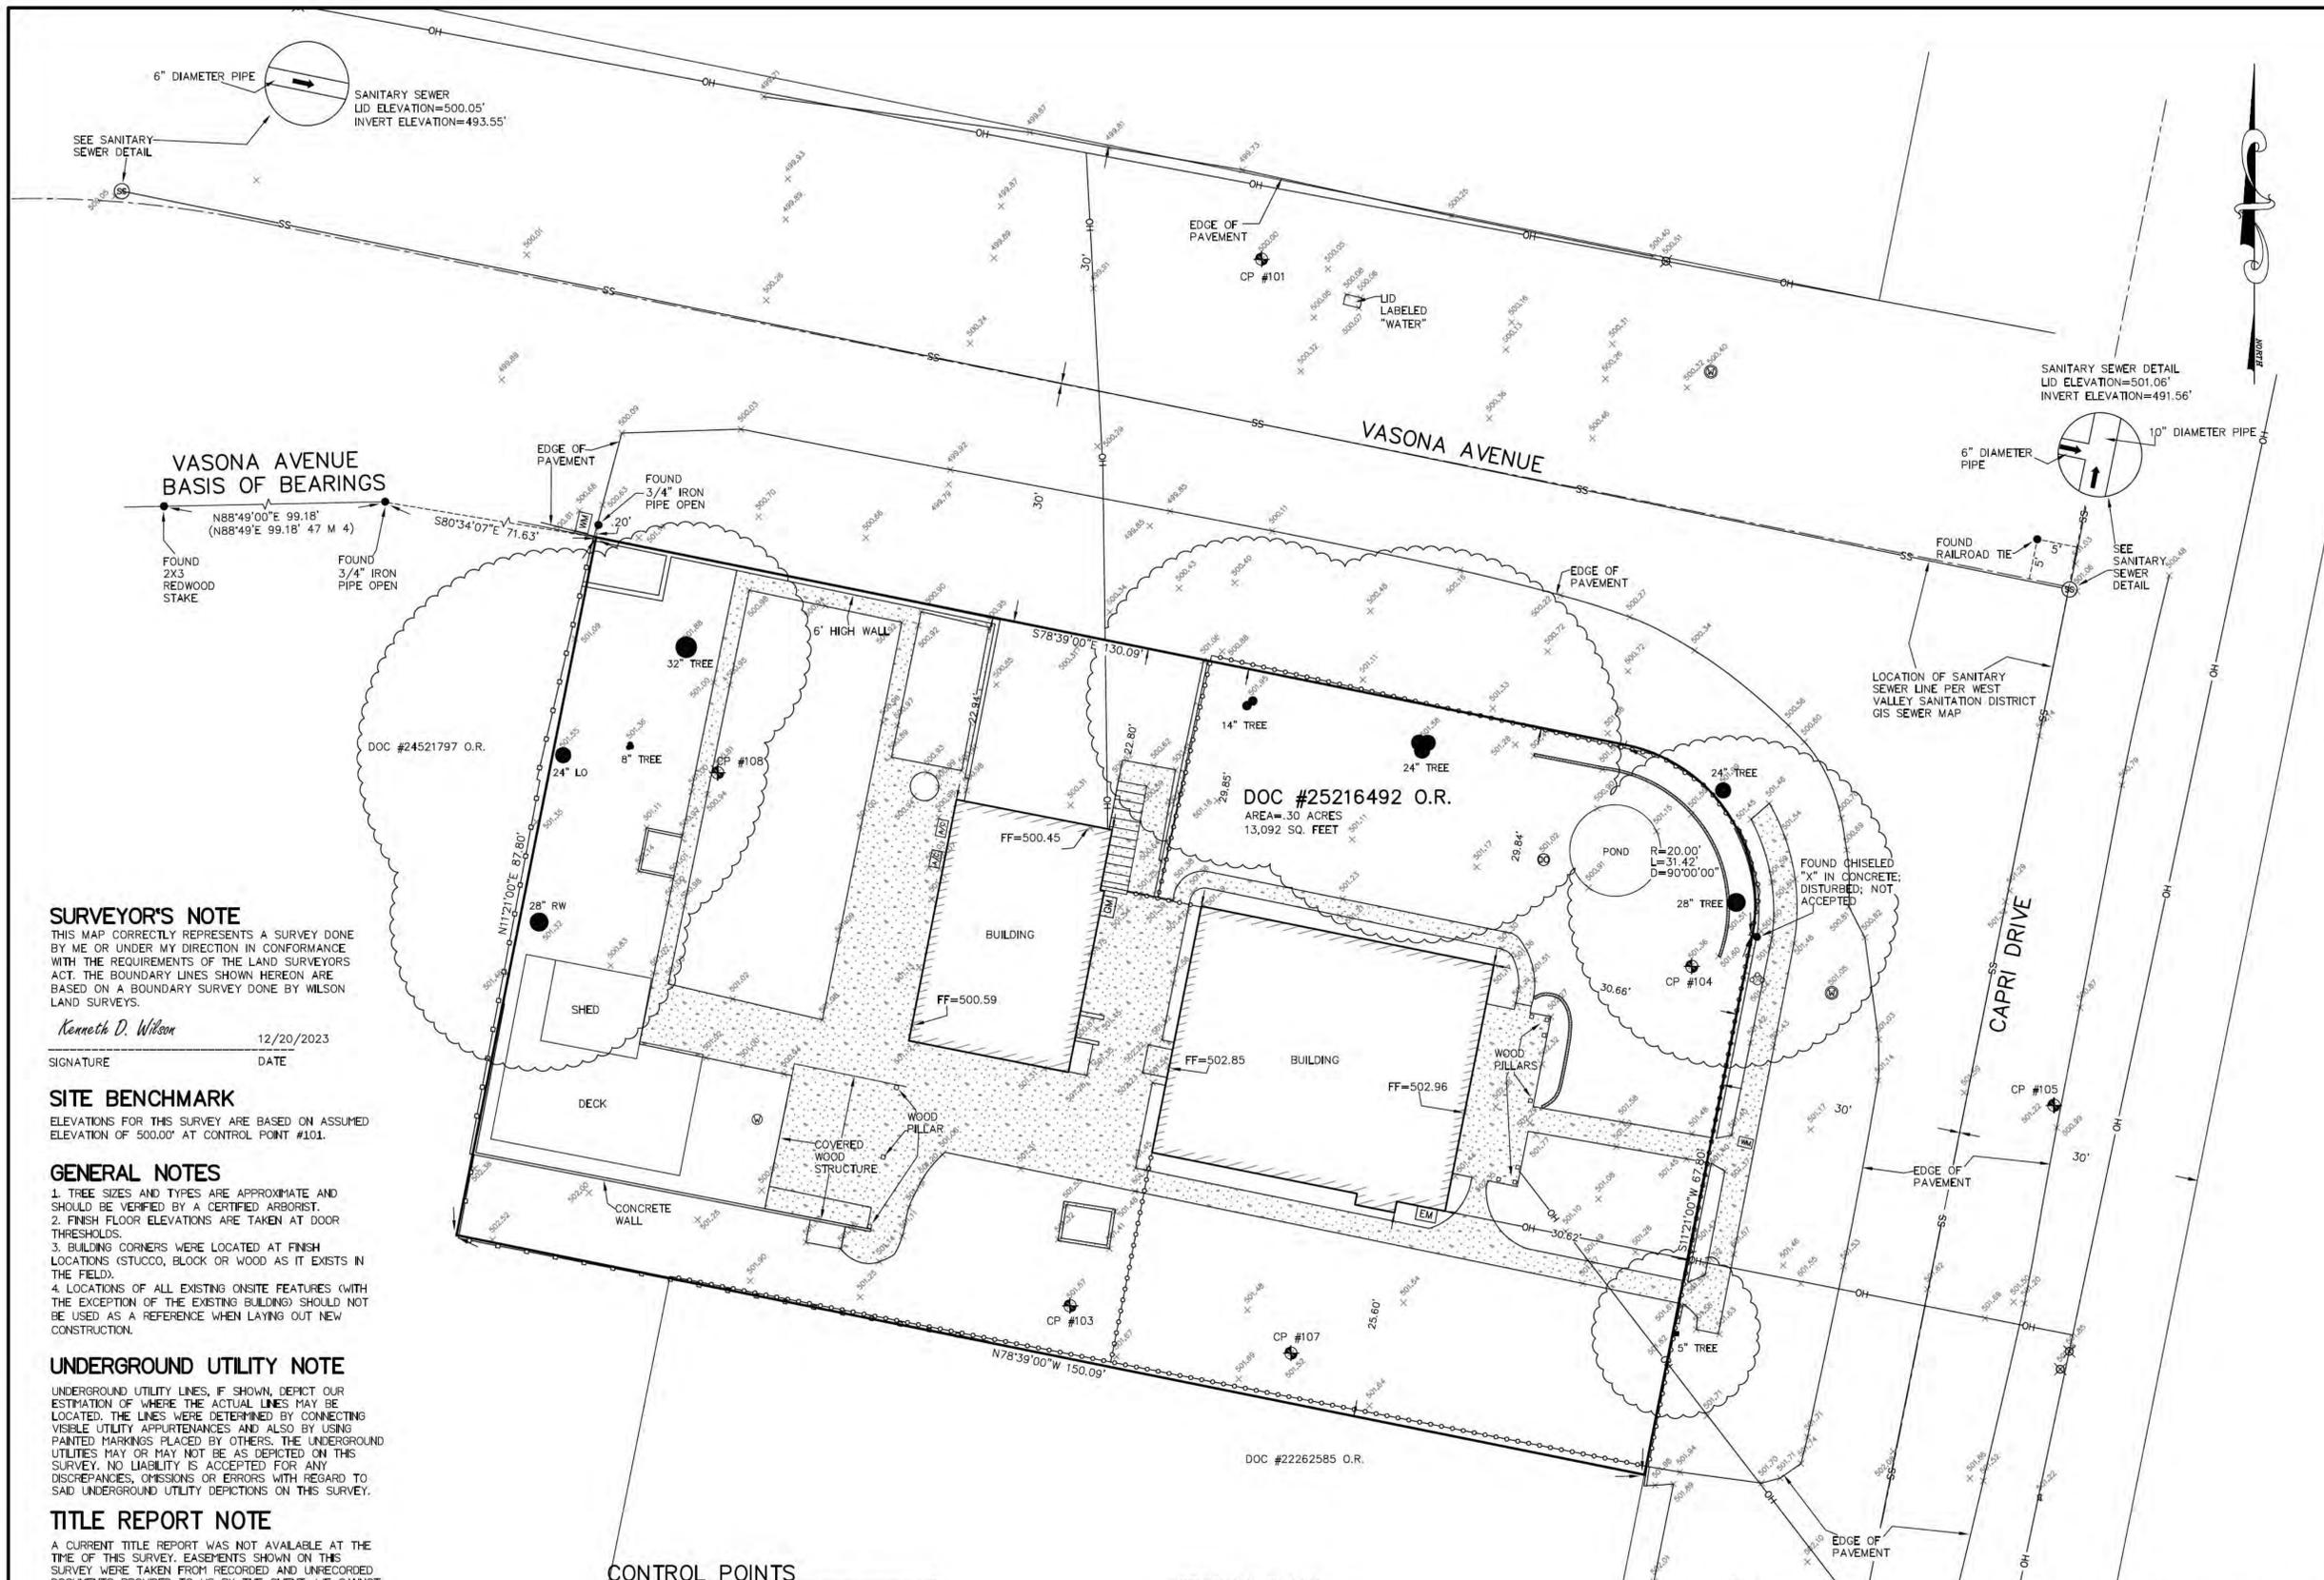

VASONA AVENUE BASIS OF BEARINGS

N88°49'00"E 99.18'
(N88°49' 99.18' 47 M 4)
S80°34'07"E 71.63'

SURVEYOR'S NOTE

THIS MAP CORRECTLY REPRESENTS A SURVEY DONE BY ME OR UNDER MY DIRECTION IN CONFORMANCE WITH THE REQUIREMENTS OF THE LAND SURVEYORS ACT. THE BOUNDARY LINES SHOWN HEREON ARE BASED ON A BOUNDARY SURVEY DONE BY WILSON LAND SURVEYS.

Kenneth D. Wilson 12/20/2023
SIGNATURE DATE

SITE BENCHMARK

ELEVATIONS FOR THIS SURVEY ARE BASED ON ASSUMED ELEVATION OF 500.00' AT CONTROL POINT #101.

GENERAL NOTES

1. TREE SIZES AND TYPES ARE APPROXIMATE AND SHOULD BE VERIFIED BY A CERTIFIED ARBORIST.
2. FINISH FLOOR ELEVATIONS ARE TAKEN AT DOOR THRESHOLDS.
3. BUILDING CORNERS WERE LOCATED AT FINISH LOCATIONS (STUCCO, BLOCK OR WOOD AS IT EXISTS IN THE FIELD).
4. LOCATIONS OF ALL EXISTING ONSITE FEATURES (WITH THE EXCEPTION OF THE EXISTING BUILDING) SHOULD NOT BE USED AS A REFERENCE WHEN LAYING OUT NEW CONSTRUCTION.

UNDERGROUND UTILITY NOTE

UNDERGROUND UTILITY LINES, IF SHOWN, DEPICT OUR ESTIMATION OF WHERE THE ACTUAL LINES MAY BE LOCATED. THE LINES WERE DETERMINED BY CONNECTING VISIBLE UTILITY APPURTENANCES AND ALSO BY USING PAINTED MARKINGS PLACED BY OTHERS. THE UNDERGROUND UTILITIES MAY OR MAY NOT BE AS DEPICTED ON THIS SURVEY. NO LIABILITY IS ACCEPTED FOR ANY DISCREPANCIES, OMISSIONS OR ERRORS WITH REGARD TO SAID UNDERGROUND UTILITY DEPICTIONS ON THIS SURVEY.

TITLE REPORT NOTE

A CURRENT TITLE REPORT WAS NOT AVAILABLE AT THE TIME OF THIS SURVEY. EASEMENTS SHOWN ON THIS SURVEY WERE TAKEN FROM RECORDED AND UNRECORDED DOCUMENTS PROVIDED TO US BY THE CLIENT. WE CANNOT DETERMINE IF ANY EASEMENTS SHOWN HEREON ARE STILL VALID AND IN EXISTENCE. OTHER EASEMENTS WHICH ARE NOT SHOWN HEREON MAY ALSO EXIST. A CURRENT TITLE REPORT IS REQUIRED IN ORDER TO DETERMINE THE VALIDITY AND EXISTENCE OF ANY EASEMENTS OF RECORD. THE BOUNDARY WAS DETERMINED FROM THE CURRENT VESTING DEED.


SETBACK LINES NOTE

BUILDING SETBACK LINES WERE NOT SHOWN ON THIS MAP (EVEN IF THEY ARE SHOWN ON THE ORIGINAL TRACT MAP). THE DESIGNER SHOULD CHECK WITH THE APPROPRIATE AUTHORITY TO DETERMINE BUILDING SETBACK LINES.

CONTROL POINTS

| Point | Northing | Eastng | Elevation | Description |
|-------|------------|------------|-----------|-------------|
| 101 | 16579.1313 | 16639.0577 | 500.0000 | CP N+T |
| 103 | 16450.0299 | 16615.3424 | 501.5679 | CP SPIKE |
| 104 | 16491.9393 | 16692.3289 | 501.3603 | CP SPIKE |
| 105 | 16474.7613 | 16737.2172 | 501.2220 | CP N+T |
| 107 | 16444.1892 | 16642.7037 | 501.5209 | CP SPIKE |
| 108 | 16515.7885 | 16571.6820 | 500.8080 | CP SPIKE |

GRAPHIC SCALE



(IN FEET)
1 inch = 10 ft.

This map was prepared as an instrument of service for the preparation of plans and specifications for construction on the site shown on this map. The information shown hereon shall not be used in whole or in part for any other project without written authority of Wilson Land Surveys.

Copyright 2023 Kenneth D. Wilson Land Surveys. All rights reserved. Copies of this drawing shall have the notice. Any drawing using the information on this map shall contain the following: Topographic Survey by Wilson Land Surveys, Los Gatos, CA



Email: koenw@wilsonlandsurveys.com
www.wilsonlandsurveys.com





BOUNDARY AND TOPOGRAPHIC SURVEY

AS REQUESTED BY:
GKW ARCHITECTS, INC.

LEGAL DESCRIPTION: LAND AS DESCRIBED IN DOC #25216492 O.R., TOWN OF LOS GATOS, COUNTY OF SANTA CLARA STATE OF CALIFORNIA

APN: 406-32-004
DATE: DECEMBER 2023
FILENAME: P-180 CAPRI GKW TOPO
SITE ADDRESS: 14331 CAPRI DRIVE, LOS GATOS, CA

DRAWN BY: ARD SCALE: 1"=10' PROJECT: F-021 JOB NUMBER: P-180 SHEET: 1 OF 1

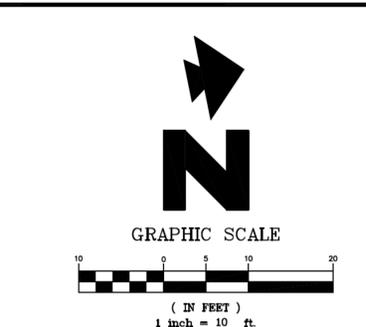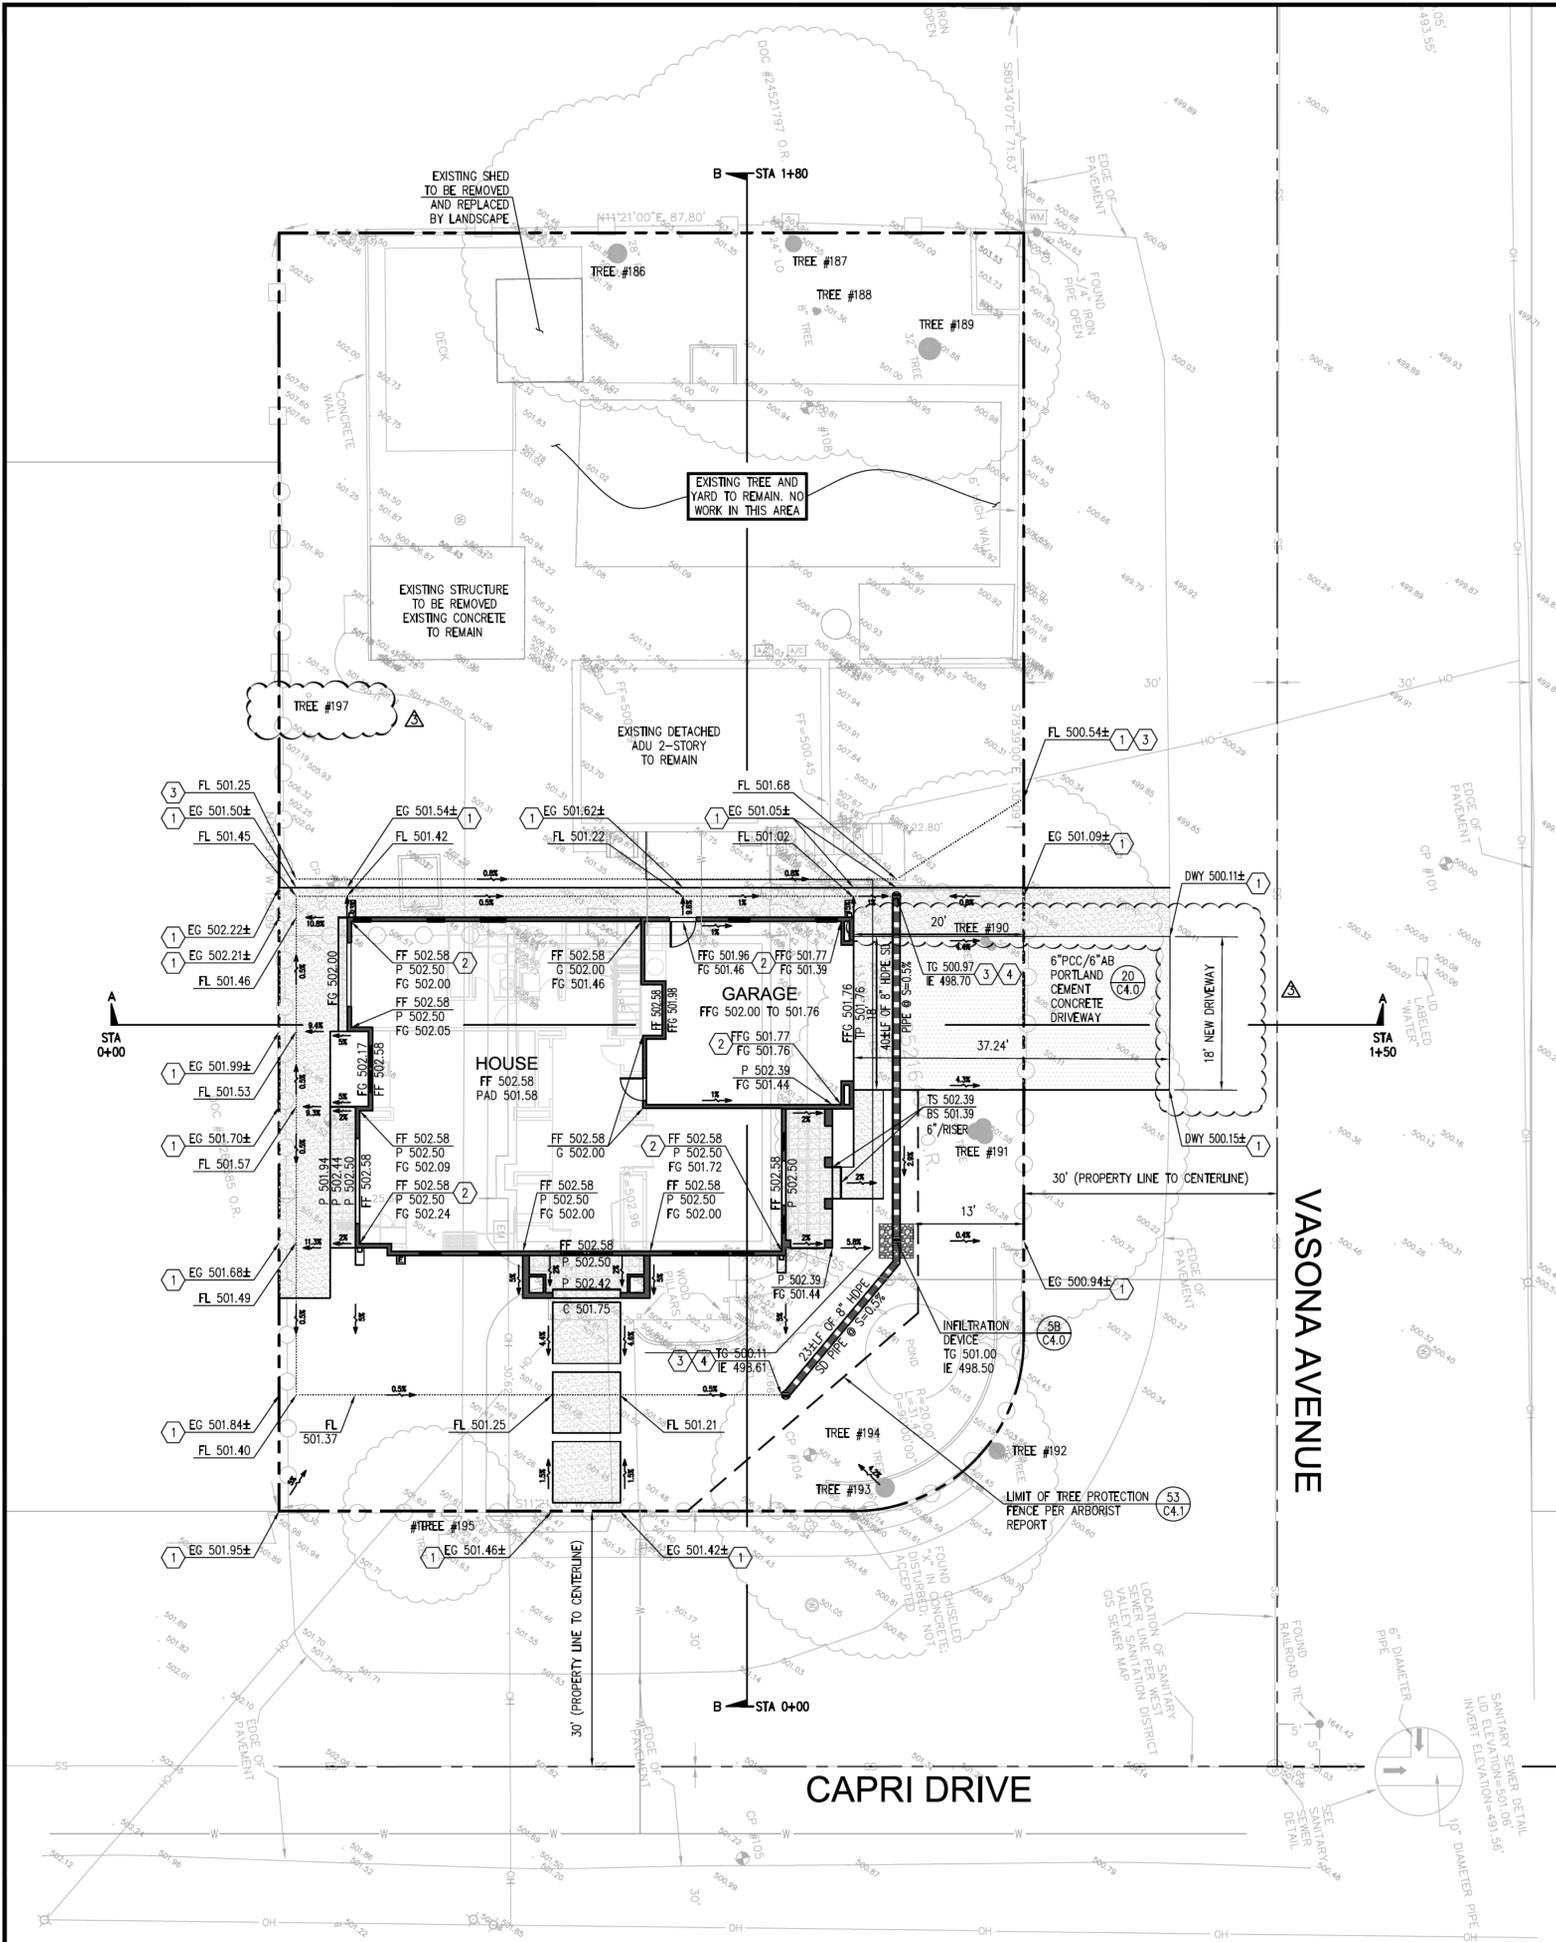

PRE & POST DEVELOPMENT PERVIOUS/IMPERVIOUS AREAS:

| AREA TYPE | EXISTING (SF) | PROPOSED (SF) |
|--------------------------------|---------------|---------------|
| LOT AREA | 13,092 SF | 13,092 SF |
| | 0.301 ACRE | 0.301 ACRE |
| TOTAL LAND DISTURBANCE * | | 0.130 ACRE |
| HOUSE (ROOF) | 1,153 | 2,776 |
| EX GARAGE | 608 | 608 |
| PATIO/HARDSCAPE | 2,912 | 1,704 |
| NEW PATIO/HARDSCAPE | N/A | 221 |
| DRIVEWAY | 521 | 307 |
| SHED | 122 | 0 |
| TOTAL IMPERVIOUS AREA | 5,316 | 5,616 |
| NET IMPERVIOUS AREA INCREASED: | | +300 |
| PERVIOUS AREA | 7,776 | 7,476 |
| TOTAL PERVIOUS AREA | 7,776 | 7,476 |

STORM DRAIN VOLUME CALCULATION:
 TIME OF CONCENTRATION = 5 MIN
 INTENSITY = 10 YEAR = 3.79 IN/HR
 IMPERVIOUS AREA INCREASED = 300 SF = 0.007 ACRE

PRE-CONDITION VOLUME REQUIRED:
 Q=CIA C=0.35 V=1.5(Q POST - Q PRE) X 10 MIN
 Q=0.35 X 3.79 X 0.010 Q=1.5(0.023 - 0.009) X 600
 Q=0.009 CFS Q=12.9 CF


POST-CONDITION VOLUME PROVIDED:
 Q=CIA V=63 LF X 8" STORAGE PIPE
 Q=0.90 X 3.79 X 0.010 V=63 LF X 0.35 SF
 Q=0.023 CFS V=22.0 CF (TOTAL)

EARTHWORK VOLUME:
 TABLE: MAXIMUM GRADED CUTS AND FILLS

| SITE ELEMENT | CUT (CY) | FILL (CY) | MAX FT (CUT) | MAX FT (FILL) | IMPORT (CY) | EXPORT (CY) |
|-------------------|----------|-----------|--------------|---------------|-------------|-------------|
| BUILDING | 24 | 4 | 2.9 | 0.08 | 0 | 20 |
| GARAGE | 19 | 1 | 2.9 | 0.75 | 0 | 18 |
| DRIVEWAY | 6 | 2 | 1 | 0.50 | 0 | 4 |
| HARDSCAPE | 2 | 6 | 1 | 0.16 | 4 | 0 |
| LANDSCAPE OR YARD | 25 | 8 | 0.75 | 0.25 | 0 | 17 |
| TOTAL | 76 | 21 | | | 0 | 55 |

CONTRACTOR SHALL ESTIMATE THEIR EARTHWORK QUANTITIES WHEN BIDDING ON THIS PROJECT

- GENERAL NOTES:**
- IF ANY EXISTING STRUCTURES TO REMAIN ARE DAMAGED DURING CONSTRUCTION IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO REPAIR AND/OR REPLACE THE EXISTING STRUCTURE AS NECESSARY TO RETURN IT TO EXISTING CONDITIONS OR BETTER.
 - CONTRACTOR SHALL PROTECT ALL PROPERTY CORNERS.
 - CONTRACTOR SHALL COMPLY WITH ALL APPLICABLE GOVERNING CODES AND BE CONSTRUCTED TO SAME.
 - CONTRACTOR SHALL ADJUST AND/OR CUT EXISTING PAVEMENT AS NECESSARY TO ASSURE A SMOOTH FIT AND CONTINUOUS GRADE.
 - CONTRACTOR SHALL ASSURE POSITIVE DRAINAGE AWAY FROM BUILDING FOR ALL NATURAL AND PAVED AREAS.
 - THE CONTRACTOR IS SPECIFICALLY CAUTIONED THAT THE LOCATION AND/OR ELEVATION OF EXISTING UTILITIES AS SHOWN ON THESE PLANS IS BASED ON RECORDS OF THE VARIOUS UTILITY COMPANIES, AND WHERE POSSIBLE, MEASUREMENTS TAKEN IN THE FIELD. THE INFORMATION IS NOT TO BE RELIED ON AS BEING EXACT OR COMPLETE. THE CONTRACTOR MUST CALL THE APPROPRIATE UTILITY COMPANIES AT LEAST 72 HOURS BEFORE ANY EXCAVATION TO REQUEST EXACT FIELD LOCATION OF UTILITIES. IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO RELOCATE UTILITIES WHICH CONFLICT WITH THE PROPOSED IMPROVEMENTS SHOWN ON THE PLANS.
 - THE CONTRACTOR SHALL ADHERE TO ALL TERMS & CONDITIONS AS OUTLINED IN GENERAL N.P.D.E.S. PERMIT FOR STORMWATER DISCHARGE ASSOCIATED WITH CONSTRUCTION ACTIVITIES.
 - UTILITY VAULTS, TRANSFORMERS, UTILITY CABINETS, CONCRETE BASES, OR OTHER STRUCTURES CANNOT BE PLACED OVER WATER MAINS/SERVICES. MAINTAIN 1' HORIZONTAL CLEAR SEPARATION FROM THE VAULTS, CABINETS & CONCRETE BASES TO EXISTING UTILITIES AS FOUND IN THE FIELD. IF THERE IS CONFLICT WITH EXISTING UTILITIES, CABINETS, VAULTS & BASES SHALL BE RELOCATED FROM THE PLAN LOCATION AS NEEDED TO MEET FIELD CONDITIONS. TREES MAY NOT BE PLANTED WITHIN 10' OF EXISTING WATER MAINS/SERVICES OR METERS. MAINTAIN 10' BETWEEN TREES AND WATER SERVICES, MAINS & METERS.
 - UTILITY INSTALLATION IF ANY SHALL BE IN ACCORDANCE WITH TOWN OF LOS GATOS STANDARDS
 - CONTRACTOR SHALL REFER TO ARCH. PLANS FOR EXACT LOCATIONS OF UTILITIES SERVICES TO NEW BUILDING. COORDINATE WITH LOCAL UTILITIES COMPANIES FOR SERVICE CONNECTIONS.

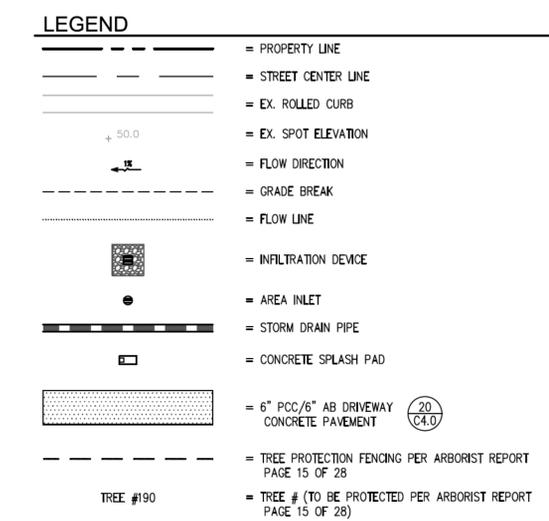


- ABBREVIATIONS:**
- BS = BOTTOM OF STEP
 - BOW = BACK OF WALK
 - BW = BOTTOM OF WALL
 - C = CONCRETE
 - DWY = DRIVEWAY
 - DK = DECK
 - EG = EXISTING GRADE
 - EX(E) = EXISTING
 - FF = FINISHED FLOOR
 - FFG = FINISHED FLOOR GARAGE
 - FG = FINISHED GRADE
 - FL = FLOW LINE
 - G = GARAGE
 - GB = GRADE BREAK
 - IE = INVERT ELEVATION
 - L = LAWN
 - LF = LINEAL FOOT
 - LP = LOW POINT
 - N = NEW
 - P = PATIO OR PORCH
 - PLT = RAISED PLANTER
 - R.O.W. = RIGHT-OF-WAY
 - S = SLOPE
 - SD = STORM DRAIN
 - SR = STRAW ROLL
 - TC = TOP OF CURB
 - TG = TOP OF GRATE
 - TP = TOP OF PAVEMENT
 - TS = TOP OF STEP
 - TW = TOP OF WALL
 - TYP = TYPICAL

- GRADING NOTES**
- MATCH EXISTING ELEVATION. GRADING LIMIT IS TO PROPERTY LINE. NO GRADING ALLOWED ON ADJACENT PROPERTIES
 - DOWNSPOUT WITH CONCRETE SPLASH PAD PER DETAIL #1A/C4
 - BEGIN/END SWALE PER DETAIL #2A/C4
 - DRAIN INLET PER DETAIL #3A/C4

| REV. | DATE | DESCRIPTION |
|------|----------|--|
| Δ | 10/31/24 | PER ENGINEERING DIV. REVIEW COMMENTS, 9/11/24 |
| Δ | 3/29/25 | PER PUBLIC WORKS AND PLANNING LATEST REVIEW COMMENTS |
| Δ | 5/10/25 | PER PUBLIC WORKS, BUILDING & PLANNING LATEST REVIEW COMMENTS |

GRADING AND DRAINAGE PLAN
RESIDENCE
14331 CAPRI DRIVE
LOS GATOS, CA 95032

GREEN
 CIVIL ENGINEERING, INC
 INFO@GREEN-CE.COM
 1900 S. NORFOLK ST. SUITE #350
 SAN MATEO, CA 94403




SCALE

VERTICAL: 1"= AS SHOWN
 HORIZONTAL: 1"= AS SHOWN

DATE: 02/01/2024
 DESIGNED: HCL
 DRAWN: BL
 REVIEWED: HCL
 JOB NO.: 20230050

SHEET
C1
 1 OF 7 SHEETS

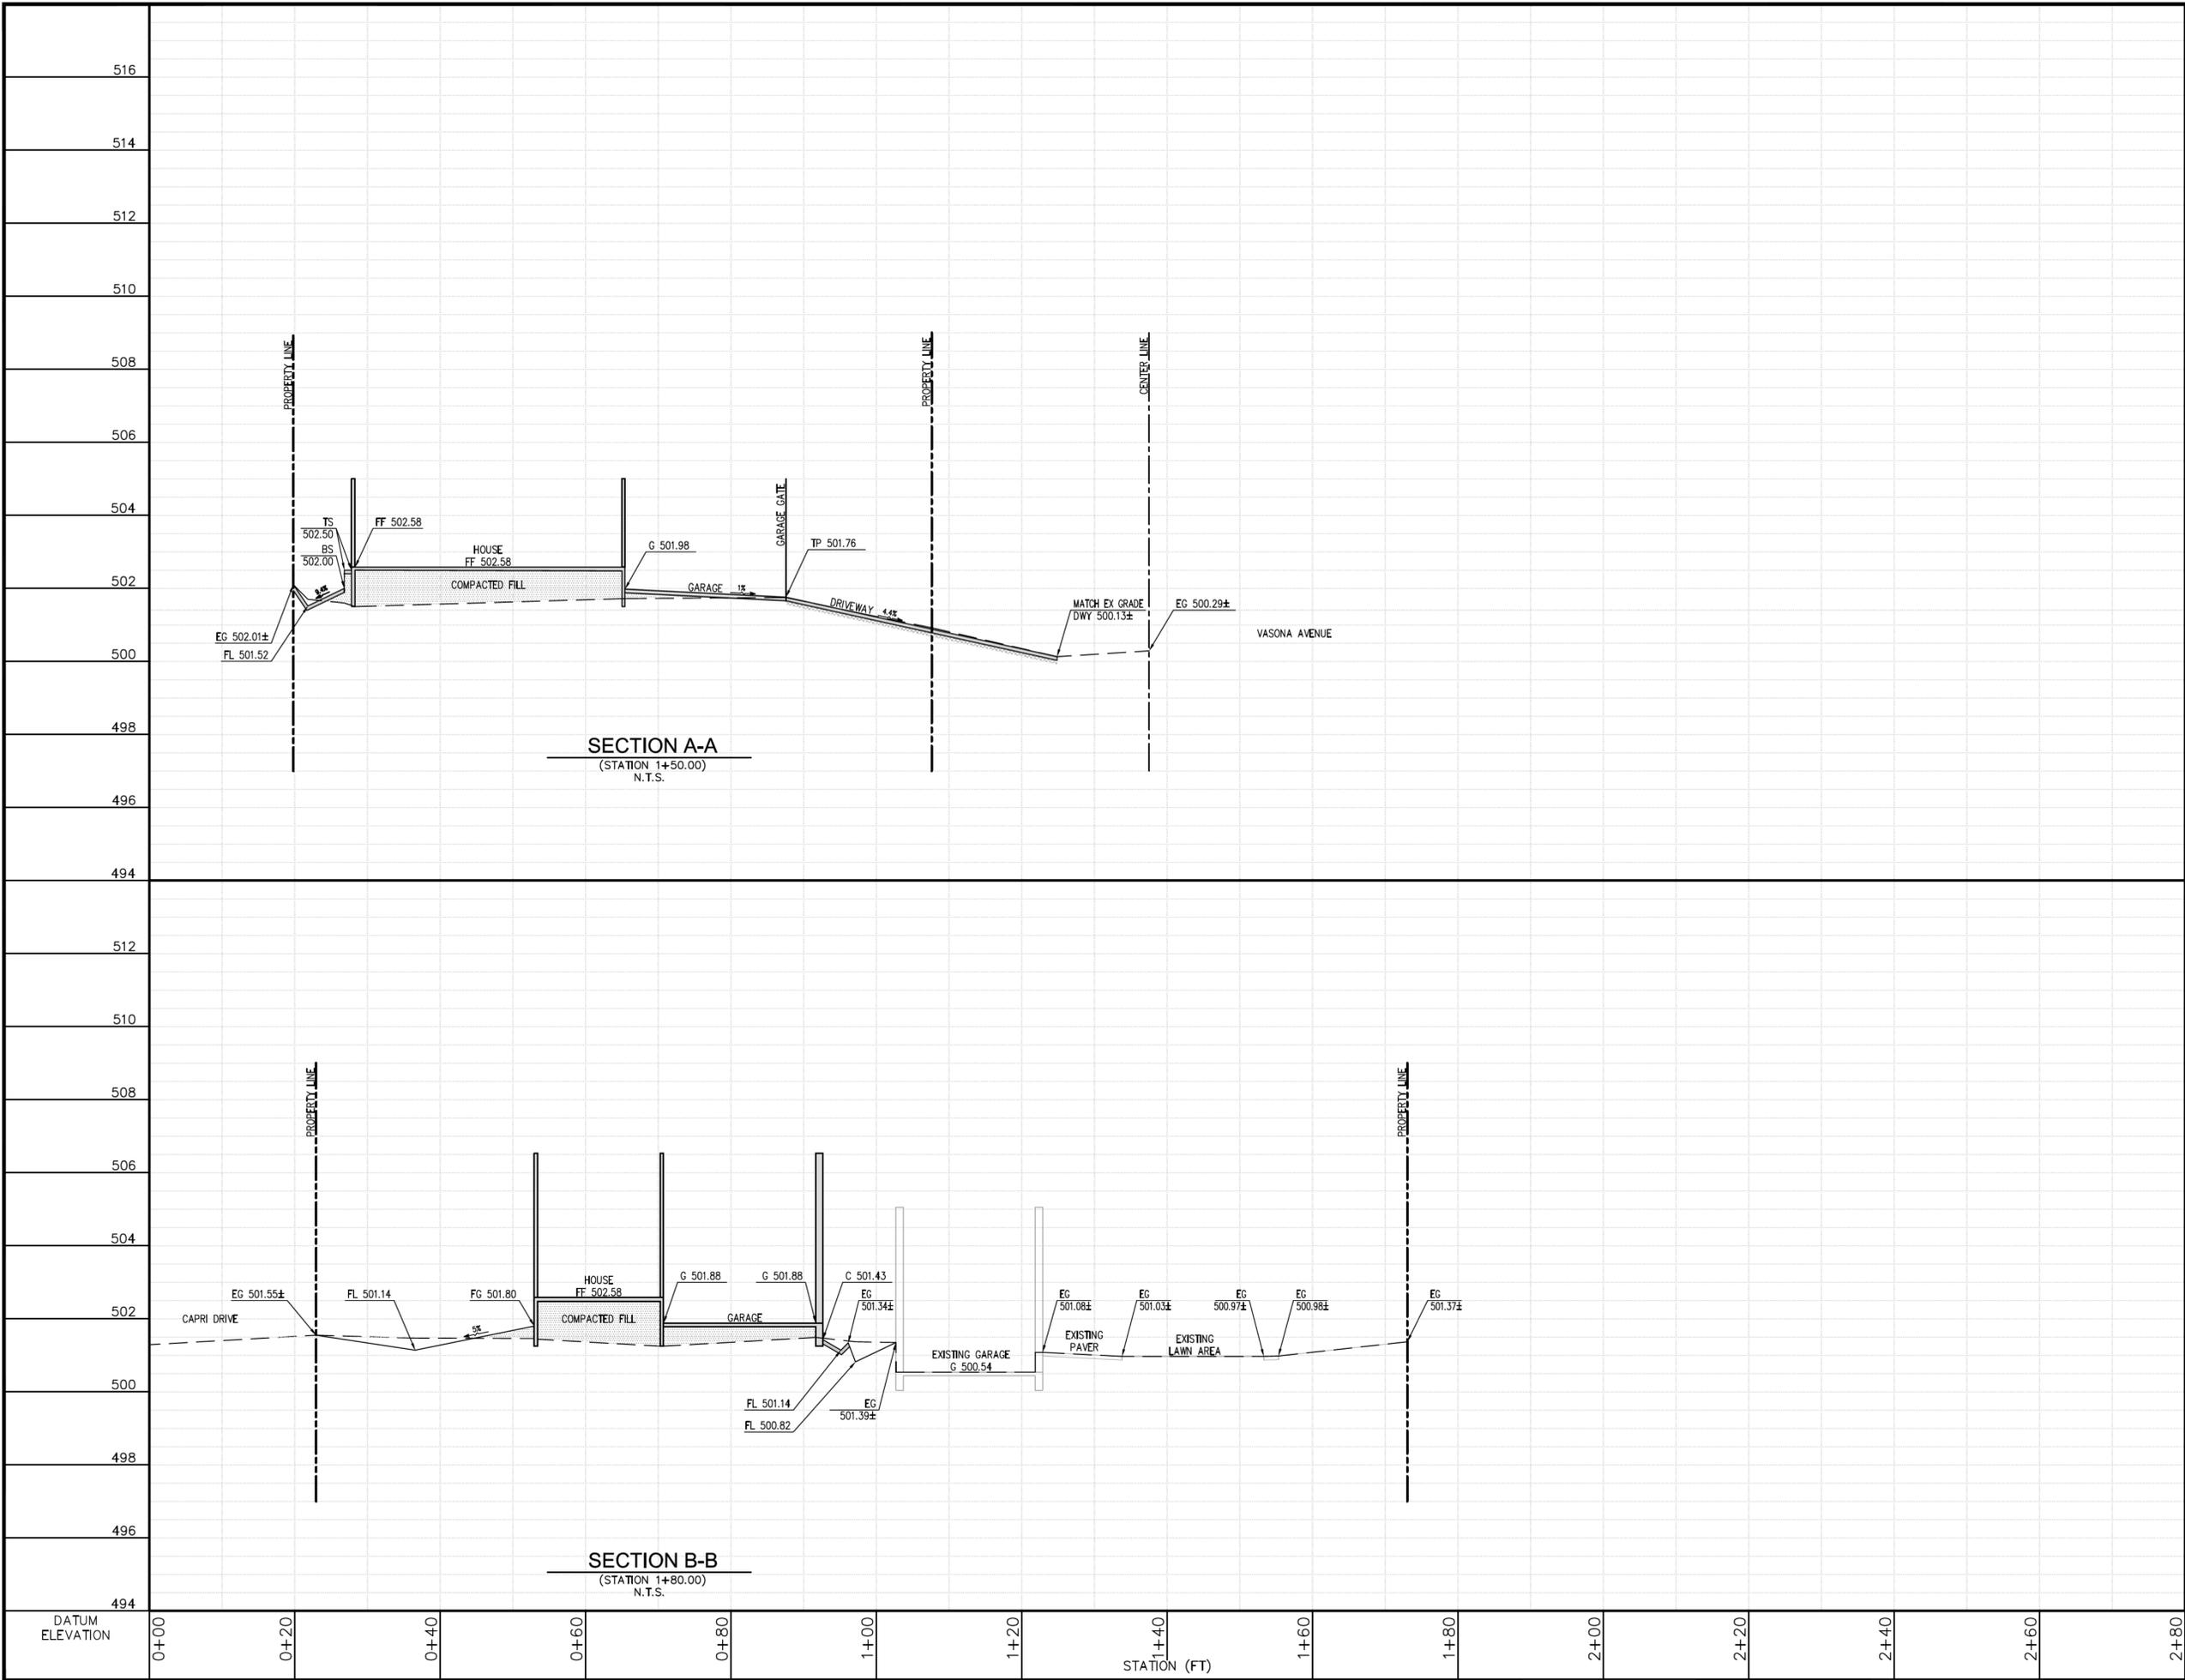


| | |
|-----------------|--------------|
| 516 | 516 |
| 514 | 514 |
| 512 | 512 |
| 510 | 510 |
| 508 | 508 |
| 506 | 506 |
| 504 | 504 |
| 502 | 502 |
| 500 | 500 |
| 498 | 498 |
| 496 | 496 |
| 494 | 494 |
| 512 | 512 |
| 510 | 510 |
| 508 | 508 |
| 506 | 506 |
| 504 | 504 |
| 502 | 502 |
| 500 | 500 |
| 498 | 498 |
| 496 | 496 |
| 494 | 494 |
| DATUM ELEVATION | 0+00 |
| | 0+20 |
| | 0+40 |
| | 0+60 |
| | 0+80 |
| | 1+00 |
| | 1+20 |
| | 1+40 |
| | 1+60 |
| | 1+80 |
| | 2+00 |
| | 2+20 |
| | 2+40 |
| | 2+60 |
| | 2+80 |
| | STATION (FT) |

| REV. | DATE | DESCRIPTION |
|------|----------|--|
| 1 | 10/31/24 | PER ENGINEERING DIV. REVIEW COMMENTS, 9/11/24 |
| 2 | 3/29/25 | PER PUBLIC WORKS AND PLANNING LATEST REVIEW COMMENTS |
| 3 | 5/10/25 | PER PUBLIC WORKS, BUILDING & PLANNING LATEST REVIEW COMMENTS |

GRADING CROSS SECTIONS
RESIDENCE
14331 CAPRI DRIVE
LOS GATOS, CA 95032

GREEN
 CIVIL ENGINEERING, INC
 INFO@GREEN-CE.COM
 1900 S. NORFOLK ST. SUITE #350
 SAN MATEO, CA 94403





SCALE
 VERTICAL: 1"= AS SHOWN
 HORIZONTAL: 1"= AS SHOWN

DATE: 02/01/2024
 DESIGNED: HCL
 DRAWN: BL
 REVIEWED: HCL
 JOB NO.: 20230050

SHEET
C1.1
 2 OF 7 SHEETS

PROFILE VIEW
 HORIZ: 1"=10'
 VERT: 1"=2'

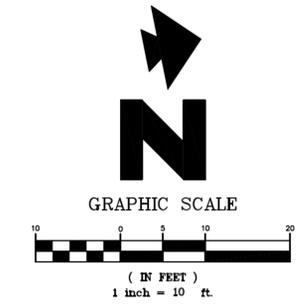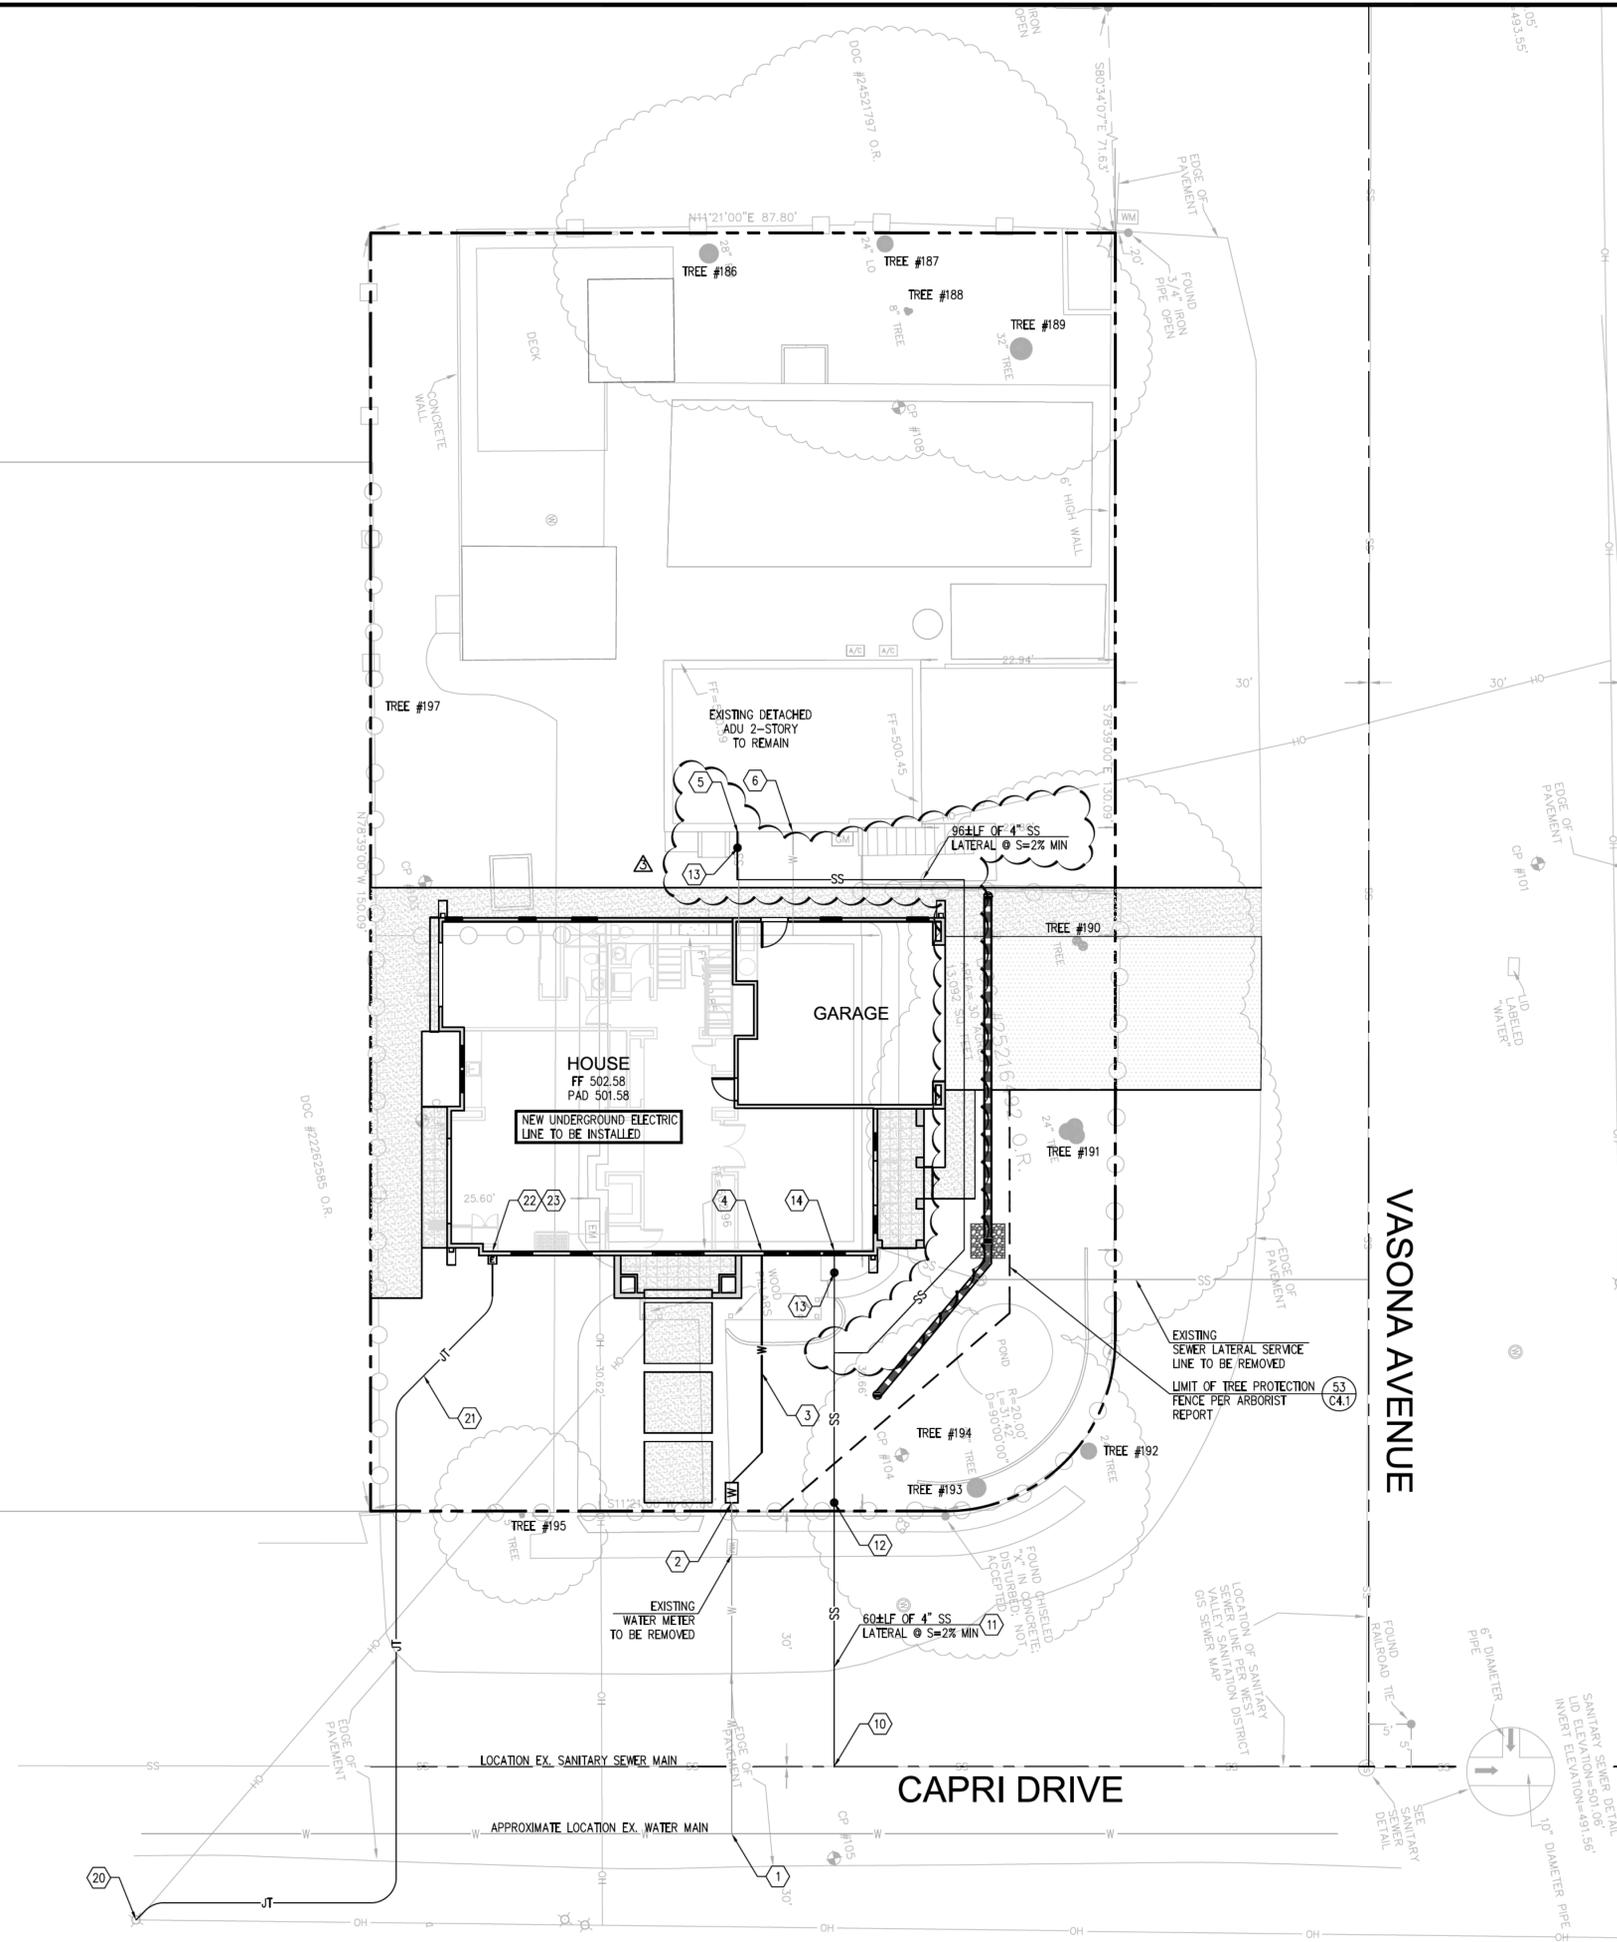

GENERAL NOTES:

- IF ANY EXISTING STRUCTURES/UTILITIES TO REMAIN ARE DAMAGED DURING CONSTRUCTION IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO REPAIR AND/OR REPLACE THE EXISTING STRUCTURE AS NECESSARY TO RETURN IT TO EXISTING CONDITIONS OR BETTER.
- CONTRACTOR SHALL PROTECT ALL PROPERTY CORNERS.
- CONTRACTOR SHALL COMPLY WITH ALL APPLICABLE GOVERNING CODES AND BE CONSTRUCTED TO SAME.
- CONTRACTOR SHALL ADJUST AND/OR CUT EXISTING PAVEMENT AS NECESSARY TO ASSURE A SMOOTH FIT AND CONTINUOUS GRADE.
- CONTRACTOR SHALL ASSURE POSITIVE DRAINAGE AWAY FROM BUILDING FOR ALL NATURAL AND PAVED AREAS.
- THE CONTRACTOR IS SPECIFICALLY CAUTIONED THAT THE LOCATION AND/OR ELEVATION OF EXISTING UTILITIES AS SHOWN ON THESE PLANS IS BASED ON RECORDS OF THE VARIOUS UTILITY COMPANIES, AND WHERE POSSIBLE, MEASUREMENTS TAKEN IN THE FIELD. THE INFORMATION IS NOT TO BE RELIED ON AS BEING EXACT OR COMPLETE. THE CONTRACTOR MUST CALL THE APPROPRIATE UTILITY COMPANIES AT LEAST 72 HOURS BEFORE ANY EXCAVATION TO REQUEST EXACT FIELD LOCATION OF UTILITIES. IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO RELOCATE UTILITIES WHICH CONFLICT WITH THE PROPOSED IMPROVEMENTS SHOWN ON THE PLANS.
- THE CONTRACTOR SHALL ADHERE TO ALL TERMS & CONDITIONS AS OUTLINED IN GENERAL N.P.D.E.S. PERMIT FOR STORMWATER DISCHARGE ASSOCIATED WITH CONSTRUCTION ACTIVITIES.
- UTILITY VAULTS, TRANSFORMERS, UTILITY CABINETS, CONCRETE BASES, OR OTHER STRUCTURES CANNOT BE PLACED OVER WATER MAINS/SERVICES. MAINTAIN 1' HORIZONTAL CLEAR SEPARATION FROM THE VAULTS, CABINETS & CONCRETE BASES TO EXISTING UTILITIES AS FOUND IN THE FIELD. IF THERE IS CONFLICT WITH EXISTING UTILITIES, CABINETS, VAULTS & BASES SHALL BE RELOCATED FROM THE PLAN LOCATION AS NEEDED TO MEET FIELD CONDITIONS. TREES MAY NOT BE PLANTED WITHIN 10' OF EXISTING WATER MAINS/SERVICES OR METERS. MAINTAIN 10' BETWEEN TREES AND WATER SERVICES, MAINS & METERS.
- UTILITY INSTALLATION IF ANY SHALL BE IN ACCORDANCE WITH TOWN OF LOS GATOS OR LOCAL UTILITIES AGENCIES STANDARDS.
- CONTRACTOR SHALL REFER TO ARCH. PLANS FOR EXACT LOCATIONS OF UTILITIES SERVICES TO NEW BUILDING. COORDINATE WITH LOCAL UTILITIES COMPANIES FOR SERVICE CONNECTIONS.

LEGEND

| | | | |
|------|-----------------------|-----|--|
| --- | PROPERTY LINE | ● | STORM/SEWER CLEANOUT |
| —G— | GAS LINE | ■ | INFILTRATION DEVICE |
| —G— | EX. GAS LINE | ● | AREA INLET OR POP UP DRAIN |
| —SS— | EX. SEWER LINE | --- | TREE PROTECTION FENCING PER ARBORIST REPORT PAGE 15 OF 28 |
| —W— | EX. WATER LINE | --- | TREE # (TO BE PROTECTED PER ARBORIST REPORT PAGE 15 OF 28) |
| —W— | NEW WATER LINE | --- | ABBREVIATIONS: EX = EXISTING LF = LINEAL FOOT S = SLOPE |
| --- | STORM DRAIN PIPE | | |
| --- | NEW 4" SEWER LATERAL | | |
| —JT— | PROPOSED JOINT TRENCH | | |


UTILITY NOTES

- EXISTING WATER SERVICE LINE TO EXISTING WATER MAIN TO REMAIN
- INSTALL NEW WATER METER WITHIN THE PROPERTY LINE
- WATER SERVICE TO BUILDING
- WATER SERVICE POINT OF ENTRY. SEE ARCH PLANS FOR EXACT LOCATION
- NEW SEWER CONNECTION AND MATCH EXISTING SEWER SERVICE POINT OF CONNECTION FOR ADU. CONTRACTOR TO VERIFY EXACT LOCATION
- EXISTING WATER SERVICE FOR ADU. CONTRACTOR TO VERIFY EXACT LOCATION
- CONNECTION TO EXISTING SEWER MAIN; MATCH EXISTING INVERT ELEVATION
- CONNECTION TO EXISTING SEWER MAIN; NEW 4" SEWER LATERAL @ 2% MINIMUM SLOPE TO BUILDING PER WEST VALLEY SANITATION DISTRICT OF SANTA CLARA DRAWING #15 AS SHOWN ON SHEET C4.0
- NEW SANITARY SEWER CLEANOUT 1' MAXIMUM BEHIND PROPERTY LINE PER WEST VALLEY SANITATION DISTRICT OF SANTA CLARA COUNTY DRAWING #3 AS SHOWN ON SHEET C4.0
- INSTALL SANITARY SEWER CLEANOUT WITH BACKFLOW PREVENTION DEVICE PER TOWN OF LOS GATOS ORDANANCE. PLACE CLEANOUT MINIMUM 2' OUTSIDE OF BUILDING FOUNDATION
- 4" SANITARY SEWER SERVICE ENTRY TO BUILDING. SEE ARCH PLANS FOR EXACT LOCATION AND LINE CONTINUATION TO BUILDING
- CONNECTION TO EXISTING ELECTRICAL LINE. CONTRACTOR SHALL COORDINATE WITH LOCAL UTILITY AGENCY PRIOR ANY CONSTRUCTION.
- JOINT TRENCH (ELECTRIC, TELECOMMUNICATION & CABLE TV SERVICE LINES) TO NEW BUILDING. CONTRACTOR SHALL COORDINATE WITH LOCAL UTILITY AGENCY PRIOR TO INSTALLATION.
- ELECTRICAL METER. SEE ARCH PLANS FOR EXACT LOCATION.
- ELECTRICAL, TELECOMMUNICATION AND CABLE TV SERVICES POINT OF ENTRY TO BUILDING. SEE ARCH PLANS FOR EXACT LOCATIONS

| REV. | DATE | DESCRIPTION |
|------|----------|--|
| Δ | 10/31/24 | PER ENGINEERING DIV REVIEW COMMENTS, 9/11/24 |
| Δ | 3/29/25 | PER PUBLIC WORKS AND PLANNING LATEST REVIEW COMMENTS |
| Δ | 5/10/25 | PER PUBLIC WORKS, BUILDING & PLANNING LATEST REVIEW COMMENTS |

UTILITY PLAN
RESIDENCE
14331 CAPRI DRIVE
LOS GATOS, CA 95032



GREEN
CIVIL ENGINEERING, INC
INFO@GREEN-CE.COM
1900 S. NORFOLK ST. SUITE #350
SAN MATEO, CA 94403



SCALE
VERTICAL: 1"= AS SHOWN
HORIZONTAL: 1"= AS SHOWN

DATE: 02/01/2024
DESIGNED: HCL
DRAWN: BL
REVIEWED: HCL
JOB NO.: 20230050

SHEET
C2
3 OF 7 SHEETS

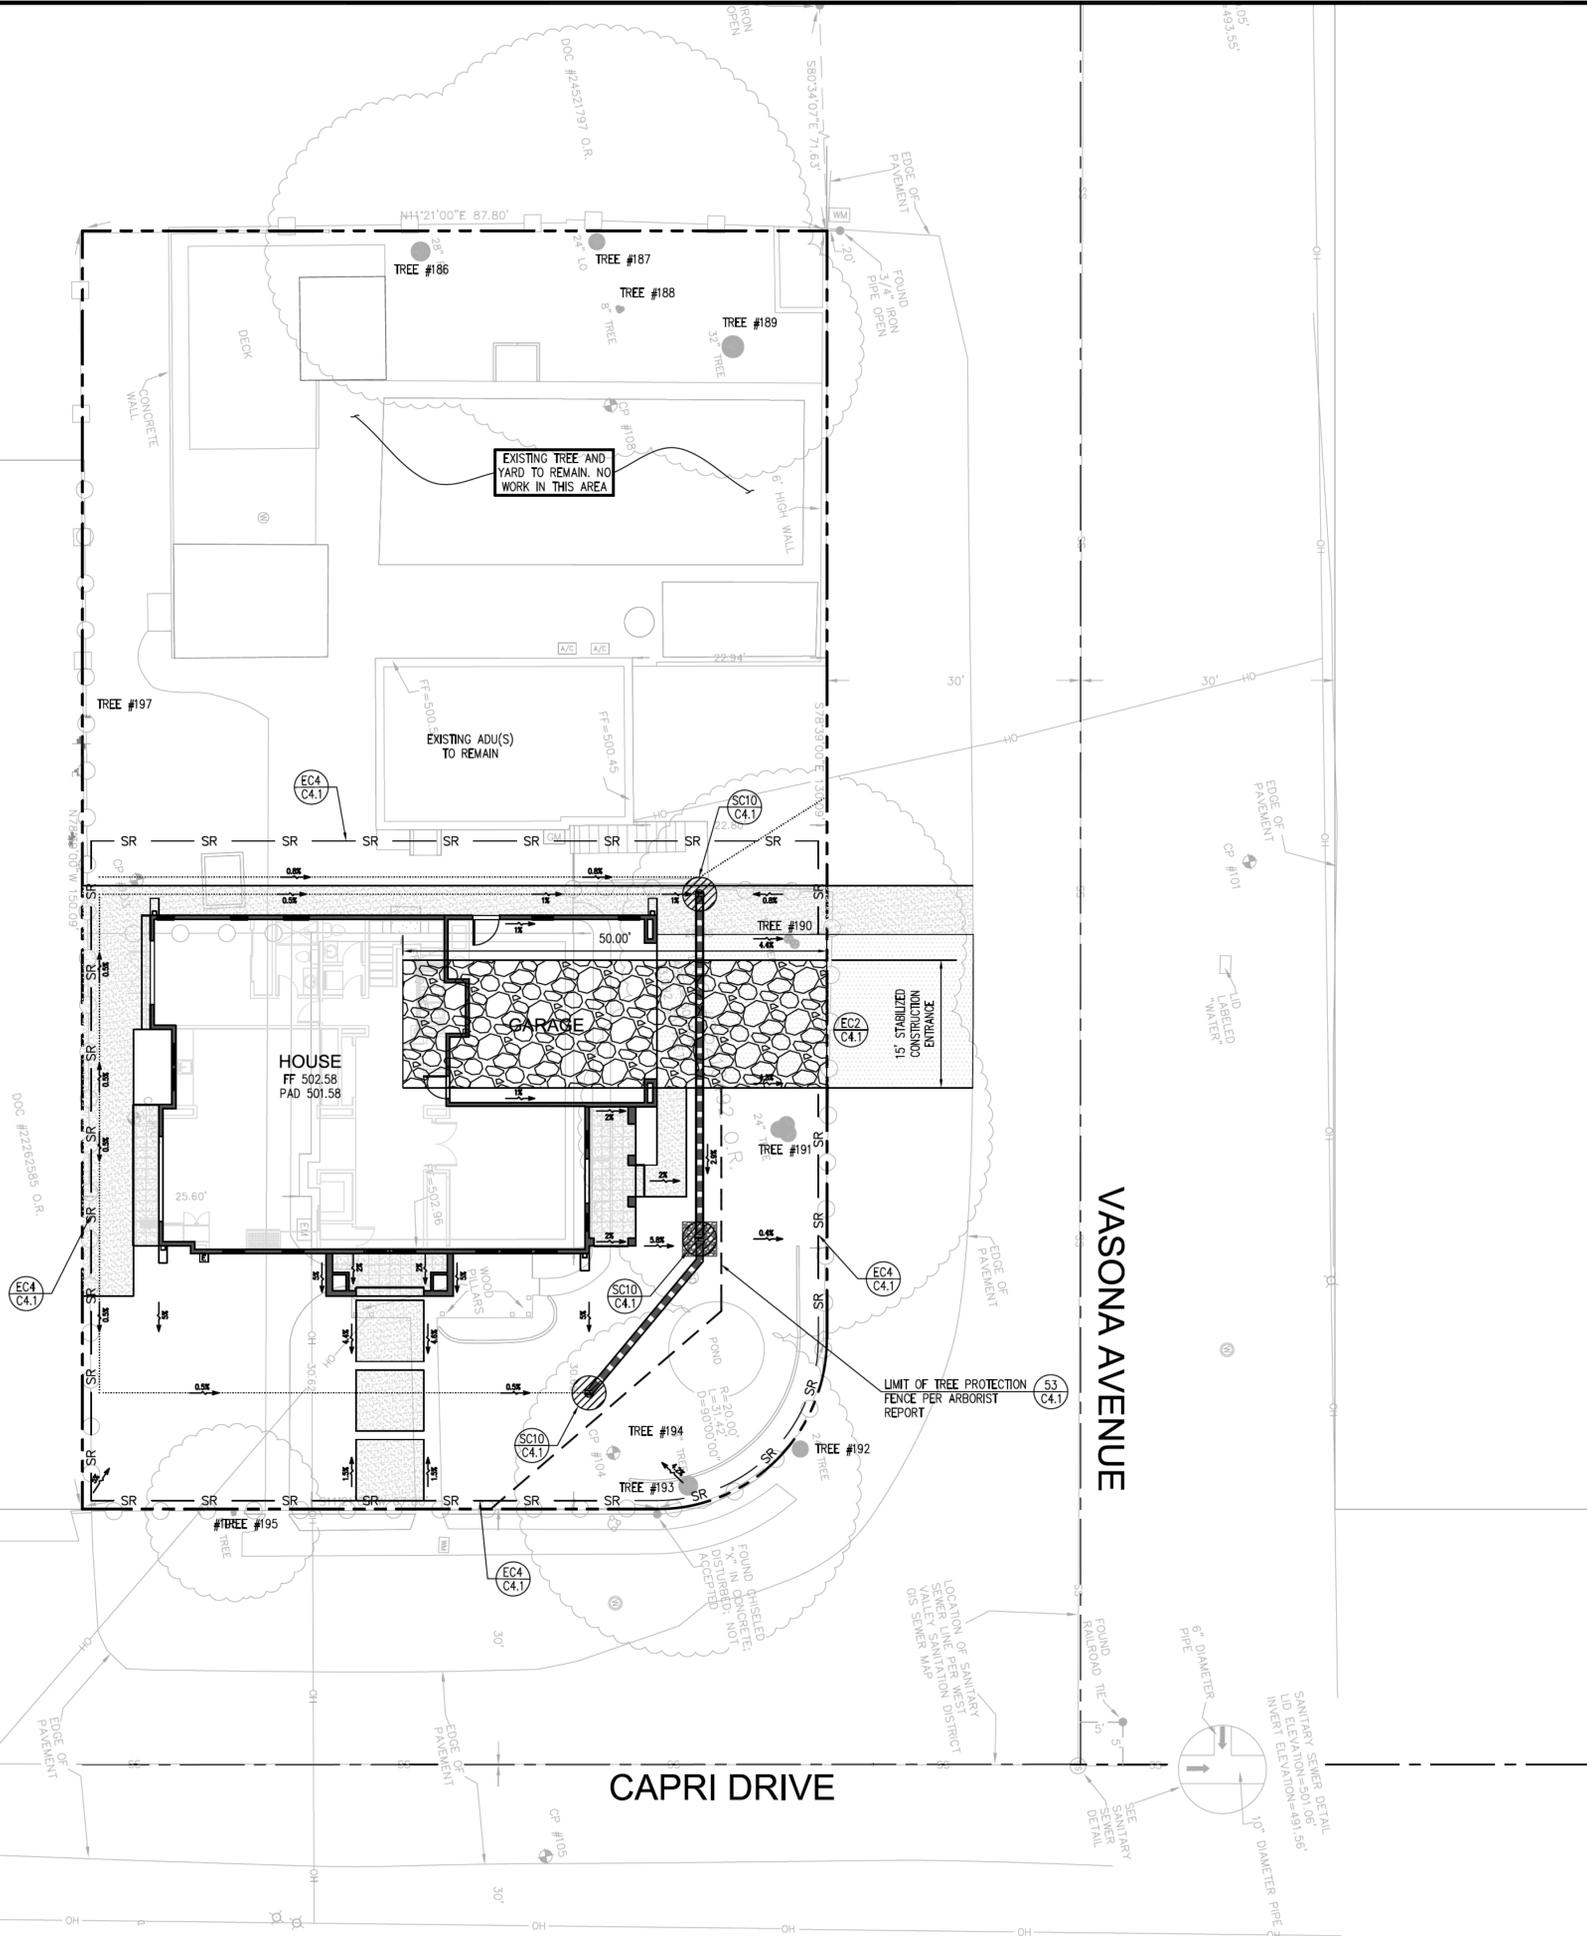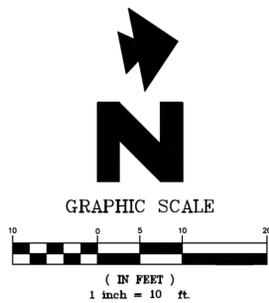

EROSION AND SEDIMENT CONTROL NOTES & MEASURES:

1. THE FACILITIES SHOWN ON THIS PLAN ARE DESIGNED TO CONTROL EROSION AND SEDIMENT DURING THE RAINY SEASON, OCTOBER 1 TO APRIL 30. FACILITIES ARE TO BE OPERABLE PRIOR TO OCTOBER 1 OF ANY YEAR. GRADING OPERATIONS DURING THE RAINY SEASON, WHICH LEAVE DENUDED SLOPES SHALL BE PROTECTED WITH EROSION CONTROL MEASURES IMMEDIATELY FOLLOWING GRADING ON THE SLOPES.
2. THIS PLAN COVERS ONLY THE FIRST WINTER FOLLOWING GRADING WITH ASSUMED SITE CONDITIONS AS SHOWN ON THE EROSION CONTROL PLAN. PRIOR TO SEPTEMBER 15, THE COMPLETION OF SITE IMPROVEMENT SHALL BE EVALUATED AND REVISIONS MADE TO THIS PLAN AS NECESSARY WITH THE APPROVAL OF THE TOWN ENGINEER.
3. IF HYDROSEEDING IS NOT USED, THEN OTHER METHODS SHALL BE IMPLEMENTED, SUCH AS EROSION CONTROL BLANKETS, OR A THREE-STEP APPLICATION OF: 1) SEED, MULCH, FERTILIZER 2) BLOWN STRAW 3) TACKIFIER AND MULCH. CONTACT TOWN OF PORTOLA VALLEY FOR APPROVED SEED MIX. UTILIZE EROSION FABRIC ON DISTURBED SLOPES GREATER THAN 2:1.
4. DURING WINTER MONTHS, ALL DISTURBED SLOPES GREATER THAN 2:1 SHALL HAVE MANDATORY EROSION CONTROL FABRIC.
5. INLET PROTECTION SHALL BE INSTALLED AT OPEN INLETS TO PREVENT SEDIMENT FROM ENTERING THE STORM DRAIN SYSTEM. INLETS NOT USED IN CONJUNCTION WITH EROSION CONTROL ARE TO BE BLOCKED TO PREVENT ENTRY OF SEDIMENT.
6. THIS EROSION AND SEDIMENT CONTROL PLAN MAY NOT COVER ALL THE SITUATIONS THAT MAY ARISE DURING CONSTRUCTION DUE TO UNANTICIPATED FIELD CONDITIONS. VARIATIONS AND ADDITIONS MAY BE MADE TO THIS PLAN IN THE FIELD. NOTIFY THE TOWN REPRESENTATIVE OF ANY FIELD CHANGES.
7. THIS PLAN IS INTENDED TO BE USED FOR INTERIM EROSION AND SEDIMENT CONTROL ONLY AND IS NOT TO BE USED FOR FINAL ELEVATIONS OR PERMANENT IMPROVEMENTS OF FUTURE CONSTRUCTION.
8. CONTRACTOR SHALL BE RESPONSIBLE FOR MONITORING EROSION AND SEDIMENT CONTROL PRIOR, DURING, AND AFTER STORM EVENTS.
9. REASONABLE CARE SHALL BE TAKEN WHEN HAULING ANY EARTH, SAND, GRAVEL, STONE, DEBRIS, PAPER OR ANY OTHER SUBSTANCE OVER ANY PUBLIC STREET, ALLEY OR OTHER PUBLIC PLACE. SHOULD ANY BLOW, SPILL, OR TRACK OVER AND UPON SAID PUBLIC OR ADJACENT PRIVATE PROPERTY, IMMEDIATE REMEDY SHALL OCCUR.
10. SANITARY FACILITIES SHALL BE MAINTAINED ON THE SITE.
11. DURING THE RAINY SEASON, ALL PAVED AREAS SHALL BE KEPT CLEAR OF EARTH MATERIAL AND DEBRIS. THE SITE SHALL BE MAINTAINED SO AS TO MINIMIZE SEDIMENT LADEN RUNOFF TO ANY STORM DRAINAGE SYSTEMS, INCLUDING EXISTING DRAINAGE SWALES AND WATER COURSES.
12. DEMOLITION OPERATIONS SHALL BE CARRIED OUT IN SUCH A MANNER THAT EROSION AND WATER POLLUTION WILL BE MINIMIZED. STATE AND LOCAL LAWS CONCERNING POLLUTION ABATEMENT SHALL BE COMPLIED WITH.
13. CONTRACTORS SHALL PROVIDE DUST CONTROL AS REQUIRED BY THE APPROPRIATE FEDERAL, STATE, AND LOCAL AGENCY REQUIREMENTS.
14. WITH THE APPROVAL OF THE TOWN INSPECTOR, EROSION AND SEDIMENT CONTROLS MAYBE REMOVED AFTER AREAS ABOVE THEM HAVE BEEN STABILIZED.
15. ALL TRUCKS TRANSPORTING MATERIALS TO AND FROM THE SITE SHALL BE COVERED.

MAINTENANCE NOTES:

1. MAINTENANCE IS TO BE PERFORMED AS FOLLOWS:
 - A. REPAIR DAMAGES CAUSED BY SOIL EROSION OR CONSTRUCTION AT THE END OF EACH WORKING DAY.
 - B. SWALES SHALL BE INSPECTED PERIODICALLY AND MAINTAINED AS NEEDED.
 - C. SEDIMENT TRAPS, BERMS, AND SWALES ARE TO BE INSPECTED AFTER EACH STORM AND REPAIRS MADE AS NEEDED.
 - D. SEDIMENT SHALL BE REMOVED AND SEDIMENT TRAPS RESTORED TO ITS ORIGINAL DIMENSIONS WHEN SEDIMENT HAS ACCUMULATED TO A DEPTH OF ONE FOOT.
 - E. SEDIMENT REMOVED FROM TRAP SHALL BE DEPOSITED IN A SUITABLE AREA AND IN SUCH A MANNER THAT IT WILL NOT ERODE.
 - F. RILLS AND GULLIES MUST BE REPAIRED.

DEMOLITION NOTES:

1. THE EXISTING BUILDING SHALL BE REMOVED ENTIRELY. NO GRADING REQUIRED BEYOND REPAIR AT FOUNDATION REMOVAL AREAS.
2. LOCATE AND MARK ALL UNDERGROUND UTILITIES. THE UTILITIES SHALL BE TREATED AS FOLLOWS:

WATER SERVICE

- A. EXISTING WATER SHALL BE CAPPED AND REMOVED IF NECESSARY FOR NEW CONSTRUCTION.

ELECTRICAL SERVICE

- A. ELECTRICAL LINE SHALL BE PROTECTED IN PLACE.

GAS SERVICE

- A. GAS LINE SHALL BE PROTECTED IN PLACE.

LEGEND

| | |
|--|--|
| | 50' X 15' STABILIZED CONSTRUCTION ENTRANCE PER TOWN OF LOS GATOS STANDARD DETAIL; (S2A C4.1) |
| | STRAW ROLL (50 C4.1) |
| | TREE PROTECTION PER ARBORIST REPORT PAGE 15 OF 28; ALL TREE PROTECTION FENCING SHALL BE CHAIN LINK AND A MINIMUM OF 6' IN HEIGHT WITH POSTS DRIVEN INTO THE GROUND (53 C4.1) |
| | INLET PROTECTION (SC10 C4.1) |
| | TREE #190 TREE # (TO BE PROTECTED PER ARBORIST REPORT PAGE 15 OF 28) |

EROSION CONTROL POINT OF CONTACT:
 NAME: CHIN HANG WONG
 TITLE/QUALIFICATION: PE, QSD
 PHONE: (650) 931-2514
 PHONE:
 E-MAIL: awong@green-ce.com

| REV. | DATE | DESCRIPTION |
|------|----------|--|
| Δ | 10/31/24 | PER ENGINEERING DIV REVIEW COMMENTS, 9/11/24 |
| Δ | 3/29/25 | PER PUBLIC WORKS AND PLANNING LATEST REVIEW COMMENTS |
| Δ | 5/10/25 | PER PUBLIC WORKS, BUILDING & PLANNING LATEST REVIEW COMMENTS |

EROSION CONTROL PLAN
RESIDENCE
14331 CAPRI DRIVE
LOS GATOS, CA 95032



GREEN
 CIVIL ENGINEERING, INC
 INFO@GREEN-CE.COM
 1900 S. NORFOLK ST. SUITE #350
 SAN MATEO, CA 94403



SCALE
 VERTICAL: 1"= AS SHOWN
 HORIZONTAL: 1"= AS SHOWN

| | |
|-----------|------------|
| DATE: | 02/01/2024 |
| DESIGNED: | HCL |
| DRAWN: | BL |
| REVIEWED: | HCL |
| JOB NO.: | 20230050 |

SHEET
C3
 4 OF 7 SHEETS

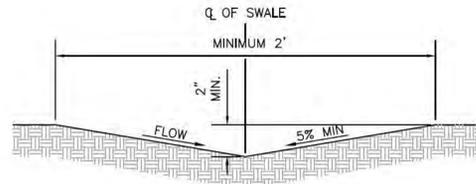
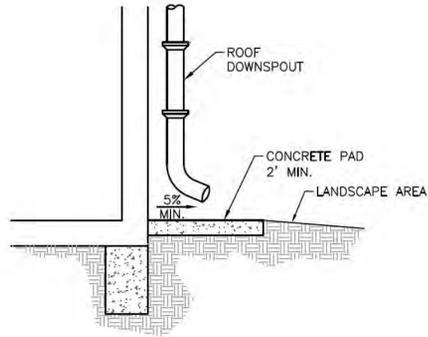


1A CONCRETE SPLASH PAD

N.T.S.


2A TYPICAL SWALE DETAIL

N.T.S.

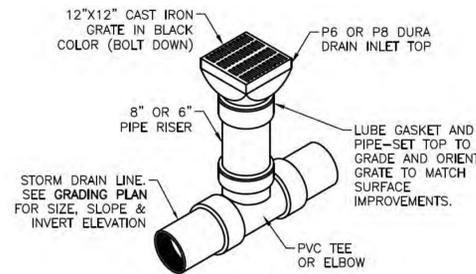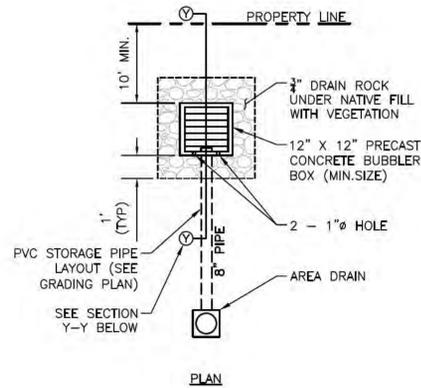

3A 12"X12" LANDSCAPE AREA DRAIN

N.T.S.

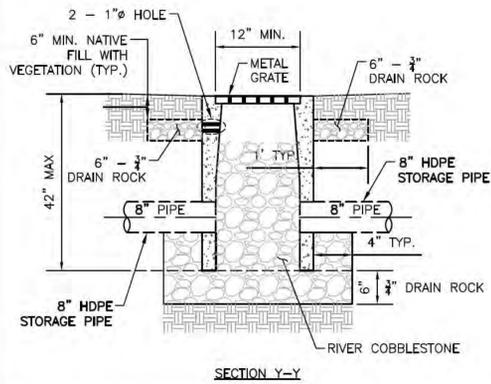


5B INFILTRATION DEVICE

N.T.S.


11 TRENCH DETAIL

N.T.S.

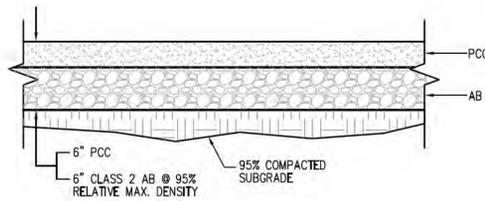

20 DRIVEWAY CONCRETE PAVEMENT SECTION

N.T.S.

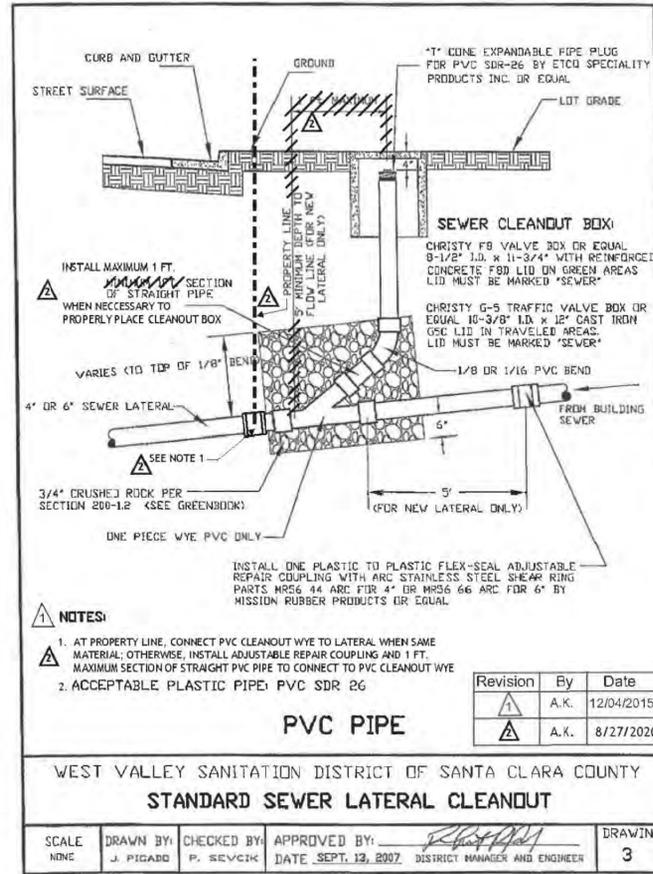


PVC PIPE

| Revision | By | Date |
|----------|------|------------|
| 1 | A.K. | 12/04/2015 |
| 2 | A.K. | 8/27/2020 |

WEST VALLEY SANITATION DISTRICT OF SANTA CLARA COUNTY
STANDARD SEWER LATERAL CLEANOUT

| | | | | |
|-------|-----------|------------|--|---------|
| SCALE | DRAWN BY | CHECKED BY | APPROVED BY: | DRAWING |
| NONE | J. PICADO | P. SEVCIK | DATE SEPT. 13, 2007. DISTRICT MANAGER AND ENGINEER | 3 |

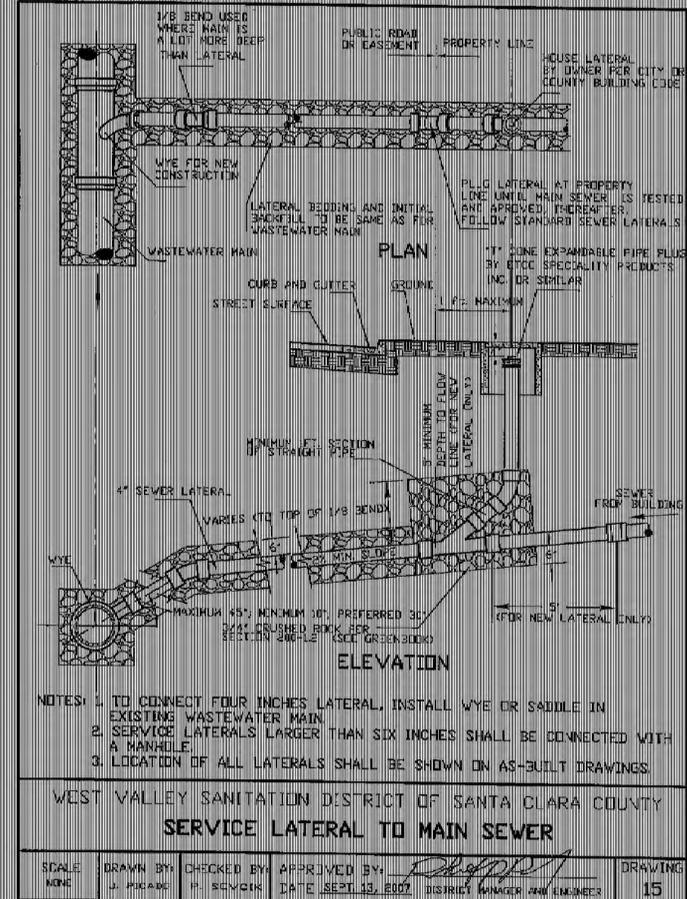

WEST VALLEY SANITATION DISTRICT OF SANTA CLARA COUNTY
SERVICE LATERAL TO MAIN SEWER

| | | | | |
|-------|-----------|------------|--|---------|
| SCALE | DRAWN BY | CHECKED BY | APPROVED BY: | DRAWING |
| NONE | J. PICADO | P. SEVCIK | DATE SEPT. 13, 2007. DISTRICT MANAGER AND ENGINEER | 15 |

| REV. | DATE | DESCRIPTION |
|------|----------|--|
| 1 | 10/31/24 | PER ENGINEERING DIV. REVIEW COMMENTS, 9/11/24 |
| 2 | 3/29/25 | PER PUBLIC WORKS AND PLANNING LATEST REVIEW COMMENTS |
| 3 | 5/10/25 | PER PUBLIC WORKS, BUILDING & PLANNING LATEST REVIEW COMMENTS |

DETAIL SHEET
RESIDENCE
14331 CAPRI DRIVE
LOS GATOS, CA 95032

GREEN
CIVIL ENGINEERING, INC.
INFO@GREEN-CE.COM
1900 S. NORFOLK ST., SUITE #350
SAN MATEO, CA 94403



SCALE
VERTICAL: 1"= AS SHOWN
HORIZONTAL: 1"= AS SHOWN

DATE: 02/01/2024



DESIGNED: HCL

DRAWN: BL

REVIEWED: HCL

JOB NO.: 20230050


SHEET
C4.0
5 OF 7 SHEETS

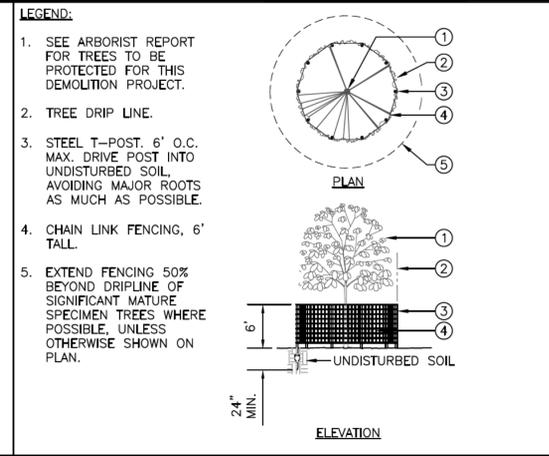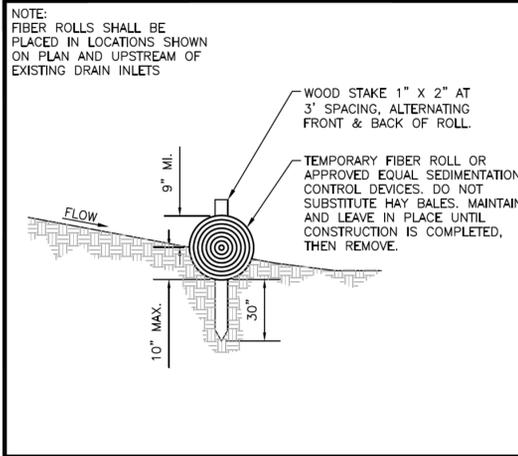

| | | | | | |
|----|------------|--------|----|-------------------------|--------|
| 50 | STRAW ROLL | N.T.S. | 53 | TREE PROTECTION FENCING | N.T.S. |
|----|------------|--------|----|-------------------------|--------|

Storm Drain Inlet Protection

SC-10

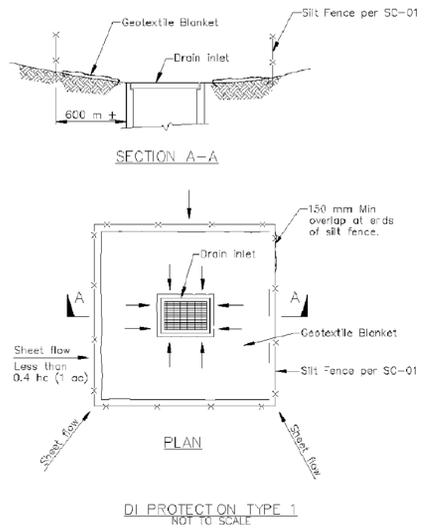


- NOTES:
- For use in areas where grading has been completed and final soil stabilization and seeding are pending.
 - Not applicable in paved areas.
 - Not applicable with concentrated flows.

Caltrans Storm Water Quality Handbooks
Construction Site Best Management Practices Manual
March 1, 2015

Section 4
Storm Drain Inlet Protection SC-10
4 of 7

| PROJECT SIZE | LENGTH OF | |
|--------------|--------------|-----|
| | CRUSHED ROCK | ATB |
| ≤ 1/4 ACRE | 30 | 0 |
| ≤ 1 ACRE | 50 | 0 |
| < 3 ACRE | 100 | 0 |
| > 3 ACRE | 100 | 50 |

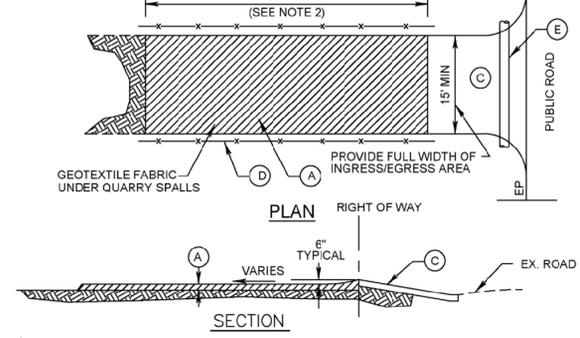

- (A) 4" CRUSHED ROCK WITH GEOTEXTILE MATERIAL UNDERNEATH.
- (B) THE MINIMUM LENGTH SHALL BE LENGTHENED AS NECESSARY TO ENSURE MATERIAL IS NOT TRACKED INTO THE PUBLIC RIGHT-OF-WAY. ALTERNATE CONSTRUCTION ENTRANCES WILL BE ALLOWED WITH APPROVAL OF THE CITY ENGINEER ON A CASE BY CASE BASIS, WHERE PHYSICAL CONDITIONS AND SIZE DICTATE.
- (C) AT DRIVEWAY RAMP, OR SITE ACCESS ROAD 20' WIDE MIN. SEE TABLE ABOVE FOR REQUIRED LENGTH.
- (D) INSTALL ORANGE BARRIER FENCE TO DIRECT TRAFFIC ONTO CONSTRUCTION ENTRANCE.
- (E) INSTALL 12" MIN. DIA. CULVERT IF A ROADSIDE DITCH IS PRESENT.

- NOTES:
- SURFACE WATER - ALL SURFACE WATER FLOWING OR DIVERTED TOWARD CONSTRUCTION ENTRANCES SHALL BE PIPED ACROSS THE ENTRANCE IF PIPING IS IMPRACTICAL, A MOUNTABLE BERM WITH 5:1 SLOPES WILL BE PERMITTED.
 - MAINTENANCE - THE ENTRANCE SHALL BE MAINTAINED IN A CONDITION WHICH WILL PREVENT TRACKING OR FLOWING OF SEDIMENT ONTO PUBLIC RIGHT-OF-WAY. THIS MAY REQUIRE PERIODIC TOP DRESSINGS AND REPAIR AND/OR CLEANOUT OF ANY MEASURES USED TO TRAP SEDIMENT. ALL SEDIMENT SPILLED, DROPPED, WASHED OR TRACKED ONTO PUBLIC RIGHT-OF-WAY MUST BE REMOVED IMMEDIATELY.
 - WHEELS SHALL BE CLEANED TO REMOVE SEDIMENT PRIOR TO ENTRANCE ONTO PUBLIC RIGHT-OF-WAY. WHEN WASHING IS USED, IT SHALL BE DONE ON AN AREA STABILIZED WITH STONE AND WHICH DRAINS INTO AN APPROVED SEDIMENT TRAPPING DEVICE.
 - PERIODIC INSPECTION AND NEEDED MAINTENANCE SHALL BE PROVIDED AFTER EACH RAIN.

| | | | | | | |
|-------------|------|---------------|---------------|----------------------------------|---------------|--------|
| APPROVED BY | DATE | TOWN ENGINEER | NOVEMBER 2010 | STABILIZED CONSTRUCTION ENTRANCE | STD. PLAN NO. | ST-250 |
|-------------|------|---------------|---------------|----------------------------------|---------------|--------|

T:\GIS\PPW\TLC\GENERAL\Standard Details\ST-250.dwg

STABILIZED CONSTRUCTION ENTRANCE (S2A) (C4.1)
N.T.S.

| REV. | DATE | DESCRIPTION |
|------|----------|--|
| 1 | 10/31/24 | PER ENGINEERING DIV. REVIEW COMMENTS, 9/11/24 |
| 2 | 3/29/25 | PER PUBLIC WORKS AND PLANNING LATEST REVIEW COMMENTS |
| 3 | 5/10/25 | PER PUBLIC WORKS, BUILDING & PLANNING LATEST REVIEW COMMENTS |

DETAIL SHEET
RESIDENCE
14331 CAPRI DRIVE
LOS GATOS, CA 95032

GREEN
CIVIL ENGINEERING, INC
INFO@GREEN-CE.COM
1900 S. NORFOLK ST. SUITE #350
SAN MATEO, CA 94403



SCALE

VERTICAL: 1"= AS SHOWN
HORIZONTAL: 1"= AS SHOWN

DATE: 02/01/2024

DESIGNED: HCL

DRAWN: BL

REVIEWED: HCL


JOB NO.: 20230050

SHEET
C4.1
6 OF 7 SHEETS

Construction Best Management Practices (BMPs)

Construction projects are required to implement year-round stormwater BMPs.

Materials, Waste, and Sediment Management

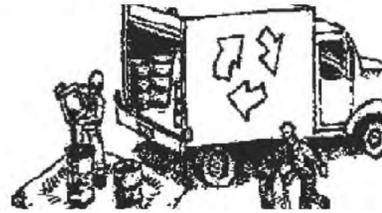

Construction Entrances and Perimeter

- Establish and maintain effective perimeter controls, and stabilize all construction entrances and exits to sufficiently control erosion, sediment discharges and tracking of sediment offsite.
- Sweep or vacuum immediately any tracking of sediment offsite and secure sediment source to prevent further tracking. Never hose down streets or sidewalks.

Non-Hazardous Materials and Dust Control

- Berm and cover stockpiles of sand, dirt or other construction material with tarps when rain is forecast or when they are not in use. Weigh down and secure tarps for wind protection.
- Keep materials off the ground (e.g., store bagged materials on wood pallets, store loose materials on tarps not pavement, etc.).
- Use captured water from other activities (e.g., testing fire lines) for dust control.
- Ensure dust control water doesn't leave site or discharge to storm drains. Only use enough to control dust. Contain and dispose of excess water properly.

Hazardous Materials

- Label all hazardous materials and hazardous wastes (such as pesticides, paints, thinners, solvents, fuel, oil, and antifreeze) in accordance with City, County, State and Federal regulations.
- Store hazardous materials and wastes in watertight containers, store in appropriate secondary containment, and cover them at the end of every workday, during wet weather or when rain is forecast.
- Follow manufacturer's application instructions for hazardous materials and do not use more than necessary. Do not apply chemicals outdoors when rain is forecast within 24 hours.
- Arrange for appropriate disposal of all hazardous wastes. Have all pertinent Safety Data Sheets (i.e., SDS/MSDS/PSDS) onsite.

Waste Management

- Inform trash-hauling contractors that you will accept only watertight dumpsters for onsite use. Repair/replace any dumpster that is not watertight or leaking.
- Cover and maintain dumpsters. Check frequently for leaks. Place dumpsters under roofs or cover with tarps or plastic sheeting secured around the outside of the dumpster. If the dumpster leaks, place a plastic liner underneath the dumpster to collect leaks. Never clean out a dumpster by hosing it down on the construction site – clean with dry methods, clean offsite or replace dumpster.
- Place portable toilets and hand wash stations away from storm drains. Make sure they are equipped with containment pans (secondary containment) and are in good working order. Check frequently for leaks.
- Dispose of all wastes and demolition debris properly per SDS and applicable regulations. Recycle or compost materials and wastes as feasible and appropriate, including solvents, water-based paints, vehicle fluids, broken asphalt and concrete, wood, and cleared vegetation.
- Dispose of liquid residues from paints, thinners, solvents, glues, and cleaning fluids as hazardous waste per SDS.
- Keep site free of litter (e.g., lunch items, water bottles, cigarette butts and plastic packaging).
- Prevent litter from uncovered loads by covering loads that are being transported to and from site.

Equipment Management & Spill Control




Vehicle and Equipment Maintenance

- Designate an area of the construction site equipped with appropriate BMPs, well away from creeks or storm drain inlets, for auto and equipment parking and storage.
- Perform major maintenance, repair jobs, and vehicle/equipment washing offsite.
- If refueling or vehicle maintenance must be done onsite, work in a bermed area away from storm drains and over a drip pan or drop cloths big enough to collect fluids. Recycle or dispose of fluids as hazardous waste.
- If vehicle or equipment cleaning must be done onsite, clean with water only in a bermed area that will not allow rinse water to run into gutters, streets, storm drains, or creeks.
- Do not clean vehicles or equipment onsite using soaps, solvents, degreasers, or steam cleaning equipment, and do not use diesel oil to lubricate equipment or parts onsite.

Spill Prevention and Control

- Always keep spill cleanup materials (e.g., rags, absorbents, and cat litter) available at the construction site.
- Maintain all vehicles and heavy equipment. Inspect frequently for leaks. Use drip pans to catch leaks until repairs are made.
- Clean up leaks, drips and other spills immediately using dry cleanup methods whenever possible (absorbent materials, cat litter and/or rags) and dispose of cleanup materials properly.
- Sweep up spilled dry materials immediately. Never attempt to "wash them away" with water or bury them.
- Clean up spills on dirt areas by digging up and properly disposing of contaminated soil.
- Report significant spills to the appropriate local spill response agencies immediately. If the spill poses a significant hazard to human health and safety, property or the environment, report it to the State Office of Emergency Services at (800) 852-7550 (24 hours).

Earthmoving

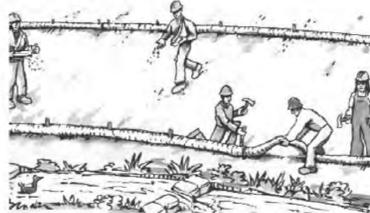

Grading and Earthwork

- Schedule grading and excavation work during dry weather.
- Prevent sediment from migrating offsite and protect storm drain inlets, drainage courses and creeks by installing and maintaining appropriate BMPs tailored to the site's specific characteristics and conditions. Examples of such BMPs may include silt fences, gravel bags, fiber rolls, temporary swales, compost socks, etc. Ensure that BMPs are installed in accordance with manufacturer's specifications and properly maintained throughout the duration of construction activities.
- Stabilize all denuded areas and install and maintain temporary erosion controls (such as erosion control fabric or bonded fiber matrix) until vegetation is established.
- Remove existing vegetation only when necessary. Plant temporary vegetation to prevent erosion on slopes or in areas where construction is not immediately planned.
- Keep excavated soil and/or transfer it to dump trucks, onsite, not in the streets. Ensure all subcontractors working onsite are implementing appropriate BMPs.

Contaminated Soils

- If any of the following conditions are observed, test for contamination and contact the [Regional Water Quality Control Board](#) and the local agency:
 - Unusual soil conditions, discoloration, or odor.
 - Abandoned underground tanks.
 - Abandoned wells.
 - Buried barrels, debris, or trash.
- If the above conditions are observed, document any signs of potential contamination, clearly mark areas and fence/tape them off so they are not disturbed by construction activities.

Landscaping

- Protect stockpiled landscaping materials from wind and rain by storing them under tarps year-round.
- Stack bagged material on pallets and under cover.
- Discontinue application of any erodible landscape material within 2 days before a forecast rain event or during wet weather.
- Store materials onsite, not in the street.

Concrete Management & Dewatering



Concrete Management

- Store both dry and wet concrete-related materials under cover, protected from rainfall and runoff and away from storm drains or creeks. Store materials off the ground on pallets. Protect dry materials from wind.
- Avoid pouring concrete in wet weather or when rainfall is imminent to prevent concrete that has not cured from contacting stormwater runoff.
- Wash out concrete equipment/mixers/trucks offsite, or onsite only in designated washout containers/areas where the water will flow into a temporary lined waste pit and in a manner that will prevent leaching into the underlying soils. (See CASQA Construction Stormwater BMP Handbook for temporary concrete washout facility details).
- Do not wash sweepings from exposed aggregate concrete into the street or storm drain. Collect and return sweepings to aggregate base stockpile or dispose properly.
- Make sure that construction waste (e.g., concrete, stucco, cement wastewater, or residual materials) is collected, removed, and disposed of only at authorized disposal areas. Do not dispose of construction waste in storm drains, ditches, streets, creeks, dirt areas, or the sanitary sewer.

Dewatering

- Discharges of groundwater or captured runoff from dewatering operations must be properly managed and disposed. When possible, send dewatering discharge to landscaped area or sanitary sewer. If discharging to the sanitary sewer, obtain permission from the local wastewater treatment plant.
- Divert water originating from offsite away from all onsite disturbed areas.
- When dewatering, notify and obtain approval from the local municipality before discharging water to a street gutter or storm drain. Filtration or diversion through a basin, tank, or sediment trap may be required.
- In areas of known or suspected contamination, call the local agency to determine whether the groundwater must be tested. Pumped groundwater may need to be collected and hauled offsite for treatment and proper disposal.
- For additional information, refer to the CASQA's Sheet NS-2 "Dewatering Operations."

Paving/Asphalt Work



Paving

- Avoid paving and seal coating in wet weather or when rain is forecast to prevent materials that have not cured from contacting with stormwater runoff.
- Cover storm drain inlets and manholes when applying seal coat, slurry seal, fog seal, or similar materials.
- When construction is complete, remove all covers from storm drain inlets and manholes.
- Collect and recycle or properly dispose of excess abrasive gravel or sand. Do NOT sweep or wash it into gutters, storm drains, streets, dirt areas, or the sanitary sewer.

Sawcutting & Asphalt/Concrete Removal

- Protect storm drain inlets during saw cutting.
- When making saw cuts, use as little water as possible.
- Residue from saw cutting, coring and grinding operations shall be picked up by means of a vacuum device.
- Shovel, absorb, or vacuum saw cut slurry deposits and dispose of all waste properly and as soon as reasonably possible. Sawcutting residue should not be left on pavement surface.
- If saw cut slurry enters a storm drain inlet, clean it up immediately and notify the local municipality.

Copper Architectural Features

Discharges to storm drains generated by installing, cleaning, treating or washing copper architectural features, is a violation of the municipal stormwater ordinance and may be subject to a fine. These BMPs must be implemented to prevent prohibited discharges to storm drains:


During Installation

- If possible, purchase copper materials that have been pre-patinated at the factory.
- If patination done on site, implement one or more of the following BMPs:
 - Discharge the rinse water to landscaping. Ensure that the rinse water does not flow to the street or storm drain. Block off storm drain inlet if needed.
 - Collect rinse water in a tank and pump to the sanitary sewer. Contact your local sanitary sewer agency before discharging to the sanitary sewer.
 - Collect the rinse water in a tank and haul off-site for proper disposal.
- Consider coating the copper materials with an impervious coating that prevents further corrosion and runoff. This will also maintain the desired color for a longer time, requiring less maintenance.

During Maintenance

- Block storm drain inlets as needed to prevent runoff from entering storm drains.
- Discharge the wash water to landscaping or to the sanitary sewer (with permission from the local sanitary sewer agency). If this is not an option, haul the wash water off-site for proper disposal.

Painting & Paint Removal

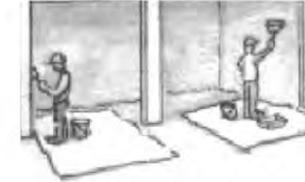

Painting Cleanup and Removal

- Never clean brushes or rinse paintcontainers to landscaping, dirt areas or into a street, gutter, storm drain, or creek.
- For water-based paints, paint out brushes to the extent possible, and then rinse into a drain connected to the sanitary sewer. Never pour paint down a storm drain inlet.
- For oil-based paints, paint out brushes to the extent possible, and then clean with thinner or solvent in a proper container. Filter and reuse thinners and solvents. Dispose of excess liquids as hazardous waste.
- Sweep up or collect paint chips and dust generated from non-hazardous dry stripping and sand blasting into plastic drop cloths and dispose of as trash.
- Chemical paint stripping residue and chips and dust from marine paints or paints containing lead, mercury, or tributyltin must be disposed of as hazardous waste. Lead-based paint removal requires a state-certified contractor.



| REV. | DATE | DESCRIPTION |
|------|----------|--|
| 1 | 10/31/24 | PER ENGINEERING DIV REVIEW COMMENTS, 9/11/24 |
| 2 | 3/29/25 | PER PUBLIC WORKS AND PLANNING LATEST REVIEW COMMENTS |
| 3 | 5/10/25 | PER PUBLIC WORKS, BUILDING & PLANNING LATEST REVIEW COMMENTS |

**BLUEPRINT FOR A CLEAN BAY
RESIDENCE
14331 CAPRI DRIVE
LOS GATOS, CA 95032**

**GREEN
CIVIL ENGINEERING, INC**
INFO@GREEN-CE.COM
1900 S. NORFOLK ST. SUITE #350
SAN MATEO, CA 94403



SCALE
VERTICAL: 1"= AS SHOWN
HORIZONTAL: 1"= AS SHOWN

| | |
|-----------|------------|
| DATE: | 02/01/2024 |
| DESIGNED: | HCL |
| DRAWN: | BL |
| REVIEWED: | HCL |
| JOB NO.: | 20230050 |

**SHEET
C5
7 OF 7 SHEETS**

Storm drain polluters may be liable for fines of up to \$10,000 per day!

FLOOR PLAN, EXISTING, KEYNOTES

- 1 CONCRETE PORCH TO BE DEMOD
- 2 CONCRETE STEP TO BE DEMOD
- 3 POST TO BE DEMOD
- 4 RESIDENCE TO BE DEMOD

ROOF PLAN, EXISTING, KEYNOTES

- 1 ROOF TO BE DEMOD
- 2 CHIMNEY TO BE DEMOD

GENERAL NOTES:

1. CONTRACTOR TO VERIFY ALL FIELD MEASUREMENTS.
2. REFER TO ELEVATIONS FOR ALL EXISTING ELEMENTS ALIGNMENT.
3. ELEMENTS IN GRAY ARE EXISTING WHILE ELEMENTS IN BLACK ARE PROPOSED.
4. LANDING MINIMUM 36" DEEP LANDING AND NOT MORE THAN 1 1/2" LOWER THAN THRESHOLD FOR OUTSWINGING DOORS.
5. WINDOWS HAVE THE BOTTOM OF THE CLEAR OPENING NOT MORE THAN 44 INCHES ABOVE THE FLOOR OPENS DIRECTLY TO STREET, PUBLIC ALLEY YARD, OR COURT THAT OPENS TO A PUBLIC RIGHT OF WAY. CRC SECTION R310
6. DOORS AND PANELS OF SHOWER AND BATHTUB ENCLOSURES SHALL BE FULLY TEMPERED, LAMINATED SAFETY GLASS OR APPROVED PLASTIC. CRC SECTION R308.4.5
7. WATER RESISTANT GYPSUM BACKING BOARD SHALL NOT BE USED OVER A VAPOR RETARDER IN SHOWER OR BATHTUB COMPARTMENTS. CRC R307.2 AND R702.4
8. CLEAR SPACE AROUND A TOILET SHALL MEASURE A MINIMUM 15" FROM CENTERLINE OF TOILET TO WALL OR BARRIER ON EACH SIDE, AND A MINIMUM 24" IN FRONT OF THE TOILET.
9. SHOWER PAN DIMENSIONS MUST BE A MINIMUM AREA OF 1024 SQ. INCHES AND A MINIMUM FINISH DIMENSION OF 30" IN ANY DIRECTION.
10. SHOWER DOORS SHALL OPEN A MINIMUM 22" UNOBSTRUCTED OPENING FOR EGRESS.
11. STAIR RISE (MAXIMUM 7'-3/4") AND RUN (MINIMUM 10") FROM NOSING TO NOSING. WHERE TREAD DEPTH IS LESS THAN 11", A NOSING OF 3/4" MINIMUM TO 1-1/4" MAXIMUM IS REQUIRED.
12. PLEASE SEE WALL SCHEDULES ON SHEET A400
13. PLEASE SEE WINDOW & DOOR SCHEDULES ON SHEET A400



GORDON K WONG, ARCHITECT LIC# 34045
 KEVIN YU PROJECT REP
 710E MCCLINTY LANE SUITE 108
 CAMPBELL, CA 95008 (408) 796-1845
 GORDONKWONGARCHITECTS.COM KEVINYU@GKWAARCHITECTS.COM



RESIDENCE
 14331 Capri Drive
 LOS GATOS, CA 95032

Floor & Roof Plans, Existing


| Project Schedule Revision | |
|---------------------------|----------------------|
| # | REV DATE DESCRIPTION |
| △ | 2024.11.29 PLANNING |
| △ | 2024.06.06 PLANNING |
| △ | 2024.09.11 PLANNING |
| △ | 2025.01.08 PLANNING |
| △ | 2025.04.30 PLANNING |

Floor & Roof Plans, Existing


A100

SCALE 1/4" = 1'-0"


5/14/2025 4:18:03 PM

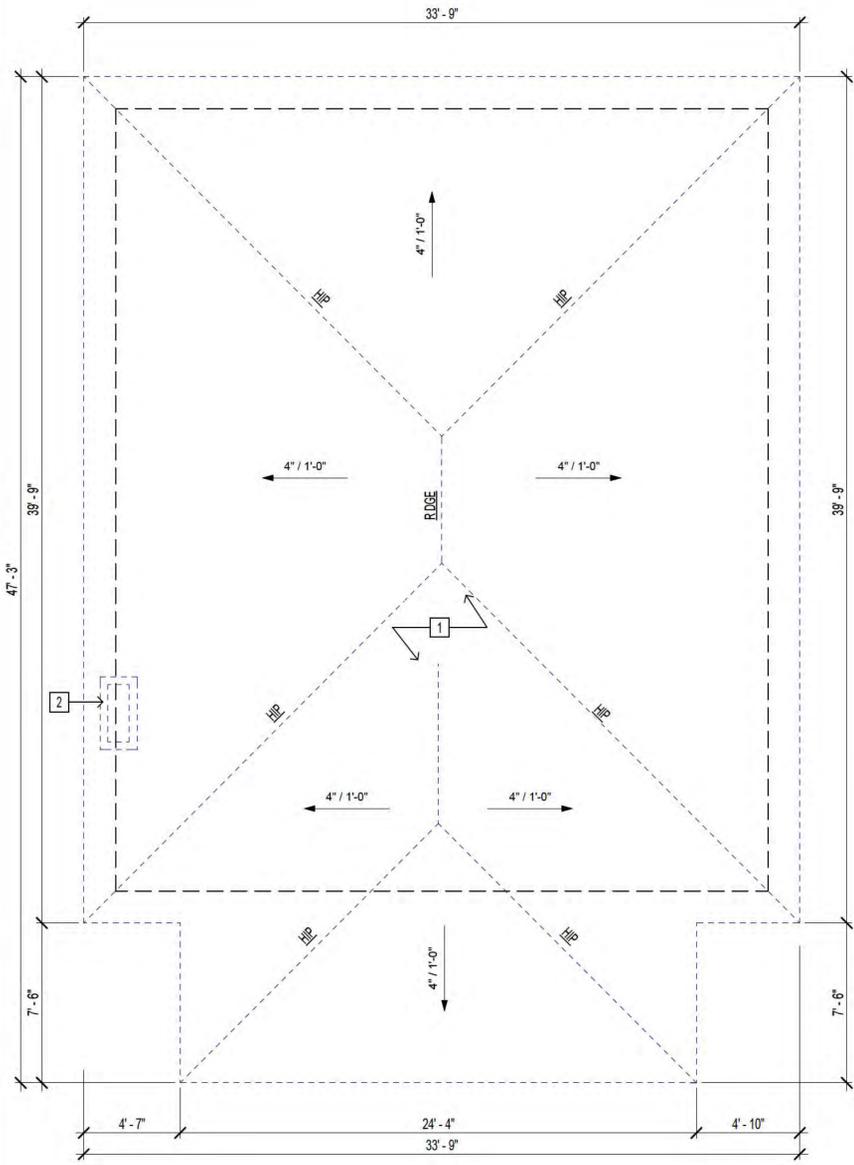



② Roof Plan, Existing
 1/4" = 1'-0"

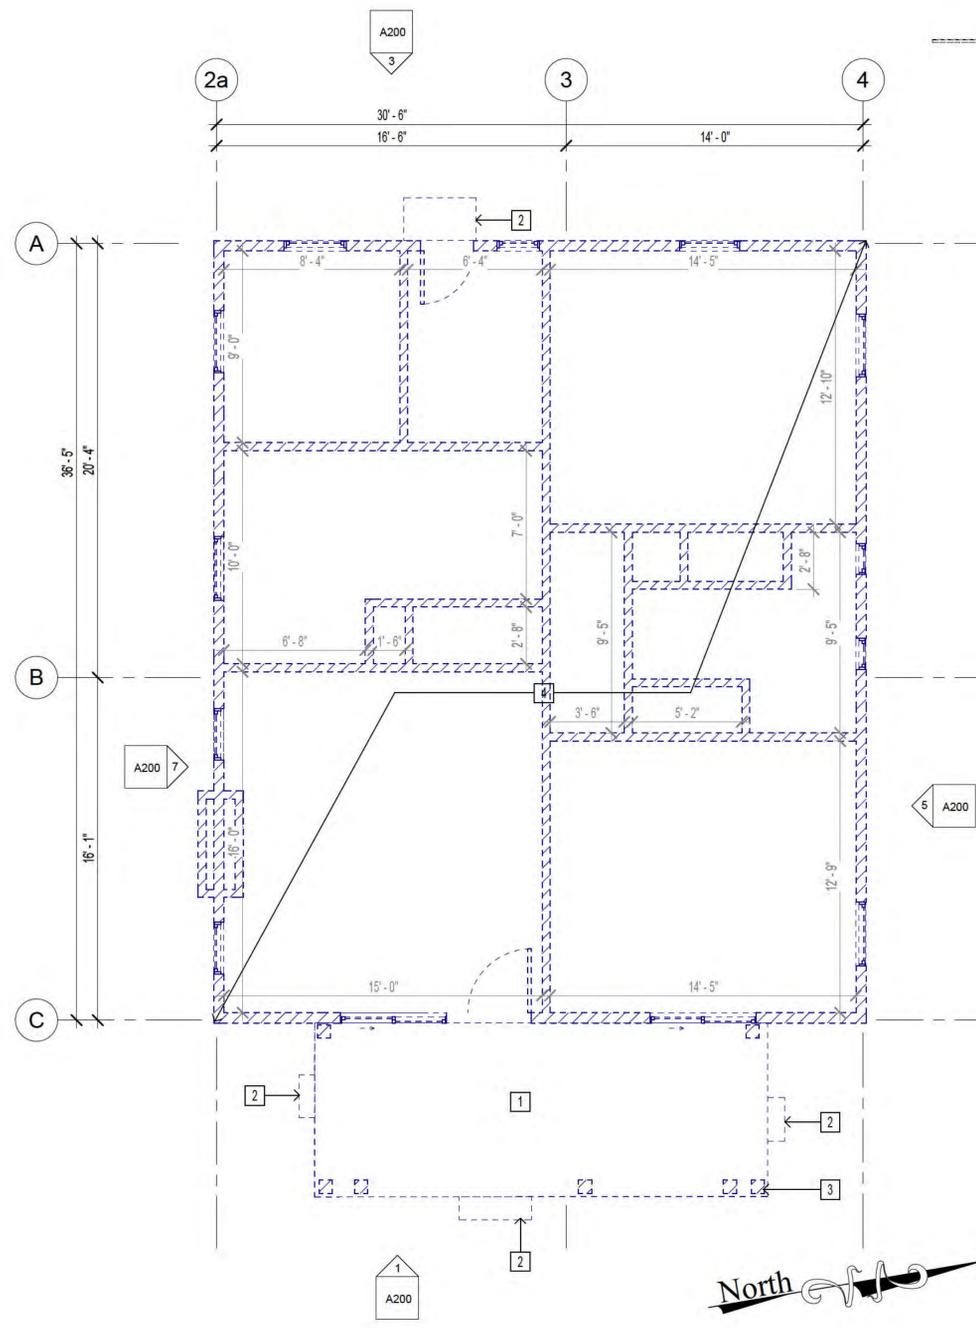


① Floor Plan, Lvl 1, Existing
 1/4" = 1'-0"

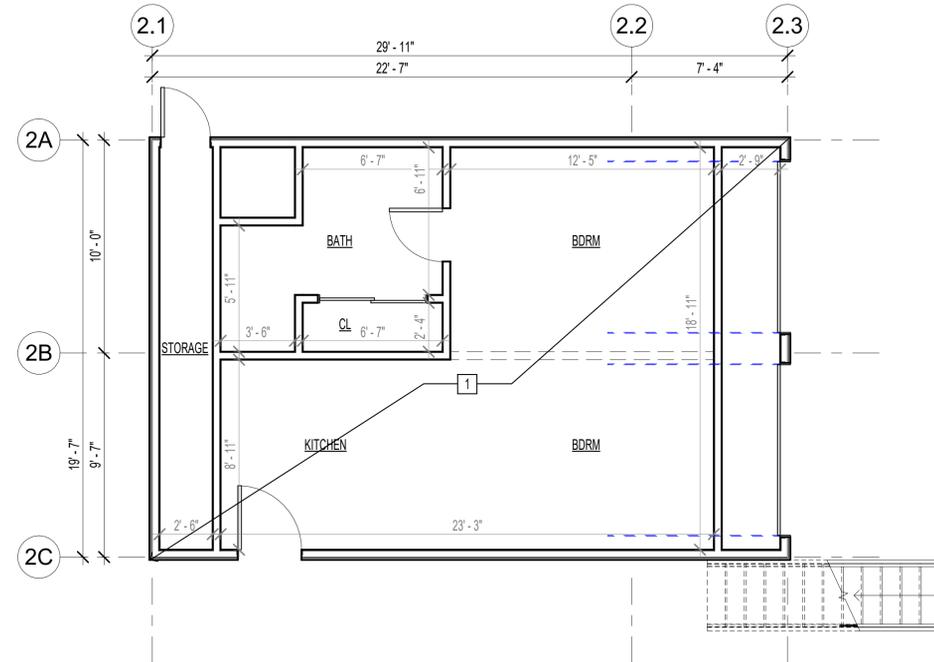

1 ADU Plan, Lvl 1, Existing
1/4" = 1'-0"

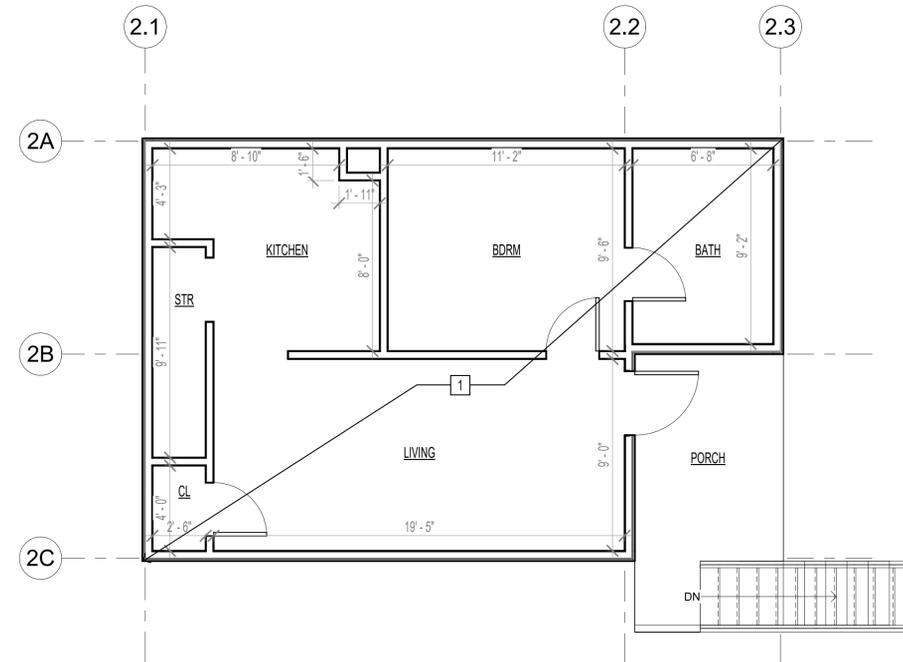

2 ADU Plan, Lvl 2, Existing
1/4" = 1'-0"



FLOOR PLAN, EXISTING, KEYNOTES


- 1 DETACHED ADU TO BE REMAINED

GENERAL NOTES:

1. CONTRACTOR TO VERIFY ALL FIELD MEASUREMENTS.
2. REFER TO ELEVATIONS FOR ALL EXT. ELEMENTS ALIGNMENT.



GORDON K WONG, ARCHITECT LIC# 34045
KEVIN YU PROJECT REP
710E MCCLINCY LANE SUITE 109
CAMPBELL, CA 95008 (408) 796-1848
GORDONKWONG@GKWAARCHITECTS.COM KEVINYU@GKWAARCHITECTS.COM

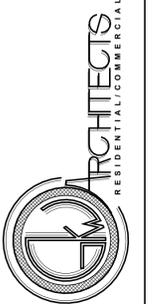

RESIDENCE

14331 Capri Drive
LOS GATOS, CA 95032

| Project Schedule Revision | | |
|---------------------------|------------|-------------|
| # | REV DATE | DESCRIPTION |
| △ | 2024.11.29 | PLANNING |
| △ | 2024.06.08 | PLANNING |
| △ | 2024.09.11 | PLANNING |
| △ | 2025.01.08 | PLANNING |
| △ | 2025.04.30 | PLANNING |


Floor Plan,
Existing,
Detached ADU

A100.1

SCALE 1/4" = 1'-0"

5/14/2025 4:18:05 PM

Floor Plan, Existing, Detached ADU

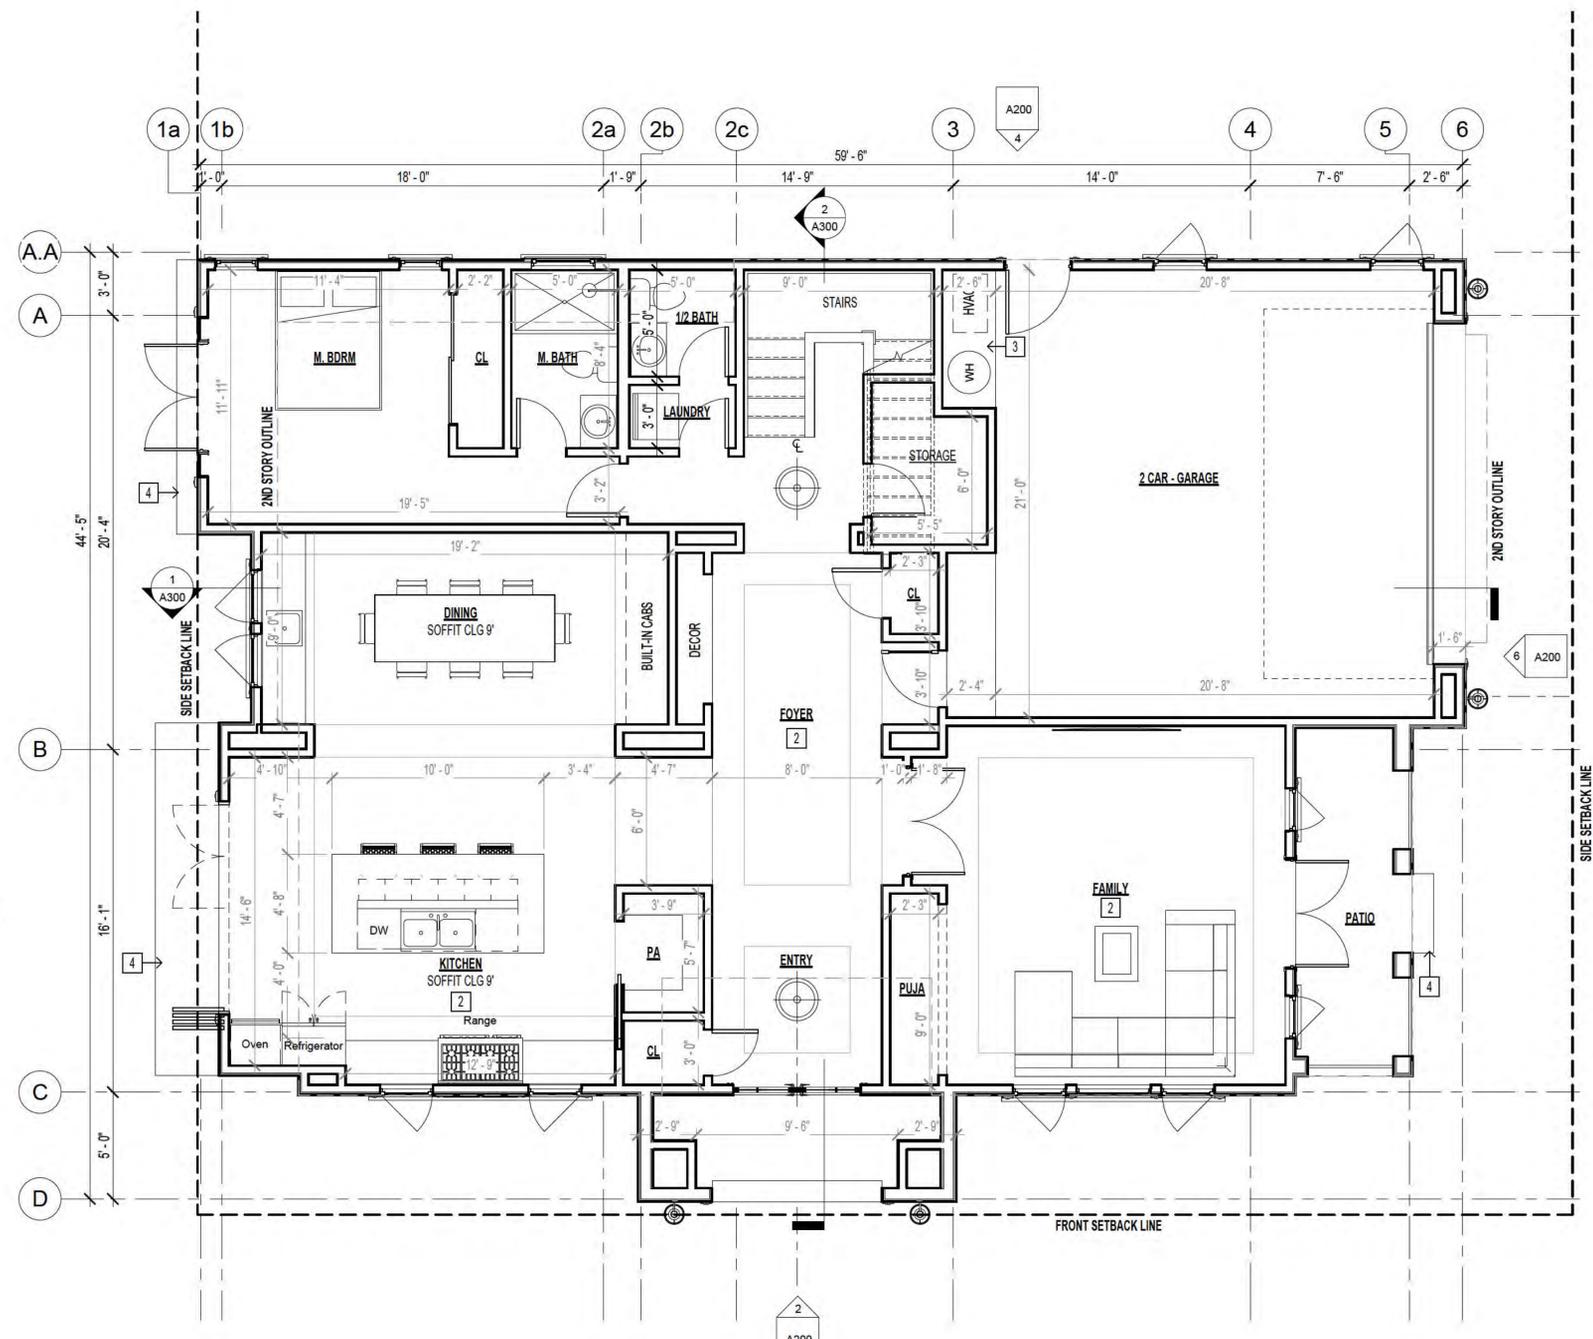

1 Floor Plan, Lvl 1, Proposed
1/4" = 1'-0"



FLOOR PLAN, PROPOSED, KEYNOTES

- 1 DECOR
- 2 COFFERED CEILING
- 3 RAISED PLATFORM
- 4 CONCRETE STEP DOWN

GENERAL NOTES:

1. CONTRACTOR TO VERIFY ALL FIELD MEASUREMENTS.
2. REFER TO ELEVATIONS FOR ALL EXISTING ELEMENTS ALIGNMENT.
3. ELEMENTS IN GRAY ARE EXISTING WHILE ELEMENTS IN BLACK ARE PROPOSED.
4. LANDING MINIMUM 36" DEEP LANDING AND NOT MORE THAN 1 1/2" LOWER THAN THRESHOLD FOR OUTSWINGING DOORS.
5. WINDOWS HAVE THE BOTTOM OF THE CLEAR OPENING NOT MORE THAN 44 INCHES ABOVE THE FLOOR OPENS DIRECTLY TO STREET, PUBLIC ALLEY YARD, OR COURT THAT OPENS TO A PUBLIC RIGHT OF WAY. CRC SECTION R310.
6. DOORS AND PANELS OF SHOWER AND BATHTUB ENCLOSURES SHALL BE FULLY TEMPERED, LAMINATED SAFETY GLASS OR APPROVED PLASTIC. CRC SECTION R308.4.5.
7. WATER RESISTANT GYPSUM BACKING BOARD SHALL NOT BE USED OVER A VAPOR RETARDER IN SHOWER OR BATHTUB COMPARTMENTS. CRC R307.2 AND R702.4.
8. CLEAR SPACE AROUND A TOILET SHALL MEASURE A MINIMUM 15" FROM CENTERLINE OF TOILET TO WALL OR BARRIER ON EACH SIDE, AND A MINIMUM 24" IN FRONT OF THE TOILET.
9. SHOWER PAN DIMENSIONS MUST BE A MINIMUM AREA OF 1024 SQ. INCHES AND A MINIMUM FINISH DIMENSION OF 30" IN ANY DIRECTION.
10. SHOWER DOORS SHALL OPEN A MINIMUM 22" UNOBSTRUCTED OPENING FOR EGRESS.
11. STAIR RISE (MAXIMUM 7'-3 1/4") AND RUN (MINIMUM 10") FROM NOSING TO NOSING. WHERE TREAD DEPTH IS LESS THAN 11", A NOSING OF 3/4" MINIMUM TO 1-1/4" MAXIMUM IS REQUIRED.
12. PLEASE SEE WALL SCHEDULES ON SHEET A400.
13. PLEASE SEE WINDOW & DOOR SCHEDULES ON SHEET A400.



GORDON K WONG ARCHITECTS
7106 MCCLINCY LANE SUITE 108
CAMPBELL, CA 95008 (408) 315-2125
GORDONKWONG@GKWAARCHITECTS.COM KEVINYU@GKWAARCHITECTS.COM



Floor Plan, Level 1, Proposed

RESIDENCE
14331 Capri Drive
LOS GATOS, CA 95032

| # | REV DATE | DESCRIPTION |
|---|------------|-------------|
| 1 | 2024.11.29 | PLANNING |
| 2 | 2024.06.06 | PLANNING |
| 3 | 2024.09.11 | PLANNING |
| 4 | 2025.01.08 | PLANNING |
| 5 | 2025.04.30 | PLANNING |

Floor Plan, Level 1, Proposed

A101

SCALE 1/4" = 1'-0"

5/14/2025 4:18:08 PM



GORDON K WONG, ARCHITECT, LIC# 34045
 KEVIN YU PROJECT REP
 7106 MCCLINCY LANE SUITE 108
 CAMPBELL, CA 95008 (408) 796-1845
 GORDONKWONG@GKORWARCHITECTS.COM KEVINYU@GKORWARCHITECTS.COM



RESIDENCE
 14331 Capri Drive
 LOS GATOS, CA 95032

Floor Plan, Level 2, Proposed

| Project Schedule Revision | | |
|---------------------------|------------|-------------|
| # | REV DATE | DESCRIPTION |
| ▲ | 2024.11.29 | PLANNING |
| ▲ | 2024.06.06 | PLANNING |
| ▲ | 2024.09.11 | PLANNING |
| ▲ | 2025.01.08 | PLANNING |
| ▲ | 2025.04.30 | PLANNING |

Floor Plan, Level 2, Proposed



A102

SCALE 1/4" = 1'-0"

5/14/2025 4:18:10 PM


FLOOR PLAN, PROPOSED, KEYNOTES

- 1 DECOR
- 2 COFFERED CEILING

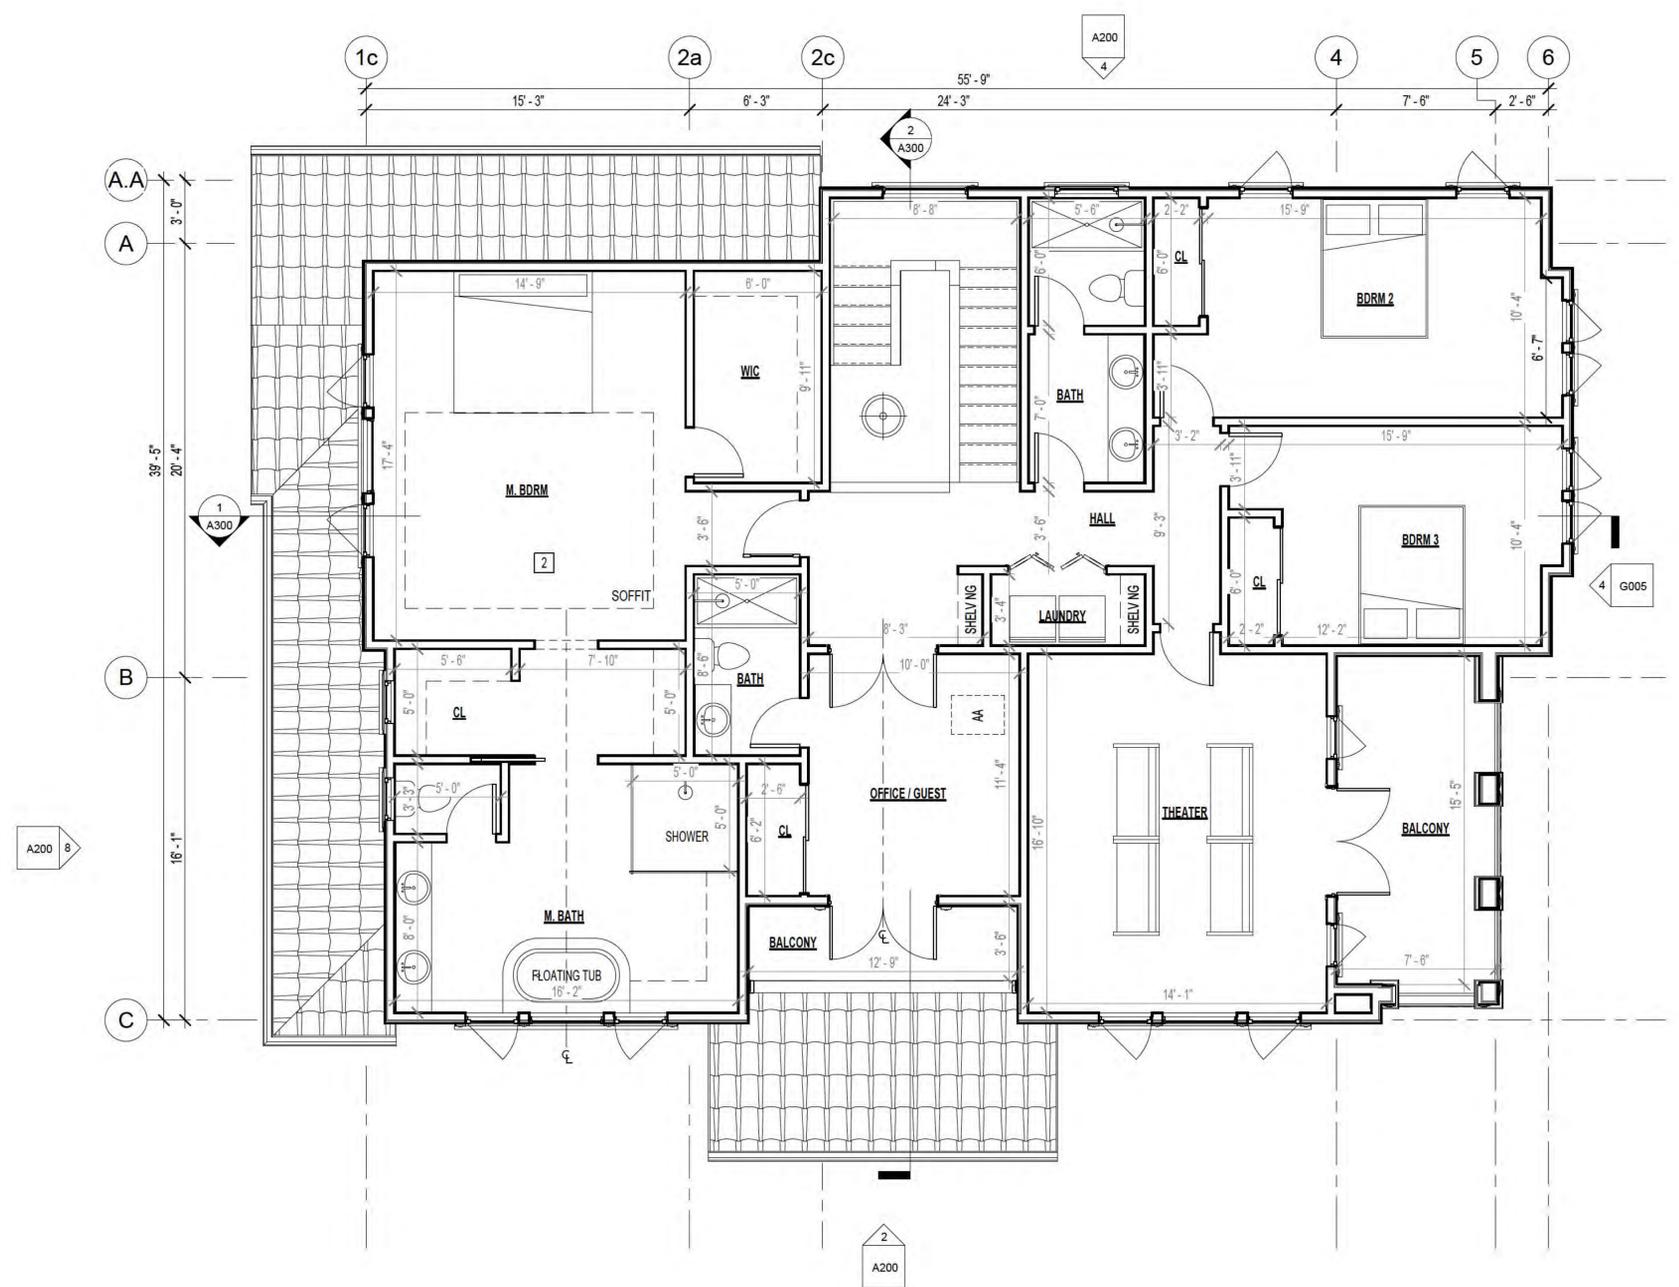


GENERAL NOTES:

1. CONTRACTOR TO VERIFY ALL FIELD MEASUREMENTS.
2. REFER TO ELEVATIONS FOR ALL EXT. ELEMENTS ALIGNMENT.
3. ELEMENTS IN GRAY ARE EXISTING WHILE ELEMENTS IN BLACK ARE PROPOSED.
4. LANDING MINIMUM 36" DEEP LANDING AND NOT MORE THAN 1 1/2" LOWER THAN TRESHOLD FOR OUTSWING DOORS.
5. WINDOWS HAVE THE BOTTOM OF THE CLEAR OPENING NOT MORE THAN 44 INCHES ABOVE THE FLOOR OPENS DIRECTLY TO STREET, PUBLIC ALLEY YARD, OR COURT THAT OPENS TO A PUBLIC RIGHT OF WAY. CRC SECTION R310
6. DOORS AND PANELS OF SHOWER AND BATHTUB ENCLOSURES SHALL BE FULLY TEMPERED, LAMINATED SAFETY GLASS OR APPROVED PLASTIC. CRC SECTION R308.4.5
7. WATER RESISTANT GYPSUM BACKING BOARD SHALL NOT BE USED OVER A VAPOR RETARDER IN SHOWER OR BATHTUB COMPARTMENTS. CRC R307.2 AND R702.4
8. CLEAR SPACE AROUND A TOILET SHALL MEASURE A MINIMUM 15" FROM CENTERLINE OF TOILET WALL OR BARRIER ON EACH SIDE, AND A MINIMUM 24" IN FRONT OF THE TOILET.
9. SHOWER PAN DIMENSIONS MUST BE A MINIMUM AREA OF 1024 SQ. INCHES AND A MINIMUM FINISH DIMENSION OF 30" IN ANY DIRECTION.
10. SHOWER DOORS SHALL OPEN A MINIMUM 22" UNOBSTRUCTED OPENING FOR EGRESS.
11. STAIR RISE (MAXIMUM 7'-3/4") AND RUN (MINIMUM 10") FROM NOSING TO NOSING. WHERE TREAD DEPTH IS LESS THAN 11", A NOSING OF 3/4" MINIMUM TO 1-1/4" MAXIMUM IS REQUIRED.
12. PLEASE SEE WINDOW SCHEDULES ON SHEET A400
13. PLEASE SEE WINDOW & DOOR SCHEDULES ON SHEET A400

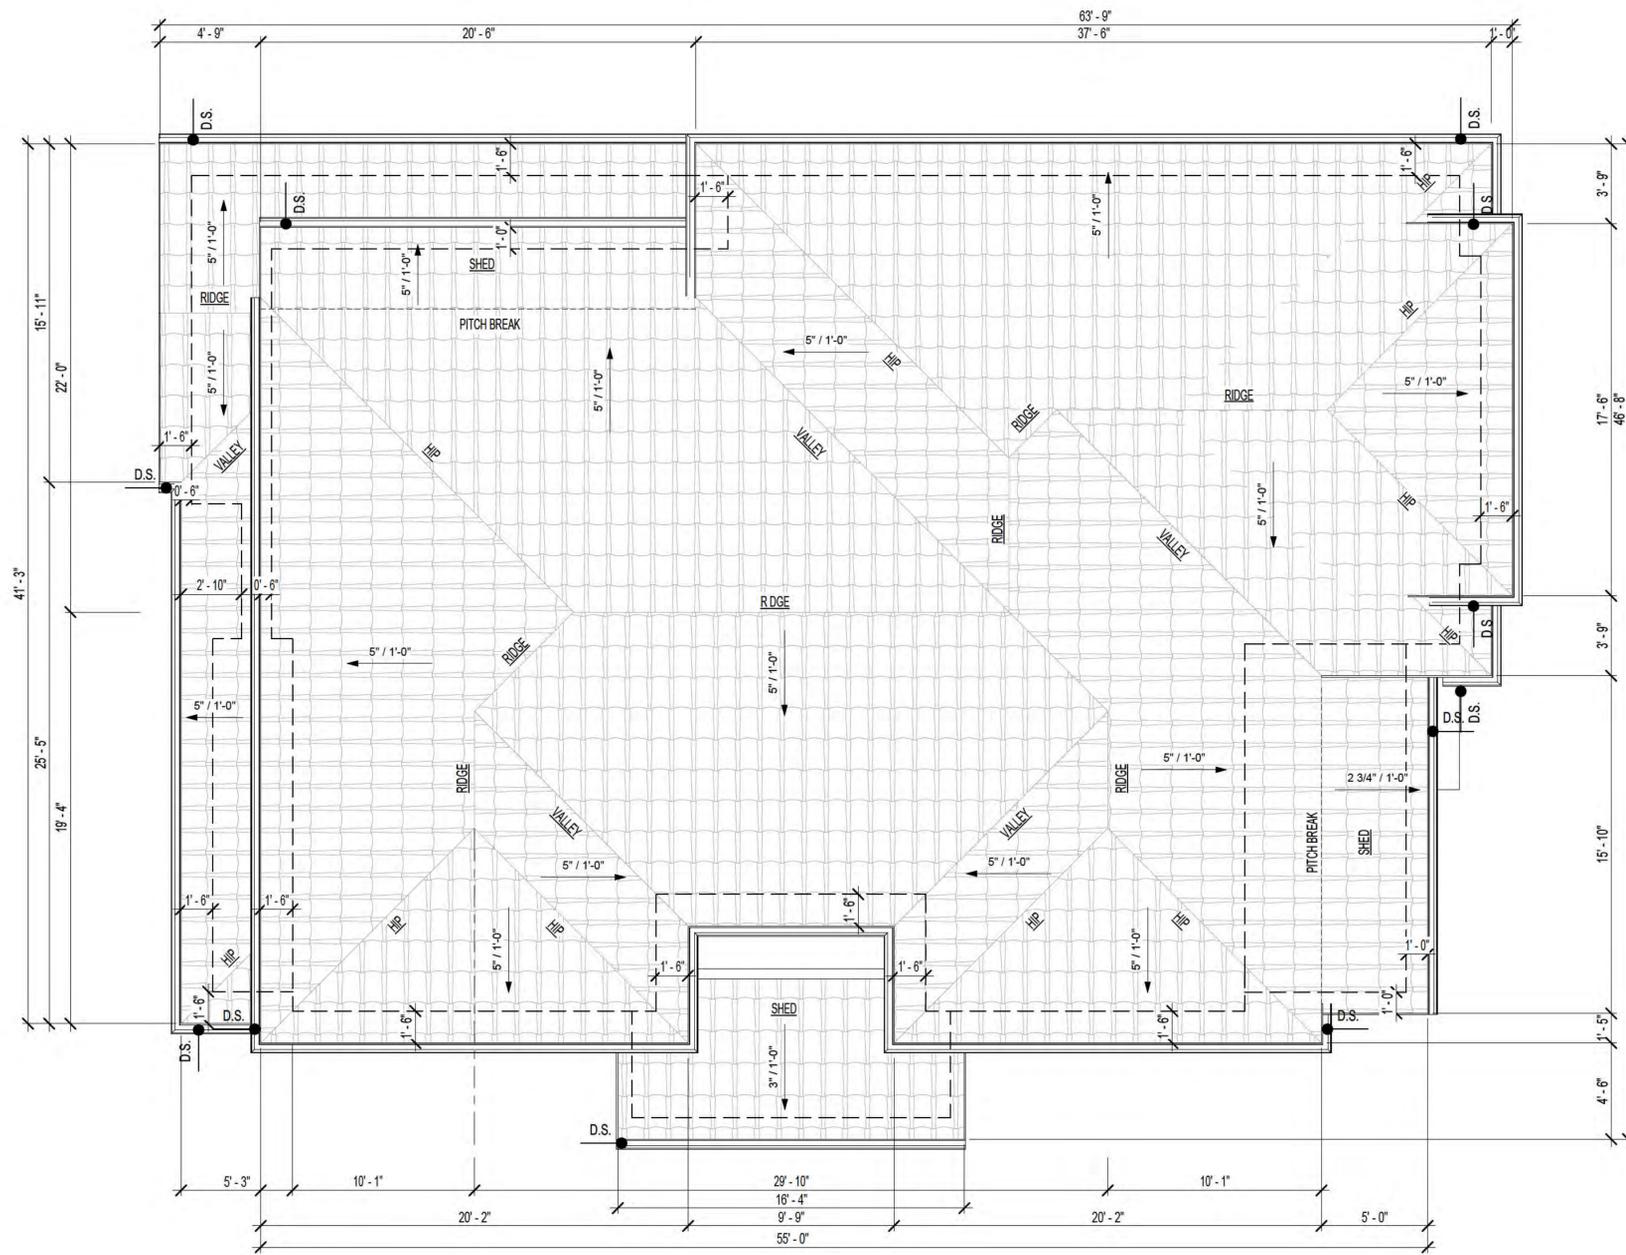

1 Roof Plan, Proposed
1/4" = 1'-0"



ROOF PLAN, PROPOSED, KEYNOTES

- 1 CLAY TILE ROOF, MIN. CLASS C RATING
- 2 FASCIA
- 3 GUTTER
- 4 DOWNSPOUTS



GORDON K WONG, ARCHITECT, LIC# 34045
 KEVIN YU PROJECT REP
 7106 MCCLINTY LANE SUITE 108
 CAMPBELL, CA 95008 (408) 796-1845
 GORDONKWONG@GKWARCHITECTS.COM KEVINYU@GKWARCHITECTS.COM



Roof Plan, Proposed

RESIDENCE
 14331 Capri Drive
 LOS GATOS, CA 95032














| # | REV DATE | DESCRIPTION |
|---|------------|-------------|
| △ | 2024.11.29 | PLANNING |
| △ | 2024.06.06 | PLANNING |
| △ | 2024.09.11 | PLANNING |
| △ | 2025.01.08 | PLANNING |
| △ | 2025.04.30 | PLANNING |

Roof Plan,
Proposed

A103

SCALE 1/4" = 1'-0"

5/14/2025 4:18:12 PM

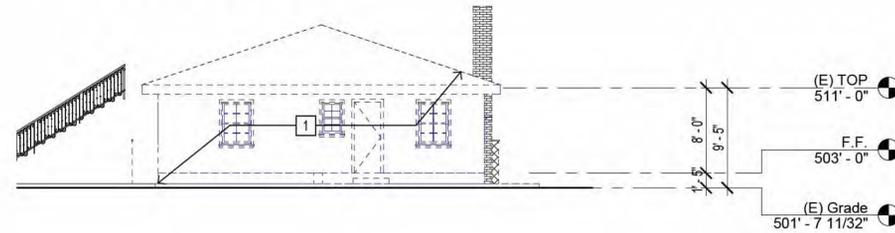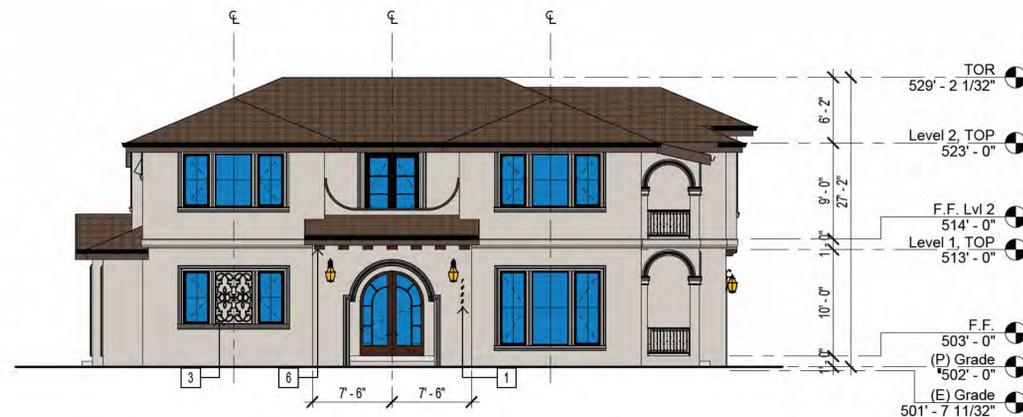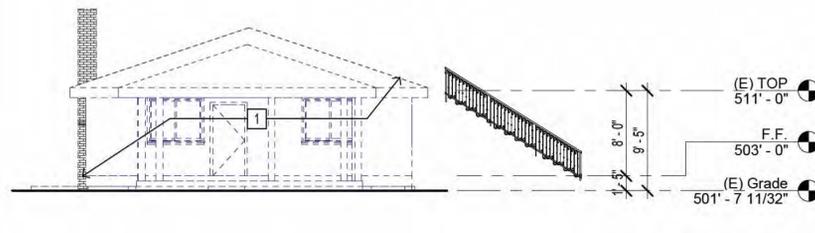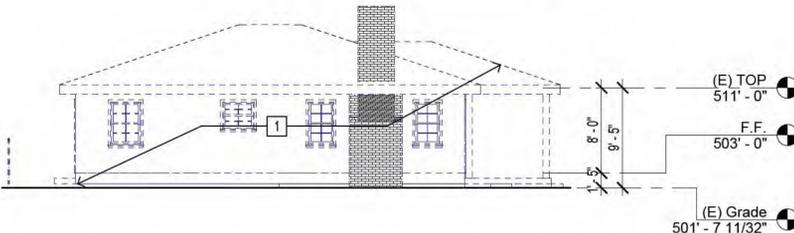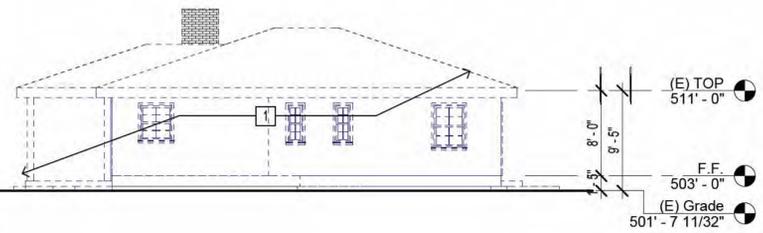

ELEVATIONS, EXISTING, KEYNOTES

- 1 BUILDING TO BE DEMOLISHED

ELEVATIONS, EXISTING, KEYNOTES

ELEVATIONS, PROPOSED, KEYNOTES

- 1 ADDRESS IDENTIFICATION PER SCOPD STANDARDS
- 2 EXTERIOR WALL LIGHT NG
- 3 ARCHITECTURAL FEATURE - WROUGHT IRON DECOR
- 4 RAILING
- 5 STUCCO TR M
- 6 CORBEL

NOTES:


- CONTRACTOR TO VERIFY ALL DIMENSION AND DESIGN ON SITE.
- ADDRESS IDENTIFICATION:** NEW AND EXISTING BUILDINGS SHALL HAVE APPROVED ADDRESS NUMBERS, BUILDING NUMBERS OR APPROVED BUILDING IDENTIFICATION PLACED IN A POSITION THAT IS PLAINLY LEGIBLE AND VISIBLE FROM THE STREET OR ROAD FRONTING THE PROPERTY. THESE NUMBERS SHALL CONTRAST WITH THE BACKGROUND. WHERE REQUIRED BY THE FIRE CODE OFFICIAL, ADDRESS NUMBERS SHALL BE PROVIDED IN ADDITIONAL APPROVED LOCATIONS TO FACILITATE EMERGENCY RESPONSE. ADDRESS NUMBERS SHALL BE ARABIC NUMBERS OR ALPHABETICAL LETTERS. NUMBERS SHALL BE A MINIMUM OF 6 INCHES HIGH WITH A MINIMUM STROKE WIDTH OF 0.5 INCH (12.7 MM). WHERE ACCESS IS BY MEANS OF A PRIVATE ROAD AND THE BUILDING CANNOT BE VIEWED FROM THE PUBLIC WAY, A MONUMENT, POLE OR OTHER SIGN OR MEANS SHALL BE USED TO IDENTIFY THE STRUCTURE. ADDRESS NUMBERS SHALL BE MAINTAINED. CFC SEC. 505.1
- ALL EXTERIOR LIGHTING WILL BE DOWNWARD DIRECTED WITH BULBS SHIELDED FROM VIEW.

MATERIAL & COLOR, LEGEND

| | | | |
|--|---|--|---|
| | CLAY ROOF TILES, BROWN VEREA | | GARAGE DOOR, SPANISH STYLE WOOD STAINED FINISH, CUSTOM |
| | STUCCO, ACCESSIBLE BEIGE SHERWIN WILLIAMS | | ACCORDION DOOR, ALUMINUM W/ BLACK PAINT PANORAMIC SLIDING |
| | FASICA BOARD, REDWOOD PAINTED FINISH W/ VAN DYKE BROWN SHERWIN WILLIAMS | | WINDOW, 400 SERIES ANDERSEN |
| | GUTTER ALUMINUM W/ BLACK PAINT GUTTER SUPPLY | | RAILING WROUGHT IRON CUSTOM |



GORDON K WONG, ARCHITECT, LIC# 34045
 KEVIN WU PROJECT REP
 710E MCCLINCY LANE SUITE 109
 CAMPBELL, CA 95008 (408) 796-1845
 GORDONKWONG@GKWARCHITECTS.COM KEVINWU@GKWARCHITECTS.COM

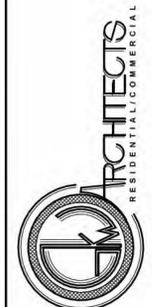

Elevations, Existing & Proposed

RESIDENCE
 14331 Capri Drive
 LOS GATOS, CA 95032

| # | REV DATE | DESCRIPTION |
|---|------------|-------------|
| △ | 2024.11.29 | PLANNING |
| △ | 2024.06.06 | PLANNING |
| △ | 2024.09.11 | PLANNING |
| △ | 2025.01.08 | PLANNING |
| △ | 2025.04.30 | PLANNING |

Elevations,
 Existing &
 Proposed

A200

SCALE As indicated

5/14/2025 4:18:36 PM

SECTIONS, PROPOSED, KEYNOTES

- 1 DECOR
- 2 COFFERED CEILING

GENERAL SECTION NOTES:


1. PROVIDE MINIMUM CLEARANCE BETWEEN TOP PLATE OF INTERIOR PARTITIONS AND BOTTOM CHORD OF TRUSSES, S.S.D.
2. IN CONCEALED SPACES OF STUD WALLS AND PARTITIONS, INCLUDING FURRED SPACES AND PARALLEL ROWS OF STUDS, OR STAGGERED STUDS PER C.R.C. SECTION R302.11 AS FOLLOWS:
 - A. VERTICALLY AT THE CEILING AND FLOOR LEVELS
 - B. HORIZONTALLY AT INTERVALS NOT EXCEEDING 10'
3. AT ALL INTERCONNECTIONS BETWEEN CONCEALED VERTICAL AND HORIZONTAL SPACES SUCH AS OCCUR AT SOFFITS, DROP CEILING, AND COVE CEILING PER C.R.C. SECTION R302.11.
4. IN CONCEALED SPACES BETWEEN STAIR STRINGERS AT THE TOP AND BOTTOM OF THE RUN PER C.R.C. SECTION 302.11.
5. AT OPENINGS AROUND VENTS, PIPES, DUCTS, CABLES AND WIRES AT CEILING AND FLOOR LEVEL, WITH AN APPROVED MATERIAL TO RESIST THE FREE PASSAGE OF FLAME AND PRODUCTS OF COMBUSTION. THE MATERIAL FILLING THIS ANNULAR SPACE SHALL NOT BE REQUIRED TO MEET THE ASTM E 136 REQUIREMENTS.
6. FIREBLOCKING OF CORNICES OF A TWO-FAMILY DWELLING IS REQUIRED AT THE LINE OF DWELLING UNIT SEPARATION.
7. WITHIN CONCEALED SPACES OF EXTERIOR WALL FINISH AND OTHER EXTERIOR ARCHITECTURAL ELEMENTS WHERE PERMITTED TO BE COMBUSTIBLE CONSTRUCTION PER CBC SECTION 1406, OR WHERE ERECTED WITH COMBUSTIBLE FRAMES AT MAXIMUM INTERVALS OF 20 FEET, SO THAT THERE WILL BE NO OPEN SPACE EXCEEDING 100 SQUARE FEET PER CBC SECTION 717.26
8. WHERE WOOD FURRING STRIPS ARE USED, THEY SHALL BE ON AN APPROVED WOOD OF NATURAL DECAY RESISTANCE OR PRESERVATIVE-TREATED WOOD. IF CONTINUOUS, SUCH ELEMENTS SHALL HAVE CLOSED ENDS, WITH 4-INCH MINIMUM SEPARATION BETWEEN SECTIONS PER CBC SECTION 717.2.6

EXCEPTIONS: (PER CBC 717.2.6)

2. FIREBLOCKING SHALL NOT BE REQUIRED WHERE INSTALLED ON NONCOMBUSTIBLE FRAMING AND THE FACE OF THE EXTERIOR WALL FINISH EXPOSED TO THE CONCEALED SPACE IS COVERED BY ONE OF THE FOLLOWING MATERIALS:
 - 2.1 ALUMINUM HAVING A MINIMUM THICKNESS OF 0.019 INCH.
 - 2.2 CORROSION-RESISTANT STEEL HAVING A BASE METAL THICKNESS NOT LESS THAN 0.016 INCH AT ANY POINT.
 - 2.3 OTHER APPROVED NONCOMBUSTIBLE MATERIALS



1 Section AA
1/4" = 1'-0"

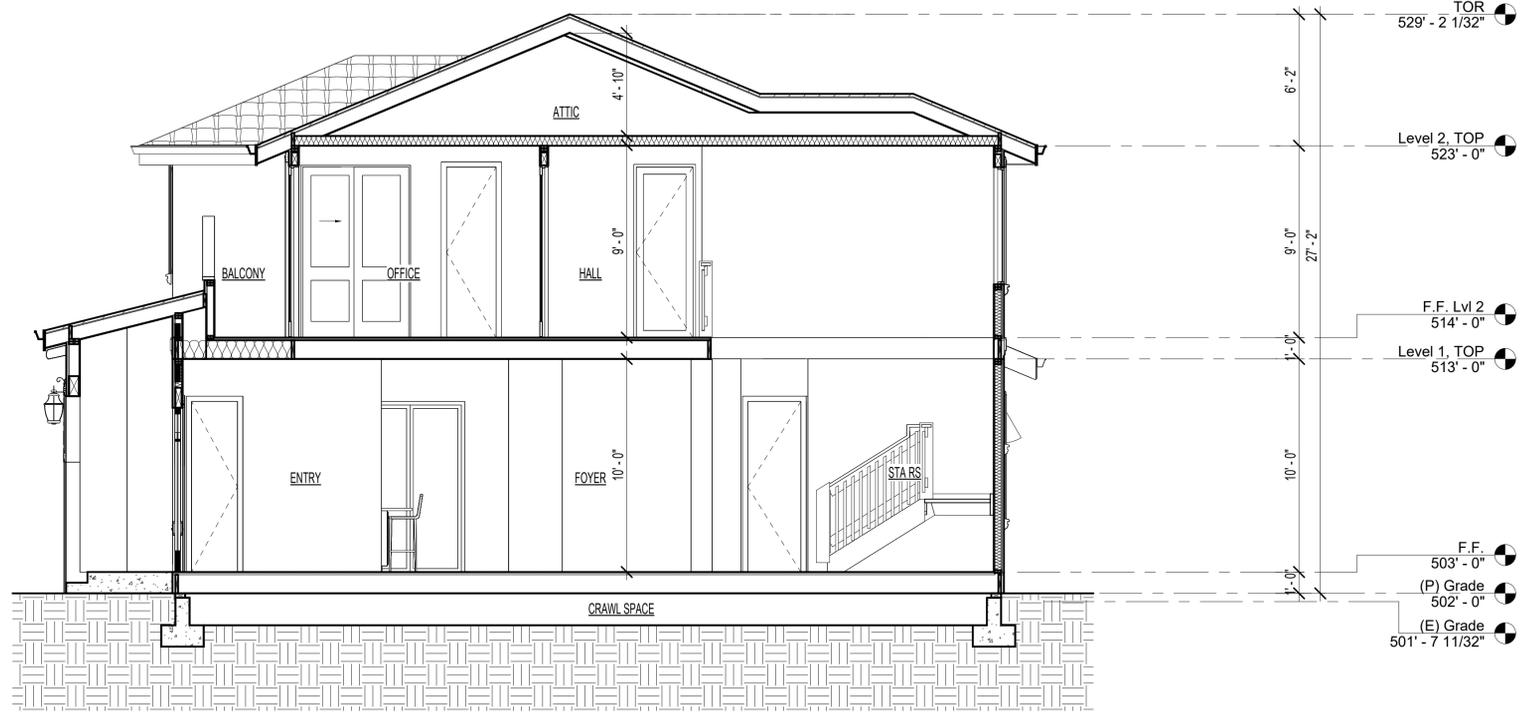

2 Section BB
1/4" = 1'-0"

Sections, Proposed



GORDON K WONG, ARCHITECT, LIC# 34045
KEVIN YU PROJECT REP
7106 MCCLINCY LANE SUITE 108
CAMPBELL, CA 95008 (408) 796-1848
GORDONKWONG@GKWAARCHITECTS.COM KEVINYU@GKWAARCHITECTS.COM



RESIDENCE
14331 Capri Drive
LOS GATOS, CA 95032

| Project Schedule Revision | | |
|---------------------------|------------|-------------|
| # | REV DATE | DESCRIPTION |
| △ | 2024.11.29 | PLANNING |
| △ | 2024.06.08 | PLANNING |
| △ | 2024.09.11 | PLANNING |
| △ | 2025.01.08 | PLANNING |
| △ | 2025.04.30 | PLANNING |

Sections, Proposed

A300

SCALE 1/4" = 1'-0"

5/14/2025 4:18:40 PM

*This Page
Intentionally
Left Blank*